


Distribution of the legally required concentration ratios of radioactive carbon (C-14) in tanks* for storing water treated with multi-nuclide removal equipment

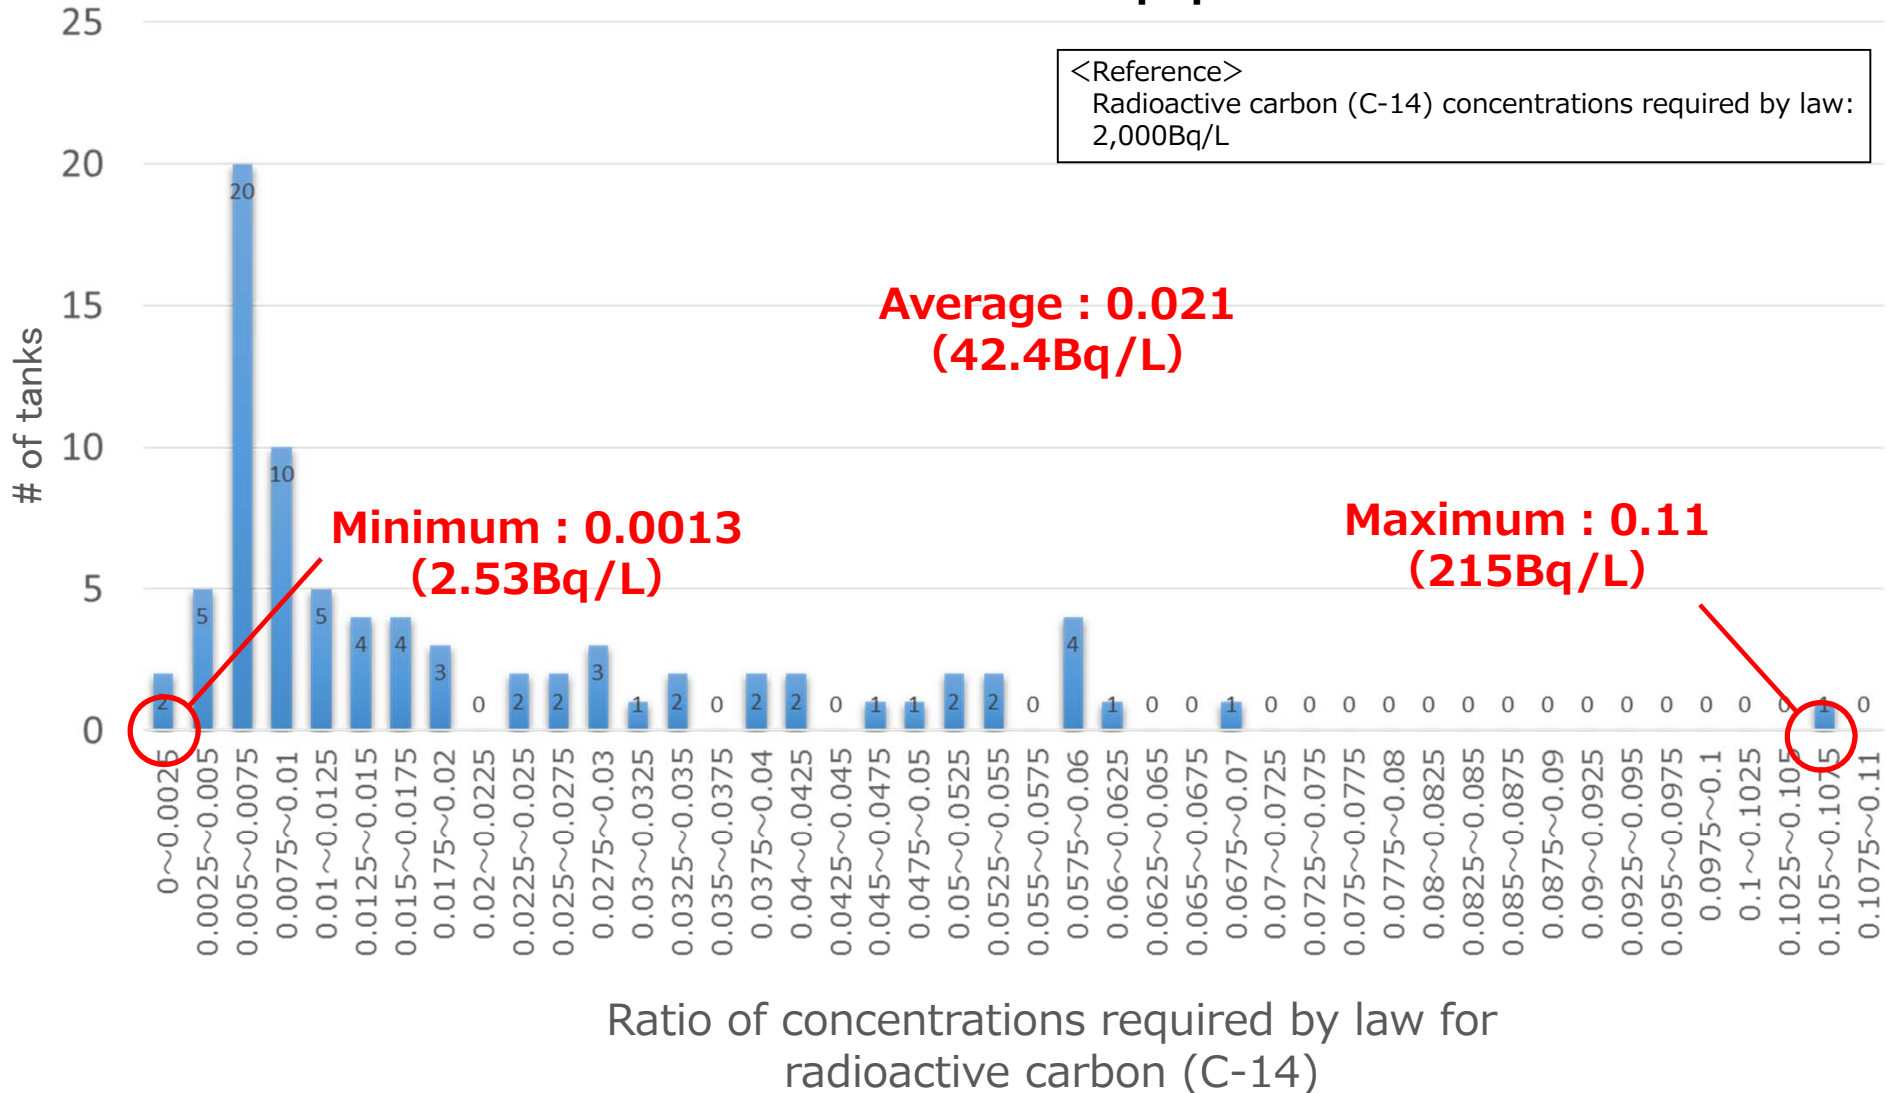

*Tanks for which analysis of radioactive carbon (C-14) has been conducted (as of the end of June, 2020, 80 tanks in total)