
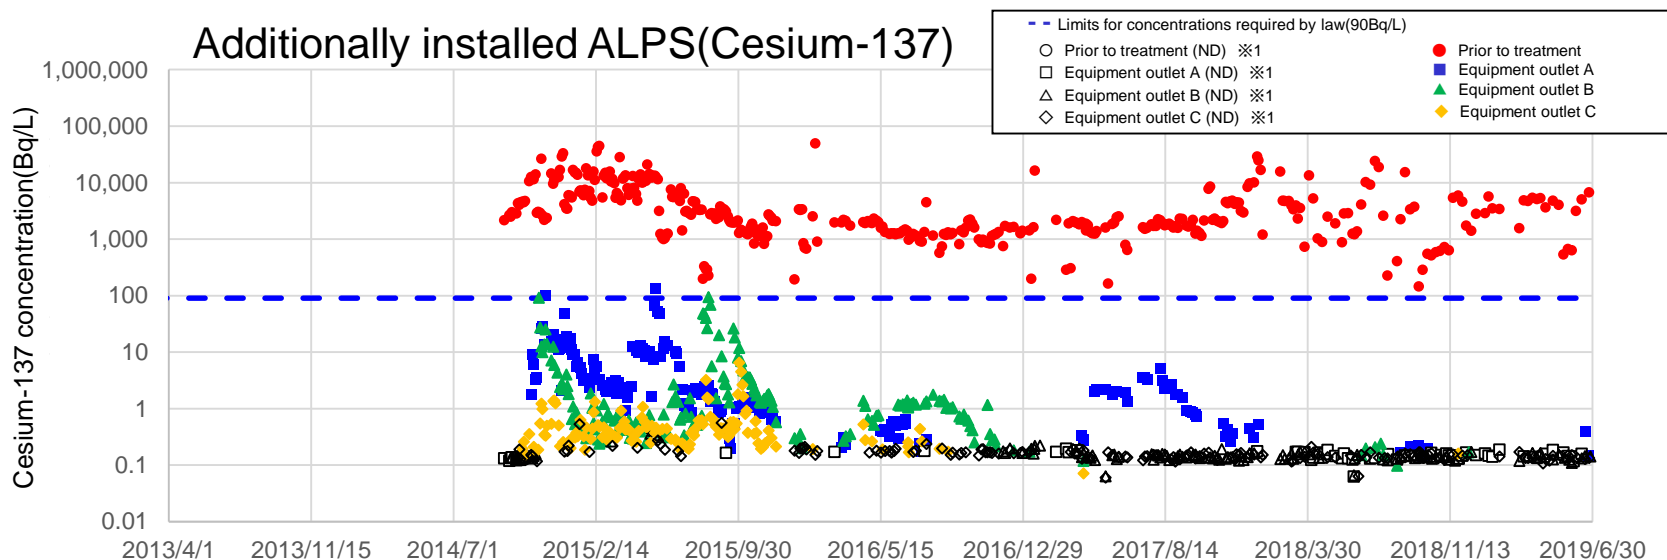



Radiation concentrations measured
at the multi-nuclide removal equipment (ALPS)
outlet (as of June 30, 2019)

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cesium-137 concentration)

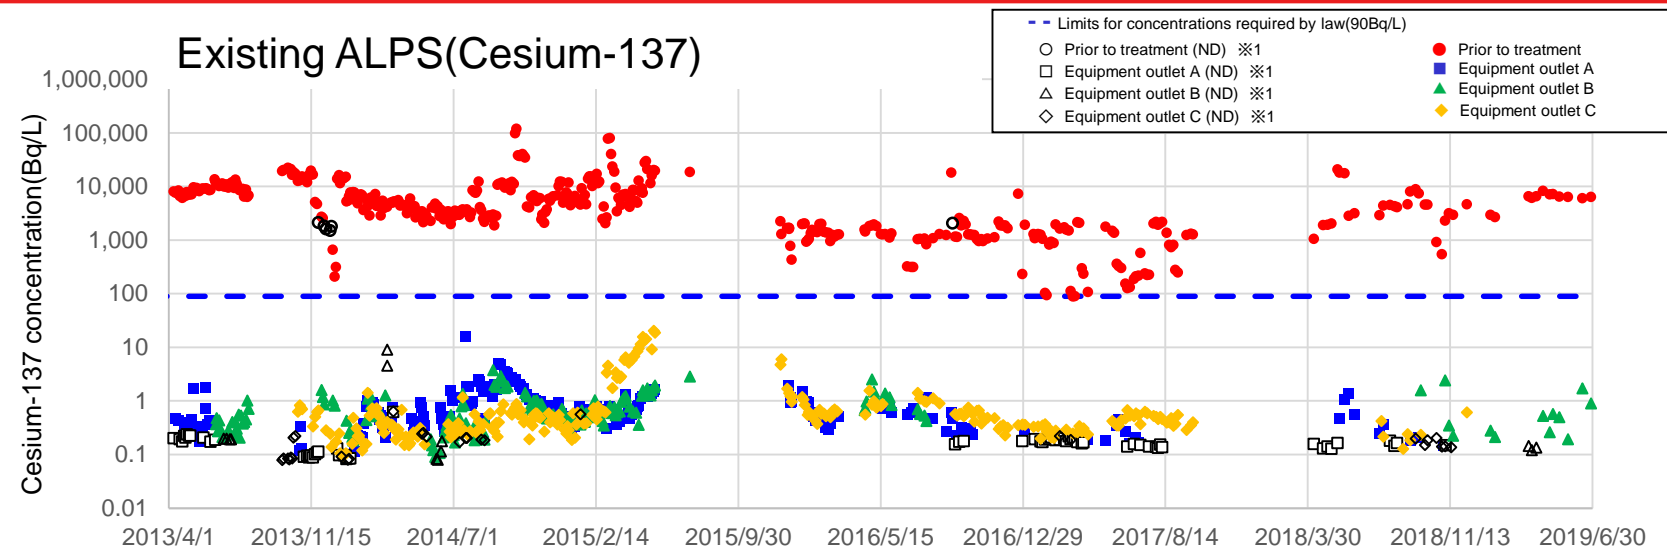


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cesium-137 concentration)

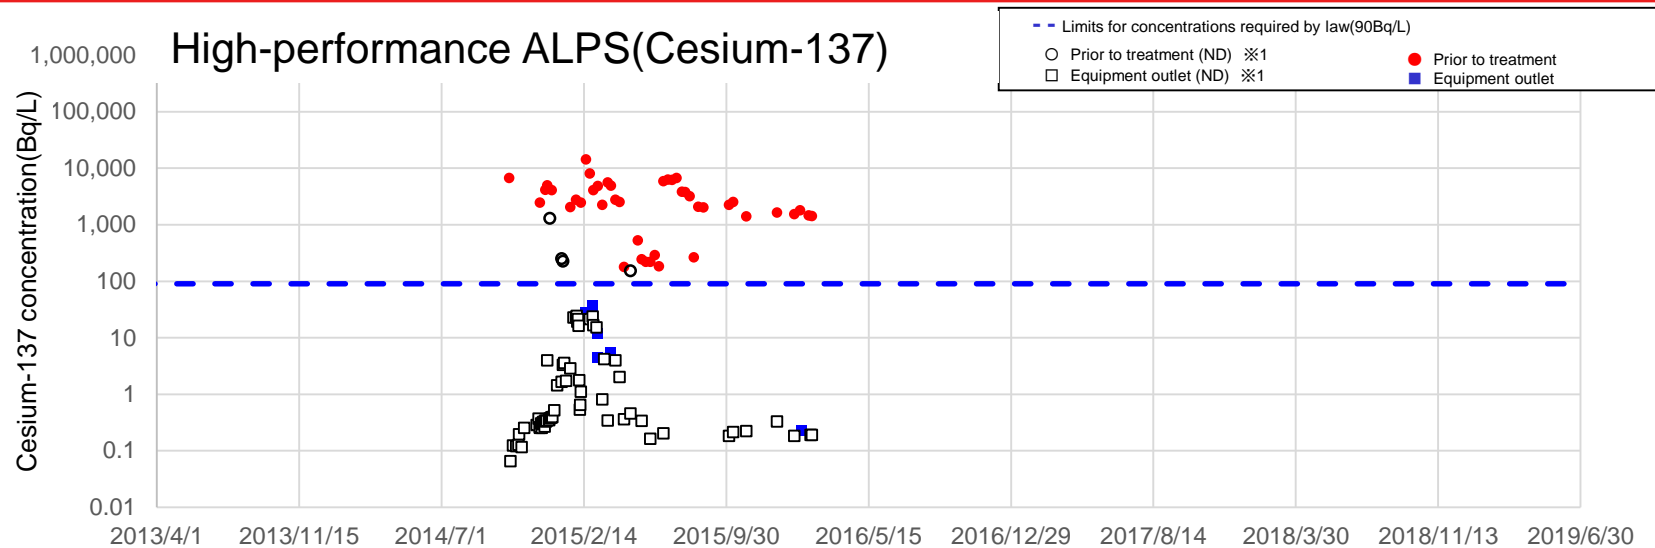


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cesium-134 concentration)

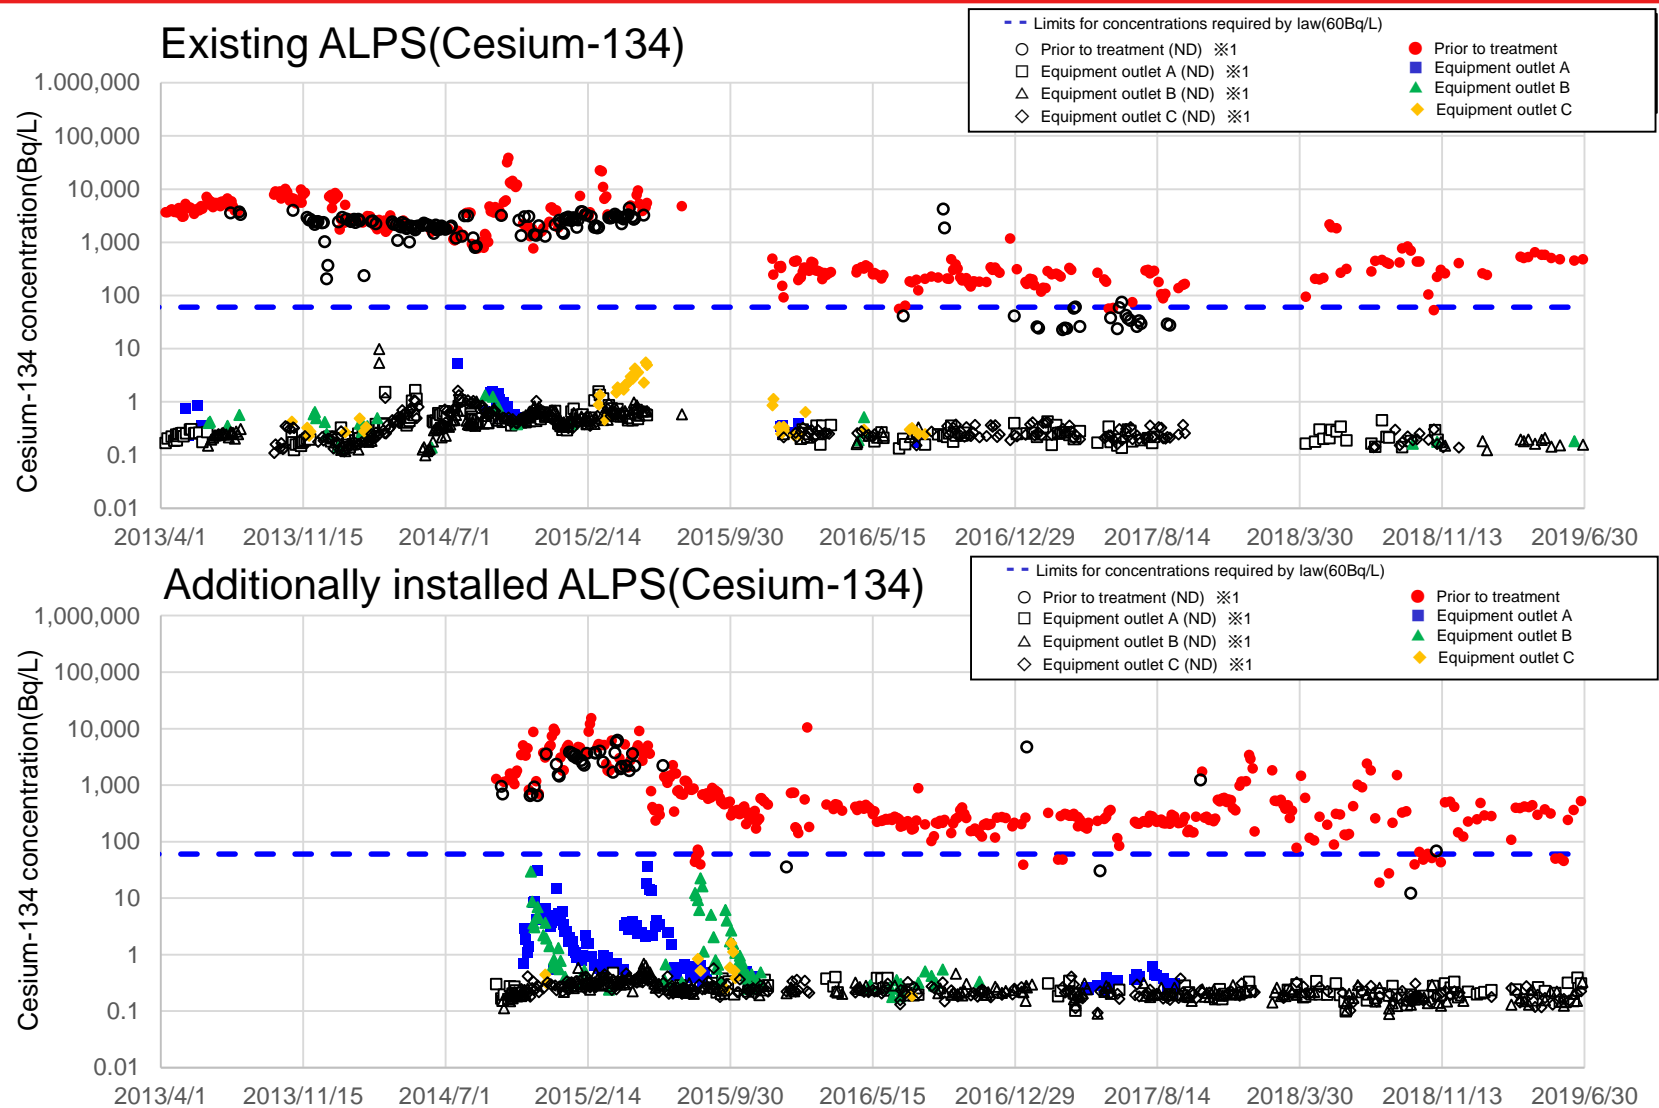

※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cesium-134 concentration)

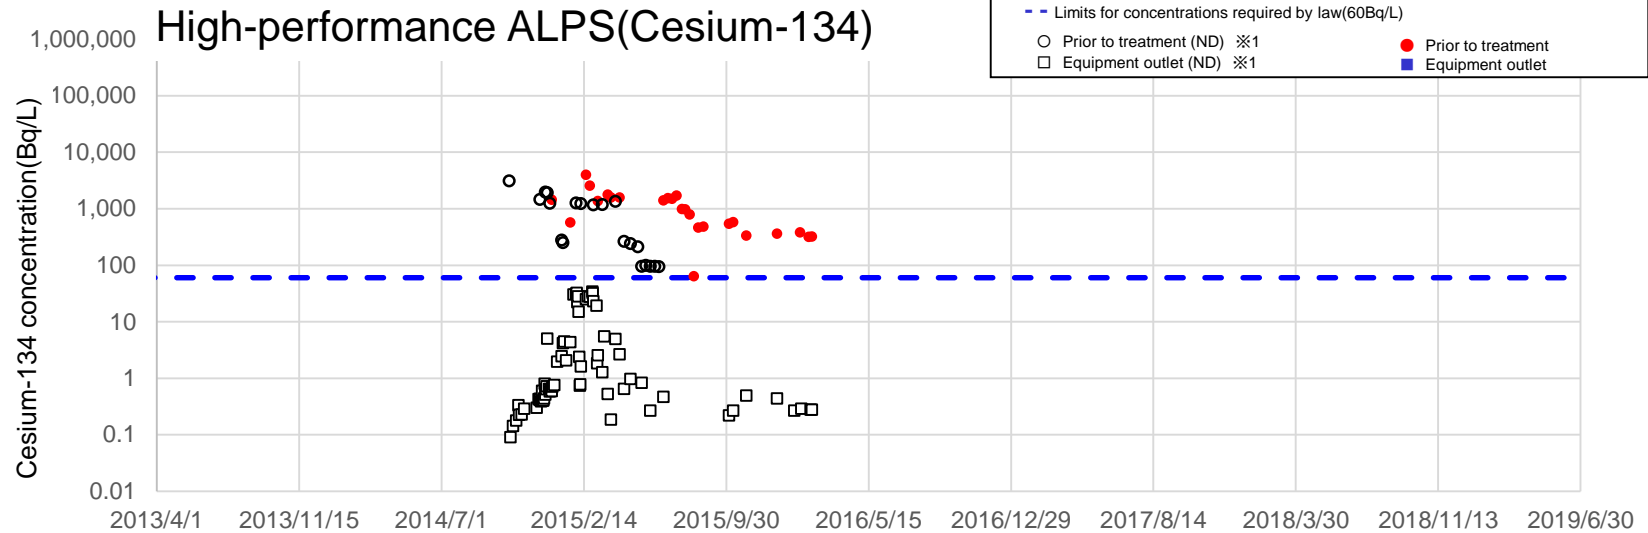


※ 1 “ND” means that concentrations were below detectable limits.

TEPCO




Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Strontium-90 concentration)

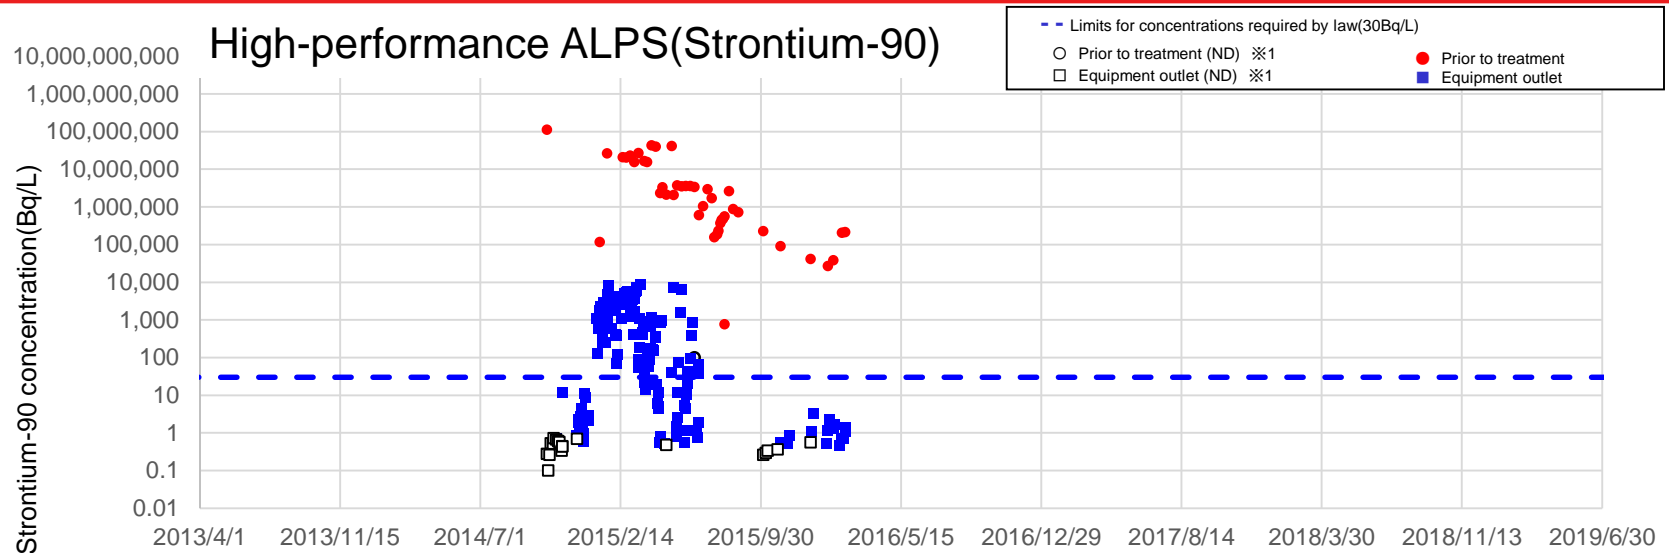


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cobalt-60 concentration)

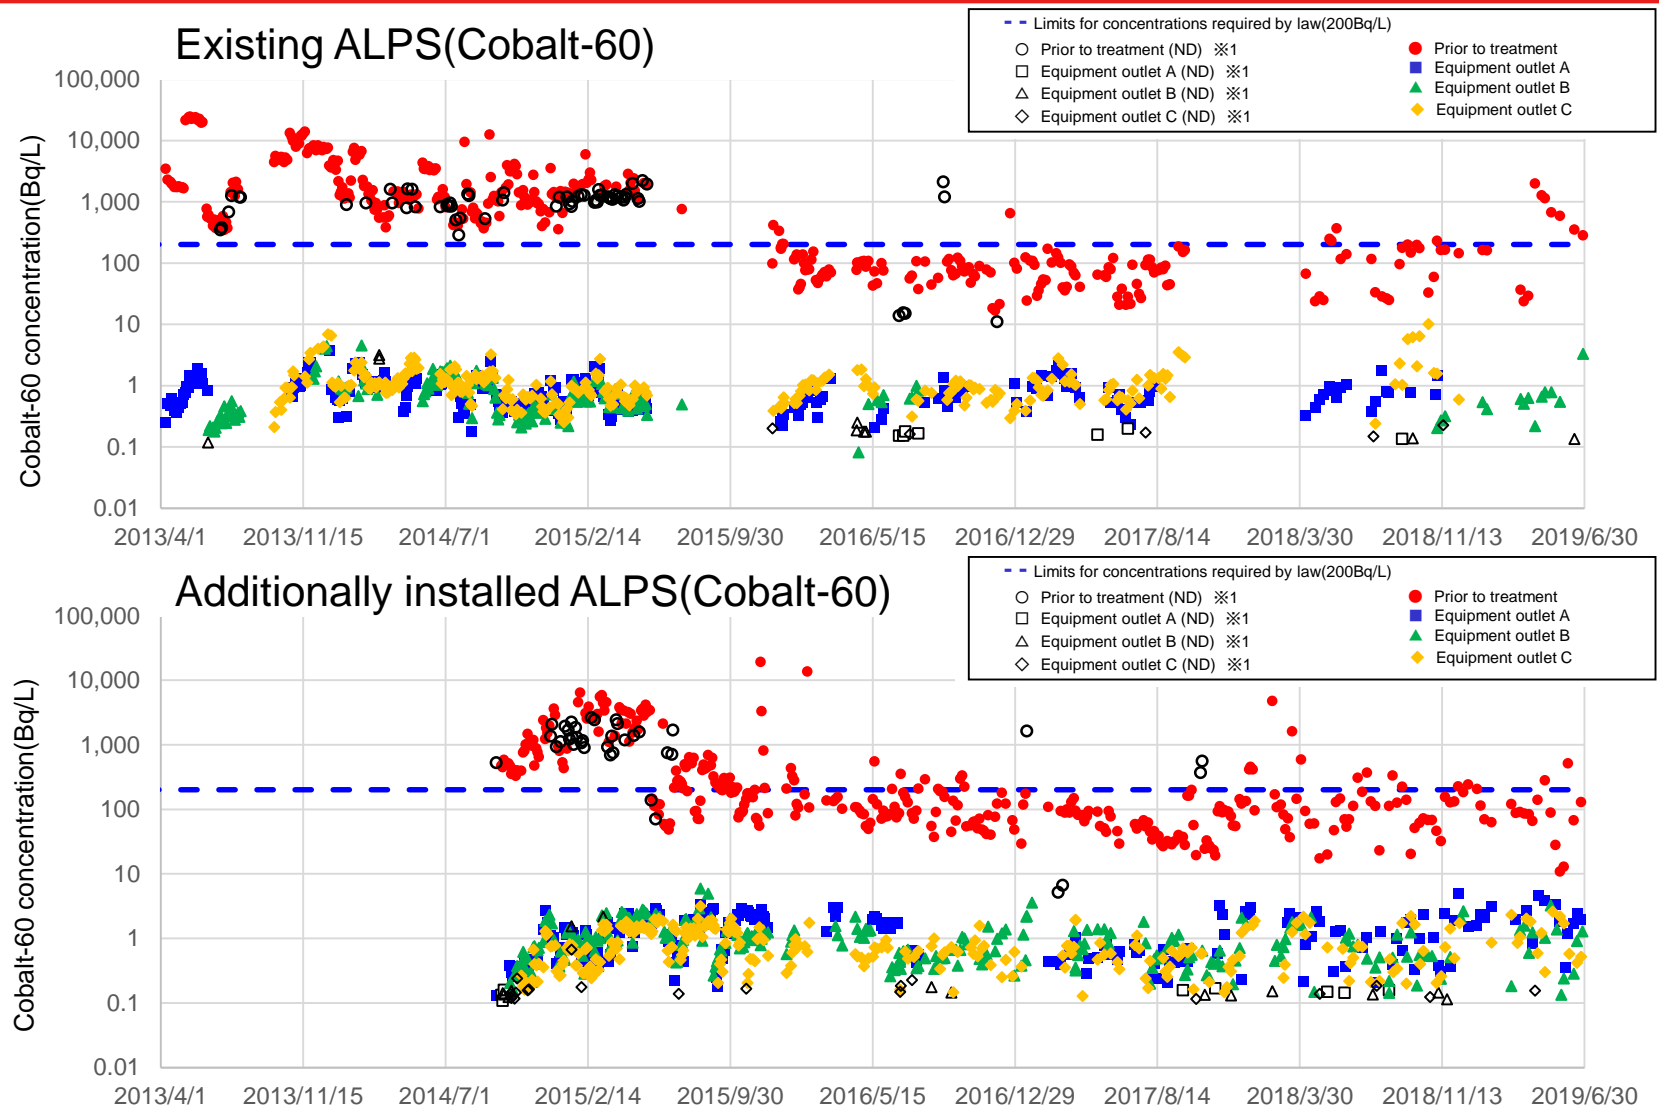


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Cobalt-60 concentration)

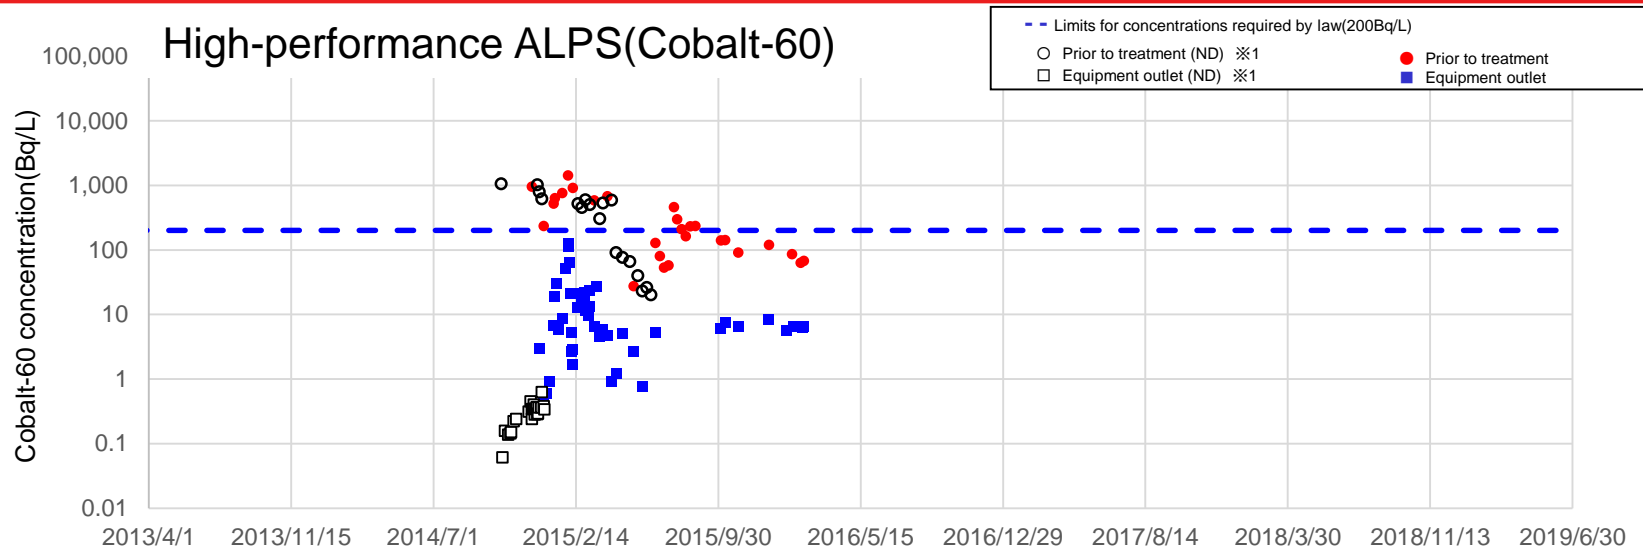


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Antimony-125 concentration)

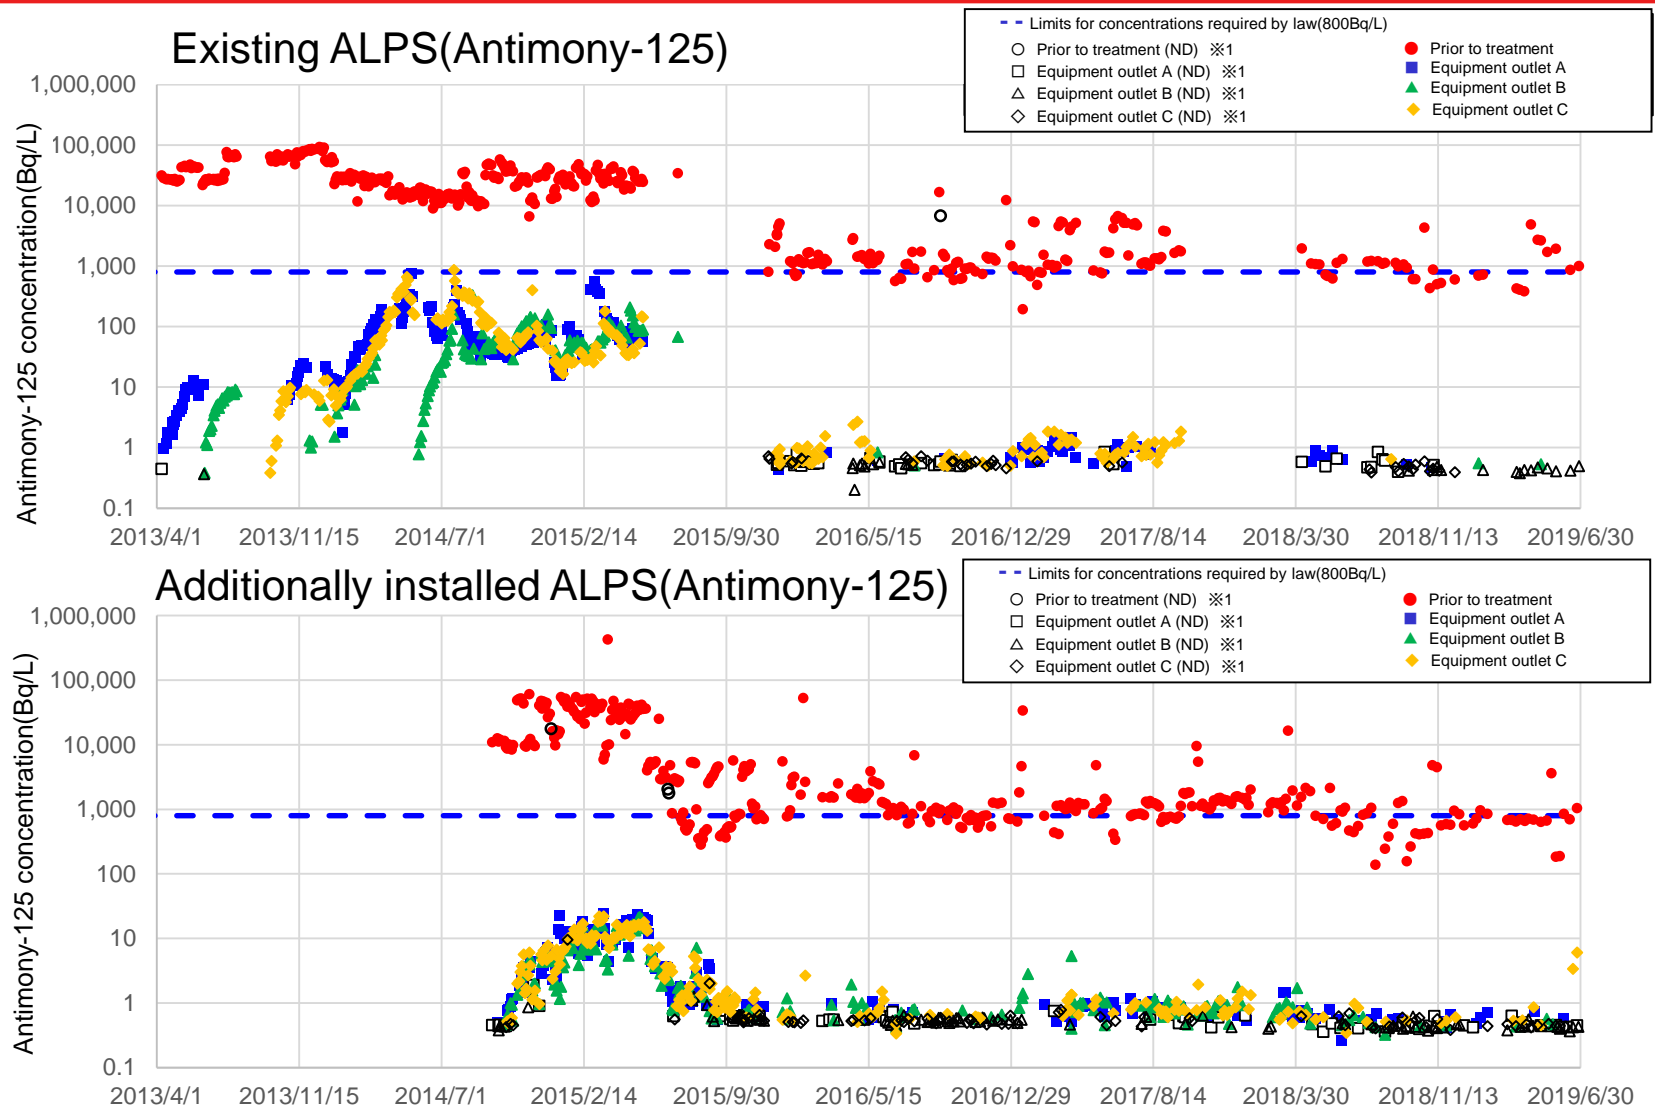


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Antimony-125 concentration)

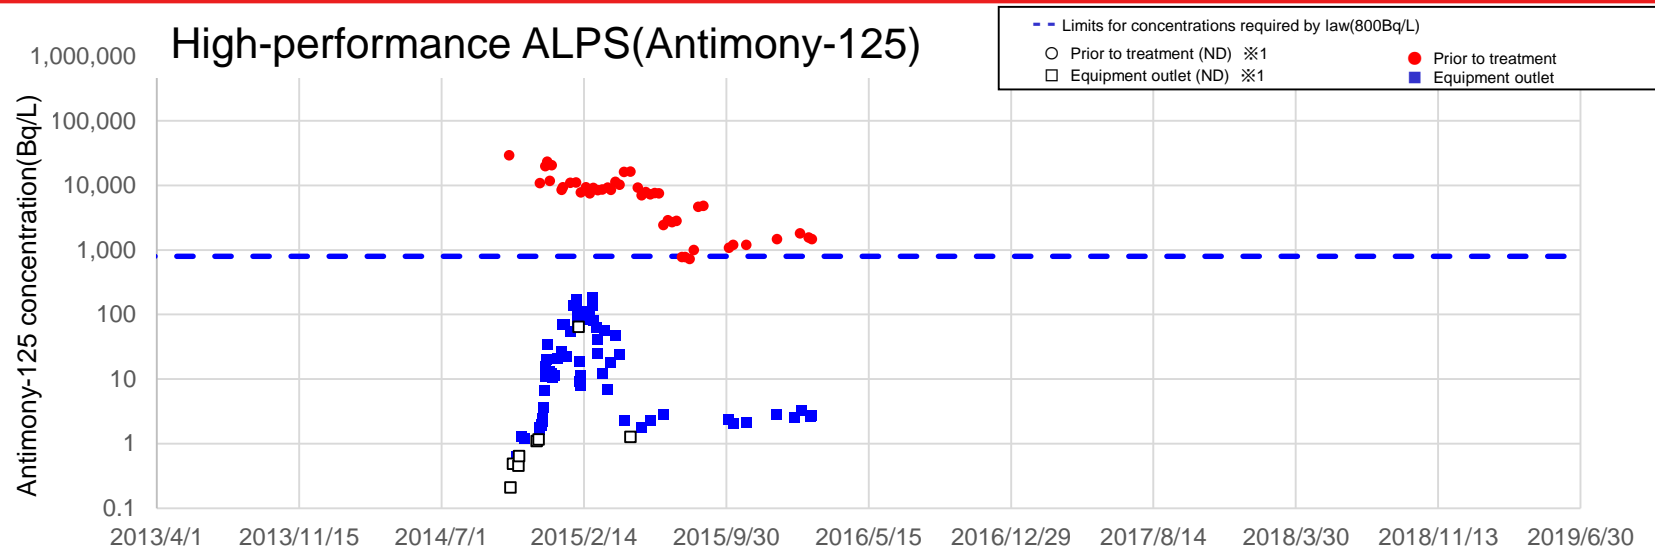


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Ruthenium-106 concentration)

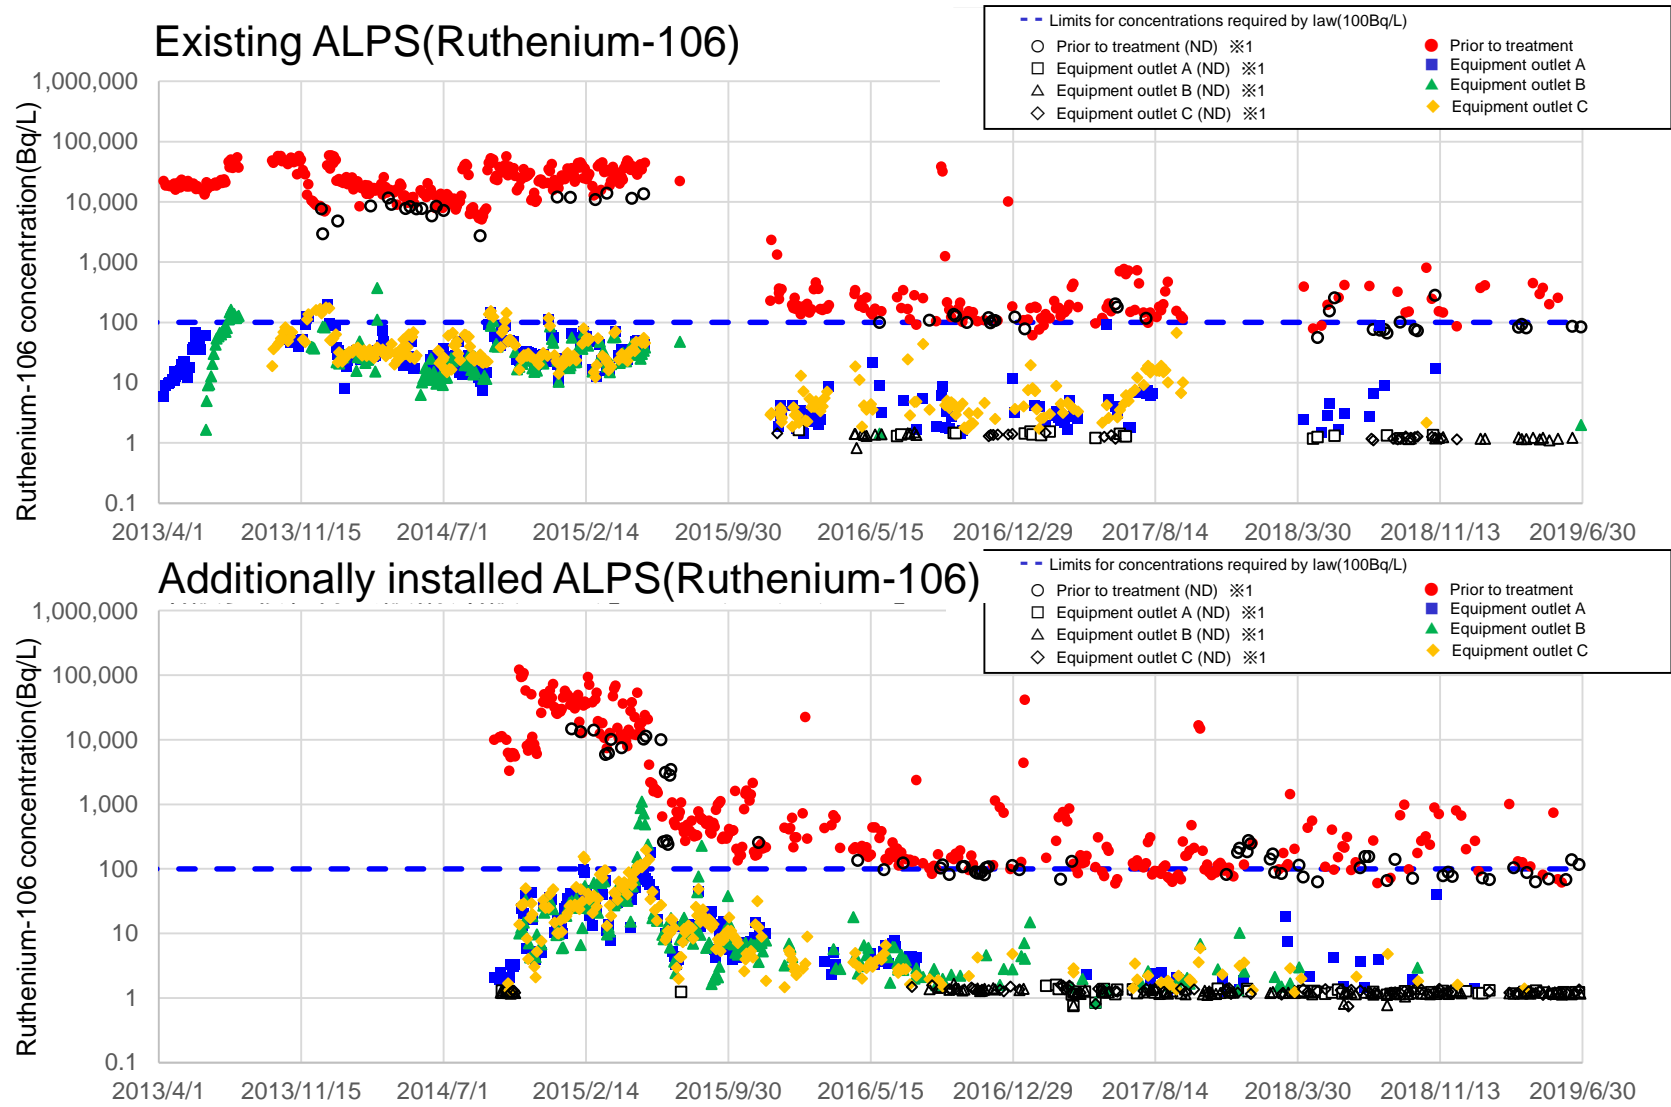


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Ruthenium-106 concentration)

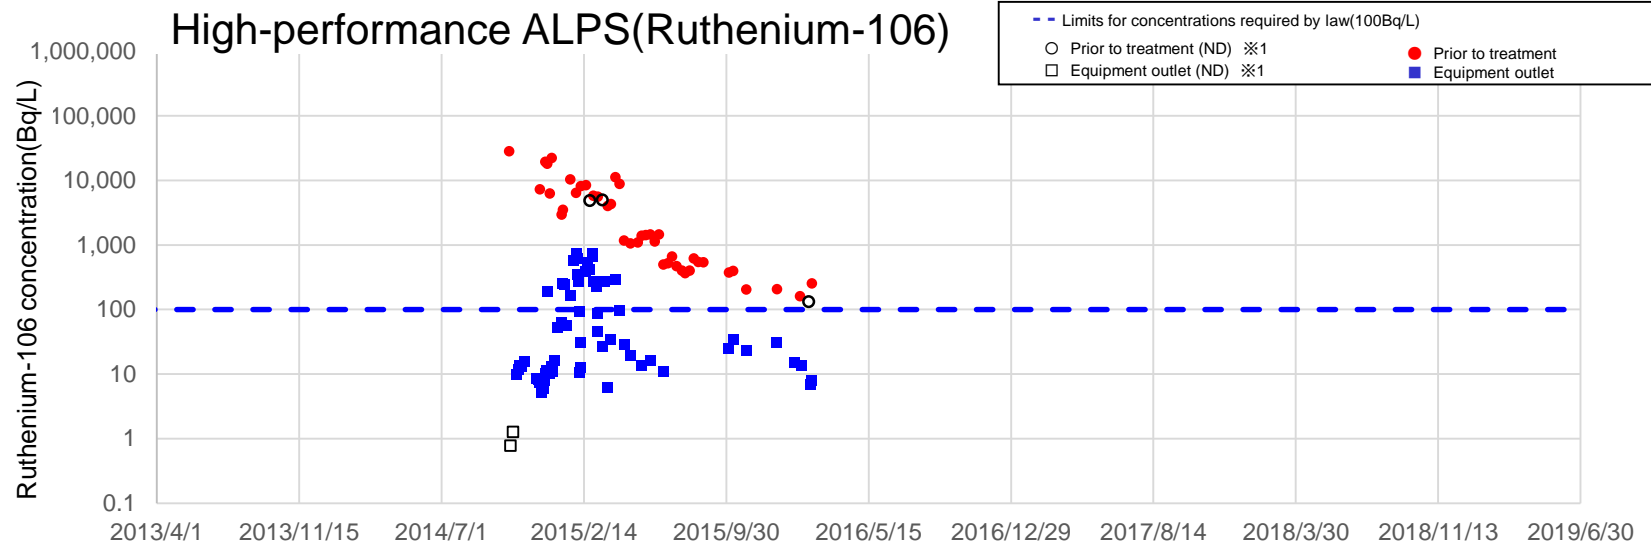


⌘ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Iodine-129 concentration)

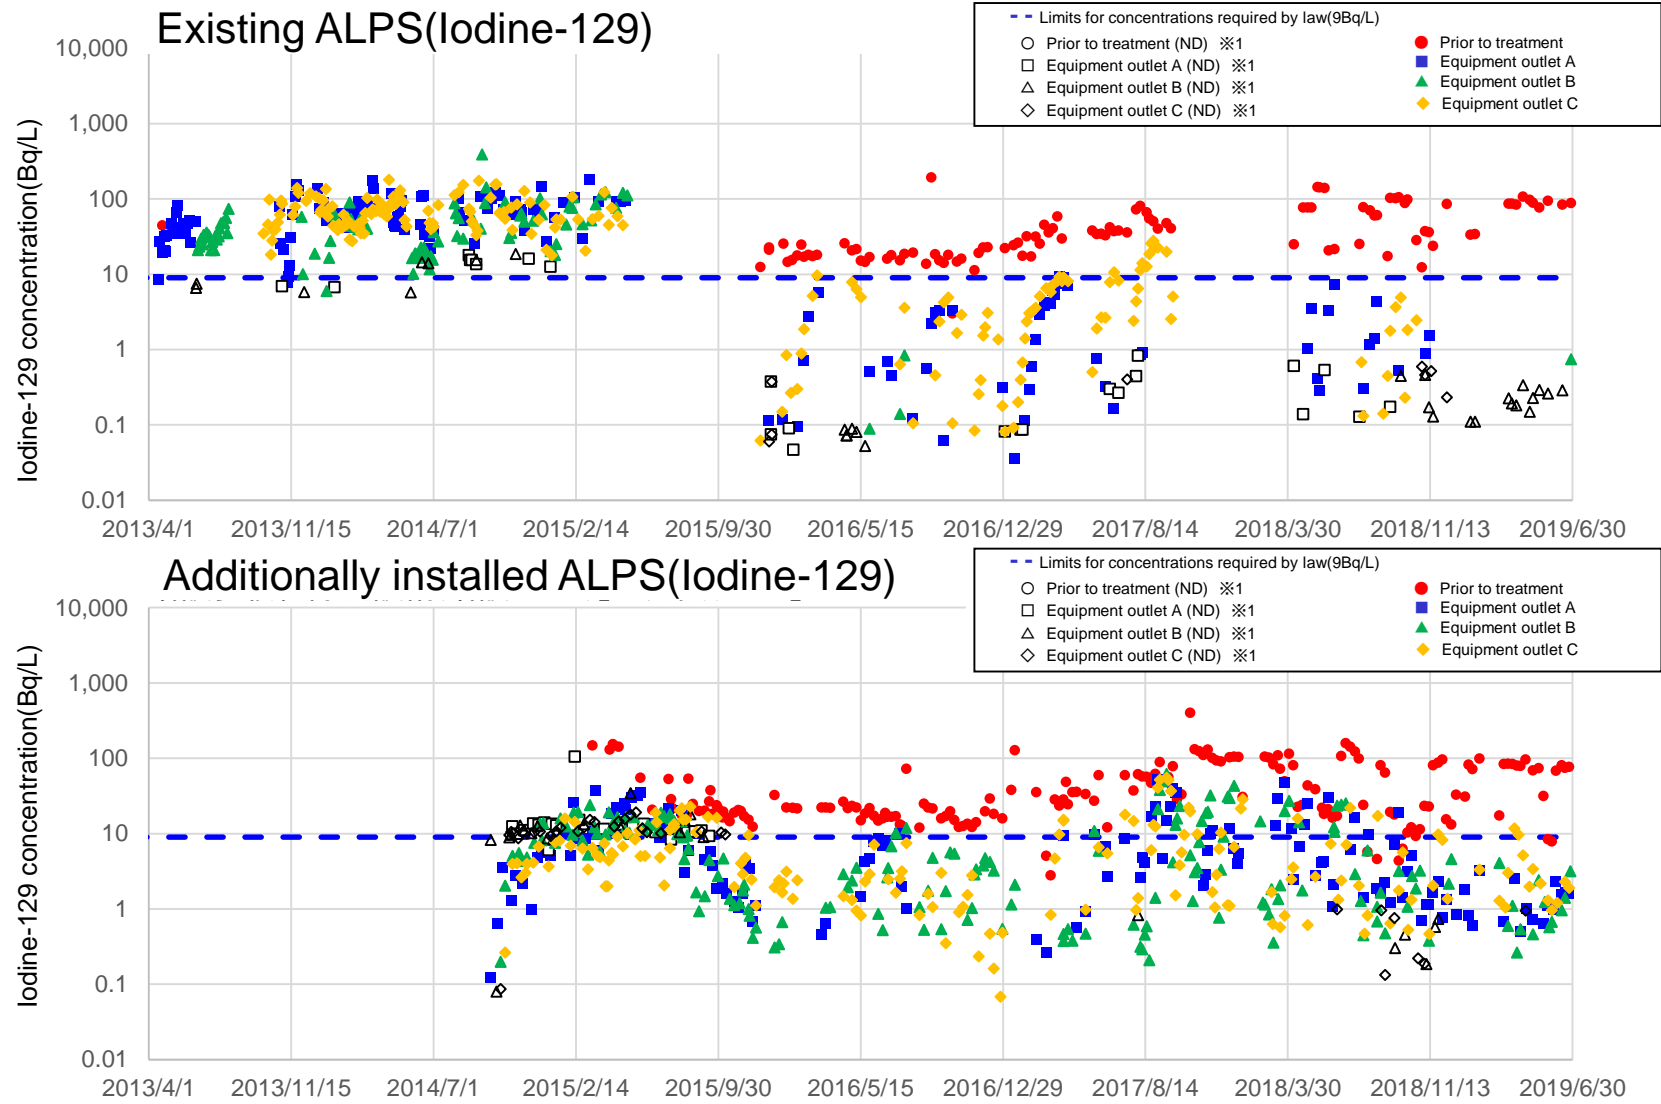


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Iodine-129 concentration)

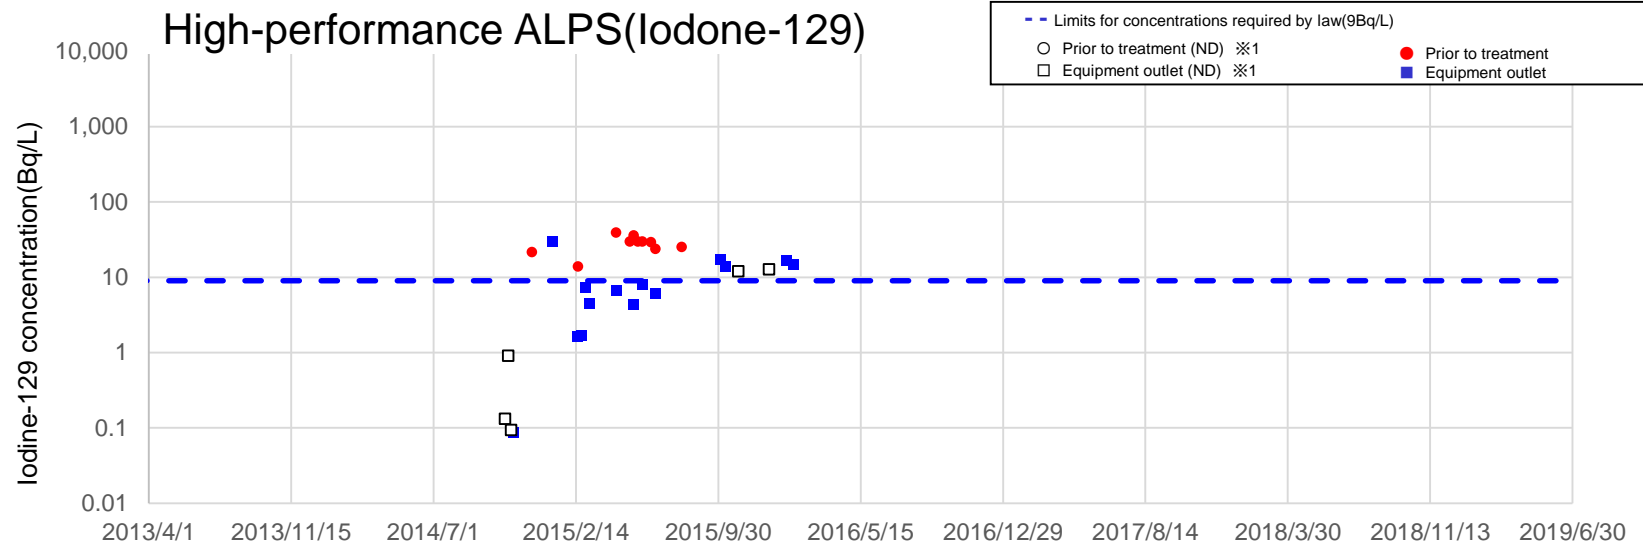


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (All β concentration)

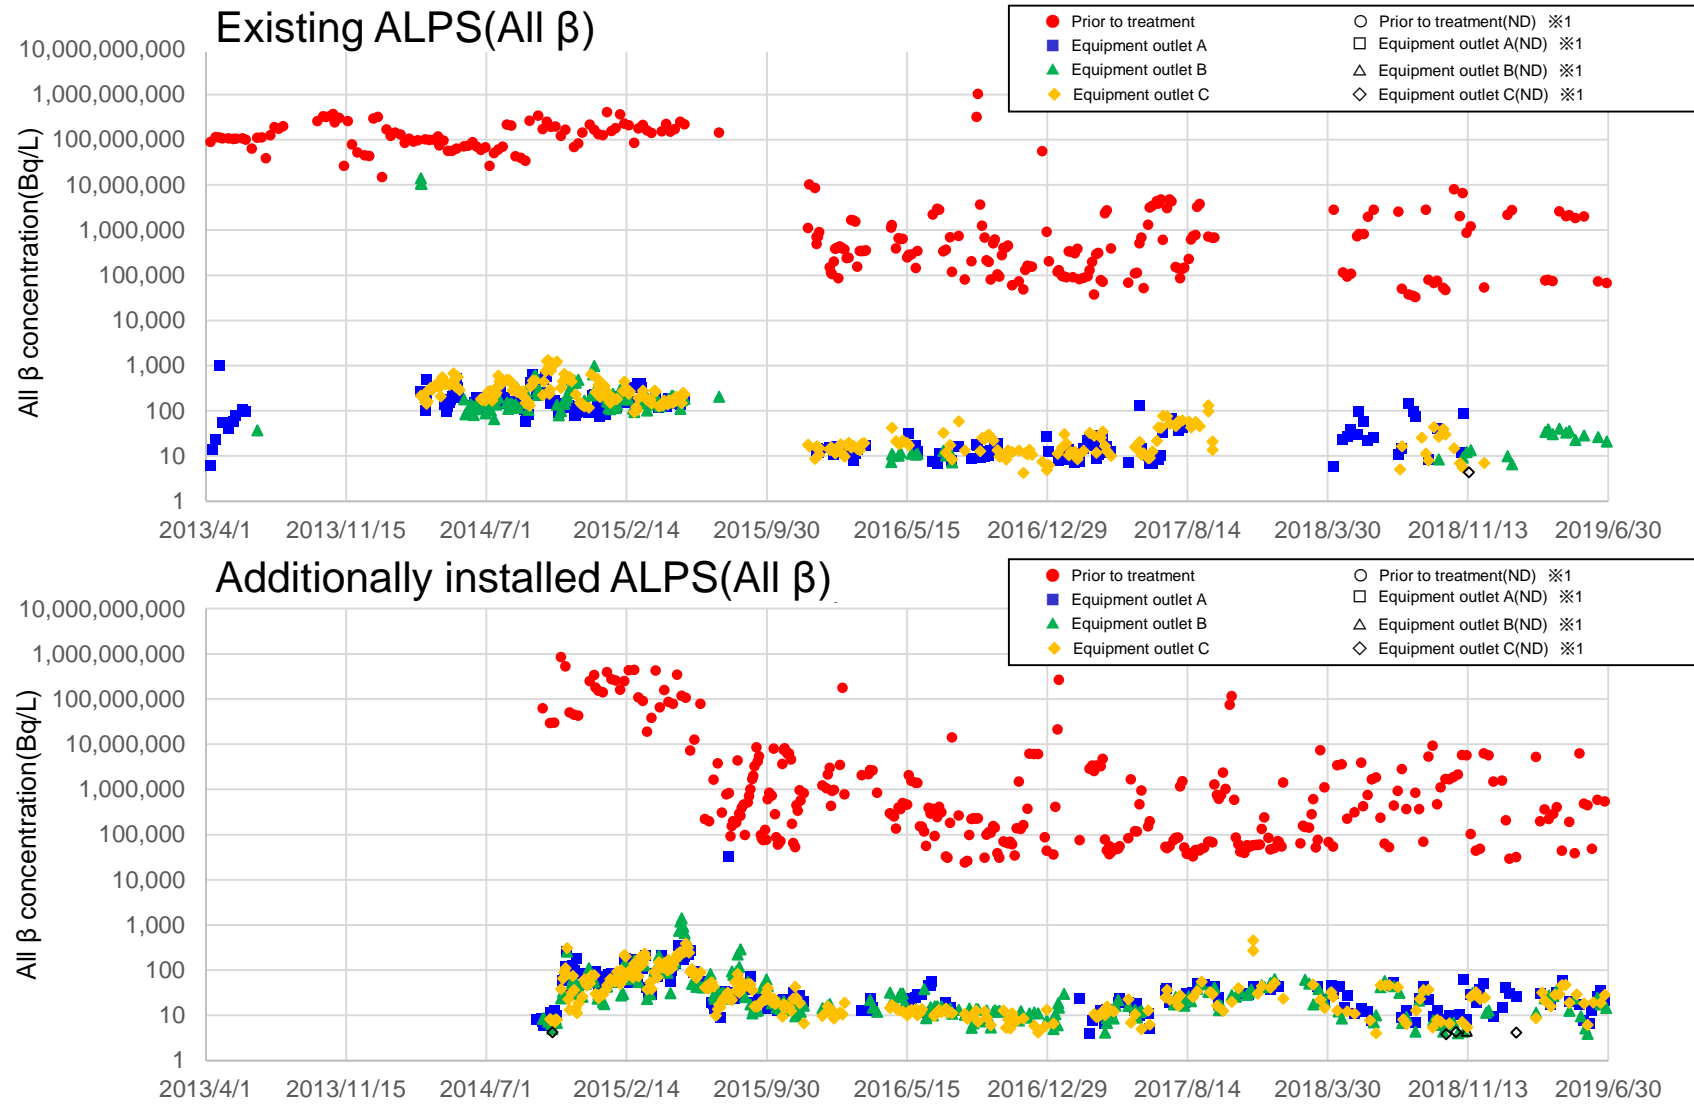



※1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (All β concentration)

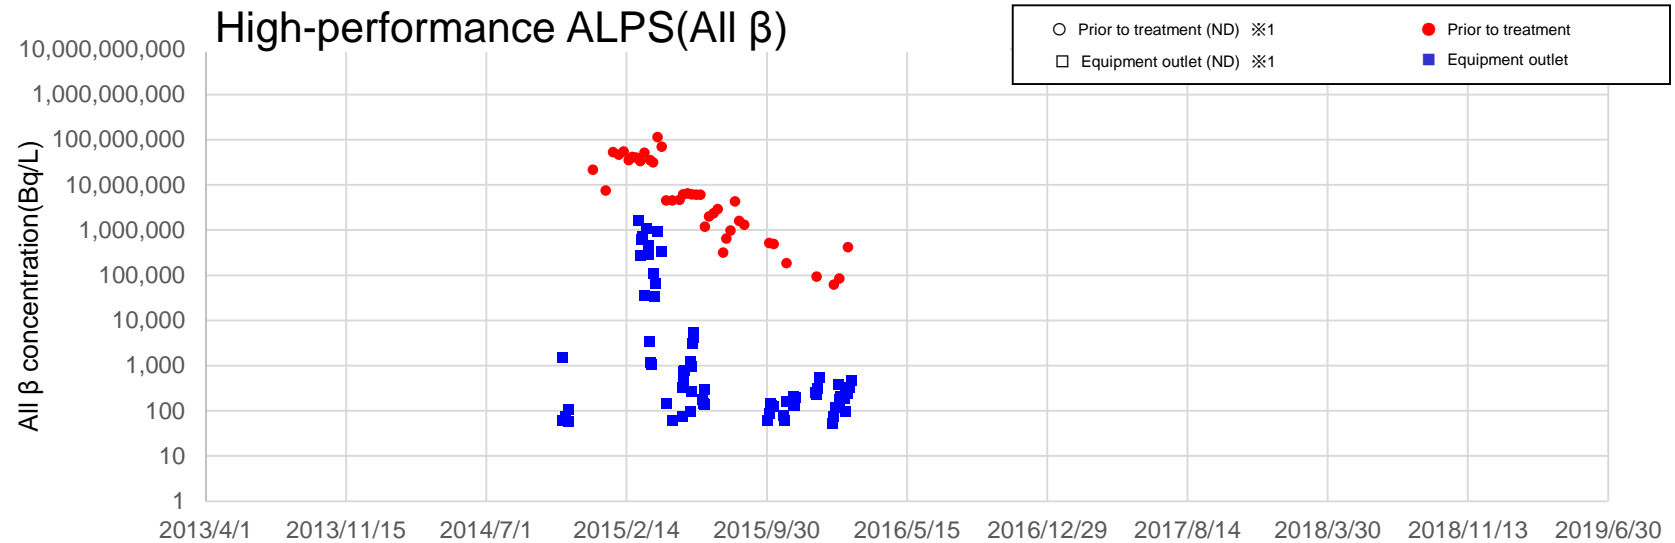


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Manganese-54 concentration)

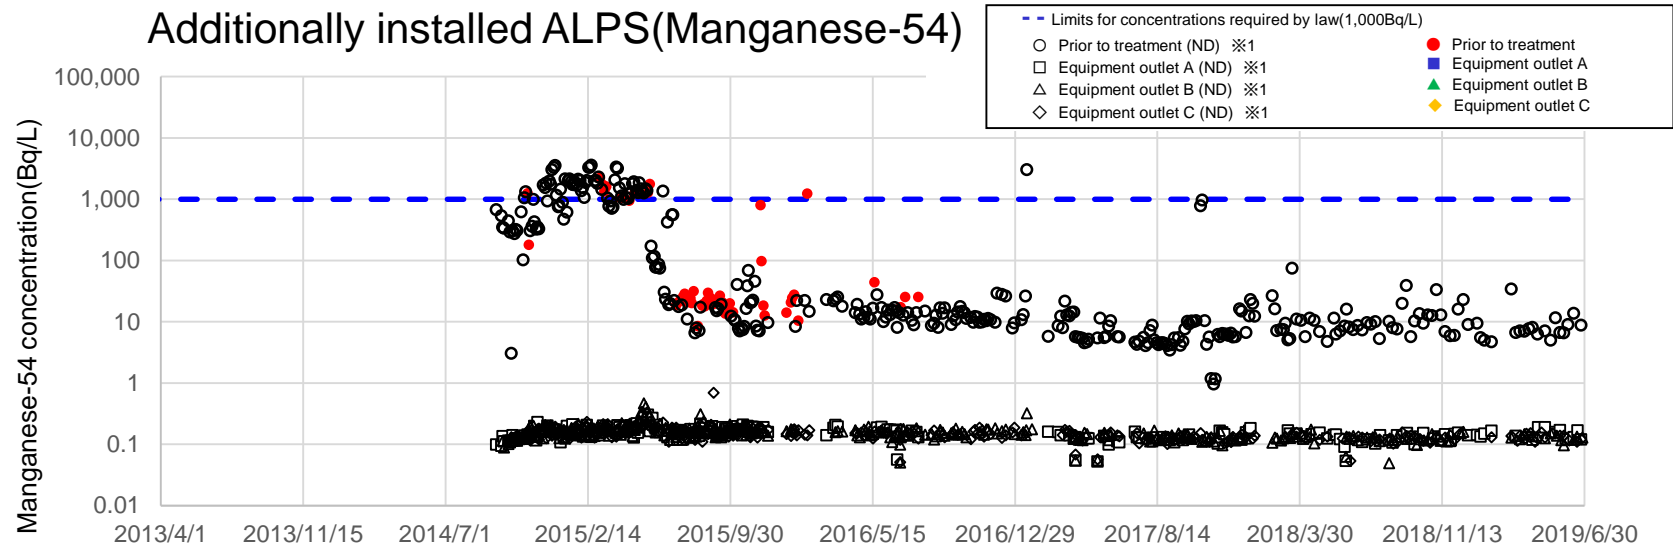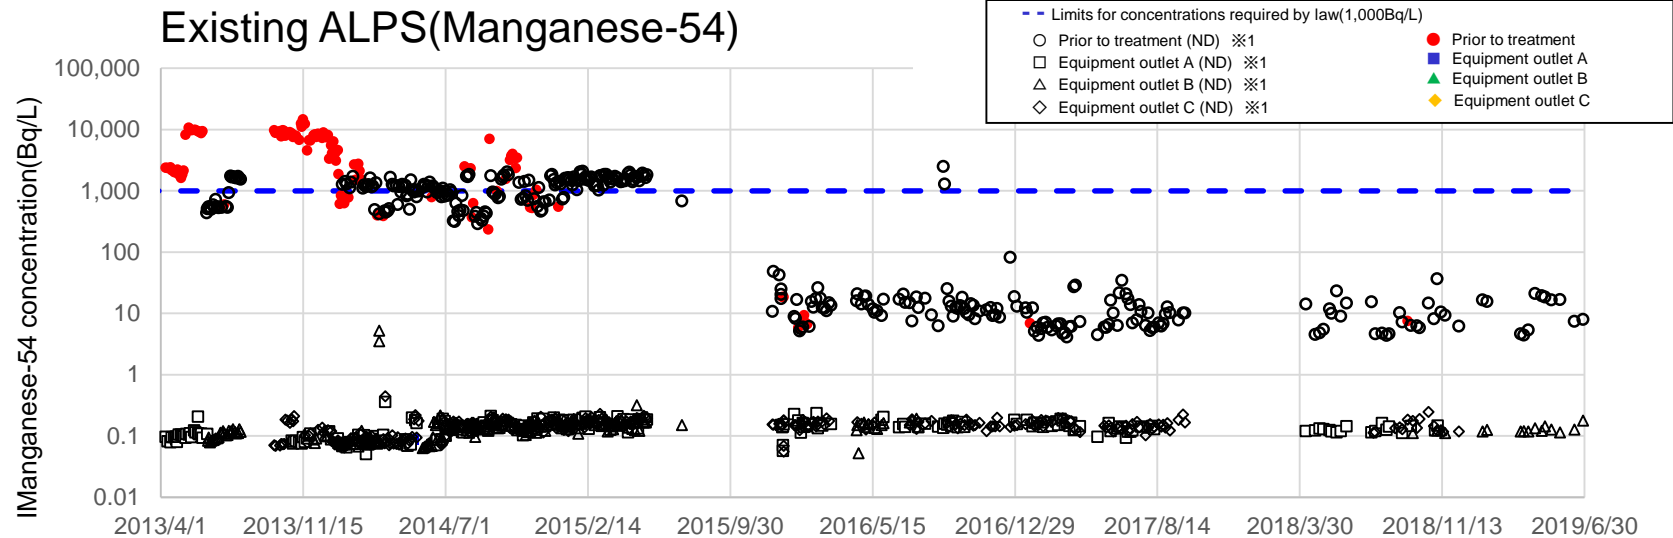



※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Manganese-54 concentration)

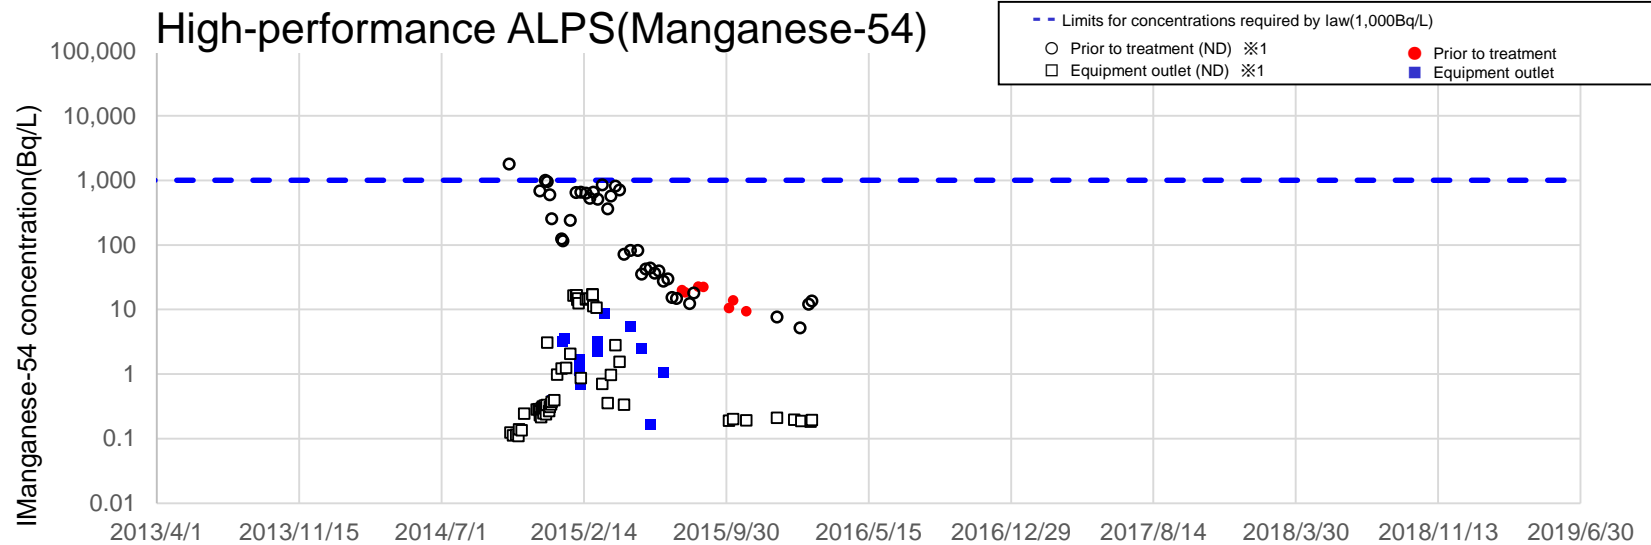


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Strontium-89 concentration)

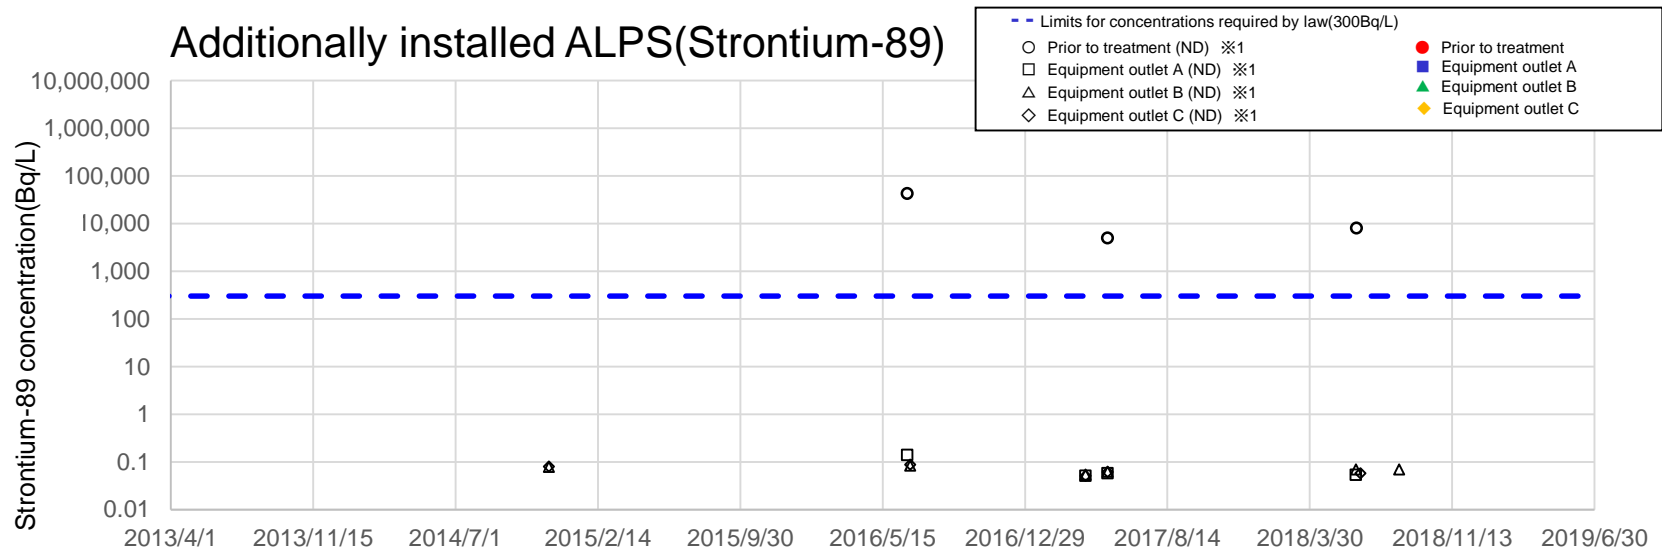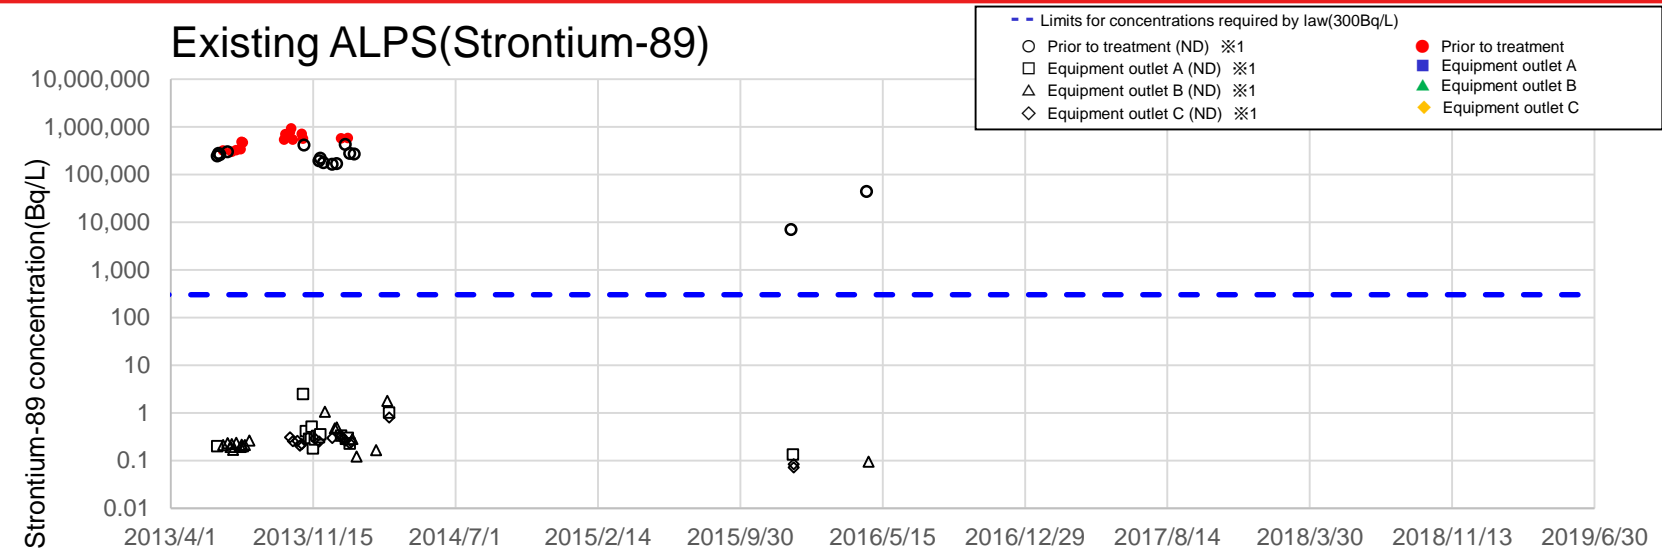



※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Strontium-89 concentration)

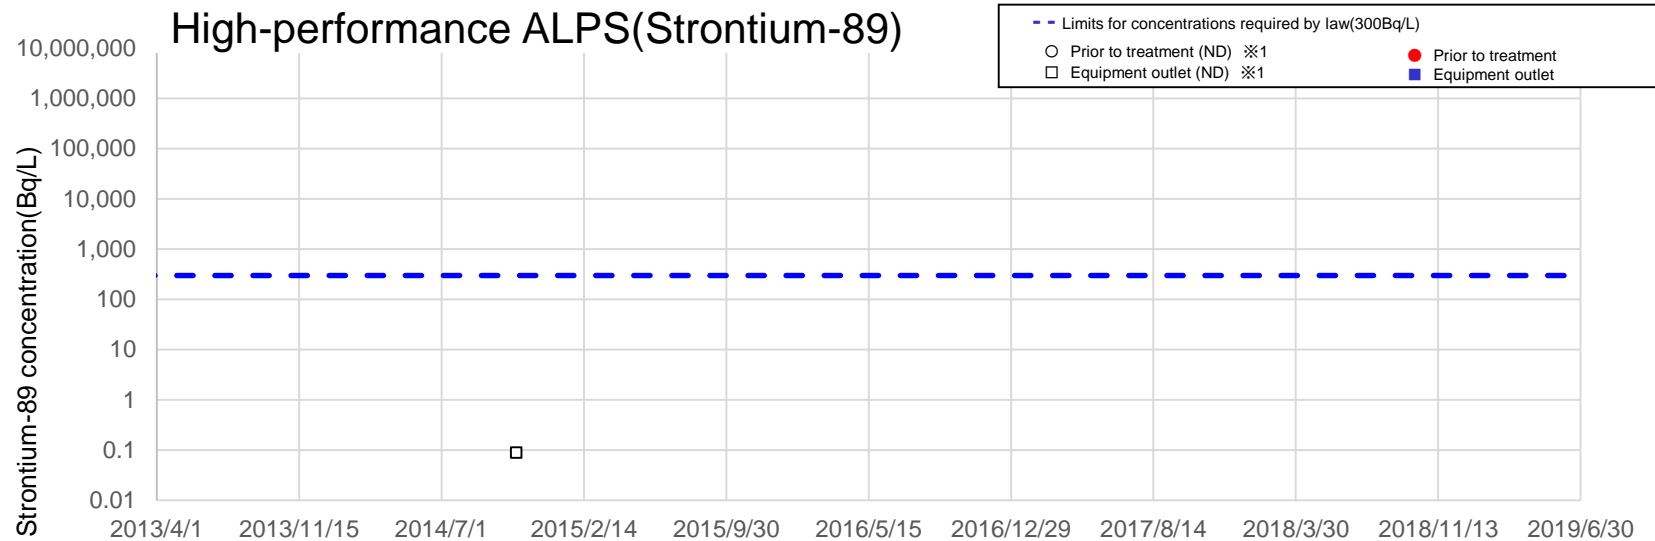


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Technetium-99 concentration)

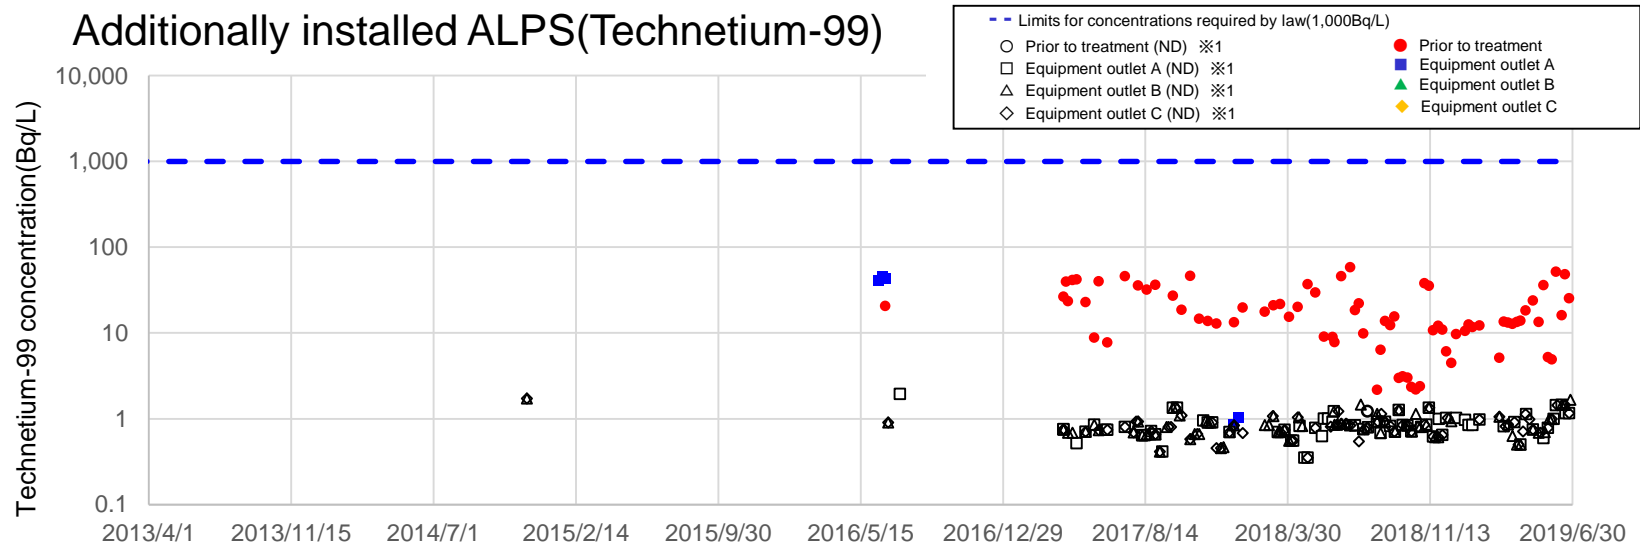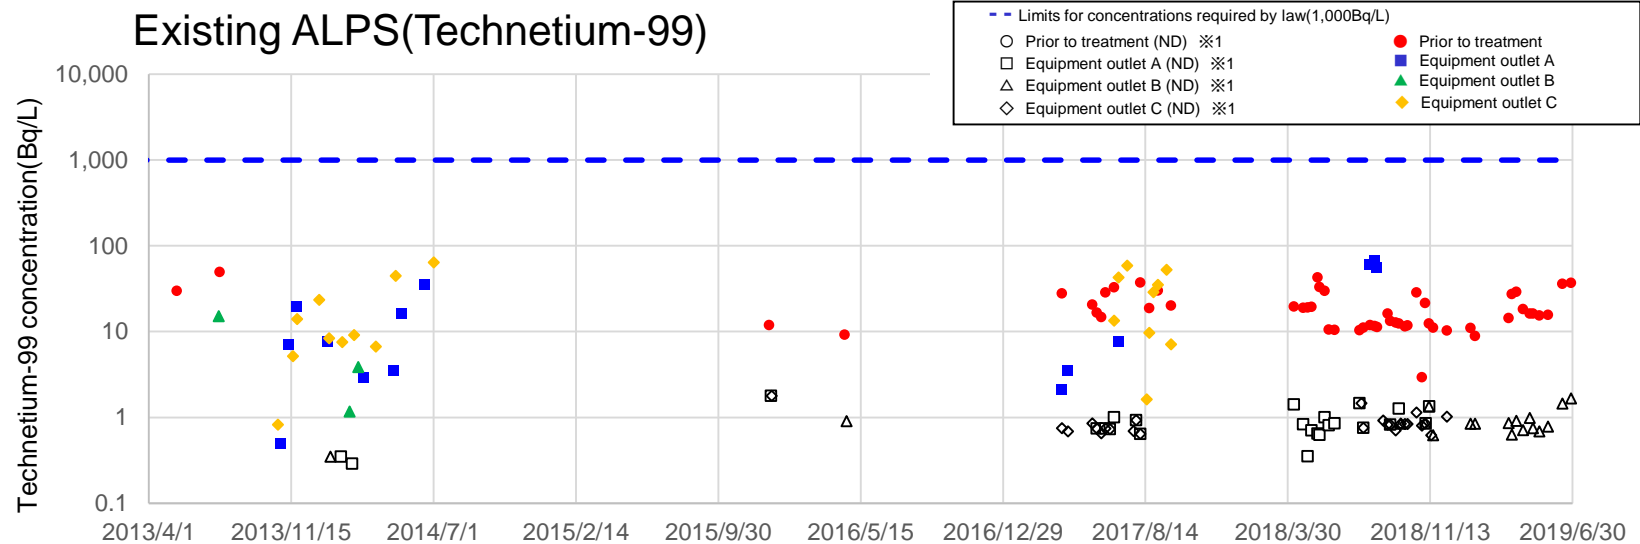

※ 1 “ND” means that concentrations were below detectable limits.


Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Technetium-99 concentration)

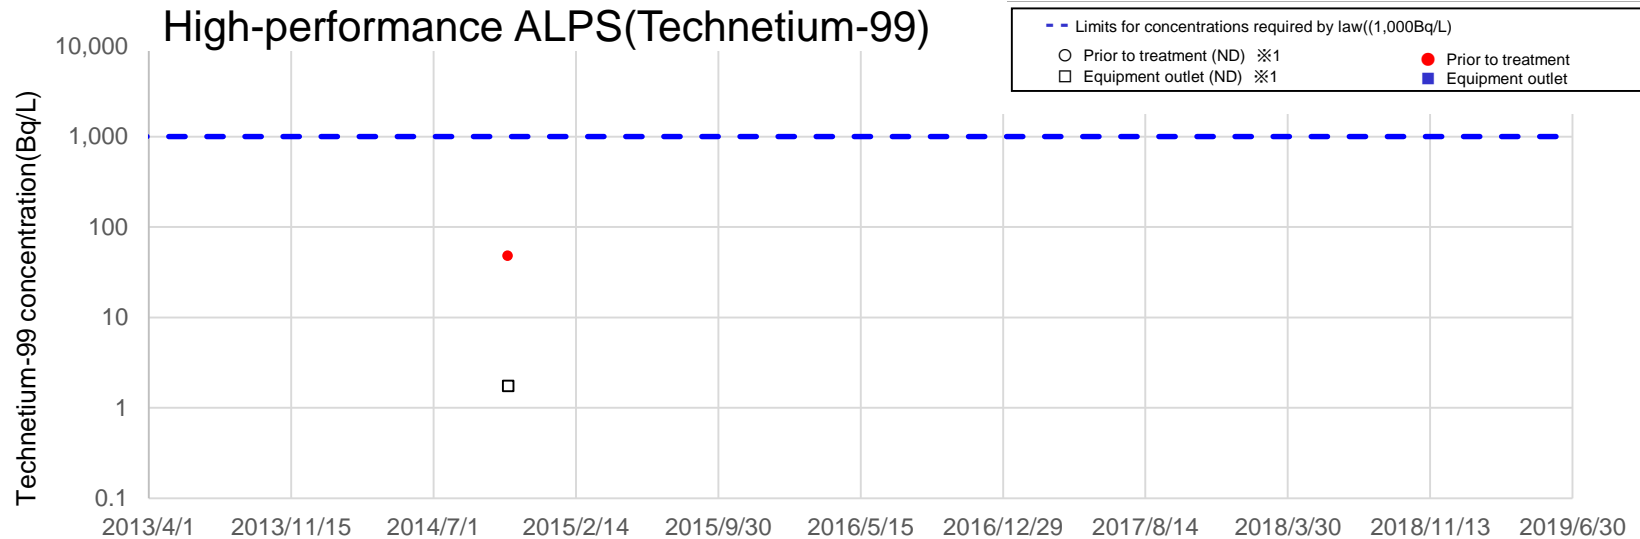

※ 1 “ND” means that concentrations were below detectable limits.


Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Rhodium-106 concentration)

TEPCO

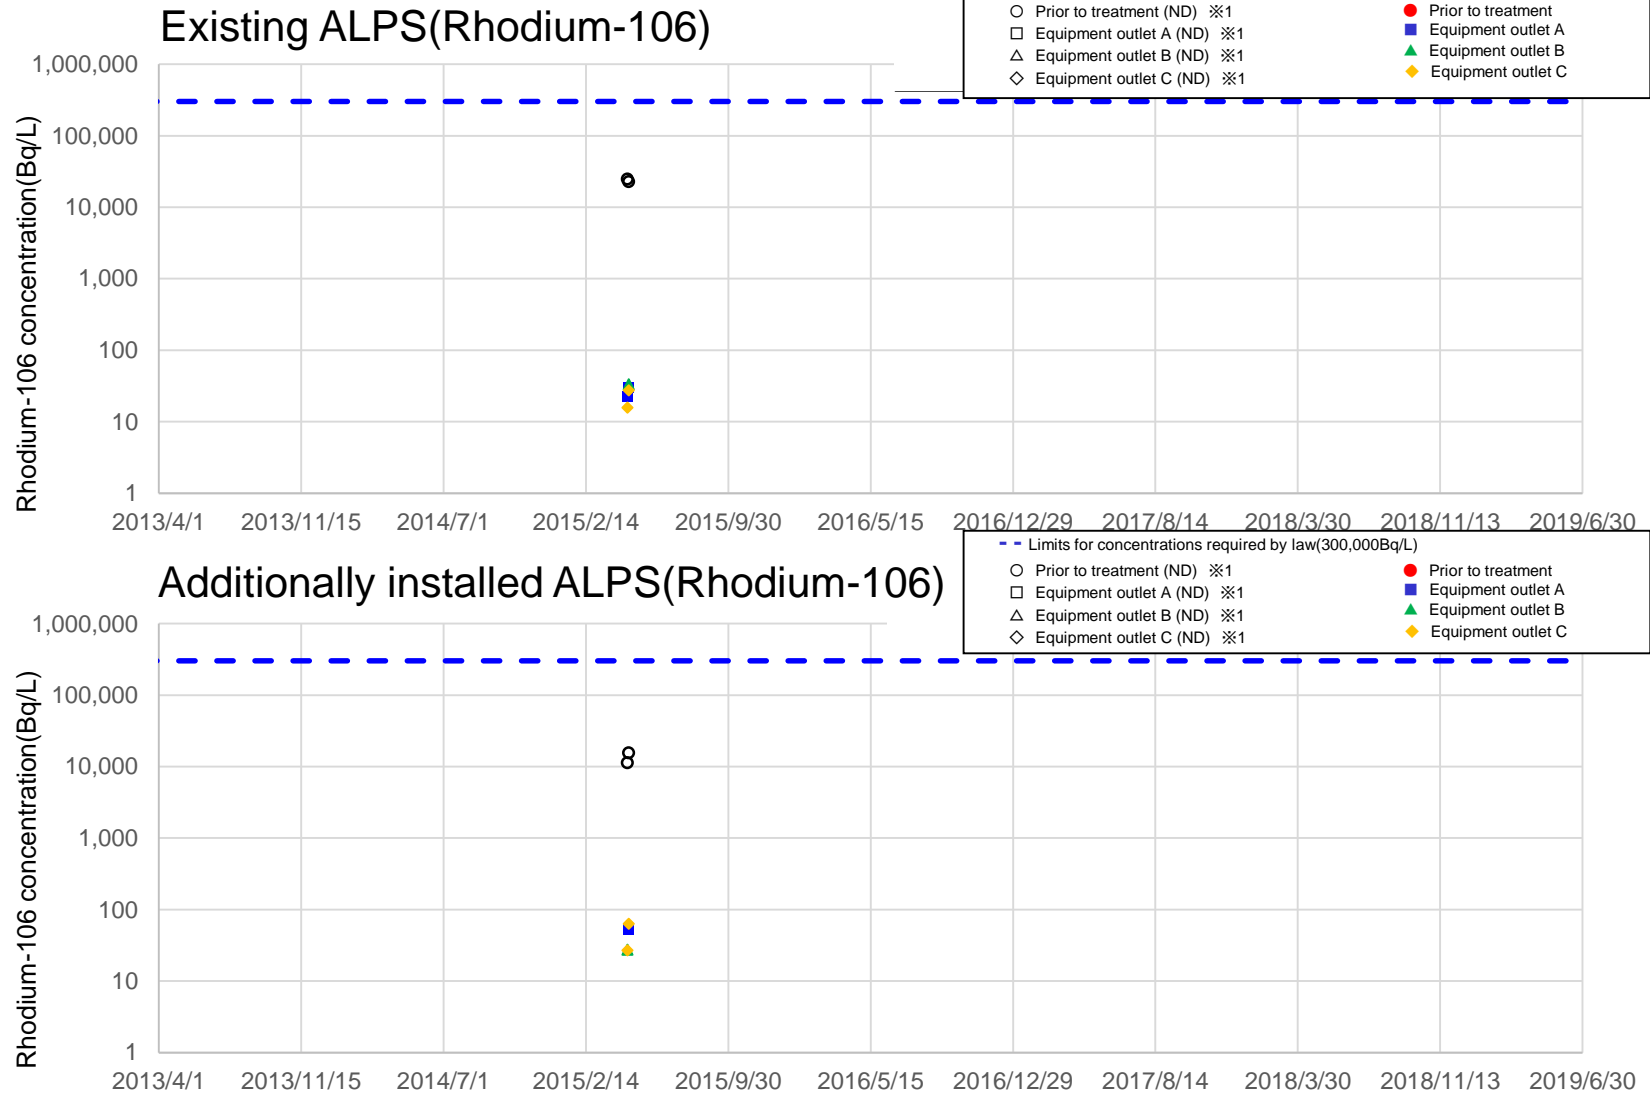

※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (Rhodium-106 concentration)

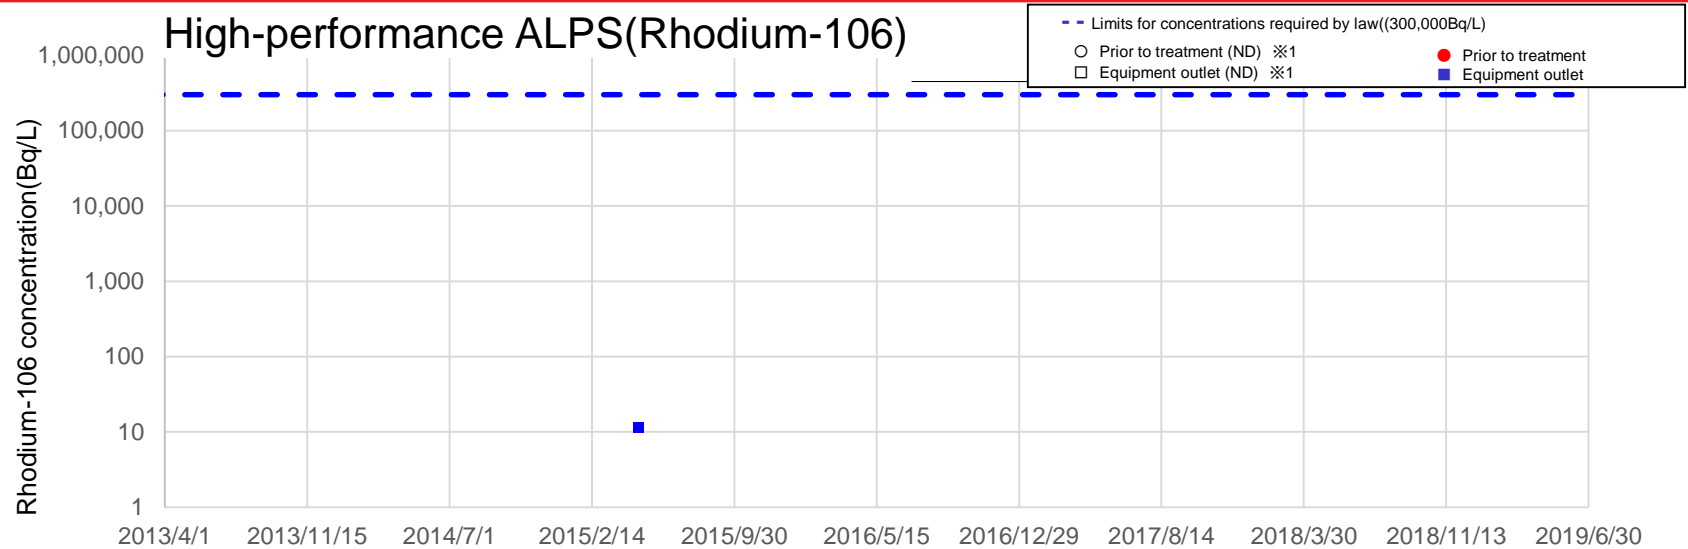


※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (All α concentration)



※ 1 “ND” means that concentrations were below detectable limits.

Radiation concentrations measured at the multi-nuclide removal equipment (ALPS) outlet (All α concentration)

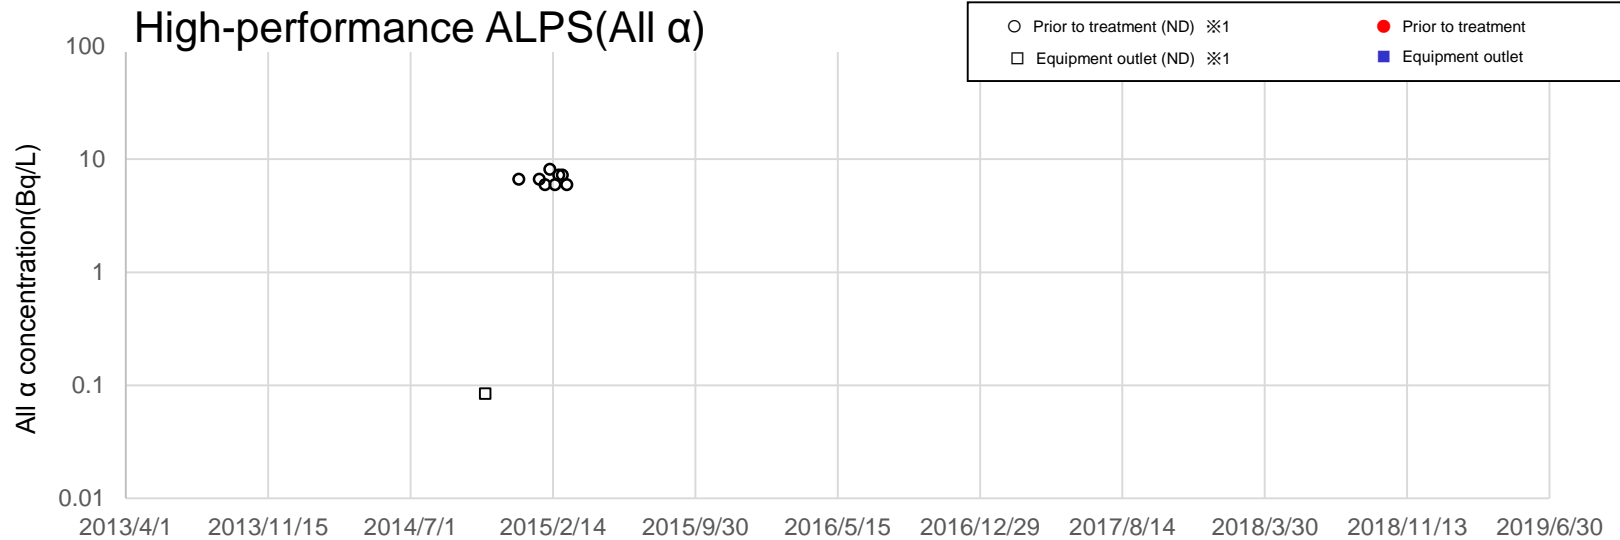

※ 1 “ND” means that concentrations were below detectable limits.

