


## <Sampling Locations>


Figure 1. Sampling locations within a 3km radius of the power station  
(in the vicinity of the discharge outlet)

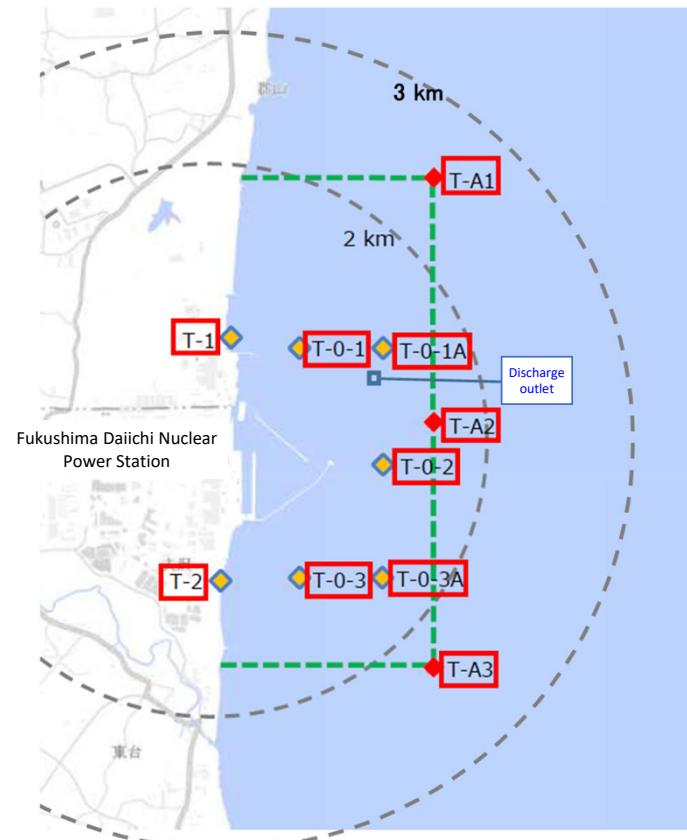

□ : Locations for quick tritium measurements (10 locations)  
Indicator (discharge suspension level): 700Bq/liter  
Indicator (investigation level): 350Bq/liter

□ : Area for which no common fishing rights exist

Figure 2. Sampling locations within a 10km square  
in front of the power station

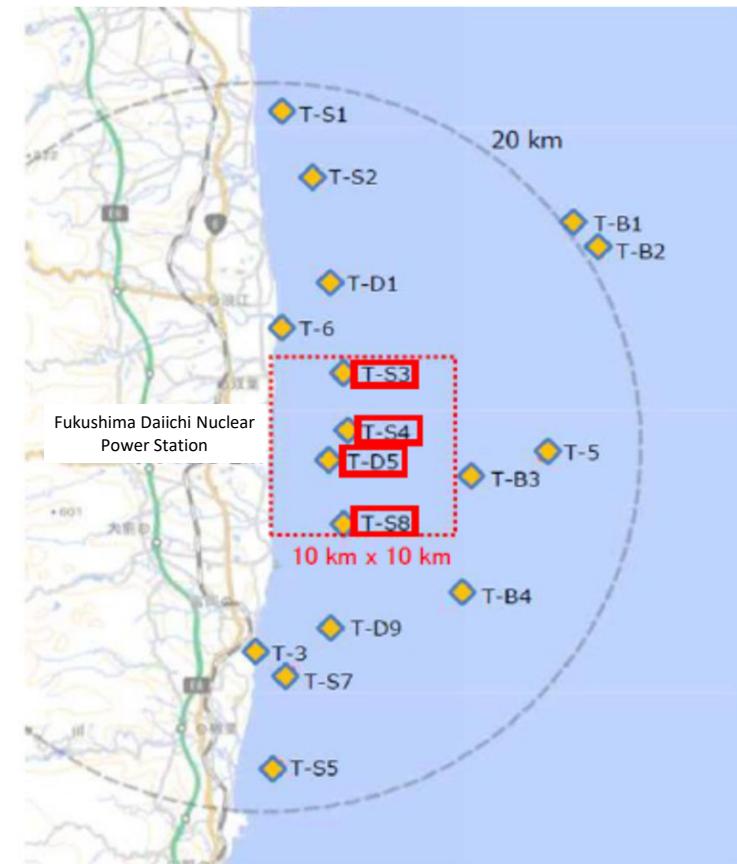

□ : Locations for quick tritium measurements (4 locations)  
Indicator (discharge suspension level): 30Bq/liter  
Indicator (investigation level): 20Bq/liter