


Main decommissioning work and steps


Fuel removal from the spent fuel pool was completed in December 2014 at Unit 4 and on February 28, 2021 at Unit 3.
 Work continues sequentially toward the start of fuel removal from Units 1 and 2 and debris (Note 1) retrieval from Units 1-3.
 (Note 1) Fuel assemblies having melted through in the accident.

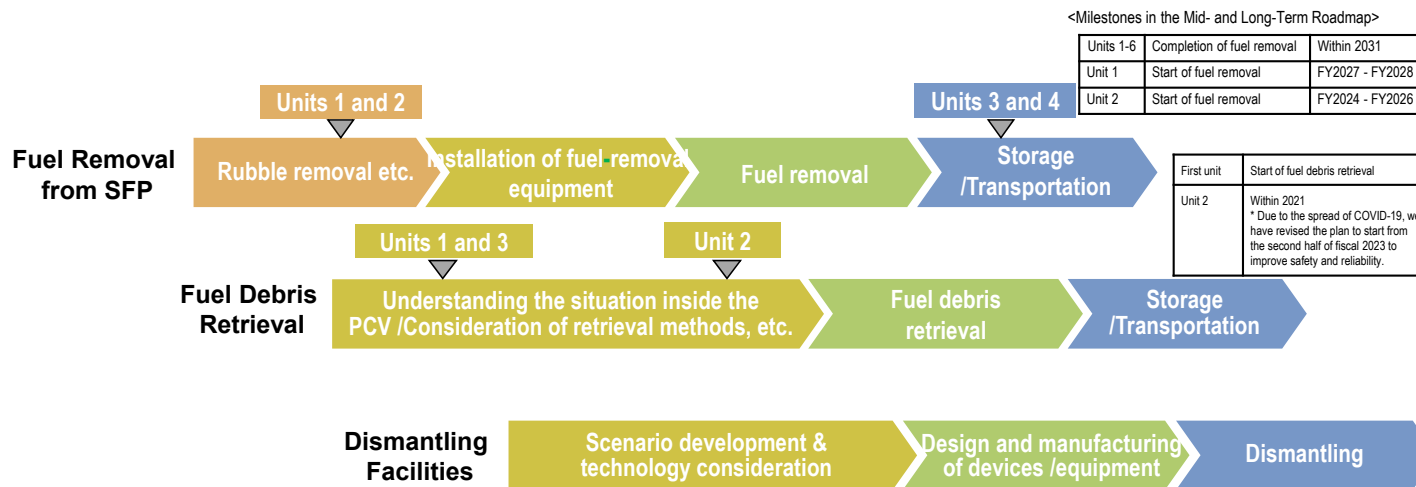

Measures for treated water

Handling of ALPS treated water

Regarding the discharge of ALPS treated water into the sea, TEPCO must comply with regulatory and other safety standards to safeguard the public, the surrounding environment and agricultural, forestry and fishery products. To minimize adverse impacts on reputation, monitoring will be further enhanced and objectivity and transparency ensured by engaging with third-party experts and having safety checked by the IAEA. Moreover, accurate information will be disseminated with full transparency on an ongoing basis.

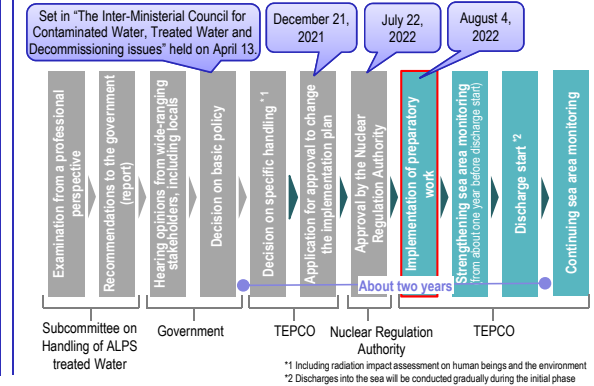

Contaminated water management - triple-pronged efforts -

(1) Efforts to promote contaminated water management based on the three basic policies

- ① "Remove" the source of water contamination
- ② "Redirect" fresh water from contaminated areas
- ③ "Retain" contaminated water from leakage


- Strontium-reduced water from other equipment is being re-treated in the Advanced Liquid Processing System (ALPS: multi-nuclide removal equipment) and stored in welded-joint tanks.
- Multi-layered contaminated water management measures, including land-side impermeable walls and sub-drains, have stabilized the groundwater at a low level and the increased contaminated water generated during rainfall is being suppressed by repairing damaged portions of building roofs facing onsite, etc. Through these measures, the generation of contaminated water was reduced from approx. 540 m³/day (in May 2014) to approx. 130 m³/day (in FY2021).
- Measures continue to further suppress the generation of contaminated water to 100 m³/day or less within 2025.

(2) Efforts to complete stagnant water treatment

- To reduce the stagnant water levels in buildings as planned, work to install additional stagnant water transfer equipment is underway. At present, the floor surface exposure condition can be maintained except for the Unit 1-3 Reactor Buildings, Process Main Building and the High-Temperature Incinerator Building.
- In 2020, treatment of stagnant water in buildings was completed, except for the Unit 1-3 Reactor Buildings, Process Main Building and High-Temperature Incinerator Building. For Reactor Buildings, the amount of stagnant water there will be reduced to about half the amount at the end of 2020 during the period FY2022-2024.
- For zeolite sandbags on the basement floors of the Process Main Building and High-Temperature Incinerator Building, measures to reduce the radiation dose are being examined with stabilization in mind.

(3) Efforts to stably operate contaminated water management

- Various measures are underway to prepare for tsunamis. For heavy rain, sandbags are being installed to suppress direct inflow into buildings while work to close openings in buildings and install sea walls to enhance drainage channels and other measures is being implemented as planned.

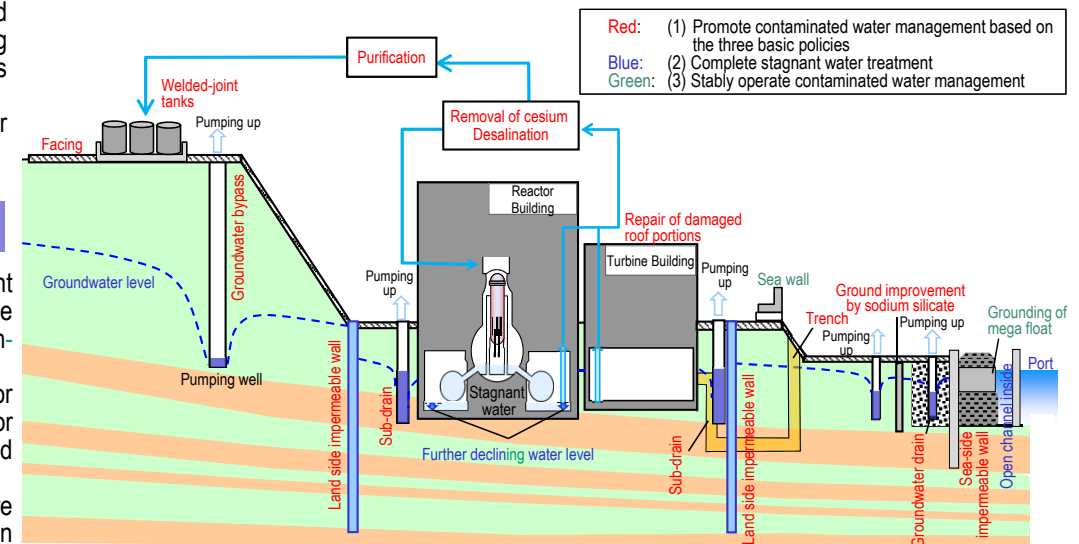

Progress status

- The temperatures of the Reactor and the Primary Containment Vessel of Units 1-3 have been maintained stable. There was no significant change in the concentration of radioactive materials newly released from Reactor Buildings into the air. It was concluded that the comprehensive cold shutdown condition had been maintained.

The Inter-Ministerial Council concerning the Continuous Implementation of the Basic Policy on Handling of ALPS Treated Water

On January 13, 2023, the 5th meeting of the Inter-Ministerial Council concerning the Continuous Implementation of the Basic Policy on Handling of ALPS Treated Water was held and confirmed “the progress of countermeasures having been implemented and the continuous implementation of the basic policy on handling of ALPS treated water.”

In future, each measure to secure safety and prevent adverse impacts on reputation will be steadily implemented and the effectiveness of these measures will be increased. Moreover, details of each measure will be repeatedly explained and dialogues will be held. Toward discharge ALPS treated water into the sea, activities to foster understanding will be further focused.


Progress status of work to install the ALPS treated water dilution/discharge facility and related facilities

To analyze the ALPS treated water, the nuclides (other than the 62 nuclides subject to removal by ALPS) emitting low-energy radiation need also be newly analyzed. To measure these nuclides, it was decided to introduce germanium semiconductor detectors (LEPS) for low-energy photons and two detectors were installed in the chemical analysis building in December 2022.


Moreover, to accurately analyze even minute amounts of tritium in seawater, it needs to be measured after being concentrated by electrolysis. In response, eight electrolytic concentrators were also supplied in December 2022.

Both types of equipment will go into operation within FY2022.

In work to install the ALPS treated water dilution/discharge facility and related facilities, the measurement/confirmation facility and the transfer facility are being installed. From January 16, the parts already installed will undergo a pre-service test.

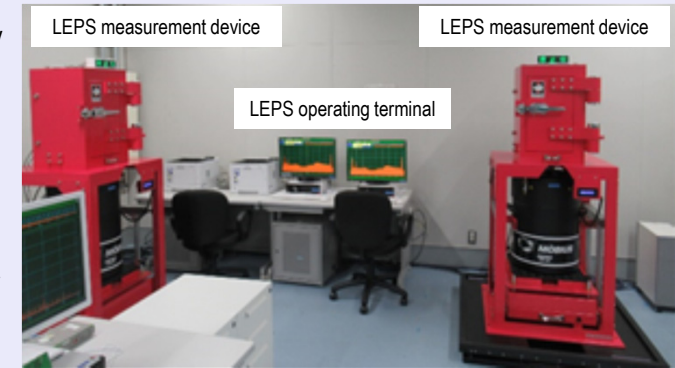

< Installation of germanium semiconductor detectors (LEPS) for low energy photon >

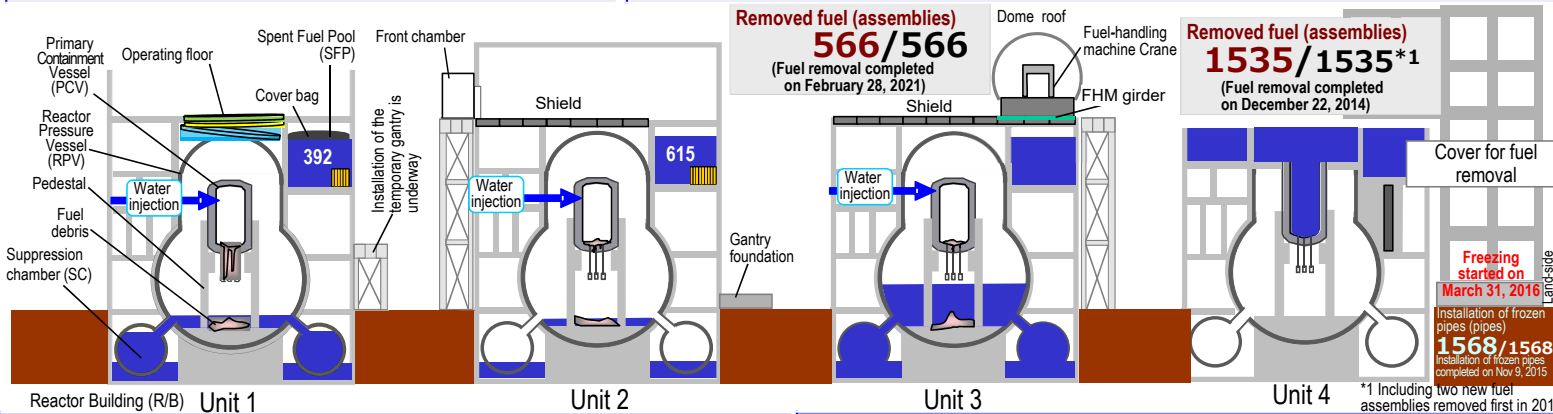

Unit 1 Status of the Primary Containment Vessel (PCV) internal investigation (the latter half)

Regarding deposit sampling using ROV-E, which had been conducted since January 12, 2023, the elbow of the installation equipment did not stretch to the designated position.

Toward resuming the investigation, the ROV installation equipment was inspected, ROV-E was installed and the operation was verified.

Subsequently, event reproducibility will be verified and after preparation is completed, the investigation will resume.


Progress toward resuming work to remove a portion of the Unit 1/2 SGTS pipes

Toward resuming work to remove a portion of the pipes of the Standby Gas Treatment System (SGTS) in the upper part of the Unit 1/2 Radioactive Waste Treatment Building, measures to improve reliability, such as modifying the cutter and preventing oil leakage of the hydraulic hose, are being implemented.

At present, a cutting test is underway outside the site. Subsequently, a mockup test using mockup pipes, which simulates the on-site conditions as much as possible, will be conducted.

As measures to further prevent dust scattering, additional urethane will be injected in February 2023.

Work will be resumed around late February.

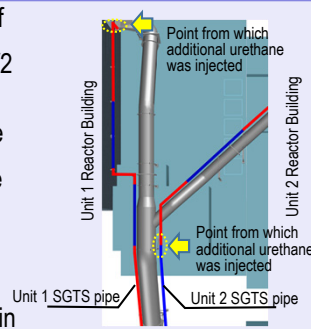


< Points from which additional urethane was injected >

Unit 2 Investigation of the basement floor of the Reactor Building

As part of efforts to examine the access method to the Reactor Core Isolation Cooling System (RCIC) room and the High-Pressure Coolant Injection System (HPCI) room, which are located on the Unit 2 Reactor Building basement floor, the status of the triangle corners (northwest and southwest) on the first basement floor were inspected in December 2022.

The inspection confirmed that no interference was generated by equipment damage or others that might hinder entry to the RCIC and HPCI rooms, the doors to these rooms were closed and there was no significant damage within the scope that could be confirmed.

Based on the information obtained, access and investigation methods will be examined.

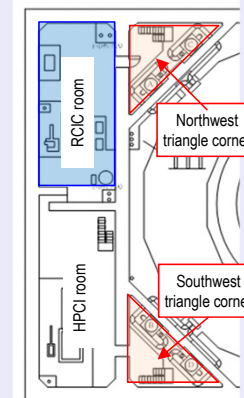

< Outline of the Unit 2 Reactor Building first basement floor >


Unit 6 Review of the process to remove spent fuel

Work is underway to load spent fuel having been stored in the common pool with the dry casks and transport them on-site to the Temporary Cask Custody Area. However, when the airtightness of the dry casks was assessed, the criteria were deemed not to be satisfied.

This was considered attributable to clad (iron oxide) or calcium carbonate having adhered to the fuel. As a countermeasure, a procedure to clean every fuel assemblies before loading them into the cask was added.

Due to this change, the process to remove Unit 6 spent fuel will be reviewed to completion in the 1st half of FY2025.

Major initiatives – Locations on site

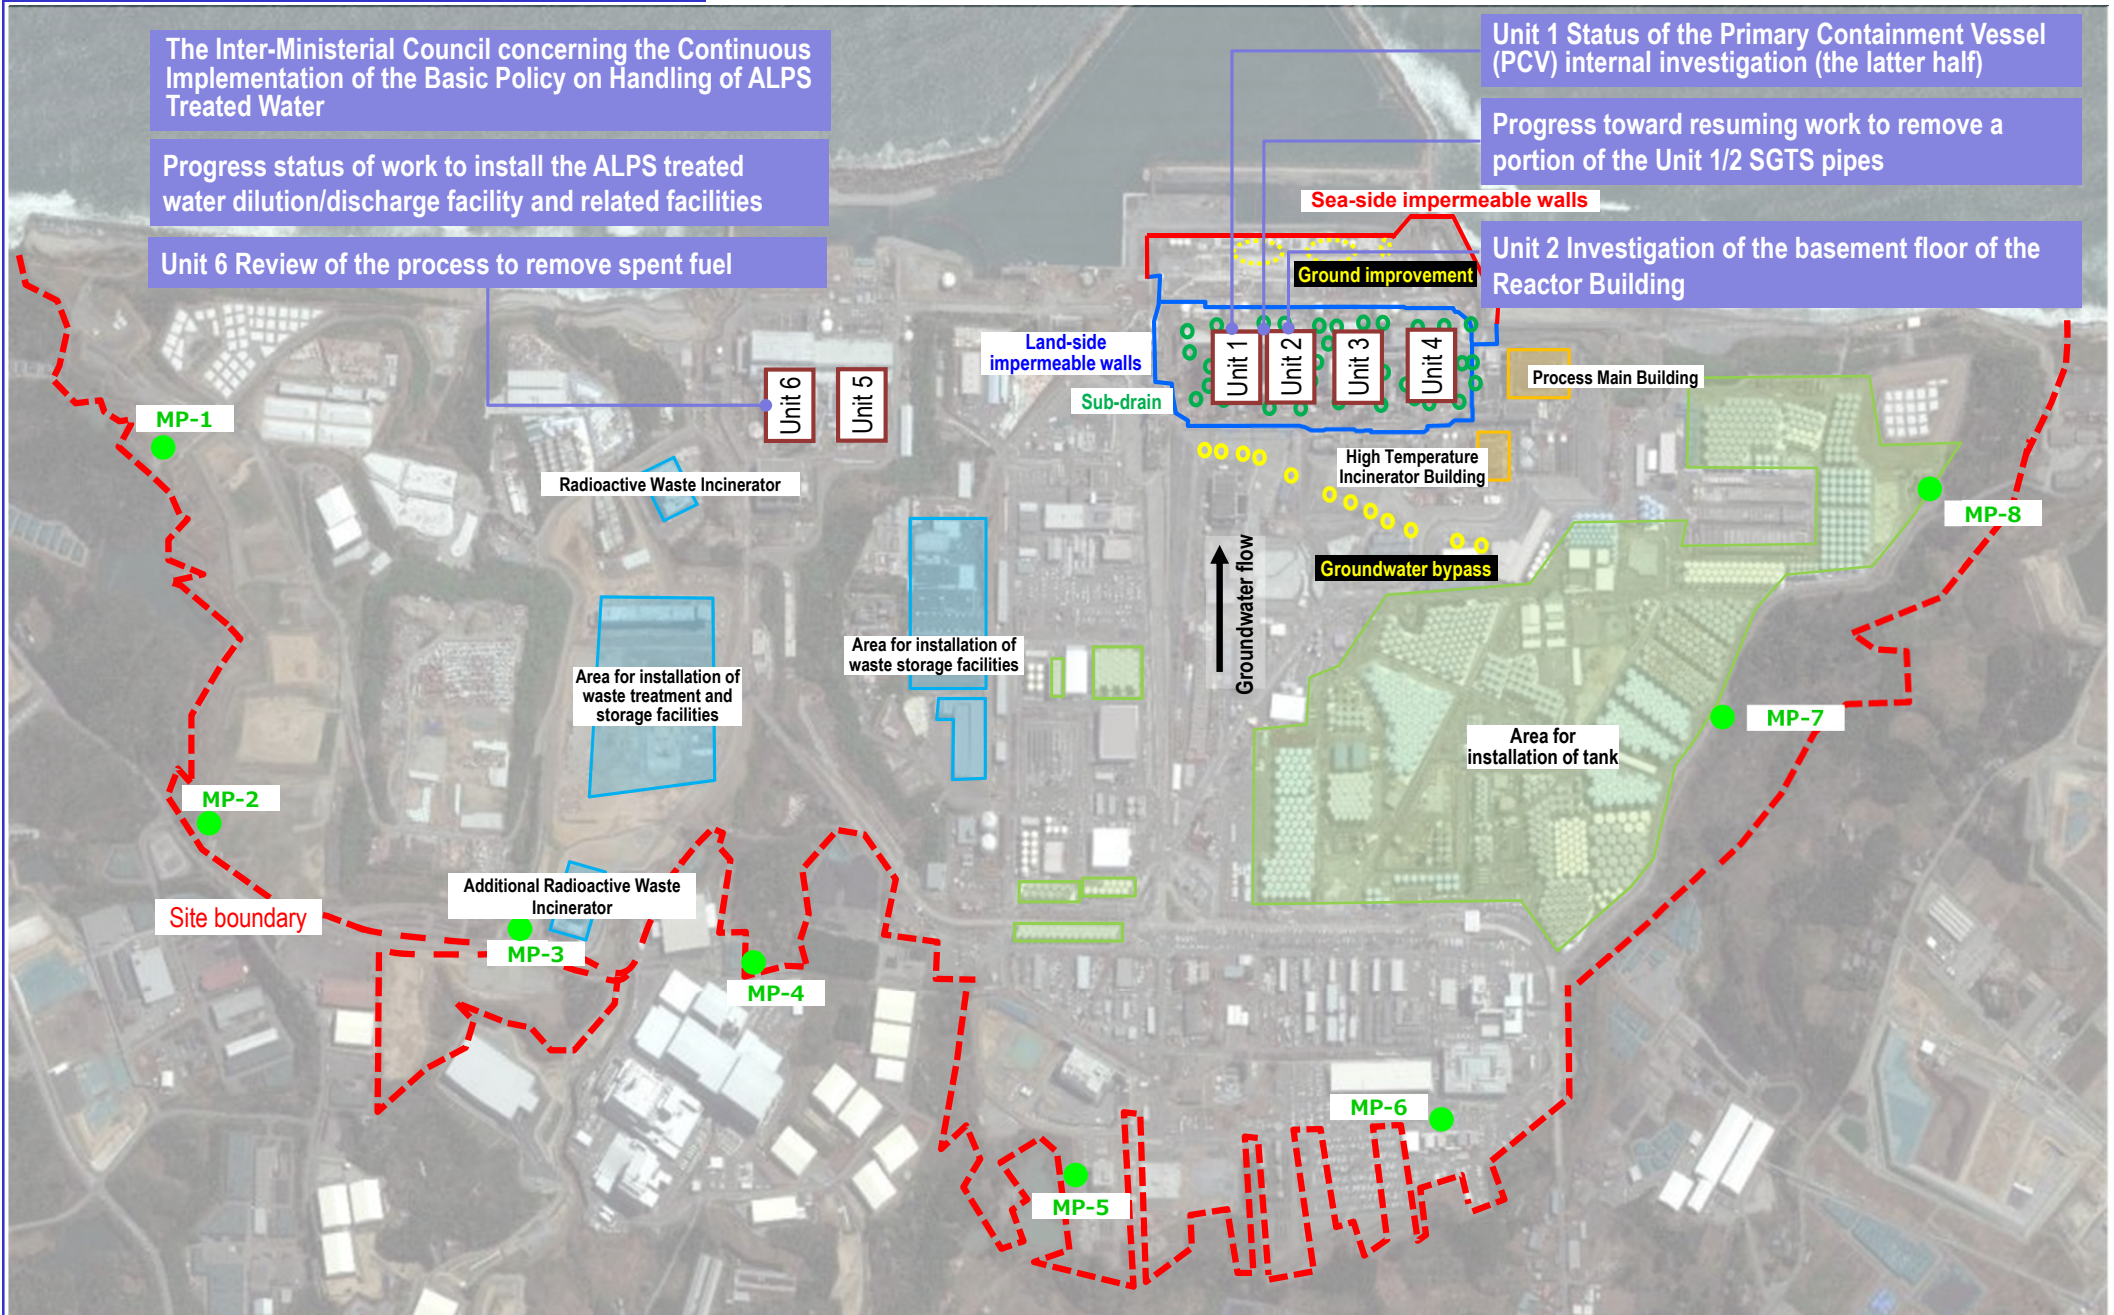


Provided by Japan Space Imaging Corp., photo taken on April 8, 2021
 Product (C) [2020] DigitalGlobe, Inc., a Maxar company


I. Confirmation of the reactor conditions

Temperatures inside the reactors

Through continuous reactor cooling by water injection, the temperatures of the Reactor Pressure Vessel (RPV) bottom and the Primary Containment Vessel (PCV) gas phase were maintained within the range of approx. 15 to 30°C for the past month, though it varied depending on the unit and location of the thermometer.

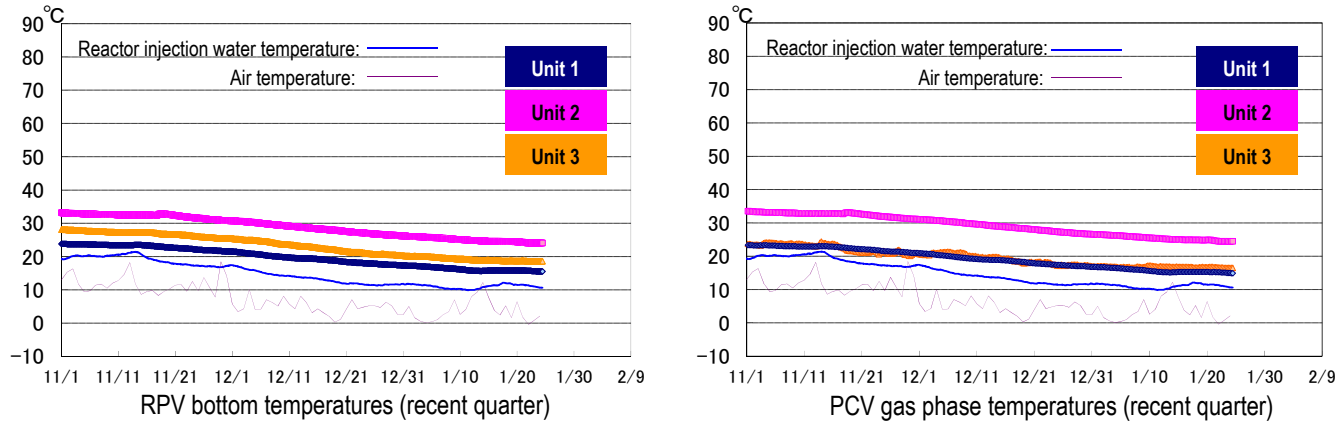

*1 The trend graphs show part of the temperature data measured at multiple points.
 *2 A part of data could not be measured due to maintenance and inspection of the facility and other work.

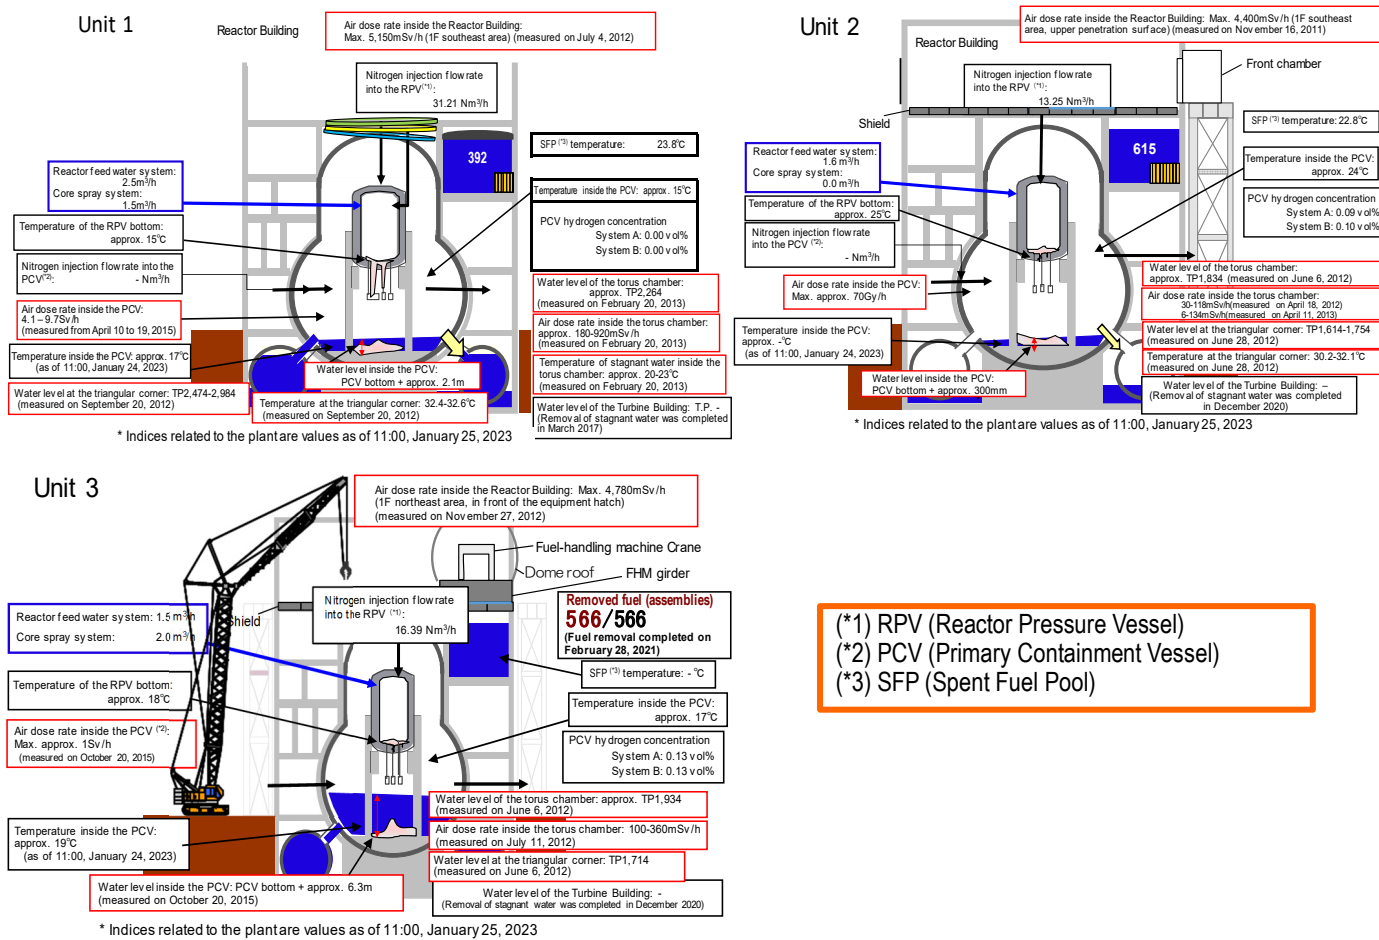


(*1) RPV (Reactor Pressure Vessel)
 (*2) PCV (Primary Containment Vessel)
 (*3) SFP (Spent Fuel Pool)

Release of radioactive materials from the Reactor Buildings

As of December 2022, the concentration of radioactive materials newly released from Reactor Building Units 1-4 into the air and measured at the site boundary was evaluated at approx. 1.7×10^{-12} Bq/cm³ and 1.7×10^{-12} Bq/cm³ for Cs-134 and -137 respectively, while the radiation exposure dose due to the release of radioactive materials there was less than 0.00003 mSv/year.

Annual radiation dose at site boundaries by radioactive materials (cesium) released from Reactor Building Units 1-4

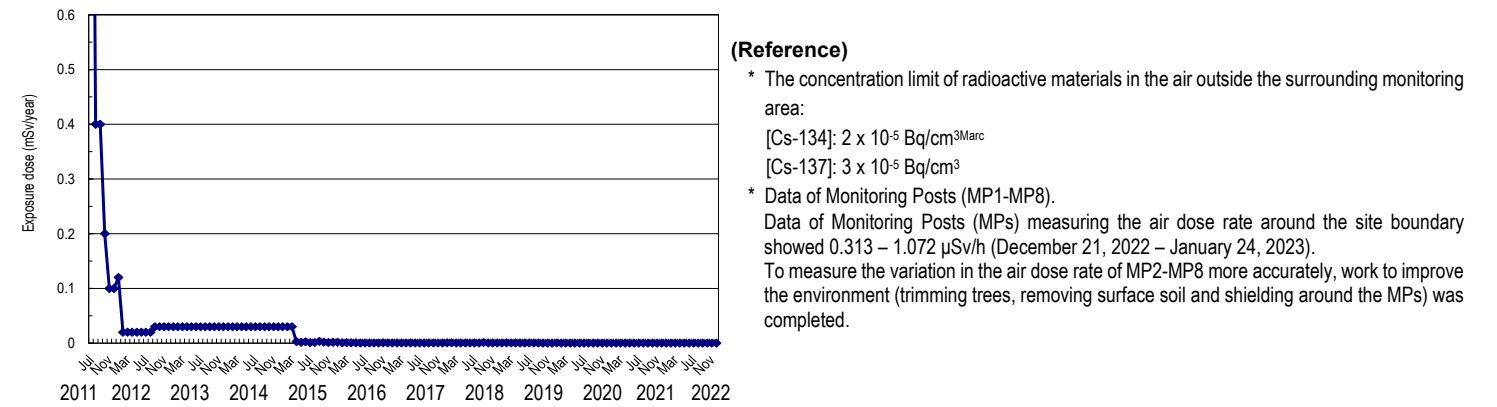

(Reference)
 * The concentration limit of radioactive materials in the air outside the surrounding monitoring area:
 [Cs-134]: 2×10^{-5} Bq/cm³ Marc
 [Cs-137]: 3×10^{-5} Bq/cm³
 * Data of Monitoring Posts (MP1-MP8).
 Data of Monitoring Posts (MPs) measuring the air dose rate around the site boundary showed 0.313 – 1.072 μSv/h (December 21, 2022 – January 24, 2023).
 To measure the variation in the air dose rate of MP2-MP8 more accurately, work to improve the environment (trimming trees, removing surface soil and shielding around the MPs) was completed.

Note 1: Different formulas and coefficients were used to evaluate the radiation dose in the facility operation plan and monthly report. The evaluation methods were integrated in September 2012. As the fuel removal from the spent fuel pool (SFP) commenced for Unit 4, the radiation exposure dose from Unit 4 was added to the items subject to evaluation since November 2013. The evaluation has been changed to a method considering the values of continuous dust monitors since FY2015, with data to be evaluated monthly and announced the following month.
 Note 2: Radiation dose was calculated using the evaluation values of release amount from Units 1-4 and Units 5 and 6. The radiation dose of Unit 5 and 6 was evaluated based on expected release amount during operation until September 2019 but the evaluation method was reviewed and changed to calculate based on the actual measurement results of Units 5 and 6 from October.


Other indices

There was no significant change in indices, including the pressure in the PCV and the PCV radioactivity density (Xe-135) for monitoring criticality, nor was any anomaly in the cold shutdown condition or criticality sign detected. Based on the above, it was confirmed that the comprehensive cold shutdown condition had been maintained and the reactors remained in a stabilized condition.

II. Progress status by each plan

Measures for contaminated water and treated water

- Status of contaminated water generated
 - Multi-layered measures, including pumping up by sub-drains and land-side impermeable walls, which were implemented to control the continued generation of contaminated water, suppressed the groundwater inflow into buildings.
 - After implementing “redirecting” measures (groundwater bypass, sub-drains, land-side impermeable walls and others) and rainwater prevention measures, including repairing damaged portions of building roofs, the amount of contaminated water generated within FY2021 declined to approx. 130 m³/day.
 - Measures will continue to further reduce the amount of contaminated water generated.

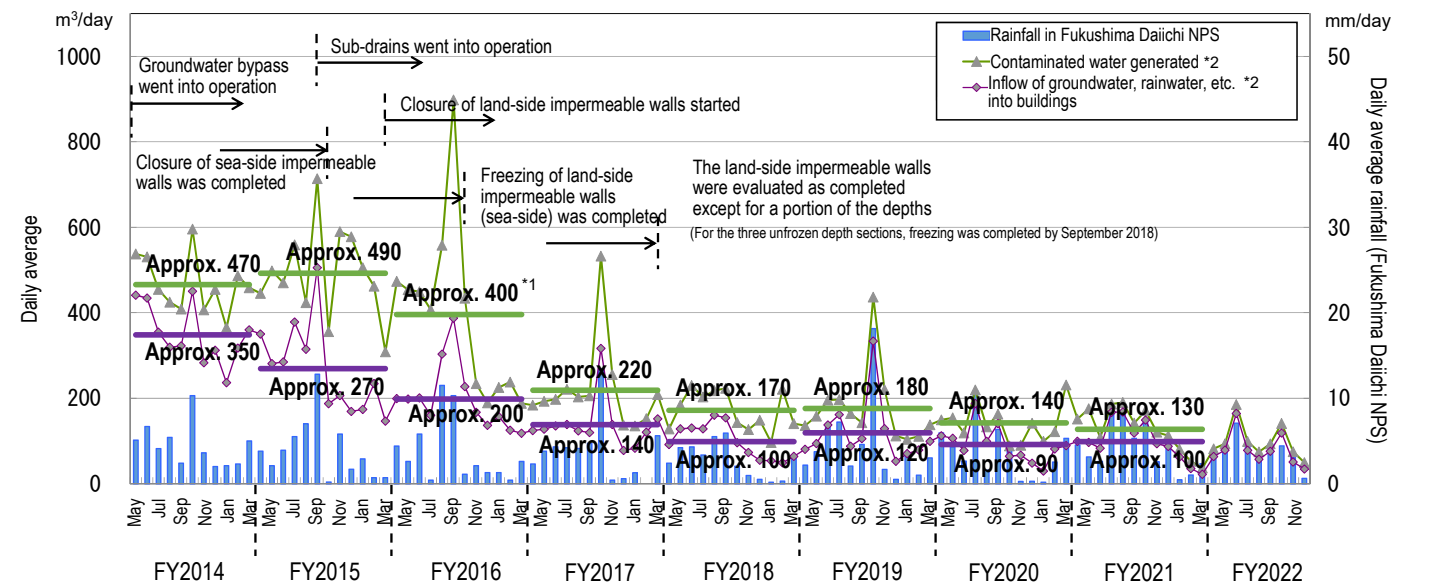

*1 Values differ from those announced at the 20th Committee on Countermeasures for Contaminated Water Treatment (held on August 25, 2017) because the method of calculating the contaminated water volume generated was reviewed on March 1, 2018. Details of the review are described in the materials for the 50th and 51st meetings of the Secretariat of the Team for Countermeasures for Decommissioning and Contaminated Water Treatment.
 *2: The monthly daily average is derived from the daily average from the previous Thursday to the last Wednesday, which is calculated based on the data measured at 7:00 on every Thursday.

Figure 1: Changes in contaminated water generated and inflow of groundwater and rainwater into buildings

➤ Operation of the Water-Treatment Facility special for Sub-drain & Groundwater drains

- At the Water-Treatment Facility Special for Sub-drain & Groundwater drains, release started from September 14, 2015 and up until January 16, 2023, 2,081 release operations had been conducted. The water quality of all temporary storage tanks satisfied the operational target.

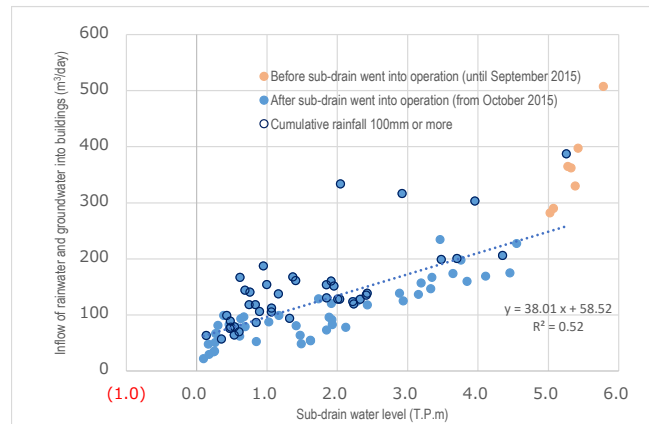


Figure 2: Correlation between inflow such as groundwater and rainwater into buildings and the water level of Units 1-4 sub-drains

➤ Implementation status of facing

- Facing is a measure that involves asphaltting the on-site surface to reduce the radiation dose, prevent rainwater infiltrating the ground and reduce the amount of underground water flowing into buildings. As of the end of December 2022, 95% of the planned area (1,450,000 m² on site) had been completed. For the area inside the land-side impermeable walls, implementation proceeds appropriately after constructing a yard from implementable zones that leave the decommissioning work unaffected. As of the end of December 2022, 30% of the planned area (60,000 m²) had been completed.

➤ Status of the groundwater level around buildings

- The groundwater level in the area inside the land-side impermeable walls has been declining each year due to the land-side impermeable walls and the decline in the set water level of the sub-drains. On the mountainside, the average difference between the inside and outside has remained at 4-5 m. The water level in the bank area has also remained low (T.P. 1.4 m) relative to the ground surface (T.P. 2.5 m).
- As the set water level of the sub-drains declined slightly (T.P. -0.55 ⇒ -0.65 m) and others in FY2021, the groundwater level on the sea side of the Unit 1-4 buildings remained low (except during heavy rainfall) compared to the T.P. 2.5 m area.


➤ Operation of the multi-nuclide removal equipment

- Regarding the multi-nuclide removal equipment (existing), hot tests using radioactive water are ongoing (System A: from March 30, 2013, System B: from June 13, 2013, System C: from September 27, 2013). On March 23, 2022, a pre-service inspection certificate was granted by the Nuclear Regulation Authority and the entire pre-service inspection was completed. The multi-nuclide removal equipment (additional) went into full-scale operation from October 16, 2017. Regarding the multi-nuclide removal equipment (high-performance), hot tests using radioactive water have been underway (from October 18, 2014).
- As of January 19, 2023, the volumes treated by existing, additional and high-performance multi-nuclide removal equipment were approx. 494,000, 748,000 and 104,000 m³, respectively (including approx. 9,500 m³ stored in the J1(D) tank, which contained water with highly concentrated radioactive materials at the System B outlet of the existing multi-nuclide removal equipment).
- Treatment measures comprising the removal of strontium by cesium-adsorption apparatus (KURION), the secondary cesium-adsorption apparatus (SARRY) and the third cesium-adsorption apparatus (SARRY II) continued. Up until January 19, 2023, approx. 701,000 m³ had been treated.

➤ Risk reduction of strontium-reduced water

- To reduce the risks of strontium-reduced water, treatment using existing, additional and high-performance multi-nuclide removal equipment is underway. Up until January 19, 2023, approx. 867,000 m³ had been treated.

As of January 19, 2023

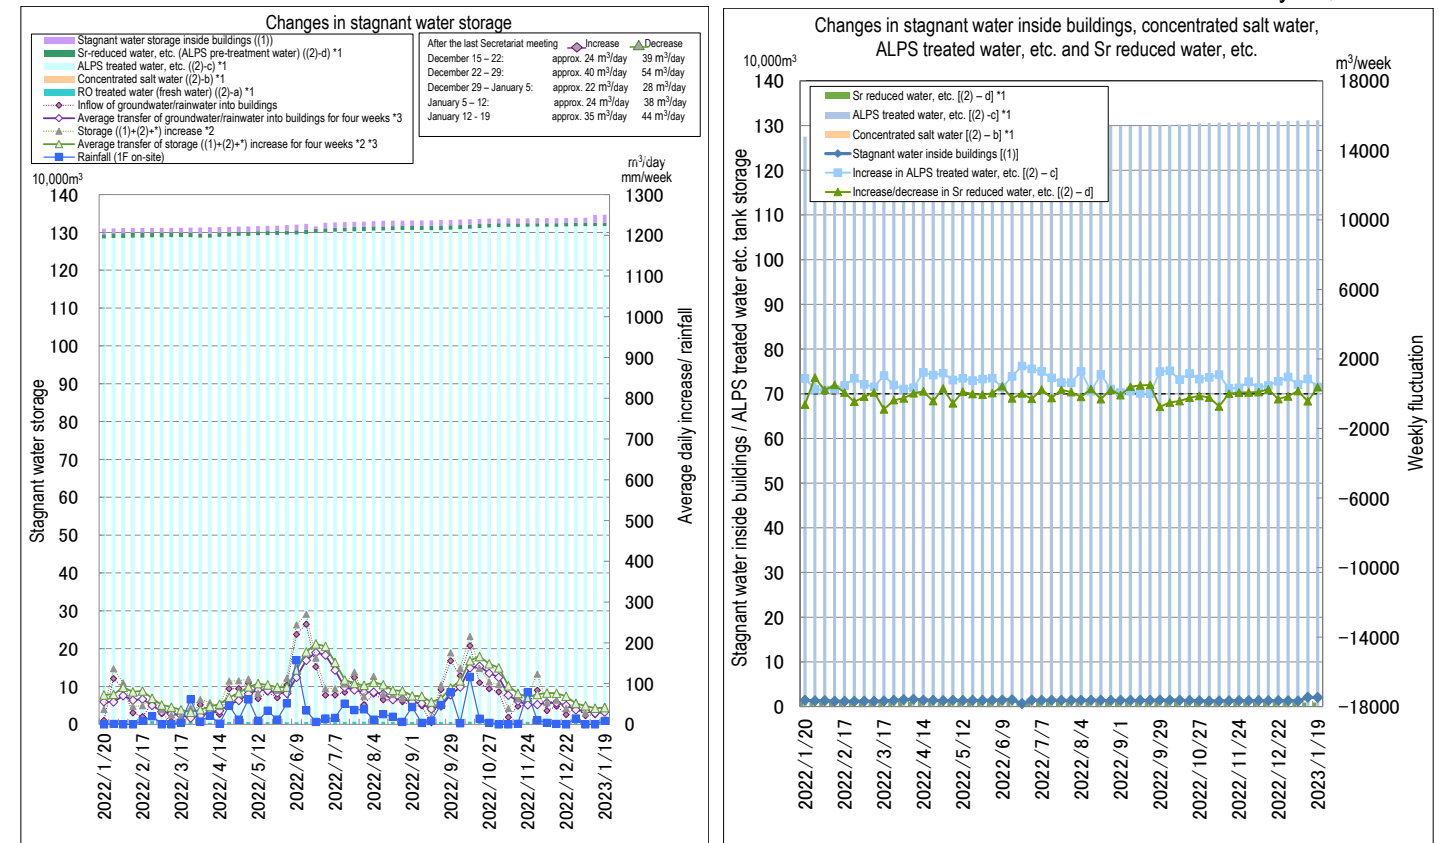

(1): Stagnant water storage inside buildings (Units 1-4, Process Main Building, High Temperature Incinerator Building, Waste Liquid Supply Tank, SPT (A), SPT (B), Units 1-3 CST, buffer tank)
 (2): Units 1-4 tank storage [(2)-a RO treated water (fresh water)] + [(2)-b Concentrated salt water] + [(2)-c ALPS treated water, etc.] + [(2)-d Sr-reduced water, etc. (ALPS pre-treatment water)]
 *: Water amount from tank bottom to water-level gauge 0% (DS)
 *1: Water amount for which the water-level gauge indicates 0% or more
 *2: Calculated in the method of contaminated water generated [(Inflow of groundwater/rainwater into buildings) + (other transfer) + (chemical injection into ALPS)]
 *3: Average transfer of storage increase and groundwater/rainwater into buildings for four weeks was added (November 24, 2022)

Figure 3: Status of stagnant water storage

➤ Status of sea-area monitoring related to the handling of ALPS treated water

- The concentration of tritium in seawater within 2km of the port has remained constant over the past year and also low at new measurement points within the fluctuation range of seawater in Japan*. The concentration of Cesium-137 increased temporarily, which was considered due to rainfall, as applied to the past fluctuation in seawater around the Fukushima Daiichi Nuclear Power Station. However, it remained constant relative to measurement benchmarks for the past year and at new measurement points and also low within the fluctuation range of seawater in Japan*. For tritium, monitoring has been conducted with a lower detection limit since April 18.
- Both concentrations of tritium and Cesium-137 in seawater within 20km of the coast had remained constant for the past year and low within the fluctuation range of seawater in Japan*.
- The concentration of tritium in seawater further than 20km from the coast remained low, including at new measurement points, within the fluctuation range of seawater in Japan*. The concentration of Cesium-137 remained constant over the past year within the fluctuation range of seawater in Japan*.

*: The range of the minimum – maximum values detected during April 2019 – March 2021 were as follows in the database below:

In Japan (including off the coast of Fukushima Prefecture):

Tritium concentration: 0.043 - 20 Bq/L
 Cesium-137 concentration: 0.0010 - 0.45 Bq/L

Off the coast of Fukushima Prefecture

Tritium concentration: 0.043 – 2.2 Bq/L

Cesium-137 concentration: 0.0010 - 0.45 Bq/L

Source: Environmental Radioactivity and Radiation in Japan, Environmental Radiation Database

<https://www.kankyo-hoshano.go.jp/data/database/>

- The concentration of tritium in fish sampled at the sampling point T-S8 had remained constant for the past year. The concentration of tritium in fish sampled at new sampling points, including where the analytical value was verified, remained low within a similar fluctuation range for seawater in Japan*. Other measurement data of fish and measurement data of seaweed are being verified.

* : The range of the minimum – maximum values detected during April 2019 – March 2021 was as follows in the database below:

In Japan (including off the coast of Fukushima Prefecture)

Tritium concentration: 0.064 – 0.12 Bq/L

➤ Progress of the rearing test of marine organisms in the Fukushima Daiichi Nuclear Power Station

- To eliminate concerns and reassure those in society, a rearing test of marine organisms (flounder and abalones) in seawater with ALPS treated water added and normal seawater for comparison is underway.
- Regarding the test of flounder, on January 16, in the series 4 tank (ALPS treated water diluted by seawater), one flounder died. Since January 17, no further death or abnormality was detected (as of January 23).
- Regarding the test of flounder, for abalones, since the test started on October 25, 13 deaths were detected in “normal seawater” and 29 deaths, in “ALPS treated water diluted by seawater” (as of January 23).
- The timing for starting the rearing test of seaweed will be announced as soon as decided.
- Subsequently, the tritium concentration will be measured for abalones having been reared in diluted ALPS treated water (less than 1,500 Bq/L) in October - November 2022 and flounder, (approx. 30 Bq/L) in November - December 2022.

Fuel removal from the spent fuel pools

Work to help remove spent fuel from the pool is progressing steadily while ensuring seismic capacity and safety.

➤ Main work to help spent fuel removal at Unit 1

- From late April 2021, work to assemble a temporary gantry and others has been underway in a yard outside the site as part of efforts to install a large cover. The ground assembly was completed for the temporary gantry and lower structure and approx. 50%, for the upper structure.
- A work yard was prepared around the Reactor Building and preliminary work to install a large cover started from August 2021.
- From April 13, 2022, drilling to install an anchor in the Reactor Building started. A temporary gantry is also being installed from the portion where anchors and base plates are installed.
- The Isolation Condenser secondary side pipe (IC pipe)*, which hinders the installation of anchors and baseplates, was removed in late September.

* Isolation Condenser secondary-side pipe: The secondary-side pipe of the Isolation Condenser, which cools the inside of the Reactor Pressure Vessel when the external power source is lost and is currently unused.

➤ Main work to help spent fuel removal at Unit 2

- Decontamination to suppress dust scattering on the top floor of the Reactor Building was completed in December 2021 and contamination reduction was confirmed, based on smear sampling results before and after decontamination. Work to install shielding within a range including above the reactor well, where the dose was observed to peak, was completed at the end of May 2022. Due to interference with the installation of the new fuel-handling machine, work to remove the control room of the fuel-handling machine (hereinafter FHM control room) has been underway since August. Once this is complete, preliminary work to dismantle the existing facility on the south side will commence (rearrangement of site, inspection of remotely operated heavy machinery (annual inspection) and measures to prevent

scattering of rubble and dust).

- Outside the building, construction of a gantry foundation has been underway since June 2022. After the construction is complete, the erection of a steel structure will commence. Outside the site, before erecting the steel structure on-site, ground assembly continues.

Retrieval of fuel debris

➤ Unit 1 PCV internal investigation (the latter half)

- Regarding the deposit debris detection (gamma-ray nuclide analysis) by ROV-D, all eight points were measured during the period December 6-9.
- Regarding the deposit sampling using ROV-E which had been conducted since January 12, 2023, the elbow of the installation equipment did not stretch to the designated position.
- Toward resuming the investigation, the ROV installation equipment was inspected, ROV-E was installed and operation was verified. Subsequently, event reproducibility will be verified and after preparation is completed, the investigation will be resumed.

➤ Progress status toward Unit 2 PCV internal investigation and trial retrieval

- Using the Naraha mockup facility, a mockup test simulating the actual site is underway.
- At present, after modifying the control program to position the arm more accurately, a permeability test etc. using the X-6 penetration mockup continues.
- For improvements determined during the performance verification test at Naraha, measures and improvement will continue to be implemented.
- Regarding work to install an isolation room as a boundary while opening the X-6 penetration, bubble generation from the shielding door when the installation status was verified (verification of pressurization), was investigated. The investigative results suggested that it was considered attributable to the pressing mechanism of the shielding door.
- Work continues safely and carefully.

➤ Development of digitalizing technology for environmental and dose distribution to reduce exposure

- To apply to work related to fuel debris retrieval, TEPCO collaborates with the Japan Atomic Energy Agency (JAEA) to develop digitalizing technology for environmental and dose distribution to reduce exposure from which the following results were obtained:
 - Development of a prototype system to assume radiation source and dose rate
 - Verification of the system by applying to an actual machine (JMTR)
 - a. The verification test confirmed that the on-site dose rate was reproducible
 - b. Effects were confirmed by the dose rate reduction simulation
 - Development toward on-site application in the Fukushima Daiichi Nuclear Power Station (1F) (underway)
- During the next phase, as well as further advancing the prototype system (increasing on-site applicability, assumption accuracy and operability), more environmental data will be collected and applied to the whole Reactor Building to help formulate a work plan to reduce exposure in 1F using this system.

Plans to store, process and dispose of solid waste and decommission of reactor facilities

Promoting efforts to reduce and store waste generated appropriately and R&D to facilitate adequate and safe storage, processing and disposal of radioactive waste

➤ Management status of rubble and trimmed trees

- As of the end of December 2022, the total storage volume for concrete and metal rubble was approx. 329,200m³ (+600 m³ compared to the end of November with an area-occupation rate of 88%). The total storage volume of trimmed trees was approx. 125,300m³ (-1,700 m³ with an area-occupation rate of 71%). The total storage volume of used protective clothing was approx. 16,000m³ (-2,900m³, with an area-occupation rate of 30%). The increase in rubble was attributable to decontamination of flanged-tanks, work related to the port and transfer for area arrangement. As

of the end of December 2022, there were six temporary deposits with storage capacity exceeding 1,000m³, storage 57,900m³.

➤ Management status of secondary waste from water treatment

- As of January 5, 2023, the total storage volume of waste sludge was 453 m³ (area-occupation rate: 65%), while that of concentrated waste fluid was 9,383 m³ (area-occupation rate: 91%). The total number of stored spent vessels, High-Integrity Containers (HICs) for multi-nuclide removal equipment and other vessels, was 5,493 (area-occupation rate: 87%).


Reduction in radiation dose and mitigation of contamination

Effective dose-reduction at site boundaries and purification of port water to mitigate the impact of radiation on the external environment


➤ Status of the groundwater and seawater on the east side of Turbine Building Units 1-4

- In the Unit 1 intake north side area, the H-3 concentration was below the legal discharge limit of 60,000 Bq/L at all observation holes and remained constant or has been declining overall. The concentration of total β radioactive materials has remained constant overall but increased temporarily from April 2020 and is even increasing or declining at many observation holes at present, including Nos. 0-1-2, 0-3-1, 0-3-2 and 0-4. The trend continues to be monitored carefully.
- In the area between the Unit 1 and 2 intakes, the H-3 concentration has remained below the legal discharge limit of 60,000 Bq/L at all observation holes. It has been increasing or declining at Nos. 1-14 and 1-17 but has otherwise remained constant or been declining overall. The concentration of total β radioactive materials has remained constant overall but been increasing or declining at many observation holes, including Nos. 1-6, 1-9, 1-11, 1-12, 1-14, 1-16 and 1-17. The trend continues to be monitored carefully.
- In the area between the Unit 2 and 3 intakes, the H-3 concentration has been below the legal discharge limit of 60,000 Bq/L at all observation holes. It has been increasing and declining at Nos. 2-3, 2-5, 2-6 and 2-7 but has remained constant overall. The concentration of total β radioactive materials has remained constant overall but been increasing or declining at No. 2-5. The trend continues to be monitored carefully.
- In the area between the Unit 3 and 4 intakes, the H-3 concentration has been below the legal discharge limit of 60,000 Bq/L at all observation holes and remained constant or been declining overall. The concentration of total β radioactive materials has remained constant overall but has been increasing or declining at many observation holes, including Nos. 3-4 and 3-5. The trend continues to be monitored carefully.
- In the groundwater on the east side of the Turbine Buildings, as with the total β radioactive materials, the concentration of cesium has also remained constant as the overall area but been increasing or declining and exceeded the previous highest record at some observation holes. Investigations into the fluctuation are underway for Nos. 0-3-2, 1, 1-6, 2-5, 2-6 and 3-3.
- The concentration of radioactive materials in drainage channels has remained constant overall, despite increasing during rainfall. In Drainage Channel D, drainage of the low-dose area on the west side of the site started to pass from August 30, 2022 and the concentration has remained low. From November 29, 2022, continuous monitors will be installed and drainage around the Units 1 and 2 switch yard will start to pass.
- In the open channel area of seawater intake for Units 1 to 4, the concentration of radioactive materials in seawater has remained below the legal discharge limit and been declining long term, despite temporary increases in Cs-137 and Sr-90 noted during rainfall. They have also been declining following the completed installation and the connection of steel pipe sheet piles for the sea-side impermeable walls. The concentration of Cs-137 has remained slightly higher in front of the south-side impermeable walls and slightly lower on the north side of the east breakwater since March 20, 2019, when the silt fence was transferred to the center of the open channel due to mega float-related construction.
- In the port area, the concentration of radioactive materials in seawater has remained below the legal discharge limit and been declining long term, despite temporary increases in Cs-137 and Sr-90 observed during rainfall. They have remained below the level of those in the Units 1-4 intake open channel area and been declining following the completed installation and connection of steel pipe sheet piles for the sea-side impermeable walls.

- In the area outside the port, regarding the concentration of radioactive materials in seawater, those of Cs-137 and Sr-90 declined and remained low after steel pipe sheet piles for the sea-side impermeable walls were installed and connected. Regarding the concentration of Cs-137, a temporary increase was sometimes observed on the north side of the Unit 5 and 6 outlets and near the south outlet due to the influence of weather, marine meteorology and other factors. Regarding the concentration of Sr-90, variation was observed in FY2021 in the area outside the port (north and south outlets). Monitoring of the tendency continues, including the potential influence of the weather, marine meteorology and others.

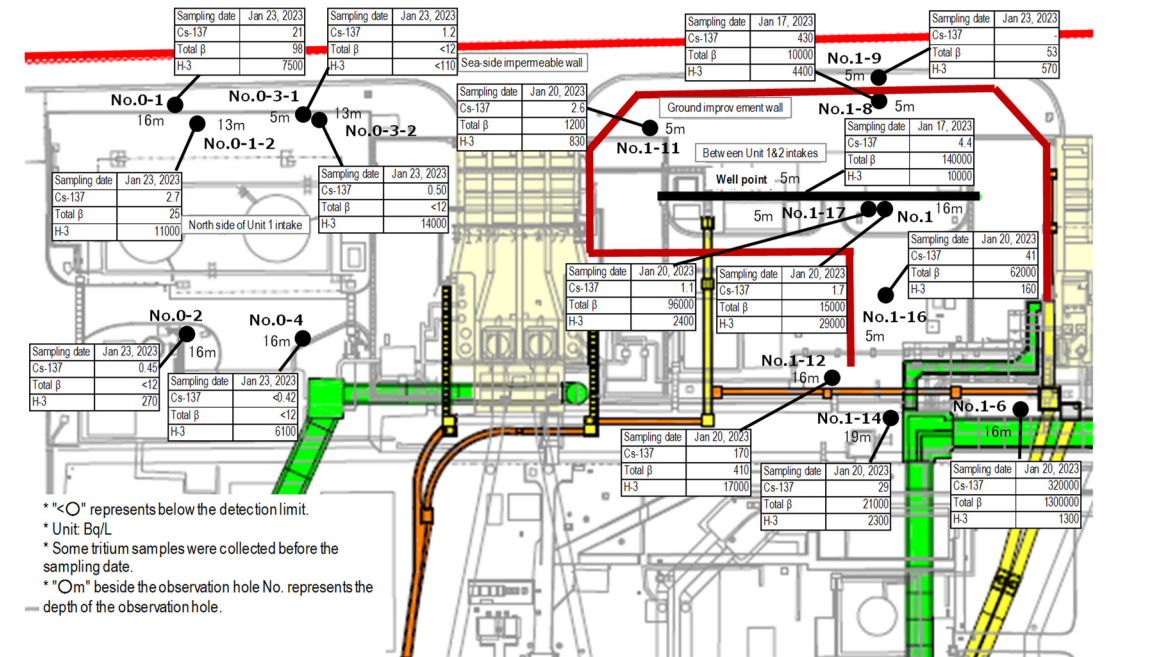

<Unit 1 intake north side, between Unit 1 and 2 intakes>

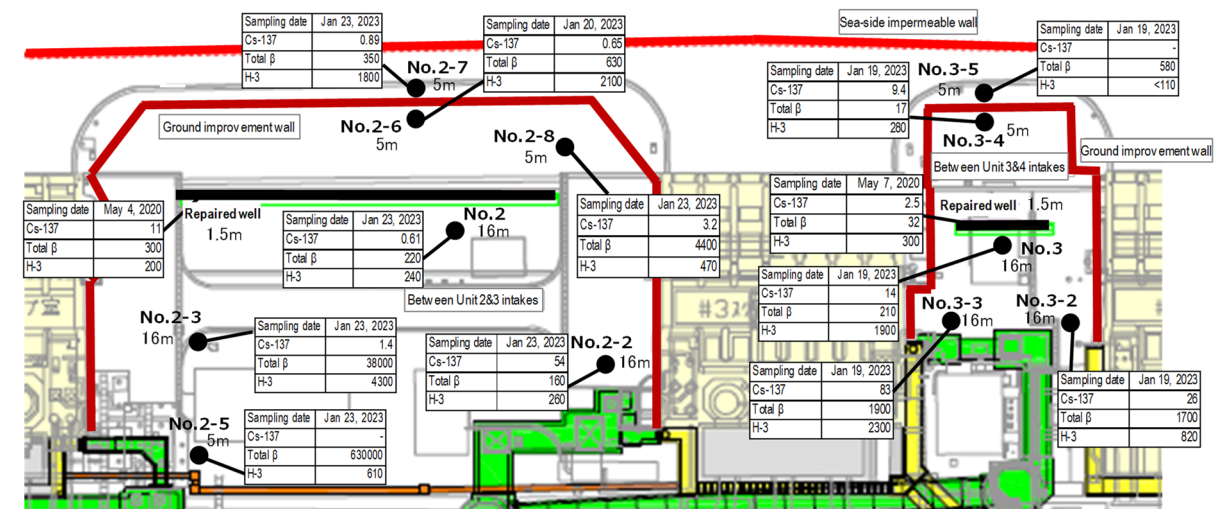

<Between Unit 2 and 3 intakes, between Unit 3 and 4 intakes>

Figure 4: Groundwater concentration on the Turbine Building east side

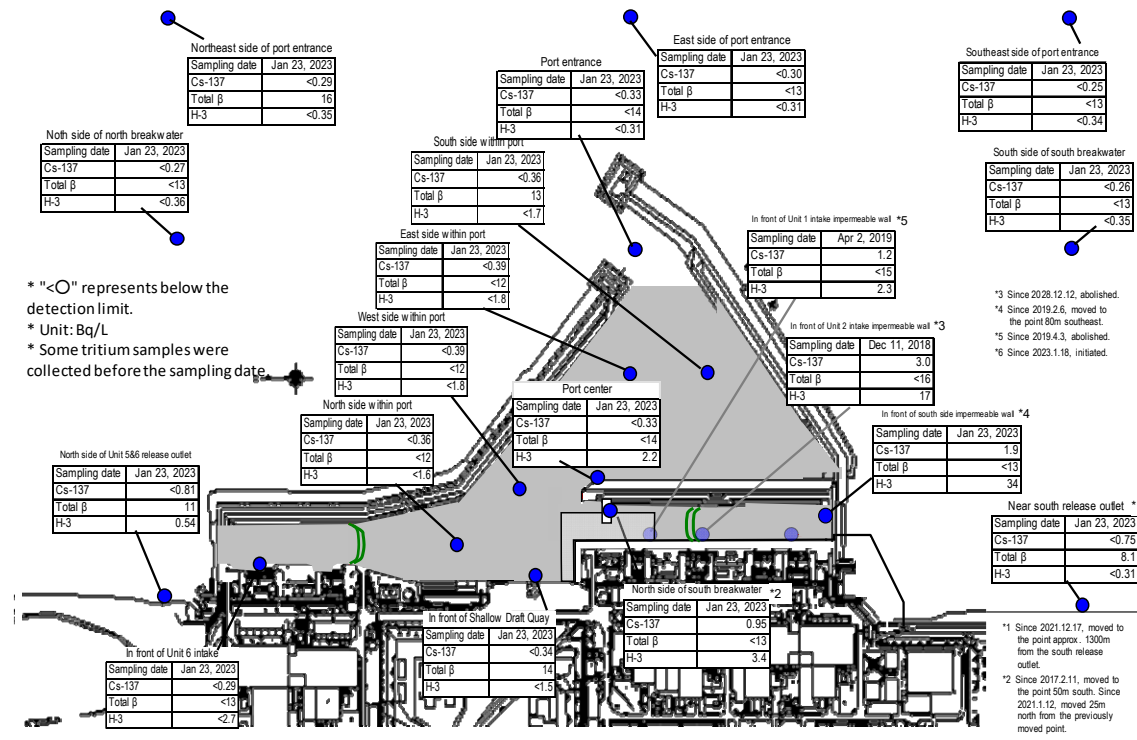


Figure 5: Seawater concentration around the port

Outlook of the number of staff required and efforts to improve the labor environment and conditions

Adequate number of staff will be secured in the long-term, while firmly implementing radiation control of workers. The work environment and labor conditions will be continuously improved by responding to the needs on the site.

➤ **Staff management**

- The monthly average total of personnel registered for at least one day per month to work on site during the past quarter from September to November 2022 was approx. 9,600 (cooperating company workers and TEPCO HD employees), which exceeded the monthly average workforce (approx. 7,600). Accordingly, sufficient personnel were registered to work on site.
- It was confirmed with the prime contractors that the estimated manpower necessary for the work in February 2023 (approx. 4,500 workers per day: cooperating company workers and TEPCO HD employees) would be secured at present. The average numbers of workers per day for each month (actual values) for the most recent 2 years were maintained, with approx. 3,000 to 4,600.
- The number of workers from within Fukushima Prefecture remained constant and the number outside decreased slightly. The local employment ratio (cooperating company workers and TEPCO HD employees) as of December 2022 remained constant at around 70%.
- The average exposure doses of workers were approx. 2.54 and 2.60 and 2.51 mSv/person-year during FY2019, 2020 and 2021, respectively (The legal exposure dose limits are 100 mSv/person and 50 mSv/person-year over five years, the TEPCO HD management target is 20 mSv/person-year).
- For most workers, the exposure dose was sufficiently within the limit and allowed them to continue engaging in radiation work.

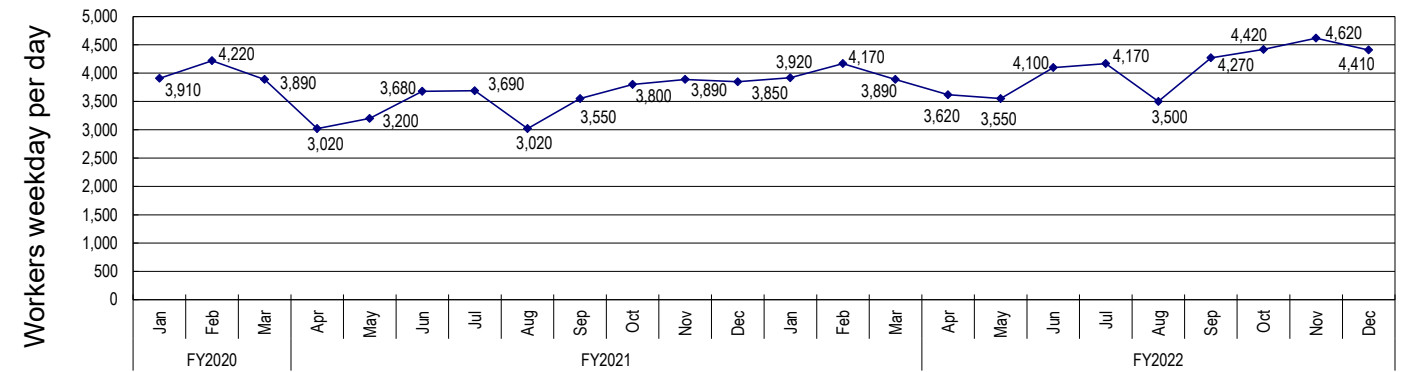


Figure 6: Changes in the average number of workers weekday per day for each month of the past 2 years (actual values)

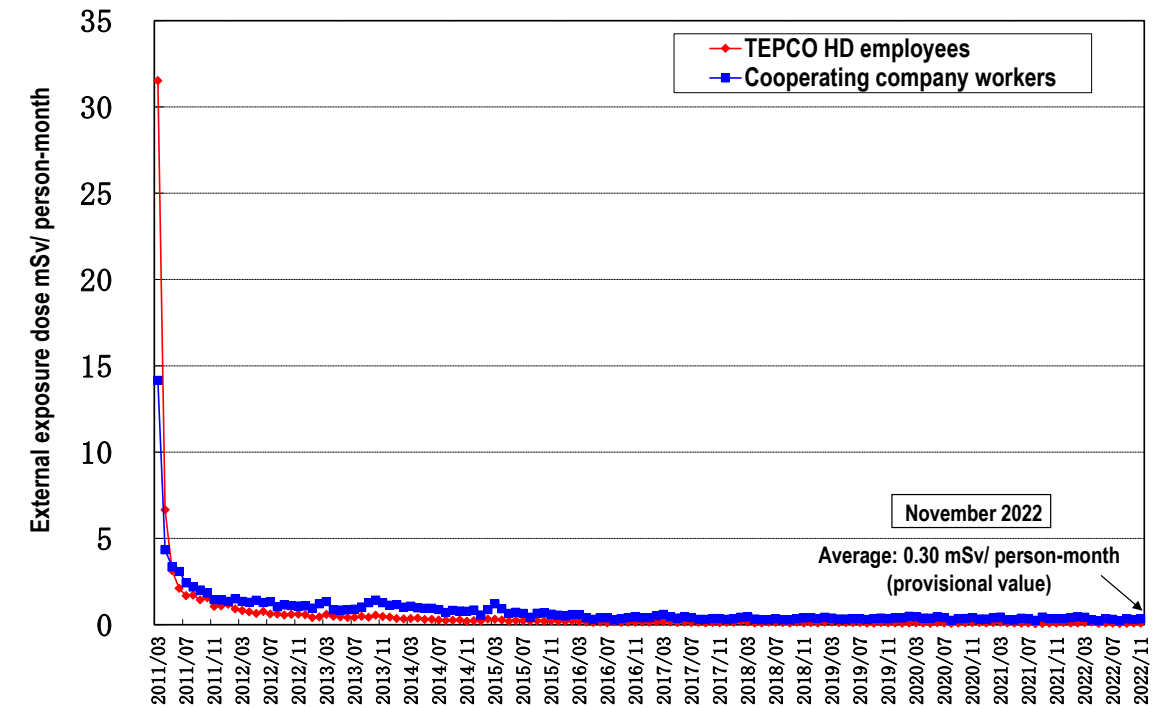


Figure 7: Changes in monthly average exposure dose of individual worker (monthly exposure dose since March 2011)

➤ **Countermeasures to suppress the spread of COVID-19 infections**

- In the Fukushima Daiichi Nuclear Power Station, infections have been decreasing, since peaking in mid- to late November. However, based on the infection status across Japan and in Fukushima Prefecture, ongoing basic countermeasures to prevent infection spreading, such as requiring employees to take their temperature before coming to the office, wear masks at all times, avoid the “Three Cs” by using the rest house in shifts, eat silently and carefully select business travel, continued to be properly implemented to proceed with decommissioning work, prioritizing safety above all.
- As of January 25, 2023,
 - (1) 1,703 workers (including 273 TEPCO HD employees, 1,425 cooperating company workers, 3 business partner company employees and 2 temporary workers) of the Fukushima Daiichi Nuclear Power Station had contracted COVID-19, an increase in 120 workers (including 27 TEPCO HD employees and 93 cooperating company workers) from the figures in the previous published material (as of December 21, 2022).
 - (2) Regarding the workplace COVID-19 vaccination program (for the omicron variant), which has been implemented since November 28, 2022, 1,704 workers (including 429 TEPCO HD employees and 1,275 cooperating company workers) had been vaccinated.
- No significant influence on decommissioning work, such as a corresponding delay to work processes due to this infection, had been identified.

- Health management of workers in the Fukushima Daiichi Nuclear Power Station
 - As health management measures in line with the guidelines of the Ministry of Health, Labour and Welfare (issued in August 2015), a scheme was established and operated, whereby prime contractors confirmed reexamination at medical institutions and the subsequent status of workers who were diagnosed as requiring “detailed examination and treatment” in the health checkup, with TEPCO confirming the operation status by the prime contractors.
 - The recent report on the management status of the health checkup during the second quarter (July – September) in FY2022 confirmed that the prime contractors had provided appropriate guidance and managed operations properly under the scheme. The report on the follow-up status during the first quarter in FY2022 and before confirmed that responses to workers, which had not been completed by the time of the previous report, were being provided on an ongoing basis and checking of operations will continue.
- Measures to prevent infection and expansion of influenza and norovirus
 - Since November, measures for influenza and norovirus have been implemented, including free influenza vaccinations (subsidized by TEPCO HD) at medical clinics around the site (from October 11, 2022 to January 28, 2023) for cooperating company workers. As of January 21, 2023, a total of 4,607 workers had been vaccinated. In addition, a comprehensive range of other measures is also being implemented, including daily actions to prevent infection and expansion (measuring body temperature, health checks and monitoring infection status) and response after detecting possible infections (swift exit of possible patients and control of entry, mandatory wearing of masks in working spaces, etc.).
- Status of influenza and norovirus cases
 - Until the 3rd week of 2023 (January 16-22, 2023), 19 influenza and three norovirus infections were recorded. The totals for the same period for the previous season also showed no influenza and three norovirus infections.


Note: The above data is based on reports from TEPCO HD and cooperating companies, which include diagnoses at medical clinics outside the site.
The subjects of this report were cooperating company workers and TEPCO HD employees in Fukushima Daiichi and Daini Nuclear Power Stations.

Status of seawater monitoring within the port (comparison between the highest values in 2013 and the latest values)

“The highest value” → “the latest value (sampled during December 26 - January 21)”; unit (Bq/L); ND represents a value below the detection limit

Summary of TEPCO data as of January 22, 2023

Note: The Total β measurement values include natural potassium 40 (approx. 12 Bq/L). They also include the contribution of yttrium 90, which radioactively balance strontium 90.

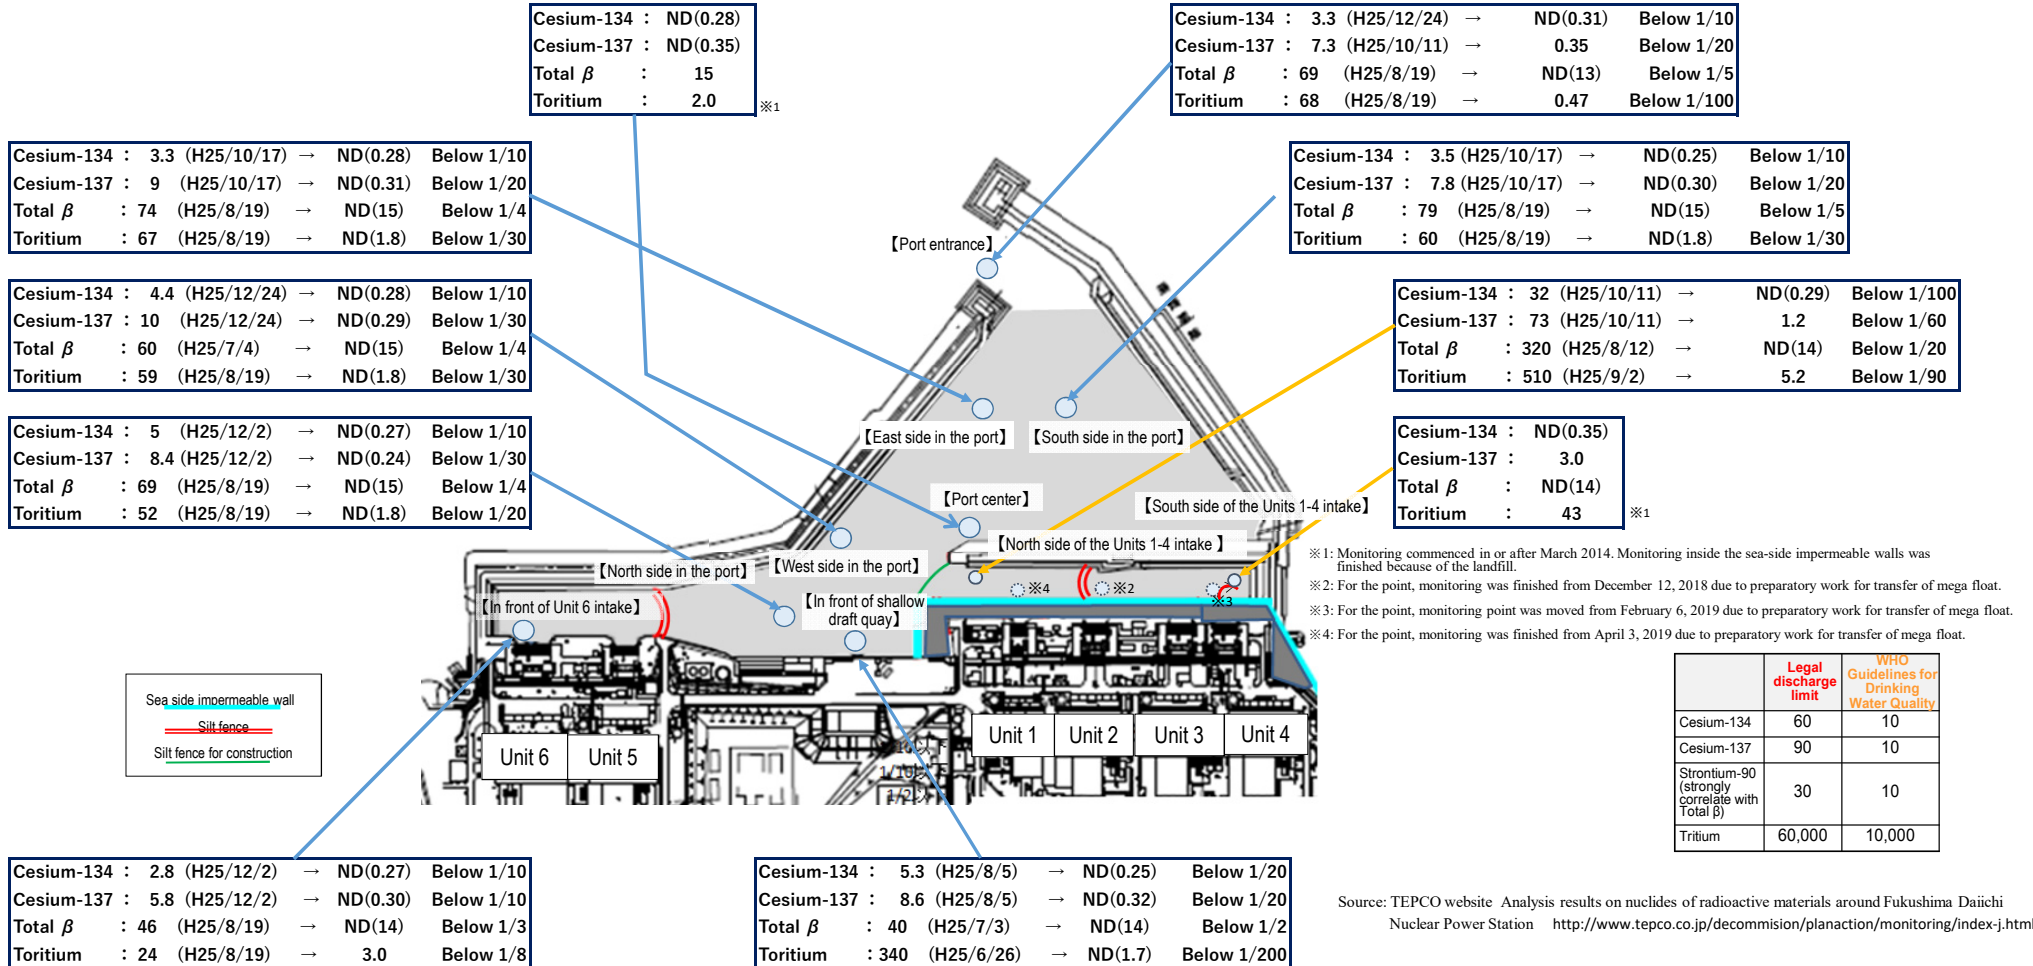


Status of seawater monitoring around outside of the port (comparison between the highest values in 2013 and the latest values)

Unit (Bq/L); ND represents a value below the detection limit; values in () represent the detection limit; ND (2013) represents ND throughout 2013 (The latest values sampled during December 26 - January 21)

Summary of TEPCO data as of January 22, 2023

	Legal discharge limit	WHO Guidelines for Drinking Water Quality
Cesium-134	60	10
Cesium-137	90	10
Strontium-90 (strongly correlate with Total β)	30	10
Tritium	60,000	10,000

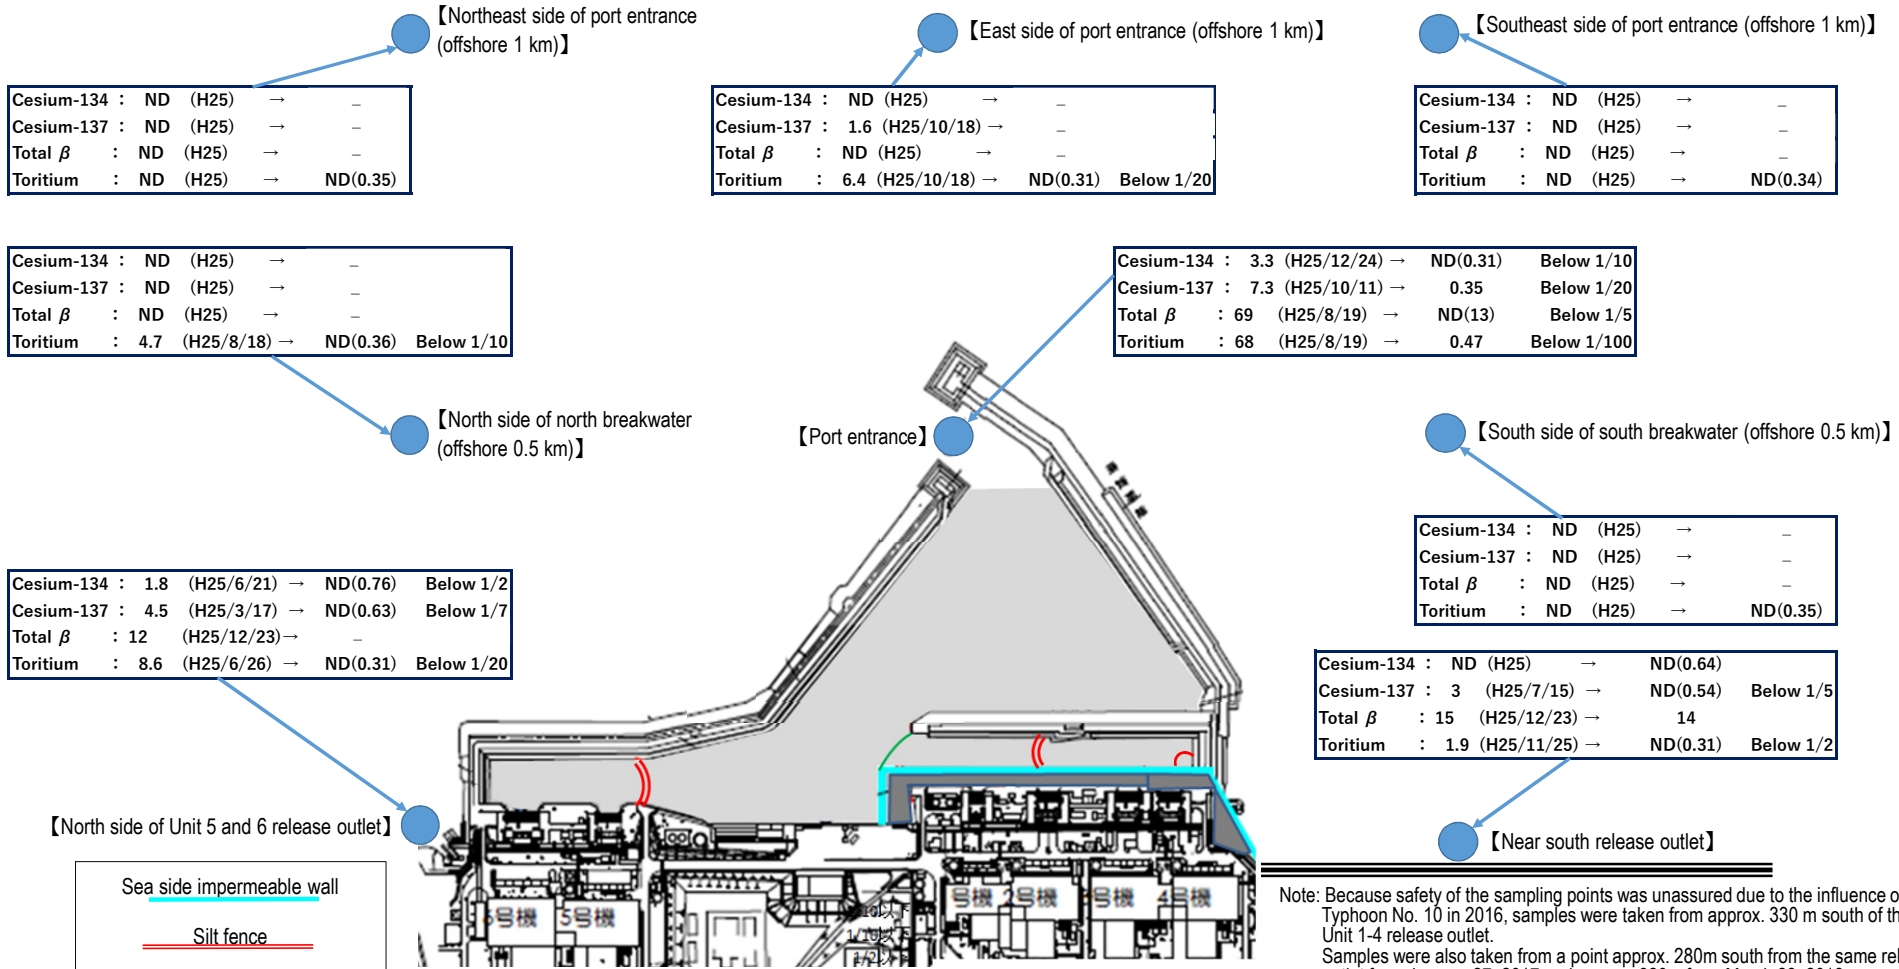


Note: The Total β measurement values include natural potassium 40 (approx. 12 Bq/L). They also include the contribution of yttrium 90, which radioactively balance strontium 90.

Note: Because safety of the sampling points was unassured due to the influence of Typhoon No. 10 in 2016, samples were taken from approx. 330 m south of the Unit 1-4 release outlet. Samples were also taken from a point approx. 280m south from the same release outlet from January 27, 2017 and approx. 320m from March 23, 2018.

Source: TEPCO website, Analysis results on nuclides of radioactive materials around Fukushima Daiichi Nuclear Power Station <http://www.tepco.co.jp/decommission/planaction/monitoring/index-j.html>

TEPCO Holdings Fukushima Daiichi Nuclear Power Station Site Layout

Appendix 2
January 26, 2023

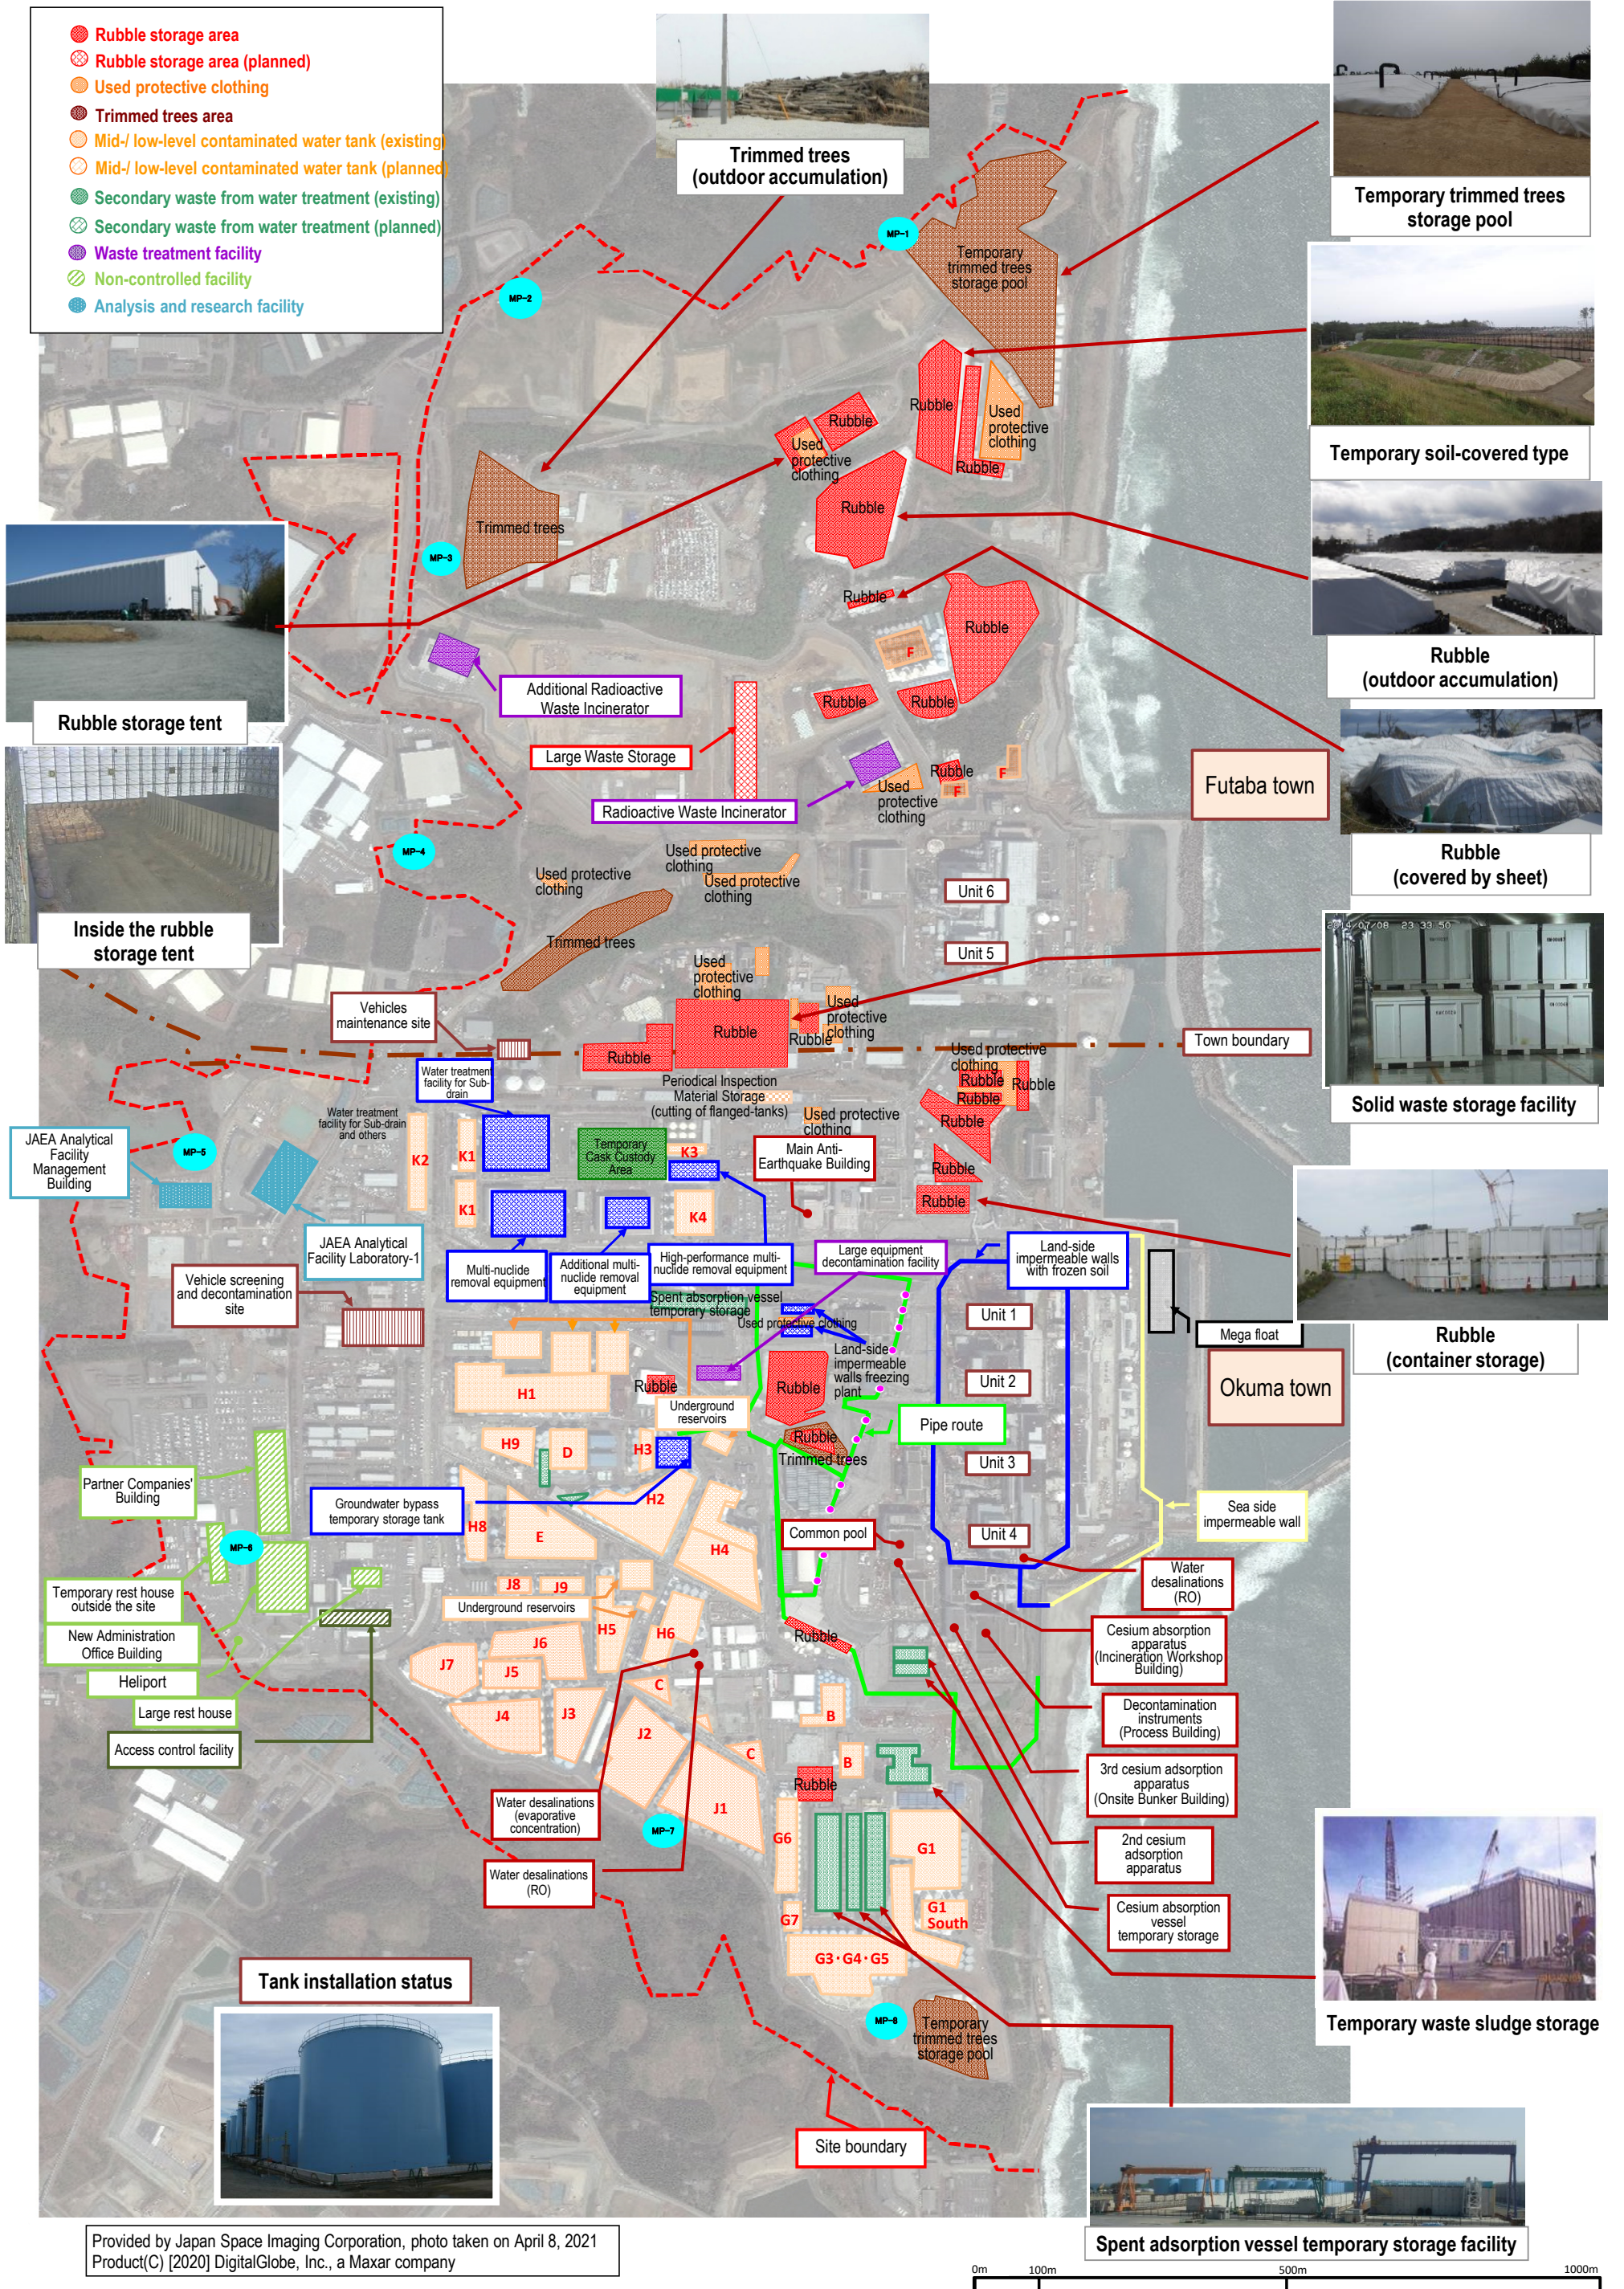

Provided by Japan Space Imaging Corporation, photo taken on April 8, 2021
Product(C) [2020] DigitalGlobe, Inc., a Maxar company

Spent adsorption vessel temporary storage facility




1 Contaminated water management

- [Completed] Suppressing the amount of contaminated water generated to 150 m³/day or less (within 2020)
- [Completed] Suppressing the amount of contaminated water generated to 100 m³/day or less (within 2025)
- [Completed] Treatment of contaminated water in buildings was completed* (within 2020) *Except for Units 1-3 Reactor Buildings, Process Main Building and High Temperature Incinerator Building.
- Contaminated water in Reactor Buildings was reduced to about a half of the level at the end of 2020 (FY2022-FY2024)

- Efforts to promote contaminated water management based on three basic policies:
 - ① "Remove" the source of water contamination
 - ② "Redirect" fresh water from contaminated areas
 - ③ "Retain" contaminated water from leakage

		2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023
Contaminated water management [Remove]	Contaminated water treatment facility	▼Reception start of contaminated water to Central Waste Treatment Building ▼Decontamination equipment (AREVA) ▼Evaporative concentration equipment ▼Cesium Adsorption Apparatus (KURION) ▼2nd Cesium Adsorption Apparatus (SARRY)	▼Cesium Adsorption Apparatus (KURION)	▼Multi-nuclide Removal Equipment (ALPS) (System A: from 2013.3.30, System B: from 2013.6.13, System C: from 2013.9.27, hot tests conducted)	▼Treatment of RO-condensed salt water complete ▼Reduction of strontium by Cesium Adsorption Apparatus (KURION) (from 2015.1.6) ▼Reduction of strontium by 2nd Cesium Adsorption Apparatus (SARRY) (from 2014.12.26)	▼Treatment start of strontium-reduced water (ALPS: from 2015.12.4, additional: from 2015.5.27, high-performance: from 2015.4.15) ▼Multi-nuclide Removal Equipment (additional ALPS) ▼Multi-nuclide Removal Equipment (high performance ALPS) (from 2014.10.18, hot tests conducted)	▼Start of full-scale operation (from 2017.10.16)	▼Purification of strontium-reduced water in flanged tanks complete ▼Reduction of strontium by 3rd Cesium Adsorption Apparatus (SARRY II) (from 2019.7.12)	▼Purification of strontium-reduced water complete					
	Removal of contaminated water from seawater pipe trench	▼Cesium Adsorption Apparatus (KURION)	▼Multi-nuclide removal equipment (ALPS)	▼Completion of tunnel filling ▼Transfer of stagnant water complete	▼Completion of tunnel filling ▼Transfer of stagnant water complete ▼Completion of shaft filling (except for upper part of S)	▼Completion of tunnel filling ▼Filling of openings II and III complete ▼Transfer stagnant water complete ▼Completion of filling parts running over	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling	▼Completion of shaft filling
Contaminated water management [Redirect]	Groundwater bypass	▼Installation start of groundwater bypass	▼Operation start of groundwater bypass (drainage started from 2014.5.21)											
	Sub-drain	▼Recovery of existing sub-drain pit and start of new installation ▼Installation start of Water-Treatment Facility special for Sub-drain & Groundwater drains	▼Operation start of sub-drain (drainage started from 2015.9.14)	▼Enhancement of treatment capacity (2000 m ³ /day)										
	Land-side impermeable wall	▼Installation start of land-side impermeable walls	▼Freezing start	▼Freezing completion (except for some parts)	▼Freezing completion	▼Freezing completion (except for some parts)	▼Freezing completion	▼Freezing completion	▼Freezing completion	▼Freezing completion	▼Freezing completion	▼Freezing completion	▼Freezing completion	▼Freezing completion
	Facing	▼Completion of waterproof pavement (facing) (except for areas of 2.5 and 6.5m above sea level and around Unit 1-4)	▼Completion of waterproof pavement (facing) (except for around Unit 1-4)											
Contaminated water management [Retain]	Bank groundwater measures	▼Installation start of seaside impermeable walls	▼Installation of seaside impermeable walls complete	▼Operation start of groundwater drain (pumping-up started on 2015.11.5)										
	Storage facility	▼Storage in steel square tanks ▼Storage in flanged cylindrical tanks ▼Water leakage (10L) from flanged tank	▼Water leakage (300L) from flanged tank ▼Water leakage (1000) from flanged tank ▼Completion of fence to prevent leakage expanding ▼Work to raise fence height complete	▼Leakage of contaminated water from underground reservoir => Start of transfer to tanks ▼Transfer of contaminated water to tanks complete ▼Storage in cylindrical steel welded-joint tanks	▼Construction of welded-joint tanks	▼Purification of strontium-reduced water in flanged tanks complete ▼Transfer and storage of all treated water in welded-joint tanks	▼Purification of strontium-reduced water complete							
Treatment of stagnant water		▼Installation of stagnant water transfer equipment/transfer start	▼Completion of work to improve reliability of transfer line (replacement with PE pipes)	▼Transfer start from each building to Central Rw Building										
Countermeasures to tsunami risks	Closure of openings		▼Examination start of measures to close building openings ▼Work for common pool complete	▼Work for Units 1 and 2 TIB complete ▼Work for HTI building complete										
	Seawall	▼Installation of outer-tie tsunami seawall complete												
	Mega float													

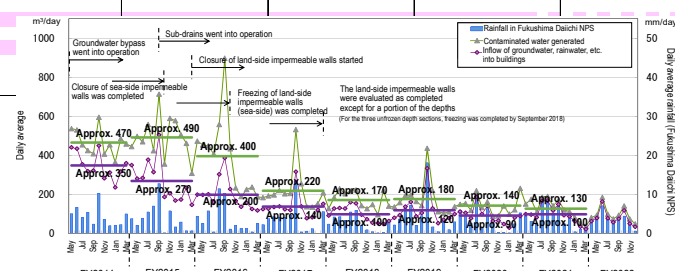

Chishima Trench Tsunami Seawall complete

Construction of Japan Trench Tsunami Seawall

2 Handling of ALPS treated water

In "The Inter-Ministerial Council for Contaminated Water, Treated water and Decommissioning" held on April 13, the basic policy on how to handle ALPS treated water was set. Based on this, the response of TEPCO was announced on April 16.

Regarding the discharge of ALPS treated water into the sea, TEPCO must comply with regulatory and other safety-related standards to ensure the safety of the public, surrounding environment and agricultural, forestry and fishery products. To minimize adverse impacts on reputation, monitoring will be further enhanced, objectivity and transparency ensured by engaging with third-party experts and safety checked by the IAEA. Moreover, accurate information will be disseminated continuously and in a highly transparent manner.

Enhancement of communication activities


- Measures for decommissioning, contaminated water and treated water of the Fukushima Daiichi Nuclear Power Station need efforts to reduce risks over a long term. Regarding handling of ALPS treated water as a part of decommissioning, to local residents, those who in the fishery industry and related parties, we will thoroughly explain about the policies and responses concerning the facility design, operation and management to ensure safety, monitoring of radioactive materials and others, and proceed with **efforts to sincerely face their concerns and interests and respond to each of them.**
- Moreover, to **further deepen the understanding** of everyone in Japan and overseas, efforts to **coherently disseminate** measurement results of ALPS treated water and information concerning facility operation, radiation impact assessment and others will continue and be enhanced.
- Information dissemination via media in Japan and overseas and others
 - To help deliver information based on scientific evidence, press release, press conference, disclosure of power plant site, briefing and others are held.
 - For overseas major media, diplomatic corps and others, briefing and press tour are held. Information dissemination to neighboring countries is also being enhanced. Information dissemination to overseas media and information provision to embassies is focused. Ex.) May 10, 2022 Diplomatic corps and others, overseas media and others
- Safety review of International Atomic Energy Agency (IAEA)
 - In February 2022, IAEA officials and international professionals (US/ UK/ France/ Russia/ China/ others) visited Japan to conduct technical inspection based on the international safety standard and on April 29, the report of safety assessment was published.
 - The report states that in regards to the safety of the facility, the IAEA has found that, "TEPCO successfully incorporated prevention measures in the design of the facility as well as in the associated operating procedures." In regards to the Radiological Environmental Impact Assessment, "it acknowledged that the doses to the assumed representative person are expected to be very low and significantly below the dose constraint set by the Japanese regulatory body."




IAEA onsite investigation



Discussion meeting (face-to-face dialogue)

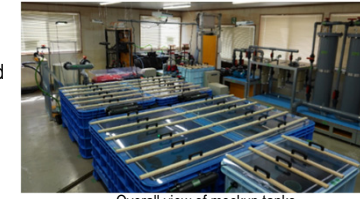

Overall view of mockup tanks



Flounder in rearing preparation tank

- Communication with related parties taking various opportunities
 - Efforts to explain about policies and safety measures for handling of ALPS treated water, countermeasures to rumors and others to people in the Metropolitan area, local residents and related parties and hear their opinions proceed. (In FY2021, approx. 3,000 times)
 - Visits and Discussion Meetings of the Fukushima Daiichi Nuclear Power Station have been held since FY2019 for 13 municipalities in Hamadori. In FY2021 and FY2022, the Visits and Discussion Meetings were expanded to within Fukushima Prefecture. (In FY2022, a total of 17 times are scheduled)
 - Moreover, online visits (connecting visitors and guide online) utilizing the "Fukushima Daiichi Virtual Tour" video, which is now being published on the TEPCO web site, and others are also offered in response to the need of people in Japan and overseas. (From August 2020 to July 2022 Online visitors: 59 organizations, 2,250 persons including overseas organizations)
- Rearing test of marine organisms
 - To alleviate concerns and lead to relief of local residents, related parties and the everyone in society, marine organisms are being reared in tanks of seawater containing ALPS treated water and the status is compared with the original seawater controls. The progress will be shown coherently and clearly.
 - Regarding behaviors of tritium and others, a lot of research has been conducted in Japan and overseas. Based on the experimental results, firstly experimental data for a half year will be collected and subsequently, the same as past experimental results, the theory "tritium in vivo is not concentrated and the concentration of tritium in vivo will not exceed the level in the growing environment" will also be reaffirmed.
 - From March 2022, practice to rear flounder started using coastal seawater around the nuclear power station to learn how to rear marine organisms, verify the equipment design and others.
 - From September 30, the stage was shifted to the next "rearing test" and on October 3, ALPS treated water was added.

- From March 17, daily rearing status is published on the TEPCO HD homepage and twitter.
- Homepage address: <http://www.tepco.co.jp/decommission/information/newsrelease/breedinqtest/index-j.html>
- Twitter address: <https://twitter.com/TEPCOfishkeeper>



Examination concerning handling of ALPS treated water

Tritiated Water Taskforce (2013.12 – 2016.5, 15 meetings)



Tank area viewed from the Large Rest House (2015.10.29)

2016.6 Report of Tritiated Water Taskforce

Subcommittee on Handling of ALPS treated water (2016.11 – 2020.1, 17 meetings)

2018.8 Explanatory and hearing meeting, receiving opinions

2020.2 Report of Subcommittee on Handling of ALPS treated water

Opportunity for receiving opinions from parties concerned concerning handling of ALPS treated water (2020.4 – 2020.10, 7 meetings)

Review meeting concerning the implementation plan on handling of ALPS treated water (from 2021.7 to 2022.4, 15 meetings) 2022.4.28, 5.13, 7.15



Application to partially revise the Application Documents for Approval to Amend the Implementation Plan was submitted 2022.7.22
 Application for the Application Documents for Approval to Amend the Implementation Plan was approved 2022.8.4 Work has commenced

2021.4.13 The basic policy on the handling of ALPS treated water was set
 2021.4.16 The response of TEPCO was announced


2022/8/30 The "Approach to Strengthening and Expansion of Measures in the Handling of ALPS Treated Water" was summarized

2022.11.14 Application for the Application Documents for Approval to Amend the Implementation Plan was submitted (amendment of organizational structure, and nucleides to be measured and assessed, and others)

Overview of ALPS treated water dilution and discharge facility

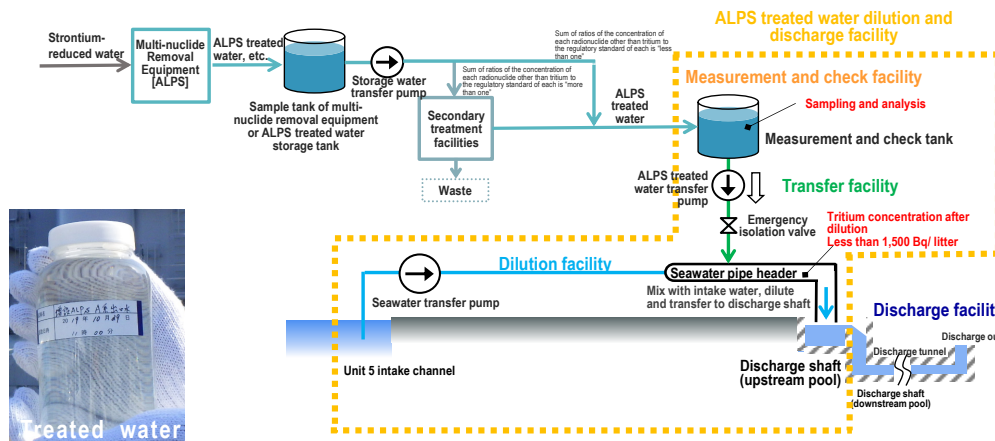


Treated water

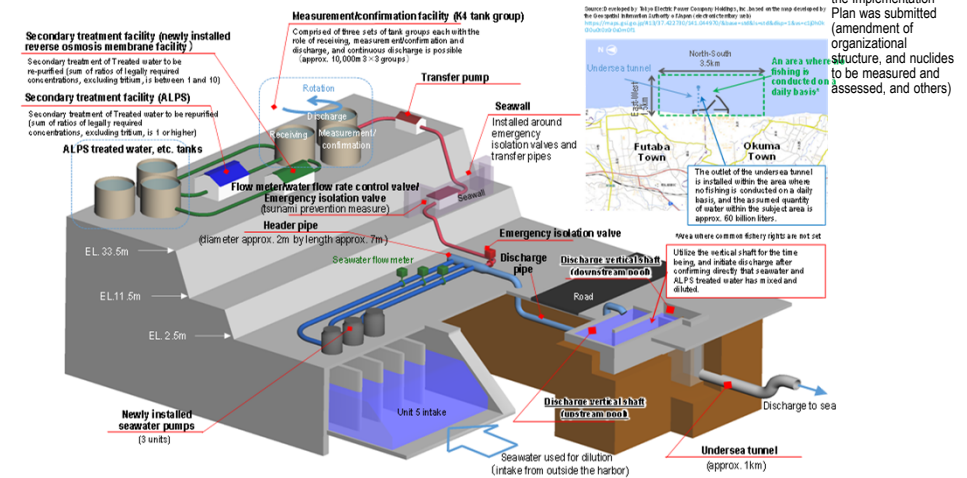

3 Removal of fuel from spent pool

Milestones of the Mid- and-Long-Term Roadmap (major target processes)

- Completion of Unit 1-6 fuel removal (within 2031)
- Completion of installation of Unit 1 large cover (around FY2023), start of Unit 1 fuel removal (FY2027-2028)
- Start of Unit 2 fuel removal (FY2024-2026)

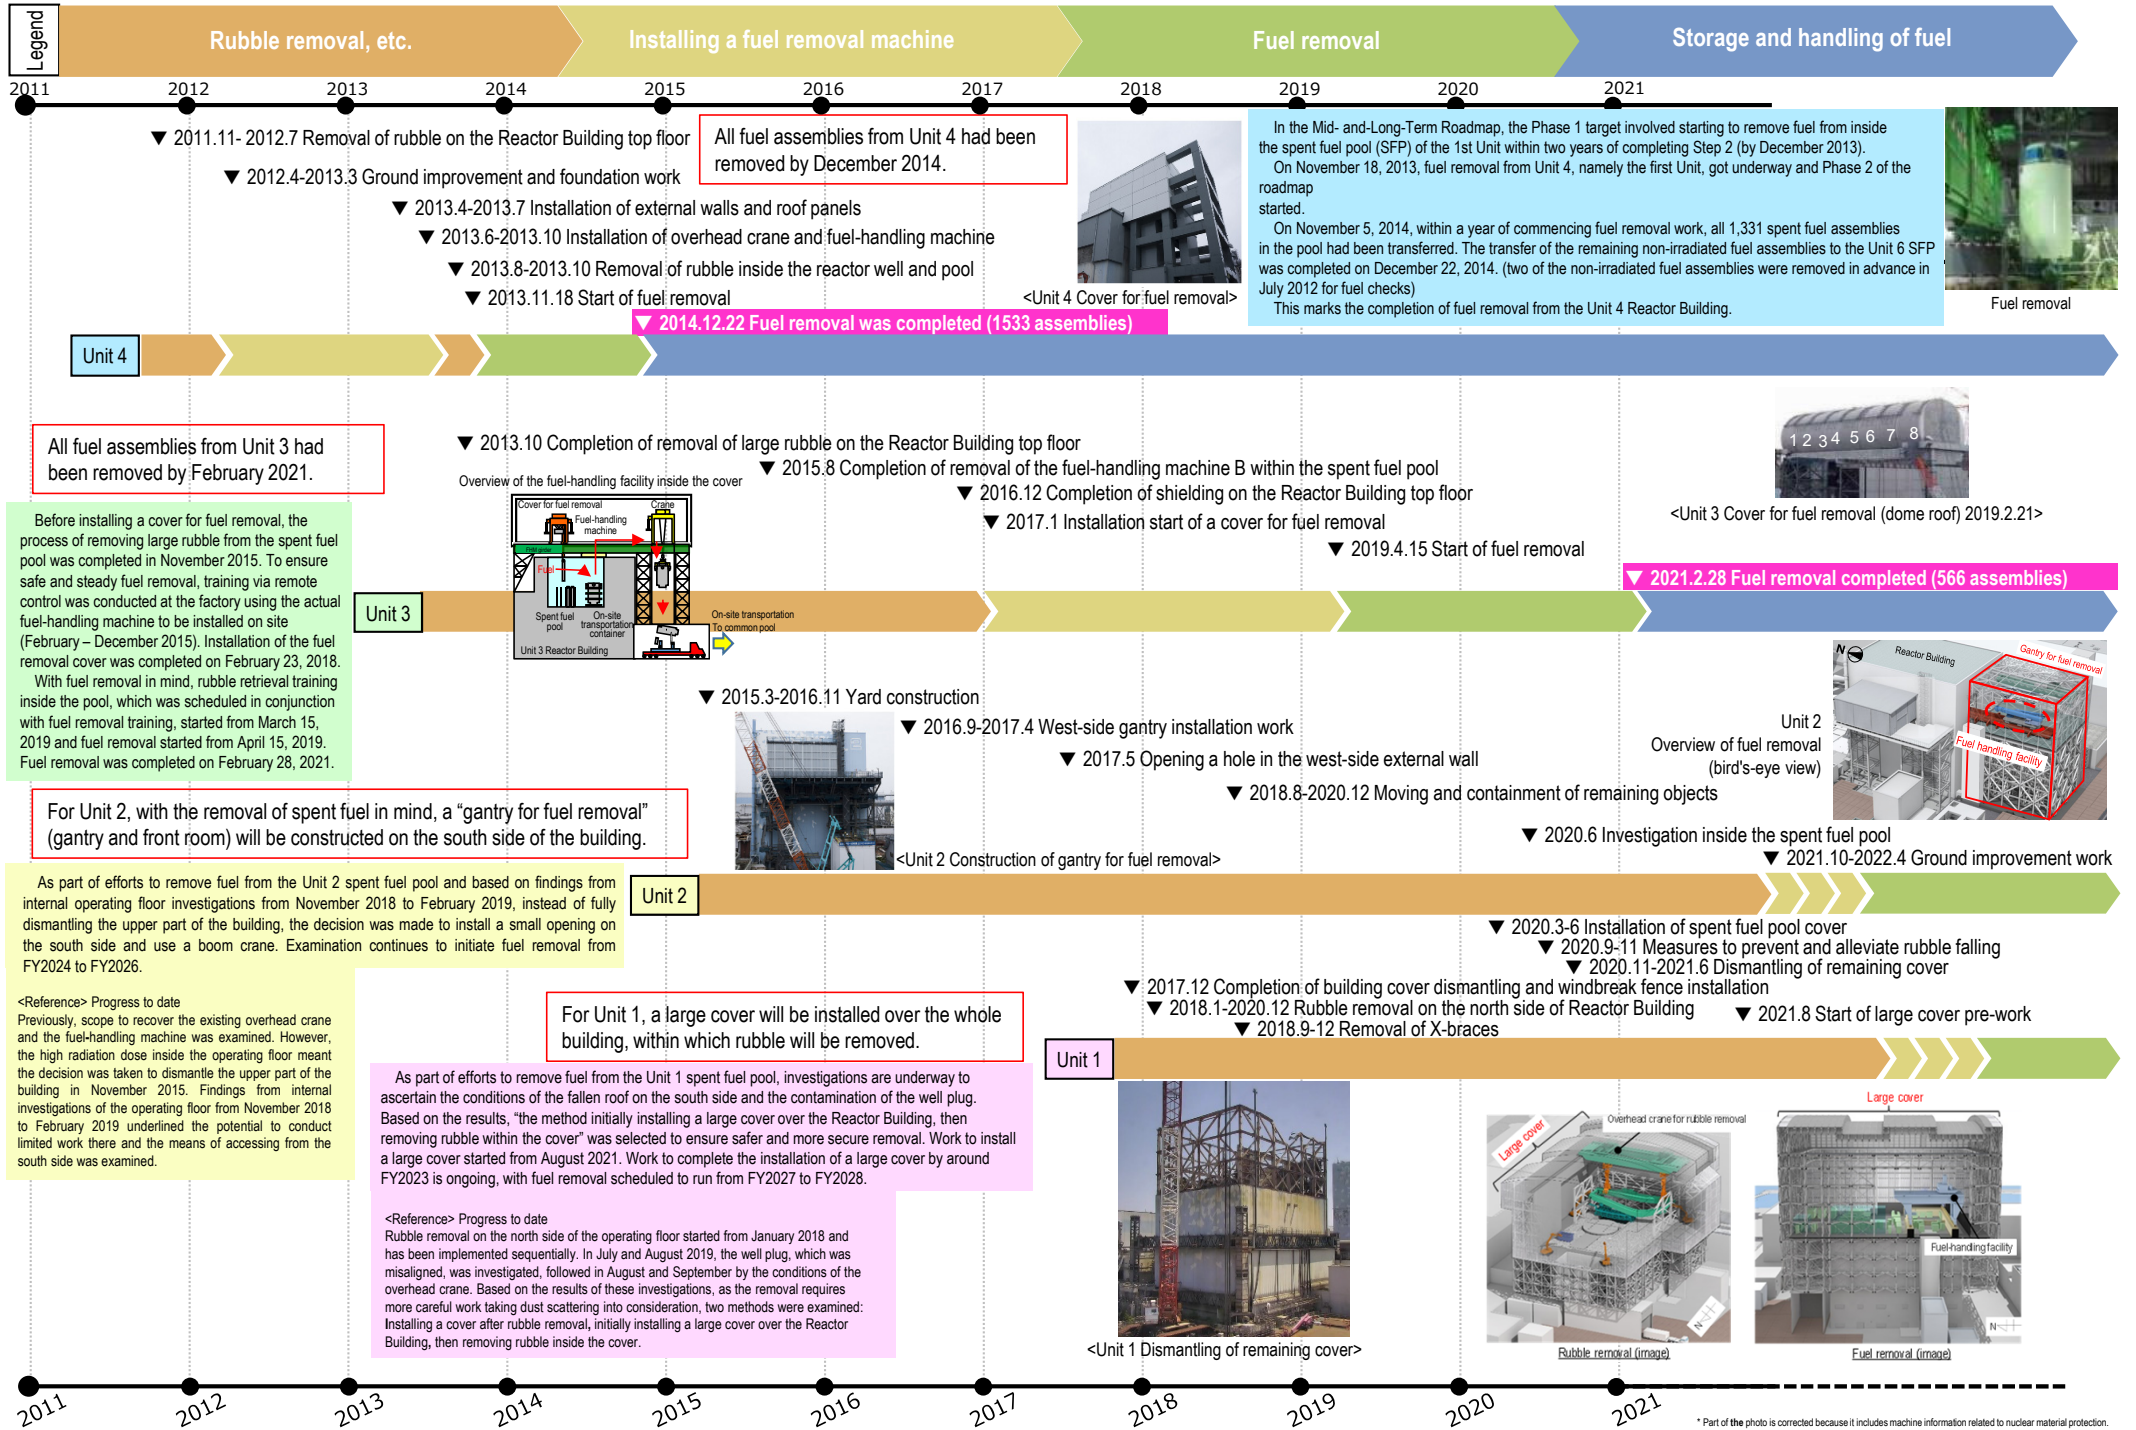

* Part of the photo is corrected because it includes machine information related to nuclear material protection.


Milestones of the Mid- and Long-Term Roadmap (major target processes)

Start of fuel debris retrieval from the first unit (Unit 2). Expanding the scale in stages (within 2021 * The schedule will be extended for about 1 year due to the spread of COVID-19 infections)

Before removing fuel debris, investigations inside the Primary Containment Vessel (PCV) are conducted to inspect the conditions there, including locations of fuel debris.


Unit 1 Investigation overview

- In April 2015, a device having entered the inside of the PCV via a narrow opening (bore:φ100 mm) collected information such as images and airborne dose inside the PCV 1st floor.
- In March 2017, an investigation using a self-propelled investigation device was conducted to inspect the spreading of debris to the basement floor outside the pedestal, with images taken of the PCV bottom status for the first time. The conditions inside the PCV will continue to be examined, based on the imagery and dose data obtained.

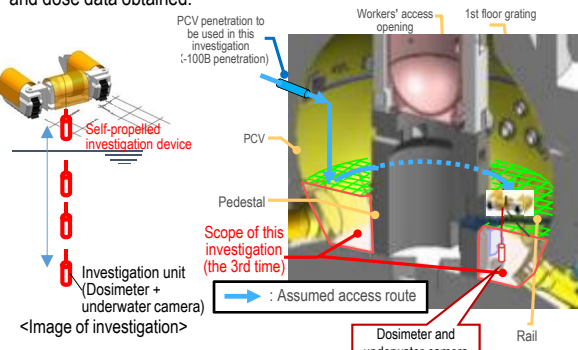

In February, the first remotely operated underwater vehicle (ROV-A) was inserted to install "guide rings" which will facilitate the investigation. As installation of guide rings has been completed, then a detailed investigation will be implemented.

In this investigation, distribution of deposits outside the pedestal and their characteristics or others will also be investigated. The results of these investigations will be utilized in the examination of method and procedures toward future debris retrieval.

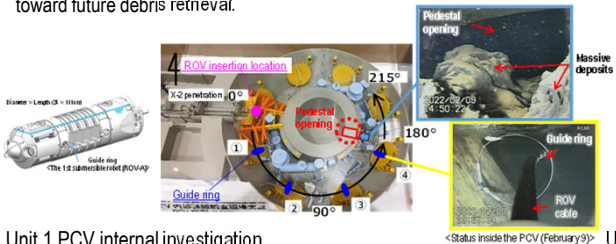

Unit 2 Investigation overview

- In January 2017, a camera was inserted from the PCV penetration to inspect the conditions of the rail on which the robot traveled. The results of a series of investigations confirmed some gratings had fallen and deformed as well as a quantity of deposit inside the pedestal.
- In January 2018, the conditions below the platform inside the pedestal were investigated. Based on the analytical results of images obtained in the investigation, deposits, probably including fuel debris, were found at the bottom of the pedestal. Moreover, multiple parts exceeding the surrounding deposits were also detected. We presumed that there were multiple instances of fuel debris falling.
- In February 2019, an investigation touching the deposits at the bottom of the pedestal and on the platform was conducted and confirmed that the pebble-shaped deposits, etc. could be moved and that hard rock-like deposits that could not be gripped may exist.




- In October 2020, as part of work to prepare for the PCV internal investigation and trial retrieval, a contact investigation to study deposits inside the penetration (X-6 penetration) was conducted, which involved inserting a guide pipe incorporating an investigative unit into the penetration. This confirmed that deposits inside the penetration had not deformed and come unstuck. The investigative information obtained will be utilized in the mockup test of the equipment to remove deposits inside the X-6 penetration.



Unit 3 Investigation overview

- In October 2014, the conditions of X-53 penetration, which may be under water and which is scheduled for use to investigate the inside of the PCV, was investigated via remote-controlled ultrasonic test equipment. The results showed that the penetration was not under water.
- In October 2015, to confirm the conditions inside the PCV, an investigative device was inserted into the PCV from X-53 penetration to obtain images, data on dosage and temperature and sample stagnant water. No damage to the structure and walls inside the PCV was identified and the water level was almost identical to estimated values. In addition, the dose inside the PCV was confirmed to be lower than in other Units.
- In July 2017, the inside of the PCV was investigated using the underwater ROV (remotely operated underwater vehicle) to inspect the inside of the pedestal. Analysis of the imagery obtained in the investigation identified damage to multiple structures and the supposed core internals.
- Videos obtained in the investigation were reproduced in 3D. Based on the reproduced images, the relative positions of the structures, such as the rotating platform slipping off the rail with a portion buried in deposits, were visually understood.

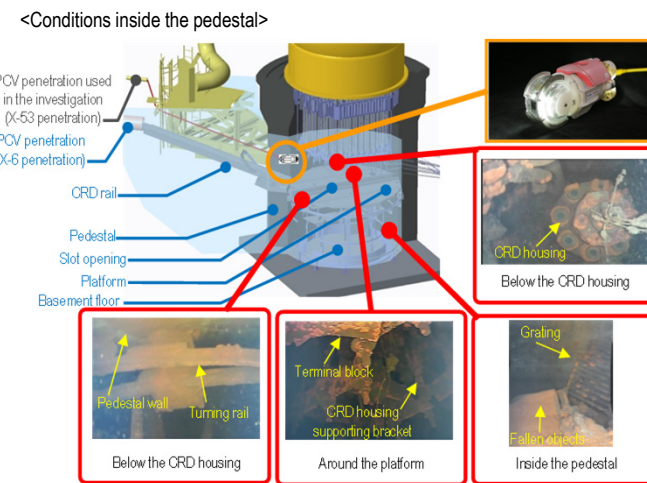

Unit 1 PCV internal investigation

Investigations inside the PCV	1st (2012.10)	- Acquiring images - Measuring the air temperature and dose rate - Measuring the water level and temperature - Sampling stagnant water - Installing permanent monitoring instrumentation
	2nd (2015.4)	Confirming the status of the PCV 1st floor - Acquiring images - Measuring the air temperature and dose rate - Replacing permanent monitoring instrumentation
	3rd (2017.3)	Confirming the status of the PCV 1st basement floor - Acquiring images - Measuring the dose rate - Sampling deposit - Replacing permanent monitoring instrumentation
Leakage points from PCV	- PCV vent pipe vacuum break line bellows (identified in 2014.5) - Sand cushion drain line (identified in 2013.11)	
Evaluation of the location of fuel debris inside the reactor by measurement using muons Confirmed that there was no large fuel in the reactor core. (2015.2-5)		

Unit 2 PCV internal investigation

Investigations inside the PCV	1st (2012.1)	- Acquiring images - Measuring the air temperature
	2nd (2012.3)	- Confirming water surface - Measuring the water temperature - Measuring the dose rate
	3rd (2013.2 - 2014.6)	- Acquiring images - Sampling stagnant water - Measuring water level - Installing permanent monitoring instrumentation
	4th (2017.1-2)	- Acquiring images - Measuring the dose rate - Measuring the air temperature
	5th (2018.1)	- Acquiring images - Measuring the dose rate - Measuring the air temperature
	6th (2019.2)	- Acquiring images - Measuring the dose rate - Measuring the air temperature - Determining characteristics of a portion of deposit
Leakage points from PCV	- No leakage from the torus chamber rooftop - No leakage from any internal/external surfaces of S/C	
Evaluation of the location of fuel debris inside the reactor by measurement using muons The existence of high-density materials, which were considered to constitute fuel debris, was confirmed at the bottom of RPV and in the lower part and outer periphery of the reactor core. It was assumed that a significant portion of fuel debris existed at the bottom of RPV. (2016.3-7)		

Unit 3 PCV internal investigation


Investigations inside the PCV	1st (2015.10-12)	- Acquiring images - Measuring the air temperature and dose rate - Measuring the water level and temperature - Sampling stagnant water - Installing permanent monitoring instrumentation (2015.12)
	2nd (2017.7)	- Acquiring images - Installing permanent monitoring instrumentation (2017.8)
Leakage points from PCV	- Main steam pipe bellows (identified in 2014.5)	
Evaluation of the location of fuel debris inside the reactor by measurement using muons The evaluation confirmed that no large lump existed in the core area where fuel had been placed and that a portion of the fuel debris potentially existed at the bottom of the RPV. (2017.5-9)		

While ensuring reliable exposure dose management for workers, sufficient personnel are secured. Moreover, while getting a handle on on-site needs, the work environment and labor conditions are continuously improved.

Regarding the site-wide reduction in the radiation dose and prevention of contamination spreading, the radiation dose on site was reduced by removal of rubble, topsoil and facing. Moreover, the operation was improved to use environmentally-improved areas as a Green Zone, within which workers are allowed to wear general work clothes and disposable dust-protective masks which are less of a physical burden.



To help workers in the Fukushima Daiichi NPS precisely understand the conditions of their workplaces, a total of 86 dose-rate monitors were installed by January 2015. These monitors allow workers to confirm on-site dose rates at their workplaces in real time.

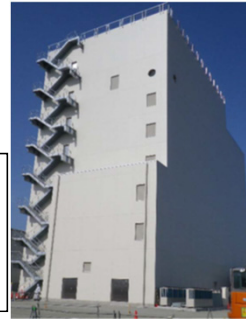

In February 2017, operation started at the Partner Companies' Building next to the New Administration Office Building.



External view of Access Control Facility

In June 2013, operation of the Access Control Facility started near the main gate of the Fukushima Daiichi NPS, to which duties conducted at J-village were shifted, including contamination examination, decontamination, switching protective equipment on and off and distribution/collection of dosimeters.


From March 12, 2011, in response to the increased airborne concentration of radioactive materials, instructions were issued to wear full-face masks throughout the Fukushima Daiichi NPS site, excluding the Main Anti-Earthquake Building and the rest house.

In March 2015, the Fukushima revitalization meal service center opened.

A large rest house for workers was established and its operation commenced in May 2015. Spaces in the large rest house are also installed for office work and collective worker safety checks as well as taking rest. In March 2016, a convenience store opened in the large rest house. In April, the shower room went into operation.

In May 2017, a heliport for emergency transport was installed inside the Fukushima Daiichi NPS and went into operation. Compared to the previous operation (at Koriyama Coast, Futaba Town or Fukushima Daini NPS, relying to a doctor helicopter), a faster response is available for seriously ill patients requiring treatment at external medical institutions.

From November 2018, from the west-side high-ground area, where Unit 1-4 can be viewed, visitors can see the site in their normal clothes without having to change.



Visit by Governor of Fukushima Prefecture to the Fukushima Daiichi NPS (2018.11.1)



Visit by Prime Minister Kishida to the Fukushima Daiichi NPS (2021.10.17)



Changes in operation of controlled area

From May 2013, full-face mask unnecessary area was expanded sequentially.


In May 2015, full-face mask unnecessary area was expanded to cover about 90% of the site.

In March 2017, the G-zone area was expanded (to cover 95% of the whole site).


In August 2021, operation started while eliminating the need for the DS2 mask during light work in G-zone outside the protection area around Unit 1-4 (except for inside Units 5 and 6).



In May 2013, areas excluding those around Unit 1-4, tank areas and rubble storage areas were set to full-face mask unnecessary areas.

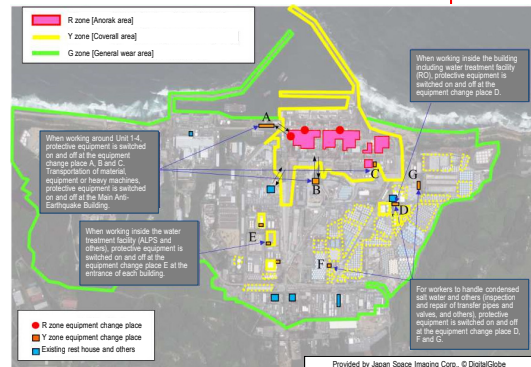

In March 2016, based on the progress of measures to reduce the environmental dosage on site, the site was categorized into two zones: Highly contaminated area around Unit 1-4 buildings, etc. and other areas where limited operation started to optimize protective equipment according to each category.

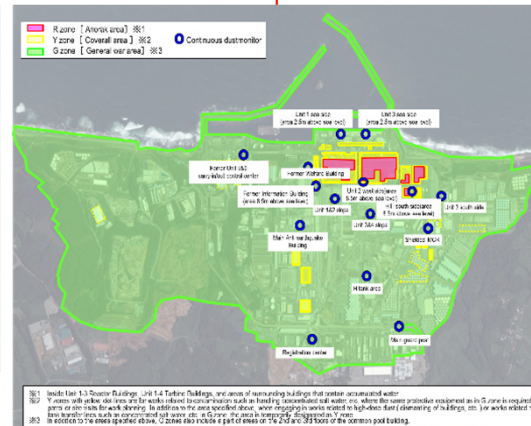

In May 2018, within about 96% of the site, workers are allowed to wear light equipment such as general workwear and disposable dust-protective masks.

<Travel survey results of major roads within the site>
The dose rate has been declining every year. In particular, in the area on the east side of the Turbine Building shown a black dotted line, the dose rate declined by facing related to installation of the seawall as the countermeasure to the Japan Trench tsunami.

