


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

* The graph shows data for the last sixteen months or so.

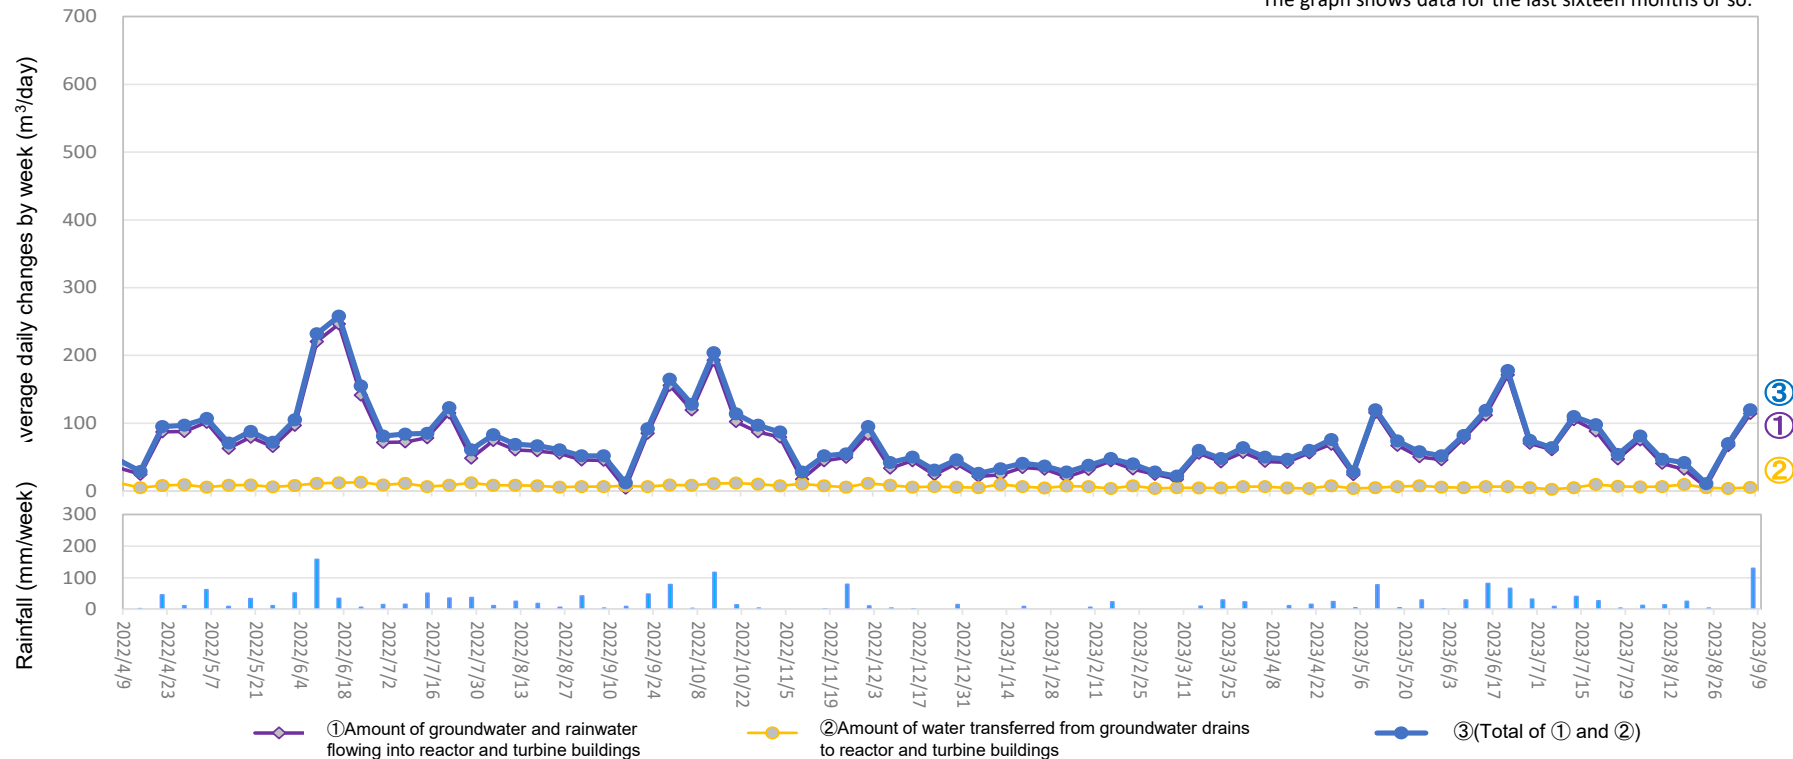

Amount of water transferred from groundwater drains to reactor and turbine buildings
(From August 31, 2023 to September 6, 2023)

Date	Temporary storage tanks			
	A	B	C	Total (α)
From Aug 31 to Sept 6	0	0	0	0

(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
5	0	0	5	5

* ①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 117 m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 5 m³/day, ③(Total of ① and ②): 122 m³/day, Rainfall: 130 mm/week

* There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Errors were corrected on September 25, 2023. (Before correction: ①114, ③120 After correction: ①117, ③122)

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

