


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

* The graph shows data for the last sixteen months or so.

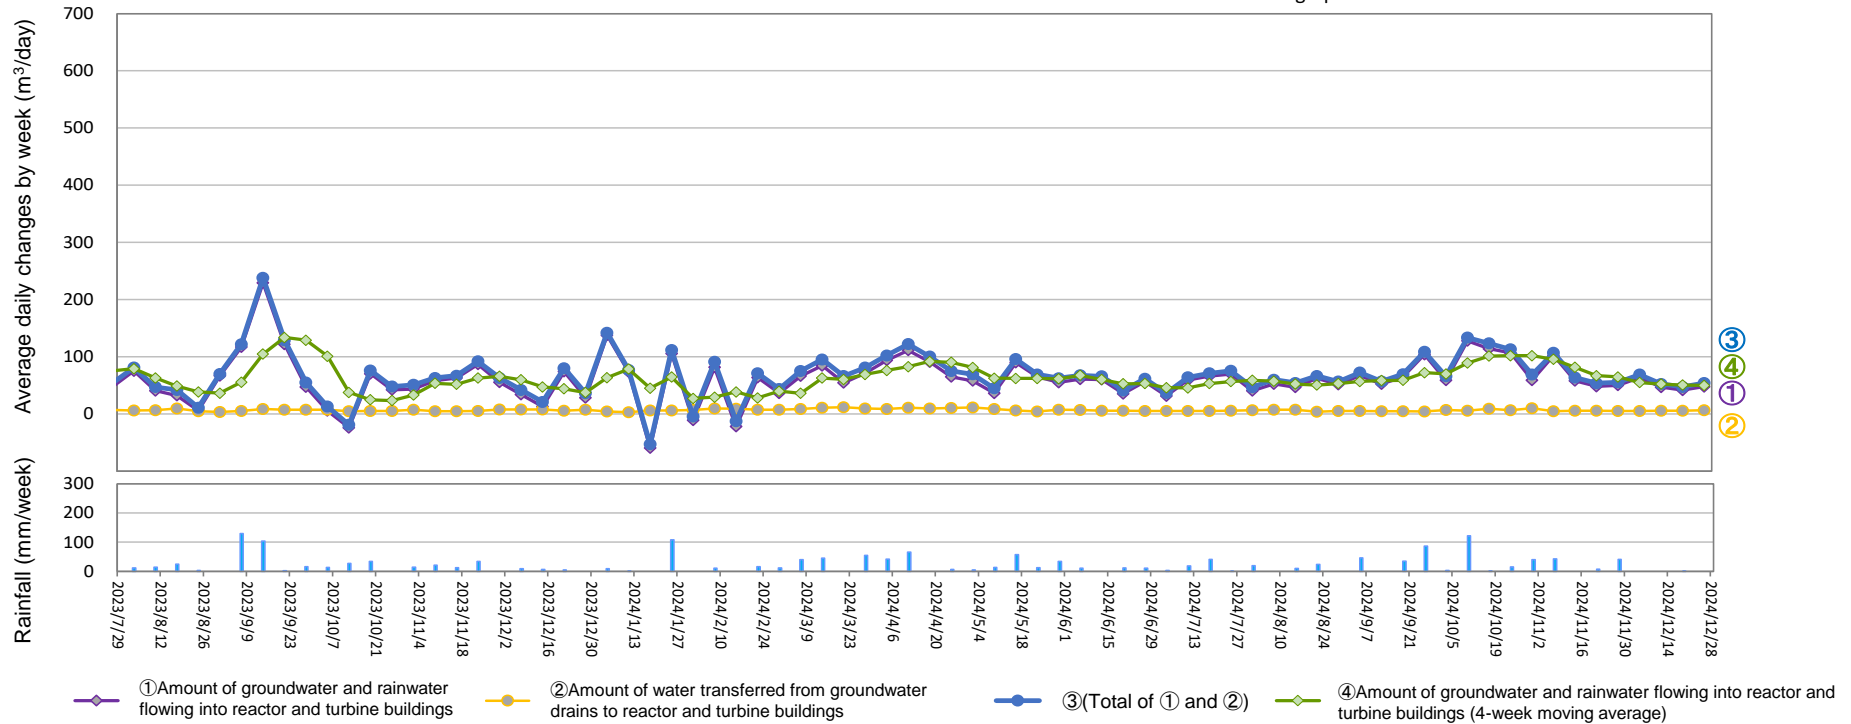

Amount of water transferred from groundwater drains to reactor and turbine buildings
(From Dec 19, 2024 to Dec 25, 2024)

Date	Temporary storage tanks			
	A	B	C	Total (α)
From Dec 19 to Dec 25	0	0	0	0

(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
6	0	0	6	6

① Amount of groundwater and rainwater flowing into reactor and turbine buildings: 48 m³/day, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: 6 m³/day, ③ (Total of ① and ②): 54 m³/day, Rainfall: 0.0 mm/week


There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Figures for ①, ③ and ④ have been calculated after elaborating some of cross sectional area of the process main building since April 4, 2024.

Nevertheless, figure for ① may be estimated to be a negative value since the calculation still contains uncertainty.


(Reference) ④ Amount of groundwater and rainwater flowing into reactor and turbine buildings (4-week moving average): 50 m³/day

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

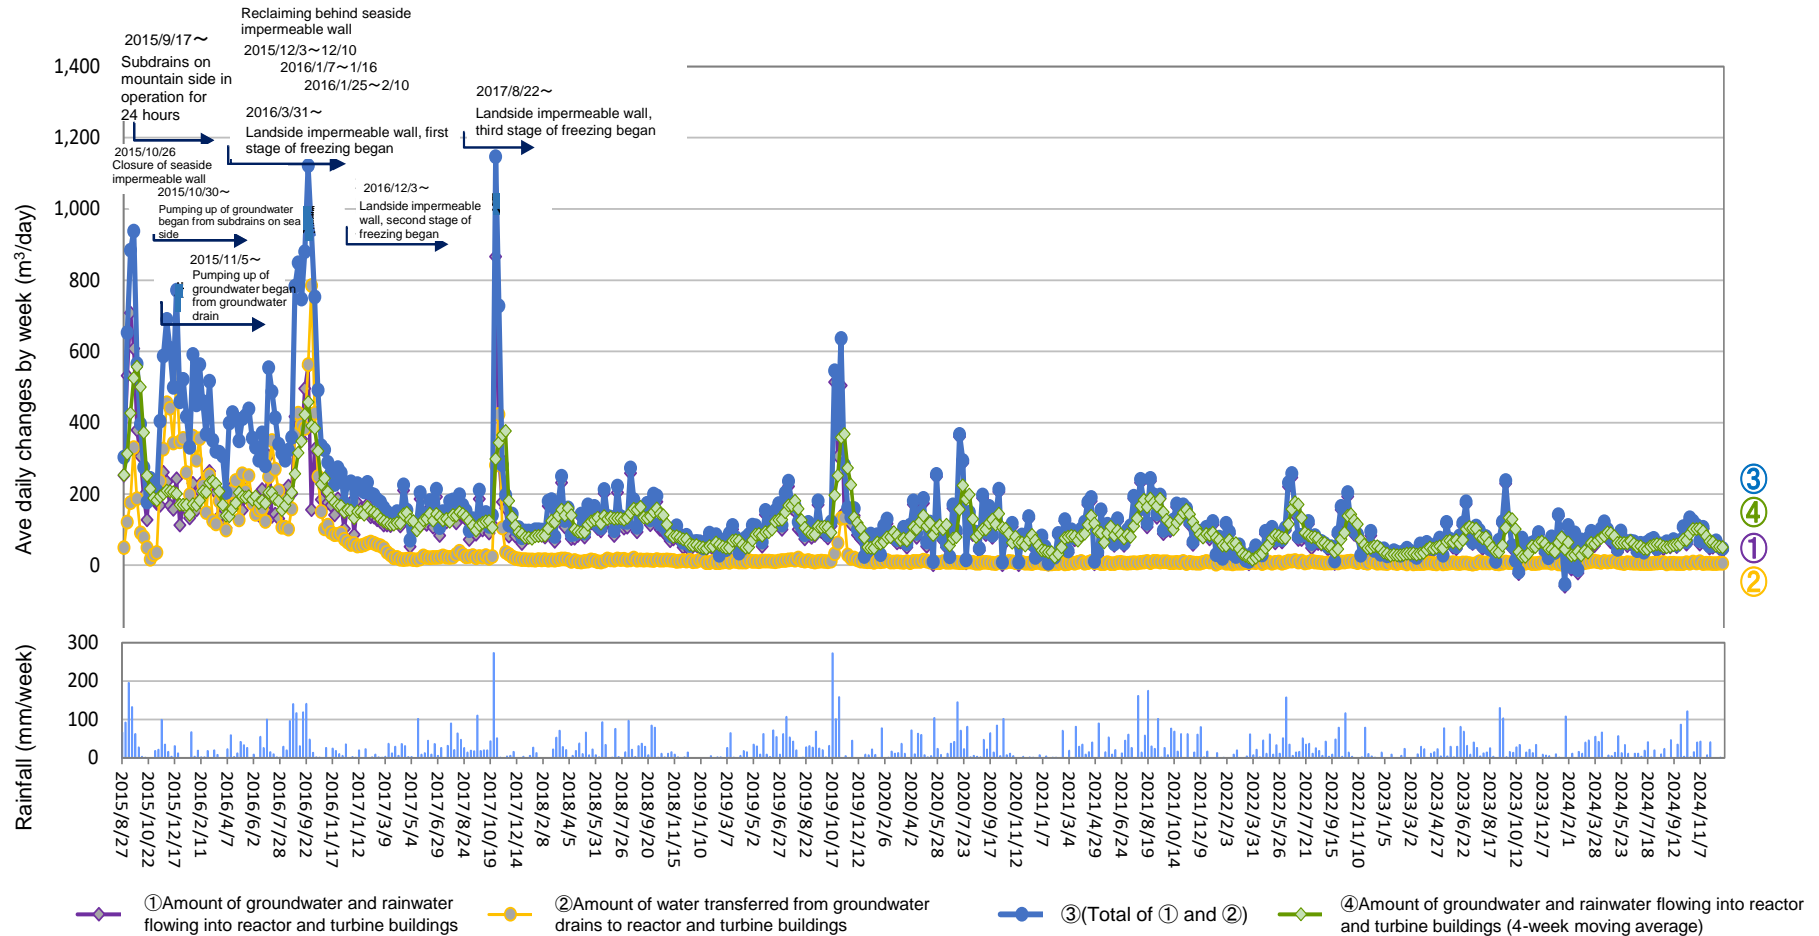

Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

* The graph shows data for the last sixteen months or so.

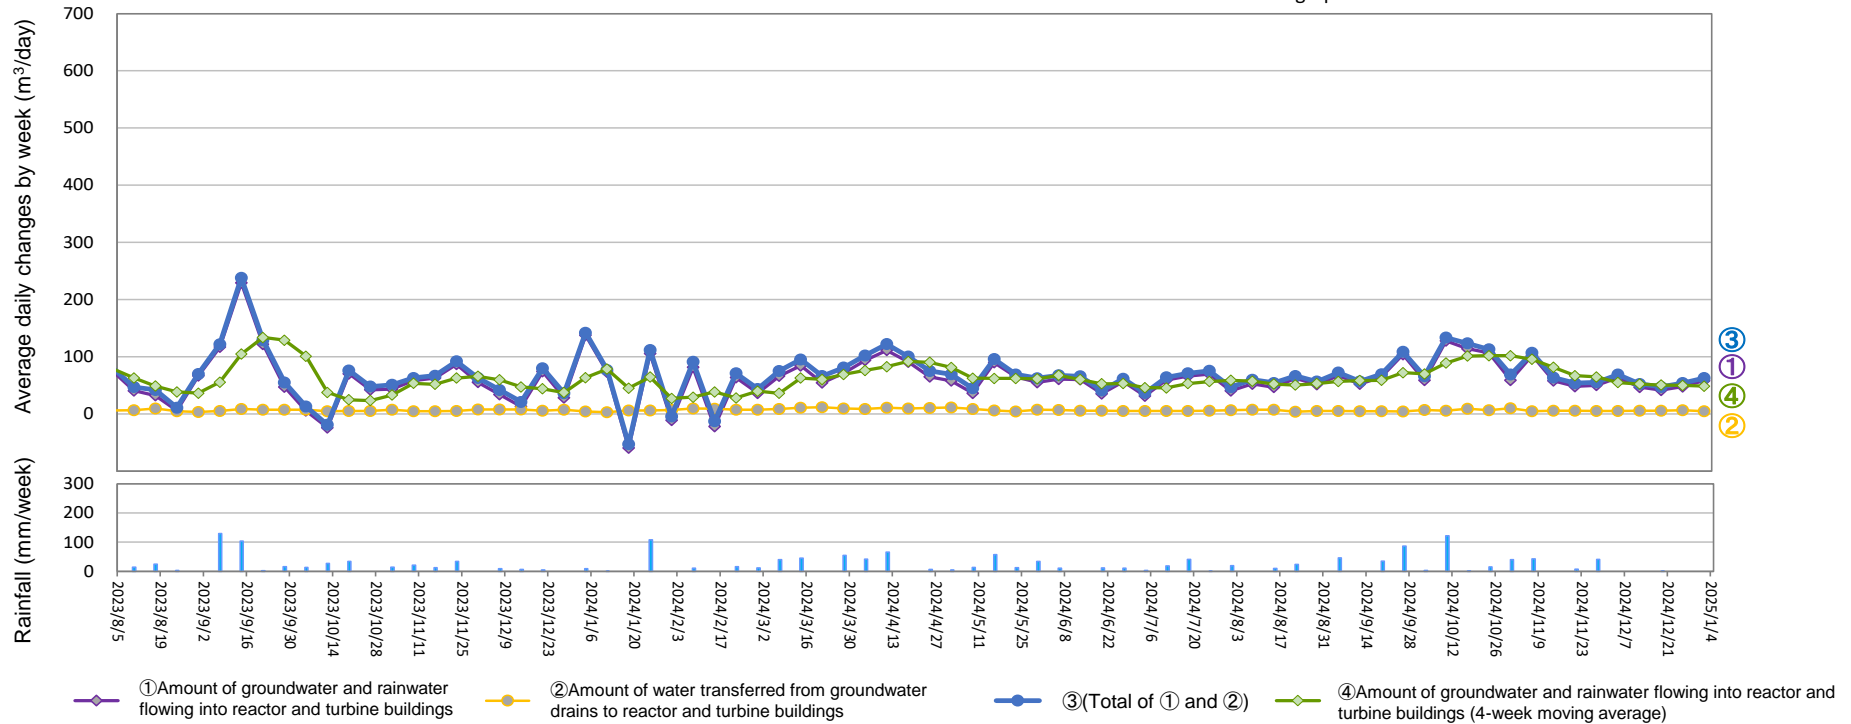

Amount of water transferred from groundwater drains to reactor and turbine buildings
 (From Dec 26, 2024 to Jan 1, 2025)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
From Dec 26 to Jan 1	0	0	0	0	5	0	0	5	5

① Amount of groundwater and rainwater flowing into reactor and turbine buildings: 58 m³/day, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: 5 m³/day, ③ (Total of ① and ②): 63 m³/day, Rainfall: 0.0 mm/week

There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Figures for ①, ③ and ④ have been calculated after elaborating some of cross sectional area of the process main building since April 4, 2024.

Nevertheless, figure for ① may be estimated to be a negative value since the calculation still contains uncertainty.

(Reference) ④ Amount of groundwater and rainwater flowing into reactor and turbine buildings (4-week moving average): 49 m³/day

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

