


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

* The graph shows data for the last sixteen months or so.

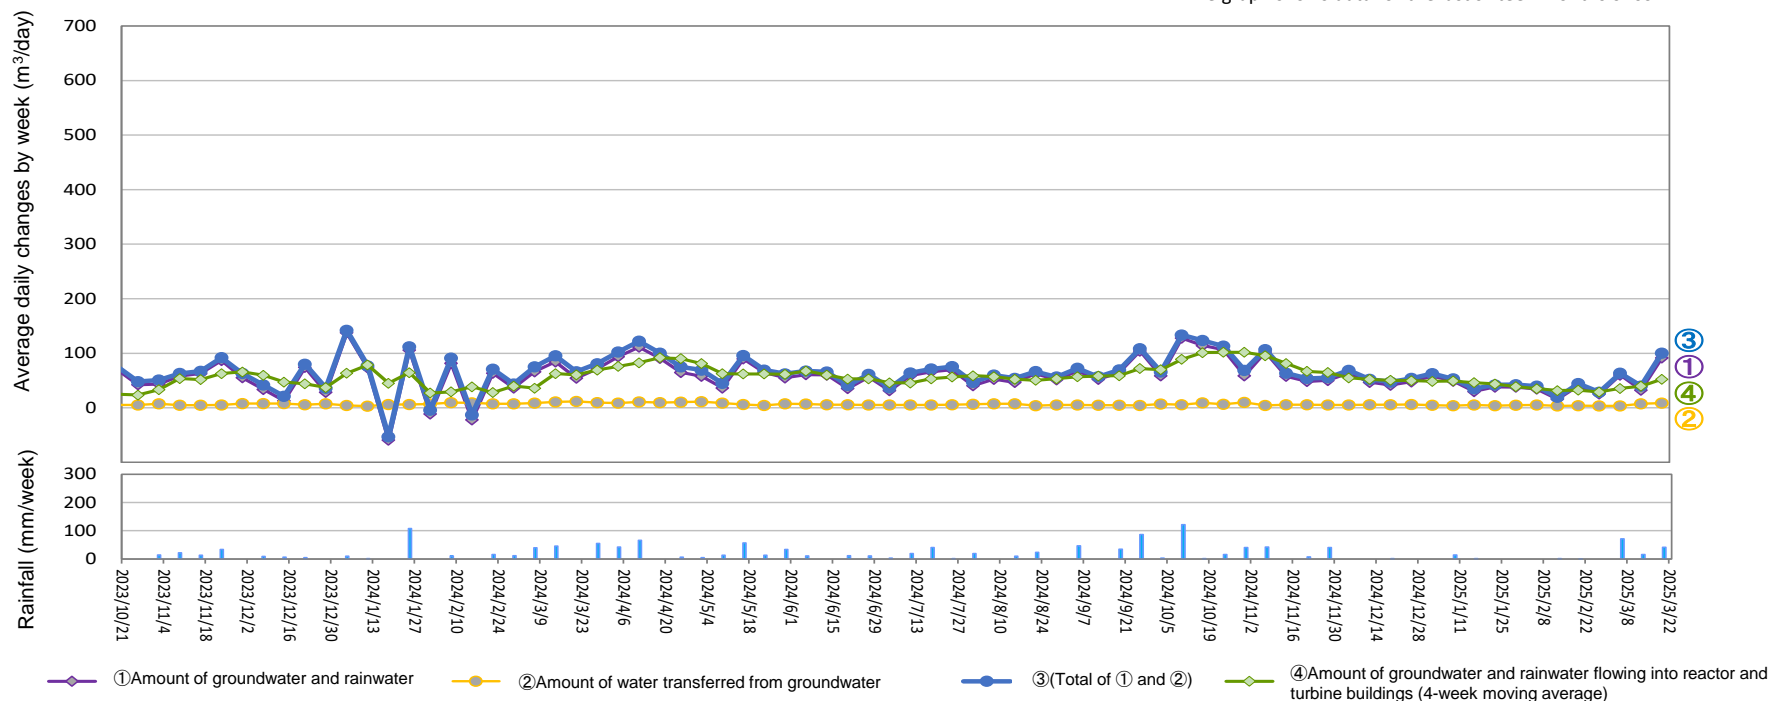

Amount of water transferred from groundwater drains to reactor and turbine buildings
(From Mar 13, 2025 to Mar 19, 2025)

Date	Temporary storage tanks			
	A	B	C	Total (α)
From Mar 13 to Mar 19	0	0	0	0

(Reference) improved wells and well points				[m³/day] (Reference) Amount of water transferred to turbine buildings [(α)+(β)]
Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
9	0	0	9	9

①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 92 m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 9 m³/day, ③(Total of ① and ②): 100 m³/day, Rainfall: 41.5 mm/week

There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Figures for ①, ③ and ④ have been calculated after elaborating some of cross sectional area of the process main building since April 4, 2024.

Nevertheless, figures may be estimated to be a negative value since the calculation still contains uncertainty.

(Reference) ④Amount of groundwater and rainwater flowing into reactor and turbine buildings (4-week moving average): 52 m³/day

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

