


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings
and in the amount of groundwater and rainwater flowing into the buildings

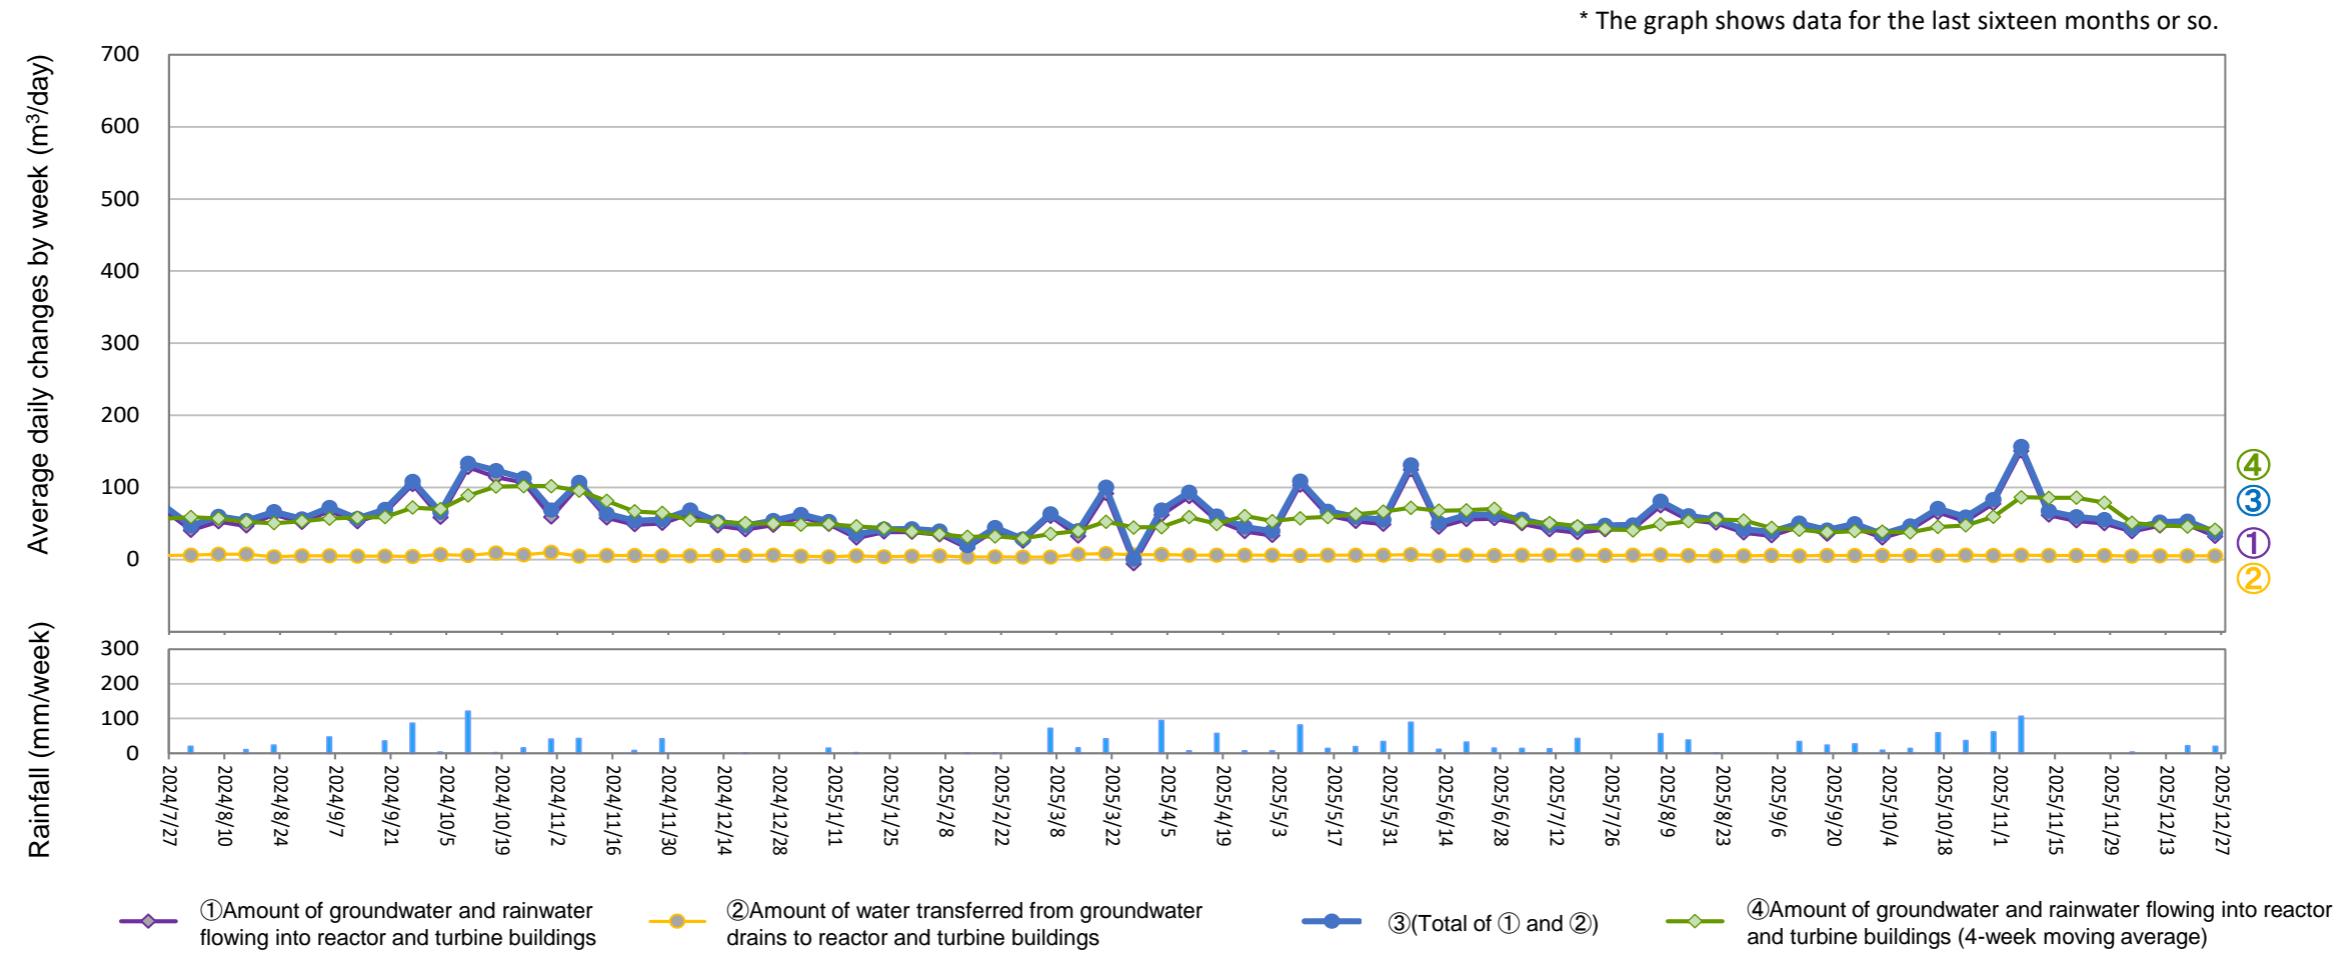

Amount of water transferred from groundwater drains to reactor and turbine buildings
(From December 18, 2025 to December 24, 2025)

[m^3/day]

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [$(\alpha)+(\beta)$]
	A	B	C	Total (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
From December 18 to December 24	0	0	0	0	5	0	0	5	5

① Amount of groundwater and rainwater flowing into reactor and turbine buildings: $32 \text{ m}^3/\text{day}$, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: $5 \text{ m}^3/\text{day}$, ③ (Total of ① and ②): $38 \text{ m}^3/\text{day}$, Rainfall: $19.5 \text{ mm}/\text{week}$


There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Figures for ①, ③ and ④ have been calculated after elaborating some of cross sectional area of the process main building since April 4, 2024.


Nevertheless, figures may be estimated to be a negative value since the calculation still contains uncertainty.

(Reference) ④ Amount of groundwater and rainwater flowing into reactor and turbine buildings (4-week moving average): $41 \text{ m}^3/\text{day}$

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

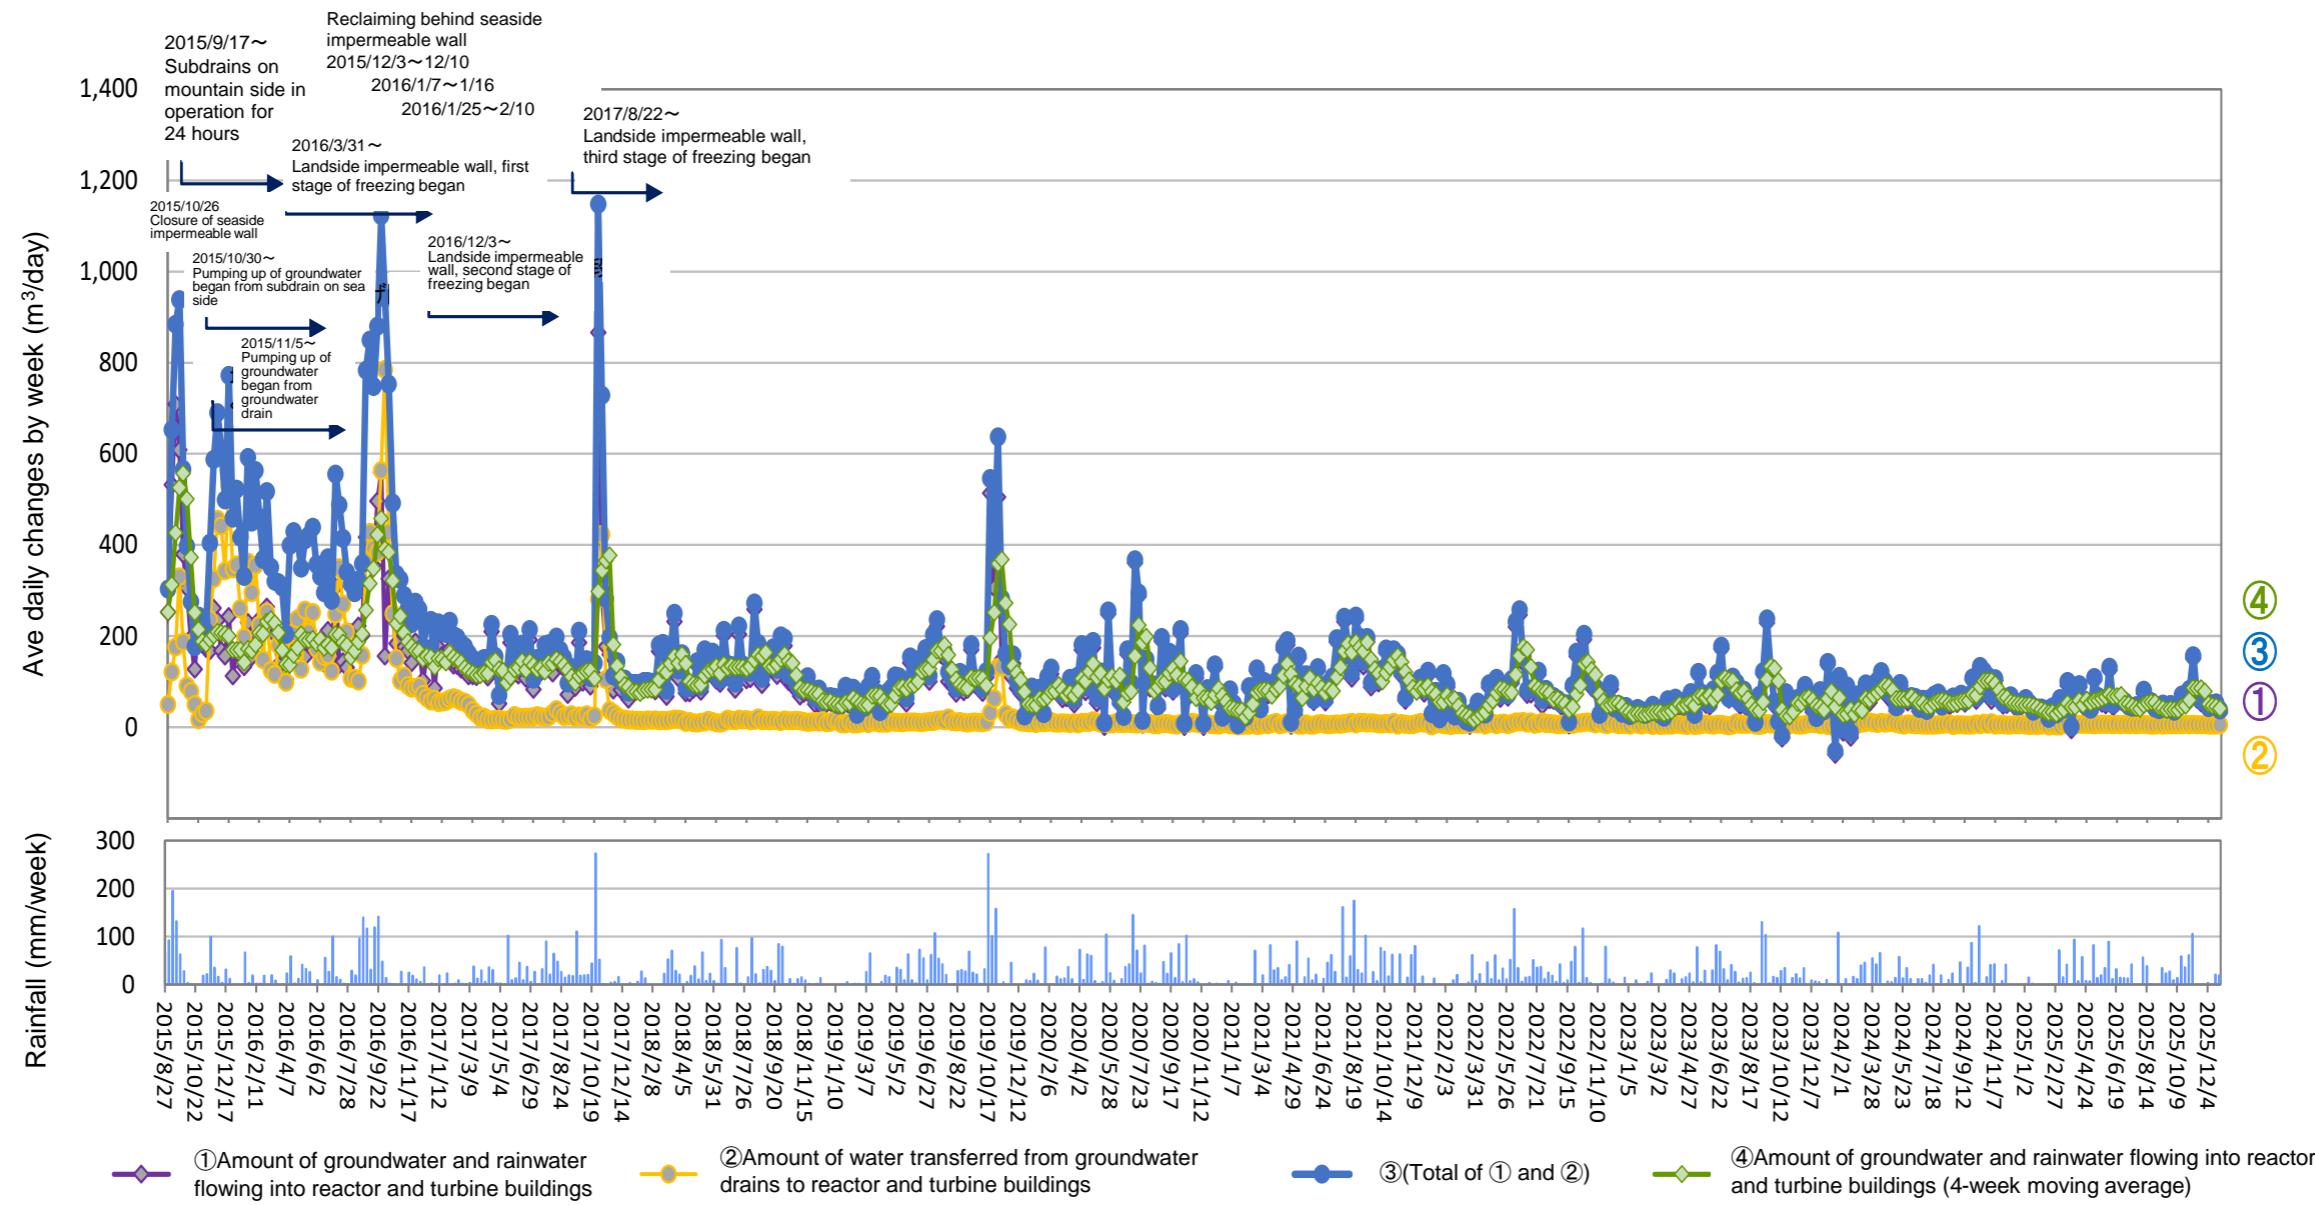

Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings
and in the amount of groundwater and rainwater flowing into the buildings

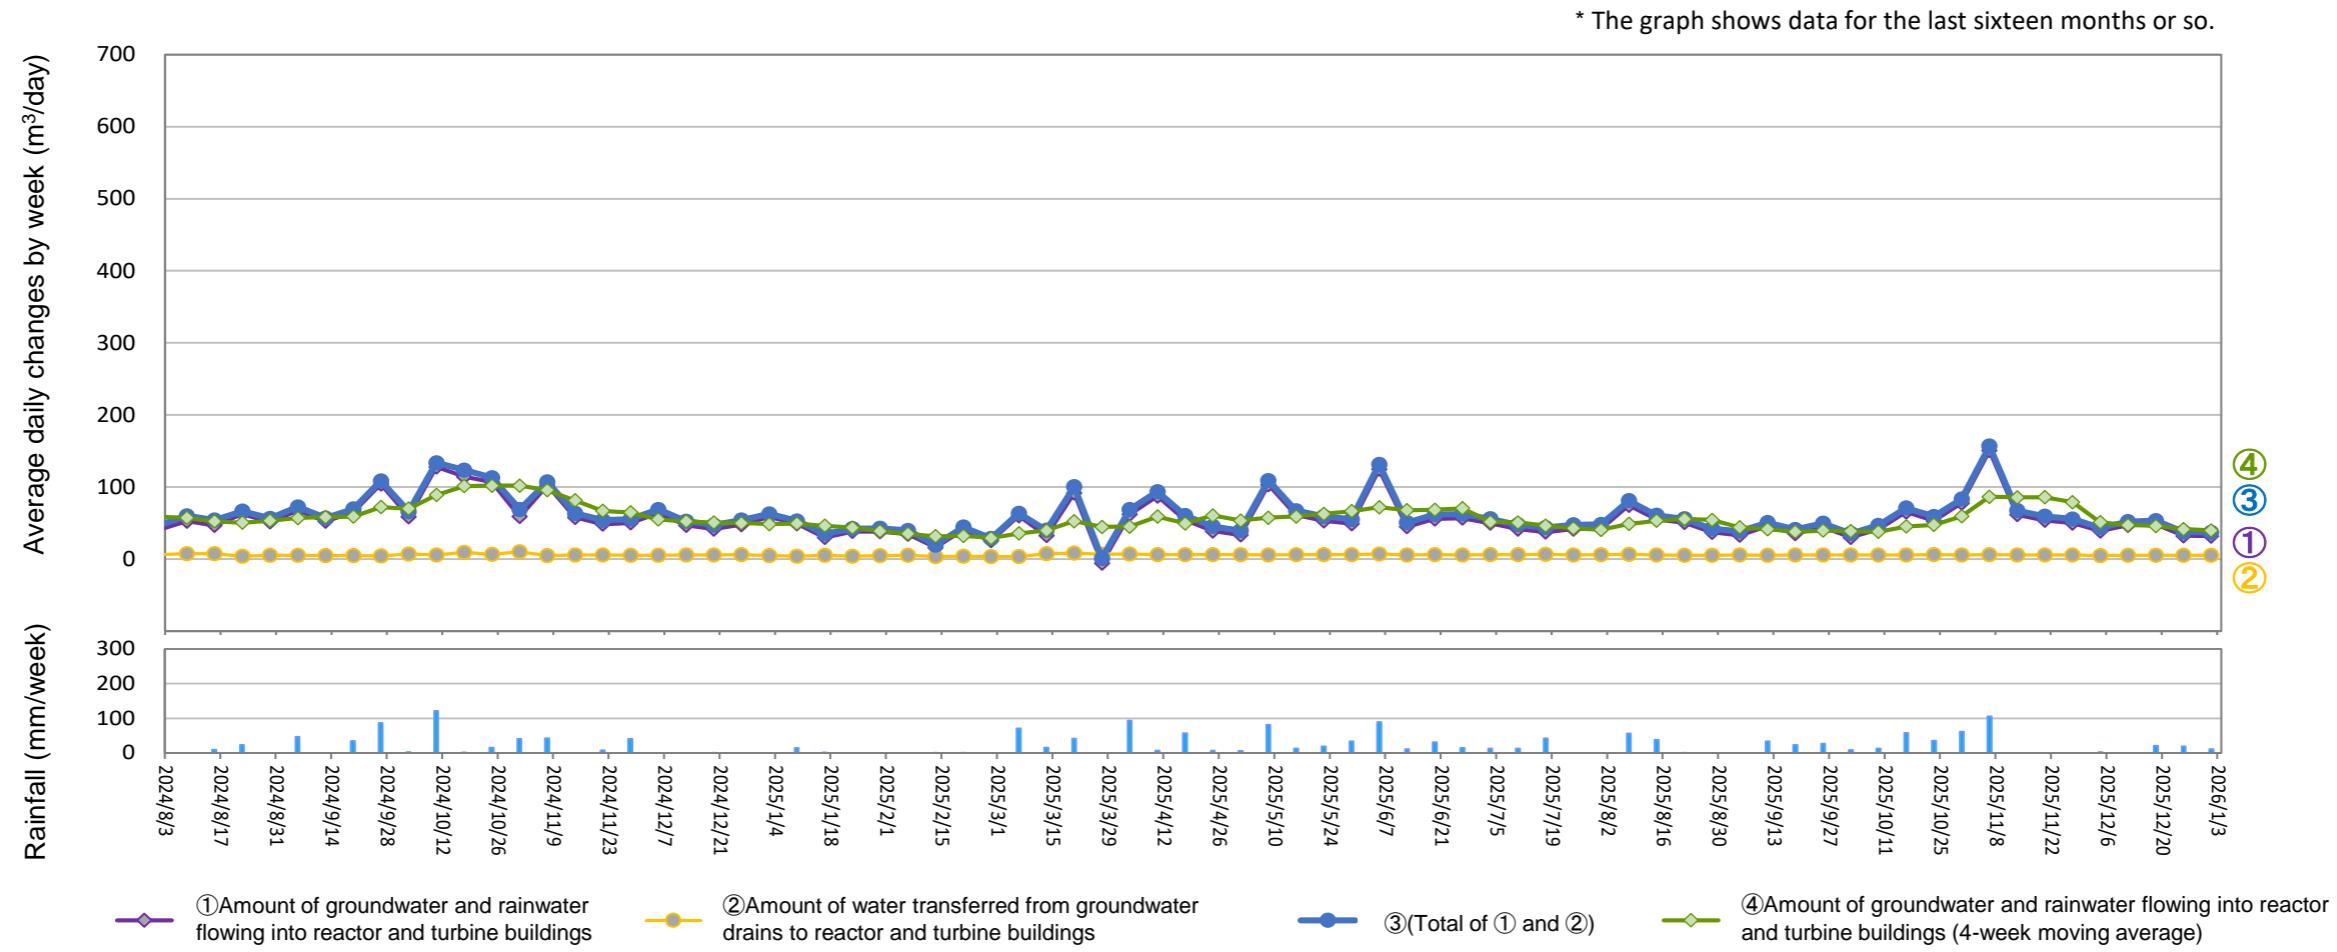

Amount of water transferred from groundwater drains to reactor and turbine buildings
(From December 25, 2025 to December 31, 2025)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings $(\alpha + \beta)$
	A	B	C	Total (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
From December 25 to December 31	0	0	0	0	5	0	0	5	5

① Amount of groundwater and rainwater flowing into reactor and turbine buildings: $32 \text{ m}^3/\text{day}$, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: $5 \text{ m}^3/\text{day}$, ③ (Total of ① and ②): $37 \text{ m}^3/\text{day}$, Rainfall: $11.0 \text{ mm}/\text{week}$

There may be a difference between the sum of the individual data and the total value since the total value is the sum of the data with the first decimal place.

* Figures for ①, ③ and ④ have been calculated after elaborating some of cross sectional area of the process main building since April 4, 2024.

Nevertheless, figures may be estimated to be a negative value since the calculation still contains uncertainty.

(Reference) ④ Amount of groundwater and rainwater flowing into reactor and turbine buildings (4-week moving average): $40 \text{ m}^3/\text{day}$

(Reference) Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings from the start of measurement

