


Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

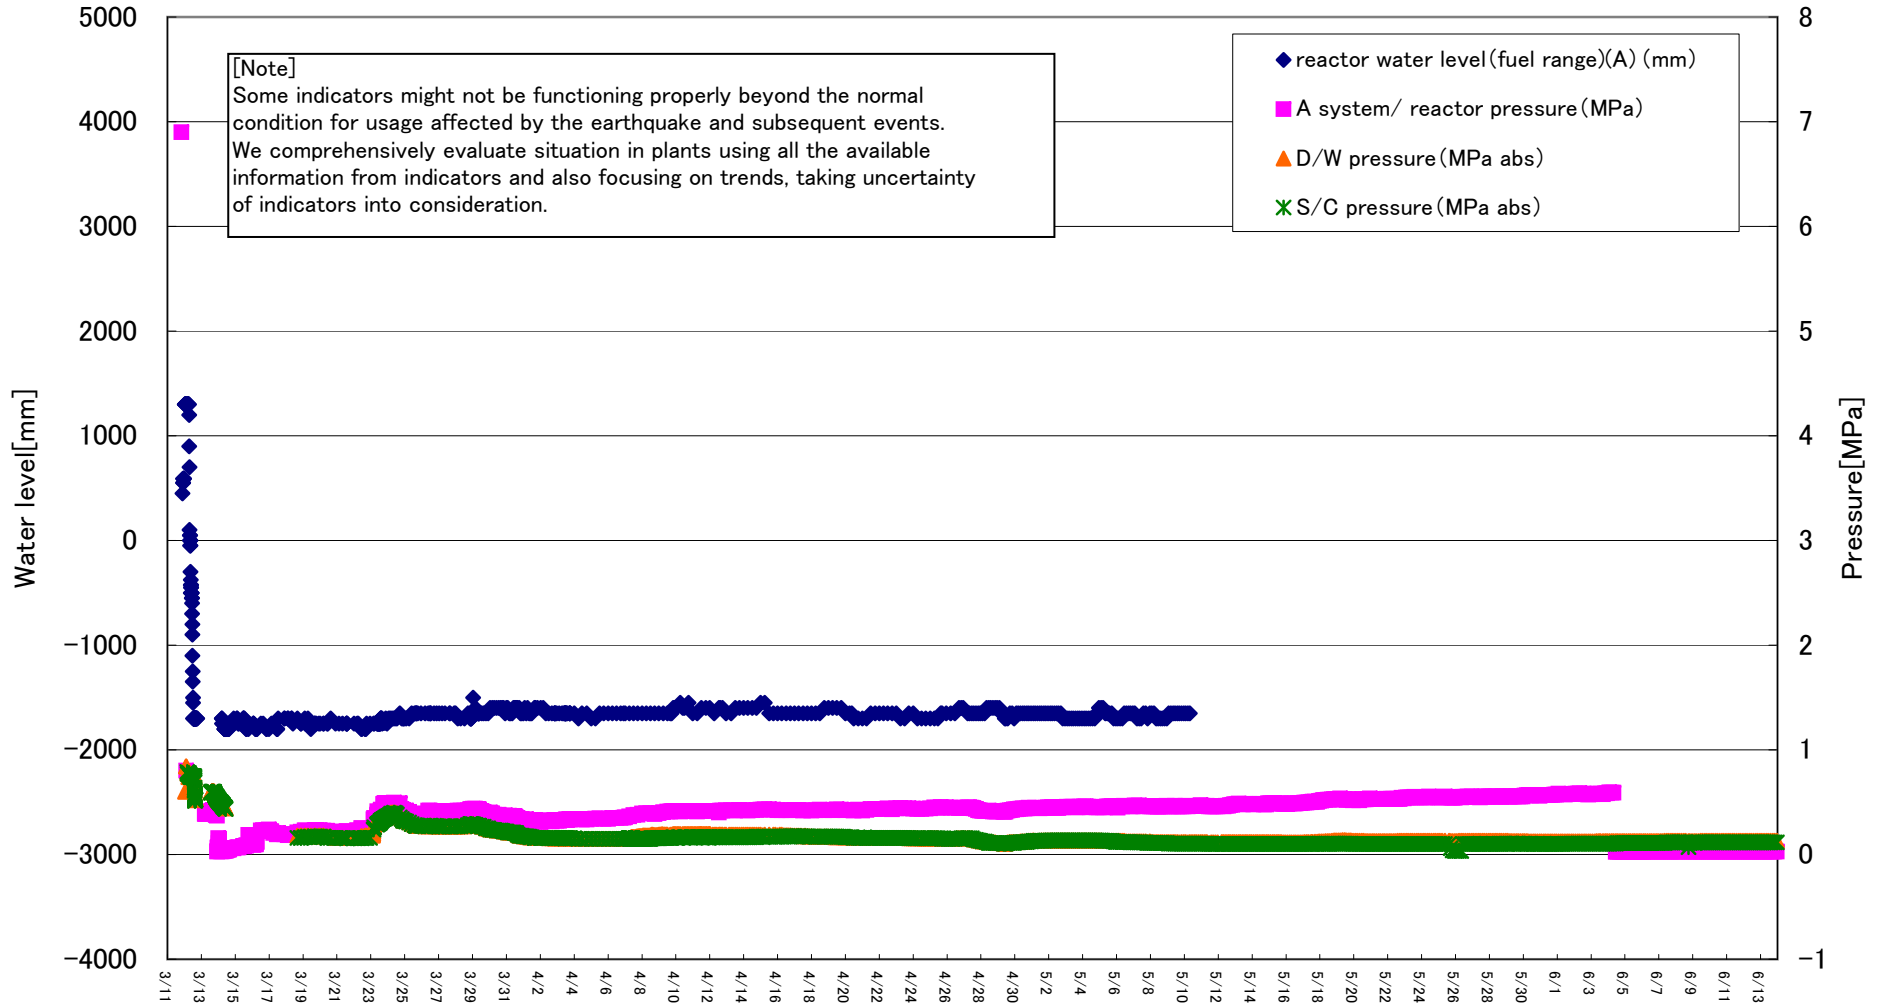

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/11 19:30											
2011/3/11 19:37											
2011/3/11 20:00											
2011/3/11 20:07			6.900								
2011/3/11 20:30											
2011/3/11 21:00											
2011/3/11 21:30	450										
2011/3/11 22:00	550										
2011/3/11 22:10	550										
2011/3/11 22:20	590										
2011/3/11 22:30											
2011/3/11 22:35	590										
2011/3/11 22:47	590										
2011/3/11 23:05	590										
2011/3/11 23:24	590										
2011/3/11 23:30											
2011/3/12 0:30	1300										
2011/3/12 0:45	1300										
2011/3/12 1:00	1300										
2011/3/12 1:05					0.600						
2011/3/12 1:25	1300										
2011/3/12 1:40	1300										
2011/3/12 1:55	1300	530									
2011/3/12 2:10	1300	500									
2011/3/12 2:30	1300	500			0.840						
2011/3/12 2:45			0.800		0.840						
2011/3/12 2:50		500									
2011/3/12 3:05	1300	500									
2011/3/12 3:30	1300										
2011/3/12 3:55	1300	500									
2011/3/12 4:19	1300	500			0.780	0.790					
2011/3/12 4:35	1300	500			0.770	0.770					
2011/3/12 4:55	1300	500									
2011/3/12 5:20	1300	500									
2011/3/12 5:30	1300	500									
2011/3/12 5:55	1300	500									
2011/3/12 6:00	1300	500			0.740						
2011/3/12 6:05					0.740						
2011/3/12 6:30	1300	550			0.790	0.780					
2011/3/12 6:47	1200	400			0.770	0.770					
2011/3/12 7:00	900	300									
2011/3/12 7:01					0.760	0.760					
2011/3/12 7:15	700	250									
2011/3/12 7:17					0.760	0.760					
2011/3/12 7:30	100	200			0.760	0.760					
2011/3/12 7:40					0.755						
2011/3/12 7:55	50	-100			0.755	0.755					
2011/3/12 8:03	50	-100			0.755	0.755					
2011/3/12 8:10	0	-200									
2011/3/12 8:15					0.750	0.750					
2011/3/12 8:20	-50	-300									
2011/3/12 8:22	0	-300									
2011/3/12 8:23					0.750	0.750					

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/12 8:30	0	-400									
2011/3/12 8:36					0.750						
2011/3/12 8:39	-50	-500									
2011/3/12 8:49	-300	-550			0.740	0.740					
2011/3/12 8:56	-375	-600									
2011/3/12 9:00	-500	-650									
2011/3/12 9:02					0.740	0.740					
2011/3/12 9:10	-425	-650									
2011/3/12 9:20	-425	-700			0.740	0.740					
2011/3/12 9:25	-450	-700			0.740	0.740					
2011/3/12 9:45	-450	-700			0.740	0.740					
2011/3/12 9:52	-500	-700			0.740	0.740					
2011/3/12 10:04	-500	-700									
2011/3/12 10:19					0.750						
2011/3/12 10:20					0.750						
2011/3/12 10:27					0.750						
2011/3/12 10:33	-500	-700									
2011/3/12 10:38	-550	-700			0.740	0.740					
2011/3/12 10:47	-550	-750			0.740	0.740					
2011/3/12 10:52	-600	-750			0.750	0.750					
2011/3/12 11:00	-700	-800			0.750	0.750					
2011/3/12 11:10	-800	-800									
2011/3/12 11:20	-900	-800			0.750	0.750					
2011/3/12 11:30	-1100	-900			0.750	0.750					
2011/3/12 11:41	-1250	-1000			0.750	0.750					
2011/3/12 11:52	-1350	-1100			0.750	0.740					
2011/3/12 12:05	-1500	-1400			0.750	0.740					
2011/3/12 12:12	-1550	-1450			0.750	0.740					
2011/3/12 12:35	-1700	-1450			0.750	0.750					
2011/3/12 12:45	-1700	-1450			0.750	0.745					
2011/3/12 12:55	-1700	-1500			0.750	0.745					
2011/3/12 13:05	-1700	-1500			0.750	0.745					
2011/3/12 13:14	-1700	-1550			0.750	0.745					
2011/3/12 13:26	-1700	-1550			0.755	0.745					
2011/3/12 13:38	-1700	-1550			0.755	0.745					
2011/3/12 13:48	-1700	-1650			0.755	0.745					
2011/3/12 13:52	-1700	-1650			0.755	0.744					
2011/3/12 13:58	-1700	-1650			0.755	0.744					
2011/3/12 14:05	-1700	-1650			0.735	0.735					
2011/3/12 14:10	-1700	-1650			0.730	0.730					
2011/3/12 14:18	-1700	-1600			0.725	0.725					
2011/3/12 14:20	-1700	-1600			0.710	0.710					
2011/3/12 14:25	-1700	-1600			0.690	0.690					
2011/3/12 14:30	-1700	-1600			0.670						
2011/3/12 14:35	-1700	-1600			0.640	0.640					
2011/3/12 14:40	-1700	-1650			0.620	0.620					
2011/3/12 14:41	-1700	-1650			0.610	0.610					
2011/3/12 14:50	-1700	-1600			0.580	0.580					
2011/3/12 14:52	-1700	-1650			0.570	0.570					
2011/3/12 14:54	-1700	-1650			0.565	0.565					
2011/3/12 14:56	-1700	-1650			0.555	0.555					
2011/3/12 14:58	-1700	-1650			0.550	0.550					
2011/3/12 15:00					0.540	0.540					

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/13 13:00		-1700	0.408								
2011/3/13 13:37					0.595	0.590					
2011/3/13 14:00		-1700	0.413		0.595	0.590					
2011/3/13 14:10		-1700	0.413		0.600	0.600					
2011/3/13 14:30		-1700		0.415	0.600	0.600					
2011/3/13 14:45		-1700		0.415	0.600	0.600					
2011/3/13 15:00		-1700	0.415		0.600	0.600					
2011/3/13 15:15		-1700		0.418	0.605	0.600					
2011/3/13 15:30		-1700		0.418	0.605	0.600					
2011/3/13 15:45		-1700		0.420	0.605	0.600					
2011/3/13 16:00		-1700	0.420		0.605	0.600					
2011/3/13 16:15		-1700	0.420		0.605	0.600					
2011/3/13 16:30		-1700	0.420		0.605	0.600					
2011/3/13 16:45		-1700	0.422		0.605	0.600					
2011/3/13 17:00		-1700	0.422		0.605	0.600					
2011/3/13 17:15		-1700	0.418		0.605	0.600					
2011/3/13 17:30		-1700	0.415		0.600	0.600					
2011/3/13 18:00		-1700	0.415		0.600	0.600					
2011/3/13 18:20		-1700	0.408		0.590	0.590					
2011/3/13 18:40		-1700	0.403		0.590	0.585					
2011/3/13 19:00		-1750	0.398		0.580	0.580					
2011/3/13 19:30		-1750	0.393		0.575	0.570					
2011/3/13 19:45		-1750	0.388		0.570	0.570					
2011/3/13 20:00		-1750	0.388		0.570	0.565					
2011/3/13 20:15		-1750	0.382		0.560	0.560					
2011/3/13 20:30		-1750	0.382		0.560	0.560					
2011/3/13 20:45		-1750	0.378		0.550	0.550					
2011/3/13 21:00		-1750	0.382		0.550	0.550					
2011/3/13 21:15		-1750	0.380		0.550	0.550					
2011/3/13 21:30		-1750	0.380		0.550	0.550					
2011/3/13 21:45		-1700			0.550	0.550					
2011/3/13 22:00		-1700			0.540	0.540					
2011/3/13 22:15		-1750	0.370		0.540	0.540					
2011/3/13 22:30		-1750	0.030	0.368	0.540	0.540					
2011/3/13 22:45		-1750	0.028	0.366	0.540	0.530					
2011/3/13 23:00		-1750	0.062	0.366	0.540	0.530					
2011/3/13 23:15		-1750	0.068	0.360	0.530	0.530					
2011/3/13 23:30		-1750	0.056	0.360	0.530	0.530					
2011/3/14 0:00		-1700	0.156	0.356	0.520	0.520					
2011/3/14 0:15		-1700	0.072	0.356	0.520	0.520					
2011/3/14 0:30		-1700	0.070	0.356	0.520	0.520					
2011/3/14 0:45		-1700	0.106	0.356	0.520	0.520					
2011/3/14 1:00		-1700	0.056	0.350	0.515	0.510					
2011/3/14 1:15		-1700	0.150	0.350							
2011/3/14 1:30		-1750	0.050	0.350	0.515	0.510					
2011/3/14 1:45		-1750	0.040	0.350	0.515	0.505					
2011/3/14 2:00		-1700	0.040	0.350	0.510	0.505					
2011/3/14 2:15		-1700	0.040	0.346	0.510	0.505					
2011/3/14 2:30		-1700	0.036	0.342	0.505	0.500					
2011/3/14 2:45		-1700	0.032	0.340	0.505	0.500					
2011/3/14 3:00		-1700	0.032	0.340	0.505	0.500					
2011/3/14 3:15		-1700	0.032	0.340	0.500	0.500					
2011/3/14 3:30		-1700	0.032	0.340	0.500	0.495					

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/14 3:45		-1700	0.032	0.338	0.500	0.495					
2011/3/14 4:00		-1700	0.032	0.338	0.495	0.490					
2011/3/14 4:15		-1700	0.030	0.328	0.495	0.490					
2011/3/14 4:30		-1700	0.030	0.328	0.495	0.490					
2011/3/14 4:45		-1700	0.038	0.332	0.490	0.485					
2011/3/14 5:00	-1700	-1700	0.030	0.326	0.485	0.480					
2011/3/14 5:15	-1700	-1700	0.030	0.326	0.485	0.480					
2011/3/14 5:30	-1750	-1750	0.030	0.326	0.480	0.480					
2011/3/14 5:45	-1750	-1750	0.030	0.323	0.480	0.475					
2011/3/14 6:00	-1750	-1750	0.030	0.326	0.480	0.475	1.64E+02		2.66E+01		
2011/3/14 6:15	-1750	-1750	0.030	0.318	0.480	0.470					
2011/3/14 6:30	-1750	-1750	0.036	0.320	0.475	0.470	1.62E+02		2.66E+01		
2011/3/14 6:45	-1750	-1750	0.030	0.316	0.475	0.470					
2011/3/14 7:00	-1750	-1750	0.036	0.318	0.470	0.467	1.61E+02		2.65E+01		
2011/3/14 7:15	-1750	-1750	0.038	0.318	0.465	0.460					
2011/3/14 7:30	-1750	-1750	0.038	0.316	0.465	0.460	1.60E+02		2.65E+01		
2011/3/14 7:45							1.60E+02		2.65E+01		
2011/3/14 8:00	-1750	-1750	0.038	0.316	0.460	0.455	1.60E+02		2.65E+01		
2011/3/14 8:15							1.57E+02		2.65E+01		
2011/3/14 8:30	-1800	-1750	0.038	0.312	0.460	0.455	1.52E+02		2.65E+01		
2011/3/14 8:45	-1800	-1750					1.49E+02		2.65E+01		
2011/3/14 9:00	-1800	-1750	0.036	0.306	0.450	0.445	1.45E+02		2.65E+01		
2011/3/14 9:35	-1800	-1750	0.040	0.306	0.450	0.445	1.41E+02		2.65E+01		
2011/3/14 9:45	-1800	-1750	0.040	0.306	0.450	0.445	1.40E+02		2.65E+01		
2011/3/14 10:00	-1800	-1750	0.042	0.310	0.445	0.440	1.39E+02		2.65E+01		
2011/3/14 10:15	-1800	-1750					1.37E+02		2.65E+01		
2011/3/14 10:30	-1800	-1750	0.038	0.306	0.440	0.435	1.35E+02		2.65E+01		
2011/3/14 10:45	-1800	-1750					1.33E+02		2.65E+01		
2011/3/14 11:00			0.038	0.306							
2011/3/14 12:00	-1800	-1750	0.040	0.306			1.23E+02		2.64E+01		
2011/3/14 12:30	-1800	-1750	0.040	0.306			1.18E+02		2.64E+01		
2011/3/14 14:45	-1800	-1750	0.046	0.300			9.80E+01		2.62E+01		
2011/3/14 15:00	-1800	-1750	0.046	0.298			9.48E+01		2.62E+01		
2011/3/14 15:30	-1750	-1750	0.048	0.300			9.17E+01		2.62E+01		
2011/3/14 16:00	-1750	-1750	0.052	0.300			8.97E+01		2.62E+01		
2011/3/14 19:15	-1750	-1750	0.062	0.272			7.88E+01		2.59E+01		
2011/3/14 21:00	-1750	-1750	0.060	0.270			6.56E+01		2.57E+01		
2011/3/14 22:00	-1700	-1700	0.058	0.260			6.10E+01		2.56E+01		
2011/3/15 2:30	-1700	-1700									
2011/3/15 3:00	-1700	-1700	0.068	0.248			5.73E+01		2.46E+01		
2011/3/15 4:00	-1750	-1750	0.068	0.240			6.27E+01		2.47E+01		
2011/3/15 5:00	-1750		0.066	0.240			7.74E+01		2.47E+01		
2011/3/15 11:25	-1700	-1700	0.078	0.206			8.70E+01		2.42E+01		
2011/3/15 11:42	-1700	-1700	0.080	0.206			8.58E+01		2.41E+01		
2011/3/15 11:58	-1700	-1700	0.079	0.202			8.44E+01		2.41E+01		
2011/3/15 13:00	-1700	-1700	0.076	0.206			8.19E+01		2.41E+01		
2011/3/15 15:25	-1800	-1750	0.082	0.195			1.04E+02		2.37E+01		
2011/3/15 16:10	-1800	-1750	0.090	0.200			9.75E+01		2.36E+01		
2011/3/15 18:43	-1800	-1800	0.188				6.89E+01		2.33E+01		
2011/3/16 1:24	-1750	-1750	0.180	0.096			3.84E+01		2.31E+01		
2011/3/16 1:44	-1750	-1750	0.092	0.176			3.50E+01		2.36E+01		
2011/3/16 1:54	-1750	-1750	0.092	0.176			3.44E+01		2.33E+01		
2011/3/16 5:00	-1800	-1750	0.096	0.178			7.92E+00		2.42E+01		

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/16 5:10	-1800	-1750		0.180			4.15E+00		2.42E+01		
2011/3/16 5:15	-1800	-1750	0.098	0.180			4.15E+00		2.42E+01		
2011/3/16 5:35	-1800	-1750	0.100	0.180			9.81E+01		3.64E+01		
2011/3/16 6:55	-1800	-1750	0.120	0.186							
2011/3/16 12:35	-1750	-1750	0.230	0.190							
2011/3/16 15:30	-1750	-1750	0.232	0.188				1.85E+01		2.20E+01	
2011/3/16 20:00	-1800	-1800	0.228	0.188				3.70E-03		2.27E+01	
2011/3/16 20:20	-1800	-1800	0.228	0.188				3.70E-03		2.27E+01	
2011/3/16 23:50	-1800	-1750	0.238	0.188				3.05E-03		2.29E+01	
2011/3/17 3:10	-1750	-1750	0.220	0.172				3.09E-03		2.40E+01	
2011/3/17 6:00	-1750	-1750	0.206	0.168				3.15E-03		1.38E+01	
2011/3/17 11:00	-1800	-1800	0.192	0.160				3.60E-03		2.38E+01	
2011/3/17 11:15	-1800	-1800	0.192	0.160				2.70E-03		3.08E+01	
2011/3/17 11:30	-1800	-1800	0.192	0.160				4.10E-03		3.15E+01	
2011/3/17 12:50	-1700	-1750	0.206	0.160				4.10E-03		3.16E+01	
2011/3/17 21:40	-1700		0.192	0.168				3.23E-03		4.82E+01	
2011/3/17 21:50	-1700		0.192	0.168				4.15E-03		4.81E+01	
2011/3/18 2:20	-1700		0.186	0.158				2.65E-03		4.78E+01	
2011/3/18 2:50	-1700		0.182	0.158				3.80E-03		4.77E+01	
2011/3/18 7:40	-1700		0.190	0.162				3.50E-03		4.70E+01	
2011/3/18 7:55	-1700		0.188	0.162				3.75E-03		4.69E+01	
2011/3/18 9:40	-1750	-1700	0.192	0.160				2.75E-03		4.67E+01	
2011/3/18 16:00	-1700	-1800	0.212	0.170	0.180	0.160		3.56E-03		4.60E+01	
2011/3/18 20:55	-1750	-1800	0.212	0.162	0.180	0.160		2.97E-03		4.54E+01	
2011/3/18 21:10	-1750	-1800	0.216	0.168	0.180	0.160		4.00E-03		4.53E+01	
2011/3/19 2:40	-1700	-1700	0.228	0.172	0.180	0.165		3.55E-03		4.46E+01	
2011/3/19 3:30	-1750	-1750	0.228	0.172	0.180	0.165		2.63E-03		1.45E+01	
2011/3/19 7:10	-1700	-1700	0.222	0.170	0.180	0.170		2.33E-03		4.40E+01	
2011/3/19 11:00	-1800	-1700	0.218	0.168	0.180	0.170		2.32E-03		4.35E+01	
2011/3/19 16:30	-1750	-1750	0.228	0.178	0.180	0.170		3.67E+01		4.29E+01	
2011/3/19 16:45	-1750	-1750	0.228	0.178	0.180	0.170		3.60E+01		4.28E+01	
2011/3/19 16:50	-1750	-1750	0.228	0.178	0.180	0.170		3.60E+01		4.28E+01	
2011/3/19 19:00	-1750	-1700	0.232	0.180	0.170	0.165		3.35E+01		4.26E+01	
2011/3/19 22:30	-1750	-1750	0.228	0.182	0.180	0.170		2.49E+01		4.21E+01	
2011/3/20 0:00	-1750	-1750	0.228	0.186	0.180	0.170		1.89E+01		4.19E+01	
2011/3/20 4:50	-1750	-1750	0.226	0.180	0.180	0.170		1.20E+01		4.13E+01	
2011/3/20 5:00	-1750	-1750	0.226	0.180	0.180	0.170		1.11E+01		4.12E+01	
2011/3/20 10:00	-1750	-1750	0.226	0.182	0.170	0.160		3.83E+00		4.07E+01	
2011/3/20 11:00	-1750	-1750	0.216	0.178	0.170	0.160		2.76E+01		4.05E+01	
2011/3/20 15:00	-1700	-1750	0.208	0.176	0.170	0.160		1.20E+01		4.00E+01	
2011/3/20 22:00	-1750	-1800	0.216	0.178	0.160	0.160		4.80E+01		3.91E+01	
2011/3/21 3:00	-1750	-1800	0.216	0.176	0.160	0.160		4.66E+01		3.85E+01	
2011/3/21 8:00	-1750	-1750	0.218	0.182	0.160	0.160		4.71E+01		3.79E+01	
2011/3/21 13:30	-1750	-1750	0.218	0.188	0.160	0.155		4.75E+01		3.74E+01	
2011/3/21 14:00	-1750	-1750	0.220	0.190	0.160	0.155		4.76E+01		3.73E+01	
2011/3/21 14:25	-1750	-1750	0.220	0.190	0.160	0.155		4.76E+01		3.73E+01	
2011/3/21 14:30	-1750	-1750	0.220	0.190	0.160	0.155		4.76E+01		3.73E+01	
2011/3/22 0:15	-1750	-1700	0.218	0.190	0.160	0.155		4.77E+01		3.62E+01	
2011/3/22 5:00	-1750	-1700	0.232	0.200	0.160	0.155		4.80E+01		3.56E+01	
2011/3/22 6:00	-1750	-1700	0.218	0.186	0.160	0.155		4.80E+01		3.55E+01	
2011/3/22 10:30	-1800	-1750	0.250	0.228	0.175	0.155		4.79E+01		3.49E+01	
2011/3/22 11:20	-1800	-1750	0.252	0.228	0.175	0.155		4.78E+01		3.49E+01	
2011/3/22 15:30	-1800	-1750	0.240	0.188	0.180	0.160		4.65E+01		3.40E+01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/22 17:00	-1800	-1750	0.242	0.212	0.180	0.160		4.68E+01		3.40E+01	
2011/3/22 18:00	-1750	-1750	0.242	0.212	0.180	0.160		4.64E+01		3.40E+01	
2011/3/22 23:00	-1750	-1750	0.246	0.218	0.185	0.160		4.71E+01		3.36E+01	
2011/3/23 2:55					0.180						
2011/3/23 3:00					0.190						
2011/3/23 3:07					0.200						
2011/3/23 3:10					0.200						
2011/3/23 3:15					0.200						
2011/3/23 3:20					0.220						
2011/3/23 3:30					0.220						
2011/3/23 3:40					0.250						
2011/3/23 3:50					0.260						
2011/3/23 4:00	-1750	-1750	0.336	0.300	0.260	0.240		4.60E+01		3.16E+01	
2011/3/23 4:40	-1750	-1750	0.348	0.322	0.280	0.260		4.76E+01		3.15E+01	
2011/3/23 5:00					0.280						
2011/3/23 5:20					0.290						
2011/3/23 6:00					0.295						
2011/3/23 6:30					0.295						
2011/3/23 7:00					0.295						
2011/3/23 7:30					0.295						
2011/3/23 8:00					0.295						
2011/3/23 8:30					0.300						
2011/3/23 9:00	-1750	-1750	0.376	0.342	0.305	0.285		4.88E+01		3.06E+01	
2011/3/23 9:30	-1750	-1750	0.412	0.368	0.310	0.290					
2011/3/23 10:00	-1750	-1750	0.388	0.358	0.320	0.295					
2011/3/23 10:30	-1750	-1750	0.390	0.358	0.320	0.295					
2011/3/23 11:00	-1750	-1750	0.396	0.360	0.325	0.300					
2011/3/23 11:30	-1750	-1750	0.400	0.366	0.320	0.300					
2011/3/23 12:00	-1750	-1750	0.396	0.356	0.320	0.300					
2011/3/23 12:30	-1750	-1750	0.392	0.362	0.325	0.305					
2011/3/23 13:00	-1750	-1750	0.400	0.366	0.330	0.305					
2011/3/23 13:30	-1750	-1700	0.400	0.370	0.330	0.310					
2011/3/23 14:00	-1700	-1700	0.418	0.398	0.345	0.320		4.80E+01		2.98E+01	
2011/3/23 14:20	-1700	-1700	0.390	0.430	0.340	0.320		4.80E+01		2.99E+01	
2011/3/23 14:30	-1700	-1700	0.428	0.390	0.340	0.320					
2011/3/23 15:00	-1700	-1700	0.416	0.380	0.345	0.325					
2011/3/23 15:30	-1700	-1700	0.416	0.378	0.345	0.330					
2011/3/23 16:00	-1750	-1700	0.422	0.398	0.360	0.330					
2011/3/23 18:09	-1740	-1670	0.483		0.347	0.339					
2011/3/23 18:10	-1740	-1680	0.481		0.347	0.339					
2011/3/23 19:32	-1740	-1680	0.490		0.360	0.346					
2011/3/23 20:21	-1740	-1660	0.492		0.354	0.347					
2011/3/23 21:00	-1700	-1650	0.440	0.416	0.375	0.355		3.12E+01		2.88E+01	
2011/3/23 23:00	-1750	-1750	0.466	0.440	0.380	0.365					
2011/3/24 1:00	-1700	-1700	0.456	0.430	0.385	0.370		4.39E+01		2.79E+01	
2011/3/24 3:00	-1700	-1700	0.470	0.440	0.395	0.380					
2011/3/24 5:00	-1700	-1700	0.472	0.446	0.400	0.390		4.37E+01		2.71E+01	
2011/3/24 7:00	-1700	-1700	0.480	0.450	0.400	0.390		4.37E+01		2.71E+01	
2011/3/24 9:00	-1700	-1700	0.496	0.466	0.400	0.400		4.41E+01		2.67E+01	
2011/3/24 11:00	-1700	-1700	0.480	0.446	0.400	0.395		4.35E+01		2.63E+01	
2011/3/24 13:00	-1700	-1650	0.470	0.430	0.390	0.382		4.24E+01		2.61E+01	
2011/3/24 17:00	-1650	-1650	0.488	0.408	0.355	0.355		4.09E+01		2.58E+01	
2011/3/24 20:00	-1700	-1650	0.430	0.402	0.345	0.340		4.05E+01		2.56E+01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/24 21:45	-1700	-1650	0.420	0.388	0.330	0.325		4.13E+01		2.55E+01	
2011/3/24 22:00	-1700	-1650	0.422	0.388	0.325	0.325		4.16E+01		2.55E+01	
2011/3/25 0:00	-1700	-1650	0.416	0.388	0.325	0.320		4.16E+01		2.54E+01	
2011/3/25 2:00	-1700	-1650	0.418	0.398	0.325	0.315		4.11E+01		2.54E+01	
2011/3/25 6:00	-1700	-1650	0.406	0.390	0.310	0.305		4.00E+01		2.51E+01	
2011/3/25 10:00	-1650	-1650	0.388	0.388	0.295	0.290		3.89E+01		2.49E+01	
2011/3/25 14:00	-1650	-1600	0.380	0.388	0.280	0.280		3.78E+01		2.47E+01	
2011/3/25 15:45	-1650	-1600	0.376	0.382	0.275	0.275		3.78E+01		2.47E+01	
2011/3/25 16:00	-1650	-1600	0.378	0.382	0.275	0.275		3.72E+01		2.46E+01	
2011/3/25 16:30	-1650	-1600	0.380	0.380	0.275	0.275		3.71E+01		2.45E+01	
2011/3/25 18:30	-1650	-1600	0.376	0.376	0.275	0.275		3.67E+01		2.44E+01	
2011/3/25 23:00	-1650	-1600	0.388	0.392	0.275	0.275		3.60E+01		2.42E+01	
2011/3/26 5:00	-1650	-1600	0.392	0.400	0.270	0.270		3.53E+01		2.38E+01	
2011/3/26 9:30	-1650	-1600	0.418	0.400	0.270	0.270		3.51E+01		2.36E+01	
2011/3/26 11:30	-1650	-1600	0.418	0.392	0.275	0.275		3.57E+01		2.35E+01	
2011/3/26 12:00	-1650	-1600	0.396	0.420	0.275	0.275		3.57E+01		2.35E+01	
2011/3/26 13:00	-1650	-1600	0.390	0.422	0.275	0.275		3.54E+01		2.34E+01	
2011/3/26 17:30	-1650	-1650	0.388	0.416	0.275	0.275		3.63E+01		2.31E+01	
2011/3/26 21:00	-1650	-1650	0.406	0.432	0.270	0.270		3.47E+01		2.29E+01	
2011/3/27 1:00	-1650	-1650	0.406	0.440	0.265	0.265		3.41E+01		2.27E+01	
2011/3/27 5:00	-1650	-1600	0.412	0.452	0.270	0.270		3.40E+01		2.25E+01	
2011/3/27 9:00	-1650	-1600	0.416	0.462	0.270	0.270		3.46E+01		2.22E+01	
2011/3/27 15:30	-1650	-1650	0.412	0.476	0.270	0.270		3.36E+01		2.19E+01	
2011/3/27 16:20	-1650	-1650	0.410	0.482	0.265	0.270		3.36E+01		2.18E+01	
2011/3/27 22:00	-1650	-1650	0.412	0.492	0.265	0.270		3.36E+01		2.16E+01	
2011/3/28 0:00	-1650	-1600	0.416	0.490	0.270	0.270		3.36E+01		2.15E+01	
2011/3/28 3:00	-1700	-1650	0.418	0.492	0.270	0.270		3.38E+01		2.13E+01	
2011/3/28 7:00	-1700	-1650	0.420	0.506	0.270	0.270		3.37E+01		2.11E+01	
2011/3/28 12:30	-1700	-1650	0.418	0.502	0.270	0.270		3.39E+01		2.08E+01	
2011/3/28 17:30	-1650	-1650	0.422	0.528	0.280	0.280		3.39E+01		2.06E+01	
2011/3/28 21:00	-1700	-1700	0.430	0.530	0.290	0.290		3.40E+01		2.04E+01	
2011/3/28 21:20	-1700	-1700	0.428	0.536	0.290	0.290		3.39E+01		2.04E+01	
2011/3/28 21:40	-1700	-1700	0.424	0.536	0.290	0.290					
2011/3/28 22:00	-1700	-1700	0.432	0.539	0.290	0.290		3.40E+01		2.03E+01	
2011/3/28 22:20	-1700	-1700	0.432	0.536	0.290	0.290					
2011/3/29 1:00	-1500	-1650	0.438	0.556	0.290	0.290		3.38E+01		2.02E+01	
2011/3/29 4:00	-1600	-1600	0.436	0.558	0.285	0.285		3.60E+01		2.00E+01	
2011/3/29 7:00	-1650	-1700	0.430	0.552	0.275	0.275		3.77E+01		1.99E+01	
2011/3/29 8:30	-1650	-1650	0.430	0.552	0.275						
2011/3/29 8:35	-1650	-1650	0.430	0.552	0.275						
2011/3/29 8:45	-1650	-1650	0.426	0.550	0.275	0.275		4.01E+01		1.98E+01	
2011/3/29 9:10	-1650	-1650	0.428	0.550	0.275	0.275		3.37E+01		1.98E+01	
2011/3/29 9:40	-1650	-1650	0.426	0.546	0.275	0.275		3.94E+01		1.98E+01	
2011/3/29 13:00	-1650	-1600	0.412	0.546	0.265	0.265		3.38E+01		1.97E+01	
2011/3/29 16:00	-1650	-1600	0.408	0.546	0.265	0.265		3.36E+01		1.96E+01	
2011/3/29 19:00	-1650	-1650	0.398	0.536	0.250	0.250		3.48E+01		1.94E+01	
2011/3/29 22:00	-1650	-1650	0.392	0.536	0.245	0.250		3.94E+01		1.93E+01	
2011/3/30 1:00	-1600	-1600	0.400	0.546	0.240	0.240		3.97E+01		1.92E+01	
2011/3/30 4:00	-1600	-1600	0.392	0.542	0.235	0.235		3.32E+01		1.91E+01	
2011/3/30 7:00	-1600	-1600	0.380	0.538	0.235	0.235		3.71E+01		1.90E+01	
2011/3/30 10:00	-1600	-1600	0.376	0.536	0.230	0.230		4.06E+01		1.89E+01	
2011/3/30 13:00	-1600	-1600	0.378	0.546	0.230	0.230		3.77E+01		1.82E+01	
2011/3/30 16:00	-1600	-1600	0.366	0.538	0.230	0.230		4.00E+01		1.85E+01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/3/30 18:00	-1600	-1600	0.366	0.538	0.225	0.225		4.07E+01		1.85E+01	
2011/3/30 20:00	-1600	-1600	0.362	0.548	0.220	0.220		4.01E+01		1.85E+01	
2011/3/30 22:00	-1650	-1650	0.372	0.562	0.220	0.220		4.00E+01		1.84E+01	
2011/3/31 0:00	-1600	-1600	0.362	0.552	0.220	0.220		4.12E+01		1.83E+01	
2011/3/31 2:00	-1600	-1600	0.362	0.552	0.210	0.210		4.23E+01		1.83E+01	
2011/3/31 4:00	-1650	-1650	0.370	0.568	0.210	0.210		4.17E+01		1.82E+01	
2011/3/31 6:00	-1650	-1650	0.368	0.568	0.210	0.210		3.82E+01		1.81E+01	
2011/3/31 8:00	-1650	-1650	0.366	0.550	0.210	0.210		3.42E+01		1.80E+01	
2011/3/31 10:00	-1600	-1600	0.358	0.566	0.210	0.210		4.23E+01		1.80E+01	
2011/3/31 12:00	-1600	-1650	0.366	0.562	0.210	0.205		4.12E+01		1.72E+01	
2011/3/31 13:00	-1600	-1550	0.356	0.552	0.205	0.205		4.12E+01		1.72E+01	
2011/3/31 14:00	-1600	-1550	0.352	0.552	0.205	0.205		3.44E+01		1.76E+01	
2011/3/31 16:00	-1600	-1550	0.350	0.552	0.190	0.190		4.35E+01		1.77E+01	
2011/3/31 18:00	-1600	-1600	0.340	0.548	0.180	0.180		4.10E+01		1.77E+01	
2011/3/31 20:00	-1650	-1650	0.336	0.538	0.180	0.180		4.25E+01		1.76E+01	
2011/3/31 22:00	-1650	-1650	0.340	0.546	0.180	0.180		4.29E+01		1.76E+01	
2011/4/1 0:00	-1650	-1650	0.326	0.536	0.175	0.175		4.39E+01		1.75E+01	
2011/4/1 2:00	-1600	-1600	0.328	0.546	0.175	0.175		3.87E+01		1.75E+01	
2011/4/1 4:00	-1650	-1600	0.336	0.558	0.170	0.175		4.24E+01		1.74E+01	
2011/4/1 6:00	-1600	-1600	0.326	0.550	0.170	0.170		4.43E+01		1.74E+01	
2011/4/1 8:00	-1650	-1650	0.322	0.552	0.165	0.170		4.25E+01		1.73E+01	
2011/4/1 10:00	-1650	-1650	0.328	0.552	0.165	0.165		4.30E+01		1.72E+01	
2011/4/1 12:00	-1650	-1600	0.320	0.550	0.165	0.165		4.09E+01		1.72E+01	
2011/4/1 16:00	-1600	-1600	0.326	0.550	0.160	0.160		4.42E+01		1.69E+01	
2011/4/1 16:30	-1600	-1600	0.326	0.564	0.160	0.160		4.30E+01		1.70E+01	
2011/4/1 17:00	-1600	-1600	0.326	0.560	0.160	0.160		4.38E+01		1.70E+01	
2011/4/1 20:00	-1600	-1600	0.316	0.556	0.160	0.160		4.29E+01		1.69E+01	
2011/4/2 0:30	-1600	-1600	0.310	0.566	0.160	0.160		4.10E+01		1.67E+01	
2011/4/2 4:00	-1600	-1600	0.320	0.578	0.160	0.160		4.55E+01		1.65E+01	
2011/4/2 8:00	-1650	-1600	0.326	0.582	0.160	0.160		4.42E+01		1.62E+01	
2011/4/2 12:00	-1650	-1650	0.322	0.590	0.155	0.155		4.51E+01		1.60E+01	
2011/4/2 16:30	-1650	-1650	0.316	0.598	0.155	0.155		3.63E+01		1.57E+01	
2011/4/2 20:00	-1650	-1650	0.326	0.598	0.155	0.155		3.38E+01		1.55E+01	
2011/4/2 20:37	-1650	-1650	0.328	0.598	0.155	0.155					
2011/4/2 20:47	-1650	-1650	0.328	0.600	0.155	0.160					
2011/4/2 21:07	-1650	-1650	0.326	0.598	0.155	0.160		3.19E+01		1.56E+01	
2011/4/2 23:00	-1650	-1650	0.322	0.590	0.155	0.160		3.75E+01		1.55E+01	
2011/4/3 3:00	-1650	-1650	0.322	0.602	0.155	0.160		3.18E+01		1.53E+01	
2011/4/3 7:00	-1650	-1600	0.328	0.608	0.155	0.160		4.74E+01		1.50E+01	
2011/4/3 9:00	-1650	-1650	0.326	0.608	0.155	0.155		4.46E+01		1.49E+01	
2011/4/3 10:52	-1650	-1650	0.330	0.612	0.155	0.155					
2011/4/3 11:02			0.330	0.618	0.155	0.155					
2011/4/3 11:07	-1650	-1650	0.328	0.616	0.155	0.155					
2011/4/3 11:12	-1650	-1650	0.328	0.612	0.155	0.155					
2011/4/3 11:17	-1650	-1650	0.328	0.612	0.155	0.155					
2011/4/3 11:37	-1650	-1650		0.616	0.155	0.155					
2011/4/3 12:17	-1650	-1650	0.330	0.626	0.155	0.155					
2011/4/3 12:35	-1650	-1650	0.336	0.628	0.155	0.155		3.11E+01		1.41E+01	
2011/4/3 14:00	-1650	-1650	0.328	0.618	0.155	0.155		3.86E+01		1.42E+01	
2011/4/3 17:20	-1650	-1650	0.336	0.628	0.155	0.155		3.89E+01		1.38E+01	
2011/4/3 17:35	-1650	-1650	0.336	0.632	0.155	0.155					
2011/4/3 17:45	-1650	-1650	0.336	0.632	0.155	0.155					
2011/4/3 18:00	-1650	-1650	0.332	0.636	0.155	0.155		3.84E+01		1.38E+01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/4 0:00	-1650	-1650	0.338	0.658	0.155	0.155		3.83E+01		1.34E+01	
2011/4/4 6:00	-1700	-1650	0.338	0.670	0.150	0.150		3.77E+01		1.28E+01	
2011/4/4 11:00	-1650	-1650	0.332	0.670	0.150	0.150		3.87E+01		1.22E+01	
2011/4/4 18:00	-1650	-1650	0.332	0.672	0.150	0.150		3.19E+01		1.16E+01	
2011/4/5 0:00	-1700	-1650	0.338	0.672	0.150	0.150		3.21E+01		1.08E+01	
2011/4/5 6:00	-1700	-1650	0.342	0.688	0.150	0.150		3.15E+01		1.02E+01	
2011/4/5 12:00	-1650	-1650	0.346	0.696	0.150	0.150		3.23E+01		9.64E+00	
2011/4/5 18:00	-1650	-1650	0.338	0.718	0.150	0.150		3.15E+01		9.19E+00	
2011/4/6 0:00	-1650	-1650	0.338	0.703	0.150	0.150		3.11E+01		8.79E+00	
2011/4/6 6:00	-1650	-1700	0.350	0.723	0.150	0.150		3.11E+01		8.40E+00	
2011/4/6 12:00	-1650	-1650	0.348	0.725	0.150	0.150		3.10E+01		8.01E+00	
2011/4/6 18:00	-1650	-1650	0.350	0.720	0.150	0.150		3.05E+01		7.57E+00	
2011/4/6 22:00	-1650	-1650	0.353	0.733	0.150	0.150		4.06E+01		7.32E+00	
2011/4/7 0:00	-1650	-1650	0.355	0.735	0.150	0.150		3.37E+01		7.17E+00	
2011/4/7 5:20					0.155	0.155					
2011/4/7 5:30					0.155	0.155					
2011/4/7 5:40					0.155	0.155					
2011/4/7 5:50					0.155	0.155					
2011/4/7 6:00	-1650	-1650	0.363	0.758	0.155	0.155		3.08E+01		1.29E+01	
2011/4/7 7:00					0.160	0.155					
2011/4/7 7:10					0.160	0.155					
2011/4/7 7:20					0.160	0.155					
2011/4/7 7:30					0.160	0.155					
2011/4/7 7:40					0.160	0.155					
2011/4/7 7:50					0.160	0.155					
2011/4/7 8:00					0.160	0.155					
2011/4/7 8:10					0.160	0.155					
2011/4/7 8:20					0.160	0.155					
2011/4/7 8:30					0.160	0.155					
2011/4/7 8:40					0.160	0.155					
2011/4/7 8:50					0.160	0.155					
2011/4/7 9:00					0.160	0.155					
2011/4/7 9:10					0.165	0.155					
2011/4/7 9:20					0.165	0.155					
2011/4/7 9:30					0.165	0.155					
2011/4/7 9:40					0.165	0.155					
2011/4/7 9:50					0.165	0.155					
2011/4/7 10:00					0.165	0.155					
2011/4/7 10:10					0.165	0.155					
2011/4/7 10:20					0.165	0.155					
2011/4/7 10:30					0.165	0.155					
2011/4/7 11:00					0.165	0.150					
2011/4/7 12:00	-1650	-1650	0.375	0.758	0.165	0.150		3.17E+01		1.29E+01	
2011/4/7 13:00					0.165	0.150					
2011/4/7 14:00					0.165	0.150					
2011/4/7 15:00					0.165	0.150					
2011/4/7 16:00					0.170	0.150					
2011/4/7 17:00					0.170	0.150					
2011/4/7 18:00	-1650	-1650	0.380	0.773	0.170	0.150		3.11E+01		1.28E+01	
2011/4/7 19:00					0.175	0.150					
2011/4/7 20:00					0.175	0.150					
2011/4/7 21:00					0.175	0.150					
2011/4/7 22:00					0.175	0.150					

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level (fuel range)(A) (mm)	reactor water level (fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/7 23:00					0.175	0.150					
2011/4/8 0:00	-1650	-1650	0.390	0.788	0.175	0.150		1.00E+02		1.27E+01	
2011/4/8 1:00					0.180	0.150					
2011/4/8 2:00					0.180	0.150					
2011/4/8 3:00					0.180	0.150					
2011/4/8 4:00					0.180	0.150					
2011/4/8 5:00					0.180	0.150					
2011/4/8 6:00	-1650	-1650	0.395	0.785	0.180	0.150		1.87E+02		1.26E+01	
2011/4/8 8:00					0.180	0.150		7.62E+01		1.25E+01	
2011/4/8 9:00					0.180	0.150		1.79E+02		1.25E+01	
2011/4/8 10:00					0.180	0.150		1.76E+02		1.25E+01	
2011/4/8 11:00					0.180	0.150		6.20E+01		1.25E+01	
2011/4/8 12:00	-1650	-1650	0.395	0.793	0.180	0.150		6.29E+01		1.18E+01	
2011/4/8 13:00					0.185	0.155		6.83E+01		1.22E+01	
2011/4/8 14:00					0.190	0.155	2.25E+00	7.10E+01		1.22E+01	
2011/4/8 15:00					0.190	0.155	2.03E+00	1.95E+02		1.23E+01	Confirmed instrument failure – CAMSD/W(A) and (B)
2011/4/8 16:00					0.185	0.155	2.05E+00	1.89E+02		1.23E+01	
2011/4/8 17:00					0.185	0.155	4.10E-03	6.10E+01		1.22E+01	
2011/4/8 18:00	-1650	-1650	0.385	0.795	0.185	0.155	3.95E-03	1.85E+02		1.22E+01	
2011/4/8 19:00					0.185	0.155	2.90E-03	8.15E+01		1.22E+01	
2011/4/8 20:00					0.185	0.155	3.45E-03	5.85E+01		1.22E+01	
2011/4/8 21:00					0.185	0.155	3.37E-03	2.00E+02		1.22E+01	
2011/4/8 22:00					0.185	0.155	3.48E-03	1.51E+02		1.22E+01	
2011/4/8 23:00					0.185	0.155	3.70E-03	9.00E+01		1.22E+01	
2011/4/9 0:00	-1650	-1650	0.395	0.803	0.190	0.155	3.88E-03	8.16E+01		1.22E+01	
2011/4/9 1:00					0.190	0.155	3.12E-03	3.14E+01		1.22E+01	
2011/4/9 2:00					0.190	0.160	2.86E-03	8.12E+01		1.21E+01	
2011/4/9 3:00					0.190	0.160	3.54E-03	1.58E+02		1.21E+01	
2011/4/9 4:00					0.190	0.160	3.75E-03	2.03E+02		1.21E+01	
2011/4/9 4:10					0.190						
2011/4/9 4:20					0.190						
2011/4/9 4:30					0.190	0.160					
2011/4/9 4:40					0.190	0.160					
2011/4/9 4:50					0.190	0.160					
2011/4/9 5:00					0.190	0.160	3.85E-03	1.85E+02		1.21E+01	
2011/4/9 6:00	-1650	-1650	0.403	0.820	0.190	0.160	3.29E-03	1.78E+02		1.21E+01	
2011/4/9 7:00					0.190	0.160	3.07E-03	1.60E+02		1.20E+01	
2011/4/9 8:00					0.190	0.160	2.66E-03	1.98E+02		1.20E+01	
2011/4/9 9:00					0.190	0.160	3.01E-03	1.13E+02		1.20E+01	
2011/4/9 10:00					0.190	0.160	2.50E-03	8.00E+01		1.20E+01	
2011/4/9 11:00					0.190	0.160	3.40E-03	9.50E+01		1.20E+01	
2011/4/9 12:00	-1650	-1650	0.410	0.825	0.190	0.160	3.55E-03	1.78E+02		1.19E+01	
2011/4/9 16:00	-1650	-1650	0.410	0.825	0.190	0.160	3.90E-03	1.61E+02		1.19E+01	
2011/4/9 18:00	-1650	-1650	0.413	0.830	0.190	0.160	2.54E-03	1.58E+02		1.18E+01	
2011/4/9 20:00	-1600	-1650	0.413	0.838	0.195	0.165	2.94E-03	1.52E+02		1.18E+01	
2011/4/9 22:00	-1600	-1650	0.413	0.843	0.195	0.165	2.67E-03	1.49E+02		1.17E+01	
2011/4/10 0:00	-1600	-1650	0.415	0.850	0.195	0.160	3.27E-03	1.04E+02		1.17E+01	
2011/4/10 2:00					0.195	0.160	3.71E-03	1.32E+02		1.17E+01	
2011/4/10 4:00					0.195	0.165	4.00E-03	1.40E+02		1.16E+01	
2011/4/10 6:00	-1550	-1600	0.410	0.848	0.195	0.165	3.77E-03	1.51E+02		1.16E+01	
2011/4/10 10:00	-1600	-1700	0.413	0.858	0.195	0.160	3.38E-03	1.16E+02		1.15E+01	
2011/4/10 12:00	-1600	-1650	0.415	0.858	0.195	0.165	4.01E-03	8.45E+01		1.07E+01	
2011/4/10 14:00					0.195	0.165	4.08E-03	1.63E+02		1.11E+01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/10 16:00					0.195	0.165	3.36E-03	1.56E+02		1.12E+01	
2011/4/10 18:00	-1550	-1650	0.415	0.863	0.195	0.165	4.05E-03	1.23E+02		1.12E+01	
2011/4/10 20:00					0.195	0.160	2.83E-03	1.36E+02		1.12E+01	
2011/4/10 22:00					0.195	0.165	3.04E-03	1.27E+02		1.12E+01	
2011/4/11 0:00	-1650	-1650	0.413	0.873	0.195	0.165	3.75E-03	1.32E+02		1.12E+01	
2011/4/11 2:00					0.195	0.165	4.05E-03	1.28E+02		1.12E+01	
2011/4/11 4:00					0.195	0.165	3.71E-03	1.35E+02		1.12E+01	
2011/4/11 6:00	-1650	-1650	0.410	0.873	0.195	0.165	3.40E-03	1.27E+02		1.11E+01	
2011/4/11 8:00					0.195	0.165	4.10E-03	1.22E+02		1.11E+01	
2011/4/11 10:00					0.195	0.165	3.97E-03	1.28E+02		1.11E+01	
2011/4/11 10:45					0.195	0.165	3.81E-03	1.28E+02		1.11E+01	
2011/4/11 11:30					0.195	0.165	3.72E-03	1.26E+02		1.11E+01	
2011/4/11 12:00	-1600	-1650	0.416	0.873	0.195	0.165	3.75E-03	1.23E+02		1.11E+01	
2011/4/11 14:30					0.195	0.165	3.55E-03	1.25E+02		1.10E+01	
2011/4/11 16:00					0.195	0.165	2.17E-03	1.35E+02		1.10E+01	
2011/4/11 18:30	-1600	-1600	0.416	0.895	0.195	0.165	2.75E-03	1.22E+02		1.04E+01	
2011/4/11 20:00					0.195	0.165	2.08E-03	1.28E+02		1.06E+01	
2011/4/11 22:00					0.195	0.160	2.80E-03	1.46E+02		1.08E+01	
2011/4/11 23:40					0.195	0.165					
2011/4/12 0:00	-1600	-1500	0.416	0.898	0.195	0.165	2.55E-03	1.27E+02		1.08E+01	
2011/4/12 4:00					0.190	0.165	3.03E-03	1.05E+02		1.08E+01	
2011/4/12 6:00	-1650	-1650	0.416	0.908	0.190	0.165	3.35E-03	1.29E+02		1.08E+01	
2011/4/12 8:00					0.190	0.165	2.41E-03	1.31E+02		1.07E+01	
2011/4/12 10:00					0.190	0.165	2.72E-03	1.43E+02		1.07E+01	
2011/4/12 13:00	-1600	-1600	0.400	0.900	0.190	0.165	2.56E-03	9.01E+01		9.50E+00	
2011/4/12 14:00					0.190	0.165	4.15E-03	1.24E+02		1.00E+01	
2011/4/12 15:00	-1600	-1600	0.418	0.918	0.190	0.165	4.13E-03	1.45E+02		1.02E+01	
2011/4/12 17:00					0.190	0.165	2.00E-03	1.69E+02		1.03E+01	
2011/4/12 18:00	-1600	-1600	0.420	0.920	0.190	0.165	3.60E-03	1.36E+02		1.04E+01	
2011/4/12 21:00					0.190	0.165	3.41E-03	1.38E+02		1.04E+01	
2011/4/12 23:00	-1650	-1650	0.423	0.925	0.190	0.165	2.75E-03	1.48E+02		1.04E+01	
2011/4/13 3:30					0.190	0.165	2.19E-03	1.41E+02		1.04E+01	
2011/4/13 6:00	-1650	-1650	0.423	0.928	0.190	0.165	3.16E-03	1.38E+02		1.04E+01	
2011/4/13 9:00					0.190	0.165	3.61E-03	1.33E+02		1.04E+01	
2011/4/13 12:00	-1600	-1650	0.420	0.933	0.190	0.165	3.20E-03	1.33E+02		1.03E+01	
2011/4/13 15:00					0.190	0.165	2.20E-03	1.34E+02		1.03E+01	
2011/4/13 18:00	-1600	-1650	0.425	0.938	0.190	0.165	2.85E-03	1.30E+02		1.02E+01	
2011/4/13 21:00					0.190	0.165	2.60E-03	1.07E+02		1.02E+01	
2011/4/14 0:00	-1600	-1600	0.423	0.940	0.190	0.165	2.64E-03	1.30E+02		1.01E+01	
2011/4/14 3:00					0.190	0.165	3.36E-03	1.45E+02		1.01E+01	
2011/4/14 6:00	-1600	-1600	0.420	0.940	0.190	0.165	3.44E-03	1.50E+02		1.00E+01	
2011/4/14 9:00					0.190	0.165	2.69E-03	1.42E+02		1.00E+01	
2011/4/14 12:00	-1600	-1600	0.423	0.948	0.190	0.165	3.21E-03	1.57E+02		9.96E+00	
2011/4/14 15:00					0.190	0.165	3.07E-03	1.41E+02		9.92E+00	
2011/4/14 18:00	-1600	-1600	0.425	0.940	0.190	0.170	2.53E-03	1.38E+02		9.87E+00	
2011/4/14 21:00					0.190	0.170	3.00E-03	1.16E+02		9.82E+00	
2011/4/15 0:00	-1550	-1550	0.428	0.953	0.190	0.170	2.73E-03	1.16E+02		9.77E+00	
2011/4/15 3:00			0.428	0.953	0.185	0.165	1.84E-03	8.13E+01		9.72E+00	
2011/4/15 6:00	-1550	-1600	0.430	0.965	0.190	0.170	2.94E-03	9.58E+01		9.68E+00	
2011/4/15 12:00	-1650	-1650	0.430	0.965	0.190	0.170	3.01E-03	1.58E+02		9.58E+00	
2011/4/15 18:00	-1650	-1650	0.428	0.963	0.190	0.170	2.89E-03	1.49E+02	1.21E+00	9.49E+00	
2011/4/15 21:00					0.190	0.170	2.36E-03	1.48E+02	1.21E+00	9.44E+00	
2011/4/16 0:00	-1650	-1700	0.423	0.978	0.185	0.170	3.50E-03	1.58E+02	1.20E+00	9.39E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/16 3:00					0.190	0.170	1.93E-03	6.70E+01	1.20E+00	9.35E+00	
2011/4/16 6:00	-1650	-1650	0.423	0.978	0.190	0.170	3.55E-03	1.60E+02	1.20E+00	9.30E+00	
2011/4/16 9:00					0.185	0.170	2.63E-03	1.37E+02	1.20E+00	9.26E+00	
2011/4/16 12:00	-1650	-1650	0.423	0.975	0.185	0.175	2.22E-03	1.80E+02	1.19E+00	9.22E+00	
2011/4/16 15:00					0.185	0.170	3.13E-03	1.03E+02	1.19E+00	9.17E+00	
2011/4/16 18:00	-1650	-1650	0.423	0.985	0.185	0.175	2.14E-03	1.17E+02	1.19E+00	9.11E+00	
2011/4/16 21:00					0.180	0.175	4.00E-03	1.76E+02	1.18E+00	9.08E+00	
2011/4/17 0:00	-1650	-1650	0.425	0.993	0.180	0.175	2.85E-03	1.64E+02	1.18E+00	9.03E+00	
2011/4/17 3:00					0.180	0.175	3.28E-03	1.51E+02	1.16E+00	8.91E+00	
2011/4/17 6:00	-1650	-1650	0.425	1.003	0.180	0.175	3.30E-03	1.41E+02	1.12E+00	8.38E+00	
2011/4/17 9:00					0.180	0.175	3.80E-03	1.84E+02	1.09E+00	7.55E+00	
2011/4/17 12:00	-1650	-1650	0.420	0.973	0.175	0.170	2.72E-03	2.24E+02	1.07E+00	6.67E+00	
2011/4/17 15:00					0.180	0.175	2.90E-03	1.73E+02	1.06E+00	5.93E+00	
2011/4/17 18:00	-1650	-1650	0.423	1.008	0.175	0.175	3.06E-03	1.93E+02	1.04E+00	5.32E+00	
2011/4/17 21:00					0.175	0.170	2.32E-03	1.65E+02	1.03E+00	4.77E+00	
2011/4/18 0:00	-1650	-1650	0.420	1.015	0.175	0.170	2.79E-03	1.76E+02	1.02E+00	4.26E+00	
2011/4/18 6:00	-1650	-1650	0.423	1.030	0.170	0.170	1.71E-03	1.75E+02	1.00E+00	3.30E+00	
2011/4/18 9:00					0.170	0.170	2.99E-03	1.74E+02	9.96E-01	2.90E+00	
2011/4/18 12:00	-1650	-1650	0.428	1.035	0.170	0.170	2.46E-03	1.73E+02	9.92E-01	2.56E+00	
2011/4/18 13:00					0.170	0.170	3.85E-03	1.64E+02	9.92E-01	2.55E+00	
2011/4/18 18:00	-1600	-1550	0.423	1.023	0.170	0.170	3.70E-03	1.46E+02	9.89E-01	2.33E+00	
2011/4/18 21:00					0.170	0.170	3.50E-03	1.34E+02	9.90E-01	2.31E+00	
2011/4/19 0:00	-1600	-1550	0.425	1.035	0.170	0.170	2.70E-03	1.30E+02	9.90E-01	2.30E+00	
2011/4/19 3:00					0.170	0.170	1.81E-03	1.67E+02	9.89E-01	2.28E+00	
2011/4/19 6:00	-1600	-1550	0.423	1.040	0.170	0.170	2.84E-03	1.02E+02	9.89E-01	2.26E+00	
2011/4/19 9:00					0.165	0.170	1.18E+00	1.70E+02	9.88E-01	2.24E+00	
2011/4/19 12:00	-1600	-1550	0.430	1.048	0.165	0.170	1.10E+00	1.67E+02	9.88E-01	2.21E+00	
2011/4/19 15:00					0.170	0.170	1.39E+00	1.53E+02	9.88E-01	2.19E+00	
2011/4/19 18:00	-1600	-1600	0.428	1.065	0.170	0.170	2.02E-03	1.24E+02	9.87E-01	2.14E+00	
2011/4/19 21:00					0.165	0.170	1.50E-03	1.38E+02	9.87E-01	2.11E+00	
2011/4/20 0:00	-1650	-1650	0.423	1.070	0.165	0.165	1.72E+00	1.40E+02	9.89E-01	2.10E+00	
2011/4/20 3:00					0.165	0.165	1.65E+00	1.44E+02	9.90E-01	2.09E+00	
2011/4/20 6:00	-1650	-1650	0.425	1.075	0.165	0.165	1.01E+00	1.63E+02	9.91E-01	2.08E+00	
2011/4/20 9:00	-1650	-1700			0.165	0.165	9.92E-01	1.41E+02	9.91E-01	2.07E+00	
2011/4/20 12:00	-1700	-1700	0.420	1.078	0.160	0.160	1.00E+00	1.43E+02	9.91E-01	2.05E+00	
2011/4/20 15:00					0.160	0.160	1.07E+00	1.50E+02	9.92E-01	1.04E+00	
2011/4/20 18:00	-1700	-1650	0.428	1.088	0.160	0.160	1.06E+00	1.51E+02	9.92E-01	2.03E+00	
2011/4/20 21:00					0.160	0.160	1.57E+00	1.40E+02	9.92E-01	2.03E+00	
2011/4/21 0:00	-1700	-1650	0.420	1.093	0.160	0.160	1.57E+00	1.42E+02	9.92E-01	2.02E+00	
2011/4/21 3:00					0.160	0.165	3.85E-03	1.42E+02	9.92E-01	2.00E+00	
2011/4/21 6:00	-1700	-1650	0.425	1.103	0.160	0.160	2.42E-03	1.40E+02	9.94E-01	1.99E+00	
2011/4/21 9:00					0.160	0.160	3.77E-03	1.40E+02	9.95E-01	1.98E+00	
2011/4/21 12:00	-1650	-1650	0.433	1.110	0.160	0.160	1.45E+00	1.51E+02	9.96E-01	1.96E+00	
2011/4/21 15:00					0.160	0.160	1.48E+00	1.45E+02	9.95E-01	1.93E+00	
2011/4/21 18:00	-1650	-1700	0.433	1.103	0.160	0.160	1.53E+00	1.51E+02	9.94E-01	1.91E+00	
2011/4/21 21:00					0.160	0.160	1.57E+00	1.60E+02	9.94E-01	1.89E+00	
2011/4/22 0:00	-1650	-1650	0.433	1.105	0.160	0.160	1.53E+00	1.54E+02	9.94E-01	1.88E+00	
2011/4/22 3:00					0.160	0.160	1.36E-03	1.25E+02	9.93E-01	1.87E+00	
2011/4/22 6:00	-1650	-1650	0.435	1.113	0.160	0.160	1.66E-03	1.53E+02	9.94E-01	1.85E+00	
2011/4/22 9:00					0.160	0.160	1.74E-03	1.16E+02	9.94E-01	1.84E+00	
2011/4/22 12:00	-1650	-1650	0.440	1.120	0.160	0.160	1.42E-03	1.82E+02	9.94E-01	1.83E+00	
2011/4/22 15:00					0.160	0.160	1.56E-03	1.84E+02	9.95E-01	1.83E+00	
2011/4/22 18:00	-1650	-1650	0.430	1.113	0.160	0.160	1.31E-03	2.43E+02	9.96E-01	1.82E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/22 21:00					0.160	0.160	1.71E-03	9.92E+01	9.96E-01	1.81E+00	
2011/4/23 0:00	-1650	-1650	0.440	1.128	0.160	0.160	1.84E-03	1.22E+02	9.97E-01	1.80E+00	
2011/4/23 3:00					0.160	0.160	1.39E-03	1.59E+02	9.97E-01	1.79E+00	
2011/4/23 6:00	-1700	-1700	0.443	1.138	0.160	0.160	1.66E-03	1.58E+02	9.98E-01	1.78E+00	
2011/4/23 9:00					0.160	0.160	1.43E-03	1.43E+02	9.99E-01	1.77E+00	
2011/4/23 12:00	-1700	-1700	0.440	1.130	0.160	0.160	1.80E-03	1.52E+02	1.00E+00	1.77E+00	
2011/4/23 15:00					0.160	0.160	1.78E-03	1.42E+02	1.00E+00	1.76E+00	
2011/4/23 18:00	-1650	-1700	0.440	1.130	0.155	0.155	1.45E-03	1.65E+02	1.00E+00	1.75E+00	
2011/4/23 21:00					0.155	0.155	1.34E-03	1.55E+02	1.00E+00	1.75E+00	
2011/4/24 0:00	-1650	-1650	0.438	1.130	0.155	0.155	1.28E-03	1.53E+02	1.01E+00	1.74E+00	
2011/4/24 3:00					0.155	0.155	1.38E-03	9.50E+01	1.01E+00	1.74E+00	
2011/4/24 6:00	-1700	-1700	0.435	1.143	0.155	0.155	1.66E-03	1.08E+02	1.01E+00	1.74E+00	
2011/4/24 12:00	-1700	-1700	0.433	1.143	0.155	0.155	2.12E-03	1.21E+02	1.02E+00	1.74E+00	
2011/4/24 15:00					0.155	0.155	1.57E-03	3.02E+02	1.03E+00	1.74E+00	
2011/4/24 18:00	-1700	-1700	0.438	1.148	0.150	0.155	1.45E-03	1.97E+02	1.03E+00	1.74E+00	
2011/4/24 21:00					0.155	0.155	1.05E-03	1.96E+02	1.04E+00	1.74E+00	
2011/4/25 0:00	-1700	-1700	0.440	1.160	0.155	0.155	1.49E-03	2.05E+02	1.04E+00	1.74E+00	
2011/4/25 3:00					0.155	0.155	1.43E-03	1.02E+02	1.05E+00	1.75E+00	
2011/4/25 6:00	-1700	-1650	0.450	1.173	0.155	0.155	1.27E-03	1.54E+02	1.06E+00	1.76E+00	
2011/4/25 9:00					0.155	0.155	2.14E-03	1.40E+02	1.07E+00	1.76E+00	
2011/4/25 11:00	-1700	-1650	0.448	1.168	0.155	0.155	1.36E-03	1.47E+02	1.08E+00	1.76E+00	
2011/4/25 15:00	-1650	-1650	0.453	1.173	0.150	0.155	1.30E-03	1.45E+02	1.08E+00	1.74E+00	
2011/4/25 17:00	-1650	-1550	0.448	1.165	0.150	0.150	1.34E-03	1.58E+02	1.09E+00	1.74E+00	
2011/4/25 20:00					0.150	0.150	1.78E-03	2.09E+02	1.10E+00	1.75E+00	
2011/4/25 23:00	-1650	-1650	0.450	1.173	0.150	0.150	1.47E-03	2.00E+02	1.10E+00	1.75E+00	
2011/4/26 2:00					0.150	0.150	1.58E-03	2.47E+02	1.11E+00	1.75E+00	
2011/4/26 5:00	-1650	-1650	0.445	1.185	0.150	0.150	1.39E-03	1.37E+02	1.11E+00	1.74E+00	
2011/4/26 8:00					0.150	0.150	1.70E-03	1.76E+02	1.12E+00	1.74E+00	
2011/4/26 11:00	-1650	-1650	0.445	1.180	0.150	0.150	1.71E-03	1.96E+02	1.12E+00	1.74E+00	
2011/4/26 14:00					0.155	0.155	1.22E-03	2.40E+02	1.12E+00	1.74E+00	
2011/4/26 17:00	-1600	-1650	0.443	1.183	0.155	0.150	1.66E-03	1.36E+02	1.13E+00	1.74E+00	
2011/4/26 20:00	-1600	-1650	0.445	1.190	0.155	0.155	1.10E-03	2.08E+02	1.13E+00	1.74E+00	
2011/4/26 23:00	-1600	-1650	0.443	1.203	0.155	0.155	1.46E-03	2.22E+02	1.13E+00	1.73E+00	
2011/4/27 2:00					0.155	0.155	1.70E-03	1.85E+02	1.13E+00	1.73E+00	
2011/4/27 5:00	-1650	-1600	0.450	1.205	0.155	0.155	1.48E-03	8.00E+01	1.14E+00	1.73E+00	
2011/4/27 8:00	-1650	-1650	0.450	1.205	0.155	0.155	1.84E-03	2.30E+02	1.14E+00	1.72E+00	
2011/4/27 11:00	-1650	-1650	0.445	1.203	0.155	0.155	1.80E-03	6.78E+01	1.14E+00	1.72E+00	
2011/4/27 14:00	-1650	-1650	0.440	1.198	0.145	0.145	2.08E-03	6.75E+01	1.15E+00	1.71E+00	
2011/4/27 17:00	-1650	-1650	0.435	1.188	0.140	0.140	3.45E-01	6.59E+01	1.15E+00	1.71E+00	
2011/4/27 20:00	-1650	-1650	0.423	1.175	0.135	0.135	1.85E-03	6.53E+01	1.16E+00	1.70E+00	
2011/4/27 23:00	-1650	-1550	0.420	1.173	0.130	0.130	5.90E-01	8.10E+01	1.16E+00	1.69E+00	
2011/4/28 2:00	-1650	-1600	0.415	1.170	0.125	0.125	1.17E+00	4.75E+01	1.16E+00	1.68E+00	
2011/4/28 5:00	-1650	-1600	0.415	1.168	0.125	0.125	1.92E+00	2.48E+01	1.16E+00	1.67E+00	
2011/4/28 8:00	-1600	-1600	0.415	1.170	0.120	0.120	2.59E+00	2.46E+01	1.16E+00	1.65E+00	
2011/4/28 11:00	-1600	-1600	0.418	1.170	0.120	0.110	2.22E+00	2.46E+01	1.16E+00	1.64E+00	
2011/4/28 14:00	-1600	-1600	0.413	1.163	0.120	0.110	2.27E+00	2.46E+01	1.17E+00	1.62E+00	
2011/4/28 17:00	-1600	-1600	0.410	1.168	0.115	0.110	2.05E+00	2.49E+01	1.17E+00	1.60E+00	
2011/4/28 20:00	-1600	-1600	0.410	1.165	0.115	0.110	9.88E-01	3.16E+01	1.17E+00	1.58E+00	
2011/4/28 23:00	-1600	-1600	0.410	1.168	0.110	0.110	1.30E+00	2.94E+01	1.17E+00	1.56E+00	
2011/4/29 2:00	-1600	-1650	0.413	1.170	0.110	0.110	1.57E+00	3.01E+01	1.17E+00	1.53E+00	
2011/4/29 5:00	-1650	-1650	0.413	1.175	0.110	0.110	2.55E+00	4.99E+01	1.17E+00	1.50E+00	
2011/4/29 8:00	-1650	-1650	0.408	1.180	0.105	0.105	2.63E+00	5.65E+01	1.17E+00	1.48E+00	
2011/4/29 10:00	-1700	-1700	0.408	1.173	0.105	0.105	2.75E+00	5.70E+01	1.16E+00	1.46E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/4/29 11:00	-1700	-1700	0.410	1.175	0.105	0.105	2.78E+00	6.66E+01	1.17E+00	1.49E+00	
2011/4/29 14:00	-1700	-1700	0.420	1.185	0.115	0.110	2.80E+00	7.67E+01	1.16E+00	1.57E+00	
2011/4/29 17:00	-1650	-1650	0.423	1.188	0.120	0.110	2.23E+00	6.14E+01	1.16E+00	1.59E+00	
2011/4/29 20:00	-1650	-1700	0.425	1.190	0.120	0.110	1.91E+00	3.53E+01	1.16E+00	1.60E+00	
2011/4/29 23:00	-1700	-1700	0.430	1.200	0.120	0.110	1.51E+00	1.07E+02	1.16E+00	1.60E+00	
2011/4/30 2:00	-1650	-1700	0.430	1.198	0.120	0.115	1.51E+00	1.12E+02	1.16E+00	1.59E+00	
2011/4/30 5:00	-1650	-1700	0.435	1.205	0.120	0.115	1.35E+00	1.15E+02	1.16E+00	1.57E+00	
2011/4/30 8:00	-1650	-1700	0.438	1.210	0.125	0.120	1.06E+00	3.36E+01	1.16E+00	1.55E+00	
2011/4/30 11:00	-1650	-1700	0.440	1.215	0.125	0.120	1.33E+00	6.39E+01	1.16E+00	1.53E+00	
2011/4/30 14:00	-1650	-1700	0.438	1.213	0.125	0.120	1.08E+00	6.75E+01	1.16E+00	1.50E+00	
2011/4/30 17:00	-1650	-1700	0.440	1.210	0.125	0.120	7.33E-01	7.72E+01	1.16E+00	1.46E+00	
2011/4/30 20:00	-1650	-1700	0.445	1.215	0.130	0.125	1.05E+00	8.85E+01	1.15E+00	1.41E+00	
2011/4/30 23:00	-1650	-1700	0.443	1.218	0.130	0.125	7.44E-01	8.85E+01	1.15E+00	1.37E+00	
2011/5/1 2:00	-1650	-1700	0.443	1.220	0.135	0.130	7.84E-01	3.66E+01	1.15E+00	1.32E+00	
2011/5/1 5:00	-1650	-1650	0.445	1.230	0.130	0.130	5.90E-01	3.34E+01	1.15E+00	1.29E+00	
2011/5/1 8:00	-1650	-1700	0.443	1.225	0.130	0.130	8.64E-01	3.42E+01	1.15E+00	1.27E+00	
2011/5/1 11:00	-1650	-1700	0.440	1.225	0.130	0.130	9.18E-01	4.10E+01	1.15E+00	1.27E+00	
2011/5/1 14:00	-1650	-1700	0.443	1.223	0.135	0.130	8.18E-01	1.38E+02	1.15E+00	1.26E+00	
2011/5/1 17:00	-1650	-1700	0.443	1.215	0.135	0.130	7.58E-01	1.35E+02	1.15E+00	1.25E+00	
2011/5/1 20:00	-1650	-1650	0.445	1.223	0.135	0.135	1.08E+00	1.28E+02	1.14E+00	1.25E+00	
2011/5/1 23:00	-1650	-1700	0.450	1.225	0.135	0.135	1.08E+00	1.30E+02	1.14E+00	1.24E+00	
2011/5/2 2:00	-1650	-1700	0.450	1.233	0.135	0.135	1.71E-01	3.63E+01	1.14E+00	1.24E+00	
2011/5/2 5:00	-1650	-1700	0.453	1.240	0.135	0.135	2.45E-01	3.72E+01	1.14E+00	1.23E+00	
2011/5/2 8:00	-1650	-1700	0.448	1.243	0.135	0.135	7.81E-01	3.99E+01	1.14E+00	1.23E+00	
2011/5/2 11:00	-1650	-1700	0.448	1.245	0.135	0.135	1.13E+00	5.81E+01	1.14E+00	1.22E+00	
2011/5/2 14:00	-1650	-1700	0.443	1.245	0.135	0.135	9.47E-01	5.71E+01	1.14E+00	1.22E+00	
2011/5/2 17:00	-1650	-1700	0.450	1.248	0.135	0.135	7.37E-01	4.70E+01	1.14E+00	1.22E+00	
2011/5/2 20:00	-1700	-1750	0.450	1.255	0.135	0.135	7.71E-01	4.36E+01	1.14E+00	1.21E+00	
2011/5/2 23:00	-1700	-1750	0.453	1.248	0.135	0.135	6.34E-01	3.70E+01	1.13E+00	1.21E+00	
2011/5/3 2:00	-1700	-1700	0.455	1.250	0.135	0.135	8.02E-01	2.87E+02	1.13E+00	1.21E+00	
2011/5/3 5:00	-1700	-1700	0.453	1.253	0.135	0.135	8.44E-01	6.97E+01	1.13E+00	1.20E+00	
2011/5/3 8:00	-1700	-1700	0.455	1.250	0.135	0.135	8.20E-01	2.93E+02	1.13E+00	1.20E+00	
2011/5/3 11:00	-1700	-1700	0.455	1.258	0.135	0.135	7.83E-01	4.12E+01	1.13E+00	1.20E+00	
2011/5/3 14:00	-1700	-1750	0.450	1.255	0.135	0.135	8.70E-01	3.55E+01	1.13E+00	1.19E+00	
2011/5/3 17:00	-1700	-1700	0.450	1.253	0.135	0.135	8.34E-01	3.48E+01	1.13E+00	1.19E+00	
2011/5/3 20:00	-1700	-1700	0.455	1.255	0.135	0.135	1.11E+00	3.44E+01	1.13E+00	1.19E+00	
2011/5/3 23:00	-1700	-1700	0.455	1.258	0.135	0.135	1.12E+00	7.82E+01	1.13E+00	1.20E+00	
2011/5/4 2:00	-1700	-1700	0.458	1.263	0.135	0.135	1.08E+00	9.25E+01	1.13E+00	1.20E+00	
2011/5/4 5:00	-1700	-1700	0.460	1.268	0.135	0.135	1.21E+00	3.80E+01	1.14E+00	1.20E+00	
2011/5/4 8:00	-1700	-1700	0.455	1.270	0.135	0.135	1.26E+00	3.53E+01	1.14E+00	1.20E+00	
2011/5/4 11:00	-1700	-1700	0.450	1.265	0.135	0.135	1.02E+00	3.17E+01	1.14E+00	1.19E+00	
2011/5/4 14:00	-1700	-1650	0.453	1.260	0.135	0.135	9.40E-01	6.65E+01	1.14E+00	1.19E+00	
2011/5/4 17:00	-1700	-1650	0.453	1.260	0.135	0.135	9.98E-01	4.05E+01	1.14E+00	1.19E+00	
2011/5/4 20:00	-1650	-1650	0.450	1.265	0.135	0.135	1.33E+00	5.85E+01	1.14E+00	1.19E+00	
2011/5/4 23:00	-1600	-1600	0.450	1.268	0.135	0.135	1.02E+00	3.01E+01	1.14E+00	1.19E+00	
2011/5/5 2:00	-1600	-1600	0.455	1.273	0.135	0.135	7.33E-01	4.44E+01	1.14E+00	1.19E+00	
2011/5/5 5:00	-1600	-1600	0.450	1.278	0.130	0.130	1.22E+00	5.29E+01	1.14E+00	1.18E+00	
2011/5/5 8:00	-1650	-1600	0.450	1.275	0.130	0.130	1.17E+00	4.80E+01	1.14E+00	1.18E+00	
2011/5/5 11:00	-1650	-1500	0.460	1.283	0.130	0.130	1.19E+00	5.80E+01	1.14E+00	1.18E+00	
2011/5/5 14:00	-1650	-1500	0.460	1.283	0.130	0.130	1.20E+00	7.61E+01	1.14E+00	1.18E+00	
2011/5/5 17:00	-1650	-1450	0.463	1.283	0.130	0.130	1.20E+00	4.18E+01	1.14E+00	1.18E+00	
2011/5/5 20:00	-1700	-1450	0.460	1.280	0.130	0.125	1.23E+00	5.20E+01	1.14E+00	1.18E+00	
2011/5/5 23:00	-1700	-1600	0.463	1.290	0.130	0.120	1.36E+00	2.05E+02	1.14E+00	1.18E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/5/6 2:00	-1700	-1650	0.448	1.280	0.130	0.120	1.70E+00	6.05E+01	1.14E+00	1.17E+00	
2011/5/6 5:00	-1700	-1700	0.463	1.295	0.130	0.120	2.04E+00	2.22E+02	1.13E+00	1.17E+00	
2011/5/6 8:00	-1700	-1650	0.460	1.288	0.130	0.120	1.15E+00	2.29E+02	1.13E+00	1.17E+00	
2011/5/6 11:00	-1650	-1700	0.465	1.285	0.130	0.120	1.81E+00	2.19E+02	1.13E+00	1.16E+00	
2011/5/6 14:00	-1650	-1700	0.463	1.290	0.125	0.120	1.93E+00	4.26E+01	1.13E+00	1.16E+00	
2011/5/6 17:00	-1650	-1700	0.463	1.285	0.125	0.120	2.29E+00	3.71E+01	1.13E+00	1.16E+00	
2011/5/6 20:00	-1650	-1700	0.460	1.295	0.125	0.115	2.80E+00	3.35E+01	1.12E+00	1.16E+00	
2011/5/6 23:00	-1650	-1700	0.460	1.295	0.125	0.115	2.11E+00	3.27E+01	1.12E+00	1.16E+00	
2011/5/7 2:00	-1650	-1650	0.468	1.303	0.125	0.115	2.54E+00	2.88E+01	1.12E+00	1.16E+00	
2011/5/7 5:00	-1700	-1700	0.465	1.303	0.125	0.115	2.56E+00	3.40E+01	1.12E+00	1.15E+00	
2011/5/7 8:00	-1700	-1650	0.468	1.293	0.125	0.115	2.65E+00	3.54E+01	1.12E+00	1.15E+00	
2011/5/7 11:00	-1700	-1650	0.463	1.290	0.125	0.115	2.31E+00	3.20E+01	1.12E+00	1.15E+00	
2011/5/7 14:00	-1650	-1650	0.460	1.285	0.125	0.115	2.60E+00	3.28E+01	1.12E+00	1.15E+00	
2011/5/7 17:00	-1650	-1650	0.463	1.293	0.125	0.115	3.07E+00	3.80E+01	1.12E+00	1.15E+00	
2011/5/7 20:00	-1700	-1700	0.463	1.293	0.120	0.110	3.26E+00	3.15E+01	1.12E+00	1.15E+00	
2011/5/7 23:00	-1650	-1650	0.458	1.293	0.125	0.110	3.40E+00	3.38E+01	1.12E+00	1.15E+00	
2011/5/8 2:00	-1650	-1700	0.460	1.298	0.120	0.110	2.94E+00	2.97E+01	1.12E+00	1.14E+00	
2011/5/8 5:00	-1650	-1700	0.460	1.290	0.120	0.110	2.59E+00	3.63E+01	1.12E+00	1.14E+00	
2011/5/8 8:00	-1700	-1700	0.458	1.293	0.120	0.110	3.48E+00	3.12E+01	1.12E+00	1.14E+00	
2011/5/8 11:00	-1700	-1700	0.455	1.290	0.120	0.110	3.16E+00	3.00E+01	1.12E+00	1.14E+00	
2011/5/8 14:00	-1700	-1700	0.458	1.290	0.120	0.110	3.25E+00	3.30E+01	1.12E+00	1.14E+00	
2011/5/8 17:00	-1700	-1700	0.458	1.285	0.120	0.110	3.62E+00	4.52E+01	1.12E+00	1.14E+00	
2011/5/8 20:00	-1700	-1700	0.458	1.295	0.120	0.110	3.05E+00	3.02E+01	1.11E+00	1.13E+00	
2011/5/8 23:00	-1700	-1700	0.465	1.295	0.120	0.110	2.78E+00	3.81E+01	1.11E+00	1.13E+00	
2011/5/9 2:00	-1650	-1700	0.460	1.290	0.120	0.105	2.88E+00	3.60E+01	1.11E+00	1.13E+00	
2011/5/9 5:00	-1650	-1700	0.460	1.300	0.120	0.105	3.18E+00	2.76E+01	1.11E+00	1.13E+00	
2011/5/9 8:00	-1650	-1700	0.458	1.293	0.120	0.105	3.10E+00	3.23E+01	1.11E+00	1.13E+00	
2011/5/9 11:00	-1650	-1650	0.465	1.288	0.120	0.105	3.19E+00	4.48E+01	1.11E+00	1.12E+00	
2011/5/9 14:00	-1650	-1650	0.458	1.290	0.120	0.105	3.71E+00	4.68E+01	1.11E+00	1.12E+00	
2011/5/9 17:00	-1650	-1700	0.460	1.280	0.115	0.105	3.55E+00	2.48E+01	1.11E+00	1.12E+00	
2011/5/9 20:00	-1650	-1700	0.460	1.278	0.120	0.105	3.30E+00	1.72E+02	1.11E+00	1.12E+00	
2011/5/9 23:00	-1650	-1650	0.458	1.283	0.120	0.105	3.97E+00	3.19E+01	1.11E+00	1.12E+00	
2011/5/10 2:00	-1650	-1650	0.465	1.280	0.120	0.105	3.73E+00	2.93E+01	1.11E+00	1.12E+00	
2011/5/10 5:00	-1650	-1650	0.458	1.275	0.115	0.105	3.40E+00	1.72E+02	1.10E+00	1.11E+00	
2011/5/10 8:00	-1650	-1650	0.463	1.280	0.120	0.105	3.76E+00	3.16E+01	1.10E+00	1.11E+00	
2011/5/10 11:00		-1650	0.463	1.273	0.120	0.105	3.44E+00	1.50E+02	1.10E+00	1.11E+00	
2011/5/10 14:00		-1650	0.463	1.273	0.120	0.105	3.69E+00	6.22E+01	1.10E+00	1.11E+00	
2011/5/10 17:00		-1650	0.463	1.273	0.120	0.105	3.71E+00	1.70E+02	1.10E+00	1.11E+00	
2011/5/10 20:00		-1650	0.463	1.278	0.120	0.105	3.28E+00	1.76E+02	1.10E+00	1.11E+00	
2011/5/10 23:00		-1650	0.470	1.283	0.120	0.105	3.25E+00	3.10E+01	1.10E+00	1.10E+00	
2011/5/11 2:00		-1700	0.465	1.285	0.120	0.105	3.20E+00	1.81E+02	1.10E+00	1.10E+00	
2011/5/11 5:00		-1700	0.463	1.280	0.120	0.105	3.61E+00	1.81E+02	1.09E+00	1.10E+00	
2011/5/11 8:00		-1700	0.465	1.288	0.120	0.105	3.56E+00	1.88E+02	1.09E+00	1.10E+00	
2011/5/11 11:00		-1500	0.460	1.278	0.110	0.100	3.35E+00	1.95E+02	1.09E+00	1.10E+00	
2011/5/11 14:00		-1450	0.458	1.278	0.115	0.100	3.33E+00	3.00E+01	1.09E+00	1.10E+00	
2011/5/11 17:00		-1550	0.460	1.283	0.1153	0.100	3.88E+00	2.01E+02	1.09E+00	1.10E+00	
2011/5/11 20:00		-1650	0.458	1.285	0.1164	0.100	3.48E+00	3.69E+01	1.09E+00	1.10E+00	
2011/5/11 23:00		-1650	0.460	1.290	0.1172	0.100	3.65E+00	2.04E+02	1.09E+00	1.09E+00	
2011/5/12 5:00		-1650	0.463	1.293	0.1185	0.100	3.65E+00	2.63E+01	1.09E+00	1.09E+00	
2011/5/12 8:00		-1700	0.460	1.293	0.1188	0.100	3.82E+00	2.07E+02	1.09E+00	1.09E+00	
2011/5/12 11:00		-1700	0.465	1.300	0.1192	0.100	3.59E+00	3.75E+01	1.09E+00	1.09E+00	
2011/5/12 14:00		-1700	0.465	1.310	0.1196	0.100	3.83E+00	2.12E+02	1.08E+00	1.09E+00	
2011/5/12 17:00		-1700	0.470	1.305	0.1199	0.100	4.13E+00	1.97E+02	1.08E+00	1.09E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/5/12 20:00		-1700	0.475	1.303	0.1199	0.100	4.06E+00	2.08E+02	1.08E+00	1.09E+00	
2011/5/12 23:00		-1650	0.480	1.303	0.1191	0.100	3.87E+00	3.50E+01	1.08E+00	1.09E+00	
2011/5/13 2:00		-1700	0.480	1.295	0.1187	0.100	3.88E+00	2.08E+02	1.08E+00	1.08E+00	
2011/5/13 5:00		-1700	0.485	1.295	0.1185	0.100	3.50E+00	2.04E+02	1.07E+00	1.08E+00	
2011/5/13 8:00		-1700	0.480	1.293	0.1184	0.100	3.77E+00	2.15E+02	1.07E+00	1.08E+00	
2011/5/13 11:00		-1700	0.478	1.298	0.1185	0.100	3.78E+00	2.19E+02	1.07E+00	1.08E+00	
2011/5/13 14:00		-1700	0.483	1.295	0.1187	0.100	3.59E+00	2.23E+02	1.07E+00	1.08E+00	
2011/5/13 17:00		-1700	0.480	1.298	0.1188	0.100	4.15E+00	3.23E+01	1.07E+00	1.08E+00	
2011/5/13 20:00		-1700	0.483	1.313	0.1188	0.100	3.57E+00	2.26E+02	1.07E+00	1.08E+00	
2011/5/13 23:00		-1700	0.480	1.318	0.1187	0.100	3.50E+00	2.15E+02	1.07E+00	1.08E+00	
2011/5/14 2:00		-1700	0.478	1.313	0.1189	0.100	3.63E+00	2.22E+02	1.07E+00	1.07E+00	
2011/5/14 5:00		-1700	0.480	1.310	0.1189	0.100	3.54E+00	2.28E+02	1.06E+00	1.07E+00	
2011/5/14 8:00		-1700	0.483	1.308	0.1189	0.100	3.82E+00	2.20E+02	1.06E+00	1.07E+00	
2011/5/14 11:00		-1700	0.483	1.305	0.1192	0.100	3.67E+00	2.57E+02	1.06E+00	1.07E+00	
2011/5/14 14:00		-1700	0.480	1.300	0.1199	0.100	3.00E+00	2.54E+02	1.06E+00	1.07E+00	
2011/5/14 17:00		-1700	0.478	1.300	0.1192	0.100	3.90E+00	2.53E+02	1.06E+00	1.07E+00	
2011/5/14 20:00		-1700	0.478	1.295	0.1194	0.100	3.72E+00	2.51E+02	1.06E+00	1.07E+00	
2011/5/14 23:00		-1700	0.488	1.313	0.1196	0.100	3.63E+00	2.51E+02	1.06E+00	1.06E+00	
2011/5/15 2:00		-1700	0.490	1.323	0.1198	0.100	3.73E+00	3.07E+01	1.06E+00	1.06E+00	
2011/5/15 5:00		-1700	0.488	1.330	0.1198	0.100	3.62E+00	5.27E+01	1.06E+00	1.06E+00	
2011/5/15 8:00		-1700	0.488	1.335	0.1199	0.100	3.76E+00	4.90E+01	1.06E+00	1.06E+00	
2011/5/15 11:00		-1700	0.485	1.335	0.1201	0.100	3.80E+00	3.28E+01	1.05E+00	1.06E+00	
2011/5/15 14:00		-1700	0.485	1.330	0.1200	0.100	3.99E+00	2.29E+02	1.05E+00	1.06E+00	
2011/5/15 17:00		-1650	0.485	1.323	0.1183	0.100	3.88E+00	2.29E+02	1.05E+00	1.06E+00	
2011/5/15 20:00		-1700	0.483	1.330	0.1171	0.100	4.06E+00	5.30E+01	1.05E+00	1.05E+00	
2011/5/15 23:00		-1700	0.483	1.333	0.1166	0.100	3.85E+00	4.40E+01	1.05E+00	1.05E+00	
2011/5/16 2:00		-1700	0.480	1.343	0.1161	0.100	4.46E+00	4.45E+01	1.05E+00	1.05E+00	
2011/5/16 5:00		-1700	0.485	1.350	0.1158	0.100	3.63E+00	4.52E+01	1.05E+00	1.05E+00	
2011/5/16 8:00		-1750	0.488	1.360	0.1155	0.100	3.91E+00	3.13E+01	1.05E+00	1.05E+00	
2011/5/16 11:00		-1750	0.485	1.350	0.1155	0.100	3.99E+00	3.11E+01	1.04E+00	1.05E+00	
2011/5/16 14:00		-1750	0.485	1.335	0.1157	0.100	4.10E+00	3.65E+01	1.04E+00	1.05E+00	
2011/5/16 17:00		-1750	0.490	1.338	0.1161	0.100	3.84E+00	3.19E+01	1.04E+00	1.05E+00	
2011/5/16 20:00		-1750	0.490	1.345	0.1169	0.100	3.88E+00	3.26E+01	1.04E+00	1.05E+00	
2011/5/16 23:00		-1750	0.493	1.343	0.1176	0.100	3.66E+00	3.73E+01	1.04E+00	1.05E+00	
2011/5/17 2:00		-1750	0.495	1.345	0.1183	0.100	2.14E+00	3.76E+01	1.04E+00	1.05E+00	
2011/5/17 5:00		-1750	0.495	1.358	0.1183	0.100	1.61E+00	3.23E+01	1.04E+00	1.04E+00	
2011/5/17 8:00		-1750	0.498	1.355	0.1179	0.100	1.51E+00	2.88E+01	1.04E+00	1.04E+00	
2011/5/17 11:00		-1750	0.500	1.355	0.1176	0.100	1.05E+00	2.18E+02	1.04E+00	1.04E+00	
2011/5/17 12:05		-1700	0.503	1.355	0.1179	0.100					Data not collected - CAMS D/W(A) and (B), S/C(A) and (B)
2011/5/17 12:20		-1700	0.503	1.353	0.1180	0.100					Data not collected - CAMS D/W(A) and (B), S/C(A) and (B)
2011/5/17 14:00		-1700	0.505	1.358	0.1192	0.105	1.21E+00	3.32E+01	1.04E+00	1.04E+00	
2011/5/17 17:00		-1700	0.505	1.353	0.1214	0.105	1.30E+00	2.93E+01	1.04E+00	1.04E+00	
2011/5/17 20:00		-1700	0.503	1.360	0.1228	0.105	1.21E+00	3.19E+01	1.04E+00	1.04E+00	
2011/5/17 23:00		-1700	0.510	1.368	0.1240	0.105	1.08E+00	3.65E+01	1.04E+00	1.04E+00	
2011/5/18 2:00		-1750	0.513	1.383	0.1252	0.105	1.06E+00	2.81E+01	1.04E+00	1.04E+00	
2011/5/18 5:00		-1750	0.520	1.398	0.1263	0.100	9.87E-01	2.54E+01	1.04E+00	1.04E+00	
2011/5/18 8:00		-1750	0.520	1.400	0.1275	0.100	1.15E+00	3.12E+01	1.04E+00	1.04E+00	
2011/5/18 11:00		-1750	0.523	1.395	0.1287	0.100	1.31E+00	4.54E+01	1.04E+00	1.03E+00	
2011/5/18 14:00		-1750	0.523	1.393	0.1299	0.100	1.29E+00	2.85E+01	1.04E+00	1.03E+00	
2011/5/18 17:00		-1750	0.525	1.405	0.1316	0.105	1.19E+00	3.08E+01	1.04E+00	1.03E+00	
2011/5/18 20:00		-1750	0.528	1.405	0.1333	0.105	1.23E+00	3.70E+01	1.04E+00	1.03E+00	
2011/5/18 23:00		-1700	0.530	1.413	0.1343	0.105	7.87E-01	3.83E+01	1.04E+00	1.03E+00	
2011/5/19 2:00		-1750	0.528	1.413	0.1352	0.105	1.08E+00	3.78E+01	1.04E+00	1.03E+00	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/5/19 5:00		-1750	0.535	1.420	0.1360	0.105	9.69E-01	3.63E+01	1.04E+00	1.03E+00	
2011/5/19 8:00		-1700	0.523	1.415	0.1367	0.105	8.81E-01	3.36E+01	1.03E+00	1.03E+00	
2011/5/19 11:00		-1650	0.528	1.408	0.1372	0.105	6.25E-01	3.42E+01	1.03E+00	1.03E+00	
2011/5/19 14:00		-1500	0.520	1.400	0.1357	0.105	6.70E-01	5.54E+01	1.03E+00	1.04E+00	
2011/5/19 17:00		-1650	0.525	1.408	0.1341	0.105	9.84E-01	4.00E+01	1.03E+00	1.04E+00	
2011/5/19 20:00		-1500	0.523	1.408	0.1331	0.105	8.15E-01	5.50E+01	1.03E+00	1.04E+00	
2011/5/19 23:00		-1550	0.518	1.405	0.1323	0.100	6.70E-01	3.90E+01	1.03E+00	1.03E+00	
2011/5/20 2:00		-1600	0.525	1.418	0.1315	0.100	7.70E-01	4.67E+01	1.02E+00	1.03E+00	
2011/5/20 5:00		-1550	0.525	1.420	0.1311	0.100	4.34E-01	3.35E+01	1.02E+00	1.03E+00	
2011/5/20 8:00		-1600	0.518	1.410	0.1306	0.100	4.50E-01	3.38E+01	1.02E+00	1.03E+00	
2011/5/20 11:00		-1600	0.525	1.418	0.1302	0.100	7.84E-01	4.65E+01	1.02E+00	1.03E+00	
2011/5/20 14:00		-1600	0.525	1.415	0.1300	0.100	1.11E+00	3.75E+01	1.02E+00	1.03E+00	
2011/5/20 17:00		-1500	0.525	1.413	0.1298	0.100	4.55E-01	4.28E+01	1.01E+00	1.03E+00	
2011/5/20 20:00		-1500	0.530	1.413	0.1297	0.100	3.65E-01	3.21E+01	1.01E+00	1.03E+00	
2011/5/20 23:00		-1500	0.535	1.418	0.1297	0.100	5.45E-01	3.80E+01	1.01E+00	1.02E+00	
2011/5/21 2:00		-1600	0.528	1.423	0.1297	0.100	5.74E-01	3.71E+01	1.01E+00	1.02E+00	
2011/5/21 5:00		-1550	0.530	1.418	0.1296	0.100	6.27E-01	3.62E+01	1.01E+00	1.02E+00	
2011/5/21 8:00		-1600	0.528	1.428	0.1297	0.100	5.31E-01	3.65E+01	1.01E+00	1.02E+00	
2011/5/21 11:00		-1550	0.528	1.423	0.1298	0.100	2.35E-01	3.36E+01	1.01E+00	1.02E+00	
2011/5/21 14:00		-1600	0.528	1.420	0.1297	0.100	3.42E-01	3.65E+01	1.00E+00	1.02E+00	
2011/5/21 17:00		-1600	0.528	1.413	0.1284	0.100	2.54E-01	4.51E+01	1.00E+00	1.02E+00	
2011/5/21 20:00		-1600	0.530	1.418	0.1287	0.100	3.77E-01	5.18E+01	9.99E-01	1.02E+00	
2011/5/21 23:00		-1550	0.533	1.428	0.1290	0.100	4.50E-01	3.89E+01	9.98E-01	1.02E+00	
2011/5/22 2:00		-1600	0.530	1.430	0.1294	0.100	4.17E-01	4.40E+01	9.97E-01	1.02E+00	
2011/5/22 5:00		-1600	0.533	1.435	0.1296	0.100	4.56E-01	3.36E+01	9.95E-01	1.01E+00	
2011/5/22 8:00		-1600	0.533	1.435	0.1298	0.100	5.50E-01	2.00E+02	9.94E-01	1.01E+00	
2011/5/22 11:00		-1600	0.530	1.435	0.1299	0.100	5.18E-01	1.96E+02	9.92E-01	1.01E+00	
2011/5/22 14:00		-1600	0.533	1.445	0.1304	0.100	4.80E-01	1.91E+02	9.91E-01	1.01E+00	
2011/5/22 17:00		-1600	0.530	1.448	0.1300	0.100	7.75E-01	3.56E+01	9.90E-01	1.01E+00	
2011/5/22 20:00		-1600	0.540	1.463	0.1300	0.100	9.74E-01	3.04E+01	9.89E-01	1.01E+00	
2011/5/22 23:00		-1600	0.535	1.465	0.1300	0.100	5.97E-01	1.92E+02	9.88E-01	1.01E+00	
2011/5/23 2:00		-1600	0.545	1.473	0.1305	0.100	5.78E-01	3.59E+01	9.87E-01	1.01E+00	
2011/5/23 5:00		-1600	0.545	1.473	0.1309	0.100	4.25E-01	3.31E+01	9.85E-01	1.01E+00	
2011/5/23 8:00		-1600	0.543	1.475	0.1311	0.100	3.46E-01	1.89E+02	9.84E-01	1.00E+00	
2011/5/23 11:00		-1600	0.545	1.468	0.1314	0.100	4.14E-01	2.01E+02	9.82E-01	1.00E+00	
2011/5/23 14:00		-1600	0.550	1.470	0.1315	0.100	5.14E-01	3.60E+01	9.81E-01	1.00E+00	
2011/5/23 17:00		-1600	0.545	1.473	0.1315	0.100	5.76E-01	1.97E+02	9.80E-01	1.00E+00	
2011/5/23 20:00		-1600	0.545	1.478	0.1314	0.100	4.95E-01	1.85E+02	9.78E-01	1.00E+00	
2011/5/23 23:00		-1600	0.545	1.465	0.1314	0.100	4.90E-01	1.87E+02	9.77E-01	1.00E+00	
2011/5/24 2:00		-1600	0.548	1.473	0.1314	0.100	5.88E-01	4.99E+01	9.76E-01	9.99E-01	
2011/5/24 5:00		-1600	0.545	1.475	0.1314	0.100	6.33E-01	3.05E+01	9.74E-01	9.97E-01	
2011/5/24 8:00		-1600	0.545	1.485	0.1315	0.100	6.66E-01	1.94E+02	9.73E-01	9.96E-01	
2011/5/24 11:00		-1600	0.553	1.483	0.1315	0.100	3.85E-01	1.92E+02	9.72E-01	9.95E-01	
2011/5/24 14:00		-1600	0.548	1.478	0.1315	0.100	5.65E-01	3.10E+01	9.70E-01	9.93E-01	
2011/5/24 17:00		-1550	0.545	1.473	0.1316	0.100	5.81E-01	1.91E+02	9.69E-01	9.92E-01	
2011/5/24 20:00		-1650	0.548	1.480	0.1316	0.100	6.90E-01	1.85E+02	9.68E-01	9.91E-01	
2011/5/24 23:00		-1650	0.545	1.485	0.1316	0.100	3.15E-01	2.05E+02	9.66E-01	9.89E-01	
2011/5/25 2:00		-1650	0.545	1.495	0.1316	0.100	4.42E-01	2.05E+02	9.65E-01	9.88E-01	
2011/5/25 5:00		-1650	0.545	1.493	0.1316	0.100	4.52E-01	2.04E+02	9.63E-01	9.87E-01	
2011/5/25 9:00		-1650	0.553	1.498	0.1315	0.100	3.00E-01	2.15E+02	9.61E-01	9.85E-01	
2011/5/25 15:00		-1650	0.545	1.478	0.1303	0.100	7.07E-01	2.93E+01	8.85E-01	8.96E-01	
2011/5/25 17:00		-1600	0.543	1.483	0.1299	0.060	6.85E-01	4.95E+01	9.01E-01	9.12E-01	
2011/5/25 20:00		-1650	0.540	1.485	0.1286	0.040	5.53E-01	2.47E+02	9.16E-01	9.34E-01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/5/25 23:00		-1600	0.540	1.493	0.1293	0.035	5.17E-01	6.51E+01	9.24E-01	9.43E-01	
2011/5/26 2:00		-1650	0.548	1.495	0.1296	0.035	4.37E-01	2.86E+01	9.29E-01	9.50E-01	
2011/5/26 5:00		-1650	0.550	1.498	0.1300	0.035	5.27E-01	3.93E+01	9.32E-01	9.54E-01	
2011/5/26 8:00		-1650	0.545	1.498	0.1301	0.035	4.31E-01	4.47E+01	9.34E-01	9.56E-01	
2011/5/26 11:00		-1600	0.550	1.500	0.1304	0.100	9.46E-01	4.37E+01	9.35E-01	9.58E-01	Pressure meter in S/C was checked.
2011/5/26 14:00		-1650	0.550	1.500	0.1305	0.100	5.75E-01	4.23E+01	9.35E-01	9.59E-01	
2011/5/26 17:00		-1650	0.553	1.503	0.1308	0.100	9.31E-01	4.23E+01	9.36E-01	9.59E-01	
2011/5/26 20:00		-1650	0.550	1.505	0.1308	0.100	8.20E-01	5.82E+01	9.36E-01	9.60E-01	
2011/5/26 23:00		-1650	0.553	1.503	0.1308	0.100	8.54E-01	5.73E+01	9.35E-01	9.60E-01	
2011/5/27 2:00		-1650	0.550	1.505	0.1310	0.100	1.08E+00	5.92E+01	9.35E-01	9.59E-01	
2011/5/27 5:00		-1650	0.548	1.513	0.1309	0.100	5.52E-01	5.35E+01	9.35E-01	9.59E-01	
2011/5/27 8:00		-1650	0.550	1.510	0.1310	0.100	6.35E-01	5.32E+01	9.34E-01	9.58E-01	
2011/5/27 11:00		-1650	0.545	1.510	0.1310	0.105	6.39E-01	6.38E+01	9.33E-01	9.57E-01	
2011/5/27 14:00		-1550	0.555	1.503	0.1311	0.100	5.52E-01	7.10E+01	9.32E-01	9.56E-01	
2011/5/27 17:00		-1600	0.553	1.510	0.1309	0.100	9.03E-01	1.27E+02	9.31E-01	9.55E-01	
2011/5/27 20:00		-1600	0.550	1.510	0.1308	0.100	1.10E+00	8.00E+01	9.31E-01	9.55E-01	
2011/5/27 23:00		-1650	0.555	1.508	0.1307	0.100	1.19E+00	2.33E+02	9.30E-01	9.54E-01	
2011/5/28 2:00		-1650	0.553	1.505	0.1308	0.100	1.02E+00	2.95E+01	9.29E-01	9.54E-01	
2011/5/28 5:00		-1650	0.553	1.508	0.1307	0.100	9.75E-01	2.15E+02	9.28E-01	9.52E-01	
2011/5/28 8:00		-1600	0.550	1.500	0.1307	0.100	9.44E-01	2.29E+02	9.27E-01	9.51E-01	
2011/5/28 11:00		-1600	0.555	1.508	0.1307	0.100	6.59E-01	3.01E+01	9.26E-01	9.50E-01	
2011/5/28 14:00		-1600	0.553	1.505	0.1307	0.105	4.80E-01	4.30E+01	9.25E-01	9.49E-01	
2011/5/28 17:00		-1600	0.550	1.515	0.1308	0.105	6.15E-01	6.55E+01	9.24E-01	9.47E-01	
2011/5/28 20:00		-1600	0.558	1.515	0.1304	0.105	7.35E-01	1.81E+02	9.23E-01	9.47E-01	
2011/5/28 23:00		-1650	0.555	1.513	0.1304	0.100	6.70E-01	2.25E+02	9.22E-01	9.46E-01	
2011/5/29 2:00		-1600	0.555	1.510	0.1302	0.105	6.15E-01	2.65E+01	9.21E-01	9.45E-01	
2011/5/29 5:00		-1600	0.550	1.515	0.1299	0.105	4.84E-01	2.25E+02	9.20E-01	9.44E-01	
2011/5/29 8:00		-1600	0.553	1.513	0.1299	0.105	4.77E-01	2.34E+02	9.19E-01	9.42E-01	
2011/5/29 11:00		-1600	0.555	1.508	0.1298	0.100	2.75E-01	2.68E+01	9.17E-01	9.41E-01	
2011/5/29 14:00		-1600	0.558	1.505	0.1293	0.105	6.80E-01	2.30E+02	9.17E-01	9.40E-01	
2011/5/29 17:00		-1550	0.553	1.505	0.1290	0.105	4.62E-01	2.27E+02	9.15E-01	9.39E-01	
2011/5/29 20:00		-1600	0.555	1.513	0.1290	0.100	5.81E-01	2.83E+01	9.14E-01	9.37E-01	
2011/5/29 23:00		-1600	0.555	1.513	0.1285	0.105	5.99E-01	2.34E+02	9.13E-01	9.36E-01	
2011/5/30 2:00		-1600	0.563	1.520	0.1276	0.105	4.31E-01	2.36E+02	9.12E-01	9.37E-01	
2011/5/30 5:00		-1600	0.565	1.523	0.1271	0.100	6.45E-01	4.18E+01	9.11E-01	9.36E-01	
2011/5/30 8:00		-1600	0.568	1.523	0.1262	0.105	5.63E-01	4.26E+01	9.10E-01	9.35E-01	
2011/5/30 11:00		-1600	0.563	1.518	0.1259	0.100	5.48E-01	3.61E+01	9.09E-01	9.33E-01	
2011/5/30 14:00		-1600	0.568	1.520	0.1255	0.100	6.32E-01	3.20E+01	9.07E-01	9.32E-01	
2011/5/30 17:00		-1600	0.565	1.523	0.1250	0.100	8.84E-01	3.18E+01	9.06E-01	9.31E-01	
2011/5/30 20:00		-1650	0.568	1.528	0.1246	0.100	1.16E+00	2.63E+01	9.05E-01	9.31E-01	
2011/5/30 23:00		-1650	0.560	1.528	0.1246	0.100	8.78E-01	2.83E+01	9.04E-01	9.30E-01	
2011/5/31 2:00		-1700	0.570	1.533	0.1246	0.100	1.03E+00	3.94E+01	9.03E-01	9.29E-01	
2011/5/31 5:00		-1700	0.565	1.525	0.1248	0.105	6.30E-01	2.40E+01	9.02E-01	9.28E-01	
2011/5/31 8:00		-1700	0.565	1.538	0.1249	0.100	7.27E-01	5.20E+01	9.01E-01	9.27E-01	
2011/5/31 11:00		-1700	0.565	1.548	0.1249	0.100	6.30E-01	5.90E+01	9.00E-01	9.26E-01	
2011/5/31 14:00		-1700	0.570	1.545	0.1250	0.100	6.33E-01	5.11E+01	8.98E-01	9.25E-01	
2011/5/31 17:00		-1700	0.568	1.545	0.1252	0.100	5.41E-01	6.08E+01	8.97E-01	9.25E-01	
2011/5/31 20:00		-1700	0.573	1.543	0.1254	0.100	6.04E-01	1.90E+02	8.96E-01	9.24E-01	
2011/5/31 23:00		-1750	0.573	1.558	0.1255	0.100	5.99E-01	3.82E+01	8.94E-01	9.23E-01	
2011/6/1 2:00		-1750	0.580	1.565	0.1254	0.100	9.00E-01	3.28E+01	8.93E-01	9.21E-01	
2011/6/1 5:00		-1750	0.578	1.568	0.1254	0.100	6.94E-01	1.85E+02	8.92E-01	9.19E-01	
2011/6/1 8:00		-1750	0.578	1.570	0.1255	0.100	7.63E-01	2.64E+01	8.92E-01	9.18E-01	
2011/6/1 11:00		-1650	0.573	1.568	0.1257	0.105	9.76E-01	3.01E+01	8.91E-01	9.17E-01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/6/1 14:00		-1650	0.575	1.563	0.1258	0.105	9.20E-01	2.76E+01	8.89E-01	9.15E-01	
2011/6/1 17:00		-1650	0.578	1.565	0.1259	0.105	8.49E-01	2.09E+02	8.88E-01	9.14E-01	
2011/6/1 20:00		-1600	0.578	1.575	0.1259	0.105	8.02E-01	1.97E+02	8.87E-01	9.13E-01	
2011/6/1 23:00		-1600	0.578	1.573	0.1259	0.105	8.40E-01	1.91E+02	8.86E-01	9.12E-01	
2011/6/2 2:00		-1600	0.580	1.575	0.1261	0.105	8.13E-01	6.94E+01	8.85E-01	9.11E-01	
2011/6/2 5:00		-1600	0.580	1.585	0.1262	0.105	7.34E-01	2.09E+02	8.84E-01	9.09E-01	
2011/6/2 8:00		-1600	0.583	1.583	0.1262	0.105	6.48E-01	4.65E+01	8.83E-01	9.08E-01	
2011/6/2 11:00		-1600	0.578	1.575	0.1265	0.105	6.14E-01	3.47E+01	8.82E-01	9.06E-01	
2011/6/2 14:00		-1600	0.580	1.558	0.1266	0.105	5.52E-01	2.40E+02	8.81E-01	9.06E-01	
2011/6/2 17:00		-1600	0.575	1.563	0.1263	0.105	5.50E-01	2.13E+02	8.80E-01	9.04E-01	
2011/6/2 20:00		-1600	0.573	1.563	0.1265	0.105	5.85E-01	2.09E+02	8.79E-01	9.03E-01	
2011/6/2 23:00		-1600	0.575	1.568	0.1265	0.105	5.65E-01	3.34E+01	8.78E-01	9.02E-01	
2011/6/3 2:00		-1600	0.575	1.563	0.1267	0.105	5.61E-01	2.29E+02	8.77E-01	9.00E-01	
2011/6/3 5:00		-1600	0.578	1.573	0.1269	0.105	4.41E-01	2.22E+02	8.76E-01	8.98E-01	
2011/6/3 8:00		-1600	0.580	1.575	0.1270	0.105	4.27E-01	3.34E+01	8.75E-01	8.97E-01	
2011/6/3 11:00		-1600	0.578	1.568	0.1270	0.105	6.00E-01	2.13E+02	8.74E-01	8.96E-01	
2011/6/3 13:30		-1550	0.580	1.575	0.1271	0.105	5.05E-01	4.30E+01	8.73E-01	8.95E-01	
2011/6/3 17:00		-1600	0.575	1.563	0.1274	0.105	7.02E-01	2.29E+02	8.72E-01	8.94E-01	
2011/6/3 20:00		-1600	0.583	1.568	0.1274	0.105	8.52E-01	2.24E+02	8.71E-01	8.92E-01	
2011/6/3 23:00		-1600	0.583	1.568	0.1275	0.105	9.44E-01	4.47E+01	8.70E-01	8.91E-01	
2011/6/4 2:00		-1600	0.593	1.573	0.1276	0.105	5.10E-01	2.54E+02	8.69E-01	8.90E-01	
2011/6/4 5:00		-1600	0.590	1.580	0.1276	0.105	4.10E-01	2.50E+02	8.68E-01	8.89E-01	
2011/6/4 8:00		-1550	0.590	1.575	0.1277	0.105	4.85E-01	2.44E+02	8.67E-01	8.87E-01	
2011/6/4 11:00		-1700	0.025	-	0.1278	0.105	4.07E-01	5.48E+01	8.65E-01	8.86E-01	
2011/6/4 14:00		-1650	0.025	-	0.1277	0.110	7.02E-01	2.33E+02	8.64E-01	8.85E-01	
2011/6/4 17:00		-1600	0.025	-	0.1276	0.110	6.00E-01	2.42E+02	8.63E-01	8.84E-01	
2011/6/4 20:00		-1600	0.025	-	0.1276	0.110	3.20E-01	6.45E+01	8.62E-01	8.84E-01	
2011/6/4 23:00		-1550	0.025	-	0.1277	0.110	4.21E-01	9.17E+01	8.61E-01	8.82E-01	
2011/6/5 2:00		-1600	0.025	-	0.1279	0.110	3.98E-01	8.72E+01	8.60E-01	8.82E-01	
2011/6/5 5:00		-1550	0.025	-	0.1280	0.110	3.67E-01	5.86E+01	8.59E-01	8.81E-01	
2011/6/5 8:00		-1600	0.025	-	0.1280	0.110	3.66E-01	7.08E+01	8.58E-01	8.80E-01	
2011/6/5 11:00		-1600	0.025	-	0.1282	0.110	3.18E-01	2.70E+01	8.58E-01	8.79E-01	
2011/6/5 14:00		-1550	0.025	-	0.1286	0.110	7.19E-01	3.16E+01	8.57E-01	8.78E-01	
2011/6/5 17:00		-1550	0.025	-	0.1288	0.110	7.65E-01	3.04E+01	8.56E-01	8.77E-01	
2011/6/5 20:00		-1550	0.025	-	0.1290	0.110	7.75E-01	3.51E+01	8.55E-01	8.76E-01	
2011/6/5 23:00		-1550	0.025	-	0.1289	0.110	4.73E-01	2.63E+01	8.54E-01	8.75E-01	
2011/6/6 2:00		-1550	0.025	-	0.1290	0.110	9.13E-01	3.66E+01	8.54E-01	8.74E-01	
2011/6/6 5:00		-1550	0.027	-	0.1290	0.110	8.98E-01	3.55E+01	8.53E-01	8.73E-01	
2011/6/6 8:00		-1550	0.026	-	0.1291	0.110	1.03E+00	2.53E+02	8.52E-01	8.72E-01	
2011/6/6 11:00		-1550	0.026	-	0.1294	0.110	9.38E-01	3.55E+01	8.51E-01	8.71E-01	
2011/6/6 14:00		-1550	0.026	-	0.1298	0.110	1.08E+00	2.79E+01	8.50E-01	8.70E-01	
2011/6/6 17:00		-1550	0.026	-	0.1298	0.110	8.64E-01	3.09E+01	8.49E-01	8.69E-01	
2011/6/6 20:00		-1600	0.026	-	0.1299	0.110	9.08E-01	2.63E+01	8.49E-01	8.69E-01	
2011/6/6 23:00		-1650	0.026	-	0.1298	0.110	1.22E+00	2.99E+01	8.48E-01	8.68E-01	
2011/6/7 2:00		-1600	0.026	-	0.1299	0.110	1.16E+00	3.91E+01	8.47E-01	8.68E-01	
2011/6/7 5:00		-1650	0.026	-	0.1299	0.110	1.09E+00	2.47E+02	8.46E-01	8.67E-01	
2011/6/7 8:00		-1650	0.026	-	0.1300	0.110	1.01E+00	2.87E+01	8.45E-01	8.66E-01	
2011/6/7 11:00		-1550	0.026	-	0.1302	0.115	1.05E+00	2.54E+02	8.44E-01	8.65E-01	
2011/6/7 14:00		-1550	0.026	-	0.1305	0.115	1.06E+00	2.80E+01	8.44E-01	8.65E-01	
2011/6/7 17:00		-1550	0.026	-	0.1309	0.115	9.42E-01	2.72E+02	8.43E-01	8.63E-01	
2011/6/7 20:00		-1600	0.028	-	0.1311	0.115	1.01E+00	3.40E+01	8.42E-01	8.60E-01	
2011/6/7 23:00		-1600	0.028	-	0.1311	0.115	1.10E+00	2.80E+02	8.41E-01	8.60E-01	
2011/6/8 2:00		-1600	0.028	-	0.1310	0.115	1.01E+00	3.53E+01	8.41E-01	8.59E-01	

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	note
2011/6/8 5:00		-1650	0.028	-	0.1309	0.115	1.38E+00	5.12E+01	8.39E-01	8.57E-01	
2011/6/8 8:00		-1650	0.028	-	0.1307	0.115	1.47E+00	3.94E+01	8.38E-01	8.56E-01	
2011/6/8 11:00		-1650	0.028	-	0.1307	0.115	1.06E+00	4.55E+01	8.38E-01	8.57E-01	
2011/6/8 14:00		-1600		-	0.1308	0.115	1.09E+00	3.40E+01	8.37E-01	8.56E-01	Data not collected - A system/ reactor pressure
2011/6/8 18:00		-1600	0.027	-	0.1288	0.070	1.05E+00	4.24E+01	0.00E+00	7.93E-01	Instruments are under investigation (S/C pressure, CAMS S/C(A))
2011/6/8 20:00		-1600	0.027	-	0.1295	0.110	0.00E+00	5.17E+01	8.04E-01	8.13E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/8 23:00		-1650	0.027	-	0.1297	0.115	0.00E+00	5.80E+01	8.12E-01	8.25E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 2:00		-1700	0.027	-	0.1298	0.110	0.00E+00	6.45E+01	8.16E-01	8.32E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 5:00		-1700	0.027	-	0.1298	0.115	0.00E+00	3.21E+01	8.18E-01	8.36E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 8:00		-1750	0.027	-	0.1297	0.115	0.00E+00	2.26E+02	8.20E-01	8.37E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 11:00		-1750	0.027	-	0.1300	0.115	0.00E+00	2.24E+02	8.21E-01	8.39E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 14:00		-1750	0.027	-	0.1303	0.115	0.00E+00	3.10E+01	8.22E-01	8.41E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 17:00		-1700	0.027	-	0.1304	0.115	0.00E+00	2.95E+01	8.23E-01	8.41E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 20:00		-1700	0.027	-	0.1304	0.115	0.00E+00	3.82E+01	8.23E-01	8.41E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/9 23:00		-1750	0.027	-	0.1303	0.115	0.00E+00	2.39E+02	8.23E-01	8.42E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/10 2:00		-1750	0.027	-	0.1303	0.115	0.00E+00	3.00E+01	8.23E-01	8.42E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/10 5:00		-1750	0.027	-	0.1303	0.115	0.00E+00	2.25E+02	8.22E-01	8.43E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/10 8:00		-1750	0.027	-	0.1302	0.115	0.00E+00	2.77E+02	8.22E-01	8.42E-01	Instruments are under investigation (S/C pressure, CAMS D/W(A)·S/C(A))
2011/6/10 11:00		-1750	0.027	-	0.1303	0.115	0.00E+00	5.10E+01	8.20E-01	8.42E-01	
2011/6/10 14:00		-1750	0.027	-	0.1304	0.115	0.00E+00	2.78E+02	8.22E-01	8.42E-01	
2011/6/10 17:00		-1750	0.027	-	0.1306	0.115	0.00E+00	2.38E+02	8.22E-01	8.42E-01	
2011/6/10 20:00		-1650	0.027	-	0.1306	0.115	0.00E+00	5.10E+01	8.21E-01	8.42E-01	
2011/6/10 23:00		-1650	0.027	-	0.1307	0.115	0.00E+00	2.80E+01	8.21E-01	8.42E-01	
2011/6/11 2:00		-1650	0.027	-	0.1307	0.115	0.00E+00	2.46E+02	8.21E-01	8.41E-01	
2011/6/11 5:00		-1700	0.027	-	0.1306	0.115	0.00E+00	9.11E+01	8.20E-01	8.41E-01	
2011/6/11 8:00		-1700	0.027	-	0.1305	0.115	0.00E+00	6.50E+01	8.19E-01	8.40E-01	
2011/6/11 11:00		-1700	0.027	-	0.1305	0.115	0.00E+00	3.14E+01	8.19E-01	8.40E-01	
2011/6/11 14:00		-1700	0.027	-	0.1304	0.115	0.00E+00	9.17E+01	8.19E-01	8.40E-01	
2011/6/11 17:00		-1700	0.027	-	0.1307	0.115	0.00E+00	3.46E+01	8.18E-01	8.39E-01	
2011/6/11 20:00		-1700	0.027	-	0.1307	0.115	0.00E+00	7.30E+01	8.18E-01	8.39E-01	
2011/6/11 23:00		-1700	0.027	-	0.1307	0.115	0.00E+00	6.10E+01	8.17E-01	8.38E-01	
2011/6/12 2:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.60E+02	8.17E-01	8.39E-01	
2011/6/12 5:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.51E+02	8.17E-01	8.37E-01	
2011/6/12 8:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.56E+02	8.16E-01	8.37E-01	
2011/6/12 11:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.61E+02	8.16E-01	8.38E-01	
2011/6/12 14:00		-1650	0.027	-	0.1309	0.115	0.00E+00	2.98E+01	8.16E-01	8.38E-01	
2011/6/12 17:00		-1700	0.027	-	0.1311	0.115	0.00E+00	2.71E+01	8.15E-01	8.36E-01	
2011/6/12 20:00		-1700	0.027	-	0.1310	0.115	0.00E+00	2.43E+02	8.15E-01	8.35E-01	
2011/6/12 23:00		-1700	0.027	-	0.1310	0.115	0.00E+00	2.94E+01	8.14E-01	8.34E-01	
2011/6/13 2:00		-1700	0.027	-	0.1308	0.115	0.00E+00	3.30E+01	8.14E-01	8.36E-01	
2011/6/13 5:00		-1700	0.027	-	0.1307	0.115	0.00E+00	1.02E+02	8.13E-01	8.35E-01	
2011/6/13 8:00		-1750	0.027	-	0.1306	0.115	0.00E+00	2.73E+01	8.12E-01	8.34E-01	
2011/6/13 11:00		-1700	0.027	-	0.1305	0.115	0.00E+00	2.28E+02	8.12E-01	8.34E-01	
2011/6/13 14:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.52E+02	8.11E-01	8.33E-01	
2011/6/13 17:00		-1650	0.027	-	0.1307	0.115	0.00E+00	5.10E+01	8.11E-01	8.32E-01	
2011/6/13 20:00		-1700	0.027	-	0.1307	0.115	0.00E+00	5.06E+01	8.10E-01	8.32E-01	
2011/6/13 23:00		-1700	0.027	-	0.1306	0.115	0.00E+00	2.54E+01	8.10E-01	8.33E-01	
2011/6/14 2:00		-1700	0.027	-	0.1305	0.115	0.00E+00	3.14E+01	8.10E-01	8.31E-01	
2011/6/14 5:00		-1700	0.027	-	0.1304	0.115	0.00E+00	3.95E+01	8.09E-01	8.31E-01	