


# Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure





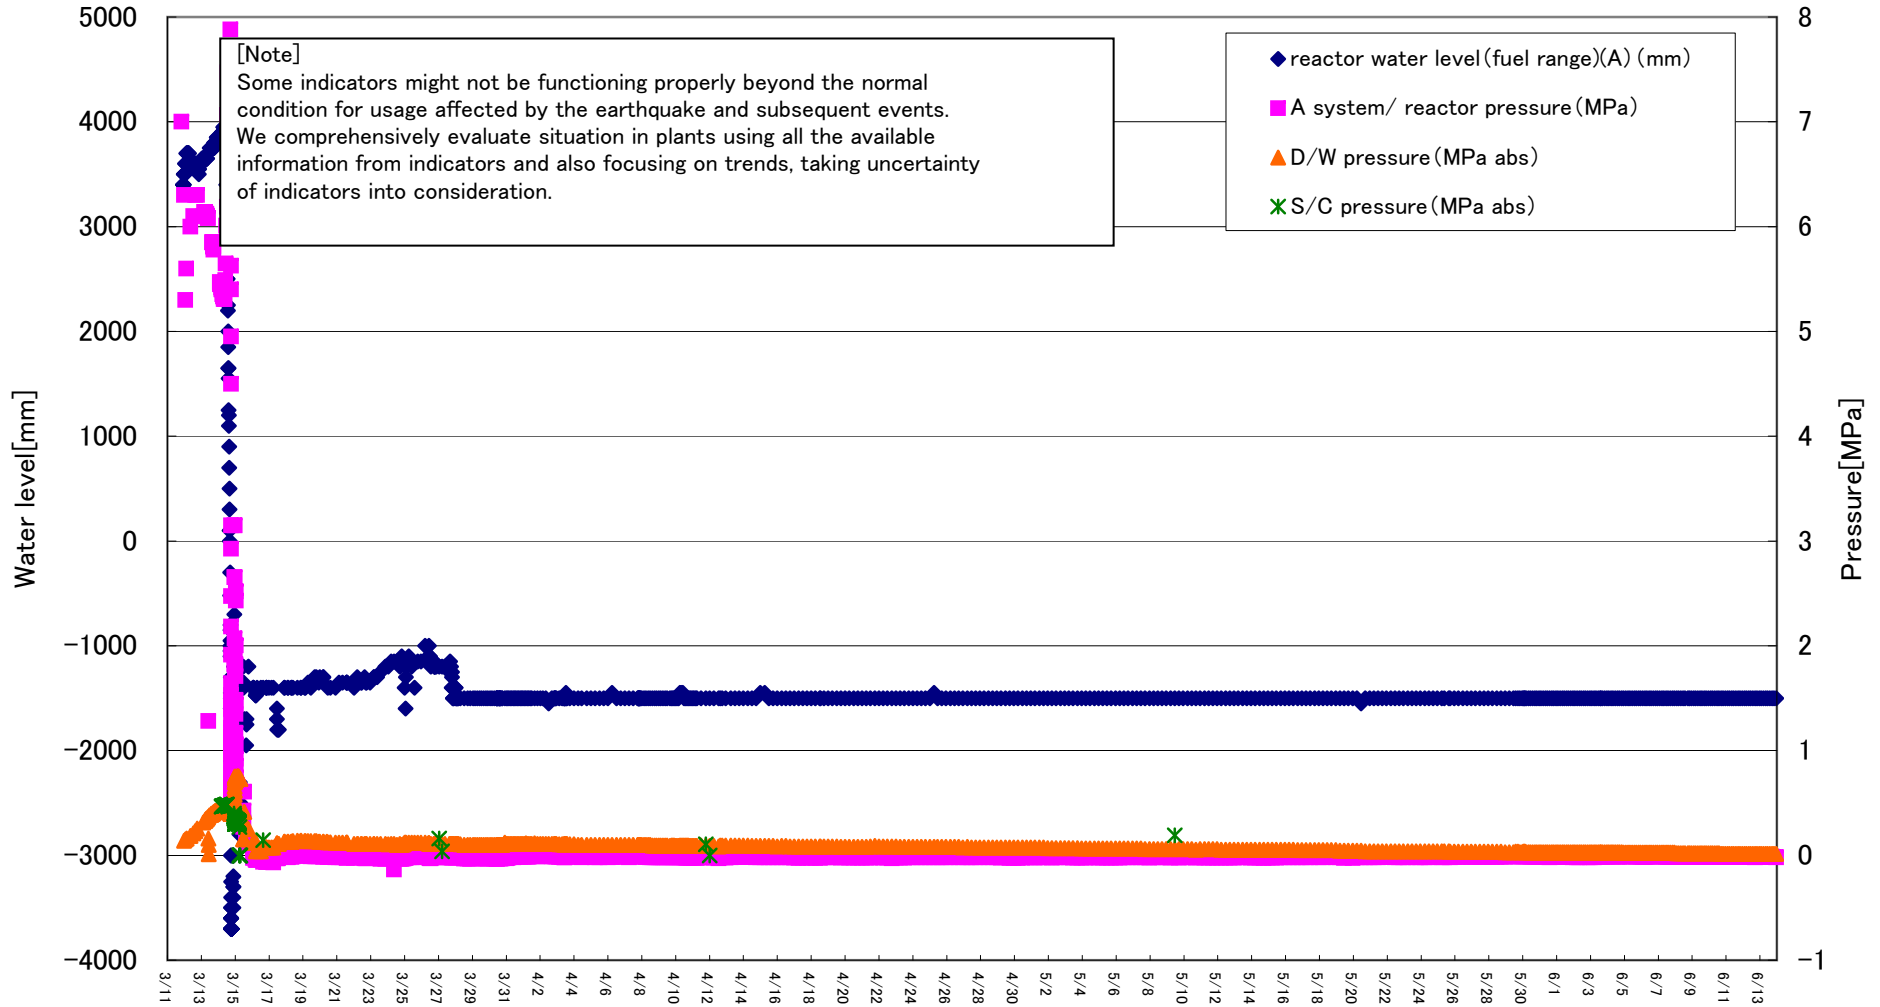

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/12 23:00	3600											
2011/3/12 23:30	3600											
2011/3/13 0:00	3600											
2011/3/13 0:30	3600											
2011/3/13 1:00	3650											
2011/3/13 2:00	3650											
2011/3/13 3:00	3650		6.098		0.315							
2011/3/13 3:38												
2011/3/13 4:00	3650		6.140									
2011/3/13 5:00	3650		6.140		0.330							
2011/3/13 5:30	3650		6.140		0.330							
2011/3/13 6:00	3650		6.120		0.340							
2011/3/13 6:30	3650		6.120		0.340							
2011/3/13 7:00	3650		6.120		0.340							
2011/3/13 7:30	3650		6.120		0.350							
2011/3/13 8:00	3650		6.100		0.350							
2011/3/13 8:20	3650		6.100		0.350							
2011/3/13 8:30												
2011/3/13 8:55	3700		6.080		0.360							
2011/3/13 9:25		3700	6.080		0.365							
2011/3/13 9:55		3700	1.283		0.160							
2011/3/13 10:30		3800			0.100							
2011/3/13 10:35		3700			0.010							
2011/3/13 10:40		3700										
2011/3/13 10:55		3700										
2011/3/13 11:05		3700										
2011/3/13 11:15		3700										
2011/3/13 11:25		3700										
2011/3/13 11:35		3700			0.380							
2011/3/13 11:45		3700										
2011/3/13 11:55	3750											
2011/3/13 12:10		3750										
2011/3/13 12:20		3750										
2011/3/13 12:30		3750										
2011/3/13 12:40		3750										
2011/3/13 13:00		3750										
2011/3/13 13:10		3750										
2011/3/13 13:45					0.390							
2011/3/13 13:58					0.390							
2011/3/13 14:15	3750				0.390							
2011/3/13 14:30		3750			0.390							
2011/3/13 14:45	3750				0.395							
2011/3/13 15:00		3750			0.395							
2011/3/13 15:15		3750			0.395							
2011/3/13 15:30		3750	5.850		0.400							
2011/3/13 15:45		3800	5.850		0.400							
2011/3/13 16:00		3750	5.850		0.400							
2011/3/13 16:15	3750	3800	5.850		0.400							

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/13 16:30	3750	3800	5.850		0.400							
2011/3/13 16:45	3750	3800	5.810		0.405							
2011/3/13 17:00	3750	3800	5.810		0.405							
2011/3/13 17:15	3750	3800	5.810		0.405							
2011/3/13 17:30	3750	3750	5.780		0.410							
2011/3/13 18:00	3750	3800			0.410							
2011/3/13 18:20	3800	3800			0.410							
2011/3/13 18:40	3800	3750			0.410							
2011/3/13 18:45												
2011/3/13 19:00	3800	3800			0.420							
2011/3/13 19:30	3800	3800			0.420							
2011/3/13 20:00	3800	3800			0.420							
2011/3/13 20:15	3800	3800			0.420							
2011/3/13 20:30	3800	3800			0.420							
2011/3/13 21:00	3800	3850			0.420							
2011/3/13 21:30	3800	3850			0.425							
2011/3/13 22:00	3850	3900			0.430							
2011/3/13 22:15					0.430							
2011/3/13 22:30	3850	3900			0.430							
2011/3/13 22:45					0.430							
2011/3/13 23:00	3850	3900			0.430							
2011/3/13 23:30	3850	3900			0.435							
2011/3/14 0:00	3850	3900			0.435							
2011/3/14 0:30	3850	3900			0.435							
2011/3/14 1:00	3850	3900			0.435							
2011/3/14 1:30	3850	3900			0.440							
2011/3/14 2:00	3850	3900			0.440							
2011/3/14 2:30	3850	3900	5.470		0.440							
2011/3/14 2:45	3850	3900	5.450		0.440							
2011/3/14 3:00	3850	3900	5.450									
2011/3/14 3:30	3850	3900	5.450									
2011/3/14 4:00	3850	3900	5.420									
2011/3/14 4:30	3850	3900	5.400			0.467						
2011/3/14 5:00	3900	3900	5.400			0.467						
2011/3/14 5:30	3900	3900	5.400			0.469						
2011/3/14 6:00	3900	3900	5.355		0.455	0.471	1.00E-03		9.00E-03			
2011/3/14 6:10					0.455							
2011/3/14 6:30	3900	3900	5.355		0.455		1.00E-03		9.00E-03			
2011/3/14 7:00	3900	3950	5.333		0.455	0.473	1.00E-03		8.50E-03			
2011/3/14 7:15	3950	3950										
2011/3/14 7:30	3950	3950	5.333		0.455	0.473	1.00E-03		8.00E-03			
2011/3/14 7:45							1.00E-03		9.50E-03			
2011/3/14 8:00	3950	3950	5.310		0.455	0.474	1.00E-03		1.00E-02			
2011/3/14 8:15							1.00E-03		1.00E-02			
2011/3/14 8:30	3950	3950	5.310		0.455	0.474	1.00E-03		1.10E-02			
2011/3/14 8:45							1.00E-03		1.10E-02			
2011/3/14 9:00	3900	3950	5.310		0.460	0.478	1.00E-03		1.15E-02			
2011/3/14 9:35	3800	3850	5.468		0.460	0.476	1.00E-03		1.15E-02			



Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/14 18:03			6.075									
2011/3/14 18:05	-2000		5.625									
2011/3/14 18:06	-1100		5.400									
2011/3/14 18:07	-2100		4.950									
2011/3/14 18:08	-2000		4.500									
2011/3/14 18:09	-3000		3.150		0.395							
2011/3/14 18:10	-3000		2.925		0.395							
2011/3/14 18:12	-3250		2.475		0.395							
2011/3/14 18:13	-3400		2.183		0.395							
2011/3/14 18:14	-3500		1.913		0.395							
2011/3/14 18:17	-3500		1.643		0.395							
2011/3/14 18:18	-3600		1.530		0.400							
2011/3/14 18:19	-3600		1.463		0.400							
2011/3/14 18:20	-3600		1.395		0.400							
2011/3/14 18:21	-3600		1.305		0.400							
2011/3/14 18:22	-3700		1.215		0.400							
2011/3/14 18:23	-3700		1.170		0.400							
2011/3/14 18:24	-3700		1.125		0.400							
2011/3/14 18:25	-3700		1.080		0.400							
2011/3/14 18:26	-3700		1.035		0.400							
2011/3/14 18:27	-3700		0.990		0.400							
2011/3/14 18:28	-3700		0.945		0.400							
2011/3/14 18:29	-3700		0.900		0.400							
2011/3/14 18:30	-3700		0.878		0.400							
2011/3/14 18:31	-3700		0.855		0.400							
2011/3/14 18:32	-3700		0.810		0.400							
2011/3/14 18:33	-3700		0.780		0.400							
2011/3/14 18:34	-3700		0.765		0.400							
2011/3/14 18:35	-3700		0.720		0.400							
2011/3/14 18:36	-3700		0.698		0.400							
2011/3/14 18:37	-3700		0.675		0.400							
2011/3/14 18:39	-3700		0.540		0.400							
2011/3/14 18:40	-3700		0.563		0.400							
2011/3/14 18:42	-3700		0.540		0.400							
2011/3/14 18:45	-3700		0.563		0.400							
2011/3/14 18:47	-3700		0.585		0.400							
2011/3/14 18:50			0.585		0.400							
2011/3/14 18:52			0.638		0.400							
2011/3/14 18:55			0.608		0.400							
2011/3/14 19:00			0.630		0.400							
2011/3/14 19:03			0.630		0.400							
2011/3/14 19:12			0.653		0.400							
2011/3/14 19:13			0.653		0.400							
2011/3/14 19:18			0.653		0.400							
2011/3/14 19:22			0.650		0.395							
2011/3/14 19:35			0.608		0.395							
2011/3/14 19:45			0.585		0.395							
2011/3/14 19:49			0.585		0.395							

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/14 19:54			0.585		0.395							
2011/3/14 19:55			0.563		0.395							
2011/3/14 19:57			0.563		0.400							
2011/3/14 19:59			0.563		0.405							
2011/3/14 20:00			0.563		0.405							
2011/3/14 20:03			0.540		0.405							
2011/3/14 20:04			0.540		0.410							
2011/3/14 20:05			0.540		0.410							
2011/3/14 20:07			0.540		0.415							
2011/3/14 20:08			0.563		0.415							
2011/3/14 20:10			0.540		0.418							
2011/3/14 20:12			0.563		0.419							
2011/3/14 20:13			0.540		0.420							
2011/3/14 20:15			0.540		0.420							
2011/3/14 20:18			0.563		0.420							
2011/3/14 20:20			0.563		0.420							
2011/3/14 20:21			0.563		0.420							
2011/3/14 20:23			0.563		0.420							
2011/3/14 20:26			0.585		0.420							
2011/3/14 20:28			0.608		0.420							
2011/3/14 20:32			0.608		0.420							
2011/3/14 20:33			0.653		0.420							
2011/3/14 20:37			0.810		0.421							
2011/3/14 20:43			0.833		0.421							
2011/3/14 20:54			1.170		0.420							
2011/3/14 20:59			1.373		0.419							
2011/3/14 21:03			1.418		0.419							
2011/3/14 21:06					0.419							
2011/3/14 21:09			1.440		0.418							
2011/3/14 21:18			1.463		0.418							
2011/3/14 21:20	-3400		0.833		0.470							
2011/3/14 21:21	-3500		0.675		0.465							
2011/3/14 21:26	-3300		0.608		0.470							
2011/3/14 21:27	-3300		0.563		0.470							
2011/3/14 21:29	-3200		0.518		0.475							
2011/3/14 21:30	-3000		0.495		0.475							
2011/3/14 21:31	-3000		0.450		0.480							
2011/3/14 21:32	-3000		0.450		0.480							
2011/3/14 21:33	-2000		0.450		0.480							
2011/3/14 21:34	-2000		0.405		0.480							
2011/3/14 21:35	-2000		0.405		0.480							
2011/3/14 21:38	-2000				0.480							
2011/3/14 21:42	-2000				0.480							
2011/3/14 21:55	-1800		0.405		0.470		5.36E+00		3.83E-01			
2011/3/14 22:00	-1600		0.405		0.480		5.79E+00		3.95E-01			
2011/3/14 22:10	-1600		0.405		0.480	0.400	6.49E+00		5.04E-01			
2011/3/14 22:20	-1400		0.405		0.480	0.370	6.88E+00		5.06E-01			
2011/3/14 22:30	-1200		0.405		0.482	0.370	7.46E+00		5.51E-01			



Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/14 22:40	-700		0.428		0.482	0.350	7.92E+00		7.35E-01			
2011/3/14 22:50	-1600		1.823		0.540	0.380	6.54E+00		1.01E+00			
2011/3/14 23:00	-1700		2.070		0.580	0.360						
2011/3/14 23:10	-2000		2.655		0.620	0.350						
2011/3/14 23:11	-2000		2.655		0.620	0.350						
2011/3/14 23:19					0.655							
2011/3/14 23:20			3.150				8.81E+00		6.61E+00			
2011/3/14 23:25			3.150		0.700		8.81E+00		6.61E+00			
2011/3/14 23:30			1.913		0.700	0.310	1.50E+01		7.40E+00			
2011/3/14 23:35			1.733		0.740	0.300						
2011/3/14 23:38			1.463			0.300						
2011/3/14 23:40			1.170		0.740	0.300						
2011/3/14 23:41			0.968		0.740	0.300						
2011/3/14 23:42			0.810		0.740	0.300	2.25E+01		9.11E+00			
2011/3/14 23:44			0.698		0.750	0.340	2.29E+01		9.12E+00			
2011/3/14 23:46			0.675		0.750	0.350	2.33E+01		9.11E+00			
2011/3/14 23:50			0.675		0.750	0.330	2.35E+01		9.07E+00			
2011/3/14 23:52			0.653		0.750	0.300	2.42E+01		9.04E+00			
2011/3/14 23:54			0.653		0.745	0.300	2.45E+01		9.10E+00			
2011/3/15 0:02					0.740							
2011/3/15 0:04					0.740							
2011/3/15 0:05			0.653		0.740	0.300						
2011/3/15 0:06			0.675		0.740	0.300						
2011/3/15 0:07			0.675		0.740	0.300						
2011/3/15 0:08			0.788		0.740	0.300						
2011/3/15 0:10			0.833		0.740	0.300						
2011/3/15 0:16			1.035		0.740	0.300						
2011/3/15 0:22			1.170		0.735	0.300						
2011/3/15 0:28			1.350		0.730	0.300						
2011/3/15 0:32			1.485		0.725	0.330						
2011/3/15 0:41			1.710		0.720	0.330						
2011/3/15 0:45			1.823									
2011/3/15 0:49			2.003									
2011/3/15 1:00			2.430									
2011/3/15 1:02			2.520									
2011/3/15 1:10			1.440		0.725							
2011/3/15 1:11			1.058		0.725	0.330						
2011/3/15 1:12			0.923									
2011/3/15 1:13			0.855		0.730	0.330						
2011/3/15 1:14			0.743		0.730	0.310						
2011/3/15 1:16			0.698		0.720	0.310						
2011/3/15 1:18			0.675		0.730	0.300	2.88E+01		8.08E+00			
2011/3/15 1:20			0.653		0.730	0.330	2.89E+01		8.12E+00			
2011/3/15 1:22			0.653		0.730	0.310	2.90E+01		8.13E+00			
2011/3/15 1:27					0.730							
2011/3/15 1:28			0.630		0.730	0.330	2.90E+01		7.96E+00			
2011/3/15 1:31			0.630		0.730	0.320	2.91E+01		7.81E+00			
2011/3/15 1:40			0.630		0.725	0.310	2.94E+01		7.84E+00			

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/15 1:48			0.630		0.725	0.310						
2011/3/15 1:53			0.630		0.725	0.330	3.04E+01		7.56E+00			
2011/3/15 2:03			0.630		0.725	0.330	3.04E+01		7.40E+00			
2011/3/15 2:08			0.630		0.725	0.330	3.09E+01		7.37E+00			
2011/3/15 2:10			0.630		0.730	0.340	3.11E+01		7.27E+00			
2011/3/15 2:17			0.630		0.730	0.340	3.15E+01		7.15E+00			
2011/3/15 2:19					0.730							
2011/3/15 2:22			0.675		0.740	0.330	3.22E+01		7.00E+00			
2011/3/15 2:26					0.740							
2011/3/15 2:39			0.653		0.750	0.330	3.46E+01		6.96E+00			
2011/3/15 2:45			0.653		0.750	0.320	3.65E+01		6.88E+00			
2011/3/15 2:50			0.653		0.750	0.330	3.78E+01		6.82E+00			
2011/3/15 3:00			0.653		0.750	0.330	4.09E+01		6.60E+00			
2011/3/15 3:05			0.653		0.750	0.330	4.18E+01		6.58E+00			
2011/3/15 3:20			0.653		0.750	0.330	4.30E+01		6.42E+00			
2011/3/15 3:30			0.653		0.750	0.330	4.59E+01		6.31E+00			
2011/3/15 3:40			0.653		0.750	0.330	4.76E+01		6.23E+00			
2011/3/15 3:50			0.653		0.750	0.330	4.94E+01		6.22E+00			
2011/3/15 4:00			0.653		0.750	0.330	5.01E+01		6.09E+00			
2011/3/15 4:05			0.653		0.750	0.330	5.12E+01		5.87E+00			
2011/3/15 4:10			0.653		0.750	0.310	5.19E+01		5.72E+00			
2011/3/15 4:20			0.637		0.750	0.310	5.32E+01		5.65E+00			
2011/3/15 4:30			0.632		0.750	0.300	5.44E+01		5.58E+00			
2011/3/15 4:45			0.632		0.750	0.310	5.55E+01		5.52E+00			
2011/3/15 5:00			0.626		0.750	0.300	5.75E+01		5.29E+00			
2011/3/15 5:15			0.623		0.740	0.300	5.83E+01		5.19E+00			
2011/3/15 5:30			0.621		0.730	0.310	5.95E+01		5.08E+00			
2011/3/15 5:45			0.617		0.740	0.320	6.06E+01		5.00E+00			
2011/3/15 6:00			0.614		0.730	0.270	6.16E+01		4.89E+00			
2011/3/15 6:02			0.612		0.730	0.000	6.26E+01		4.80E+00			
2011/3/15 6:10	-2800				0.730	0.000						
2011/3/15 6:20	-2700		0.612		0.730	0.000	6.27E+01		4.80E+00			
2011/3/15 6:25	-2300		0.610		0.730	0.000	4.30E+01		4.70E+00			
2011/3/15 7:20	-2500		0.612		0.730	0.000						
2011/3/15 11:20					0.155							
2011/3/15 11:25	-1200		0.270		0.155		4.56E+01		5.79E+00			Instrument failure - S/C pressure
2011/3/15 11:42	-1400		0.315		0.155		4.61E+01		5.52E+00			
2011/3/15 11:58	-1350		0.428		0.155		4.65E+01		5.27E+00			
2011/3/15 13:00	-1700		0.608		0.415		4.77E+01		4.62E+00			
2011/3/15 15:25	-1950		0.119		0.275		1.35E+02		6.92E+00			
2011/3/15 15:50	-1750		0.117		0.270							
2011/3/15 16:10	-1700		0.119		0.270		1.38E+02		6.49E+00			
2011/3/15 18:43	-1200		0.099		0.250		1.22E+02		4.40E+00			
2011/3/16 1:24	-1400		-0.023		0.120		1.03E+02		3.68E+00			
2011/3/16 1:44	-1400		-0.023		0.120		1.02E+02		3.66E+00			
2011/3/16 1:54	-1400		-0.023		0.120		1.02E+02		3.65E+00			
2011/3/16 5:00	-1475		-0.038		0.125		9.85E+01		3.67E+00			
2011/3/16 5:15	-1475		-0.041		0.120		9.83E+01		3.69E+00			

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/16 5:35	-1450		-0.041		0.040		6.05E+01		2.43E+00			
2011/3/16 6:10	-1425		-0.043		0.050		9.77E+01		3.63E+00			
2011/3/16 6:55	-1400		-0.043		0.045		9.72E+01		3.57E+00			
2011/3/16 12:35	-1400				0.040		9.38E+01		3.01E+00			
2011/3/16 15:30	-1400		-0.061		0.075	0.145	9.24E+01		2.86E+00			
2011/3/16 20:00	-1400		-0.063		0.075		9.03E+01		2.75E+00			
2011/3/16 20:20	-1400		-0.063		0.075		9.03E+01		2.75E+00			
2011/3/16 20:40	-1400		-0.063		0.075		9.03E+01		2.75E+00			
2011/3/16 23:50	-1400		-0.063		0.075		9.03E+01		2.75E+00			
2011/3/17 3:10	-1400		-0.065		0.075		8.70E+01		2.65E+00			
2011/3/17 6:00	-1400		-0.068		0.075		8.63E+01		2.63E+00			
2011/3/17 11:00	-1600		-0.029		0.110		8.46E+01		2.50E+00			
2011/3/17 11:15	-1700		-0.029		0.115		8.46E+01		2.50E+00			
2011/3/17 11:30	-1800		-0.029		0.115		8.46E+01		2.50E+00			
2011/3/17 12:50	-1800		-0.027		0.110		8.44E+01		2.43E+00			
2011/3/17 14:00	-1800				0.110							
2011/3/17 21:40	-1400				0.130		8.21E+01		2.40E+00			
2011/3/17 21:50	-1400				0.130		8.24E+01		2.41E+00			
2011/3/18 2:20	-1400		-0.018		0.130		8.02E+01		2.40E+00			
2011/3/18 2:50	-1400		-0.016		0.130		7.98E+01		2.40E+00			
2011/3/18 7:40	-1400		-0.014		0.130		7.81E+01		2.37E+00			
2011/3/18 7:55	-1400		-0.014		0.130		7.80E+01		2.37E+00			
2011/3/18 9:40	-1400		-0.009		0.135		7.74E+01		2.36E+00			
2011/3/18 16:00	-1400		-0.002		0.139		7.50E+01		2.34E+00			
2011/3/18 20:55	-1400		-0.002		0.140		7.35E+01		2.33E+00			
2011/3/18 21:10	-1400		-0.005		0.140		7.35E+01		2.32E+00			
2011/3/19 2:40	-1400		-0.005		0.135		7.18E+01		2.30E+00			
2011/3/19 3:30	-1400		-0.005		0.135		7.15E+01		2.30E+00			
2011/3/19 7:10	-1350		-0.005		0.135		7.06E+01		2.29E+00			
2011/3/19 11:00	-1400	-400	-0.009		0.135		6.96E+01		2.27E+00			
2011/3/19 16:30	-1300	-300	-0.009		0.135		6.83E+01		2.26E+00			
2011/3/19 19:00	-1300	-350	-0.009		0.135		6.76E+01		2.25E+00			
2011/3/19 22:30	-1350	-400	-0.009		0.130		6.68E+01		2.20E+00			
2011/3/20 0:00	-1300	-380	-0.007		0.130		6.58E+01		2.20E+00			
2011/3/20 4:50	-1300	-380	-0.014		0.130		6.97E+01		2.18E+00			
2011/3/20 5:00	-1300	-500	-0.014		0.130		6.47E+01		2.17E+00			
2011/3/20 10:00			-0.011		0.130		6.36E+01		2.16E+00			
2011/3/20 11:00	-1400	-400	-0.016		0.125		1.34E+01		2.15E+00			
2011/3/20 15:00	-1400	-400	-0.016	-0.020	0.125		6.25E+01		2.13E+00		0.060	
2011/3/20 22:00	-1400	-200	-0.018	-0.020	0.120		6.12E+01		2.11E+00		0.060	
2011/3/21 3:00	-1350	-250	-0.018	-0.020	0.120		6.01E+01		2.09E+00		0.060	
2011/3/21 8:00	-1350	-300	-0.020	-0.020	0.120		5.91E+01		2.06E+00		0.060	
2011/3/21 13:30	-1350	-200	-0.020	-0.025	0.120		5.83E+01		2.04E+00			
2011/3/21 14:00	-1350	-200	-0.023	-0.025	0.120		5.81E+01		2.03E+00			
2011/3/21 14:25	-1350	-200	-0.023	-0.025	0.120		5.81E+01		2.03E+00			
2011/3/21 14:30	-1350	-200	-0.023	-0.025	0.120		5.81E+01		2.03E+00			
2011/3/22 0:15	-1400	-200	-0.025	-0.027	0.110		5.64E+01		1.99E+00			
2011/3/22 5:00	-1300	-100	-0.016	-0.018	0.110		5.55E+01		1.90E+00			

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/22 6:00	-1350	0	-0.005	-0.029	0.110		5.54E+01		1.95E+00			
2011/3/22 10:30	-1350	0	-0.020	-0.023	0.110		5.47E+01		1.93E+00			
2011/3/22 11:20	-1350	175	-0.018	-0.018	0.110							
2011/3/22 15:30	-1300	-400	-0.029	-0.032	0.110		5.36E+01		1.90E+00			
2011/3/22 17:00	-1350	-150	-0.027	-0.032	0.110		5.35E+01		1.88E+00			
2011/3/22 18:00	-1350	-100	-0.029	-0.034	0.110		5.34E+01		1.88E+00			
2011/3/22 23:00	-1350	-500	-0.020	-0.043	0.110		5.28E+01		1.83E+00			
2011/3/23 4:20	-1300	0	-0.025	-0.025	0.110		5.20E+01		1.80E+00			
2011/3/23 4:40	-1300	0	-0.025	-0.025	0.110		5.20E+01		1.80E+00			
2011/3/23 9:00	-1300	-150	-0.023	-0.023	0.110		5.14E+01		1.76E+00			
2011/3/23 14:00	-1250	100	-0.036	-0.036	0.110		5.07E+01		1.67E+00			
2011/3/23 21:00	-1200	-550	-0.036	-0.036	0.110		4.98E+01		1.53E+00			
2011/3/24 1:00	-1200	-250	-0.025	-0.025	0.105		4.93E+01		1.49E+00			
2011/3/24 5:00	-1150	-100	-0.027	-0.027	0.110		4.88E+01		1.43E+00			
2011/3/24 9:00	-1150	-100	-0.135	-0.038	0.110		4.84E+01		1.40E+00		0.100	
2011/3/24 13:00	-1150	-200	-0.023	-0.025	0.100		4.79E+01		1.37E+00		0.100	
2011/3/24 17:00	-1200	-250	-0.036	-0.036	0.110		4.74E+01		1.36E+00			
2011/3/24 20:00	-1100	0	-0.036	-0.036	0.100		4.71E+01		1.34E+00			
2011/3/24 22:00	-1150	-150	-0.020	-0.020	0.105		4.68E+01		1.39E+00			
2011/3/24 22:30	-1150	-50	-0.032	-0.032	0.105		4.68E+01		1.47E+00			
2011/3/25 0:00	-1400	-600	-0.025	-0.027	0.120		4.66E+01		1.50E+00			
2011/3/25 1:20	-1600	-750	-0.025	-0.027	0.120						0.120	
2011/3/25 2:00	-1300	-1400	-0.023	-0.025	0.120		4.64E+01		1.52E+00			
2011/3/25 2:30	-1200	-300										
2011/3/25 6:00	-1100	-200	-0.020	-0.020	0.120		4.59E+01		1.54E+00		0.100	
2011/3/25 10:00	-1200	-500	-0.020	-0.020	0.120		4.56E+01		1.54E+00			
2011/3/25 14:00	-1400	-400	-0.016	-0.018	0.120		4.52E+01		1.54E+00			
2011/3/25 18:30	-1150	-250	-0.020	-0.018	0.120		4.47E+01		1.54E+00			
2011/3/25 23:00	-1150	-450	-0.009	-0.009	0.120		4.43E+01		1.53E+00			
2011/3/26 5:00	-1000	-300	-0.014	-0.014	0.120		4.38E+01		1.51E+00			
2011/3/26 9:30	-1100	-500	-0.014	-0.014	0.115		4.34E+01		1.49E+00			
2011/3/26 10:21	-1000	-500	-0.014	-0.014	0.115							
2011/3/26 10:40	-1100	-500	-0.014	-0.016	0.115							
2011/3/26 10:41					0.115							
2011/3/26 11:00	-1100	-500	-0.014	-0.016	0.115							
2011/3/26 11:30	-1100	-600	-0.025	-0.027	0.110		4.33E+01		1.49E+00			
2011/3/26 12:00	-1100	-700	-0.027	-0.027	0.110		4.32E+01		1.49E+00			
2011/3/26 13:00	-1200	-1000	-0.027	-0.027	0.110		4.32E+01		1.48E+00			
2011/3/26 17:30	-1150	-1600	-0.018	-0.038	0.110		4.28E+01		1.47E+00			
2011/3/26 17:50	-1150	-1650										
2011/3/26 18:00	-1200	-1600										
2011/3/26 18:10	-1200	-1600	-0.016	-0.016	0.110							
2011/3/26 18:30	-1200	-1550	-0.016	-0.016	0.110							
2011/3/26 19:00	-1200	-1650	-0.018	-0.016	0.110							
2011/3/26 21:00	-1200	-1850	-0.016	-0.018	0.110		4.26E+01		1.46E+00			
2011/3/27 1:00	-1200	-1850	-0.018	-0.018	0.110	0.160	4.22E+01		1.45E+00			
2011/3/27 5:00	-1200	-1850	-0.018	-0.018	0.110	0.040	4.19E+01		1.43E+00			
2011/3/27 9:00	-1200	-1850	-0.018	-0.020	0.110		4.16E+01		1.41E+00			

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/27 15:30	-1250	-1900	-0.018	-0.020	0.110		4.11E+01		1.39E+00			
2011/3/27 16:20	-1150	-1850	-0.018	-0.020	0.110		4.11E+01		1.38E+00			
2011/3/27 17:50	-1200	-1900	-0.018	-0.020	0.110		4.10E+01		1.38E+00			
2011/3/27 18:40	-1400	-1850	-0.018	-0.020	0.110							
2011/3/27 19:00	-1250	-1950	-0.020	-0.020	0.110							
2011/3/27 19:20	-1300	-1900	-0.020	-0.023	0.110							
2011/3/27 19:40	-1400	-1900	-0.020	-0.020	0.110							
2011/3/27 20:00	-1400	-1900	-0.020	-0.023	0.110							
2011/3/27 20:20	-1500	-2000	-0.020	-0.023	0.110		4.08E+01		1.37E+00			
2011/3/27 20:40	-1500	-2000	-0.020	-0.023	0.110							
2011/3/27 22:00	-1500	-2050	-0.020	-0.020	0.110		4.07E+01		1.37E+00		0.120	
2011/3/28 0:00	-1400	-2000	-0.020	-0.020	0.110		4.06E+01		1.36E+00			
2011/3/28 0:15	-1400	-1950	-0.020	-0.020	0.110							
2011/3/28 0:35	-1500	-2100	-0.020	-0.020	0.110							
2011/3/28 0:55	-1500	-2100	-0.020	-0.020	0.110		4.05E+01		1.36E+00			
2011/3/28 1:15	-1500	-2100	-0.020	-0.020	0.110							
2011/3/28 3:00	-1500	-2100	-0.020	-0.020	0.110		4.05E+01		1.37E+00		0.150	
2011/3/28 3:30	-1500	-2100	-0.020	-0.020	0.110		4.05E+01		1.37E+00			
2011/3/28 4:00	-1500	-2100	-0.020	-0.023	0.110		4.05E+01		1.37E+00			
2011/3/28 7:00	-1500	-2100	-0.020	-0.023	0.105		4.05E+01		1.39E+00			
2011/3/28 12:30	-1500	-2100	-0.032	-0.032	0.100		4.04E+01		1.39E+00			
2011/3/28 17:30	-1500	-2100	-0.032	-0.032	0.100		4.04E+01		1.40E+00			
2011/3/28 21:00	-1500	-2100	-0.034	-0.034	0.100		4.04E+01		1.40E+00			
2011/3/29 1:00	-1500	-2050	-0.027	-0.029	0.100		4.04E+01		1.39E+00		0.120	
2011/3/29 4:00	-1500	-2100	-0.027	-0.029	0.100		4.04E+01		1.37E+00		0.120	
2011/3/29 7:00	-1500	-2100	-0.027	-0.029	0.100		4.04E+01		1.36E+00		0.100	
2011/3/29 10:00	-1500	-2100	-0.025	-0.027	0.100		4.04E+01		1.35E+00		0.110	
2011/3/29 13:00	-1500	-2100	-0.025	-0.025	0.100		4.05E+01		1.33E+00		0.110	
2011/3/29 16:00	-1500	-2100	-0.025	-0.025	0.100		4.04E+01		1.32E+00		0.120	
2011/3/29 19:00	-1500	-2100	-0.034	-0.032	0.100		4.02E+01		1.31E+00		0.120	
2011/3/29 22:00	-1500	-2100	-0.032	-0.032	0.100		4.01E+01		1.30E+00		0.110	
2011/3/30 1:00	-1500	-2100	-0.025	-0.025	0.100		4.01E+01		1.29E+00		0.100	
2011/3/30 4:00	-1500	-2100	-0.025	-0.025	0.100		4.00E+01		1.28E+00		0.110	
2011/3/30 7:00	-1500	-2100	-0.032	-0.032	0.100		3.99E+01		1.28E+00		0.100	
2011/3/30 10:00	-1500	-2100	-0.032	-0.032	0.100		3.98E+01		1.27E+00		0.110	
2011/3/30 10:30	-1500	-2100	-0.025	-0.027	0.100							
2011/3/30 10:50	-1500	-2100	-0.032	-0.034	0.100							
2011/3/30 11:10	-1500	-2100	-0.032	-0.034	0.100							
2011/3/30 11:30	-1500	-2100	-0.032	-0.034	0.100							
2011/3/30 13:00	-1500	-2100	-0.023	-0.023	0.100		3.96E+01		1.26E+00		0.100	
2011/3/30 14:00	-1500	-2100	-0.025	-0.023	0.100							
2011/3/30 14:20	-1500	-2100	-0.027	-0.025	0.100							
2011/3/30 14:40	-1500	-2050	-0.027	-0.027	0.100							
2011/3/30 15:00	-1500	-2050	-0.027	-0.027	0.100							
2011/3/30 15:20	-1500	-2050	-0.029	-0.027	0.100							
2011/3/30 16:00	-1500	-2050	-0.032	-0.032	0.100		3.95E+01		1.24E+00		0.130	
2011/3/30 18:00	-1500	-2050	-0.029	-0.027	0.100		3.94E+01		1.23E+00		0.130	
2011/3/30 18:30	-1500	-2050	-0.029	-0.027	0.100							

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/3/30 22:00	-1500	-2050	-0.014	-0.011	0.120		3.92E+01		1.22E+00		0.100	
2011/3/31 0:00	-1500	-2050	-0.027	-0.025	0.110		3.91E+01		1.21E+00		0.110	
2011/3/31 2:00	-1500	-2050	-0.025	-0.025	0.110		3.89E+01		1.21E+00		0.100	
2011/3/31 4:00	-1500	-2050	-0.018	-0.020	0.110		3.87E+01		1.19E+00		0.100	
2011/3/31 6:00	-1500	-2050	-0.014	-0.014	0.110		3.86E+01		1.19E+00		0.110	
2011/3/31 8:00	-1500	-2050	-0.016	-0.018	0.110		3.85E+01		1.17E+00		0.120	
2011/3/31 10:00	-1500	-2050	-0.018	-0.020	0.110		3.84E+01		1.17E+00		0.130	
2011/3/31 12:00	-1500	-2100	-0.011	-0.011	0.110		3.79E+01		1.16E+00		0.110	
2011/3/31 14:00	-1500	-2100	-0.011	-0.011	0.110		3.80E+01		1.16E+00		0.110	
2011/3/31 16:00	-1500	-2100	-0.009	-0.011	0.110		3.79E+01		1.16E+00		0.110	
2011/3/31 18:00	-1500	-2100	-0.011	-0.011	0.110		3.78E+01		1.15E+00		0.110	
2011/3/31 20:00	-1500	-2050	-0.014	-0.016	0.110		3.78E+01		1.15E+00		0.110	
2011/3/31 22:00	-1500	-2050	-0.007	-0.009	0.110		3.77E+01		1.14E+00		0.110	
2011/4/1 0:00	-1500	-2050	-0.014	-0.014	0.110		3.76E+01		1.14E+00		0.110	
2011/4/1 2:00	-1500	-2050	-0.014	-0.014	0.110		3.75E+01		1.14E+00		0.120	
2011/4/1 4:00	-1500	-2050	-0.009	-0.009	0.115		3.73E+01		1.13E+00		0.090	
2011/4/1 6:00	-1500	-2050	-0.014	-0.016	0.110		3.72E+01		1.11E+00		0.110	
2011/4/1 8:00	-1500	-2100	-0.014	-0.014	0.110		3.71E+01		1.10E+00		0.120	
2011/4/1 10:00	-1500	-2050	-0.007	-0.009	0.110		3.70E+01		1.09E+00		0.100	
2011/4/1 12:00	-1500	-2050	-0.007	-0.007	0.110		3.69E+01		1.08E+00		0.100	
2011/4/1 16:00	-1500	-2050	-0.005	-0.005	0.115		3.67E+01		1.06E+00		0.110	
2011/4/1 20:00	-1500	-2050	-0.011	-0.014	0.110		3.65E+01		1.04E+00		0.120	
2011/4/2 0:30	-1500	-2050	-0.011	-0.014	0.110		3.63E+01		9.93E-01		0.130	
2011/4/2 4:00	-1500	-2050	-0.011	-0.014	0.110		3.61E+01		9.81E-01		0.130	
2011/4/2 8:00	-1500	-2050	-0.007	-0.009	0.110		3.59E+01		9.72E-01		0.110	
2011/4/2 12:00	-1550	-2100	-0.007	-0.007	0.110		3.57E+01		9.66E-01		0.120	
2011/4/2 16:30	-1500	-2100	-0.011	-0.014	0.110		3.55E+01		9.59E-01		0.130	
2011/4/2 20:00	-1500	-2100	-0.007	-0.009	0.110		3.54E+01		9.53E-01		0.120	
2011/4/2 20:53	-1500	-2100	-0.009	-0.009	0.110							
2011/4/2 21:03	-1500	-2100	-0.007	-0.009	0.110							
2011/4/2 21:23	-1500	-2100	-0.009	-0.009	0.110		3.53E+01		9.50E-01		0.120	
2011/4/2 23:00	-1500	-2100	-0.014	-0.016	0.110		3.53E+01		9.51E-01		0.130	
2011/4/3 3:00	-1500	-2100	-0.016	-0.018	0.105		3.50E+01		9.47E-01		0.100	
2011/4/3 7:00	-1500	-2050	-0.016	-0.020	0.105		3.45E+01		9.39E-01		0.110	
2011/4/3 9:00	-1500	-2050	-0.016	-0.018	0.105		3.43E+01		9.35E-01		0.090	
2011/4/3 10:26	-1500	-2050	-0.018	-0.020	0.105							
2011/4/3 10:42	-1500	-2050	-0.018	-0.018	0.105							
2011/4/3 10:47	-1500	-2050	-0.018	-0.018	0.105							
2011/4/3 10:52			-0.016	-0.018	0.105							
2011/4/3 11:30	-1500	-2050	-0.011	-0.011	0.110		3.43E+01		9.32E-01		0.120	
2011/4/3 12:30	-1450	-1950	-0.011	-0.011	0.110							
2011/4/3 13:00	-1500	-1950	-0.011	-0.011	0.110							
2011/4/3 14:00	-1500	-2050	-0.016	-0.016	0.110		3.39E+01		9.25E-01		0.130	
2011/4/3 18:00	-1500	-2100	-0.011	-0.011	0.105		3.38E+01		9.20E-01		0.100	
2011/4/4 0:00	-1500	-2100	-0.011	-0.014	0.105		3.34E+01		9.11E-01		0.100	
2011/4/4 6:00	-1500	-2100	-0.011	-0.016	0.100		3.30E+01		9.02E-01		0.080	
2011/4/4 11:00	-1500	-2100	-0.018	-0.020	0.100		3.28E+01		8.79E-01		0.090	
2011/4/4 18:00	-1500	-2050	-0.014	-0.016	0.100		3.26E+01		8.86E-01		0.080	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/4/5 0:00	-1500	-2050	-0.016	-0.018	0.100		3.24E+01		8.76E-01		0.100	
2011/4/5 6:00	-1500	-2100	-0.018	-0.018	0.100		3.21E+01		8.67E-01		0.090	
2011/4/5 12:00	-1500	-2100	-0.020	-0.023	0.100		3.19E+01		8.58E-01		0.080	
2011/4/5 18:00	-1500	-2100	-0.014	-0.016	0.100		3.17E+01		8.49E-01		0.080	
2011/4/6 0:00	-1500	-2050	-0.018	-0.023	0.100		3.15E+01		8.39E-01		0.080	
2011/4/6 6:00	-1450	-2100	-0.016	-0.020	0.100		3.13E+01		8.33E-01		0.090	
2011/4/6 12:00	-1500	-2100	-0.016	-0.018	0.100		3.11E+01		8.25E-01		0.090	
2011/4/6 18:00	-1500	-2100	-0.014	-0.018	0.100		3.10E+01		8.17E-01		0.090	
2011/4/7 0:00	-1500	-2050	-0.011	-0.018	0.100		3.08E+01		8.09E-01		0.070	
2011/4/7 6:00	-1500	-2050	-0.018	-0.025	0.100		3.06E+01		8.01E-01			
2011/4/7 12:00	-1500	-2050	-0.009	-0.016	0.100		3.05E+01		7.94E-01		0.080	
2011/4/7 18:00	-1500	-2050	-0.011	-0.014	0.100		3.03E+01		7.87E-01		0.070	
2011/4/7 19:00	-1500	-2100	-0.011	-0.014	0.100						0.080	
2011/4/7 19:20	-1500	-2100	-0.011	-0.014	0.100							
2011/4/7 19:40	-1500	-2100	-0.011	-0.014	0.100							
2011/4/7 20:00	-1500	-2100	-0.011	-0.014	0.100							
2011/4/7 20:30	-1500	-2100	-0.011	-0.014	0.100							
2011/4/7 21:00	-1500	-2100	-0.011	-0.016	0.100						0.070	
2011/4/7 21:30	-1500	-2100	-0.011	-0.016	0.100							
2011/4/7 22:00	-1500	-2100	-0.011	-0.016	0.100							
2011/4/8 0:00	-1500	-2100	-0.009	-0.014	0.100		3.10E+01		7.81E-01		0.090	
2011/4/8 3:00	-1500	-2100	-0.011	-0.016	0.100		3.00E+01		7.72E-01		0.080	
2011/4/8 6:00	-1500	-2100	-0.016	-0.018	0.100		2.99E+01		7.75E-01		0.090	
2011/4/8 9:00	-1500	-2050	-0.014	-0.018	0.100							
2011/4/8 12:00	-1500	-2100	-0.020	-0.020	0.100		2.94E+01		7.65E-01		0.080	
2011/4/8 15:00	-1500	-2100	-0.018	-0.018	0.095		2.96E+01		7.59E-01		0.080	
2011/4/8 18:00	-1500	-2100	-0.018	-0.020	0.095		2.96E+01		7.56E-01		0.080	
2011/4/8 21:00	-1500	-2100	-0.018	-0.020	0.095		2.95E+01		7.54E-01		0.080	
2011/4/9 0:00	-1500	-2100	-0.018	-0.020	0.095		2.94E+01		7.51E-01		0.100	
2011/4/9 3:00	-1500	-2050	-0.018	-0.023	0.095		2.94E+01		7.50E-01		0.070	
2011/4/9 6:00	-1500	-2050	-0.018	-0.023	0.095		2.93E+01		7.48E-01		0.070	
2011/4/9 9:00	-1500	-2100	-0.018	-0.023	0.095		2.93E+01		7.46E-01		0.080	
2011/4/9 12:00	-1500	-2100	-0.020	-0.025	0.095		2.92E+01		7.43E-01		0.080	
2011/4/9 16:00	-1500	-2100	-0.018	-0.025	0.090		2.91E+01		7.42E-01		0.080	
2011/4/9 18:00	-1500	-2100	-0.018	-0.027	0.095		2.91E+01		7.41E-01		0.070	
2011/4/9 20:00	-1500	-2100	-0.018	-0.025	0.095		2.91E+01		7.41E-01		0.070	
2011/4/9 22:00	-1500	-2100	-0.020	-0.025	0.095		2.90E+01		7.40E-01		0.070	
2011/4/10 0:00	-1500	-2100	-0.020	-0.025	0.090		2.90E+01		7.39E-01		0.077	
2011/4/10 2:00	-1500	-2100	-0.020	-0.025	0.090		2.90E+01		7.39E-01		0.077	
2011/4/10 4:00	-1500	-2050	-0.020	-0.025	0.090		2.90E+01		7.38E-01		0.077	
2011/4/10 6:00	-1450	-2050	-0.020	-0.025	0.095		2.90E+01		7.37E-01		0.120	
2011/4/10 8:00	-1450	-2050	-0.018	-0.025	0.095		2.89E+01		7.35E-01		0.090	
2011/4/10 10:00	-1450	-2050	-0.020	-0.025	0.095		2.89E+01		7.34E-01		0.090	
2011/4/10 12:00	-1500	-2100	-0.020	-0.025	0.095		2.85E+01		7.32E-01		0.070	
2011/4/10 14:00	-1500	-2100	-0.023	-0.025	0.095		2.86E+01		7.31E-01		0.095	
2011/4/10 16:00	-1500	-2100	-0.023	-0.025	0.095		2.87E+01		7.30E-01		0.090	
2011/4/10 18:00	-1500	-2050	-0.023	-0.025	0.095		2.87E+01		7.28E-01		0.110	
2011/4/10 20:00	-1500	-2050	-0.023	-0.025	0.090		2.86E+01		7.27E-01		0.110	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/4/10 22:00	-1500	-2050	-0.023	-0.025	0.090		2.86E+01		7.26E-01		0.095	
2011/4/11 0:00	-1500	-2050	-0.020	-0.025	0.090		2.86E+01		7.25E-01		0.100	
2011/4/11 2:00	-1500	-2050	-0.025	-0.027	0.090		2.86E+01		7.24E-01		0.100	
2011/4/11 4:00	-1500	-2050	-0.020	-0.025	0.090		2.85E+01		7.22E-01		0.120	
2011/4/11 6:00	-1500	-2050	-0.025	-0.029	0.090		2.85E+01		7.21E-01		0.110	
2011/4/11 12:00	-1500	-2050	-0.020	-0.023	0.095		2.84E+01		7.17E-01		0.120	
2011/4/11 18:30	-1500	-2100	-0.020	-0.023	0.095	0.105	2.80E+01		6.92E-01		0.090	
2011/4/12 0:00	-1500	-2050	-0.023	-0.025	0.090	0.000	2.81E+01		6.85E-01		0.080	
2011/4/12 6:00	-1500	-2100	-0.023	-0.025	0.090		2.81E+01		6.81E-01		0.090	
2011/4/12 13:00	-1500	-2100	-0.027	-0.027	0.085		2.74E+01		6.72E-01		0.080	
2011/4/12 15:00	-1500	-2050	-0.020	-0.025	0.095		2.77E+01		6.72E-01		0.070	
2011/4/12 18:00	-1500	-2050	-0.018	-0.020	0.095		2.78E+01		6.70E-01		0.080	
2011/4/12 23:00	-1500	-2050	-0.023	-0.025	0.095		2.79E+01		6.63E-01		0.085	
2011/4/13 6:00	-1500	-2100	-0.018	-0.023	0.095		2.79E+01		6.56E-01		0.080	
2011/4/13 12:00	-1500	-2050	-0.016	-0.020	0.095		2.79E+01		6.53E-01		0.100	
2011/4/13 18:00	-1500	-2050	-0.016	-0.018	0.095		2.78E+01		6.48E-01		0.080	
2011/4/14 0:00	-1500	-2050	-0.016	-0.020	0.095		2.77E+01		6.45E-01		0.080	
2011/4/14 6:00	-1500	-2050	-0.016	-0.021	0.095		2.76E+01		6.41E-01		0.080	
2011/4/14 12:00	-1500	-2050	-0.016	-0.021	0.090		2.74E+01		6.37E-01		0.090	
2011/4/14 18:00	-1500	-2050	-0.018	-0.020	0.090		2.73E+01		6.33E-01		0.090	
2011/4/15 0:00	-1450	-2050	-0.018	-0.023	0.090		2.71E+01		6.29E-01		0.090	
2011/4/15 6:00	-1450	-2050	-0.018	-0.025	0.090		2.70E+01		6.24E-01		0.090	
2011/4/15 12:00	-1500	-2100	-0.018	-0.023	0.090		2.69E+01		6.20E-01		0.100	
2011/4/15 18:00	-1500	-2050	-0.018	-0.023	0.090		2.68E+01	3.04E+01	6.16E-01	5.62E+01	0.100	
2011/4/16 0:00	-1500	-2100	-0.018	-0.023	0.085		2.66E+01	3.02E+01	6.12E-01	7.00E+01	0.080	
2011/4/16 6:00	-1500	-2100	-0.018	-0.023	0.090		2.65E+01	3.01E+01	6.08E-01	1.33E+02	0.080	
2011/4/16 12:00	-1500	-2100	-0.018	-0.025	0.090		2.64E+01	3.00E+01	6.08E-01	1.35E+02	0.090	
2011/4/16 18:00	-1500	-2100	-0.020	-0.025	0.085		2.63E+01	2.99E+01	6.11E-01	1.27E+02	0.070	
2011/4/17 0:00	-1500	-2100	-0.023	-0.025	0.085		2.62E+01	2.98E+01	6.08E-01	1.13E+02	0.080	
2011/4/17 6:00	-1500	-2100	-0.025	-0.025	0.085		2.61E+01	2.96E+01	6.05E-01	1.18E+02	0.070	
2011/4/17 12:00	-1500	-2100	-0.023	-0.025	0.085		2.60E+01	2.95E+01	6.00E-01	1.21E+02	0.070	
2011/4/17 18:00	-1500	-2100	-0.023	-0.025	0.085		2.59E+01	2.94E+01	5.97E-01	1.08E+02	0.070	
2011/4/18 0:00	-1500	-2100	-0.023	-0.027	0.085		2.58E+01	2.93E+01	5.92E-01	1.08E+02	0.060	
2011/4/18 6:00	-1500	-2100	-0.025	-0.029	0.085		2.57E+01	2.92E+01	5.80E-01	1.01E+02	0.100	
2011/4/18 12:00	-1500	-2100	-0.023	-0.032	0.085		2.56E+01	2.91E+01	5.84E-01	1.01E+02	0.080	
2011/4/18 13:00	-1500	-2100	-0.023	-0.032	0.085		2.56E+01	2.91E+01	5.84E-01	1.01E+02	0.080	
2011/4/18 18:00	-1500	-2100	-0.018	-0.027	0.085		2.55E+01	2.90E+01	5.78E-01	8.54E+01	0.070	
2011/4/19 0:00	-1500	-2100	-0.020	-0.029	0.085		2.54E+01	2.89E+01	5.71E-01	9.72E+01	0.080	
2011/4/19 6:00	-1500	-2100	-0.020	-0.029	0.085		2.53E+01	2.88E+01	5.68E-01	1.14E+02	0.080	
2011/4/19 12:00	-1500	-2100	-0.020	-0.029	0.085		2.53E+01	2.87E+01	5.65E-01	1.08E+02	0.070	
2011/4/19 18:00	-1500	-2100	-0.023	-0.027	0.080		2.52E+01	2.86E+01	5.64E-01	9.92E+01	0.070	
2011/4/20 0:00	-1500	-2100	-0.020	-0.027	0.080		2.51E+01	2.85E+01	5.60E-01	8.93E+01	0.100	
2011/4/20 6:00	-1500	-2100	-0.023	-0.029	0.080		2.50E+01	2.84E+01	5.55E-01	1.05E+02	0.080	
2011/4/20 12:00	-1500	-2100	-0.023	-0.029	0.080		2.49E+01	2.83E+01	5.51E-01	1.03E+02	0.090	
2011/4/20 18:00	-1500	-2100	-0.023	-0.029	0.080		2.48E+01	2.81E+01	5.47E-01	1.01E+02	0.080	
2011/4/21 0:00	-1500	-2100	-0.023	-0.029	0.080		2.47E+01	2.81E+01	5.42E-01	1.08E+02	0.080	
2011/4/21 6:00	-1500	-2050	-0.023	-0.029	0.080		2.46E+01	2.80E+01	5.38E-01	1.09E+02	0.080	
2011/4/21 12:00	-1500	-2050	-0.023	-0.025	0.085		2.46E+01	2.79E+01	5.34E-01	1.14E+02	0.050	



Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/4/21 18:00	-1500	-2050	-0.020	-0.025	0.090		2.45E+01	2.78E+01	5.30E-01	1.20E+02	0.065	
2011/4/22 0:00	-1500	-2050	-0.018	-0.023	0.085		2.44E+01	2.77E+01	5.26E-01	1.32E+02	0.072	
2011/4/22 6:00	-1500	-2100	-0.023	-0.027	0.085		2.43E+01	2.76E+01	5.22E-01	1.37E+02	0.065	
2011/4/22 12:00	-1500	-2050	-0.023	-0.027	0.085		2.42E+01	2.75E+01	5.19E-01	1.36E+02	0.080	
2011/4/22 18:00	-1500	-2050	-0.027	-0.034	0.085		2.41E+01	2.74E+01	5.17E-01	1.35E+02	0.060	
2011/4/23 0:00	-1500	-2100	-0.023	-0.027	0.085		2.41E+01	2.73E+01	5.16E-01	1.32E+02	0.080	
2011/4/23 6:00	-1500	-2100	-0.023	-0.027	0.080		2.40E+01	2.70E+01	5.12E-01	1.35E+02	0.070	
2011/4/23 12:00	-1500	-2100	-0.023	-0.025	0.080		2.39E+01	2.68E+01	5.09E-01	1.36E+02	0.070	
2011/4/23 18:00	-1500	-2050	-0.020	-0.023	0.080		2.38E+01	2.67E+01	5.06E-01	1.28E+02	0.100	
2011/4/24 0:00	-1500	-2050	-0.020	-0.020	0.080		2.37E+01	2.66E+01	5.03E-01	1.26E+02	0.100	
2011/4/24 6:00	-1500	-2050	-0.020	-0.025	0.080		2.36E+01	2.65E+01	5.00E-01	1.10E+02	0.100	
2011/4/24 12:00	-1500	-2050	-0.018	-0.025	0.080		2.36E+01	2.65E+01	4.97E-01	1.15E+02	0.080	
2011/4/24 18:00	-1500	-2050	-0.020	-0.025	0.080		2.35E+01	2.64E+01	4.96E-01	1.07E+02	0.070	
2011/4/25 0:00	-1500	-2100	-0.020	-0.027	0.080		2.34E+01	2.63E+01	4.93E-01	1.19E+02	0.060	
2011/4/25 6:00	-1450	-2100	-0.020	-0.027	0.080		2.33E+01	2.62E+01	4.90E-01	1.03E+02	0.060	
2011/4/25 11:00	-1500	-2100	-0.020	-0.025	0.080		2.32E+01	2.61E+01	4.89E-01	9.41E+01	0.050	
2011/4/25 17:00	-1500	-2100	-0.018	-0.025	0.080		2.32E+01	2.60E+01	4.86E-01	9.86E+01	0.070	
2011/4/25 23:00	-1500	-2100	-0.020	-0.025	0.080		2.31E+01	2.60E+01	4.83E-01	1.05E+02	0.050	
2011/4/26 5:00	-1500	-2100	-0.020	-0.025	0.080		2.30E+01	2.59E+01	4.80E-01	1.04E+02	0.060	
2011/4/26 11:00	-1500	-2050	-0.016	-0.025	0.080		2.29E+01	2.58E+01	4.77E-01	7.64E+01	0.070	
2011/4/26 17:00	-1500	-2100	-0.018	-0.025	0.080		2.28E+01	2.57E+01	4.76E-01	1.06E+02	0.080	
2011/4/26 23:00	-1500	-2100	-0.020	-0.027	0.075		2.27E+01	2.56E+01	4.74E-01	5.77E+01	0.080	
2011/4/27 5:00	-1500	-2100	-0.018	-0.023	0.080		2.27E+01	2.56E+01	4.72E-01	4.33E+01	0.080	
2011/4/27 11:00	-1500	-2100	-0.018	-0.025	0.075		2.26E+01	2.55E+01	4.70E-01	4.59E+01	0.060	
2011/4/27 17:00	-1500	-2100	-0.020	-0.023	0.075		2.25E+01	2.54E+01	4.67E-01	4.33E+01	0.050	
2011/4/27 23:00	-1500	-2100	-0.018	-0.020	0.075		2.25E+01	2.53E+01	4.65E-01	4.19E+01	0.080	
2011/4/28 5:00	-1500	-2100	-0.016	-0.020	0.075		2.24E+01	2.52E+01	4.63E-01	4.08E+01	0.080	
2011/4/28 11:00	-1500	-2100	-0.020	-0.023	0.075		2.23E+01	2.52E+01	4.61E-01	3.97E+01	0.040	
2011/4/28 17:00	-1500	-2100	-0.020	-0.020	0.075		2.23E+01	2.51E+01	4.60E-01	3.83E+01	0.070	
2011/4/28 23:00	-1500	-2100	-0.020	-0.023	0.075		2.22E+01	2.50E+01	4.56E-01	3.74E+01	0.060	
2011/4/29 5:00	-1500	-2100	-0.023	-0.023	0.075		2.21E+01	2.49E+01	4.54E-01	3.59E+01	0.080	
2011/4/29 11:00	-1500	-2100	-0.020	-0.023	0.075		2.21E+01	2.48E+01	4.52E-01	3.71E+01	0.080	
2011/4/29 17:00	-1500	-2100	-0.025	-0.025	0.075		2.20E+01	2.48E+01	4.49E-01	3.61E+01	0.070	
2011/4/29 23:00	-1500	-2100	-0.025	-0.023	0.075		2.20E+01	2.47E+01	4.47E-01	3.85E+01	0.070	
2011/4/30 5:00	-1500	-2100	-0.025	-0.025	0.075		2.19E+01	2.46E+01	4.44E-01	4.52E+01	0.070	
2011/4/30 11:00	-1500	-2100	-0.023	-0.020	0.075		2.18E+01	2.46E+01	4.42E-01	4.56E+01	0.080	
2011/4/30 17:00	-1500	-2100	-0.020	-0.020	0.075		2.18E+01	2.45E+01	4.39E-01	4.49E+01	0.030	
2011/4/30 23:00	-1500	-2100	-0.020	-0.020	0.075		2.17E+01	2.44E+01	4.37E-01	4.62E+01	0.050	
2011/5/1 5:00	-1500	-2100	-0.023	-0.020	0.075		2.17E+01	2.44E+01	4.34E-01	4.64E+01	0.040	
2011/5/1 11:00	-1500	-2100	-0.020	-0.020	0.075		2.16E+01	2.43E+01	4.32E-01	4.22E+01	0.050	
2011/5/1 17:00	-1500	-2100	-0.020	-0.016	0.075		2.16E+01	2.42E+01	4.31E-01	4.33E+01	0.042	
2011/5/1 23:00	-1500	-2100	-0.018	-0.018	0.070		2.15E+01	2.42E+01	4.29E-01	3.98E+01	0.045	
2011/5/2 5:00	-1500	-2100	-0.023	-0.018	0.070		2.14E+01	2.41E+01	4.27E-01	3.91E+01	0.050	
2011/5/2 11:00	-1500	-2100	-0.020	-0.018	0.070		2.14E+01	2.41E+01	4.26E-01	4.13E+01	0.042	
2011/5/2 17:00	-1500	-2100	-0.020	-0.018	0.070		2.13E+01	2.40E+01	4.25E-01	4.33E+01	0.040	
2011/5/2 23:00	-1500	-2100	-0.020	-0.018	0.070		2.13E+01	2.39E+01	4.23E-01	4.50E+01	0.040	
2011/5/3 5:00	-1500	-2100	-0.020	-0.018	0.070		2.12E+01	2.39E+01	4.21E-01	4.35E+01	0.040	
2011/5/3 11:00	-1500	-2100	-0.023	-0.018	0.070		2.12E+01	2.38E+01	4.19E-01	4.72E+01	0.040	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/5/3 17:00	-1500	-2100	-0.023	-0.016	0.070		2.11E+01	2.37E+01	4.17E-01	4.94E+01	0.050	
2011/5/3 23:00	-1500	-2100	-0.023	-0.016	0.065		2.10E+01	2.37E+01	4.15E-01	4.63E+01	0.050	
2011/5/4 5:00	-1500	-2100	-0.023	-0.018	0.065		2.10E+01	2.36E+01	4.13E-01	5.34E+01	0.040	
2011/5/4 11:00	-1500	-2100	-0.020	-0.016	0.065		2.09E+01	2.36E+01	4.11E-01	5.58E+01	0.040	
2011/5/4 17:00	-1500	-2100	-0.020	-0.016	0.065		2.09E+01	2.35E+01	4.10E-01	5.97E+01	0.050	
2011/5/4 23:00	-1500	-2100	-0.023	-0.018	0.065		2.08E+01	2.35E+01	4.08E-01	6.97E+01	0.050	
2011/5/5 5:00	-1500	-2100	-0.023	-0.018	0.065		2.07E+01	2.34E+01	4.06E-01	7.66E+01	0.050	
2011/5/5 11:00	-1500	-2100	-0.023	-0.018	0.065		2.07E+01	2.33E+01	4.05E-01	8.35E+01	0.040	
2011/5/5 17:00	-1500	-2100	-0.023	-0.018	0.065		2.06E+01	2.33E+01	4.03E-01	9.52E+01	0.040	
2011/5/5 23:00	-1500	-2100	-0.023	-0.018	0.065		2.06E+01	2.32E+01	4.02E-01	1.06E+02	0.050	
2011/5/6 5:00	-1500	-2100	-0.023	-0.018	0.065		2.05E+01	2.32E+01	4.00E-01	1.18E+02	0.050	
2011/5/6 11:00	-1500	-2100	-0.020	-0.020	0.065		2.05E+01	2.31E+01	3.99E-01	1.30E+02	0.040	
2011/5/6 17:00	-1500	-2100	-0.020	-0.018	0.065		2.04E+01	2.30E+01	3.97E-01	1.37E+02	0.040	
2011/5/6 23:00	-1500	-2100	-0.020	-0.018	0.065		2.04E+01	2.30E+01	3.95E-01	1.33E+02	0.040	
2011/5/7 5:00	-1500	-2100	-0.018	-0.020	0.065		2.03E+01	2.29E+01	3.93E-01	1.30E+02	0.040	
2011/5/7 11:00	-1500	-2100	-0.020	-0.018	0.065		2.03E+01	2.29E+01	3.91E-01	1.35E+02	0.040	
2011/5/7 17:00	-1500	-2100	-0.020	-0.018	0.060		2.03E+01	2.28E+01	3.90E-01	1.45E+02	0.040	
2011/5/7 23:00	-1500	-2100	-0.023	-0.018	0.060		2.01E+01	2.27E+01	3.88E-01	1.48E+02	0.050	
2011/5/8 5:00	-1500	-2100	-0.020	-0.018	0.060		2.01E+01	2.27E+01	3.86E-01	1.48E+02	0.050	
2011/5/8 11:00	-1500	-2100	-0.020	-0.018	0.060		2.00E+01	2.26E+01	3.86E-01	1.40E+02	0.050	
2011/5/8 17:00	-1500	-2100	-0.020	-0.016	0.060		2.00E+01	2.26E+01	3.84E-01	1.38E+02	0.050	
2011/5/8 23:00	-1500	-2100	-0.020	-0.018	0.060		2.00E+01	2.25E+01	3.83E-01	1.32E+02	0.050	
2011/5/9 5:00	-1500	-2100	-0.023	-0.020	0.060		1.99E+01	2.25E+01	3.82E-01	1.28E+02	0.055	
2011/5/9 11:00	-1500	-2100	-0.020	-0.018	0.060	0.190	1.99E+01	2.24E+01	3.80E-01	1.24E+02	0.040	
2011/5/9 17:00	-1500	-2100	-0.023	-0.020	0.060		1.98E+01	2.23E+01	3.79E-01	1.22E+02	0.035	
2011/5/9 23:00	-1500	-2100	-0.020	-0.014	0.060		1.98E+01	2.23E+01	3.78E-01	1.18E+02	0.036	
2011/5/10 5:00	-1500	-2100	-0.020	-0.016	0.060		1.97E+01	2.22E+01	3.76E-01	1.17E+02	0.035	
2011/5/10 11:00	-1500	-2100	-0.020	-0.016	0.060		1.97E+01	2.22E+01	3.76E-01	1.20E+02	0.040	
2011/5/10 17:00	-1500	-2100	-0.023	-0.016	0.055		1.96E+01	2.21E+01	3.74E-01	1.13E+02	0.035	
2011/5/10 23:00	-1500	-2100	-0.020	-0.018	0.060		1.96E+01	2.21E+01	3.72E-01	1.10E+02	0.040	
2011/5/11 5:00	-1500	-2100	-0.023	-0.018	0.060		1.95E+01	2.20E+01	3.70E-01	1.06E+02	0.035	
2011/5/11 11:00	-1500	-2100	-0.023	-0.018	0.060		1.95E+01	2.20E+01	3.68E-01	1.01E+02	0.037	
2011/5/11 17:00	-1500	-2100	-0.023	-0.020	0.060		1.95E+01	2.19E+01	3.69E-01	1.02E+02	0.040	
2011/5/11 23:00	-1500	-2100	-0.023	-0.020	0.060		1.94E+01	2.19E+01	3.68E-01	9.85E+01	0.060	
2011/5/12 5:00	-1500	-2100	-0.023	-0.020	0.055		1.94E+01	2.18E+01	3.67E-01	9.29E+01	0.040	
2011/5/12 11:00	-1500	-2100	-0.023	-0.018	0.055		1.93E+01	2.17E+01	3.66E-01	9.02E+01	0.035	
2011/5/12 17:00	-1500	-2100	-0.023	-0.018	0.055		1.93E+01	2.16E+01	3.64E-01	8.76E+01	0.040	
2011/5/12 23:00	-1500	-2100	-0.023	-0.018	0.055		1.92E+01	2.16E+01	3.63E-01	8.58E+01	0.045	
2011/5/13 5:00	-1500	-2100	-0.018	-0.018	0.055		1.92E+01	2.15E+01	3.61E-01	8.24E+01	0.030	
2011/5/13 11:00	-1500	-2100	-0.018	-0.016	0.055		1.91E+01	2.15E+01	3.60E-01	8.17E+01	0.040	
2011/5/13 17:00	-1500	-2100	-0.020	-0.016	0.055		1.91E+01	2.15E+01	3.58E-01	8.02E+01	0.040	
2011/5/13 23:00	-1500	-2100	-0.023	-0.018	0.055		1.90E+01	2.14E+01	3.57E-01	7.70E+01	0.040	
2011/5/14 5:00	-1500	-2100	-0.023	-0.018	0.055		1.90E+01	2.14E+01	3.56E-01	7.21E+01	0.040	
2011/5/14 11:00	-1500	-2100	-0.023	-0.020	0.055		1.90E+01	2.13E+01	3.53E-01	7.61E+01	0.040	
2011/5/14 17:00	-1500	-2100	-0.025	-0.018	0.055		1.89E+01	2.13E+01	3.52E-01	7.28E+01	0.040	
2011/5/14 23:00	-1500	-2100	-0.023	-0.020	0.055		1.89E+01	2.12E+01	3.50E-01	7.19E+01	0.040	
2011/5/15 5:00	-1500	-2100	-0.023	-0.020	0.055		1.88E+01	2.12E+01	3.49E-01	7.00E+01	0.040	
2011/5/15 11:00	-1500	-2100	-0.023	-0.020	0.055		1.88E+01	2.11E+01	3.47E-01	6.84E+01	0.030	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/5/15 17:00	-1500	-2100	-0.018	-0.020	0.055		1.88E+01	2.11E+01	3.47E-01	6.58E+01	0.030	
2011/5/15 23:00	-1500	-2100	-0.020	-0.020	0.055		1.87E+01	2.10E+01	3.45E-01	6.50E+01	0.030	
2011/5/16 5:00	-1500	-2100	-0.020	-0.020	0.055		1.87E+01	2.10E+01	3.43E-01	6.21E+01	0.030	
2011/5/16 11:00	-1500	-2100	-0.020	-0.020	0.055		1.86E+01	2.10E+01	3.42E-01	6.42E+01	0.040	
2011/5/16 17:00	-1500	-2100	-0.020	-0.018	0.050		1.86E+01	2.09E+01	3.41E-01	6.15E+01	0.060	
2011/5/16 23:00	-1500	-2100	-0.020	-0.018	0.050		1.86E+01	2.09E+01	3.40E-01	6.15E+01	0.070	
2011/5/17 5:00	-1500	-2100	-0.020	-0.018	0.050		1.86E+01	2.08E+01	3.38E-01	6.04E+01	0.050	
2011/5/17 11:00	-1500	-2100	-0.018	-0.016	0.050		1.86E+01	2.08E+01	3.37E-01	5.89E+01	0.050	
2011/5/17 17:00	-1500	-2100	-0.016	-0.016	0.050		1.86E+01	2.07E+01	3.35E-01	5.80E+01	0.050	
2011/5/17 23:00	-1500	-2100	-0.018	-0.018	0.050		1.85E+01	2.07E+01	3.34E-01	5.74E+01	0.050	
2011/5/18 5:00	-1500	-2100	-0.018	-0.018	0.050		1.85E+01	2.07E+01	3.34E-01	5.57E+01	0.040	
2011/5/18 11:00	-1500	-2100	-0.016	-0.018	0.050		1.85E+01	2.06E+01	3.33E-01	5.62E+01	0.040	
2011/5/18 17:00	-1500	-2100	-0.016	-0.020	0.050		1.84E+01	2.06E+01	3.31E-01	5.49E+01	0.050	
2011/5/18 23:00	-1500	-2150	-0.018	-0.023	0.050		1.84E+01	2.05E+01	3.32E-01	5.59E+01	0.030	
2011/5/19 5:00	-1500	-2100	-0.018	-0.020	0.045		1.84E+01	2.05E+01	3.31E-01	5.51E+01	0.030	
2011/5/19 11:00	-1500	-2150	-0.025	-0.025	0.045		1.83E+01	2.04E+01	3.30E-01	5.41E+01	0.040	
2011/5/19 17:00	-1500	-2100	-0.018	-0.018	0.045		1.83E+01	2.04E+01	3.29E-01	5.33E+01	0.050	
2011/5/19 23:00	-1500	-2100	-0.025	-0.023	0.045		1.83E+01	2.04E+01	3.28E-01	5.29E+01	0.040	
2011/5/20 5:00	-1500	-2100	-0.018	-0.018	0.045		1.82E+01	2.03E+01	3.27E-01	5.28E+01	0.040	
2011/5/20 11:00	-1550	-2100	-0.018	-0.018	0.045		1.82E+01	2.03E+01	3.26E-01	5.25E+01	0.040	
2011/5/20 17:00	-1500	-2100	-0.018	-0.016	0.040		1.82E+01	2.02E+01	3.24E-01	5.18E+01	0.040	
2011/5/20 23:00	-1500	-2100	-0.020	-0.018	0.040		1.81E+01	2.02E+01	3.23E-01	5.11E+01	0.040	
2011/5/21 5:00	-1500	-2100	-0.018	-0.018	0.040		1.81E+01	2.02E+01	3.22E-01	5.11E+01	0.040	
2011/5/21 11:00	-1500	-2100	-0.018	-0.016	0.040		1.81E+01	2.01E+01	3.21E-01	5.04E+01	0.040	
2011/5/21 17:00	-1500	-2100	-0.016	-0.018	0.040		1.80E+01	2.01E+01	3.20E-01	4.97E+01	0.040	
2011/5/21 23:00	-1500	-2100	-0.016	-0.016	0.040		1.80E+01	2.01E+01	3.19E-01	4.88E+01	0.025	
2011/5/22 5:00	-1500	-2100	-0.016	-0.018	0.040		1.80E+01	2.00E+01	3.18E-01	4.83E+01	0.025	
2011/5/22 11:00	-1500	-2100	-0.018	-0.020	0.040		1.79E+01	2.00E+01	3.16E-01	4.78E+01	0.025	
2011/5/22 17:00	-1500	-2100	-0.018	-0.020	0.040		1.79E+01	2.00E+01	3.15E-01	4.69E+01	0.025	
2011/5/22 23:00	-1500	-2100	-0.018	-0.020	0.040		1.79E+01	1.99E+01	3.14E-01	4.69E+01	0.025	
2011/5/23 5:00	-1500	-2100	-0.018	-0.020	0.040		1.78E+01	1.99E+01	3.13E-01	4.63E+01	0.025	
2011/5/23 11:00	-1500	-2100	-0.016	-0.020	0.040		1.78E+01	1.98E+01	3.12E-01	4.58E+01	0.025	
2011/5/23 17:00	-1500	-2100	-0.018	-0.020	0.040		1.78E+01	1.98E+01	3.11E-01	4.55E+01	0.025	
2011/5/23 23:00	-1500	-2100	-0.020	-0.020	0.040		1.77E+01	1.98E+01	3.10E-01	4.57E+01	0.025	
2011/5/24 5:00	-1500	-2100	-0.018	-0.020	0.040		1.77E+01	1.97E+01	3.09E-01	4.48E+01	0.025	
2011/5/24 11:00	-1500	-2100	-0.018	-0.020	0.040		1.77E+01	1.97E+01	3.08E-01	4.44E+01	0.025	
2011/5/24 17:00	-1500	-2100	-0.016	-0.018	0.040		1.76E+01	1.96E+01	3.07E-01	4.35E+01	0.020	
2011/5/24 23:00	-1500	-2100	-0.014	-0.020	0.040		1.76E+01	1.96E+01	3.06E-01	4.30E+01	0.020	
2011/5/25 5:00	-1500	-2100	-0.018	-0.020	0.040		1.76E+01	1.96E+01	3.05E-01	4.29E+01	0.022	
2011/5/25 9:00	-1500	-2100	-0.018	-0.020	0.040		1.76E+01	1.95E+01	3.04E-01	4.30E+01	0.020	
2011/5/25 15:00	-1500	-2100	-0.016	-0.020	0.040		1.69E+01	1.94E+01	3.02E-01	9.94E+01	0.040	
2011/5/25 17:00	-1500	-2100	-0.018	-0.020	0.035		1.71E+01	1.95E+01	3.03E-01	5.11E+01	0.040	
2011/5/25 23:00	-1500	-2150	-0.016	-0.020	0.035		1.73E+01	1.95E+01	3.01E-01	4.41E+01	0.020	
2011/5/26 5:00	-1500	-2100	-0.016	-0.018	0.035		1.74E+01	1.94E+01	3.00E-01	4.29E+01	0.020	
2011/5/26 11:00	-1500	-2100	-0.016	-0.020	0.035		1.74E+01	1.94E+01	2.99E-01	4.24E+01	0.040	
2011/5/26 17:00	-1500	-2100	-0.014	-0.018	0.035		1.73E+01	1.94E+01	2.99E-01	4.19E+01	—	
2011/5/26 23:00	-1500	-2150	-0.016	-0.016	0.035		1.73E+01	1.93E+01	3.00E-01	4.19E+01	0.020	
2011/5/27 5:00	-1500	-2100	-0.016	-0.020	0.035		1.73E+01	1.93E+01	3.00E-01	4.14E+01	0.015	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/5/27 11:00	-1500	-2100	-0.016	-0.018	0.035		1.73E+01	1.93E+01	3.01E-01	4.13E+01	0.017	
2011/5/27 17:00	-1500	-2150	-0.016	-0.018	0.035		1.72E+01	1.92E+01	3.01E-01	4.08E+01	0.014	
2011/5/27 23:00	-1500	-2150	-0.016	-0.018	0.035		1.72E+01	1.92E+01	3.00E-01	4.03E+01	0.015	
2011/5/28 5:00	-1500	-2150	-0.016	-0.018	0.035		1.72E+01	1.91E+01	3.00E-01	4.05E+01	0.013	
2011/5/28 11:00	-1500	-2150	-0.016	-0.016	0.035		1.72E+01	1.91E+01	3.00E-01	4.01E+01	0.013	
2011/5/28 17:00	-1500	-2150	-0.014	-0.014	0.035		1.71E+01	1.91E+01	2.99E-01	3.96E+01	0.015	
2011/5/28 23:00	-1500	-2150	-0.014	-0.016	0.030		1.71E+01	1.90E+01	2.99E-01	3.95E+01	0.015	
2011/5/29 5:00	-1500	-2150	-0.014	-0.014	0.030		1.71E+01	1.90E+01	2.99E-01	3.90E+01	0.015	
2011/5/29 11:00	-1500	-2150	-0.011	-0.016	0.030		1.70E+01	1.90E+01	2.98E-01	3.88E+01	0.015	
2011/5/29 14:00	-1500	-2150	-0.007	-0.007	0.035		1.70E+01	1.88E+01	2.97E-01	3.83E+01	0.015	
2011/5/29 17:00	-1500	-2150	-0.011	-0.014	0.035		1.70E+01	1.87E+01	2.96E-01	3.87E+01	0.013	
2011/5/29 20:00	-1500	-2100	-0.011	-0.009	0.030		1.70E+01	1.87E+01	2.98E-01	3.87E+01	0.014	
2011/5/29 23:00	-1500	-2100	-0.009	-0.009	0.030		1.69E+01	1.86E+01	2.99E-01	3.87E+01	0.013	
2011/5/30 1:00	-1500	-2100	-0.009	-0.009	0.035		1.69E+01	1.86E+01	3.01E-01	3.86E+01	0.015	
2011/5/30 2:00	-1500	-2100	-0.011	-0.009	0.035		1.69E+01	1.86E+01	3.01E-01	3.87E+01	0.015	
2011/5/30 3:00	-1500	-2100	-0.014	-0.009	0.035		1.68E+01	1.86E+01	3.01E-01	3.87E+01	0.014	
2011/5/30 5:00	-1500	-2150	-0.011	-0.009	0.030		1.68E+01	1.85E+01	3.03E-01	3.81E+01	0.017	
2011/5/30 8:00	-1500	-2150	-0.011	-0.009	0.030		1.68E+01	1.85E+01	3.04E-01	3.80E+01	0.015	
2011/5/30 11:00	-1500	-2100	-0.014	-0.011	0.030		1.67E+01	1.84E+01	3.05E-01	3.76E+01	0.015	
2011/5/30 14:00	-1500	-2100	-0.014	-0.011	0.030		1.67E+01	1.84E+01	3.06E-01	3.72E+01	0.015	
2011/5/30 17:00	-1500	-2100	-0.014	-0.011	0.030		1.67E+01	1.84E+01	3.06E-01	3.73E+01	0.020	
2011/5/30 20:00	-1500	-2100	-0.014	-0.014	0.030		1.66E+01	1.84E+01	3.06E-01	3.70E+01	0.014	
2011/5/30 23:00	-1500	-2100	-0.016	-0.016	0.030		1.66E+01	1.84E+01	3.06E-01	3.73E+01	0.015	
2011/5/31 2:00	-1500	-2100	-0.014	-0.014	0.030		1.66E+01	1.83E+01	3.06E-01	3.72E+01	0.014	
2011/5/31 5:00	-1500	-2100	-0.014	-0.014	0.030		1.66E+01	1.83E+01	3.06E-01	3.72E+01	0.014	
2011/5/31 8:00	-1500	-2100	-0.014	-0.014	0.030		1.66E+01	1.83E+01	3.07E-01	3.72E+01	0.017	
2011/5/31 11:00	-1500	-2100	-0.014	-0.014	0.030		1.65E+01	1.82E+01	3.07E-01	3.71E+01	0.020	
2011/5/31 14:00	-1500	-2100	-0.018	-0.016	0.030		1.65E+01	1.82E+01	3.07E-01	3.70E+01	0.016	
2011/5/31 17:00	-1500	-2100	-0.016	-0.014	0.030		1.65E+01	1.82E+01	3.07E-01	3.70E+01	0.013	
2011/5/31 20:00	-1500	-2100	-0.014	-0.014	0.030		1.64E+01	1.82E+01	3.08E-01	3.73E+01	0.015	
2011/5/31 23:00	-1500	-2100	-0.016	-0.016	0.030		1.63E+01	1.81E+01	3.08E-01	3.64E+01	0.013	
2011/6/1 2:00	-1500	-2100	-0.014	-0.014	0.030		1.62E+01	1.81E+01	3.08E-01	3.61E+01	0.013	
2011/6/1 5:00	-1500	-2100	-0.016	-0.016	0.030		1.62E+01	1.81E+01	3.08E-01	3.60E+01	0.015	
2011/6/1 8:00	-1500	-2100	-0.016	-0.014	0.030		1.62E+01	1.80E+01	3.08E-01	3.55E+01	0.017	
2011/6/1 11:00	-1500	-2100	-0.016	-0.014	0.030		1.61E+01	1.80E+01	3.08E-01	3.54E+01	0.013	
2011/6/1 14:00	-1500	-2100	-0.016	-0.014	0.030		1.61E+01	1.80E+01	3.08E-01	3.51E+01	0.018	
2011/6/1 17:00	-1500	-2100	-0.016	-0.016	0.030		1.62E+01	1.80E+01	3.08E-01	3.50E+01	0.013	
2011/6/1 20:00	-1500	-2100	-0.016	-0.016	0.030		1.62E+01	1.79E+01	3.08E-01	3.49E+01	0.013	
2011/6/1 23:00	-1500	-2100	-0.018	-0.018	0.030		1.61E+01	1.79E+01	3.08E-01	3.48E+01	0.015	
2011/6/2 2:00	-1500	-2100	-0.016	-0.016	0.030		1.61E+01	1.79E+01	3.08E-01	3.44E+01	0.015	
2011/6/2 5:00	-1500	-2100	-0.018	-0.016	0.030		1.61E+01	1.79E+01	3.07E-01	3.44E+01	0.013	
2011/6/2 8:00	-1500	-2100	-0.018	-0.018	0.030		1.61E+01	1.78E+01	3.07E-01	3.44E+01	0.014	
2011/6/2 11:00	-1500	-2100	-0.016	-0.016	0.030		1.60E+01	1.78E+01	3.08E-01	3.42E+01	0.014	
2011/6/2 14:00	-1500	-2100	-0.016	-0.016	0.030		1.60E+01	1.78E+01	3.08E-01	3.50E+01	0.014	
2011/6/2 17:00	-1500	-2100	-0.014	-0.014	0.030		1.60E+01	1.78E+01	3.08E-01	3.65E+01	0.014	
2011/6/2 20:00	-1500	-2100	-0.018	-0.016	0.030		1.60E+01	1.78E+01	3.08E-01	3.41E+01	0.013	
2011/6/2 23:00	-1500	-2100	-0.018	-0.016	0.030		1.60E+01	1.77E+01	3.08E-01	3.36E+01	0.012	
2011/6/3 2:00	-1500	-2100	-0.014	-0.016	0.030		1.59E+01	1.77E+01	3.08E-01	3.36E+01	0.014	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A) (mm)	reactor water level(fuel range)(B) (mm)	A system/ reactor pressure (MPa)	B system/ reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/6/3 5:00	-1500	-2100	-0.018	-0.018	0.030		1.59E+01	1.77E+01	3.09E-01	3.34E+01	0.013	
2011/6/3 8:00	-1500	-2100	-0.016	-0.018	0.030		1.59E+01	1.77E+01	3.09E-01	3.32E+01	0.014	
2011/6/3 11:00	-1500	-2100	-0.016	-0.016	0.030		1.59E+01	1.76E+01	3.09E-01	3.31E+01	0.013	
2011/6/3 13:30	-1500	-2100	-0.014	-0.014	0.030		1.59E+01	1.76E+01	3.09E-01	3.31E+01	0.020	
2011/6/3 14:30	-1500	-2100	-0.014	-0.014	0.030		1.59E+01	1.76E+01	3.09E-01	3.29E+01	0.020	
2011/6/3 17:00	-1500	-2100	-0.016	-0.016	0.030		1.58E+01	1.76E+01	3.10E-01	3.27E+01	0.020	
2011/6/3 20:00	-1500	-2100	-0.014	-0.014	0.030		1.58E+01	1.76E+01	3.09E-01	3.28E+01	0.010	
2011/6/3 23:00	-1500	-2100	-0.014	-0.014	0.030		1.58E+01	1.76E+01	3.07E-01	3.26E+01	0.012	
2011/6/4 2:00	-1500	-2100	-0.011	-0.011	0.030		1.58E+01	1.75E+01	3.05E-01	3.30E+01	0.013	
2011/6/4 5:00	-1500	-2100	-0.011	-0.011	0.030		1.57E+01	1.75E+01	3.04E-01	3.28E+01	0.017	
2011/6/4 8:00	-1500	-2100	-0.014	-0.014	0.030		1.57E+01	1.75E+01	3.04E-01	3.23E+01	0.016	
2011/6/4 11:00	-1500	-2100	-0.011	-0.011	0.030		1.57E+01	1.75E+01	3.05E-01	3.38E+01	0.020	
2011/6/4 14:00	-1500	-2100	-0.014	-0.014	0.030		1.57E+01	1.74E+01	3.06E-01	3.17E+01	0.013	
2011/6/4 17:00	-1500	-2100	-0.014	-0.014	0.030		1.57E+01	1.74E+01	3.07E-01	3.11E+01	0.012	
2011/6/4 20:00	-1500	-2100	-0.011	-0.011	0.030		1.57E+01	1.74E+01	3.07E-01	3.08E+01	0.016	
2011/6/4 23:00	-1500	-2100	-0.011	-0.011	0.025		1.56E+01	1.74E+01	3.06E-01	3.06E+01	0.016	
2011/6/5 2:00	-1500	-2100	-0.011	-0.011	0.025		1.56E+01	1.74E+01	3.06E-01	3.03E+01	0.020	
2011/6/5 5:00	-1500	-2100	-0.011	-0.011	0.025		1.56E+01	1.73E+01	3.05E-01	3.01E+01	0.019	
2011/6/5 8:00	-1500	-2100	-0.014	-0.011	0.025		1.56E+01	1.73E+01	3.05E-01	3.00E+01	0.012	
2011/6/5 11:00	-1500	-2100	-0.011	-0.009	0.025		1.56E+01	1.73E+01	3.05E-01	3.00E+01	0.013	
2011/6/5 14:00	-1500	-2100	-0.011	-0.009	0.025		1.56E+01	1.73E+01	3.04E-01	2.98E+01	0.015	
2011/6/5 17:00	-1500	-2100	-0.014	-0.011	0.025		1.56E+01	1.73E+01	3.04E-01	2.97E+01	0.014	
2011/6/5 20:00	-1500	-2150	-0.011	-0.009	0.025		1.55E+01	1.73E+01	3.03E-01	2.97E+01	0.017	
2011/6/5 23:00	-1500	-2100	-0.014	-0.011	0.025		1.55E+01	1.72E+01	3.03E-01	2.95E+01	0.013	
2011/6/6 2:00	-1500	-2100	-0.016	-0.014	0.025		1.55E+01	1.72E+01	3.03E-01	2.95E+01	0.025	
2011/6/6 5:00	-1500	-2100	-0.016	-0.011	0.025		1.55E+01	1.72E+01	3.03E-01	2.94E+01	0.015	
2011/6/6 8:00	-1500	-2100	-0.014	-0.011	0.025		1.55E+01	1.72E+01	3.02E-01	2.93E+01	0.016	
2011/6/6 11:00	-1500	-2100	-0.011	-0.011	0.025		1.55E+01	1.72E+01	3.02E-01	2.91E+01	0.015	
2011/6/6 14:00	-1500	-2100	-0.009	-0.009	0.025		1.55E+01	1.71E+01	3.01E-01	2.89E+01	0.015	
2011/6/6 17:00	-1500	-2100	-0.011	-0.011	0.025		1.54E+01	1.71E+01	3.01E-01	2.89E+01	0.014	
2011/6/6 20:00	-1500	-2100	-0.014	-0.011	0.025		1.54E+01	1.71E+01	3.00E-01	2.87E+01	0.014	
2011/6/6 23:00	-1500	-2100	-0.011	-0.009	0.025		1.54E+01	1.71E+01	3.00E-01	2.86E+01	0.014	
2011/6/7 2:00	-1500	-2100	-0.014	-0.011	0.025		1.54E+01	1.71E+01	3.00E-01	2.83E+01	0.014	
2011/6/7 5:00	-1500	-2100	-0.011	-0.009	0.025		1.54E+01	1.71E+01	2.99E-01	2.82E+01	0.015	
2011/6/7 8:00	-1500	-2100	-0.011	-0.009	0.025		1.54E+01	1.71E+01	2.99E-01	2.81E+01	0.015	
2011/6/7 11:00	-1500	-2100	-0.014	-0.011	0.025		1.54E+01	1.70E+01	2.98E-01	2.79E+01	0.020	
2011/6/7 14:00	-1500	-2100	-0.016	-0.009	0.025		1.54E+01	1.70E+01	2.98E-01	2.78E+01	0.014	
2011/6/7 17:00	-1500	-2100	-0.016	-0.009	0.025		1.53E+01	1.70E+01	2.97E-01	2.76E+01	0.017	
2011/6/7 20:00	-1500	-2100	-0.016	-0.009	0.025		1.53E+01	1.70E+01	2.97E-01	2.74E+01	0.013	
2011/6/7 23:00	-1500	-2100	-0.016	-0.011	0.025		1.53E+01	1.70E+01	2.96E-01	2.73E+01	0.015	
2011/6/8 2:00	-1500	-2100	-0.016	-0.011	0.020		1.53E+01	1.70E+01	2.96E-01	2.71E+01	0.013	
2011/6/8 5:00	-1500	-2100	-0.016	-0.011	0.020		1.53E+01	1.69E+01	2.96E-01	2.70E+01	0.015	
2011/6/8 8:00	-1500	-2100	-0.014	-0.011	0.020		1.53E+01	1.69E+01	2.95E-01	2.70E+01	0.015	
2011/6/8 11:00	-1500	-2100	-0.014	-0.011	0.020		1.53E+01	1.69E+01	2.94E-01	2.70E+01	0.014	
2011/6/8 14:00	-1500	-2100	-0.014	-0.011	0.020		1.52E+01	1.69E+01	2.94E-01	2.68E+01	0.016	
2011/6/8 18:00	-1500	-2100	-0.014	-0.011	0.020		1.48E+01	1.69E+01	2.93E-01	4.30E+01	0.014	Instruments are under investigation (CAMS S/C(B))
2011/6/8 20:00	-1500	-2100	-0.014	-0.011	0.020		1.50E+01	1.69E+01	2.94E-01	2.93E+01	0.019	Instruments are under investigation (CAMS S/C(B))
2011/6/8 23:00	-1500	-2100	-0.014	-0.011	0.020		1.50E+01	1.69E+01	2.93E-01	2.77E+01	0.016	Instruments are under investigation (CAMS S/C(B))
2011/6/9 2:00	-1500	-2100	-0.016	-0.011	0.020		1.51E+01	1.68E+01	2.93E-01	2.72E+01	0.016	Instruments are under investigation (CAMS S/C(B))

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	reactor water level(fuel range)(A)(mm)	reactor water level(fuel range)(B)(mm)	A system/reactor pressure (MPa)	B system/reactor pressure (MPa)	D/W pressure (MPa abs)	S/C pressure (MPa abs)	CAMS D/W(A) (Sv/h)	CAMS D/W(B) (Sv/h)	CAMS S/C(A) (Sv/h)	CAMS S/C(B) (Sv/h)	radiation dose in main control room(mSv/h)	note
2011/6/9 5:00	-1500	-2100	-0.016	-0.011	0.020		1.51E+01	1.68E+01	2.92E-01	2.70E+01	0.012	Instruments are under investigation (CAMS S/C(B))
2011/6/9 8:00	-1500	-2100	-0.016	-0.009	0.020		1.51E+01	1.68E+01	2.91E-01	2.67E+01	0.013	Instruments are under investigation (CAMS S/C(B))
2011/6/9 11:00	-1500	-2100	-0.016	-0.009	0.020		1.51E+01	1.68E+01	2.91E-01	3.47E+01	0.015	Instruments are under investigation (CAMS S/C(B))
2011/6/9 14:00	-1500	-2100	-0.011	-0.007	0.020		1.51E+01	1.68E+01	2.90E-01	2.65E+01	0.013	Instruments are under investigation (CAMS S/C(B))
2011/6/9 17:00	-1500	-2100	-0.011	-0.005	0.020		1.51E+01	1.68E+01	2.90E-01	2.64E+01	0.013	Instruments are under investigation (CAMS S/C(B))
2011/6/9 20:00	-1500	-2100	-0.014	-0.009	0.020		1.51E+01	1.67E+01	2.89E-01	2.63E+01	0.013	Instruments are under investigation (CAMS S/C(B))
2011/6/9 23:00	-1500	-2150	-0.014	-0.009	0.020		1.51E+01	1.67E+01	2.88E-01	2.61E+01	0.012	Instruments are under investigation (CAMS S/C(B))
2011/6/10 2:00	-1500	-2150	-0.014	-0.009	0.020		1.50E+01	1.67E+01	2.88E-01	2.62E+01	0.015	Instruments are under investigation (CAMS S/C(B))
2011/6/10 5:00	-1500	-2100	-0.014	-0.009	0.020		1.50E+01	1.67E+01	2.87E-01	2.60E+01	0.012	Instruments are under investigation (CAMS S/C(B))
2011/6/10 8:00	-1500	-2100	-0.016	-0.009	0.020		1.50E+01	1.67E+01	2.87E-01	2.59E+01	0.013	Instruments are under investigation (CAMS S/C(B))
2011/6/10 11:00	-1500	-2100	-0.014	-0.007	0.020		1.50E+01	1.67E+01	2.86E-01	2.60E+01	0.013	Instrument failure - CAMS S/C(B) radiation monitor
2011/6/10 14:00	-1500	-2100	-0.009	-0.007	0.020		1.50E+01	1.66E+01	2.85E-01	2.60E+01	0.014	
2011/6/10 17:00	-1500	-2100	-0.014	-0.007	0.015		1.50E+01	1.66E+01	2.85E-01	2.58E+01	0.014	
2011/6/10 20:00	-1500	-2100	-0.014	-0.007	0.015		1.50E+01	1.66E+01	2.84E-01	2.57E+01	0.013	
2011/6/10 23:00	-1500	-2100	-0.016	-0.009	0.015		1.50E+01	1.66E+01	2.84E-01	2.55E+01	0.013	
2011/6/11 2:00	-1500	-2100	-0.014	-0.009	0.015		1.50E+01	1.66E+01	2.84E-01	2.55E+01	0.013	
2011/6/11 5:00	-1500	-2100	-0.014	-0.009	0.015		1.49E+01	1.66E+01	2.83E-01	2.54E+01	0.013	
2011/6/11 8:00	-1500	-2100	-0.016	-0.009	0.015		1.49E+01	1.66E+01	2.82E-01	2.52E+01	0.013	
2011/6/11 11:00	-1500	-2100	-0.016	-0.007	0.015		1.49E+01	1.65E+01	2.82E-01	2.51E+01	0.013	
2011/6/11 14:00	-1500	-2100	-0.016	-0.007	0.015		1.49E+01	1.65E+01	2.81E-01	2.51E+01	0.013	
2011/6/11 17:00	-1500	-2100	-0.016	-0.007	0.015		1.49E+01	1.65E+01	2.80E-01	2.50E+01	0.013	
2011/6/11 20:00	-1500	-2100	-0.016	-0.005	0.015		1.49E+01	1.65E+01	2.80E-01	2.50E+01	0.013	
2011/6/11 23:00	-1500	-2100	-0.016	-0.005	0.015		1.49E+01	1.65E+01	2.79E-01	2.49E+01	0.013	
2011/6/12 2:00	-1500	-2100	-0.016	-0.005	0.015		1.48E+01	1.65E+01	2.79E-01	2.49E+01	0.013	
2011/6/12 5:00	-1500	-2100	-0.016	-0.005	0.015		1.48E+01	1.65E+01	2.78E-01	2.48E+01	0.014	
2011/6/12 8:00	-1500	-2100	-0.016	-0.005	0.015		1.48E+01	1.65E+01	2.77E-01	2.48E+01	0.013	
2011/6/12 11:00	-1500	-2100	-0.016	-0.005	0.015		1.47E+01	1.64E+01	2.77E-01	2.48E+01	0.013	
2011/6/12 14:00	-1500	-2100	-0.016	-0.005	0.015		1.47E+01	1.64E+01	2.76E-01	2.48E+01	0.013	
2011/6/12 17:00	-1500	-2100	-0.018	-0.005	0.015		1.47E+01	1.64E+01	2.75E-01	2.48E+01	0.010	
2011/6/12 20:00	-1500	-2100	-0.014	-0.002	0.015		1.47E+01	1.64E+01	2.75E-01	2.48E+01	0.014	
2011/6/12 23:00	-1500	-2100	-0.014	-0.002	0.015		1.47E+01	1.64E+01	2.74E-01	2.46E+01	0.013	
2011/6/13 2:00	-1500	-2100	-0.016	-0.005	0.015		1.47E+01	1.64E+01	2.73E-01	2.45E+01	0.017	
2011/6/13 5:00	-1500	-2100	-0.014	-0.002	0.015		1.47E+01	1.64E+01	2.73E-01	2.46E+01	0.015	
2011/6/13 8:00	-1500	-2100	-0.011	-0.002	0.015		1.46E+01	1.63E+01	2.72E-01	2.47E+01	0.012	
2011/6/13 11:00	-1500	-2100	-0.014	-0.007	0.015		1.46E+01	1.63E+01	2.71E-01	2.48E+01	0.017	
2011/6/13 14:00	-1500	-2100	-0.014	-0.005	0.015		1.46E+01	1.63E+01	2.71E-01	2.47E+01	0.014	
2011/6/13 17:00	-1500	-2100	-0.014	-0.005	0.015		1.46E+01	1.63E+01	2.70E-01	2.47E+01	0.013	
2011/6/13 20:00	-1500	-2100	-0.016	-0.002	0.015		1.46E+01	1.63E+01	2.70E-01	2.45E+01	0.012	
2011/6/13 23:00	-1500	-2100	-0.018	-0.005	0.015		1.46E+01	1.63E+01	2.69E-01	2.38E+01	0.015	
2011/6/14 2:00	-1500	-2100	-0.014	-0.005	0.015		1.74E+01	1.63E+01	2.69E-01	2.42E+01	0.014	
2011/6/14 5:00	-1500	-2100	-0.011	-0.005	0.015		1.47E+01	1.62E+01	2.68E-01	2.42E+01	0.014	