
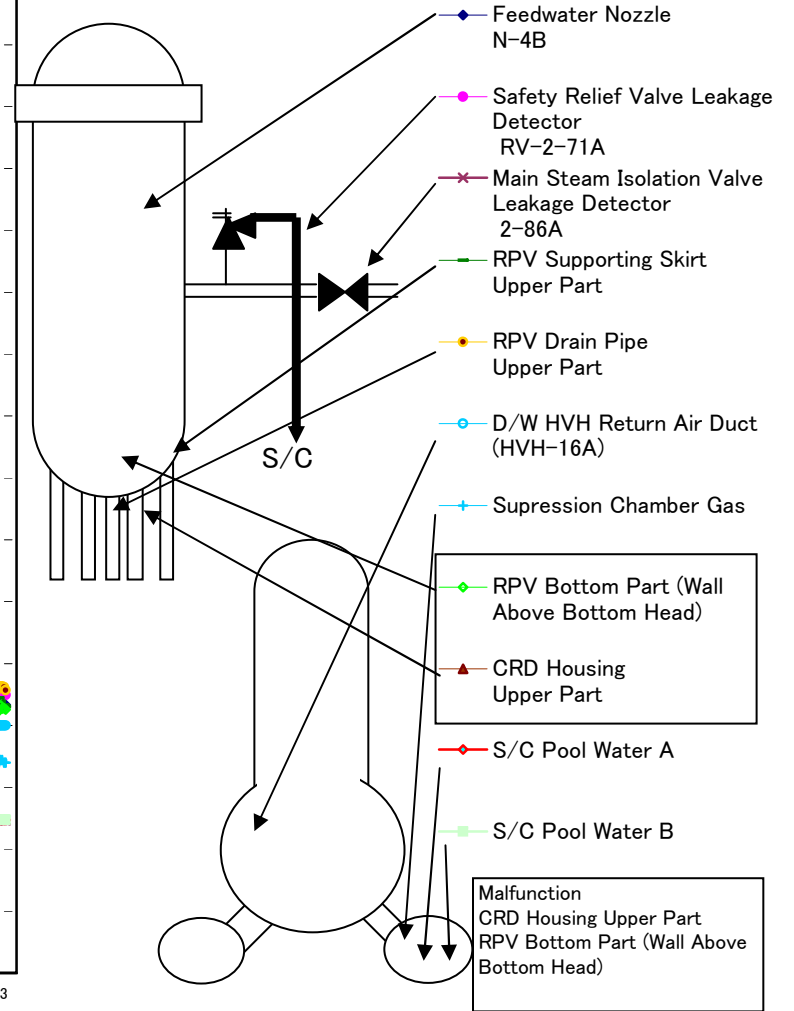


Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature (Typical Points)

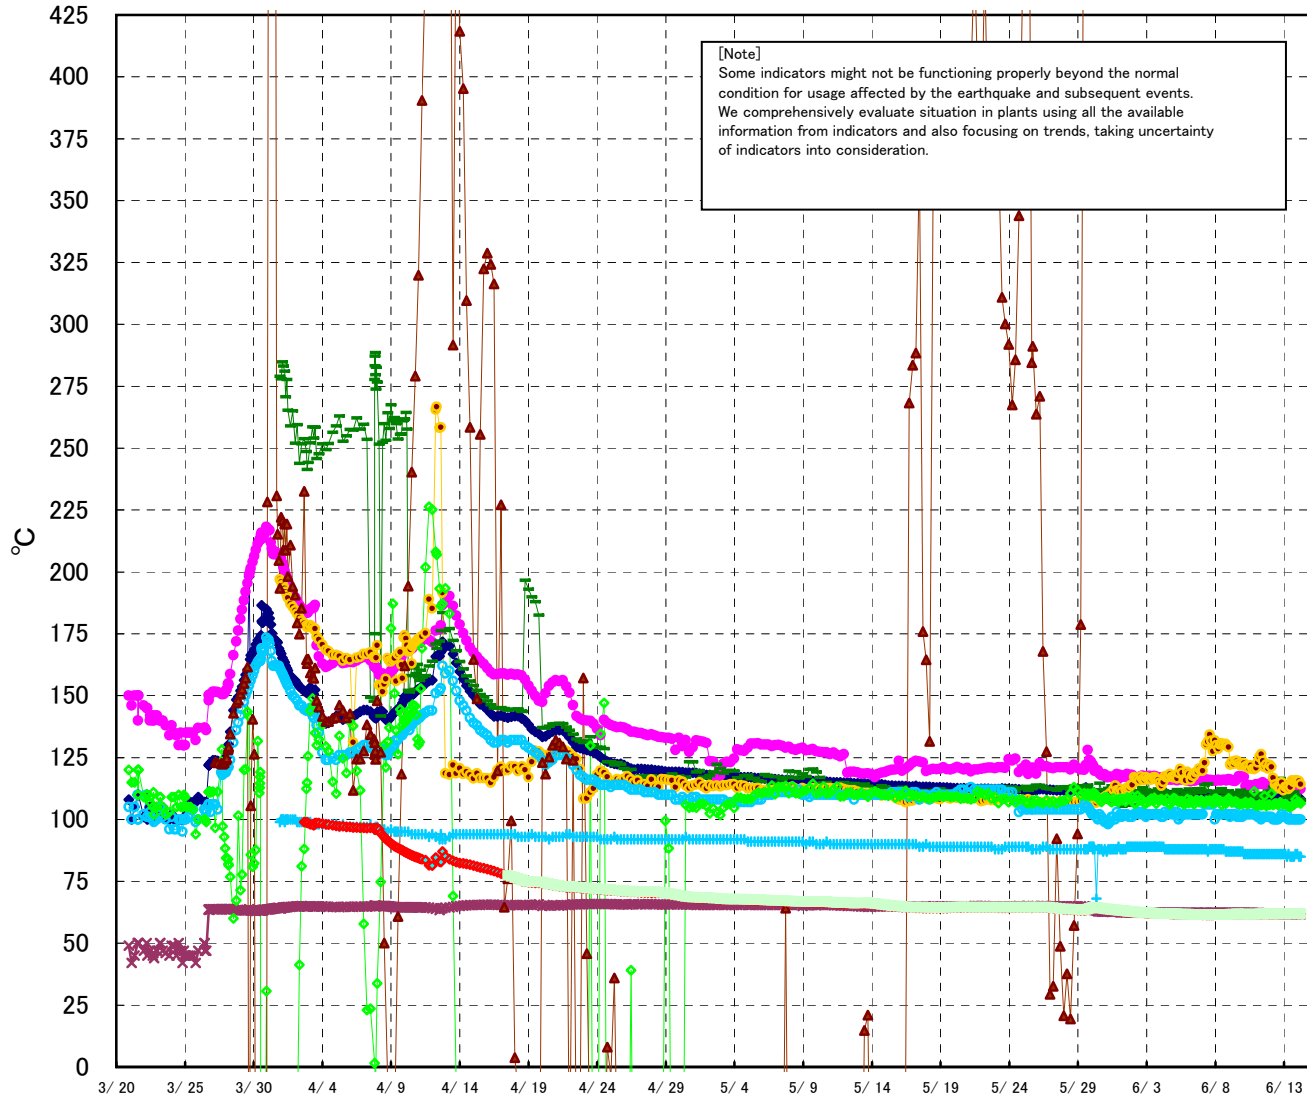

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
3/20 22:00	150	49	108		120			105					
3/21 3:00	146	42	100		115			100					
3/21 8:00	150	45	105		115			105					
3/21 13:30	150	50	110		120			110					
3/21 14:00	140	50	110		110			100					
3/21 14:25	150	50	110		120			100					
3/21 14:30	150	50	110		120			100					
3/22 0:15	146	47	101		109			102					
3/22 5:00	145	50	110		110			110					
3/22 6:00	145	45	100		110			101					
3/22 10:30	140	47	105		107			101					
3/22 11:20	142	47	105		109			103					
3/22 15:30	140	45	100		105			100					
3/22 17:00	142	46	102		111			100					
3/22 18:00	140	44	102		102			99					
3/22 23:00	142	47	105		105			100					
3/23 4:20	140	50	102		109			105					
3/23 4:40	140	50	102		109			105					
3/23 9:00	140	47	105		105			101					
3/23 14:00	138	46	101		102			100					
3/23 21:00	134	45	100		103			96					
3/24 1:00	138	49	102		109			101					
3/24 5:00	135	49	100		109			96					
3/24 9:00	134	45	100		105			96					
3/24 13:00	130	50	100		110			100					
3/24 17:00	135	47	100		105			100					
3/24 20:00	130	42	100		105			95					
3/24 22:00	130	47	100		110			100					
3/24 22:30	130	45	101		109			100					
3/25 0:00	130	45	104		109			100					
3/25 2:00	135	45	105		105			100					
3/25 6:00	135	45	105		105			101					
3/25 10:00	135	45	107		105			104					
3/25 14:00	135	45	107		104			104					
3/25 18:30	132	42	107		94			99					
3/25 23:00	137	47	109		100			100					
3/26 9:30	137	50	107		100			104					
3/26 10:21	137	50	107		100			104					
3/26 10:40	137	47	107		100			104					
3/26 13:00	136	47	107		99			103					
3/26 17:30	148.1	63.6	121.8		111.1			106					
3/26 17:50	150.1	63.5	121.9		111.1			106					
3/26 18:00	150.1	63.5	122.0		111.1			106					
3/26 18:10	150.1	63.5	122.0		111.1			106					
3/26 18:30	150.2	63.6	122.1		111.2			106					
3/26 19:00	150.2	63.6	122.2		111.4			106					
3/26 21:00	150.7	63.7	123.0		111.0			103					
3/27 1:00	151.6	63.8	123.9		111.2			106					
3/27 5:00	151.6	63.7	123.9	123.3	96.6			106					
3/27 9:00	151.4	63.7	123.6	122.9	111.2			104					
3/27 15:30	150.8	63.8	123.2	122.6	123.4			119					
3/27 16:20	150.8	63.8	123.1	122.5	128.3			119					
3/27 17:50	150.6	63.8	123.0	122.4	97.3			118					
3/27 20:20	150.7	63.8	123.6	122.9	93.0			119					

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
3/27 22:00	151.5	63.8	124.6	123.9	88.4			119					
3/28 0:00	152.1	63.8	124.8	124.1	84.4			119					
3/28 0:55	152.4	63.8	125.5	124.8	84.4			120					
3/28 3:00	154.5	63.8	129.0	128.2	84.0			121					
3/28 3:30	154.9	63.8	129.6	128.7	82.0			121					
3/28 4:00	154.3	63.8	130.3	129.4	81.5			121					
3/28 7:00	158.7	63.7	135.4	134.5	76.8			124					
3/28 12:30	166.3	63.7	144.1	142.9	60.0			131					
3/28 17:30	171.9	63.4	148.3	147.0	67.3			136					
3/28 21:00	176.3	63.5	149.5	148.2	101.5			139					
3/29 1:00	180.9	63.4	152.0	150.7	71.4			142					
3/29 4:00	184.7	63.3	153.7	152.6	77.7			144.5					
3/29 7:00	188.5	63.2	156.2	154.9	120.0			147.5					
3/29 10:00	191.9	63.2	158.5	157.2	120.3			150					
3/29 13:00	195.4	63.2	160.5	161.6	143.6			152					
3/29 16:00	198.6	63.7	198.2	-126.8	141.6			154					Instrument failure - temperature at upper CRD housing
3/29 17:30	200.0		164.7										
3/29 19:00	201.4	63.3	166.3	105.5	85.7			156					
3/29 22:00	204.0	63.3	167.4	140.5	80.8			158					
3/30 1:00	206.3	63.3	168.6	126.3	82.2			160					
3/30 4:00	208.9	63.0	170.7	-126.2	87.7			162					
3/30 7:00	211.4	63.2	172.4	-126.0	131.6			163.5					
3/30 10:00	212.6	63.3	172.9	-126.0	110.7			164					
3/30 10:30	212.8	63.3	173.0	-126.0	112.8			164					
3/30 10:50	212.9	63.3	173.0	-99.2	114.6			164					
3/30 11:10	213.0	63.2	173.0	-125.9	117.2			164					
3/30 11:30	213.3	63.3	173.3	-125.6	119.1			164					
3/30 13:00	215.0	63.3	174.3	-125.9	-125.7			165					Instrument failure - temperature at PPV bottom
3/30 14:00	215.8	63.4	186.5	-125.9	-125.7			169					
3/30 14:20	215.4	63.3	180.2	-125.8	-125.6			169					
3/30 14:40	214.9	63.3	179.9	-125.8	-125.6			168					
3/30 15:00	214.4	63.4	179.7	-125.7	-125.6			168					
3/30 15:20	214.0	63.4	179.5	-125.7	-102.3			168					
3/30 16:00	213.5	63.4	179.6	-125.7	-45.2			168					
3/30 18:00	214.6	63.5	180.6	-125.6	-125.5			168					
3/30 18:30	214.9	63.5	180.7	-125.6	-125.5			168					
3/30 22:00	218.2	63.6	184.9	-125.5	30.6			173.5					
3/31 0:00	217.2	63.6	183.0	228.3	-125.3			172					
3/31 2:00	217.1	63.6	183.4	561.6	-125.2			172.5					
3/31 4:00	216.8	63.7	181.2	561.7	-125.2			171					
3/31 6:00	211.8	63.8	178.7	561.7	-125.1			168					
3/31 8:00	209.4	63.9	175.3	561.7	-125.0			164					
3/31 10:00	207.2	64.0	173.4	556.6	-124.9			162					
3/31 12:00	207.1	64.0	172.4	561.7	-124.9			162					
3/31 14:00	208.1	64.2	172.2	561.7	-125.0			162					
3/31 16:00	207.7	64.2	172.0	230.7	-125.0			162					
3/31 18:00	207.3	64.3	171.5	215.2	-124.9			162					
3/31 20:00	207.1	64.3	169.0	204.6	-124.8			162					
3/31 22:00	206.2	64.0	168.0	193.3	-124.7	279.0	197.0	161		99			
4/1 0:00	205.4	64.0	167.0	222.1	-124.6	278.0	196.0	160		100			
4/1 2:00	203.6	64.4	165.3	220.6	-124.5	284.8	194.7	159		100			
4/1 4:00	201.9	64.4	164.4	208.9	-124.4	283.1	194.5	158		100			
4/1 6:00	200.5	64.4	163.5	219.4	-124.4	281.1	193.3	157		99			
4/1 8:00	199.0	64.5	162.1	208.7	-124.3	270.7	192.0	156		100			

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
4/1 10:00	197.7	64.6	161.0	219.3	-124.5	277.7	190.7	155		100			
4/1 12:00	196.3	64.7	160.1	198.2	-124.5	265.3	189.5	154		100			
4/1 16:00	193.7	64.7	158.1	210.8	-125.3	258.9	187.1	152		100			
4/1 20:00	191.7	64.8	156.9	194.1	-114.0	265.0	185.9	150		100			
4/2 0:30	189.8	64.8	156.1	190.6	-61.4	251.9	184.4	149		100			
4/2 4:00	188.3	64.9	155.0	179.4	-30.6	259.4	183.1	148		99			
4/2 8:00	186.6	64.9	153.7	174.9	41.3	243.8	181.6	146		99			
4/2 12:00	185.3	65.0	152.9	185.3	81.1	251.7	180.3	146		99			
4/2 16:30	183.9	64.9	151.9	232.5	88.1	253.7	179.3	144.5		99	98.9		
4/2 20:00	183.6	64.8	151.3	164.5	112.4	248.6	178.2	144		99	98.8		
4/2 21:23	183.4	64.8	151.1	162.9	114.8	241.4	177.7	144		99	98.7		
4/2 23:00	183.5	64.8	151.7	164.8	125.6	244.2	177.8	144		99	98.5		
4/3 3:00	185.0	64.9	153.4	159.2	144.0	252.1	178.5	145		99	98.1		
4/3 7:00	185.6	64.8	151.0	157.6	148.9	258.6	177.9	142		98	98.1		
4/3 9:00	185.4	64.8	150.5	157.0	146.1	254.0	176.8	141		98	97.6		
4/3 11:30	186.6	64.8	152.3	161.1	134.9	258.4	177.1	143		98	98.5		
4/3 14:00	170.3	64.9	144.5	148.1	130.0	245.7	173.8	138		98	98.5		
4/3 18:00	165.8	64.9	143.6	145.4	132.3	247.7	172.6	135		98	98.5		
4/4 0:00	163.0	64.9	140.3	141.6	138.2	251.7	170.6	127		98	98.3		
4/4 6:00	161.5	64.8	138.8	139.6	129.5	249.3	168.5	124		98	98.1		
4/4 11:00	162.1	64.7	139.0	139.6	127.7	251.8	168.0	124		98	97.9		
4/4 18:00	163.0	64.7	140.5	140.8	115.2	256.3	166.4	125		98	97.6		
4/5 0:00	164.2	64.7	141.7	141.2	110.5	258.9	166.4	124		98	97.4		
4/5 6:00	164.3	64.6	141.7	146.2	133.7	263.0	166.0	126		97	97.3		
4/5 12:00	163.1	64.7	140.3	143.9	124.7	252.7	164.1	126		98	97.2		
4/5 18:00	163.4	64.8	140.7	141.1	118.7	254.9	165.2	126		97	97.0		
4/6 0:00	163.6	64.7	140.9	142.6	139.6	257.5	164.5	127		97	97.0		
4/6 6:00	163.5	64.7	141.6	111.8	137.7	257.3	131.1	127		97	96.7		
4/6 12:00	164.1	64.8	142.5	124.4	119.6	262.2	165.3	128		97	96.8		
4/6 18:00	165.0	64.8	143.6	124.4	111.8	257.7	165.7	129		97	96.6		
4/7 0:00	165.6	64.8	144.2	127.6	57.8	259.6	166.8	130		97	96.6		
4/7 6:00	165.5	64.8	144.2	138.2	23.0	253.5	166.8	130		97	96.5		
4/7 12:00	164.2	64.9	143.6	134.3	23.6	149.3	167.5	129		98	96.6		
4/7 18:00	162.3	65.0	141.5	132.5		147.7	165.7	128		96	96.5		
4/7 19:00	162.0	65.0	141.4	131.0	1.5	175.0	165.5	128			96.3		
4/7 19:20	161.9	65.0	141.3	126.4		277.7	165.5	128		96	96.2		
4/7 19:40	161.9	65.0	141.2	126.4		287.1	165.5	128		96	96.2		
4/7 20:00	161.8	65.0	141.2	126.4		283.3	165.4	128		96	96.1		
4/7 20:30	161.7	65.0	141.2	127.6		288.6	165.4	128		96	96.1		
4/7 21:00	161.5	65.0	141.0	124.3	-6.5	279.6	165.3	128		97	96.0		
4/7 21:30	161.5	65.0	141.0			273.8	165.3	128			95.9		
4/7 22:00	161.5	65.0	141.0			282.6	165.3	128			95.8		
4/8 0:00	160.6	65.0	143.3	148.0	33.7	276.6	170.3	128		97	96.6		
4/8 3:00	158.5	65.0	143.0			251.5	154.3	128			96.0		
4/8 6:00	158.8	65.0	143.9	127.2	74.8	141.7	153.9	128		96	94.6		
4/8 9:00	159.0	65.0	143.6			252.4	151.6	128.5			93.7		
4/8 12:00	157.9	65.0	141.2	50.0	130.1	259.9	154.7	128		96	92.8		
4/8 15:00	157.2	65.0	140.3			253.1	156.8	126			92.1		
4/8 18:00	157.9	64.9	140.3	-7.3	131.4	264.2	165.2	126		95	91.4		
4/8 21:00	158.1	64.9	140.5			137.1	257.9	164.1	127		90.9		
4/9 0:00	159.8	64.8	141.5	-66.3	177.2	267.5	163.7	128		96	90.3		
4/9 3:00	160.4	64.7	142.5			187.1	261.1	129			89.8		
4/9 6:00	161.1	64.7	143.0	-27.3	150.9	262.3	165.2	130		95	89.3		
4/9 9:00	162.6	64.6	143.9			135.9	259.8	155.8	132	95	88.9		

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
4/9 12:00	163.5	64.6	144.5	60.8	126.4	253.6	166.7	132		95	88.5		
4/9 16:00	164.8	64.6	145.5		144.5	255.6	167.6				88.0		
4/9 18:00	165.5	64.6	146.0	118.4	142.8	255.7	162.4	134		95	87.7		
4/9 20:00	166.7	64.6	147.1		138.2	261.0	157.0	134			87.5		
4/9 22:00	167.4	64.6	148.3		140.2	261.3	173.5	135			87.2		
4/10 0:00	167.9	64.5	149.7	162.1	139.1	261.8	174.4	136		95	86.9		
4/10 2:00	167.8	64.5	149.2		140.8	264.4	173.0	137			86.7		
4/10 4:00	167.8	64.5	149.2		140.1	257.7	170.4	137			86.5		
4/10 6:00	168.3	64.5	149.4	194.2	143.8	152.1	167.8	138		95	86.2		
4/10 8:00	168.4	64.5	149.5		142.0	151.5	168.1	136			86.0		
4/10 10:00	168.8	64.5	149.6		144.3	158.0	168.6	138			85.8		
4/10 12:00	168.9	64.5	150.0	240.3	142.8	161.1	162.9	138		94	85.5		
4/10 14:00	169.2	64.5	150.5		146.4	161.6	169.9	139			85.3		
4/10 16:00	169.9	64.5	151.0		145.7	161.4	170.6	139.5			85.1		
4/10 18:00	170.3	64.5	151.4	279.1	145.8	152.5	171.2	140		94	84.9		
4/10 20:00	170.7	64.5	151.9		142.3	158.8	171.8	140			84.8		
4/10 22:00	171.2	64.4	152.3		132.4	162.6	172.4	140.5			84.6		
4/11 0:00	171.5	64.4	152.6	319.9	130.1	157.5	172.9	141		94	84.4		
4/11 2:00	171.2	64.4	152.8		131.3	156.1	173.2	141			84.2		
4/11 4:00	171.5	64.4	153.2		152.9	160.3	173.6	142			84.1		
4/11 6:00	172.3	64.5	153.6	390.5	169.2	157.4	173.9	142		94	83.9		
4/11 12:00	173.4	64.5	154.8	446.6	201.9	158.1	175.3	143		94	83.5		
4/11 18:30	172.5	64.4	156.0	493.8	226.4	161.9	189.0	144		93	81.5		
4/12 0:00	171.6	64.2	156.2	498.2	225.2	163.9	185.2	144		94	81.4		
4/12 6:00	176.3	63.9	165.8	564.6	208.1	170.9	265.5	151		93	84.6		
4/12 8:00			165.6	564.6	206.9	169.1	266.7						
4/12 13:00	176.7	63.4	165.9	563.4	193.2	172.0	258.2	152		92	82.9		
4/12 15:00	178.3	64.0	167.6	564.2	186.3	176.1	258.4	153		94	82.8		
4/12 18:00	186.5	64.2	171.7	564.4	187.1	183.5	191.5	162		92	87.0		
4/12 23:00	187.5	64.4	169.7	564.6	193.3	176.3	118.6	159		92	85.1		
4/13 6:00	190.2	64.4	170.1	564.7	183.2	177.1	118.1	160		93	83.9		
4/13 12:00	186.2	64.7	166.9	291.6	69.1	172.3	122.0	156		94	83.3		
4/13 18:00	182.4	65.0	163.2	477.2	-9.2	168.2	118.6	152		94	82.8		
4/14 0:00	178.7	65.1	159.7	418.4	-104.7	163.8	120.7	148		94	82.4		
4/14 6:00	175.3	65.2	156.8	395.2	-116.3	160.8	118.3	146		94	82.3		
4/14 12:00	172.3	65.3	154.1	309.6	-116.3	157.9	119.2	144		94	82.0		
4/14 18:00	169.4	65.4	151.8	258.4	-116.2	155.8	118.0	141		94	81.7		
4/15 0:00	167.5	65.4	150.0	164.6	-116.0	154.0	116.5	139		94	81.3		
4/15 6:00	165.7	65.4	148.2	148.8	-115.9	152.1	118.6	138		94	81.0		
4/15 12:00	164.1	65.5	146.6	255.6	-115.8	150.4	116.7	136		94	80.6		
4/15 18:00	162.8	65.6	145.7	322.4	-115.7	149.4	116.7	135		94	80.3		
4/16 0:00	161.2	65.6	144.3	328.8	-115.5	147.8	116.7	134		94	79.9		
4/16 6:00	159.5	65.6	142.8	324.2	-115.3	146.3	114.8	132		94	79.5		
4/16 12:00	158.6	65.6	141.6	316.4	-115.3	145.0	117.1	131		94	79.1		
4/16 18:00	158.7	65.4	141.6	119.7	-115.2	144.9	119.9	131		94	78.6		
4/17 0:00	159.0	65.4	142.0	227.1	-115.1	145.1	121.3	132		94	78.1		
4/17 6:00	158.9	65.3	141.5	64.6	-115.0	144.7	119.8	132		94	77.6		
4/17 12:00	158.5	65.4	141.1	76.1	-114.8	144.1	119.9	131		94	77.0	77.4	
4/17 18:00	158.8	65.4	141.5	99.5	-114.8	144.4	121.4	132		94	76.5	77.0	
4/18 0:00	158.5	65.4	141.7	3.7	-114.6	144.5	121.3	132		94	76.1	76.4	
4/18 6:00	158.6	65.3	141.8	-9.8	-114.5	144.6	119.5	132		93	75.6	76.0	
4/18 12:00	158.2	65.4	140.9	-14.4	-114.9	143.7	120.3	132		93	75.2	75.5	
4/18 13:00			140.8	-3.8	-114.7	143.6	121.4				75.2	75.5	
4/18 18:00	156.5	65.4	140.0	-14.4	-114.4	196.6	120.0	130		93	74.9	75.2	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
4/19 0:00	154.1	65.4	138.2	-35.7	-114.3	193.0	117.1	129		93	74.6	74.9	
4/19 6:00	152.0	65.4	136.5	-71.1	-114.2	189.9	123.3	128		94	74.5	74.8	
4/19 12:00	149.9	65.6	135.4	-114.6	-114.4	187.9	127.8	127		93	74.4	74.8	
4/19 18:00	147.9	65.7	134.6	-114.7	-114.4	182.5	127.5	126		93	74.4	74.8	
4/20 0:00	147.5	65.1	133.4	123.0	-114.1	137.1	126.2	124		93	74.3	74.6	
4/20 6:00	151.0	65.2	133.6	118.4	-114.0	136.9	125.8	122		93	74.0	74.3	
4/20 12:00	153.9	65.2	134.7	125.2	-114.0	137.6	126.2	123		92	73.7	74.0	
4/20 18:00	155.3	65.4	135.5	130.0	-114.1	138.5	126.9	124		93	73.4	73.7	
4/21 0:00	156.2	65.3	136.0	132.1	-114.1	138.7	127.2	126		93	73.2	73.5	
4/21 6:00	155.9	65.2	136.1	130.9	-114.1	138.8	128.4	126		93	72.9	73.2	
4/21 12:00	156.2	65.3	136.0	129.4	-114.2	138.7	128.4	126		93	72.8	73.0	
4/21 18:00	153.8	65.5	134.6	124.4	-114.3	137.2	127.6	125		94	72.6	72.9	
4/22 0:00	151.2	65.5	133.1	-54.0	-114.3	135.9	126.7	124		94	72.6	72.9	
4/22 6:00	146.1	65.7	131.2	123.9	-114.2	134.4	125.5	122		93	72.5	72.8	
4/22 12:00	141.8	65.7	129.2	-48.2	-114.0	132.4	124.4	120		93	72.4	72.7	
4/22 18:00	140.7	65.7	128.8	-20.8	-114.0	131.7	120.4	118		93	72.3	72.6	
4/23 0:00	140.1	65.7	128.4	157.2	-113.9	131.0	108.4	117		93	72.2	72.5	
4/23 6:00	140.0	65.8	128.0	45.8	-114.0	131.6	108.5	116		93	72.1	72.3	
4/23 12:00	139.8	65.8	127.7	-43.2	129.9	133.4	111.0	116		93	72.0	72.2	
4/23 18:00	138.7	65.8	127.2	-80.7	-113.8	130.1	112.5	116		93	71.9	72.1	
4/24 0:00	136.6	65.8	126.3	-113.9	-113.7	129.1	118.1	115		93	71.8	72.1	
4/24 6:00	134.0	65.8	125.2	-92.9	134.6	129.1	119.8	114		92	71.7	71.9	
4/24 12:00	140.2	65.8	124.2	-42.4	147.0	128.5	118.9	114		92	71.5	71.8	
4/24 18:00	138.9	65.8	123.4	8.0	-113.5	123.3	117.2	114		92	71.4	71.6	
4/25 0:00	138.1	65.8	122.9	-3.7	-113.3	123.2	114.4	113		92	71.3	71.6	
4/25 6:00	137.6	65.7	122.5	35.9	-113.1	122.0	115.5	114		93	71.2	71.4	
4/25 11:00	137.2	65.7	122.3	-40.4	-113.1	122.9	116.3	114		92	71.1	71.3	
4/25 17:00	137.4	65.7	122.5	-28.4	-113.1	122.2	115.6	114		92	71.0	71.3	
4/25 23:00	137.1	65.7	121.9	-61.5	-112.9	120.5	116.4	114		92	70.9	71.1	
4/26 5:00	136.4	65.6	121.2	-70.8	-112.8	120.0	117.5	113		92	70.8	70.9	
4/26 11:00	135.4	65.7	120.5	-50.3	39.1	120.1	116.2	112		92	70.7	71.0	
4/26 17:00	135.4	65.8	120.2	-39.5	-112.7	117.3	115.0	112		92	70.7	70.9	
4/26 23:00	135.0	65.7	120.4	-65.5	-112.6	117.0	115.7	112		92	70.6	70.9	
4/27 5:00	134.9	65.7	120.4	-62.5	-112.6	117.6	114.0	112		92	70.5	70.8	
4/27 11:00	134.4	65.7	120.3	-111.7	-112.6	116.0	114.2	111		92	70.5	70.8	
4/27 17:00	134.0	65.8	120.1	-101.6	-112.6	116.5	113.4	111		92	70.5	70.7	
4/27 23:00	134.4	65.8	120.1	-112.7	-112.4	117.6	116.1	111		92	70.4	70.7	
4/28 5:00	133.8	65.7	119.9	-112.5	-112.3	117.1	113.3	111		92	70.4	70.7	
4/28 11:00	133.4	65.7	119.8	-112.4	-112.3	116.2	113.1	110		92	70.3	70.6	
4/28 17:00	133.2	65.6	119.6	-112.1	-111.9	117.0	116.3	110		92	70.3	70.5	
4/28 23:00	133.0	65.6	119.4	-111.8	99.4	116.2	116.1	110		92	70.0	70.3	
4/29 5:00	132.9	65.6	119.2	-111.7	88.3	116.5	115.9	110		92	69.7	70.0	
4/29 11:00	132.6	65.7	119.2	-111.8	-111.6	118.3	115.8	110		92	69.6	69.8	
4/29 17:00	128.0	65.8	119.3	-111.7	-111.5	116.7	113.0	108		92	69.3	69.6	
4/29 23:00	132.9	65.7	119.3	-111.5	-111.3	117.5	115.8	108		92	69.1	69.3	
4/30 5:00	129.6	65.6	119.1	-111.3	-111.1	116.8	115.3	109		92	68.8	69.1	
4/30 11:00	132.1	65.6	118.9	-111.1	105.9	117.1	113.7	108		93	68.6	68.8	
4/30 17:00	127.3	65.6	118.9	-111.1	104.7	123.2	112.7	108		92	68.5	68.7	
4/30 23:00	129.1	65.7	118.8	-110.9	105.0	123.2	113.7	109		92	68.3	68.6	
5/1 5:00	131.9	65.5	118.7	-110.9	104.7	119.1	114.1	109		92	68.2	68.5	
5/1 11:00	131.6	65.5	118.5	-110.7	106.2	119.6	115.0	108		92	68.2	68.4	
5/1 17:00	131.4	65.5	118.3	-110.6	106.3	117.1	113.4	108		92	68.2	68.4	
5/1 23:00	130.9	65.5	118.0	-110.2	105.4	116.8	112.5	108		92	68.2	68.4	
5/2 5:00	123.5	65.5	117.9	-110.0	102.4	117.7	113.9	108		92	68.1	68.3	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
5/2 11:00	123.4	65.5	117.6	-109.8	104.4	119.1	113.4	108		92	68.0	68.2	
5/2 17:00	116.9	65.5	117.6	-109.6	102.7	122.2	113.7	108		92	67.8	68.1	
5/2 23:00	117.7	65.6	117.5	-109.5	101.8	120.6	113.3	108		92	67.7	67.9	
5/3 5:00	122.5	65.5	117.3	-109.5	104.8	118.6	113.8	108		92	67.6	67.9	
5/3 11:00	123.3	65.5	117.3	-109.5	106.0	119.6	113.8	107		92	67.6	67.8	
5/3 17:00	123.1	65.5	117.4	-109.5	106.5	119.8	114.2	107		92	67.6	67.8	
5/3 23:00	124.6	65.5	117.4	-109.4	104.6	119.5	114.2	107		92	67.6	67.8	
5/4 5:00	128.3	65.5	117.2	-109.2	108.8	116.8	112.7	107		92	67.5	67.8	
5/4 11:00	127.9	65.5	117.0	-109.3	108.8	113.8	113.8	107		92	67.5	67.8	
5/4 17:00	127.6	65.6	117.0	-109.3	108.3	117.6	113.5	107		92	67.5	67.7	
5/4 23:00	128.9	65.5	117.1	-109.1	108.2	117.8	112.5	107		91	67.4	67.6	
5/5 5:00	130.6	65.4	117.0	-109.0	108.3	116.4	112.7	107		91	67.3	67.6	
5/5 11:00	130.6	65.5	116.8	-109.0	109.8	116.5	112.5	108		91	67.3	67.5	
5/5 17:00	130.7	65.5	116.7	-109.0	110.8	115.5	112.6	108		91	67.3	67.5	
5/5 23:00	130.2	65.5	116.7	-109.1	110.5	115.3	111.5	108		91	67.2	67.5	
5/6 5:00	130.2	65.4	116.5	-109.0	111.1	118.1	111.9	110		91	67.2	67.4	
5/6 11:00	130.2	65.5	116.4	-109.1	110.8	117.4	111.4	110		91	67.1	67.4	
5/6 17:00	129.6	65.5	116.4	-109.0	113.7	113.7	111.8	110		91	67.0	67.3	
5/6 23:00	130.0	65.4	116.3	-108.9	110.2	117.2	112.0	111		91	67.0	67.2	
5/7 5:00	130.1	65.4	116.1	-108.8	113.2	114.6	112.4	111		91	66.9	67.2	
5/7 11:00	129.7	65.5	116.0	-108.7	113.0	116.3	112.6	111		91	66.9	67.1	
5/7 17:00	128.9	65.4	115.8	64.1	113.5	116.9	112.4	111		91	66.8	67.1	
5/7 23:00	129.3	65.4	115.7	-108.5	110.6	119.5	112.7	111		91	66.8	67.0	
5/8 5:00	128.4	65.5	115.6	-108.4	113.4	116.9	113.2	111		91	66.8	67.0	
5/8 11:00	128.1	65.5	115.4	-108.1	110.6	119.3	112.4	111		91	66.7	66.9	
5/8 17:00	128.5	65.4	115.6	-107.9	110.5	116.7	110.9	112		91	66.7	66.9	
5/8 23:00	129.0	65.1	115.7	-107.8	111.4	118.3	112.7	110		91	66.7	66.9	
5/9 5:00	127.9	65.3	115.6	-107.5	111.7	117.3	112.1	110		90	66.6	66.8	
5/9 11:00	128.0	65.3	115.6	-107.6	112.9	120.2	112.3	109		91	66.6	66.8	
5/9 17:00	128.4	65.4	115.5	-107.7	114.4	120.3	112.6	110		91	66.5	66.8	
5/9 23:00	127.5	65.3	115.3	-107.6	110.4	119.1	111.8	110		90	66.5	66.7	
5/10 5:00	127.3	65.4	115.3	-107.4	111.0	116.9	112.2	110		90	66.5	66.7	
5/10 11:00	127.2	65.4	115.3	-107.1	113.3	114.7	112.0	110		90	66.5	66.8	
5/10 17:00	127.1	65.4	115.3	-106.9	110.5	114.9	112.7	110		91	66.5	66.7	
5/10 23:00	126.3	65.4	115.1	-106.8	110.7	113.5	112.7	110		90	66.4	66.6	
5/11 5:00	127.0	65.3	115.0	-106.9	112.1	113.2	112.4	110		90	66.2	66.5	
5/11 11:00	126.1	65.3	115.0	-106.7	113.3	113.3	112.6	110		90	66.1	66.4	
5/11 17:00	125.5	65.2	115.0	-98.3	109.3	114.4	112.8	110		90	66.1	66.3	
5/11 23:00	126.3	65.2	114.9	-17.1	109.4	114.8	112.3	110		90	66.0	66.3	
5/12 5:00	118.9	65.1	114.8	-106.2	110.9	113.6	111.9	110		90	66.0	66.3	
5/12 11:00	119.2	65.1	114.8	-106.3	111.0	112.2	111.8	110		90	65.9	66.2	
5/12 17:00	119.2	65.0	114.6	-106.2	109.9	114.5	111.8	108		90	65.9	66.1	
5/12 23:00	119.0	64.9	114.6	-106.2	109.9	113.1	111.2	110		90	65.9	66.2	
5/13 5:00	118.5	64.8	114.6	-106.2	110.9	112.8	110.6	110		90	66.0	66.2	
5/13 11:00	118.5	64.8	114.6	14.7	110.1	114.2	110.7	110		90	65.9	66.2	
5/13 17:00	118.6	64.7	114.3	20.9	109.2	113.3	110.7	110		90	66.0	66.3	
5/13 23:00	118.4	64.7	114.5	-106.2	110.9	112.0	110.6	110		90	65.8	66.1	
5/14 5:00	117.1	64.8	114.5	-106.0	111.3	111.3	110.6	110		90	65.7	65.9	
5/14 11:00	118.4	64.8	114.3	-106.5	110.7	111.9	110.0	110		90	65.6	65.8	
5/14 17:00	118.8	64.9	114.2	-105.9	110.1	113.6	109.6	110		90	65.4	65.6	
5/14 23:00	119.1	64.9	113.9	-105.8	109.8	113.1	109.9	110		90	65.2	65.4	
5/15 5:00	119.7	64.8	113.7	-85.9	109.5	112.3	109.9	110		90	65.0	65.3	
5/15 11:00	120.0	64.9	113.7	-87.0	110.6	110.2	109.8	111		90	64.9	65.1	
5/15 17:00	120.2	64.9	113.6	-21.5	108.8	110.2	108.8	111		90	64.8	65.0	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
5/15 23:00	123.6	64.9	113.5	-45.5	109.7	111.4	108.0	111		90	64.7	64.9	
5/16 5:00	119.6	64.8	113.5	-36.8	109.8	112.9	107.7	111		90	64.6	64.8	
5/16 11:00	120.5	64.8	113.4	-4.5	111.5	111.5	107.0	111		90	64.5	64.7	
5/16 17:00	121.6	64.9	113.3	268.2	109.4	110.1	107.3	109		90	64.4	64.6	
5/16 23:00	122.9	64.8	113.3	283.5	109.9	111.6	107.6	111		90	64.4	64.6	
5/17 5:00	123.6	64.8	113.5	288.4	109.6	110.3	108.2	111		90	64.3	64.6	
5/17 11:00	123.4	64.9	113.2	366.1	108.8	110.6	108.1	108		89	64.3	64.5	
5/17 17:00	123.0	64.8	113.2	175.9	109.4	111.5	108.5	110		89	64.2	64.5	
5/17 23:00	119.5	64.9	113.2	164.5	108.7	111.6	108.6	110		90	64.2	64.4	
5/18 5:00	120.0	64.8	113.2	131.5	108.4	111.1	108.3	108		89	64.2	64.4	
5/18 11:00	120.4	64.9	113.0	362.0	108.9	111.5	108.5	110		89	64.1	64.4	
5/18 17:00	120.3	64.8	112.9	350.6	109.2	110.2	108.5	111		89	64.1	64.3	
5/18 23:00	120.4	64.8	113.0	361.9	109.6	112.2	108.1	110		89	64.1	64.3	
5/19 5:00	121.0	64.8	112.9	387.9	109.1	111.6	109.2	110		89	64.2	64.4	
5/19 11:00	120.3	64.9	112.9	385.7	109.5	111.4	108.9	110		89	64.2	64.4	
5/19 17:00	120.1	64.9	112.8	398.0	109.0	109.7	108.4	110		89	64.3	64.5	
5/19 23:00	120.5	64.9	112.7	356.7	109.2	111.1	109.1	110		89	64.4	64.6	
5/20 5:00	121.2	64.9	112.6	384.5	109.3	111.2	108.7	111		89	64.4	64.6	
5/20 11:00	120.7	64.9	112.5	370.4	108.4	110.1	108.6	112		89	64.4	64.7	
5/20 17:00	120.1	64.9	112.6	393.4	108.6	111.1	108.6	112		89	64.5	64.7	
5/20 23:00	120.8	64.9	112.5	391.8	108.5	111.1	108.5	111		89	64.4	64.6	
5/21 5:00	119.4	64.9	112.4	399.7	108.1	109.3	108.3	113		89	64.4	64.6	
5/21 11:00	120.1	65.0	112.3	450.5	108.7	110.7	108.7	112		89	64.4	64.6	
5/21 17:00	120.2	65.0	112.3	397.3	111.3	113.0	108.5	112		89	64.4	64.6	
5/21 23:00	120.4	65.0	112.4	369.3	110.7	113.1	107.3	112		89	64.4	64.6	
5/22 5:00	120.7	65.0	112.4	446.1	110.0	111.1	107.7	112		89	64.4	64.6	
5/22 11:00	120.9	64.9	112.4	368.5	110.5	112.4	108.1	112		89	64.4	64.6	
5/22 17:00	120.9	64.9	112.3	403.0	108.5	112.1	107.8	112		89	64.4	64.6	
5/22 23:00	120.7	64.9	112.2	379.5	109.2	112.7	107.7	112		88	64.4	64.6	
5/23 5:00	121.1	64.8	112.2	369.2	106.6	112.3	108.3	112		88	64.3	64.5	
5/23 11:00	121.0	64.9	112.5	310.9	108.2	113.2	108.2	112		88	64.3	64.5	
5/23 17:00	120.8	64.9	112.4	300.2	108.4	112.9	108.4	111		89	64.3	64.5	
5/23 23:00	124.3	64.9	112.4	291.9	107.0	111.3	108.8	111		89	64.3	64.5	
5/24 5:00	123.8	64.9	112.3	267.5	108.0	113.0	108.3	111		89	64.4	64.5	
5/24 11:00	124.5	64.9	112.2	285.7	106.8	111.4	108.0	108		89	64.4	64.6	
5/24 17:00	119.1	65.0	112.1	343.9	108.0	112.7	107.9	103		89	64.4	64.6	
5/24 23:00	120.7	64.9	111.9	436.4	108.0	112.4	107.9	104		89	64.4	64.6	
5/25 5:00	122.1	64.9	111.8	533.6	106.9	113.3	107.1	104		89	64.4	64.6	
5/25 9:00	118.4	65.0	111.7	562.8	106.5	111.8	108.1	104		89	64.4	64.6	
5/25 15:00	120.5	64.8	111.6	284.6	107.6	112.4	107.5	104		88	64.3	64.6	
5/25 17:00	120.9	65.0	111.7	291.2	106.5	112.6	107.6	104		88	64.4	64.6	
5/25 23:00	118.5	64.9	111.7	263.7	107.9	113.8	106.8	104		88	64.4	64.6	
5/26 5:00	122.7	64.9	112.2	270.9	107.0	113.7	106.9	104		88	64.4	64.6	
5/26 11:00	121.4	65.0	112.2	167.9	106.6	113.0	107.0	104		89	64.4	64.6	
5/26 17:00	121.5	65.0	112.0	127.4	107.7	112.5	106.0	104		89	64.4	64.6	
5/26 23:00	120.9	64.9	112.0	29.4	106.7	112.2	107.4	104		88	64.3	64.5	
5/27 5:00	120.7	64.9	111.9	32.6	107.3	112.3	106.7	104		88	64.2	64.3	
5/27 11:00	121.1	64.9	111.7	92.2	106.3	111.8	106.8	104		88	64.3	64.1	
5/27 17:00	121.0	64.9	111.7	48.8	107.4	113.0	107.3	104		88	64.1	63.9	
5/27 23:00	121.1	64.9	111.7	20.7	107.6	112.5	106.9	104		88	63.6	63.7	
5/28 5:00	121.0	64.9	111.7	37.6	108.3	113.2	107.2	104		88	63.5	63.7	
5/28 11:00	120.1	64.9	111.7	19.4	110.6	112.1	106.8	104		88	63.5	63.7	
5/28 17:00	122.1	64.9	111.8	57.2	113.0	113.4	106.9	104		88	63.4	63.6	
5/28 23:00	120.8	64.9	111.6	94.1	111.8	113.5	106.9	104		88	63.4	63.6	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
5/29 5:00	120.1	64.9	111.6	178.7	109.7	111.8	107.3	104		88	63.3	63.5	
5/29 11:00	120.0	64.9	111.5	568.4	110.6	112.7	107.3	106		88	63.2	63.4	
5/29 14:00	122.0	64.7	112.9	568.3	109.5	113.1	108.5	105		88	63.4	63.6	
5/29 17:00	128.1	64.3	112.3	568.3	110.5	113.8	106.7	105		88	63.5	63.7	
5/29 20:00	124.0	64.0	111.5	568.3	109.4	112.3	106.9	104		89	63.8	64.0	
5/29 23:00	123.4	63.9	111.0	567.7	110.3	111.3	107.2	103		89	64.0	64.2	
5/30 1:00	122.3	63.7	110.7	568.3	109.8	107.6	107.5	102		89	64.1	64.3	
5/30 2:00	121.8	63.6	110.7	568.2	109.7	107.6	107.3	102		88	64.2	64.3	
5/30 3:00	121.4	63.5	110.8	568.2	110.8	108.7	107.8	102		89	64.2	64.4	
5/30 5:00	119.7	63.4	110.7	568.2	110.7	107.3	108.2	102		88	64.2	64.4	
5/30 8:00	119.8	63.1	110.5	568.2	109.5	107.0	106.7	101		68	64.2	64.3	
5/30 11:00	119.9	62.9	110.4	568.2	109.0	107.3	108.0	100		88	64.1	64.3	
5/30 14:00	118.5	62.8	110.3	568.1	107.7	114.6	107.9	102		88	64.0	64.2	
5/30 17:00	117.8	62.7	110.2	568.1	107.1	111.9	108.7	101		88	64.0	64.1	
5/30 20:00	117.8	62.7	110.1	568.0	108.7	106.9	108.0	100		87	63.9	64.0	
5/30 23:00	118.2	62.7	110.6	568.0	108.9	109.9	109.0	99	188	88	63.8	63.9	
5/31 2:00	117.0	62.7	110.5	567.9	109.0	111.9	109.5	99		87	63.6	63.8	
5/31 5:00	117.1	62.9	110.5	567.8	108.5	112.5	109.5	98	182	88	63.6	63.7	
5/31 8:00	117.3	62.8	110.3	567.8	107.3	109.9	110.6	99	183	88	63.5	63.6	
5/31 11:00	117.0	62.6	110.4	567.7	107.0	113.5	107.7	101	178	88	63.3	63.5	
5/31 14:00	116.9	62.7	110.4	567.7	108.5	112.9	112.0	101	179	88	63.3	63.5	
5/31 17:00	116.6	62.9	110.4	567.7	107.5	108.8	113.7	100	174	88	63.3	63.4	
5/31 20:00	118.3	62.9	110.4	567.6	108.0	110.3	111.7	103	170	88	63.2	63.4	
5/31 23:00	116.3	62.7	110.3	567.6	107.1	110.2	111.4	101	178	89	63.1	63.3	
6/1 2:00	118.0	62.5	110.3	567.5	108.5	110.0	112.2	102	158	88	63.0	63.2	
6/1 5:00	117.2	62.5	110.2	567.5	107.8	105.3	111.2	101	160	88	62.9	63.1	
6/1 8:00	117.3	62.5	110.1	567.5	108.2	110.3	108.9	102	175	88	62.9	63.1	
6/1 11:00	117.2	62.4	110.2	567.3	107.2	109.4	112.0	102	160	88	62.8	63.0	
6/1 14:00	118.3	62.5	110.2	567.3	108.9	112.3	112.8	102	155	89	62.7	62.9	
6/1 17:00	117.7	62.5	110.2	567.2	108.5	112.8	112.6	101	153	89	62.6	62.8	
6/1 20:00	118.0	62.4	110.2	567.3	108.2	111.6	113.8	101	150	89	62.5	62.8	
6/1 23:00	118.0	62.4	110.1	567.3	109.4	105.7	114.0	101	148	89	62.5	62.7	
6/2 2:00	117.1	62.4	110.2	567.2	106.5	111.5	117.0	102	147	89	62.5	62.6	
6/2 5:00	116.7	62.4	110.1	567.2	106.4	111.1	116.5	102	146	89	62.4	62.6	
6/2 8:00	116.4	62.4	110.2	567.2	109.6	111.3	116.4	103	138	89	62.4	62.5	
6/2 11:00	117.0	62.4	110.2	567.1	107.9	109.8	115.6	103	136	89	62.3	62.5	
6/2 14:00	117.4	62.4	110.2	566.9	107.9	111.3	117.3	102	134	89	62.3	62.5	
6/2 17:00	117.7	62.4	110.3	566.6	107.9	112.8	116.3	103	127	89	62.3	62.4	
6/2 20:00	117.1	62.4	110.3	566.3	106.4	110.9	115.9	102	130	89	62.2	62.4	
6/2 23:00	117.4	62.4	110.2	566.2	106.4	111.7	117.0	101	132	89	62.2	62.3	
6/3 2:00	117.0	62.4	110.2	566.0	107.3	117.7	116.4	102	113	89	62.1	62.3	
6/3 5:00	117.6	62.4	110.2	565.9	107.3	109.9	116.2	102	116	89	62.1	62.2	
6/3 8:00	117.5	62.4	110.1	565.8	108.4	111.0	116.0	102	122	89	62.0	62.2	
6/3 11:00	117.3	62.3	110.2	565.7	107.7	111.2	116.9	102	120	89	62.0	62.1	
6/3 13:30	117.6	62.4	110.1	565.7	108.8	111.3	116.4	102	119	89	61.9	62.1	
6/3 14:30	117.0	62.3	110.1	565.7	108.0	111.6	117.0	102	119	89	62.0	62.1	
6/3 17:00	117.3	62.3	110.1	565.6	106.3	110.9	116.4	102	116	89	61.9	62.0	
6/3 20:00	116.4	62.4	110.1	565.5	107.7	112.2	116.0	102	108	89	61.9	62.0	
6/3 23:00	116.9	62.4	110.1	565.5	108.0	110.6	114.9	102	109	89	61.9	62.0	
6/4 2:00	116.9	62.4	110.1	565.5	108.3	111.7	113.5	101	105	89	62.0	62.0	
6/4 5:00	116.9	62.3	110.0	565.4	107.8	111.5	115.1	101	102	89	61.9	62.0	
6/4 8:00	116.5	62.3	111.0	565.4	107.4	110.9	117.4	103	102	88	61.9	62.0	
6/4 11:00	116.1	62.3	109.9	565.4	108.4	110.3	116.9	102	97	88	61.9	62.0	
6/4 14:00	116.2	62.3	109.9	565.3	106.6	109.6	117.5	102	91	88	61.9	62.0	
6/4 17:00	116.2	62.3	109.8	565.3	106.1	110.2	118.3	103	89	88	61.8	61.9	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
6/4 20:00	116.0	62.4	109.8	565.3	107.2	111.0	117.2	102	97	88	61.8	61.9	
6/4 23:00	116.5	62.4	109.8	565.2	108.7	110.1	116.9	102	88	88	61.7	61.8	
6/5 2:00	116.6	62.3	109.8	565.2	108.4	109.2	117.0	103	88	88	61.7	61.8	
6/5 5:00	115.8	62.3	109.8	565.2	107.6	112.0	116.5	103	86	88	61.7	61.8	
6/5 8:00	116.2	62.3	109.7	565.2	106.9	111.3	118.7	100	82	88	61.6	61.7	
6/5 11:00	116.4	62.3	109.7	565.2	107.4	109.4	120.4	101	83	88	61.6	61.7	
6/5 14:00	116.0	62.3	109.9	562.2	107.3	109.7	118.8	102	82	88	61.6	61.7	
6/5 17:00	116.5	62.4	109.8	565.2	106.0	109.1	116.1	102	78	88	61.6	61.7	
6/5 20:00	115.9	62.3	109.8	565.2	106.4	110.9	115.8	102	76	88	61.6	61.7	
6/5 23:00	115.7	62.3	109.7	565.1	108.3	109.4	119.2	102	77	88	61.6	61.7	
6/6 2:00	116.1	62.3	109.6	565.1	106.6	112.2	118.3	102	74	88	61.6	61.7	
6/6 5:00	115.4	62.3	109.5	563.7	107.8	110.3	116.0	102	75	88	61.6	61.6	
6/6 8:00	116.7	62.2	109.4	565.1	107.0	110.8	117.7	102	74	88	61.5	61.6	
6/6 11:00	115.6	62.2	109.3	565.1	106.0	108.6	117.6	102	70	88	61.5	61.6	
6/6 14:00	115.7	62.3	109.3	565.1	107.7	111.7	119.0	102	62	88	61.5	61.6	
6/6 17:00	116.0	62.3	109.4	565.1	107.8	111.7	119.2	102	53	88	61.5	61.6	
6/6 20:00	116.4	62.3	109.3	565.1	107.0	112.4	120.5	102	52	88	61.5	61.6	
6/6 23:00	115.9	62.4	109.3	565.1	107.9	110.8	119.6	102	52	88	61.5	61.5	
6/7 2:00	115.7	62.3	109.2	565.0	107.3	107.9	119.6	102	52	88	61.4	61.5	
6/7 5:00	115.6	62.3	109.2	565.0	106.4	114.0	122.9	106	43	88	61.5	61.5	
6/7 8:00	116.2	62.3	109.2	565.0	107.5	111.5	130.2	106	48	88	61.4	61.5	
6/7 11:00	115.9	62.2	109.0	565.1	107.3	114.3	131.4	106	47	87	61.4	61.5	
6/7 14:00	115.9	62.2	109.1	565.1	107.6	109.1	134.2	106	46	88	61.4	61.5	
6/7 17:00	115.9	62.3	109.1	565.1	107.3	111.3	131.8	106	49	88	61.4	61.5	
6/7 20:00	115.8	62.3	109.2	565.0	106.5	109.5	127.5	106	43	88	61.4	61.5	
6/7 23:00	115.6	62.3	109.1	565.0	108.4	111.0	131.9	100	42	88	61.5	61.5	
6/8 2:00	115.6	62.3	109.1	565.0	108.4	109.1	130.0	102	40	88	61.5	61.5	
6/8 5:00	116.0	62.3	109.0	565.0	107.7	111.2	128.6	102	38	88	61.5	61.5	
6/8 8:00	115.8	62.3	109.1	564.9	107.6	111.3	130.3	102	45	88	61.5	61.5	
6/8 11:00	115.8	62.3	109.0	565.1	105.8	112.4	130.7	102	36	88	61.5	61.6	
6/8 14:00	116.0	62.3	109.0	565.0	106.9	111.5	130.3	102	37	88	61.5	61.6	
6/8 18:00	115.9	62.3	108.8	564.3	106.3	110.7	130.5	102	38	87	61.5	61.6	
6/8 20:00	115.7	62.4	108.9	565.0	107.7	109.1	129.8	102	24	87	61.6	61.6	
6/8 23:00	116.3	62.3	108.9	565.0	108.5	111.5	129.2	102	26	87	61.6	61.6	
6/9 2:00	116.1	62.3	108.8	565.0	107.9	110.1	122.1	101	24	87	61.6	61.7	
6/9 5:00	115.8	62.3	108.5	565.0	106.8	110.2	123.2	102	23	87	61.6	61.7	
6/9 8:00	115.6	62.3	108.3	565.0	107.0	108.5	122.3	102	22	87	61.7	61.7	
6/9 11:00	115.5	62.2	108.4	565.0	107.4	110.8	123.7	102	21	87	61.7	61.7	
6/9 14:00	116.3	62.3	108.5	565.0	106.9	109.1	123.6	101	19	87	61.7	61.8	
6/9 17:00	117.5	62.3	108.6	565.0	106.2	108.9	122.6	106	18	87	61.7	61.8	
6/9 20:00	117.5	62.3	108.6	565.0	106.2	111.8	121.8	101	15	87	61.7	61.7	
6/9 23:00	117.1	62.3	108.8	565.0	106.3	110.2	121.9	101	16	87	61.7	61.7	
6/10 2:00	117.2	62.3	108.8	565.0	106.6	111.0	122.7	102	15	86	61.7	61.7	
6/10 5:00	113.4	62.3	108.8	565.0	107.1	111.1	121.5	102	14	86	61.7	61.7	
6/10 8:00	113.9	62.3	108.8	565.0	106.0	108.1	121.6	102	11	86	61.7	61.7	
6/10 11:00	113.8	62.3	108.8	565.0	106.4	108.9	120.6	102	12	86	61.7	61.7	
6/10 14:00	113.7	62.3	108.8	565.0	106.9	110.5	121.8	102	10	86	61.7	61.7	
6/10 17:00	113.6	62.3	108.8	565.0	106.5	109.5	120.4	102	8	86	61.7	61.7	
6/10 20:00	113.6	62.2	108.9	565.0	111.4	109.7	120.3	102	7	86	61.7	61.7	
6/10 23:00	114.2	62.2	108.8	565.0	105.6	109.1	120.8	102	8	86	61.7	61.7	
6/11 2:00	114.1	62.2	108.8	565.0	105.7	108.6	123.0	101	6	86	61.7	61.7	
6/11 5:00	114.3	62.2	108.8	565.0	106.1	110.4	125.2	101	5	86	61.7	61.8	
6/11 8:00	114.3	62.1	108.7	565.0	105.7	106.8	126.4	100	3	86	61.7	61.8	
6/11 11:00	115.0	62.1	108.7	565.0	106.0	109.2	123.7	101	4	86	61.8	61.8	

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Safety Relief Valve Leakage Detector RV-2-71A	Main Steam Isolation Valve Leakage Detector	Feedwater Nozzle N-4B	CRD Housing Upper Part	RPV Bottom Part (Wall Above Bottom Head)	RPV Supporting Skirt Upper Part	RPV Drain Pipe Upper Part	D/W HVH Return Air Duct (HVH-16A)	RPV Bellows Air	Suppression Chamber Gas	S/C Pool Water A	S/C Pool Water B	note
6/11 14:00	114.1	61.9	108.6	565.1	109.6	107.5	121.2	101	4	86	61.8	61.8	
6/11 17:00	114.1	61.9	108.6	565.0	105.4	110.5	122.2	101	4	86	61.8	61.8	
6/11 20:00	114.0	61.9	108.6	565.0	105.9	111.3	120.5	101	3	86	61.8	61.8	
6/11 23:00	113.8	61.9	108.5	565.0	105.9	110.9	122.1	101	4	86	61.8	61.8	
6/12 2:00	114.0	61.9	108.5	565.0	110.5	111.5	121.2	101	4	86	61.8	61.8	
6/12 5:00	114.0	61.8	108.4	565.0	105.8	113.2	116.8	100	9	86	61.8	61.8	
6/12 8:00	114.0	61.8	108.4	564.9	106.5	107.5	114.1	100		86	61.8	61.8	
6/12 11:00	113.6	61.8	108.4	565.0	106.4	107.1	113.1	100		86	61.8	61.8	
6/12 14:00	114.0	61.8	108.4	565.0	105.8	105.7	112.7	100		86	61.8	61.8	
6/12 17:00	113.5	61.9	108.4	565.0	106.9	116.5	112.7	101		86	61.8	61.8	
6/12 20:00	114.8	61.9	108.4	565.0	106.5	107.2	115.0	102		86	61.8	61.8	
6/12 23:00	113.9	61.8	108.4	565.0	106.1	112.8	111.7	101		86	61.8	61.8	
6/13 2:00	113.6	61.8	108.3	565.0	106.3	111.2	113.2	101		86	61.8	61.8	
6/13 5:00	113.1	61.8	108.3	565.0	105.9	109.1	113.1	102		85	61.8	61.8	
6/13 8:00	112.0	61.7	108.2	565.0	105.2	109.9	112.2	100		86	61.8	61.8	
6/13 11:00	112.5	61.8	108.1	565.0	105.2	109.7	113.0	100		85	61.8	61.8	
6/13 14:00	112.3	61.8	108.3	565.0	105.4	108.4	115.7	100	79	85	61.8	61.8	
6/13 17:00	112.7	61.8	108.3	565.0	105.9	111.1	115.1	100	119	85	61.8	61.9	
6/13 20:00	112.7	61.8	108.3	565.0	108.1	109.7	115.7	100	114	86	61.8	61.8	
6/13 23:00	112.8	61.8	108.2	565.0	106.8	107.9	115.7	100	111	86	61.8	61.9	
6/14 2:00	113.2	61.8	108.2	565.0	107.0	108.3	115.5	100	94	85	61.8	61.9	
6/14 5:00	112.2	61.7	108.2	565.0	106.4	107.6	114.2	100	82	85	61.8	61.8	