
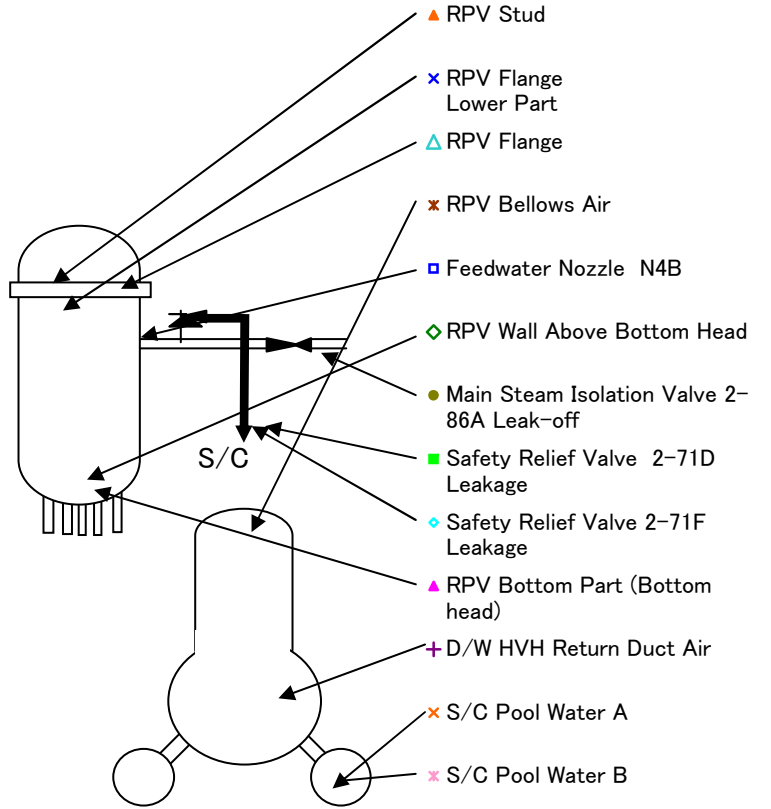


Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature (Typical Points)

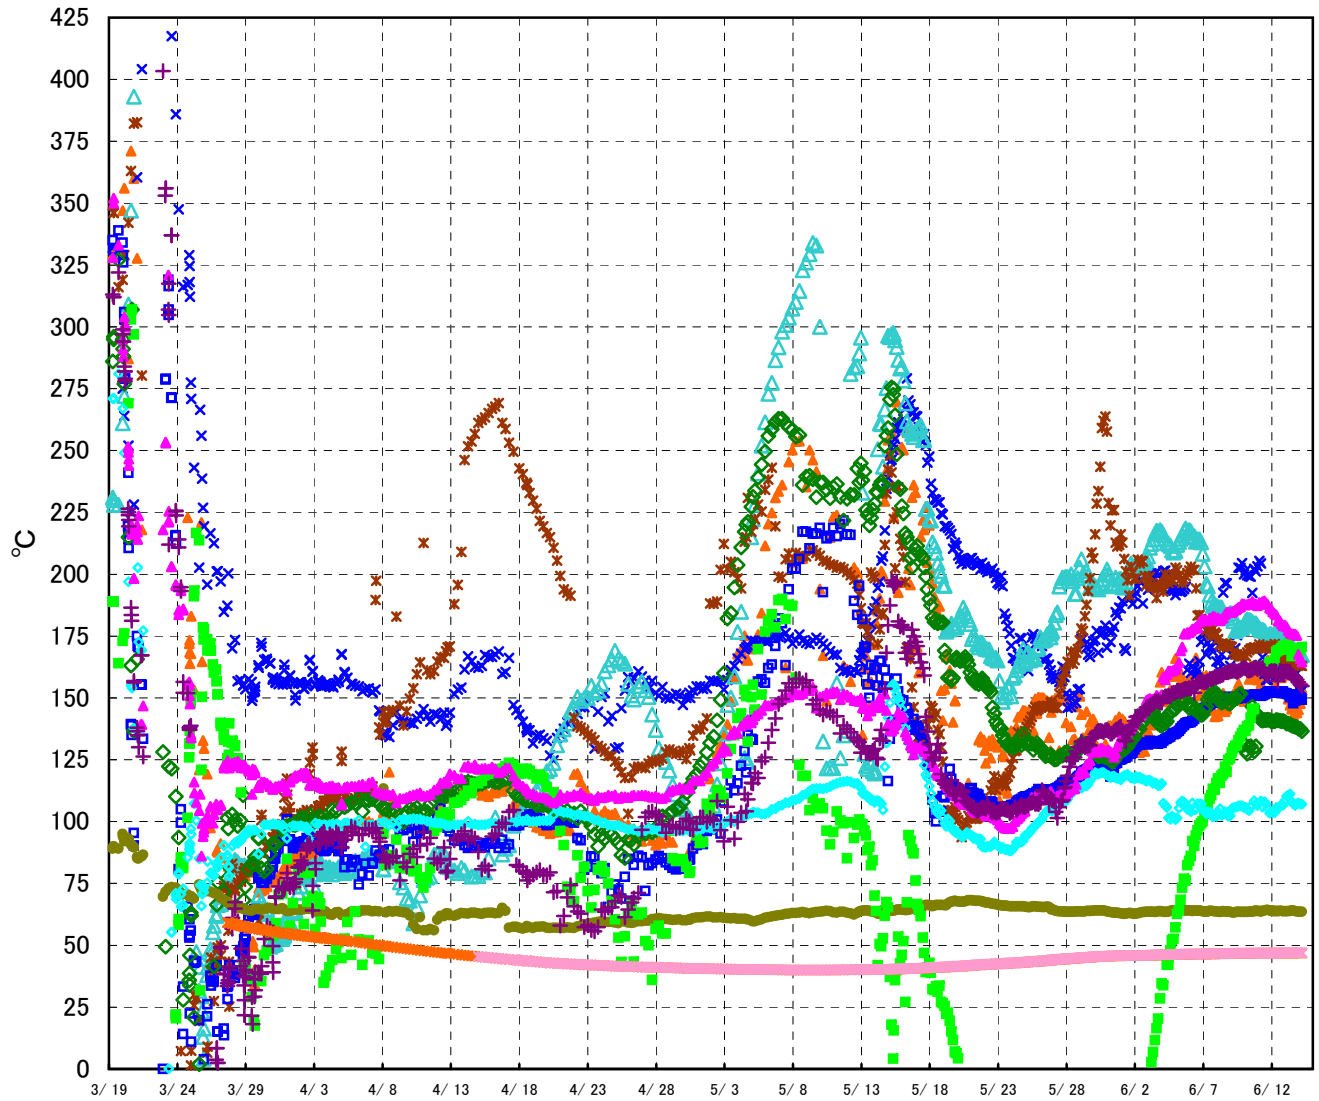

[Note]
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
3/19 6:30	335	286	231	328	329	332	189	271	89	313	349			
3/19 8:20	331	295	228	352			189	271	90	312	346			
3/19 8:30	331	296	230	350			189	271	90	312	346			
3/19 16:30	336.2		232.7							320				
3/19 17:00	339	327	228	333			164	281	89	322	316			
3/19 17:20	339		228							322				
3/20 0:25	334	295	261	295	347	275	173	267	95	299	319			
3/20 0:50	329	291		291					94	297				
3/20 1:00		288							94	294				
3/20 1:10	326	288		288					94	294				
3/20 3:10	306	277	272	304	356	264	176	249	92	284	329			
3/20 3:50	303			301					93	282				
3/20 4:10	303			301					93	282				
3/20 4:20	279			300					93	278				
3/20 4:30	279			300					93	279				
3/20 9:55	219.5			251.6					93.2	226.5				
3/20 10:00	241	215	309	251	287	252	269	197	93	225	342			
3/20 10:10	216.9			249.2					92.9	223.9				
3/20 10:35	214.4			246.6					92.6	221.9				
3/20 11:00	210.6			243.9					92.2	219.4				
3/20 15:00				220.0					90.9	186.5				
3/20 15:00	139.4	163.0	347.0		371.0	225.0	303.0	155.0			363.0			
3/20 15:35	138.8			217.7					90.7	183.5				
3/20 16:00	135.0			216.1					90.5	181.2				
3/20 16:30		307.0					307.0	154.0						
3/20 19:40				198.3					89.7	156.9				
3/20 19:40	95.4	136.7	393.0		359.9	228.2	296.9	137.7			382.1			
3/20 20:00	90.3			198.2					89.6	156.2				
3/21 1:25	175.0			219.8				137.7	85.6	138.0				
3/21 1:25		165.7	558.8		327.7	360.4	559.3				382.7			
3/21 1:45	-131.4			217.0				-133.2	85.1	136.5				
3/21 2:30	171.0			214.0				202.7	85.5	134.8				
3/21 4:00	170.4			223.6				172.6	85.0	130.1				
3/21 8:00	155.3			139.3				169.3	85.9	167.2				
3/21 10:00	155.3	-131.6	-131.5	139.3	218.0	404.2	532.3	169.3	85.9	167.2	280.3			
3/21 12:15	133.4			146.8				177.2	86.6	126.3				
3/22 22:40				218.0						403.4	-141.1			
3/22 22:40	-139.4	128.1	-139.7		-138.4	533.1	-141.3	-106.2	69.6					
3/23 3:00							-134.7	-78.4		353.1	-133.5			
3/23 3:30	278.6	49.4	-135.0	253.4	-129.1	504.3	-134.6	-75.9	71.6	356.0	-133.3			
3/23 4:00	279.0		-135.0	253.0			-135.0	-76.0		356.0	-134.0			
3/23 8:20	319.0		-132.0	321.0			-134.0	-3.0		307.0	-133.0			
3/23 8:45	316.4	122.3	-132.2	221.5	-129.2	481.4	-134.3	0.1	73.0	304.8	-133.5			
3/23 8:50	307.0		-132.0	221.0			-134.0	-3.0		212.0	-133.0			
3/23 9:10	304.8		-132.2	225.5			-134.2	-14.2		317.5	-133.6			

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
3/23 13:40	271.2		-132.3	203.1			-74.2	55.2		337.0	-133.4			
3/23 13:50	271.2	121.4	-132.3	203.1	-129.6	417.5	-74.2	55.2	73.5	337.0	-133.4			
3/23 21:10	215.4		-67.4	195.6			21.5	71.0		225.7	-133.6			
3/23 21:25	215.7	110.1	-65.3	195.8	-78.5	385.9	22.0	70.2	73.2	225.5	-133.6			
3/23 21:40	212.4		-64.8	195.3			20.4	68.7		223.8	-133.6			
3/24 2:20	80.7		-108.0	185.4			58.3	79.3		214.0	-133.6			
3/24 2:25	70.7	93.6	-115.2	183.6	-128.6	347.5	60.6	78.7	72.4	210.8	-133.6			
3/24 6:20	99.5		-81.8	193.3			82.8	70.7		194.8	-2.4			
3/24 6:35	104.9		-80.9	194.8			85.6	65.6		193.2	7.3			
3/24 10:00	33.3		-107.0	186.0			82.2	66.3		152.1	-108.7			
3/24 10:00		27.9			-43.7	316.1			70.7					
3/24 10:20	14.1		-124.6	185.5			81.1	72.8		156.4	-102.3			
3/24 18:00	65.6		-124.6	155.7			101.5	85.6		151.9	-33.9			
3/24 18:00		-14.9			222.9	317.0			70.5					
3/24 21:00	54.1	35.8	-81.0	156.4	171.8	329.0	125.9	88.9	69.7	138.0	-28.4			
3/24 21:20	53.0	33.9	-87.0	155.0	173.3	324.6	131.5	90.3	69.6	137.0	-24.9			
3/24 21:40	60.5		-85.4	150.9			131.5	91.2		137.3	-21.5			
3/24 21:40		38.7			168.4	318.1			69.8					
3/24 22:00	22.4		-83.7	147.5			136.6	87.8		138.4	-18.0			
3/24 22:00		45.9			163.8	312.1			69.8					
3/24 23:30	55.9		-57.9	135.2			148.0	97.1		138.7	1.4			
3/24 23:30		63.1			167.8	277.5			69.7					
3/25 0:30	11.0		-57.3	133.8			151.9	94.8		-32.2	7.4			
3/25 0:30		62.0			183.0	270.9			69.7					
3/25 5:30	43.8		-14.5	115.9			191.0	107.3		-8.9	25.6			
3/25 5:30		20.9			153.2	243.0			68.9					
3/25 6:10	42.8		-1.5	111.6			193.4	107.1		-28.4	30.0			
3/25 9:30	43.3		47.3	107.8			216.6	100.4		-40.7	28.9			
3/25 14:10	19.7		31.6	104.4			213.7	85.0		-88.2	19.4			
3/25 14:10		2.0			120.9	202.7			74.5					
3/25 16:10	-33.4		41.3	111.0			31.7	74.3		-109.6	-36.4			
3/25 16:10		-132.9			521.1	266.5			73.6					
3/25 18:10	-8.4		29.4	86.1			120.9	65.9		-135.6	-135.2			
3/25 18:10		-133.0			220.9	256.0			72.3					
3/25 19:10	-5.3		23.3	99.2			150.4	70.6		-135.7	-135.2			
3/25 19:10		-133.0			164.6	238.6			72.4					
3/25 21:10	-0.8		13.0	93.9			178.4	74.2		-135.7	-63.8			
3/25 21:10		-100.3			132.8	226.9			72.5					
3/25 22:00	-2.5		4.2	95.8			173.5	71.4		-135.6	-33.3			
3/25 23:00	3.9		16.3	97.0			177.8	73.3		-135.6	-19.2			
3/25 23:00		-52.8			129.5	219.4			72.4					
3/26 4:20	21.2		37.9	99.4			173.7	75.3		-106.6	6.6			
3/26 4:20		-17.6			119.2	195.8			71.8					
3/26 5:05	26.1		41.2	102.5			169.2	83.8		-119.8	9.0			
3/26 10:00	37.6		48.4	106.1			172.0	79.2		-49.7	39.7			

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
3/26 10:00		-49.9			97.5	216.5			71.7					
3/26 11:15	33.7		46.4	100.4			169.0	79.3		-57.8	45.0			
3/26 14:30	35.7		55.2	99.4			163.5	78.5		-23.7	35.1			
3/26 16:00	35.3		57.8	102.8			160.2	78.2		-46.4	27.5			
3/26 16:00		41.6			105.6	212.5			71.1					
3/26 20:00	41.9		61.9	107.0			161.4	83.0		3.7	40.6			
3/26 21:00	41.7	66.4	62.4	106.5	88.2	201.1	156.7	83.1	70.8	8.4	43.3			
3/26 21:20	41.7		62.4	106.5			156.7	83.1		8.4	43.3			
3/26 23:00	15.1	75.5	66.2	104.8	87.6	201.2	151.4	81.7	70.4	2.4	49.0			
3/26 23:10	15.1		66.2	104.8			151.4	81.7		2.4	49.0			
3/27 4:15	-7.9		67.2	106.5			139.9	85.3		49.3	45.8			
3/27 4:15		79.7			91.1	197.1			69.1					
3/27 4:45	-1.7		66.7	106.8			138.6	85.6		48.8	49.9			
3/27 9:25	16.3		73.0	122.7			135.3	90.5		38.3	73.3			
3/27 9:25		71.6			85.3	184.8			68.5					
3/27 10:10	13.6		72.7	121.6			133.1	90.2		38.4	74.0			
3/27 16:00	33.1		75.1	123.8			125.5	86.4		33.5	71.1	59.1		
3/27 16:00		101.4			82.9	187.2			67.4					
3/27 16:25	28.2		75.4	124.6			123.3	85.6		34.7	73.1	59.1		
3/27 17:30	33.8		75.0	123.1			132.2	82.0		35.8	55.9	59.1		
3/27 17:30		97.2			81.9	200.3			67.0					
3/27 18:30	39.1		76.2	122.5			127.0	81.5		41.4	43.4	59.0		
3/27 19:00	41.9		77.5	121.7			139.7	78.0		40.1	25.2	59.0		
3/28 0:00	38.1		82.0	123.6			131.9	90.1		56.7	82.9	58.7		
3/28 0:00		102.9			82.8	170.0			66.3					
3/28 0:50	38.2		82.6	122.6			132.7	90.2		61.1	81.0	58.7		
3/28 5:00	36.7		83.7	124.0			130.5	91.2		67.4	71.8	58.4		
3/28 5:00		100.5			81.6	173.4			65.4					
3/28 5:30	38.0		84.5	123.0			130.7	91.5		64.9	72.9	58.4		
3/28 10:00	39.1		83.6	123.8			125.5	92.1		59.2	74.3	58.2		
3/28 10:00		98.2			81.6	156.7			65.0					
3/28 10:30	41.9		83.1	124.4			125.5	91.2		59.6	75.4	58.1		
3/28 15:00	48.0		81.5	123.1			122.5	92.3		41.5	76.6	57.9		
3/28 15:00		100.4			82.0	157.3			65.0					
3/28 16:00	47.6		82.3	121.8			111.7	92.6		48.6	75.7	57.9		
3/28 19:30	46.3		81.0	122.7			-4.4	93.8		37.7	77.9	57.7		
3/28 19:30		110.6			81.6	155.0			65.0					
3/28 20:35	49.6		81.5	122.8			41.3	94.4		43.7	79.4	57.6		
3/28 20:35		68.2			82.8	155.2			64.7					
3/28 21:10	48.2		82.2	122.8			41.9	94.3		33.8	80.0	57.6		
3/28 21:20	49.7		82.3	122.9			42.3	94.5		21.7	79.6	57.6		
3/28 21:40	52.4		82.0	121.7			41.6	94.5		27.8	80.0	57.6		
3/28 23:00	53.7	73.7	81.5	121.9	77.9	153.5	40.5	94.8	64.3	40.0	81.1			
3/28 23:30	53.7		81.5	121.9			40.5	94.8		40.0	81.1	57.5		
3/29 0:00	53.8		81.6	121.8			43.0	95.1		37.2	81.1	57.5		

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
3/29 4:45	61.5		82.0	120.9			37.8	96.7		45.3	80.1	57.2		
3/29 4:45		80.8			79.5	157.6			64.1					
3/29 5:15	61.6		82.0	120.4			36.4	95.7		45.0	79.9	57.2		
3/29 10:15	63.8		82.6	118.9	49.6	156.5				21.5	82.4	57.0		
3/29 10:15		82.8					29.0	96.3	63.9					
3/29 10:45	62.9		83.2	111.1	51.1	148.8				29.0	82.2	57.0		
3/29 12:00	62.2		83.4	121.2	51.7	150.4				18.1	82.3	56.9		
3/29 14:30	62.3		82.9	120.7	49.3	152.3				36.3	81.1	56.8		
3/29 14:30		82.9					19.8	96.7	64.5					
3/29 15:15	63.2		82.3	120.9	34.2	153.4				36.4	80.4	56.8		
3/29 15:45	64.5		82.0	120.5	36.2	153.1				29.3	80.4	56.8		
3/29 16:10	64.6	85.7	82.0	120.7	37.7	152.7	17.5	96.5	64.6	38.9	80.5			
3/29 16:50	64.1		80.7	119.7	40.4	154.5				31.9	79.9	56.7		
3/29 22:10	77.2		70.1	114.6	71.5	163.2				39.1	62.9	56.5		
3/29 22:10		93.6					38.2	87.0	64.6					
3/29 23:00	77.5		69.9	113.7	73.0	162.1				38.6	59.9	56.5		
3/29 23:00		93.2					36.8	86.9	64.6					
3/30 3:20	76.8		67.5	115.4	72.0	172.2				38.5	100.5	56.3		
3/30 3:20		81.2					35.4	94.9	64.5					
3/30 3:50	75.3		67.3	116.0	72.5	170.7				41.5	102.7	56.3		
3/30 8:30	75.2		62.7	115.9	72.6	165.4				52.5	87.3	56.2		
3/30 8:30		79.8					45.9	98.7	64.4					
3/30 13:00	77.1		63.5	115.0	74.0	165.8				56.4	89.5	55.9		
3/30 13:00		80.9					47.8	98.7	64.8					
3/30 13:30	76.7		64.4	115.4	73.7	165.0				57.8	90.3	55.9		
3/30 18:20	78.7		52.1	114.2	77.0	164.0				56.7	90.7	55.7		
3/30 18:20		86.8					53.8	98.6	65.1					
3/30 19:00	79.5		49.5	114.5	77.5	164.0				55.7	90.8	55.7		
3/30 23:20	81.5		50.4	113.1	76.3	157.4				49.7	93.4	55.5		
3/30 23:30	82.9	91.2	50.1	113.1	76.1	157.8	53.7	99.1	64.8	43.1	93.2			
3/30 23:50	83.5		50.5	113.2	76.9	158.3				39.1	93.7	55.5		
3/31 4:10	85.0		50.7	113.8	77.0	156.5				69.2	95.3	55.4		
3/31 4:20	87.8	90.9	50.5	113.9	76.8	156.1	58.9	98.9	64.6	69.3	95.3			
3/31 4:40	88.5		53.7	114.2	76.6	157.7				69.7	93.7	55.3		
3/31 9:40	88.6		57.4	114.4	78.0	155.5				73.8	96.7	55.2		
3/31 9:40		92.2					70.3	98.7	64.6					
3/31 16:10	93.4		52.5	115.0	80.2	156.2				72.4	99.0	55.0		
3/31 16:10		97.0					70.9	98.6	65.0					
3/31 16:45	93.0		53.2	115.4	80.2	155.4				72.8	98.9	55.0		
3/31 19:00	92.2		53.8	114.8	81.5	157.2				72.6	97.8	54.9		
3/31 19:00		97.8					73.8	96.9	64.4					
3/31 19:30	93.9		54.7	114.6	81.3	161.2				73.1	109.8	54.9		
3/31 19:50	94.4		55.3	114.1	80.9	163.5				73.6	104.2	54.9		
4/1 0:00	100.9		61.8	112.4	80.4	155.5				77.3	117.4	54.7		
4/1 0:00		98.1					84.9	93.2	63.8					

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
4/1 0:45	100.8		60.6	112.3	80.8	156.5				79.2	110.9	54.7		
4/1 5:15	92.7		59.4	115.9	83.6	158.8				73.5	105.9	54.6		
4/1 5:15		98.6					57.9	97.6	63.8					
4/1 5:45	92.6		59.0	116.3	83.4	159.1				73.6	103.4	54.6		
4/1 11:10	89.2		63.0	117.5	85.1	156.0				74.8	98.2	54.4		
4/1 11:10		98.8					67.1	98.3	64.1					
4/1 11:45	90.2		63.8	117.8	84.7	155.8				73.5	98.1	54.4		
4/1 15:00	90.9		63.8	118.6	86.0	151.2				75.5	98.6	54.3		
4/1 15:00		98.6					74.4	98.2	64.5					
4/1 15:30	90.0		63.9	118.3	85.6	149.0				76.7	98.8	54.3		
4/1 20:00	91.6		71.3	118.5	86.0	156.0				81.4	101.0	54.1		
4/1 20:00		100.4					79.7	98.1	64.5					
4/1 20:30	91.5		71.3	118.6	85.8	155.9				81.7	101.0	54.1		
4/2 1:00	90.7		73.9	119.4	87.6	156.3				84.2	102.5	54.0		
4/2 1:00		101.6					81.4	98.3	64.3					
4/2 1:30	90.8		73.8	119.4	86.4	155.7				82.5	103.1	54.0		
4/2 5:55	91.9		77.2	119.4	87.3	153.8				83.1	103.0	53.8		
4/2 5:55		101.1					58.5	97.8	64.4					
4/2 6:25	91.9		79.7	119.6	87.7	153.6				83.2	103.5	53.8		
4/2 11:05	93.3		78.0	119.6	88.0	154.8				88.4	104.7	53.7		
4/2 11:05		98.9					79.1	97.8	64.7					
4/2 11:40	91.9		79.3	118.9	88.2	154.9				89.1	104.2	53.7		
4/2 12:10	92.3		78.7	117.8	88.2	156.3				90.5	103.9	53.7		
4/2 12:10		100.7					67.6	96.7	64.7					
4/2 16:00	96.3		81.5	115.0	85.8	165.1				91.1	119.3	53.6		
4/2 16:00		102.8					79.1	92.1	64.7					
4/2 16:30	96.7		81.3	114.6	85.4	165.4				90.0	123.8	53.6		
4/2 21:00	93.8		82.0	114.9	87.0	160.6				64.0	129.9	53.5		
4/2 21:00		101.0					69.9	95.3	64.4					
4/2 21:30	93.9		81.8	114.7	87.6	160.9				74.0	127.4	53.4		
4/3 2:00	90.7		78.7	115.7	88.4	155.1				83.2	104.9	53.3		
4/3 2:00		100.0					56.6	99.4	63.7					
4/3 2:30	90.6		72.4	115.9	88.4	155.5				80.7	104.8	53.3		
4/3 7:00	91.3		82.0	115.7	90.4	156.6				91.0	106.2	53.2		
4/3 7:00		99.9					69.4	98.9	63.0					
4/3 7:30	91.2		82.3	115.5	90.6	157.1				90.8	106.0	53.1		
4/3 9:15	90.5		81.6	114.8	90.5	156.4				91.0	105.9	53.1		
4/3 9:15		102.2					66.9	98.9	63.2					
4/3 10:00	89.5		83.0	115.1	90.8	156.0				91.1	106.3	53.1		
4/3 10:30	90.6		83.0	114.3	90.7	156.5				94.2	106.2	53.1		
4/3 10:30		101.4					66.5	98.5	63.3					
4/3 11:00	89.6		83.1	114.0	90.8	156.0				92.1	106.7	53.1		
4/3 12:00	88.7		82.8	114.1	90.8	155.4				94.2	106.3	53.0		
4/3 12:00		101.7					59.5	98.6	63.3					
4/3 12:30	89.6		82.2	114.1	91.0	155.3				94.3	106.4	53.0		

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
4/3 13:00	89.7		82.9	114.3	91.4	154.7				94.5	106.4	53.0		
4/3 13:30	89.7		81.7	113.9	91.3	154.6				95.0	106.2	53.0		
4/3 17:00	89.9		79.7	113.4	91.6	155.1				95.9	107.8	52.9		
4/3 17:00		100.2					34.8	98.5	63.8					
4/3 17:35	89.9		79.3	113.5	91.5	154.9				93.8	108.4	52.9		
4/3 18:00	88.0		80.1	113.4	91.3	155.2				95.3	108.3	52.9		
4/3 18:00		99.3					35.1	98.7	63.7					
4/3 21:00	88.3		81.5	113.8	91.7	155.8				91.6	108.3	52.8		
4/3 21:00		100.6					37.7	98.5	63.5					
4/3 22:00	88.8		79.0	113.8	91.4	155.1				93.2	108.5	52.8		
4/4 3:00	89.6		81.5	114.1	92.8	154.7				92.8	109.2	52.6		
4/4 3:00		100.9					41.0	98.8	62.5					
4/4 3:30	89.8		80.1	114.1	92.2	155.4				94.9	109.4	52.6		
4/4 8:00	89.4		78.7	114.4	93.2	154.8				94.1	109.6	52.5		
4/4 8:00		104.7					44.0	99.0	62.3					
4/4 8:30	89.4		80.1	113.3	93.4	154.9				93.0	109.6	52.5		
4/4 9:30	90.0		80.8	113.7	93.6	154.3				93.7	109.8	52.5		
4/4 14:30	89.8		80.4	113.5	94.6	155.9				95.6	109.8	52.3		
4/4 14:30		104.2					48.5	99.0	63.3					
4/4 18:30	88.0		81.5	113.7	96.4	157.4				94.8	110.0	52.2		
4/4 18:30		105.1					51.1	98.7	63.4					
4/4 19:00	88.8		80.4	113.5	96.4	156.4				93.6	110.1	52.2		
4/5 0:00	90.2		82.5	106.7	97.7	167.4	52.2	95.3	62.3	89.3	124.5	52.1		
4/5 0:30	89.9		81.3	107.4	97.9	167.7	44.8	95.2	62.3	89.7	128.3	52.1		
4/5 5:10	81.5		79.2	113.5	98.4	160.5				94.2	110.5	51.9		
4/5 5:10		105.9					52.7	99.4	62.2					
4/5 5:40	84.7		80.1	113.7	98.1	159.9				92.7	109.9	51.9		
4/5 10:20	84.7		80.8	114.1	99.4	158.1				94.6	108.1	51.8		
4/5 10:20		106.5					59.4	99.5	62.7					
4/5 17:10	81.7		80.0	114.1	98.3	155.7				97.9	108.6	51.6		
4/5 17:10		107.7					46.1	99.3	63.5					
4/5 18:30	83.5		81.1	114.1	98.2	155.6				95.9	108.8	51.5		
4/6 0:00	84.4		84.1	114.1	99.2	154.9				97.3	109.5	51.4		
4/6 0:00		107.4					63.5	99.4	63.7					
4/6 6:30	74.6		83.6	114.7	99.0	154.6				94.6	110.0	51.2		
4/6 6:30		109.5					52.3	100.5	63.4					
4/6 12:30	78.8		84.9	115.0	99.3	152.7				94.9	110.6	51.0		
4/6 12:30		104.1					42.0	99.1	64.0					
4/6 18:00	83.0		85.2	114.2	99.9	153.6				97.3	110.7	50.8		
4/6 18:00		108.6					51.7	89.8	64.1					
4/7 0:00	78.2		85.8	115.6	100.0	153.9				96.8	111.9	50.6		
4/7 0:00		108.6					51.9	98.7	64.0					
4/7 6:00	83.4		86.2	115.8	98.8	152.5				96.8	114.2	50.4		
4/7 6:15	82.9	109.1	84.8	116.0	99.3	152.2	46.8	98.6	63.7	96.6	114.1			
4/7 12:00	88.3		84.8	112.3	97.6	153.3				97.3	189.6	50.2		

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
4/7 12:00		108.6					47.9	97.6	63.8					
4/7 12:40										95.5	197.3			
4/7 12:40							46.6	97.6		95.5				
4/7 18:00	85.7		84.7	111.6	98.0	145.0				93.3	138.1	50.1		
4/7 18:00		107.7					44.4	99.4	63.7					
4/7 19:30	86.6		84.0	111.6	98.4	144.5				91.9	135.1	50.0		
4/8 1:30	88.2		80.9	110.8	103.7	135.2				86.6	140.0	49.8		
4/8 1:35	87.8	105.1	80.6	111.1	103.4	135.7	95.1	99.9	113.4	86.3	144.4			
4/8 6:00	85.9		84.2	111.2	101.9	134.9				83.6	140.2	49.7		
4/8 6:15	85.8	105.1	84.7	110.9	102.5	135.1	82.3	99.4	63.3	83.9	140.4			
4/8 6:40	86.3		84.6	110.5	102.3	135.7				85.3	141.0	49.6		
4/8 12:00	88.8		84.3	110.7	120.0	134.2				83.8	144.6	49.5		
4/8 12:00		104.4					86.5	98.6	63.8					
4/8 18:00	86.3		84.0	111.1	109.1	139.0				85.4	145.1	49.3		
4/8 18:00		104.9					86.1	99.5	63.6					
4/9 0:00	99.2		84.3	107.5	102.4	144.3				86.1	182.8	49.1		
4/9 0:00		104.0					92.7	97.7	63.8					
4/9 6:15	96.6		75.5	109.4	100.6	141.1				76.2	146.9	48.9		
4/9 6:15		100.5					81.1	100.5	63.5					
4/9 12:25	96.6		73.4	109.2	100.4	140.4				83.5	138.8	48.8		
4/9 12:25		99.8					81.1	100.9	63.3					
4/9 18:25	97.3		68.9	109.8	100.1	140.0				81.6	144.5	48.6		
4/9 18:25		103.6					88.5	100.7	63.1					
4/10 0:00	98.7		68.1	110.4	102.3	139.9				87.0	149.7	48.4		
4/10 0:00		105.2					84.8	100.9	62.0					
4/10 6:00	91.7		58.9	110.8	104.8	139.5				89.1	153.9	48.3		
4/10 6:00		104.7					79.8	101.2	58.4					
4/10 12:00	95.3		65.5	111.2	101.9	141.6				85.7	159.6	48.1		
4/10 12:00		105.6					80.8	100.9	56.5					
4/10 18:00	96.3	103.8	70.2	111.6	100.9	142.8	77.2	101.0	61.3	90.3	164.3	47.9		
4/11 0:00	97.7	103.6	76.4	110.2	99.3	145.4	73.2	100.4	56.1	95.8	212.6	47.8		
4/11 6:00	97.7	103.9	77.4	110.5	100.7	142.8	77.0	100.2	56.0	91.0	161.1	47.6		
4/11 12:00	97.0	107.1	77.9	111.0	99.8	140.4	81.1	99.8	56.5	93.4	159.6	47.5		
4/11 18:30	97.9	108.8	86.6	112.7	104.6	143.5	96.1	99.5	56.1	85.0	160.8	47.2		
4/12 0:00	102.0	110.6	87.2	113.2	105.8	143.2	97.7	99.4	60.3	83.2	164.8	47.1		
4/12 6:00	105.4	110.6	86.0	115.6	106.0	141.4	102.4	99.4	61.9	84.4	166.6	47.0		
4/12 12:00	98.9	110.2	87.0	115.9	104.5	144.1	103.7	99.0	61.7	89.5	166.2	46.8		
4/12 15:10	98.6	110.4	83.4	115.4	109.4	138.7	99.5	98.3	62.8	79.4	168.9	46.8		
4/12 18:00	97.4	111.3	81.6	116.5	110.2	140.2	99.8	98.4	62.9	80.1	170.4	46.7		
4/12 22:10	96.0	111.6	81.5	119.3	111.4	144.0	103.0	98.3	62.1	84.9	170.8	46.6		
4/13 6:00	92.4	111.8	80.3	118.7	109.9	151.5	107.5	98.7	61.9	92.4	187.9	46.4		
4/13 12:10	92.2	112.7	79.2	117.3	110.0	153.4	107.8	98.7	62.4	93.4	195.7	46.3		
4/13 18:00	92.7	112.4	81.3	117.4	111.9	154.1	108.7	98.7	63.0	94.9	209.0	46.1		
4/14 0:00	90.4	115.7	80.2	122.0	115.3	161.5	110.4	98.9	62.9	96.1	246.1	46.0		
4/14 6:05	89.3	116.1	93.6	122.6	115.5	166.8	112.4	100.0	62.8	92.4	251.7	45.8		

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
4/14 12:00	89.9	115.6	77.8	121.7	113.1	164.9	111.4	98.7	63.1	93.9	253.6	45.7		
4/14 18:00	90.0	115.2	78.1	122.9	113.3	162.5	115.6	99.0	63.1	93.2	256.7	45.6		
4/15 0:00	91.2	115.2	78.0	121.1	112.4	162.2	115.4	98.6	62.9	87.7	261.1	45.4	45.4	
4/15 6:00	90.1	115.3	80.2	121.4	110.6	162.9	116.5	98.7	62.7	80.8	262.3	45.3	45.3	
4/15 12:00	89.6	116.1	79.5	121.5	112.4	167.3	118.8	98.8	63.0	82.0	263.4	45.2	45.2	
4/15 18:00	91.2	116.5	85.2	121.3	110.1	166.6	119.3	99.1	63.2	80.4	265.2	45.0	45.0	
4/16 0:00	91.4	116.6	92.8	122.1	111.7	166.6	120.5	99.1	63.1	93.9	266.9	44.9	44.9	
4/16 6:00	91.1	116.0	101.6	121.3	111.6	167.6	121.2	99.2	62.9	95.1	267.7	44.8	44.8	
4/16 12:10	89.3	115.8	95.3	119.7	113.5	168.7	120.8	98.7	63.0	97.9	269.2	44.6	44.6	
4/16 18:00	92.7	116.8	86.7	120.4	112.2	159.7	120.5	99.0	65.1	99.5	261.2	44.5	44.5	
4/17 0:00	89.3	117.1	89.0	121.7	113.6	160.5	122.3	99.3	63.9	99.1	258.7	44.4	44.4	
4/17 6:00	90.7	117.5	90.4	121.7	114.7	166.2	123.7	99.8	57.1	103.9	253.2	44.3	44.3	
4/17 14:00	98.4	112.4	98.4	118.6	106.8	147.2	123.0	100.3	57.4	104.7	249.5	44.1	44.1	
4/17 19:00	98.5	110.6	100.7	116.2	105.8	145.1	119.5	99.8	57.5	82.5		44.0	44.1	
4/18 0:00	98.5	110.4	101.0	115.2	104.9	143.2	119.2	100.4	57.1	81.8	242.8	43.9	43.9	
4/18 6:00	99.9	109.2	105.1	114.3	102.7	140.4	121.3	100.2	56.7	80.1	240.4	43.8	43.8	
4/18 12:00	101.2	108.4	106.5	113.2	102.7	137.8	119.4	100.4	57.1	78.9	236.9	43.7	43.7	
4/18 13:10	101.5	108.7	105.7	112.7	102.4	137.1	121.3	101.0	57.7	79.2	236.3	43.7	43.7	
4/18 13:45	101.6		105.5	112.4	102.2	136.2				76.2	236.0	43.6	43.6	
4/18 18:00	102.8	108.3	109.4	111.2	100.8	136.9	120.5	100.1	57.3	77.6	232.8	43.6	43.6	
4/19 0:00	102.6	108.0	110.6	111.2	99.7	131.6	119.0	100.1	57.0	78.6	229.7	43.5	43.4	
4/19 6:00	102.2	106.6	112.9	110.3	97.9	134.7	117.4	100.1	57.4	79.5	226.5	43.4	43.3	
4/19 12:00	101.1	106.6	113.2	109.8	97.4	135.1	118.9	100.3	57.5	80.4	221.6	43.2	43.2	
4/19 18:10	99.7	106.7	118.1	109.7	96.4	133.7	117.6	100.4	57.6	78.4	219.3	43.1	43.1	
4/20 0:02	98.5	106.6	120.4	109.5	96.3	132.7	113.9	100.3	57.1	78.3	216.6	43.0	43.0	
4/20 6:00	98.7	105.6	121.3	108.4	95.1	126.7	108.9	100.4	57.0	79.5	215.0	42.9	42.9	
4/20 12:00	100.2	104.7	123.7	107.5	95.8	124.8	111.8	102.6	57.1	71.5	210.7	42.8	42.8	
4/20 18:10	100.4	104.7	130.9	108.5	95.8	133.8	108.7	105.5	57.1	72.0	205.5	42.7	42.7	
4/20 23:50	100.7	104.7	135.3	110.9	96.7	135.4	96.1	104.3	57.0	58.0	199.3	42.7	42.7	
4/21 6:00	101.6	103.2	137.3	109.4	96.6	137.6	90.5	103.6	56.9	61.9	193.9	42.6	42.6	
4/21 12:00	100.4	104.4	139.7	110.4	96.9	140.2	73.6	103.6	57.2	69.4	192.6	42.5	42.5	
4/21 18:00	100.0	102.8	144.7	110.0	96.3	140.0	72.3	103.3	57.1	74.3	191.3	42.4	42.4	
4/22 0:00	99.5	103.3	146.0	110.9	119.1	142.2	67.8	102.5	57.0	65.8	142.0	42.3	42.3	
4/22 6:00	93.3	101.2	150.4	110.4	119.4	143.5	86.3	102.9	57.6	63.7	138.6	42.3	42.3	
4/22 11:50	92.4	104.2	148.8	111.6	116.1	146.3	77.2	102.6	57.8	62.8	137.9	42.2	42.2	
4/22 17:50	80.5	101.8	149.9	110.1	113.3	146.2	81.7	102.3	58.5	57.3	136.6	42.1	42.1	
4/23 0:00	81.7	100.7	150.0	109.2	110.8	148.1	71.8	102.2	58.6	58.1	135.2	42.1	42.1	
4/23 6:15	85.9	98.2	154.9	109.4	108.5	108.9	65.2	101.4	58.9	56.2	134.2	42.0	42.0	
4/23 11:55	85.7	94.8	152.1	108.6	104.3	129.5	72.4	100.6	59.2	55.7	132.9	41.9	41.9	
4/23 18:00	81.1	90.0	153.0	110.1	100.6	144.4	80.5	100.6	59.4	57.3	130.6	41.9	41.9	
4/24 0:00	79.1	94.6	155.7	109.6	102.7	150.4	81.9	99.5	59.6	64.4	129.6	41.8	41.8	
4/24 5:50	81.1	93.2	160.7	109.9	104.3	151.9	79.4	99.5	59.3	63.5	128.3	41.8	41.8	
4/24 12:00	65.5	95.6	163.2	110.6	102.9	140.5	74.9	98.6	59.4	65.2	126.6	41.7	41.7	
4/24 18:00	71.6	94.6	165.5	110.2	102.8	142.7	68.0	98.3	59.4	65.3	126.6	41.7	41.7	
4/25 0:00	74.6	93.0	169.0	110.8	103.4	129.6	60.4	98.4	59.2	67.8	124.3	41.6	41.6	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
4/25 6:00	72.5	91.2	165.9	109.3	99.3	130.0	53.0	98.5	58.9	70.2	122.5	41.6	41.6	
4/25 11:00	68.8	86.4	164.8	110.0	99.5	145.8	43.2	97.8	59.6	69.5	120.0	41.6	41.5	
4/25 17:00	77.7	85.3	163.8	110.0	98.0	153.0	53.6	97.3	59.5	61.4	117.6	41.5	41.5	
4/25 23:00	84.9	92.7	155.7	109.8	98.8	158.4	62.6	96.7	59.2	64.5	103.1	41.4	41.4	
4/26 5:00	67.9	92.7	151.0	110.4	94.9	156.8	66.7	97.0	59.0	67.3	117.9	41.4	41.4	
4/26 9:00	82.5	90.7	149.4	110.7	97.0	158.0	43.4	96.7	59.1	69.0	121.5	41.4	41.4	
4/26 17:00	86.2	93.9	154.8	110.5	94.3	160.7	62.4	96.0	59.6	71.2	122.2	41.3	41.3	
4/26 23:00	85.6	95.8	156.6	110.7	92.0	158.7	63.2	96.1	59.7	96.7	122.2	41.2	41.2	
4/27 5:00	72.0	95.1	153.1	110.7	94.3	157.0	51.7	96.3	59.9	101.9	121.7	41.2	41.2	
4/27 11:00	82.3	96.4	150.4	110.3	95.3	153.7	50.0	97.3	59.9	103.6	123.4	41.1	41.1	
4/27 17:00	83.2	95.7	143.2	109.9	92.4	156.8	36.0	96.7	60.6	104.0	124.6	41.1	41.1	
4/27 23:00	84.6	96.4	137.1	110.2	90.5	152.1	56.6	97.2	60.7	102.9	124.1	41.1	41.1	
4/28 5:00	86.0	98.6	129.5	109.6	92.7	150.9	57.8	96.2	60.9	102.1	124.7	41.0	41.0	
4/28 11:00	85.1	102.1	127.2	109.4	91.3	154.4	54.7	95.6	60.7	98.9	125.4	41.0	41.0	
4/28 17:10	83.5	101.4	124.1	110.0	94.9	150.1	54.7	96.0	60.6	95.5	128.0	41.0	41.0	
4/28 23:00	82.4	103.1	120.6	112.1	92.2	149.7	96.3	96.8	60.5	98.1	129.1	40.9	40.9	
4/29 5:00	81.3	104.1	114.7	112.7	91.6	150.8	85.1	96.7	60.2	98.6	128.3	40.9	40.9	
4/29 11:00	80.6	105.2	111.0	112.9	84.0	151.7	84.0	96.7	60.3	97.2	127.4	40.9	40.9	
4/29 17:00	80.9	105.6	105.1	113.7	83.7	151.2	84.5	96.3	60.4	97.6	127.6	40.8	40.8	
4/29 23:00	81.6	107.9	106.2	113.3	83.2	147.1	84.8	96.1	60.1	97.9	128.6	40.8	40.8	
4/30 5:00	83.6	111.6	100.9	113.1	84.6	150.0	81.6	97.0	60.0	101.2	125.3	40.7	40.7	
4/30 10:00	84.6	113.8	100.6	114.7	87.6	152.1	79.2	96.2	60.4	100.2	129.7	40.7	40.7	
4/30 11:30	84.8	114.7	101.2	113.4	88.2	150.0	79.8	96.5	60.3	96.9	128.8	40.7	40.7	
4/30 17:00	89.1	117.4	98.5	116.5	91.6	153.0	99.7	96.9	61.0	96.7	134.7	40.7	40.7	
4/30 23:00	90.5	119.2	98.2	116.6	97.6	154.6	94.3	96.6	61.2	99.3	137.3	40.6	40.6	
5/1 5:00	93.7	122.3	99.6	116.5	98.8	154.6	91.3	96.9	61.2	101.7	137.3	40.6	40.6	
5/1 10:15	90.8	124.1	102.2	118.4	102.7	153.6	91.7	97.2	61.4	101.7	138.7	40.6	40.6	
5/1 17:00	96.1	128.0	102.9	119.9	104.6	153.9	107.2	97.7	61.6	99.9	141.7	40.5	40.5	
5/1 22:50	96.8	131.7	104.4	122.4	117.2	157.0	104.4	97.5	61.6	101.5	188.2	40.5	40.5	
5/2 5:00	99.2	134.3	106.4	123.6	122.5	156.7	108.9	97.1	61.2	100.4	188.1	40.5	40.5	
5/2 11:00	100.8	140.9	115.0	125.3	127.8	156.8	112.7	98.6	61.2	108.3	189.0	40.5	40.5	
5/2 17:00	95.1	149.2	123.6	127.8	131.2	156.6	112.0	97.5	61.3	96.6	201.7	40.4	40.5	
5/2 23:00	108.0	159.9	135.6	130.1	135.4	153.4	109.5	99.3	61.1	92.0	212.3	40.4	40.4	
5/3 5:00	111.6	182.1	147.1	128.5	139.3	157.2	119.5	100.0	60.9	106.0	202.2	40.4	40.4	
5/3 11:00	116.6	184.3	150.1	135.1	148.6	161.2	129.3	101.1	60.8	100.5	205.0	40.4	40.4	
5/3 17:00	112.6	194.6	158.7	136.7	157.9	162.9	134.9	100.1	60.9	93.1	200.8	40.3	40.4	
5/3 23:00	115.4	203.7	176.7	135.6	167.7	165.9	141.8	100.8	60.7	99.9	198.2	40.3	40.3	
5/4 5:00	122.6	210.8	184.8	138.6	169.4	167.8	143.7	101.9	60.7	103.5	194.2	40.3	40.3	
5/4 11:00	128.5	217.1	125.7	140.0	175.1	169.6	153.2	103.0	60.7	111.2	213.1	40.3	40.3	
5/4 14:00	119.9	220.0	124.2	139.4	165.2	170.5	150.6	102.4	60.6	104.2	215.0	40.3	40.3	
5/4 17:00	135.1	221.2	124.3	141.2	165.2	171.2	132.2	103.1	60.5	109.0	230.9	40.2	40.3	
5/4 23:00	133.4	227.3	214.9	139.9	169.8	173.2	150.2	103.3	59.9	115.7	217.1	40.2	40.2	
5/5 2:00	133.1	231.3	222.2	141.2	170.0	172.6	155.3	103.8	59.7	115.5	220.3	40.2	40.2	
5/5 5:00	144.0	233.7	228.0	142.7	171.9	173.0	145.2	103.6	59.6	119.6	222.2	40.2	40.2	
5/5 11:00	156.6	239.0	240.7	143.5	175.6	172.5	169.6	103.7	60.0	117.7	228.1	40.2	40.2	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/5 17:00	157.5	244.4	252.0	145.0	184.3	173.1	151.3	103.0	60.5	124.4	225.3	40.1	40.2	
5/5 23:00	156.1	249.7	261.4	147.2	211.5	172.9	176.8	103.2	61.1	125.9	234.1	40.1	40.1	
5/6 5:00	162.0	255.8	273.0	146.8	220.3	173.0	181.1	103.7	61.3	131.9	238.3	40.1	40.1	
5/6 11:00	163.5	258.6	277.4	147.4	224.8	174.8	183.8	104.9	61.6	137.1	243.1	40.1	40.1	
5/6 17:00	171.0	261.4	286.5	148.0	230.9	175.1	178.5	105.2	61.9	141.7	219.3	40.1	40.1	
5/6 23:00	182.1	262.9	291.7	148.7	233.5	174.7	189.5	106.2	62.1	147.5	199.1	40.1	40.1	
5/7 5:00	180.2	262.9	298.0	149.6	236.1	174.8	190.0	106.7	62.2	149.5	198.5	40.0	40.1	
5/7 11:00	163.2	260.9	300.7	150.3	162.2	176.2	181.8	107.7	62.6	153.0	206.0	40.0	40.1	
5/7 17:00	193.8	259.3	303.8	150.4	245.4	174.2	187.6	107.7	62.8	155.9	208.3	40.0	40.0	
5/7 23:00	202.3	258.4	307.3	152.2	250.2	172.0	187.1	108.6	63.0	154.2	204.4	40.0	40.0	
5/8 5:00	202.1	255.6	310.1	151.9	253.6	173.3	158.2	108.8	63.0	157.6	208.6	40.0	40.0	
5/8 11:00	206.2	256.3	314.5	151.3	253.8	175.6	122.9	109.4	63.1	157.7	207.3	40.0	40.0	
5/8 17:00	217.2	236.0	322.9	151.9	206.3	173.2	118.4	110.6	63.4	156.0	207.3	40.0	40.0	
5/8 23:00	217.2	239.4	326.0	153.0	235.3	172.2	118.4	111.2	63.2	157.1	207.2	40.0	40.0	
5/9 5:00	210.4	239.8	329.4	153.0	250.2	171.7	104.6	112.4	62.9	154.5	209.7	40.0	40.0	
5/9 11:00	216.4	238.4	333.9	154.3	246.2	173.3	109.5	113.3	63.1	147.4	209.7	40.0	40.0	
5/9 17:00	216.4	231.2	332.9	145.8	241.5	174.3	105.5	113.4	63.4	149.2	208.6	40.0	40.0	
5/9 23:00	218.7	237.1	300.0	150.4	194.0	173.1	107.3	113.4	63.5	145.3	207.4	40.0	40.0	
5/10 5:00	192.7	237.1	132.4	150.6	167.1	171.9	105.4	113.2	63.7	143.2	205.5	40.0	40.0	
5/10 11:00	214.5	234.2	121.5	151.9	148.7	170.6	96.3	113.6	63.9	144.8	205.1	40.0	40.0	
5/10 17:00	215.5	230.7	122.0	151.7	214.8	168.9	90.7	114.2	63.8	144.1	203.9	40.0	40.1	
5/10 23:00	218.7	235.2	121.6	152.5	223.1	167.4	95.8	114.9	63.3	142.6	203.7	40.0	40.1	
5/11 5:00	215.3	236.4	155.9	152.4	223.9	167.4	104.0	115.5	63.2	142.6	202.6	40.0	40.1	
5/11 11:00	220.3	231.3	125.7	149.4	221.2	162.2	100.4	116.0	63.5	135.6	202.9	40.0	40.1	
5/11 17:00	221.7	221.7	134.8	151.5	162.9	160.9	99.2	116.1	63.6	138.9	202.2	40.0	40.1	
5/11 22:50	216.0	230.5	136.7	151.2	161.6	160.8	85.2	116.3	63.2	137.5	200.8	40.1	40.1	
5/12 5:00	215.9	232.2	280.9	150.2	156.6	160.2	99.6	116.1	62.9	136.1	199.6	40.1	40.1	
5/12 11:15	189.2	232.0	283.6	149.0	202.7	161.2	93.3	115.4	62.4	133.9	197.7	40.1	40.1	
5/12 16:50	183.5	242.7	284.1	148.8	200.7	160.3	98.7	115.5	63.0	132.8	196.2	40.1	40.1	
5/12 20:00	195.3	237.1	289.2	148.6	195.7	165.2	100.8	114.5	63.6	132.1	191.6	40.1	40.2	
5/12 23:00	161.5	244.8	295.6	149.9	185.1	167.5	99.0	113.6	63.8	127.9	186.2	40.1	40.2	
5/13 2:00	181.8	238.0	233.0	146.0	135.0	168.2	98.9	111.4	63.9	130.5	180.4	40.1	40.2	
5/13 5:00	170.5	241.5	127.3	145.7	161.8	170.2	96.3	111.0	64.1	130.5	179.9	40.1	40.2	
5/13 8:00	170.6	225.9	122.4	146.0	167.0	171.4	94.4	110.9	64.0	127.7	180.3	40.1	40.2	
5/13 11:00	155.4	224.0	121.2	142.7	155.7	173.3	88.4	109.9	64.0	127.8	176.8	40.1	40.2	
5/13 14:00	150.0	219.8	124.4	145.0	146.6	175.7	89.8	109.7	63.9	127.5	172.8	40.1	40.2	
5/13 17:00	163.3	222.9	123.4	144.7	156.5	179.7	82.3	108.6	63.7	127.8	200.7	40.2	40.2	
5/13 20:00	158.0	226.1	120.4	146.7	162.7	184.9	84.2	108.7	63.7	128.6	199.3	40.2	40.2	
5/13 23:00	162.2	228.6	119.5	146.2	171.5	186.2	70.0	107.8	63.4	129.4	198.4	40.2	40.2	
5/14 2:00	161.8	233.3	120.0	146.1	180.2	189.0	63.8	108.5	63.4	125.8	185.9	40.2	40.2	
5/14 5:00	154.9	233.0	250.5	148.1	185.1	194.5	41.9	108.5	62.8	125.3	171.9	40.2	40.2	
5/14 8:00	165.0	236.0	260.9	150.0	190.2	197.0	50.5	108.0	62.7	133.6	177.7	40.2	40.3	
5/14 11:00	164.8	237.3	260.6	147.1	201.2	205.5	49.6	107.2	63.6	137.1	183.5	40.2	40.3	
5/14 14:00	154.0	236.2	243.4	146.3	200.0	207.2	52.8	104.7	64.2	132.7	184.3	40.2	40.3	
5/14 17:00	161.4	252.0	266.6	151.5	229.5	217.7	61.9	122.2	64.2	153.7	211.9	40.2	40.3	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/14 20:00	157.7	256.0	275.3	144.9	241.7	234.5	67.4	131.7	64.1	168.2	232.6	40.3	40.3	
5/14 23:00	116.3	259.1	296.3	139.5	254.2	239.0	65.3	142.0	63.9	179.4	242.3	40.3	40.3	
5/15 2:00	133.4	270.6	295.9	137.2	249.2	245.6	37.2	148.1	64.0	187.4	248.0	40.3	40.4	
5/15 5:00	139.8	275.5	297.0	136.5	256.6	246.3	17.9	154.7	63.9	197.5	241.1	40.3	40.4	
5/15 8:00	140.1	272.6	297.5	139.4	256.3	250.3	4.1	155.5	64.0	196.5	235.4	40.3	40.4	
5/15 9:00	138.9	274.9	297.0	137.4	223.3	252.4	15.5	155.2	64.0	195.2	222.4	40.3	40.4	
5/15 11:00	141.1	264.3	294.6	139.0	197.0	254.7	35.9	154.0	64.1	196.2	202.4	40.4	40.4	
5/15 14:00	157.7	248.5	291.8	139.9	269.6	259.2	39.9	151.4	64.3	196.8	225.0	40.4	40.4	
5/15 17:00	152.6	235.1	286.6	144.2	192.6	261.4	53.4	149.8	64.5	180.9	235.2	40.4	40.5	
5/15 20:00	149.3	234.4	283.2	142.5	196.6	259.2	42.7	148.2	64.4	178.8	214.3	40.4	40.5	
5/15 23:00	146.3	227.5	283.9	142.0	251.3	258.6	46.1	145.4	64.4	179.5	211.6	40.5	40.5	
5/16 2:00	149.0	224.5	278.3	142.6	250.1	262.7	51.7	142.3	64.3	178.5	206.9	40.5	40.5	
5/16 5:00	141.3	216.5	269.0	136.2	258.6	267.0	27.0	137.7	64.2	168.3	196.8	40.5	40.6	
5/16 8:00	145.7	214.9	261.8	134.7	257.3	279.1	67.3	133.5	64.2	165.8	170.3	40.5	40.6	
5/16 11:00	143.4	212.9	259.2	133.2	202.3	270.2	94.5	131.8	64.3	170.3	170.8	40.6	40.6	
5/16 14:00	138.9	206.4	258.2	130.9	195.7	268.7	92.1	131.0	64.5	172.1	165.6	40.6	40.6	
5/16 17:00	138.4	202.8	256.8	129.8	231.0	265.3	88.6	130.1	64.8	177.6	154.2	40.6	40.7	
5/16 20:00	141.4	207.8	255.5	127.2	236.0	265.4	87.1	128.3	65.0	174.8	146.2	40.6	40.7	
5/16 23:00	137.1	210.0	257.4	130.2	233.0	264.0	76.1	127.2	65.2	172.6	140.3	40.7	40.7	
5/17 2:00	138.6	211.4	258.7	129.7	170.4	263.8	66.7	128.7	65.4	171.0	133.8	40.7	40.7	
5/17 5:00	137.5	208.8	259.3	129.5	160.1	259.5	64.3	127.5	65.5	167.7	133.8	40.7	40.8	
5/17 8:00	135.3	207.8	260.1	130.5	215.1	257.1	61.7	127.6	65.7	164.4	139.0	40.7	40.8	
5/17 11:50	133.2	206.4	254.2	129.8	221.8	253.7	53.0	126.4	65.6	162.0	133.2	40.8	40.8	
5/17 14:00	133.2	202.8	254.3	128.5	218.0	256.6	46.9	122.8	65.9	159.0	133.1	40.8	40.8	
5/17 17:00	128.4	199.1	226.3	128.3	227.3	252.1	39.1	118.9	66.2	142.3	130.5	40.8	40.9	
5/17 20:00	123.1	193.9	226.5	126.8	204.7	245.1	41.0	117.6	66.3	136.4	139.2	40.9	40.9	
5/17 23:00	122.3	190.0	222.5	126.8	219.8	247.6	42.8	114.4	66.3	131.2	141.8	40.9	40.9	
5/18 2:00	119.5	187.4	221.7	126.4	202.0	236.6	38.8	111.3	66.0	128.0	146.7	40.9	41.0	
5/18 5:00	108.9	182.5	212.9	123.8	196.3	232.8	32.2	108.2	65.8	124.7	145.9	40.9	41.0	
5/18 8:00	103.6	180.6	211.3	122.3	190.7	230.3	31.9	106.1	66.0	125.9	142.2	41.0	41.0	
5/18 11:00	100.1	181.7	208.6	119.8	185.7	230.0	33.4	104.5	66.2	127.8	143.7	41.0	41.1	
5/18 14:00	103.9	180.1	204.5	118.7	183.9	228.9	31.2	103.4	66.2	131.3	137.1	41.0	41.1	
5/18 17:00	104.1	180.8	201.2	119.2	187.0	229.1	33.6	105.1	66.3	127.9	135.4	41.0	41.1	
5/18 20:00	104.0	180.4	199.3	118.3	153.0	224.7	27.0	104.5	66.2	119.2	130.1	41.1	41.2	
5/18 23:00	110.2	180.5	195.5	117.1	140.8	224.1	26.5	101.6	66.2	116.6	124.3	41.1	41.2	
5/19 2:00	109.7	169.2	195.3	115.5	153.5	219.4	25.4	99.3	66.1	115.3	117.8	41.2	41.2	
5/19 5:00	113.4	166.6	176.8	114.6	166.5	219.5	22.3	98.1	66.1	114.9	114.5	41.2	41.3	
5/19 8:00	115.6	158.2	178.4	113.8	167.7	218.7	22.7	101.1	66.8	113.8	104.7	41.3	41.3	
5/19 11:00	121.2	158.6	177.7	112.2	161.1	217.7	19.4	100.2	67.3	113.7	104.3	41.3	41.4	
5/19 14:00	117.2	157.0	180.0	112.2	155.8	216.3	15.2	97.9	67.6	116.7	104.5	41.3	41.4	
5/19 17:00	114.7	158.0	178.9	111.6	140.2	210.3	11.7	96.6	67.8	111.6	102.6	41.4	41.4	
5/19 20:00	113.6	165.4	178.5	111.0	149.0	212.7	7.0	96.1	67.9	110.5	104.1	41.4	41.5	
5/19 20:40	113.5	165.6	178.6	110.5	148.7	211.6	6.6	95.7	67.8	110.7	105.8	41.4	41.5	
5/19 23:00	113.0	166.3	178.6	110.3	113.0	211.3	6.4	96.1	67.8	110.8	101.6	41.5	41.5	
5/20 2:00	111.1	165.7	181.7	108.6	107.6	207.6	4.3	95.0	67.7	113.2	100.5	41.5	41.5	
5/20 5:00	112.0	164.9	183.1	108.2	107.6	206.2	-1.6	94.5	67.6	112.9	95.9	41.5	41.6	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/20 8:00	110.0	165.1	183.0	107.8	107.3	204.4	-7.6	93.9	67.6	112.4	93.7	41.6	41.6	
5/20 11:00	109.2	165.6	186.5	106.9	110.2	206.3	-12.8	93.8	67.6	111.9	97.0	41.6	41.7	
5/20 14:00	108.4	166.5	184.4	108.4	111.3	205.3	-8.7	94.7	67.7	108.5	98.8	41.7	41.7	
5/20 17:00	107.9	165.3	183.0	108.0	113.9	203.9	-14.8	95.7	67.9	108.0	99.7	41.7	41.8	
5/20 20:00	111.9	163.5	181.6	108.0	115.6	205.5	-21.0	95.3	68.2	107.4	102.4	41.7	41.8	
5/20 23:00	113.4	160.3	179.9	106.5	108.7	206.4	-23.9	94.6	68.2	106.5	104.4	41.8	41.8	
5/21 2:00	113.5	158.1	173.8	105.1	108.7	206.5	-25.2	94.3	68.2	106.3	103.6	41.8	41.9	
5/21 5:00	111.6	157.0	175.5	104.4	109.1	205.3	-38.3	93.2	68.1	105.7	101.5	41.9	41.9	
5/21 8:00	110.8	156.1	173.8	103.7	111.8	204.1	-41.8	93.4	67.9	104.8	101.1	41.9	42.0	
5/21 11:00	111.2	157.2	171.6	103.5	111.0	203.6	-43.9	92.6	67.9	104.3	101.3	42.0	42.0	
5/21 14:00	110.8	155.6	170.4	104.3	132.9	204.1	-44.4	93.1	67.9	104.6	101.9	42.0	42.1	
5/21 17:00	109.2	156.9	172.4	104.4	134.3	202.0	-44.6	92.9	67.9	105.2	104.2	42.0	42.1	
5/21 20:00	107.7	157.9	172.2	103.7	132.1	204.6	-47.6	89.9	67.7	105.6	104.0	42.1	42.2	
5/21 23:00	106.8	156.6	171.1	103.8	133.0	202.5	-50.3	89.7	67.5	105.5	104.9			
5/22 0:20	107.5	155.9	170.3	103.5	128.8	203.1	-68.1	89.8	67.4	105.5	103.6	42.2	42.2	
5/22 2:00	107.8	154.7	169.8	102.6	123.6	201.9	-68.4	89.5	67.3	105.1	105.0	42.2	42.2	
5/22 5:00	107.6	154.1	169.7	102.2	130.6	200.9	-104.1	89.9	67.2	107.3	107.0	42.2	42.3	
5/22 8:00	107.5	153.6	169.5	102.5	132.6	201.4	-105.2	89.9	67.2	105.7	106.1	42.3	42.3	
5/22 11:00	108.0	152.5	167.0	102.9	125.7	201.4	-107.7	90.0	66.9	104.1	112.6	42.3	42.4	
5/22 14:00	107.8	146.1	166.3	102.5	133.3	202.3	-110.2	90.6	66.8	103.6	114.7	42.3	42.4	
5/22 17:00	105.1	143.6	165.9	101.5	132.0	200.5	-118.4	91.8	66.7	104.2	118.3	42.4	42.5	
5/22 20:00	104.8	140.5	166.2	101.4	131	198.5	-122.5	90.8	66.6	103.5	113	42.4	42.5	
5/22 23:00	104.3	139	165.1	100.7	130.1	196.4	-122.5	90.5	66.4	103.7	116	42.5	42.5	
5/23 2:00	104.8	137.7	156.9	99.3	108.4	195.8	-122.4	89.9	66.3	104.1	115	42.5	42.6	
5/23 5:00	104.6	137.6	150.5	98.8	112.7	199.3	-122.4	89.0	66.1	105.1	115.7	42.6	42.6	
5/23 8:00	105.9	134.9	148.5	98.1	126.9	195.1	-122.4	89.5	66	105.2	117.4	42.6	42.7	
5/23 11:00	105.8	132.6	150.2	97.4	126.2	184.0	-122.4	88.8	66.0	104.9	115.6	42.6	42.7	
5/23 14:00	105.7	132.8	151.8	97.3	119.1	181.9	-122.4	88.6	66	104.7	114.4	42.7	42.7	
5/23 17:00	105.2	130.7	154.5	97.3	111.4	179.1	-122.7	88.8	65.9	104.6	118.1	42.7	42.8	
5/23 20:00	105.8	130.7	154.5	97.2	133.8	176.0	-122.8	88.1	65.8	103.4	119.6	42.8	42.8	
5/23 23:00	106.6	130.9	150.6	97.8	136.6	171.1	-122.7	88.3	65.8	103.9	123.2	42.8	42.9	
5/24 2:00	106.6	129.8	158.1	98.0	130.0	166.2	-122.6	88.9	65.7	104.3	125.7	42.8	42.9	
5/24 5:00	106.6	130.3	159.1	100.1	136.5	165.9	-122.7	90.0	65.7	105.9	128.5	42.9	42.9	
5/24 8:00	107.5	130.7	161.3	101.0	138.1	165.0	-122.6	91.7	65.7	104.7	128.9	42.9	43.0	
5/24 11:00	108.4	131.7	162.9	101.3	142.2	167.3	-97.0	91.7	65.7	105.3	136.0	43.0	43.0	
5/24 14:00	108.8	133.8	164.7	102.1	142.2	174.2	-122.7	91.7	65.8	106.0	133.4	43.0	43.1	
5/24 17:00	109.1	131.0	166.7	103.2	143.5	173.9	-122.7	91.8	65.8	106.8	133.3	43.0	43.1	
5/24 20:00	109.8	135.4	169.8	103.8	145.0	169.7	-109.6	92.3	65.8	106.0	133.7	43.1	43.1	
5/24 23:00	110.1	131.9	163.8	104.2	144.8	168.8	-122.5	94.3	65.6	105.8	136.6	43.1	43.2	
5/25 2:00	110.1	131.9	167.6	107.4	141.1	165.9	-118.7	94.4	65.5	106.4	138.2	43.2	43.2	
5/25 5:00	110.0	131.3	168.5	107.0	144.4	160.9	-122.4	95.3	65.4	106.5	139.6	43.2	43.3	
5/25 8:00	110.5	131.7	165.1	107.5	141.3	169.7	-122.4	95.8	65.4	107.6	140.8	43.3	43.3	
5/25 11:00	110.9	131.5	167.0	109.7	134.9	174.4	-122.5	97.2	65.6	107.7	142.3	43.3	43.4	
5/25 14:00	111.4	129.0	166.5	109.2	136.8	175.8	-122.5	97.4	65.7	108.1	145.2	43.3	43.4	
5/25 17:00	111.3	130.8	165.7	110.1	149.6	174.1	-122.3	98.5	65.7	107.1	146.4	43.4	43.5	
5/25 20:00	112.1	131.7	169.6	110.0	143.6	173.8	-122.2	99.0	65.6	107.3	144.8	43.5	43.5	
5/25 23:00	113.1	130.2	170.4	110.0	150.3	172.2	-122.2	99.8	65.5	107.0	145.5	43.5	43.6	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/26 2:00	112.2	129.9	174.4	110.2	150.0	172.6	-122.1	100.5	65.5	107.8	146.1	43.6	43.6	
5/26 5:00	112.3	129.0	173.1	109.4	150.1	171.0	-122.1	100.9	65.5	112.7	146.6	43.6	43.7	
5/26 8:00	112.4	128.1	173.3	109.9	150.0	165.2	-122.1	102.8	65.4	112.0	146.7	43.7	43.8	
5/26 11:00	112.5	126.4	173.7	110.7	149.1	165.9	-122.2	103.3	65.5	110.6	146.2	43.8	43.8	
5/26 14:00	112.9	126.8	175.6	110.5	148.8	165.8	-122.3	104.4	65.6	110.4	146.8	43.8	43.9	
5/26 17:00	113.0	126.8	176.1	110.9	133.9	163.4	-122.5	104.4	65.5	107.2	146.1	43.9	43.9	
5/26 20:00	112.9	126.9	174.5	112.2	128.7	161.1	-122.3	104.7	64.8	109.3	148.0	44.0	44.0	
5/26 21:10	112.8	126.2	176.2	111.6	144.2	159.2	-122.3	104.7	64.5	109.1	148.5	44.0	44.0	
5/26 23:00	112.6	126.6	177.0	110.4	148.9	158.0	-122.3	104.3	64.6	108.6	147.3	44.0	44.1	
5/27 2:00	112.9	125.2	180.4	110.0	148.9	158.4	-122.2	105.5	64.2	108.2	146.4	44.1	44.1	
5/27 5:00	113.4	125.2	183.5	109.4	149.9	157.6	-122.2	105.9	63.9	103.9	146.1	44.1	44.2	
5/27 8:00	113.6	125.4	184.5	110.4	126.8	157.7	-122.2	106.3	63.8	101.4	145.8	44.2	44.2	
5/27 11:00	114.1	126.5	195.0	110.5	128.7	156.4	-122.3	107.1	63.7	105.8	151.7	44.2	44.3	
5/27 14:00	114.8	126.7	197.1	111.2	149.3	156.7	-122.2	108.1	63.7	108.0	155.6	44.3	44.4	
5/27 17:00	115.7	126.7	198.7	110.2	151.9	162.7	-122.4	108.2	63.7	108.7	157.1	44.4	44.4	
5/27 20:00	116.0	127.6	198.5	110.0	150.9	158.4	-122.6	108.5	63.6	113.5	160.6	44.4	44.5	
5/27 21:30	115.9	127.8	198.6	110.3	150.3	162.0	-122.5	108.4	63.6	114.0	160.5	44.4	44.5	
5/27 23:00	116.1	127.8	198.9	110.6	139.9	151.7	-122.6	108.3	63.6	116.3	160.2	44.5	44.5	
5/28 2:00	116.1	128.1	198.8	111.8	148.8	146.0	-122.3	109.1	63.6	118.6	164.6	44.5	44.6	
5/28 5:00	115.9	127.2	198.2	112.4	146.8	150.8	-122.2	112.7	63.6	122.2	164.1	44.6	44.6	
5/28 8:00	116.4	126.9	199.9	113.3	138.4	146.4	-122.0	111.2	63.6	124.5	168.7	44.6	44.7	
5/28 11:00	116.2	126.4	197.2	113.3	133.0	147.7	-122.0	112.7	63.6	125.8	163.9	44.7	44.7	
5/28 14:00	116.8	127.1	192.0	113.3	133.4	151.0	-122.0	113.0	63.6	125.9	165.2	44.7	44.8	
5/28 17:00	117.3	128.6	192.1	115.0	146.4	148.0	-122.0	113.2	63.7	128.4	168.3	44.8	44.8	
5/28 20:00	118.0	128.9	198.4	118.8	151.7	153.3	-121.8	113.5	63.7	130.1	169.8	44.8	44.9	
5/28 23:00	118.6	129.6	202.5	120.1	150.7	153.6	-121.8	113.7	63.7	130.2	173.3	44.9	44.9	
5/29 2:00	119.7	131.6	206.0	119.3	143.2	173.9	-121.6	113.5	63.7	132.4	178.1	44.9	45.0	
5/29 5:00	120.2	131.7	199.8	120.3	133.8	174.1	-121.6	114.1	63.6	130.7	177.0	45.0	45.0	
5/29 8:00	120.8	131.4	199.4	119.8	133.3	171.7	-121.5	114.5	63.7	130.1	183.0	45.0	45.1	
5/29 11:00	120.9	131.3	201.3	123.2	144.4	170.3	-121.4	114.5	63.8	130.4	187.7	45.1	45.1	
5/29 14:00	121.2	130.5	199.5	123.1	136.0	167.4	-121.5	115.0	63.9	130.7	193.2	45.1	45.2	
5/29 17:00	122.2	130.1	194.6	124.6	140.1	166.5	-121.5	116.5	63.8	130.8	198.4	45.2	45.2	
5/29 20:00	121.7	129.9	194.4	128.5	134.6	170.8	-121.5	117.7	63.9	133.6	208.8	45.2	45.3	
5/29 23:00	121.8	128.1	195.7	128.5	141.5	172.9	-121.6	118.6	63.9	134.1	206.4	45.3	45.4	
5/30 2:00	122.4	128.2	195.2	128.5	139.0	173.5	-121.4	119.9	64.0	135.2	216.1	45.3	45.4	
5/30 5:00	122.4	127.4	194.4	128.0	130.5	177.0	-121.3	119.5	64.0	136.2	228.6	45.4	45.5	
5/30 8:00	122.6	126.3	193.9	128.4	125.6	168.2	-121.2	119.2	64.1	136.6	233.6	45.4	45.5	
5/30 11:00	122.8	126.4	195.6	129.6	126.4	175.5	-120.8	119.6	64.1	136.6	243.4	45.5	45.5	
5/30 14:00	122.6	127.1	197.9	129.5	128.6	176.1	-111.8	119.9	64.1	136.5	259.1	45.5	45.6	
5/30 17:00	122.9	126.3	197.9	128.9	129.5	176.9	-105.1	119.9	64.0	136.1	262.1	45.5	45.6	
5/30 20:00	122.4	126.0	199.9	128.2	131.2	179.2	-93.2	119.2	63.9	136.9	263.8	45.6	45.6	
5/30 23:00	122.5	125.9	201.9	128.8	129.3	170.3	-77.1	118.8	63.7	137.1	257.7	45.6	45.6	
5/31 2:00	120.8	125.9	199.8	128.9	138.7	177.0	-71.1	118.5	63.6	136.5	228.8	45.6	45.7	
5/31 5:00	118.2	125.2	196.0	128.3	138.7	172.7	-67.3	117.8	63.4	135.5	219.7	45.7	45.7	
5/31 8:00	119.1	124.1	195.2	127.7	138.0	176.8	-69.6	118.3	63.3	135.6	225.8	45.7	45.7	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/31 11:00	120.7	124.8	196.1	126.1	138.2	178.7	-74.2	118.4	63.2	136.4	226.0	45.7	45.7	
5/31 14:00	123.5	126.1	198.7	127.6	140.9	184.7	-72.6	117.6	63.2	137.0	212.8	45.7	45.8	
5/31 17:00	123.7	126.9	195.7	130.4	137.4	183.3	-71.1	117.5	63.1	137.3	211.2	45.7	45.8	
5/31 20:00	125.0	127.5	198.0	132.2	142.4	186.5	-69.9	117.4	63.0	138.0	211.8	45.7	45.8	
5/31 23:00	125.2	128.3	198.1	133.2	137.0	186.2	-61.2	116.8	62.9	138.4	216.1	45.7	45.8	
6/1 2:00	125.3	129.2	194.8	136.0	141.5	189.1	-57.8	118.0	62.8	136.6	212.7	45.8	45.8	
6/1 5:00	125.8	129.3	194.6	137.4	140.6	170.1	-54.2	118.6	62.7	133.1	206.2	45.8	45.8	
6/1 8:00	125.9	129.7	196.8	136.5	135.5	169.0	-49.9	118.7	62.8	132.4	201.3	45.8	45.8	
6/1 11:00	126.3	130.3	199.2	136.4	136.4	191.1	-45.4	119.0	62.9	135.2	197.5	45.8	45.9	
6/1 14:00	127.5	131.7	202.2	138.2	137.8	190.3	-40.7	118.3	63.0	136.8	191.4	45.8	45.9	
6/1 17:00	127.4	132.6	204.3	137.6	132.1	190.5	-40.3	117.7	63.0	138.2	202.9	45.8	45.9	
6/1 20:00	127.9	133.4	203.1	139.0	133.4	188.0	-37.7	117.8	62.8	139.0	200.7	45.9	45.9	
6/1 23:00	129.2	134.3	203.3	140.1	133.1	191.2	-34.0	117.3	62.7	140.7	198.3	45.9	45.9	
6/2 2:00	130.2	136.3	204.2	141.4	139.3	192.6	-30.9	118.1	62.8	142.3	198.1	45.9	45.9	
6/2 5:00	130.9	137.1	203.4	142.5	134.7	195.2	-25.8	117.6	62.9	142.6	205.9	45.9	46.0	
6/2 8:00	131.1	137.4	202.8	142.8	127.9	197.1	-27.8	118.0	63.0	142.6	204.4	45.9	46.0	
6/2 11:00	131.5	139.5	202.3	143.0	129.0	197.6	-21.1	117.2	63.3	143.1	205.4	45.9	46.0	
6/2 14:00	131.9	140.6	202.6	144.3	133.5	188.2	-24.1	117.3	63.4	143.4	205.1	45.9	46.0	
6/2 17:00	131.8	141.1	204.6	146.5	128.4	199.5	-14.1	116.7	63.4	144.8	199.3	46.0	46.0	
6/2 20:00	132.0	142.3	205.5	148.9	134.0	202.3	-9.5	116.4	63.5	146.1	195.5	46.0	46.0	
6/2 23:00	131.1	143.0	207.2	149.3	136.6	193.7	-5.7	116.7	63.5	146.4	196.6	46.0	46.0	
6/3 2:00	132.6	143.2	210.7	149.7	140.3	198.3	-1.2	116.7	63.5	146.9	199.0	46.0	46.1	
6/3 5:00	132.0	143.6	212.2	149.4	139.0	200.3	2.7	116.2	63.5	147.3	194.7	46.0	46.1	
6/3 8:00	131.9	144.5	214.1	149.5	146.2	198.6	6.8	115.5	63.5	147.6	194.8	46.0	46.1	
6/3 11:00	131.9	143.0	216.4	149.8	143.3	200.4	11.7	115.7	63.4	148.6	195.1	46.1	46.1	
6/3 14:00	131.9	141.6	217.5	151.0	140.9	200.9	16.4	115.3	63.6	148.7	190.4	46.1	46.1	
6/3 17:00	131.5	139.6	217.2	150.4	148.8	199.6	20.3	114.5	63.7	148.7	194.2	46.1	46.2	
6/3 20:00	132.5	139.0	217.8	150.4	156.3	196.1	28.5	114.6	63.8	148.2	196.5	46.1	46.2	
6/3 23:00	131.8	138.8	217.1	151.3	160.4	194.3	34.5	115.5	63.7	148.1	195.0	46.1	46.2	
6/4 2:00	132.6	139.7	215.9	158.4	149.1	201.3	33.8	107.4	63.6	150.0	193.0	46.1	46.2	
6/4 5:00	133.3	139.8	214.2	157.4	148.5	201.5	45.9	106.5	63.4	150.7	200.0	46.2	46.2	
6/4 8:00	133.6	140.5	212.6	159.4	151.6	199.2	42.0	105.7	63.6	150.5	197.9	46.2	46.2	
6/4 11:00	133.9	143.1	212.3	160.9	149.8	200.1	42.0	101.4	63.6	150.9	196.5	46.2	46.2	
6/4 14:00	134.3	144.2	211.4	160.9	153.2	194.0	47.9	100.9	63.8	150.7	198.5	46.2	46.3	
6/4 17:00	135.8	144.7	209.6	160.7	158.8	193.9	52.0	102.2	64.0	151.8	197.3	46.2	46.3	
6/4 20:00	135.2	145.5	208.8	161.2	158.6	193.4	52.6	101.6	64.1	152.0	199.6	46.2	46.3	
6/4 23:00	135.5	145.6	209.4	161.5	165.9	191.5	57.2	100.8	64.1	152.0	202.6	46.2	46.3	
6/5 2:00	136.2	147.3	211.8	162.9	160.7	193.2	62.7	101.5	64.0	153.0	201.6	46.3	46.3	
6/5 5:00	136.7	148.8	213.0	164.3	159.5	194.9	64.0	105.5	64.0	152.9	199.6	46.3	46.3	
6/5 8:00	137.6	148.6	214.3	169.0	159.9	192.8	68.3	107.7	64.0	152.7	197.9	46.3	46.4	
6/5 11:00	138.3	148.5	215.6	170.6	157.5	193.2	73.2	108.3	64.2	153.1	196.4	46.3	46.4	
6/5 14:00	139.0	148.6	217.5	176.0	154.5	194.0	76.9	107.8	64.3	153.5	197.7	46.3	46.4	
6/5 17:00	139.8	149.2	218.5	175.8	151.1	194.9	76.1	106.0	63.9	153.7	199.2	46.3	46.4	
6/5 20:00	139.9	147.4	216.6	176.4	156.3	161.4	82.3	105.0	64.0	153.6	200.4	46.3	46.4	
6/5 23:00	140.1	145.8	217.8	176.4	153.8	163.8	84.1	104.7	64.0	154.0	201.5	46.3	46.4	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
6/6 2:00	140.1	146.8	217.3	177.0	153.7	160.1	86.1	104.0	64.0	153.8	203.0	46.4	46.4	
6/6 5:00	140.7	147.2	214.9	177.8	158.7	162.8	92.1	107.5	63.8	154.6	201.7	46.4	46.5	
6/6 8:00	141.5	145.3	215.4	178.0	159.2	161.7	90.1	104.8	64.0	152.1	201.7	46.4	46.5	
6/6 11:00	142.3	145.3	213.2	178.6	166.2	159.3	94.3	105.0	63.9	155.1	194.3	46.4	46.5	
6/6 14:00	143.0	144.4	214.1	178.3	159.3	161.3	96.4	107.2	63.9	155.9	183.2	46.4	46.5	
6/6 17:00	144.0	143.7	214.1	180.7	150.8	164.8	98.3	107.2	64.1	156.6	183.5	46.4	46.5	
6/6 20:00	144.5	143.1	212.9	181.2	157.7	172.6	99.2	107.2	63.9	156.6	181.9	46.4	46.5	
6/6 23:00	145.3	143.2	208.2	182.0	158.7	176.1	100.0	105.0	63.7	156.4	180.7	46.5	46.5	
6/7 2:00	145.8	145.3	203.2	181.5	153.6	175.8	103.0	104.0	63.7	156.2	179.7	46.5	46.5	
6/7 5:00	146.3	146.5	196.0	181.5	159.1	167.6	105.3	103.1	63.5	156.5	177.3	46.5	46.6	
6/7 8:00	146.7	149.3	195.2	181.1	151.2	172.3	105.8	104.0	63.5	156.8	177.9	46.5	46.6	
6/7 11:00	147.3	150.8	191.7	182.2	148.7	170.6	109.2	103.6	63.9	157.6	176.2	46.5	46.6	
6/7 14:00	147.8	151.5	188.8	182.1	146.2	170.5	110.7	103.6	63.9	157.6	175.1	46.5	46.6	
6/7 17:00	148.0	151.9	187.3	183.0	144.9	168.8	113.2	101.8	63.8	157.9	178.0	46.5	46.6	
6/7 20:00	148.0	152.4	187.2	182.7	142.4	172.7	112.9	102.4	63.7	158.5	176.4	46.5	46.6	
6/7 23:00	148.5	151.4	187.3	181.7	142.6	164.8	115.6	102.1	63.7	158.4	175.8	46.6	46.6	
6/8 2:00	148.4	151.2	186.7	182.4	142.8	161.5	117.4	103.9	63.6	158.7	173.8	46.6	46.6	
6/8 5:00	148.9	148.6	186.6	181.2	145.2	164.9	115.6	105.2	63.4	158.9	171.3	46.6	46.7	
6/8 8:00	149.2	148.1	186.5	182.0	149.2	167.6	118.6	102.5	63.5	159.2	171.9	46.6	46.7	
6/8 11:00	149.5	148.4	184.3	182.4	151.8	192.6	119.2	103.2	63.8	159.4	170.5	46.6	46.7	
6/8 14:00	150.0	148.9	183.9	183.8	144.4	196.4	122.2	104.1	63.6	160.3	171.6	46.6	46.7	
6/8 17:00	150.4	149.2	183.3	184.6	145.4	196.3	120.1	103.0	63.6	160.4	172.0	46.6	46.7	
6/8 20:00	150.3	147.8	182.2	184.7	148.8	170.8	124.9	102.1	63.7	160.4	170.9	46.6	46.7	
6/8 23:00	149.5	147.6	184.3	184.6	148.4	162.9	125.5	102.4	63.5	160.7	171.0	46.6	46.7	
6/9 2:00	149.8	149.5	184.2	184.5	150.7	167.4	127.9	105.2	63.3	160.9	170.6	46.7	46.7	
6/9 5:00	149.6	149.6	181.1	185.0	151.6	168.1	129.5	105.6	63.1	161.0	168.5	46.7	46.8	
6/9 8:00	149.7	149.9	177.1	185.6	150.0	170.0	130.6	105.9	63.3	160.9	167.5	46.7	46.8	
6/9 11:00	149.7	149.8	177.7	186.0	153.4	175.4	131.0	105.8	63.5	160.5	167.6	46.7	46.8	
6/9 14:00	150.0	151.1	178.5	186.6	155.8	202.7	132.9	106.4	63.5	160.8	167.0	46.7	46.8	
6/9 17:00	151.3	151.7	178.3	186.8	153.8	202.5	134.3	106.4	63.4	161.3	166.8	46.7	46.8	
6/9 20:00	149.9	132.1	178.2	188.1	151.2	204.5	135.8	106.4	63.5	161.8	166.8	46.7	46.8	
6/9 23:00	150.4	131.1	179.5	187.9	148.6	200.0	137.1	105.6	63.4	162.1	167.3	46.7	46.8	
6/10 2:00	150.6	128.6	181.1	187.5	149.5	201.5	136.5	105.7	63.5	161.9	166.9	46.7	46.8	
6/10 5:00	150.9	127.5	181.7	187.8	150.9	199.6	138.5	105.0	63.4	161.2	168.4	46.7	46.8	
6/10 8:00	150.8	130.3	181.5	188.1	157.5	199.2	138.9	104.4	63.6	161.0	169.3	46.7	46.8	
6/10 11:00	151.1	130.4	181.3	188.1	163.0	199.0	142.0	106.3	63.7	161.3	169.9	46.7	46.8	
6/10 14:00	151.0	146.5	180.6	189.0	160.8	192.5	145.3	106.4	63.6	161.5	170.1	46.8	46.8	
6/10 17:00	151.2	128.4	180.0	188.0	157.9	202.1	145.6	108.5	63.7	162.1	170.4	46.8	46.8	
6/10 20:00	151.3	130.5	180.1	187.9	160.1	201.1	161.9	107.2	64.0	162.3	170.2	46.8	46.8	
6/10 23:00	150.9	143.2	179.1	187.3	157.2	203.2	162.8	106.5	63.8	161.7	170.0	46.8	46.9	
6/11 2:00	150.9	142.0	178.2	188.5	158.7	205.4	162.1	107.6	63.9	162.2	171.6	46.8	46.9	
6/11 5:00	150.8	141.1	177.3	188.2	155.7	204.4	161.8	108.3	63.6	161.7	170.2	46.8	46.9	
6/11 8:00	151.0	140.8	177.5	188.9	154.3	166.4	161.8	105.9	63.8	162.1	171.1	46.8	46.9	
6/11 11:00	151.4	141.0	177.1	189.2	162.2	159.7	161.9	108.1	64.0	160.9	170.0	46.8	46.9	
6/11 14:00	151.8	141.1	175.9	188.4	162.7	157.2	162.8	107.1	64.2	159.4	170.1	46.8	46.9	

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
6/11 17:00	152.5	141.2	175.2	187.8	165.3	157.4	163.2	105.3	64.3	159.1	170.6	46.8	46.9	
6/11 20:00	152.6	141.1	175.7	186.4	163.7	158.6	164.3	103.4	64.0	160.5	170.4	46.8	46.9	
6/11 23:00	152.4	140.6	175.8	185.9	162.5	161.7	162.8	104.1	63.9	160.8	170.6	46.8	46.9	
6/12 2:00	152.6	140.5	175.4	184.8	160.4	162.5	164.2	103.6	64.0	160.7	170.9	46.8	46.9	
6/12 5:00	152.0	140.6	175.8	184.0	155.1	162.2	165.2	103.6	63.7	160.8	171.7	46.8	46.9	
6/12 8:00	152.1	141.0	176.6	183.5	158.7	160.2	168.6	105.7	63.9	160.6	171.0	46.8	46.9	
6/12 11:00	152.2	140.9	177.0	181.0	159.1	159.5	169.2	105.4	63.7	156.9	169.7	46.8	46.9	
6/12 14:00	152.3	140.8	175.1	181.2	159.1	158.4	169.4	106.3	63.9	161.0	168.1	46.8	46.9	
6/12 17:00	152.4	140.6	175.2	180.0	158.1	160.7	170.1	106.6	63.9	160.4	168.6	46.9	46.9	
6/12 20:00	152.6	140.7	175.2	179.1	159.7	163.8	170.9	106.6	63.7	160.6	166.4	46.9	47.0	
6/12 23:00	151.9	140.3	174.9	179.4	173.6	161.0	169.5	108.6	63.8	160.6	166.0	46.9	47.0	
6/13 2:00	151.8	139.6	175.0	178.7	159.2	166.5	170.7	110.2	63.7	160.7	165.5	46.9	47.0	
6/13 5:00	151.4	139.6	174.6	177.3	149.5	167.7	171.7	110.6	63.8	160.4	165.0	46.9	47.0	
6/13 8:00	150.3	139.2	170.2	176.2	147.0	172.5	170.0	111.2	63.8	160.5	164.0	46.9	47.0	
6/13 11:00	151.3	138.8	168.2	175.9	145.4	169.5	166.8	108.1	64.0	159.3	163.8	46.9	47.0	
6/13 14:00	147.8	138.6	168.1	175.8	142.9	167.1	169.8	107.1	64.1	158.8	163.0	46.9	47.0	
6/13 17:00	148.8	138.4	168.2	175.8	143.9	166.6	170.0	106.5	63.8	158.2	163.3	46.9	47.0	
6/13 20:00	151.1	138.2	168.4	175.2	143.9	160.0	169.7	107.2	63.7	157.4	163.4	46.9	47.0	
6/13 23:00	149.4	137.6	168.0	167.6	145.2	153.6	168.9	107.5	63.6	156.3	163.5	46.9	47.0	
6/14 2:00	150.1	137.4	166.8	165.9	147.7	152.3	169.4	107.2	63.5	155.4	163.1	46.9	47.0	
6/14 5:00	149.2	136.5	167.3	164.5	153.8	153.0	170.6	107.0	63.5	154.8	162.9	46.9	47.0	