


### Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature (Typical Points)

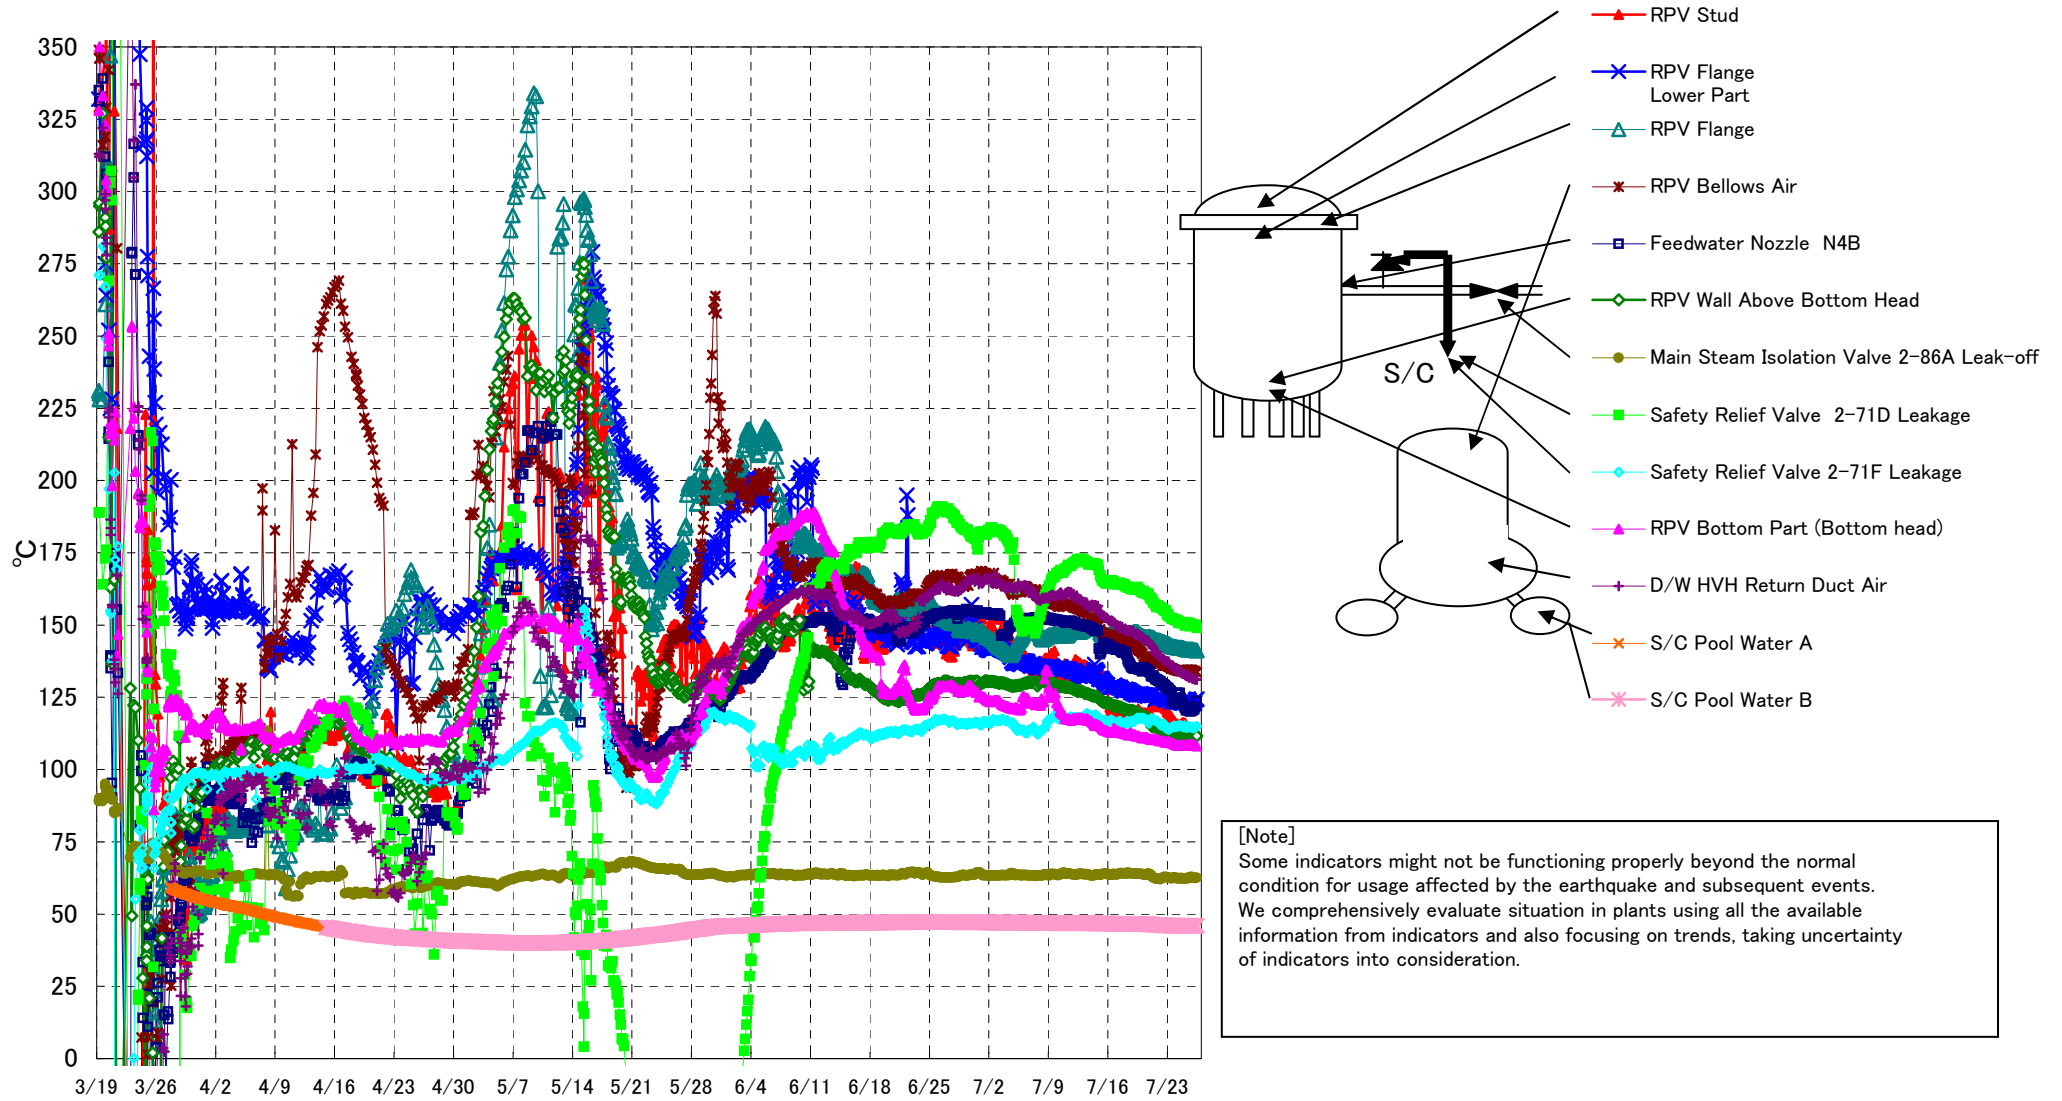

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle M4B	RPV Wall Above Bottom Head	RPV Flange	RPV Bottom Part (Bottom head)	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
7/20 2:00	133.9	118.6	146.2	110.9	119.6	125.9	161.1	117.7	63.8	145.8	140.0	46.3	46.5	
7/20 5:00	135.4	118.4	146.0	111.2	119.6	125.9	161.7	117.9	63.7	145.2	139.1	46.3	46.5	
7/20 8:00	134.6	118.3	145.9	111.0	119.6	125.8	161.0	117.4	63.6	144.8	139.0	46.3	46.5	
7/20 11:00	134.5	118.2	145.9	111.2	119.6	125.7	160.9	117.2	63.6	144.8	139.0	46.3	46.5	
7/20 14:00	134.3	118.0	145.7	111.2	119.3	125.7	160.8	117.2	63.8	144.6	138.8	46.3	46.5	
7/20 17:00	134.5	117.9	145.9	110.9	119.3	125.4	160.9	117.0	63.9	144.4	138.8	46.3	46.5	
7/20 20:00	134.1	117.6	146.0	110.6	120.2	125.8	160.3	116.0	64	144.2	138.6	46.3	46.5	
7/20 23:00	133.6	116.7	145.9	110.5	119.6	125.9	159.4	117.3	63.8	143.4	138.1	46.3	46.4	
7/21 2:00	132.5	116.3	145.7	110.3	121.8	125.6	159.2	117.6	63.6	143.1	137.9	46.2	46.4	
7/21 5:00	132.1	114.9	145.6	110.5	124.8	125.8	158.8	117.6	62.9	142.7	137.7	46.2	46.4	
7/21 8:00	132.5	114.9	145.7	110.7	126.6	125.7	157.7	117.4	62.6	142.0	137.5	46.2	46.3	
7/21 11:00	131.9	114.9	145.3	110.5						140.7	137.4			Not available due to changeover of station power source
7/21 14:25	131.2	114.7	145.0	110.4	123.1	124.4	156.9	116.8	62.3	140.6	137.3			Not available due to changeover of station power source
7/21 15:20												46.1	46.3	Not available due to changeover of station power source
7/21 17:00	131.2	114.5	144.8	110.3	122.0	124.7	156.2	116.8	62.3	139.9	137.3	46.1	46.2	
7/21 20:00	131.0	114.5	144.8	110.3	121.7	125.0	156.8	116.6	62.3	140.4	137.1	46.1	46.2	
7/21 23:00	130.7	114.4	144.7	110.1	121.7	124.7	156.6	116.5	62.2	139.5	136.9	46.0	46.2	
7/22 2:00	130.6	114.0	144.7	109.9	122.9	124.9	156.2	116.2	62.1	139.6	136.7	46.0	46.2	
7/22 5:00	130.5	113.9	144.5	110.0	123.3	124.9	156.1	115.3	62	138.9	136.7	46.0	46.2	
7/22 8:00														Not available due to the overload shutdown of the bus circuit-breaker connected to Unit 3 and 4
7/22 10:40	129.8	113.3	144.2	110.0	122.5	124.6	155.6	115.3	62.5	138.1	135.9			"
7/22 10:50												46.0	46.1	"
7/22 14:00	129.4	113.4	144.1	109.9	123.3	124.6	155.2	115.9	62.8	137.9	136.1	46.0	46.1	
7/22 17:00	129.1	113.2	143.9	109.4	121.3	124.3	154.8	115.2	62.8	137.7	135.9	46.0	46.1	
7/22 20:00	128.8	113.0	143.8	109.7	120.9	124.1	154.9	114.3	62.8	137.3	136.1	46.0	46.1	
7/22 23:00	128.4	113.0	143.6	109.4	119.9	124.3	153.6	114.5	62.8	137.5	136.0	45.9	46.1	
7/23 2:00	128.1	112.8	143.5	109.5	119.7	124.2	153.7	114.0	62.6	137.1	135.7	45.9	46.1	
7/23 3:20	127.9	112.9	143.4	109.8	118.9	124.3	153.1	113.9	62.6	137.3	135.6			Not available due to changeover of station power source
7/23 3:50												45.9	46.1	"
7/23 5:00														"
7/23 7:00	127.4	113.1	143.2	109.4						136.4	135.4			"
7/23 8:00														"
7/23 10:30	127.1	112.5	142.7	109.2	118.5	123.4	152.4	114.3	62.4	135.8	134.9	45.9	46.1	
7/23 14:00	124.9	112.7	142.7	109.1	117.5	123.8	152.3	114.7	62.4	135.9	135.1	45.9	46.1	
7/23 17:00	123.4	113.1	142.6	109.1	117.1	123.8	152.1	114.9	62.7	135.3	134.7	45.9	46.0	
7/23 20:00	123.0	113.0	142.6	108.7	116.6	123.5	151.9	115.1	62.6	135.0	134.7	45.9	46.0	
7/23 23:00	122.7	112.7	142.4	108.7	116.0	123.5	151.9	114.8	62.6	134.9	134.5	45.9	46.0	
7/24 2:00	124.2	112.4	142.3	108.4	115.9	123.3	151.6	115.0	62.5	134.4	134.3	45.9	46.0	
7/24 5:00	126.5	112.4	142.2	108.3	115.6	123.6	151.5	115.0	62.3	134.7	134.3	45.9	46.0	
7/24 8:00	126.3	112.3	142.2	108.3	115.4	123.4	150.6	115.2	62.5	134.1	134.1	45.9	46.0	
7/24 11:00	126.5	112.3	142.1	108.3	115.4	123.2	151.0	115.3	62.4	133.7	134.1	45.9	46.0	
7/24 14:00	124.7	112.3	142.2	108.3	115.7	123.3	150.9	115.1	62.3	133.8	134.0	45.9	46.0	
7/24 17:00	123.3	112.2	142.1	108.6	116.0	123.0	150.6	115.1	62.5	133.4	134.0	45.9	46.0	
7/24 20:00	122.5	112.1	142.1	108.5	116.3	122.9	150.8	114.8	62.4	133.1	134.0	45.8	46.0	
7/24 23:00	122.0	112.0	141.9	108.4	116.2	123.4	151.0	114.8	62.3	133.1	134.0	45.8	46.0	
7/25 2:00	121.4	112.1	141.8	108.4	116.1	123.4	149.8	115.2	62.2	132.7	134.1	45.8	46.0	
7/25 5:00	120.5	112.0	141.7	108.3	113.6	124.2	150.7	114.5	62.2	132.6	134.0	45.8	46.0	
7/25 8:00	120.6	111.7	141.6	108.5	113.8	124.2	150.5	114.6	62.3	132.2	134.6	45.8	46.0	
7/25 11:00	120.6	111.8	141.5	108.7	113.0	124.4	150.7	114.8	62.6	132.5	134.4	45.8	46.0	
7/25 14:00	120.3	111.8	141.5	108.6	112.4	123.8	149.6	115.0	62.6	131.8	134.6	45.8	46.0	
7/25 17:00	120.1	111.8	141.5	108.5	112.3	123.2	149.5	114.6	62.6	132.1	134.4	45.8	46.0	
7/25 20:00	120.3	111.8	141.5	108.7	112.6	123.1	150.4	114.6	62.9	131.8	134.6	45.8	46.0	
7/25 23:00	120.4	111.7	141.5	108.7	112.4	123.0	149.7	114.5	62.7	131.5	134.4	45.8	46.0	
7/26 2:00	120.7	111.7	141.4	108.7	112.5	123.2	150.1	114.3	62.6	131.5	134.1	45.8	46.0	
7/26 5:00	120.9	111.6	141.3	108.4	112.5	123.0	149.8	114.5	62.5	131.2	134.1	45.8	46.0	
7/26 8:00	121.7	111.6	141.2	108.3	112.4	124.1	149.9	114.7	62.5	131.1	133.8	45.8	46.0	
7/26 11:00	123.7	111.6	141.2	108.1	112.5	124.4	149.0	115.0	62.6	131.1	133.7	45.8	46.0	