


# Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

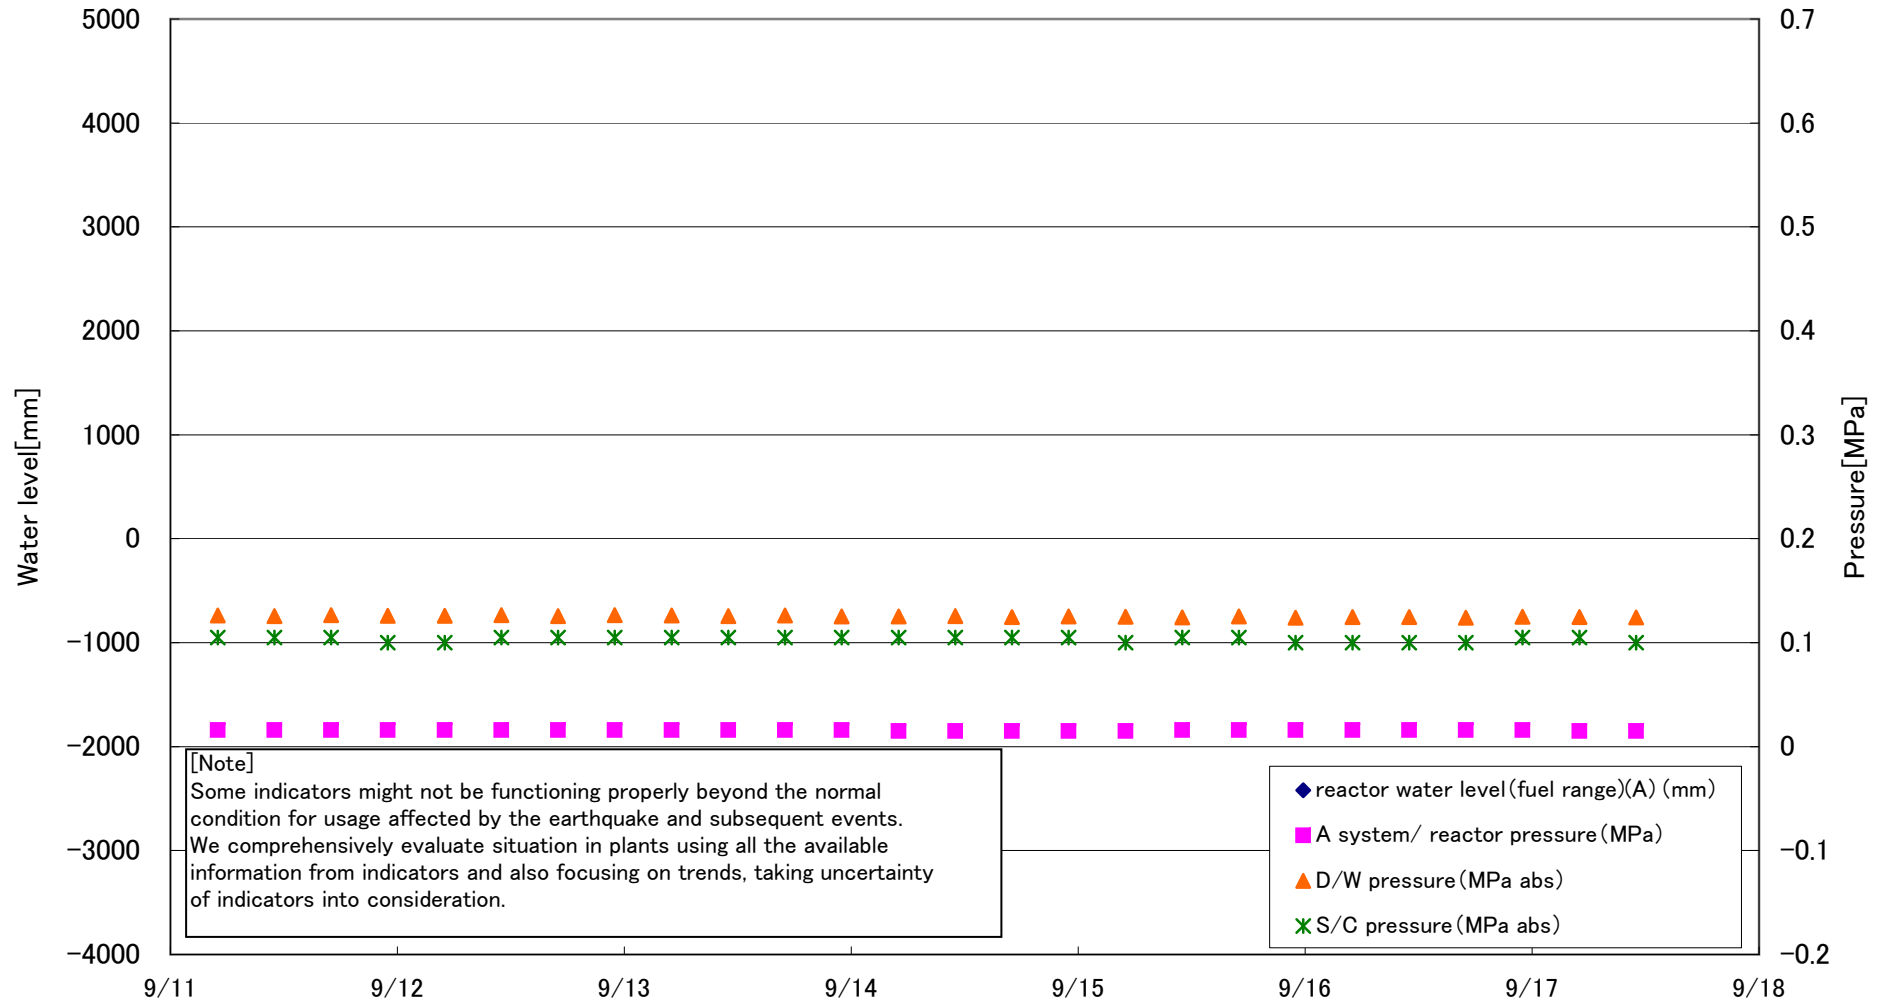

## Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level(fuel range)(A) (mm) | reactor water level(fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | note |
|------------|---|---|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|------|
| 9/11 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1263                 | 0.105                  | 0.00E+00           | 1.09E+02           | 6.73E-01           | 6.84E-01           |      |
| 9/11 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1257                 | 0.105                  | 0.00E+00           | 6.70E+01           | 6.72E-01           | 6.84E-01           |      |
| 9/11 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1266                 | 0.105                  | 0.00E+00           | 2.69E+01           | 6.73E-01           | 6.84E-01           |      |
| 9/11 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1258                 | 0.100                  | 0.00E+00           | 2.61E+01           | 6.72E-01           | 6.82E-01           |      |
| 9/12 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1259                 | 0.100                  | 0.00E+00           | 3.28E+01           | 6.72E-01           | 6.83E-01           |      |
| 9/12 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1264                 | 0.105                  | 0.00E+00           | 2.97E+01           | 6.72E-01           | 6.82E-01           |      |
| 9/12 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1257                 | 0.105                  | 0.00E+00           | 2.45E+01           | 6.71E-01           | 6.84E-01           |      |
| 9/12 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1264                 | 0.105                  | 0.00E+00           | 2.34E+01           | 6.72E-01           | 6.83E-01           |      |
| 9/13 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1263                 | 0.105                  | 0.00E+00           | 2.34E+01           | 6.72E-01           | 6.83E-01           |      |
| 9/13 11:00 |   | -1650                                   | 0.016                            | -                                | 0.1255                 | 0.105                  | 0.00E+00           | 2.76E+01           | 6.70E-01           | 6.82E-01           |      |
| 9/13 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1263                 | 0.105                  | 0.00E+00           | 3.32E+01           | 6.71E-01           | 6.83E-01           |      |
| 9/13 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1252                 | 0.105                  | 0.00E+00           | 3.03E+02           | 6.70E-01           | 6.83E-01           |      |
| 9/14 5:00  |   | -1700                                   | 0.015                            | -                                | 0.1252                 | 0.105                  | 0.00E+00           | 4.11E+01           | 6.70E-01           | 6.83E-01           |      |
| 9/14 11:00 |   | -1700                                   | 0.015                            | -                                | 0.1256                 | 0.105                  | 0.00E+00           | 2.95E+01           | 6.70E-01           | 6.82E-01           |      |
| 9/14 17:00 |   | -1650                                   | 0.015                            | -                                | 0.1247                 | 0.105                  | 0.00E+00           | 4.55E+01           | 6.70E-01           | 6.80E-01           |      |
| 9/14 23:00 |   | -1700                                   | 0.015                            | -                                | 0.1254                 | 0.105                  | 0.00E+00           | 2.51E+01           | 6.70E-01           | 6.82E-01           |      |
| 9/15 5:00  |   | -1700                                   | 0.015                            | -                                | 0.1250                 | 0.100                  | 0.00E+00           | 2.49E+01           | 6.70E-01           | 6.79E-01           |      |
| 9/15 11:00 |   | -1650                                   | 0.016                            | -                                | 0.1245                 | 0.105                  | 0.00E+00           | 2.59E+01           | 6.69E-01           | 6.82E-01           |      |
| 9/15 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1253                 | 0.105                  | 0.00E+00           | 2.78E+01           | 6.71E-01           | 6.81E-01           |      |
| 9/15 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1242                 | 0.100                  | 0.00E+00           | 3.70E+01           | 6.69E-01           | 6.80E-01           |      |
| 9/16 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1248                 | 0.100                  | 0.00E+00           | 4.03E+01           | 6.69E-01           | 6.79E-01           |      |
| 9/16 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1247                 | 0.100                  | 0.00E+00           | 1.93E+02           | 6.68E-01           | 6.78E-01           |      |
| 9/16 17:00 |   | -1650                                   | 0.016                            | -                                | 0.1241                 | 0.100                  | 0.00E+00           | 2.76E+01           | 6.68E-01           | 6.77E-01           |      |
| 9/16 23:00 |   | -1650                                   | 0.016                            | -                                | 0.1251                 | 0.105                  | 0.00E+00           | 3.57E+02           | 6.69E-01           | 6.78E-01           |      |
| 9/17 5:00  |   | -1650                                   | 0.015                            | -                                | 0.1248                 | 0.105                  | 0.00E+00           | 2.32E+01           | 6.69E-01           | 6.78E-01           |      |
| 9/17 11:00 |   | -1650                                   | 0.015                            | -                                | 0.1244                 | 0.100                  | 0.00E+00           | 2.69E+01           | 6.70E-01           | 6.79E-01           |      |

DS

measurement instrument malfunction measurement instrument malfunction