


## Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure

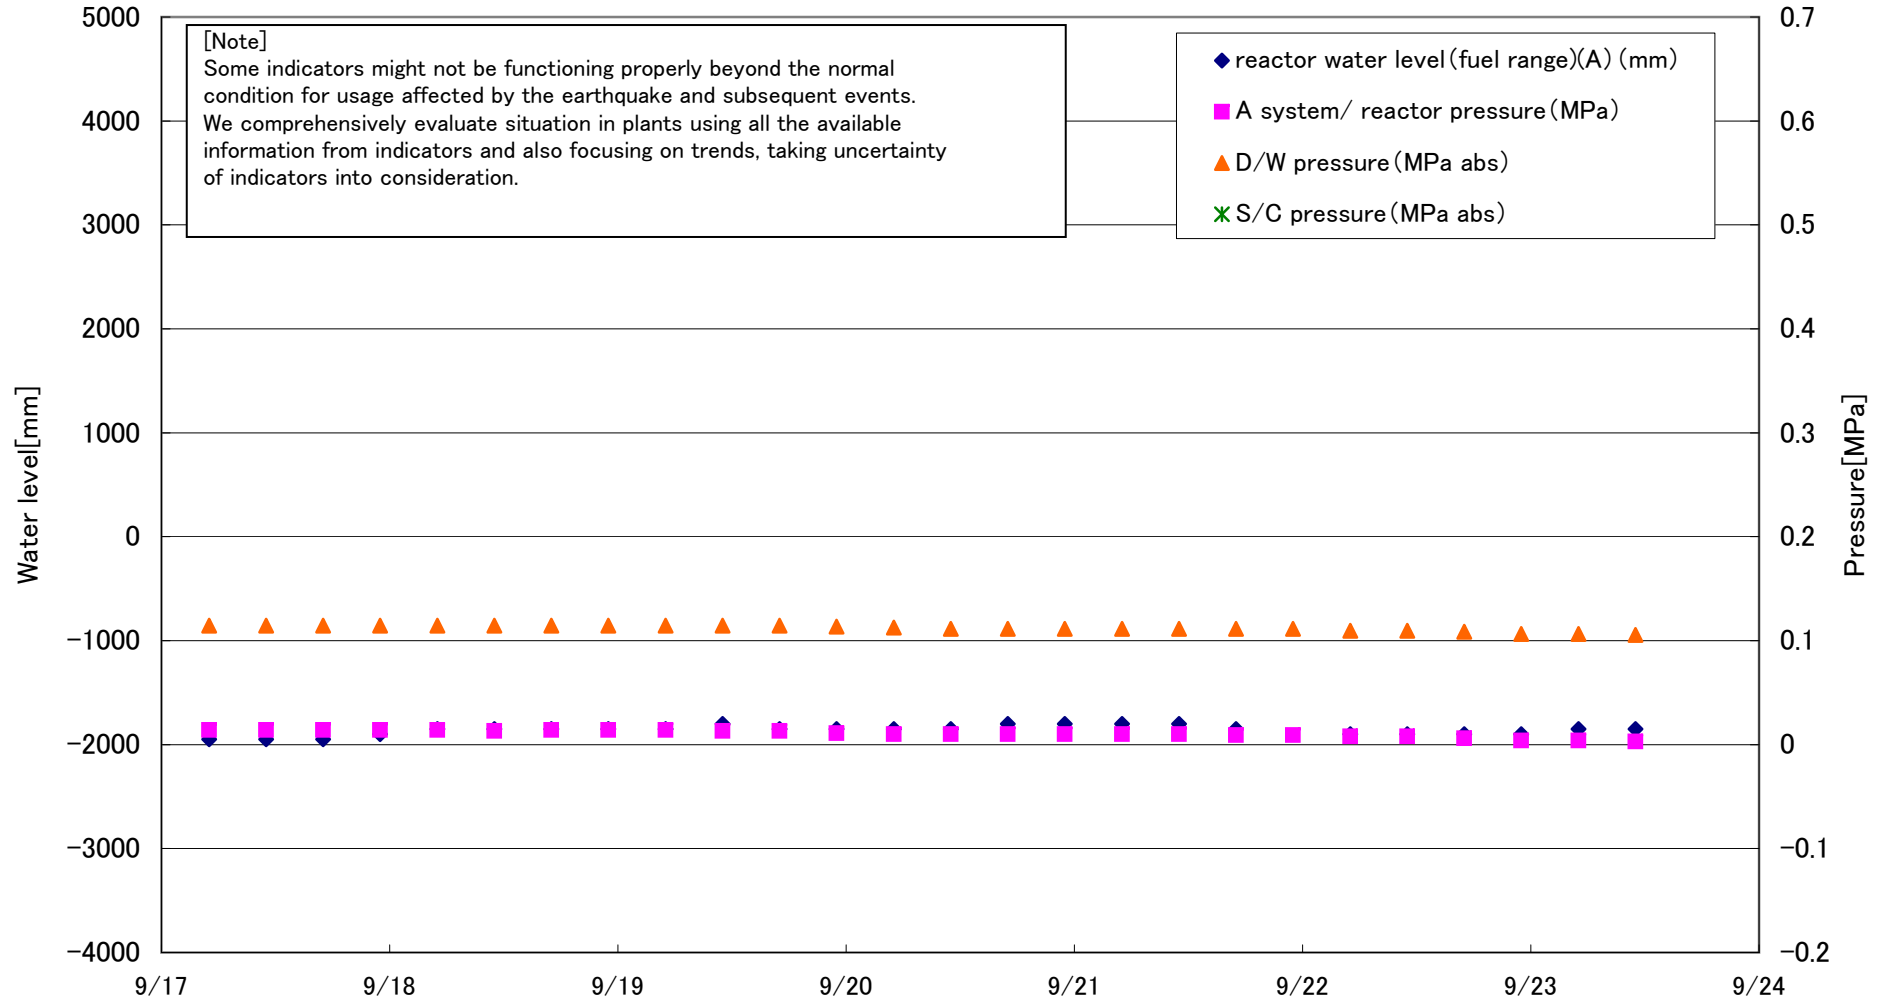

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level (fuel range)(A) (mm) | reactor water level (fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | radiation dose in main control room (mSv/h) | note                                       |
|------------|--|--|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|---|--|
| 9/17 5:00  | -1950                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.78E+00           | 4.86E+00           | 1.18E-01           | 6.06E+00           | 0.010                                       |  |
| 9/17 11:00 | -1950                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.75E+00           | 4.84E+00           | 1.19E-01           | 6.11E+00           | 0.013                                       |  |
| 9/17 17:00 | -1950                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.72E+00           | 4.84E+00           | 1.19E-01           | 6.16E+00           | 0.010                                       |  |
| 9/17 23:00 | -1900                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.69E+00           | 4.83E+00           | 1.19E-01           | 6.21E+00           | 0.010                                       |  |
| 9/18 5:00  | -1850                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.66E+00           | 4.82E+00           | 1.20E-01           | 6.24E+00           | 0.010                                       |  |
| 9/18 11:00 | -1850                                    | -2200                                    | 0.013                            | -                                | 0.115                  |                        | 9.64E+00           | 4.81E+00           | 1.20E-01           | 6.26E+00           | 0.010                                       |  |
| 9/18 17:00 | -1850                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.62E+00           | 4.80E+00           | 1.21E-01           | 6.34E+00           | 0.010                                       |  |
| 9/18 23:00 | -1850                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.60E+00           | 4.79E+00           | 1.22E-01           | 6.38E+00           | 0.010                                       |  |
| 9/19 5:00  | -1850                                    | -2200                                    | 0.014                            | -                                | 0.115                  |                        | 9.58E+00           | 4.77E+00           | 1.22E-01           | 6.41E+00           | 0.010                                       |  |
| 9/19 11:00 | -1800                                    | -2200                                    | 0.013                            | -                                | 0.115                  |                        | 9.57E+00           | 4.74E+00           | 1.23E-01           | 6.44E+00           | 0.011                                       |  |
| 9/19 17:00 | -1850                                    | -2200                                    | 0.013                            | -                                | 0.115                  |                        | 9.56E+00           | 4.72E+00           | 1.23E-01           | 6.46E+00           | 0.010                                       |  |
| 9/19 23:00 | -1850                                    | -2200                                    | 0.011                            | -                                | 0.114                  |                        | 9.54E+00           | 4.70E+00           | 1.24E-01           | 6.50E+00           | 0.010                                       |  |
| 9/20 5:00  | -1850                                    | -2200                                    | 0.010                            | -                                | 0.113                  |                        | 9.53E+00           | 4.68E+00           | 1.25E-01           | 6.43E+00           | 0.010                                       |  |
| 9/20 11:00 | -1850                                    | -2200                                    | 0.010                            | -                                | 0.112                  |                        | 9.51E+00           | 4.65E+00           | 1.26E-01           | 6.31E+00           | 0.010                                       |  |
| 9/20 17:00 | -1800                                    | -2200                                    | 0.010                            | -                                | 0.112                  |                        | 9.50E+00           | 4.64E+00           | 1.27E-01           | 6.24E+00           | 0.010                                       |  |
| 9/20 23:00 | -1800                                    | -2200                                    | 0.010                            | -                                | 0.112                  |                        | 9.49E+00           | 4.62E+00           | 1.29E-01           | 6.21E+00           | 0.010                                       |  |
| 9/21 5:00  | -1800                                    | -2200                                    | 0.010                            | -                                | 0.112                  |                        | 9.48E+00           | 4.60E+00           | 1.30E-01           | 6.16E+00           | 0.011                                       |  |
| 9/21 11:00 | -1800                                    | -2200                                    | 0.010                            | -                                | 0.112                  |                        | 9.47E+00           | 4.59E+00           | 1.31E-01           | 6.09E+00           | 0.010                                       |  |
| 9/21 17:00 | -1850                                    | -2200                                    | 0.009                            | -                                | 0.112                  |                        | 9.46E+00           | 4.57E+00           | 1.32E-01           | 6.01E+00           | 0.009                                       |  |
| 9/21 23:00 |  |  | 0.009                            | -                                | 0.112                  |                        |                    |                    |                    |                    |   | some of sampling canceled due to the storm |
| 9/22 5:00  | -1900                                    | -2200                                    | 0.008                            | -                                | 0.110                  |                        | 9.44E+00           | 4.52E+00           | 1.35E-01           | 3.44E+00           | 0.009                                       |  |
| 9/22 11:00 | -1900                                    | -2200                                    | 0.008                            | -                                | 0.110                  |                        | 9.43E+00           | 4.51E+00           | 1.36E-01           | 3.96E+00           | 0.008                                       |  |
| 9/22 17:00 | -1900                                    | -2200                                    | 0.006                            | -                                | 0.109                  |                        | 9.42E+00           | 4.49E+00           | 1.37E-01           | 5.55E+00           | 0.009                                       |  |
| 9/22 23:00 | -1900                                    | -2200                                    | 0.004                            | -                                | 0.107                  |                        | 9.42E+00           | 4.47E+00           | 1.29E-01           | 6.95E+00           | 0.008                                       |  |
| 9/23 5:00  | -1850                                    | -2200                                    | 0.004                            | -                                | 0.107                  |                        | 9.40E+00           | 4.43E+00           | 1.38E-01           | 7.37E+00           | 0.008                                       |  |
| 9/23 11:00 | -1850                                    | -2200                                    | 0.003                            | -                                | 0.106                  |                        | 9.38E+00           | 4.40E+00           | 1.38E-01           | 7.32E+00           | 0.008                                       |  |

measurement instrument malfunction

measurement instrument malfunction

measurement instrument malfunction