


## Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure

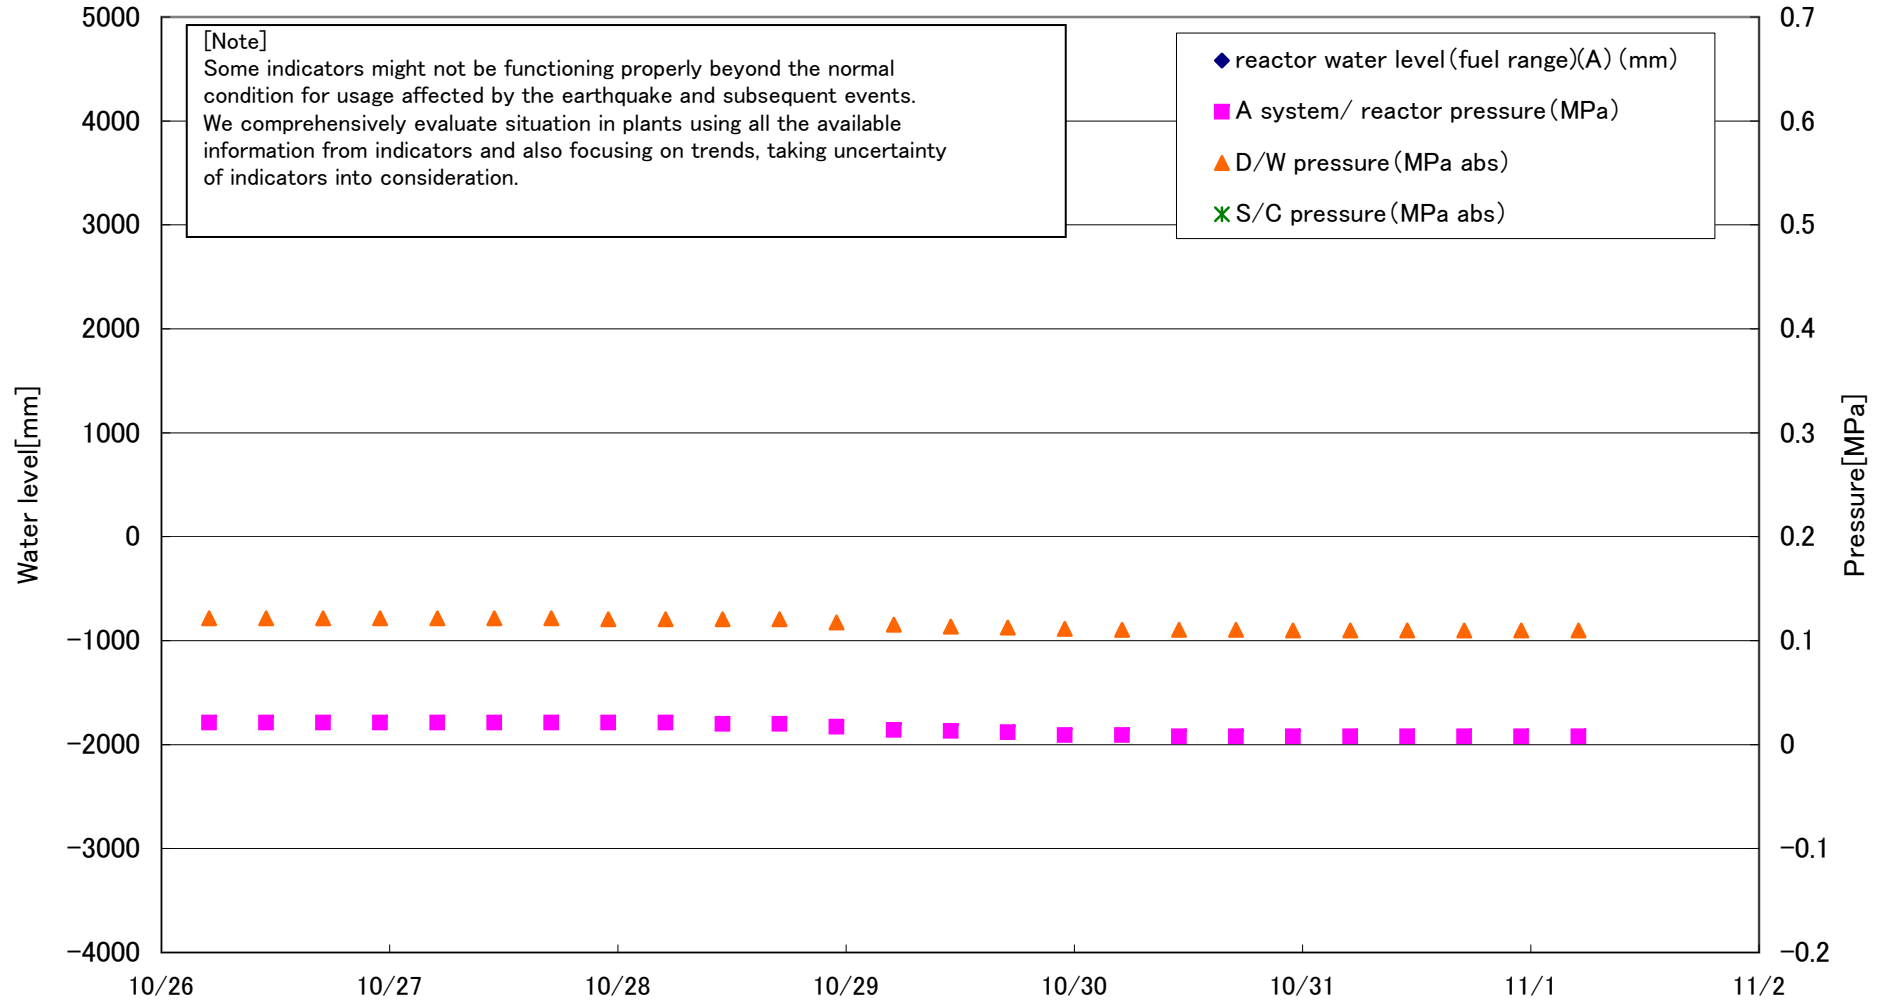

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

2011/11/11Revised

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date        | reactor water level (fuel range)(A) (mm) | reactor water level (fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | radiation dose in main control room (mSv/h) | note  |
|-------------|--|--|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|---|---|
| 10/26 5:00  |  | -2200                                    | 0.021                            | -                                | 0.122                  |                        | 8.01E+00           | 3.25E+00           | 9.49E-02           | 4.04E+00           | 0.008                                       |   |
| 10/26 11:00 |  | -2200                                    | 0.021                            | -                                | 0.122                  |                        | 8.04E+00           | 3.19E+00           | 9.46E-02           | 3.96E+00           | 0.009                                       |   |
| 10/26 17:00 |  | -2150                                    | 0.021                            | -                                | 0.122                  |                        | 8.05E+00           | 3.16E+00           | 9.45E-02           | 3.91E+00           | 0.009                                       |   |
| 10/26 23:00 |  | -2200                                    | 0.021                            | -                                | 0.122                  |                        | 8.06E+00           | 3.14E+00           | 9.43E-02           | 3.87E+00           | 0.009                                       |   |
| 10/27 5:00  |  | -2200                                    | 0.021                            | -                                | 0.122                  |                        | 8.06E+00           | 3.13E+00           | 9.40E-02           | 3.84E+00           | 0.009                                       |   |
| 10/27 11:00 |  | -2150                                    | 0.021                            | -                                | 0.122                  |                        | 8.06E+00           | 3.11E+00           | 9.40E-02           | 3.80E+00           | 0.009                                       |   |
| 10/27 17:00 |  | -2150                                    | 0.021                            | -                                | 0.122                  |                        | 8.06E+00           | 3.12E+00           | 9.38E-02           | 3.78E+00           | 0.009                                       |   |
| 10/27 23:00 |  | -2200                                    | 0.021                            | -                                | 0.121                  |                        | 8.05E+00           | 3.11E+00           | 9.36E-02           | 3.74E+00           | 0.008                                       |   |
| 10/28 5:00  |  | -2200                                    | 0.021                            | -                                | 0.121                  |                        | 8.05E+00           | 3.09E+00           | 9.33E-02           | 3.69E+00           | 0.009                                       |   |
| 10/28 11:00 |  | -2107                                    | 0.020                            | -                                | 0.121                  |                        | 7.86E+00           | 3.10E+00           | 9.00E-02           | 3.64E+00           | 0.009                                       |   |
| 10/28 17:00 |  | -2103                                    | 0.020                            | -                                | 0.121                  |                        | 7.87E+00           | 3.10E+00           | 9.00E-02           | 3.61E+00           |   | Radiation dose at the Main Control Room: Sampling once a day after introduction of the digital recorder |
| 10/28 23:00 |  | -2110                                    | 0.017                            | -                                | 0.118                  |                        | 7.86E+00           | 3.10E+00           | 9.00E-02           | 3.58E+00           |   |   |
| 10/29 5:00  |  | -2112                                    | 0.014                            | -                                | 0.116                  |                        | 7.86E+00           | 3.09E+00           | 9.00E-02           | 3.56E+00           |   |   |
| 10/29 11:00 |  | -2109                                    | 0.013                            | -                                | 0.114                  |                        | 7.86E+00           | 3.07E+00           | 9.00E-02           | 3.50E+00           |   |   |
| 10/29 17:00 |  | -2105                                    | 0.012                            | -                                | 0.113                  |                        | 7.86E+00           | 3.09E+00           | 9.00E-02           | 3.50E+00           | 0.010                                       |   |
| 10/29 23:00 |  | -2107                                    | 0.009                            | -                                | 0.111                  |                        | 7.86E+00           | 3.08E+00           | 9.00E-02           | 3.47E+00           |   |   |
| 10/30 5:00  |  | -2109                                    | 0.009                            | -                                | 0.110                  |                        | 7.86E+00           | 3.07E+00           | 9.00E-02           | 3.46E+00           |   |   |
| 10/30 11:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.86E+00           | 3.07E+00           | 9.00E-02           | 3.45E+00           | 0.010                                       |   |
| 10/30 17:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.08E+00           | 9.00E-02           | 3.43E+00           |   |   |
| 10/30 23:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.07E+00           | 9.00E-02           | 3.43E+00           |   |   |
| 10/31 5:00  |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.07E+00           | 9.00E-02           | 3.34E+00           |   |   |
| 10/31 11:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.07E+00           | 9.00E-02           | 3.33E+00           | 0.010                                       |   |
| 10/31 17:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.09E+00           | 9.00E-02           | 3.32E+00           |   |   |
| 10/31 23:00 |  | -2107                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.09E+00           | 9.00E-02           | 3.32E+00           |   |   |
| 11/1 5:00   |  | -2111                                    | 0.008                            | -                                | 0.110                  |                        | 7.79E+00           | 3.09E+00           | 9.00E-02           | 3.32E+00           |   |   |

DS

measurement instrument malfunction

measurement instrument malfunction

measurement instrument malfunction

Sampling once a day