


# Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

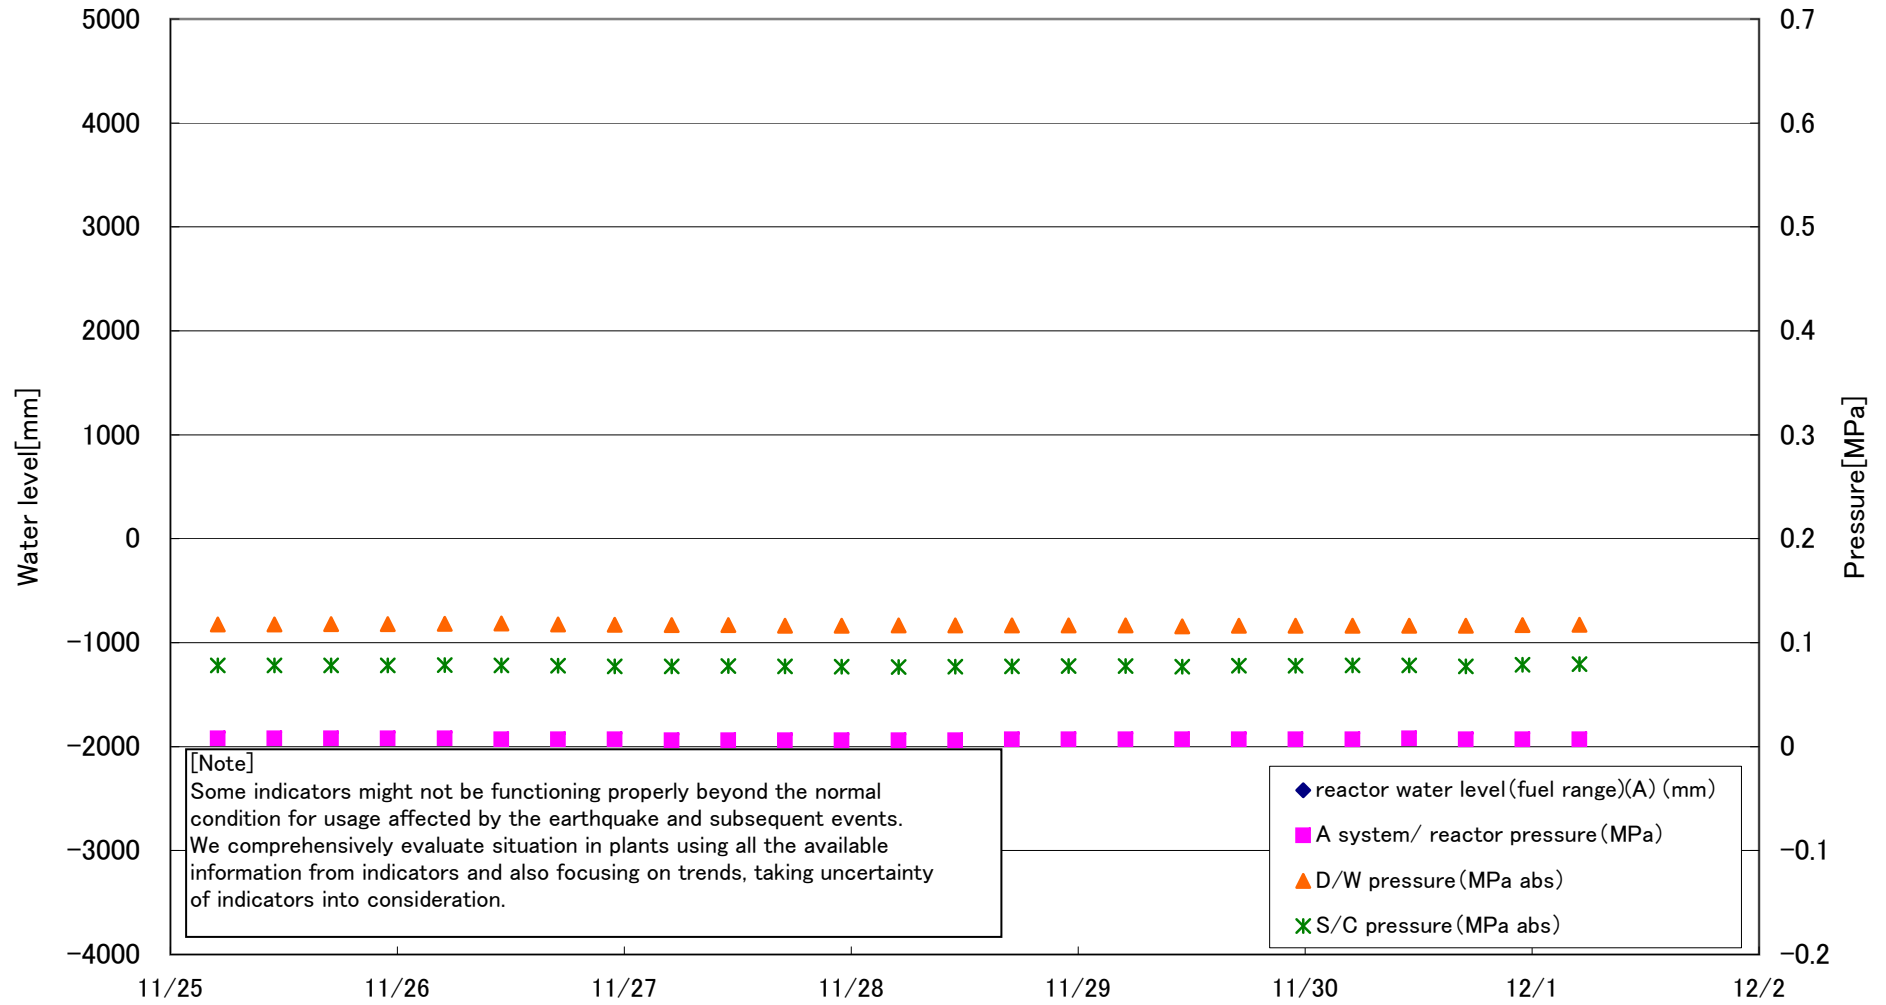

## Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date        | reactor water level(fuel range)(A) (mm) | reactor water level(fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | note |
|-------------|---|---|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|------|
| 11/25 5:00  |   | -1390                                   | 0.008                            | -                                | 0.1176                 | 0.078                  | 1.00E-02           | 1.90E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/25 11:00 |   | -1380                                   | 0.008                            | -                                | 0.1176                 | 0.078                  | 1.00E-02           | 1.42E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/25 17:00 |   | -1380                                   | 0.008                            | -                                | 0.1177                 | 0.078                  | 1.00E-02           | 1.81E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/25 23:00 |   | -1410                                   | 0.008                            | -                                | 0.1177                 | 0.078                  | 1.00E-02           | 1.48E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/26 5:00  |   | -1440                                   | 0.008                            | -                                | 0.1182                 | 0.078                  | 1.00E-02           | 1.52E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/26 11:00 |   | -1420                                   | 0.007                            | -                                | 0.1184                 | 0.078                  | 1.00E-02           | 1.46E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/26 17:00 |   | -1340                                   | 0.007                            | -                                | 0.1175                 | 0.078                  | 1.00E-02           | 1.46E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/26 23:00 |   | -1320                                   | 0.007                            | -                                | 0.1172                 | 0.077                  | 1.00E-02           | 1.63E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/27 5:00  |   | -1300                                   | 0.006                            | -                                | 0.1170                 | 0.077                  | 1.00E-02           | 1.56E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/27 11:00 |   | -1370                                   | 0.006                            | -                                | 0.1168                 | 0.078                  | 1.00E-02           | 1.59E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/27 17:00 |   | -1300                                   | 0.006                            | -                                | 0.1164                 | 0.077                  | 1.00E-02           | 1.56E+02           | 6.70E-01           | 6.90E-01           |      |
| 11/27 23:00 |   | -1300                                   | 0.006                            | -                                | 0.1164                 | 0.077                  | 1.00E-02           | 1.53E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/28 5:00  |   | -1290                                   | 0.006                            | -                                | 0.1165                 | 0.077                  | 1.00E-02           | 1.31E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/28 11:00 |   | -1270                                   | 0.006                            | -                                | 0.1166                 | 0.077                  | 1.00E-02           | 1.20E+01           | 6.70E-01           | 6.80E-01           |      |
| 11/28 17:00 |   | -1390                                   | 0.007                            | -                                | 0.1166                 | 0.077                  | 1.00E-02           | 1.20E+01           | 6.70E-01           | 6.90E-01           |      |
| 11/28 23:00 |   | -1390                                   | 0.007                            | -                                | 0.1166                 | 0.078                  | 1.00E-02           | 1.20E+01           | 6.70E-01           | 6.80E-01           |      |
| 11/29 5:00  |   | -1380                                   | 0.007                            | -                                | 0.1165                 | 0.077                  | 1.00E-02           | 1.23E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/29 11:00 |   | -1320                                   | 0.007                            | -                                | 0.1157                 | 0.077                  | 1.00E-02           | 1.27E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/29 17:00 |   | -1330                                   | 0.007                            | -                                | 0.1163                 | 0.078                  | 1.00E-02           | 1.44E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/29 23:00 |   | -1340                                   | 0.007                            | -                                | 0.1164                 | 0.078                  | 1.00E-02           | 2.16E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/30 5:00  |   | -1330                                   | 0.007                            | -                                | 0.1164                 | 0.078                  | 1.00E-02           | 2.16E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/30 11:00 |   | -1320                                   | 0.008                            | -                                | 0.1164                 | 0.078                  | 1.00E-02           | 1.90E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/30 17:00 |   | -1330                                   | 0.007                            | -                                | 0.1163                 | 0.077                  | 1.00E-02           | 1.61E+01           | 6.60E-01           | 6.80E-01           |      |
| 11/30 23:00 |   | -1380                                   | 0.007                            | -                                | 0.1169                 | 0.079                  | 1.00E-02           | 1.71E+02           | 6.60E-01           | 6.80E-01           |      |
| 12/1 5:00   |   | -1410                                   | 0.007                            | -                                | 0.1171                 | 0.079                  | 1.00E-02           | 1.67E+01           | 6.60E-01           | 6.80E-01           |      |

DS

measurement measurement  
 instrument instrument  
 malfunction malfunction