


## Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure

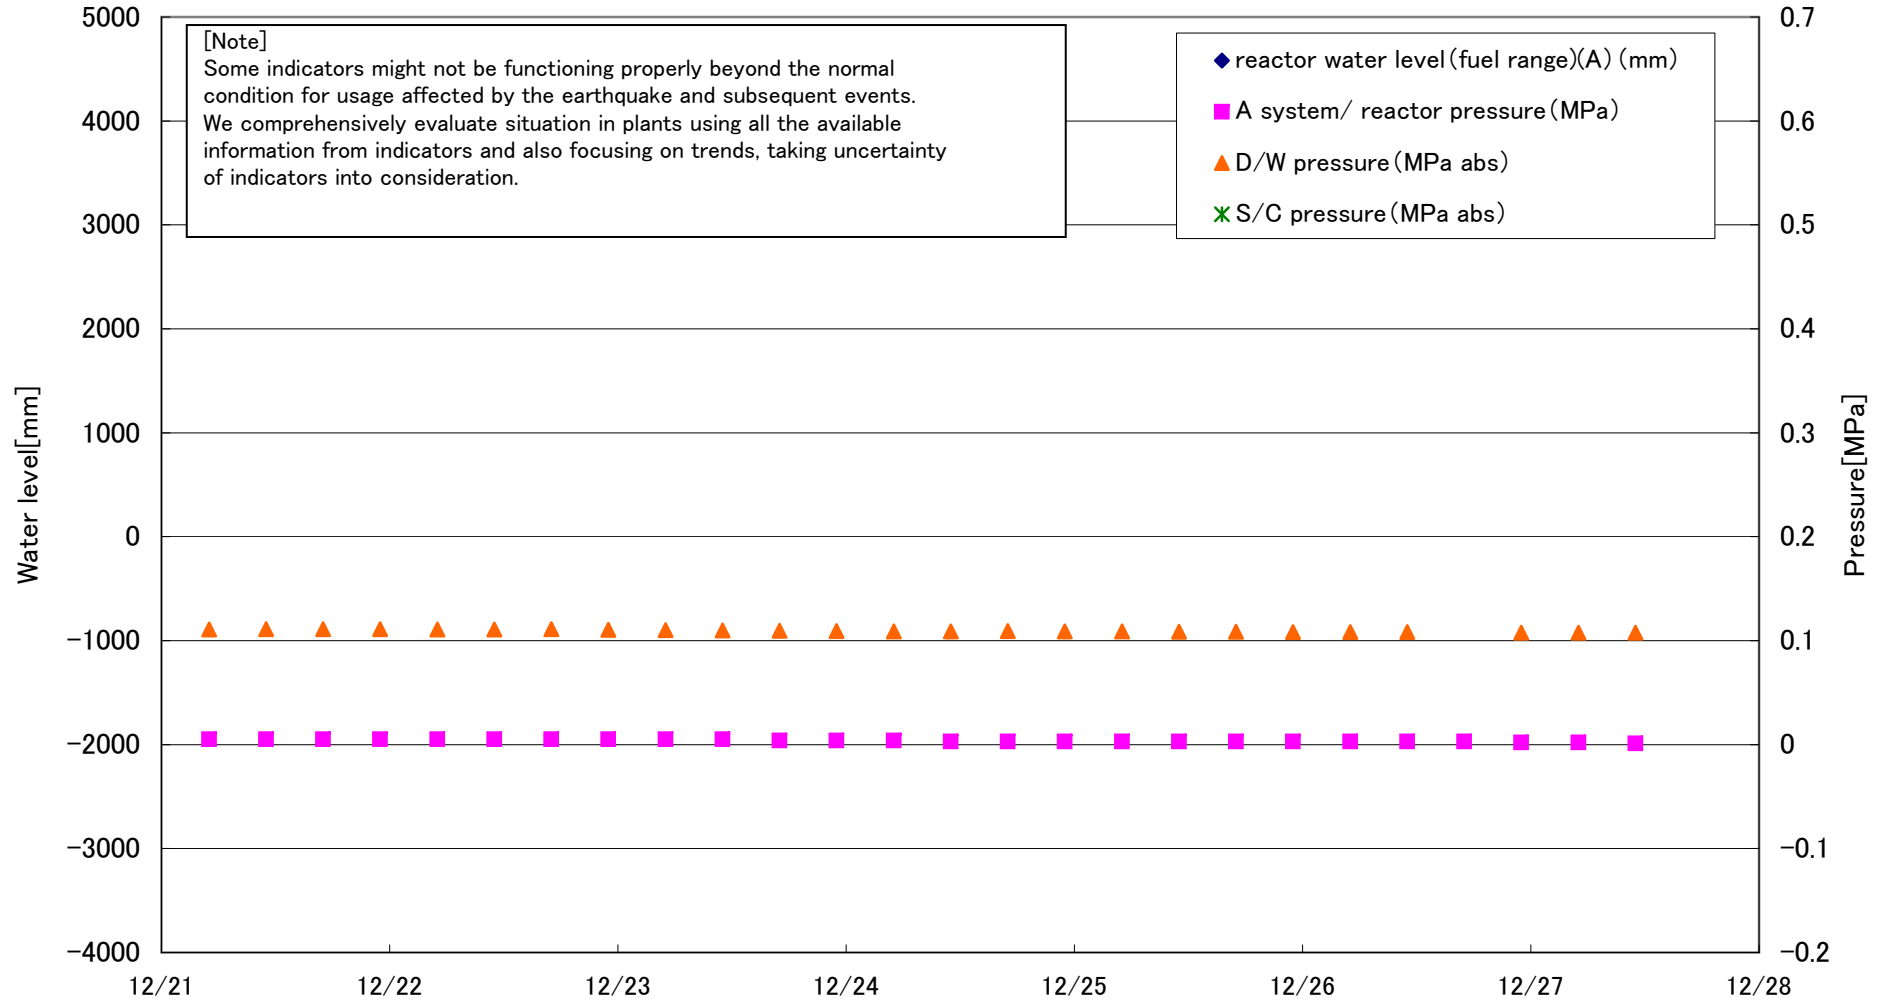

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date        | reactor water level (fuel range)(A) (mm) | reactor water level (fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | radiation dose in main control room of Unit 1 & Unit 2 (mSv/h) | note  |
|-------------|--|--|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|--|---|
| 12/21 5:00  |  | -2127                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.59E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/21 11:00 |  | -2123                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.59E+00           | 7.00E-02           | 2.09E+00           | 0.004  |   |
| 12/21 17:00 |  | -2121                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.59E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/21 23:00 |  | -2122                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.59E+00           | 7.00E-02           | 2.06E+00           | 0.004  |   |
| 12/22 5:00  |  | -2123                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.57E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/22 11:00 |  | -2122                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.57E+00           | 7.00E-02           | 2.06E+00           | 0.004  |   |
| 12/22 17:00 |  | -2120                                    | 0.005                            | -                                | 0.111                  |                        | 7.00E+00           | 2.57E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/22 23:00 |  | -2120                                    | 0.005                            | -                                | 0.111                  |                        | 6.98E+00           | 2.57E+00           | 7.00E-02           | 2.03E+00           | 0.004  |   |
| 12/23 5:00  |  | -2122                                    | 0.005                            | -                                | 0.110                  |                        | 6.98E+00           | 2.57E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/23 11:00 |  | -2121                                    | 0.005                            | -                                | 0.110                  |                        | 6.98E+00           | 2.57E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/23 17:00 |  | -2121                                    | 0.004                            | -                                | 0.110                  |                        | 6.95E+00           | 2.57E+00           | 7.00E-02           | 2.05E+00           | 0.004  |   |
| 12/23 23:00 |  | -2124                                    | 0.004                            | -                                | 0.109                  |                        | 6.95E+00           | 2.57E+00           | 7.00E-02           | 2.03E+00           | 0.004  |   |
| 12/24 5:00  |  | -2125                                    | 0.004                            | -                                | 0.109                  |                        | 6.96E+00           | 2.57E+00           | 6.00E-02           | 2.02E+00           | 0.005  |   |
| 12/24 11:00 |  | -2123                                    | 0.003                            | -                                | 0.109                  |                        | 6.95E+00           | 2.57E+00           | 6.00E-02           | 2.01E+00           | 0.004  |   |
| 12/24 17:00 |  | -2119                                    | 0.003                            | -                                | 0.109                  |                        | 6.96E+00           | 2.57E+00           | 6.00E-02           | 1.99E+00           | 0.004  |   |
| 12/24 23:00 |  | -2122                                    | 0.003                            | -                                | 0.109                  |                        | 6.95E+00           | 2.57E+00           | 6.00E-02           | 1.97E+00           | 0.005  |   |
| 12/25 5:00  |  | -2124                                    | 0.003                            | -                                | 0.109                  |                        | 6.95E+00           | 2.57E+00           | 6.00E-02           | 1.97E+00           | 0.004  |   |
| 12/25 11:00 |  | -2122                                    | 0.003                            | -                                | 0.109                  |                        | 6.95E+00           | 2.57E+00           | 6.00E-02           | 1.96E+00           | 0.004  |   |
| 12/25 17:00 |  | -2122                                    | 0.003                            | -                                | 0.109                  |                        | 6.96E+00           | 2.56E+00           | 6.00E-02           | 1.96E+00           | 0.004  |   |
| 12/25 23:00 |  | -2124                                    | 0.003                            | -                                | 0.108                  |                        | 6.95E+00           | 2.55E+00           | 6.00E-02           | 1.96E+00           | 0.004  |   |
| 12/26 5:00  |  | -2126                                    | 0.003                            | -                                | 0.108                  |                        | 6.95E+00           | 2.55E+00           | 6.00E-02           | 1.95E+00           | 0.004  |   |
| 12/26 11:00 |  | -2123                                    | 0.003                            | -                                | 0.108                  |                        | 6.92E+00           | 2.55E+00           | 6.00E-02           | 1.94E+00           | 0.004  |   |
| 12/26 17:00 |  |  | 0.003                            | -                                |                        |                        | 6.93E+00           | 2.55E+00           | 6.00E-02           | 1.95E+00           | 0.004  | Regarding reactor water level (fuel range) (B), D/W pressure, and S/C pressure, data is missing due to power conversion work. |
| 12/26 23:00 |  | -2125                                    | 0.002                            | -                                | 0.108                  |                        | 6.92E+00           | 2.55E+00           | 6.00E-02           | 1.90E+00           | 0.004  |   |
| 12/27 5:00  |  | -2124                                    | 0.002                            | -                                | 0.108                  |                        | 6.93E+00           | 2.55E+00           | 6.00E-02           | 1.89E+00           | 0.004  |   |
| 12/27 11:00 |  | -2123                                    | 0.001                            | -                                | 0.108                  |                        | 6.93E+00           | 2.55E+00           | 6.00E-02           | 1.86E+00           | 0.004  |   |

DS

measurement  
instrument  
malfunction

measurement  
instrument  
malfunction

measurement  
instrument  
malfunction