


## Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure

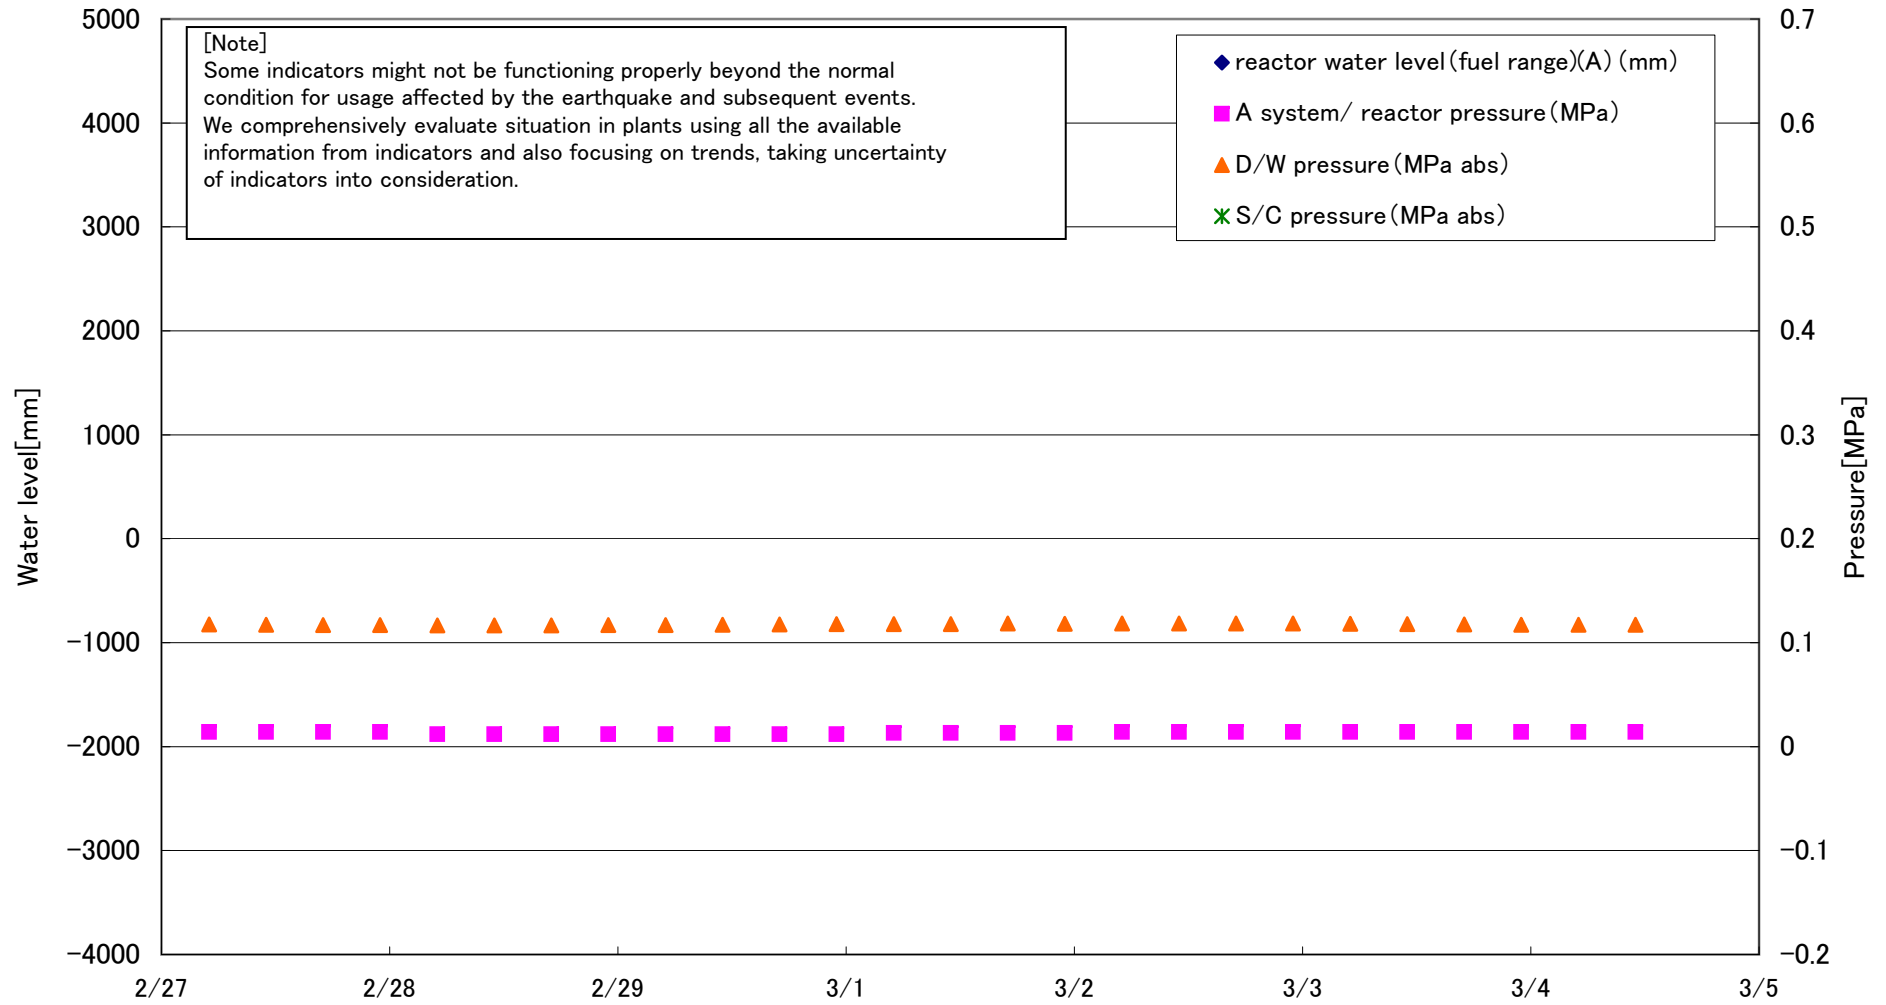

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level(fuel range)(A) (mm)<br>※3 | reactor water level(fuel range)(B) (mm)<br>※3 | A system/<br>reactor<br>pressure (MPa) | B system/<br>reactor<br>pressure (MPa) | D/W<br>pressure<br>(MPa abs) | S/C<br>pressure<br>(MPa abs)<br>※1 | CAMS<br>D/W(A)<br>(Sv/h) | CAMS<br>D/W(B)<br>(Sv/h)<br>※1 | CAMS<br>S/C(A)<br>(Sv/h) | CAMS<br>S/C(B)<br>(Sv/h)<br>※1 | radiation dose in main control room of Unit 1 & Unit 2 (mSv/h) | note<br>※1: Instrument failure<br>※3: continuously monitoring the status |
|------------|---|---|--|--|------------------------------|------------------------------------|--------------------------|--------------------------------|--------------------------|--------------------------------|--|--|
| 2/27 5:00  |   | -2116   | 0.014                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 1.10E+01                       | 0.004  |  |
| 2/27 11:00 |   | -2116   | 0.014                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 8.00E+00                       | 0.005  |  |
| 2/27 17:00 |   | -2115   | 0.014                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 9.91E+00                       | 0.004  |  |
| 2/27 23:00 |   | -2116   | 0.014                                  | -                                      | 0.117                        |                                    | 6.30E+00                 | 2.52E+00                       | 5.00E-02                 | 8.17E+00                       | 0.004  |  |
| 2/28 5:00  |   | -2116   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 7.51E+00                       | 0.004  |  |
| 2/28 11:00 |   | -2115   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 6.19E+00                       | 0.004  |  |
| 2/28 17:00 |   | -2115   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 2.49E+00                       | 0.004  |  |
| 2/28 23:00 |   | -2115   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 1.10E+01                       | 0.004  |  |
| 2/29 5:00  |   | -2115   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 1.04E+01                       | 0.004  |  |
| 2/29 11:00 |   | -2114   | 0.012                                  | -                                      | 0.117                        |                                    | 6.30E+00                 | 2.52E+00                       | 5.00E-02                 | 9.50E+00                       | 0.004  |  |
| 2/29 17:00 |   | -2114   | 0.012                                  | -                                      | 0.117                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 9.50E+00                       | 0.004  |  |
| 2/29 23:00 |   | -2115   | 0.012                                  | -                                      | 0.118                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 9.04E+00                       | 0.004  |  |
| 3/1 5:00   |   | -2115   | 0.013                                  | -                                      | 0.118                        |                                    | 6.30E+00                 | 2.52E+00                       | 5.00E-02                 | 9.66E+00                       | 0.004  |  |
| 3/1 11:00  |   | -2115   | 0.013                                  | -                                      | 0.118                        |                                    | 6.31E+00                 | 2.52E+00                       | 5.00E-02                 | 9.35E+00                       | 0.004  |  |
| 3/1 17:00  |   | -2114   | 0.013                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.20E+01                       | 0.004  |  |
| 3/1 23:00  |   | -2115   | 0.013                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.14E+01                       | 0.004  |  |
| 3/2 5:00   |   | -2113   | 0.014                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.12E+01                       | 0.004  |  |
| 3/2 11:00  |   | -2113   | 0.014                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.00E+01                       | 0.004  |  |
| 3/2 17:00  |   | -2114   | 0.014                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.06E+01                       | 0.004  |  |
| 3/2 23:00  |   | -2113   | 0.014                                  | -                                      | 0.118                        |                                    | 6.26E+00                 | 2.52E+00                       | 5.00E-02                 | 9.55E+00                       | 0.004  |  |
| 3/3 5:00   |   | -2114   | 0.014                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 1.05E+01                       | 0.004  |  |
| 3/3 11:00  |   | -2114   | 0.014                                  | -                                      | 0.118                        |                                    | 6.26E+00                 | 2.52E+00                       | 5.00E-02                 | 1.07E+01                       | 0.004  |  |
| 3/3 17:00  |   | -2114   | 0.014                                  | -                                      | 0.118                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 9.99E+00                       | 0.004  |  |
| 3/3 23:00  |   | -2113   | 0.014                                  | -                                      | 0.117                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 9.73E+00                       | 0.004  |  |
| 3/4 5:00   |   | -2114   | 0.014                                  | -                                      | 0.117                        |                                    | 6.25E+00                 | 2.52E+00                       | 5.00E-02                 | 9.62E+00                       | 0.004  |  |
| 3/4 11:00  |   | -2114   | 0.014                                  | -                                      | 0.117                        |                                    | 6.26E+00                 | 2.52E+00                       | 5.00E-02                 | 1.04E+01                       | 0.004  |  |

DS

DS