Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Temperature

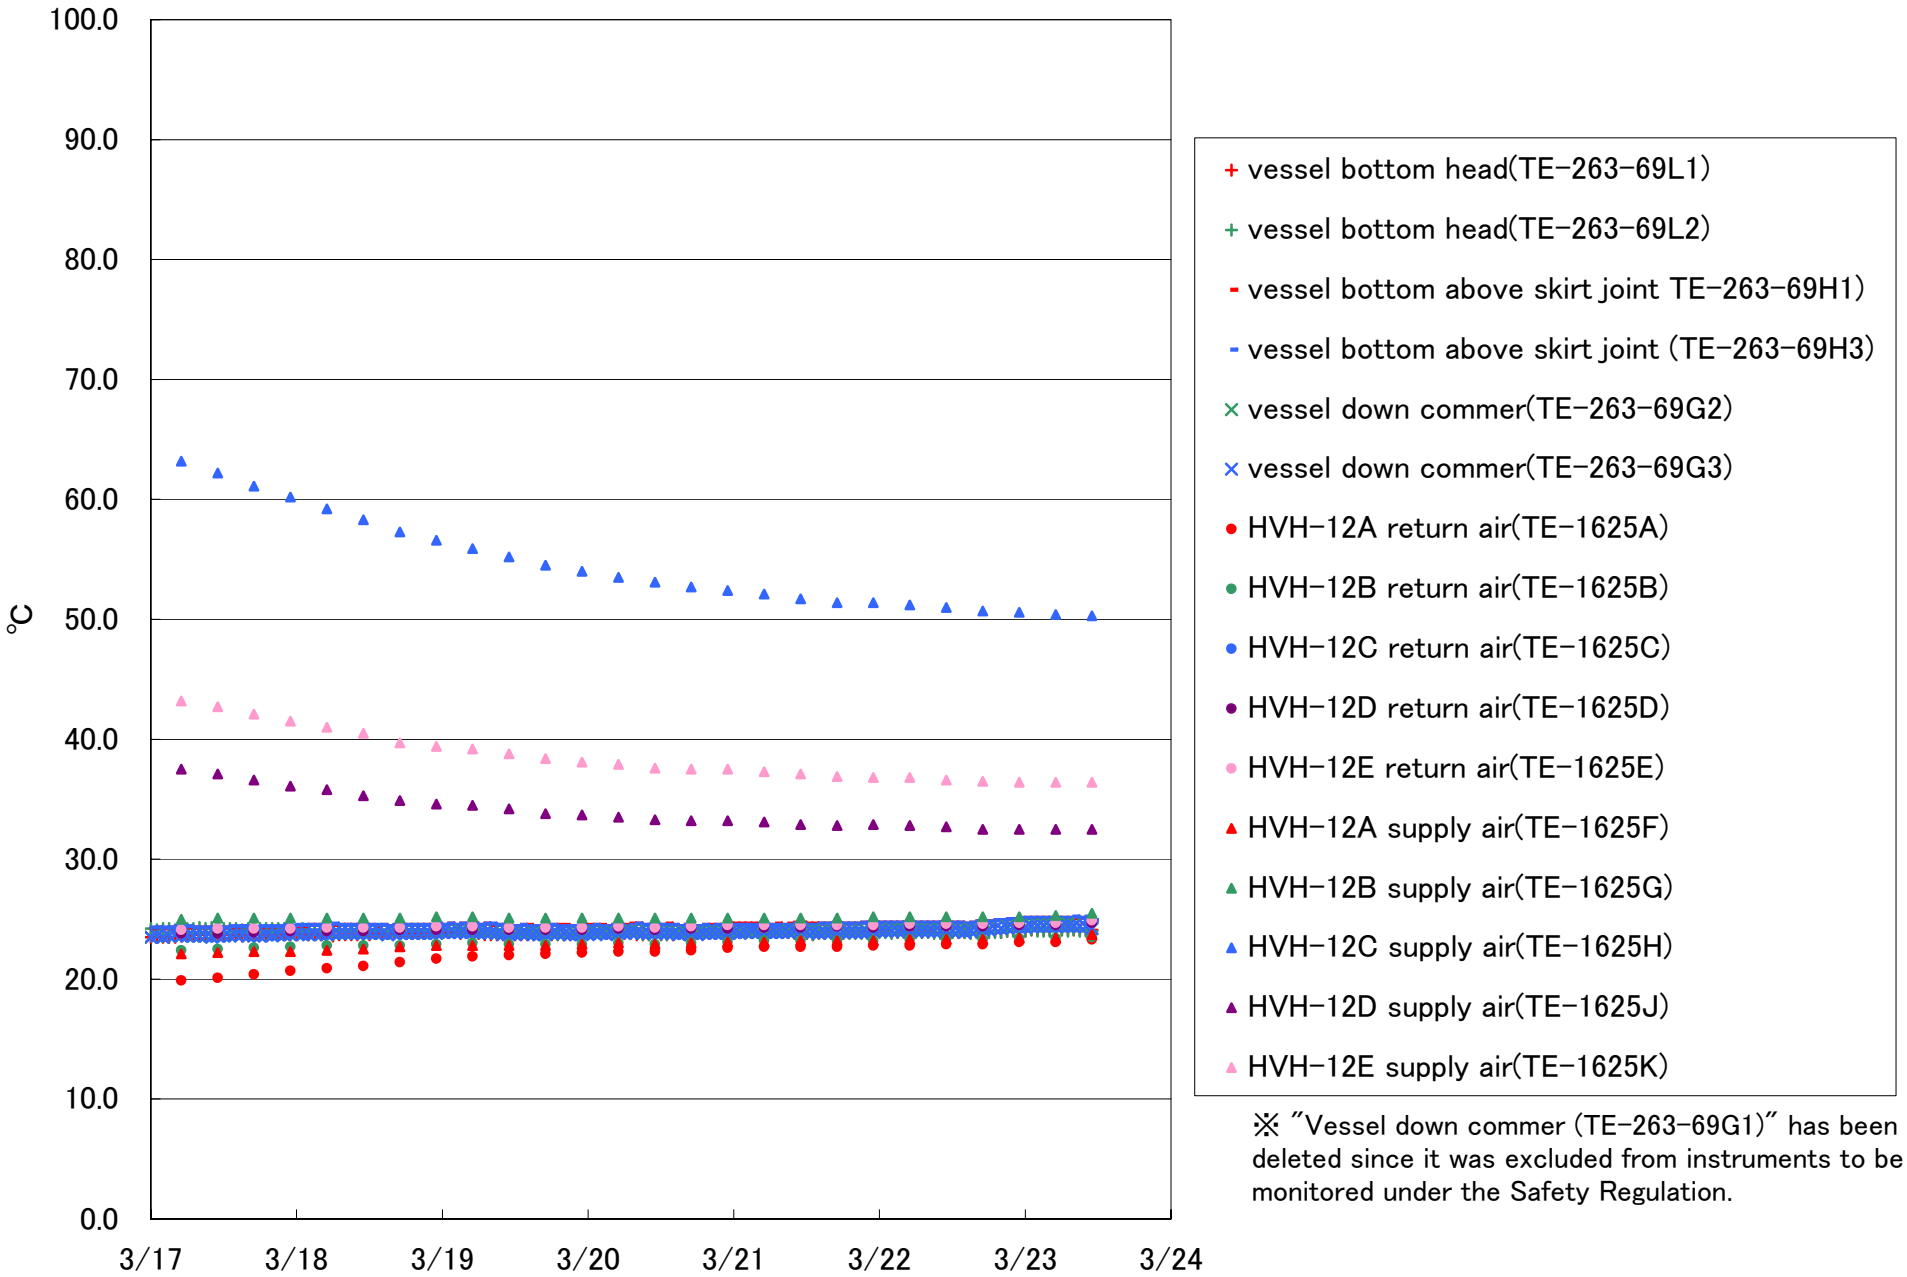

※ "Vessel down commer (TE-263-69G1)" has been deleted since it was excluded from instruments to be monitored under the Safety Regulation.