


Fukushima Daiichi Nuclear Power Station Unit 3 Parameters of Temperature

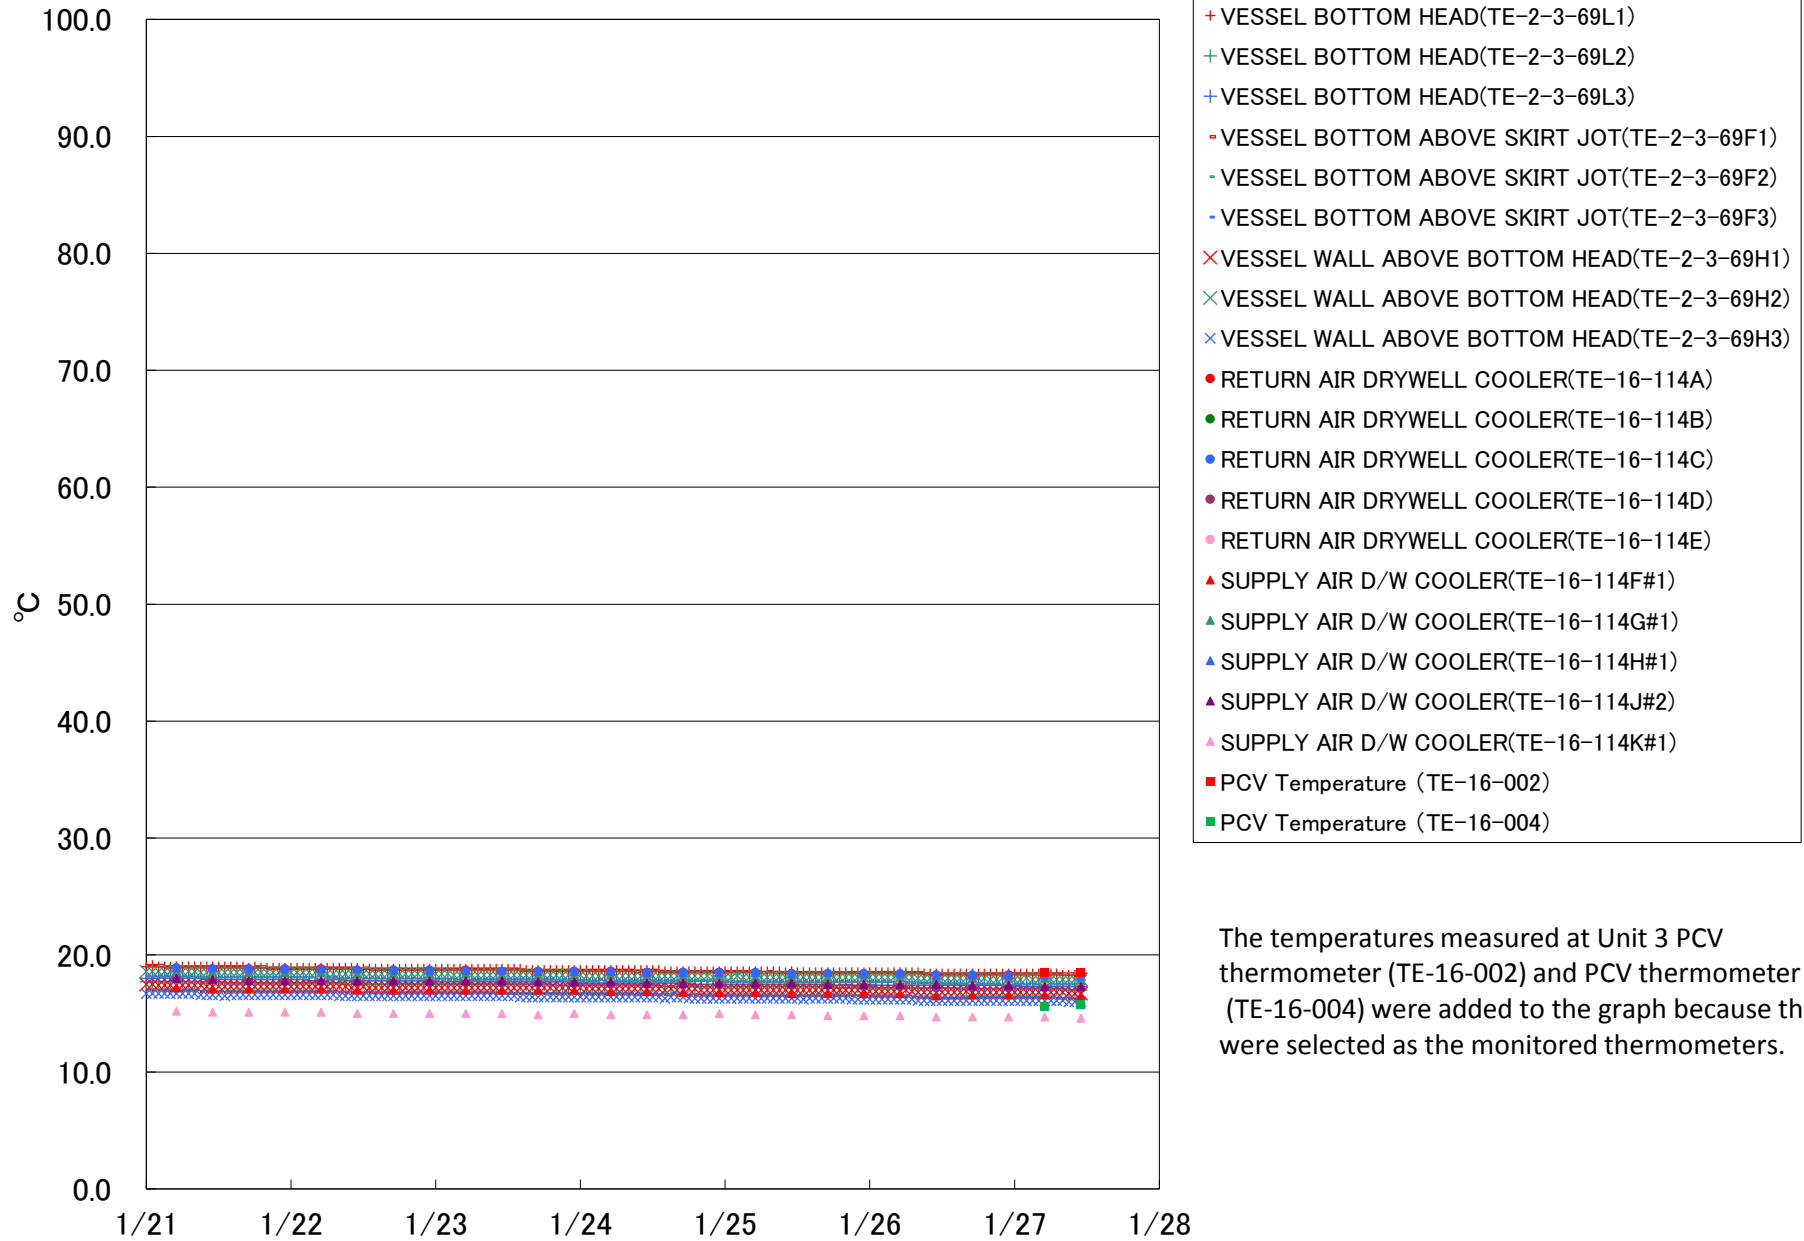

The temperatures measured at Unit 3 PCV thermometer (TE-16-002) and PCV thermometer (TE-16-004) were added to the graph because they were selected as the monitored thermometers.