

Nuclide Analysis Results of Radioactive Materials in Seawater <Coast>

Reference

(Data summarized on December 28)

Place of Sampling	North of Discharge Channel of 5-6u of 1F (approx. 30m north of 5-6u discharge channel)	Around South Discharge Channel of 1F (approx. 330m south of 1-4u Discharge Channel)	Around North Discharge Channel of 2F (Around 3,4u Discharge Channel) (approx. 10 km from 1F)	Around Iwasawa Shore of 2F (approx. 7 km south of 1,2u Discharge Channel) (approx. 16 km from 1F)						
Time of Sampling	Dec 27, 2011 08:35 am	Dec 27, 2011 08:10 am	Dec 27, 2011 08:10 am	Dec 27, 2011 07:50 am	Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)					
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)		Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (about 8 days)	ND	-	ND	-		ND	-	ND	-	40
Cs-134 (about 2 years)	3.0	0.05	1.6	0.03		ND	-	ND	-	60
Cs-137 (about 30 years)	3.3	0.04	1.9	0.02	ND	-	ND	-	90	

* Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm³ to Bq/L.

* Data of other nuclides are under evaluation.

* In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

* "ND" means the sampled data is below measurable limit.

I-131: approx. 0.61Bq/L, Cs-134: approx. 0.97Bq/L, Cs-137: approx. 1.1Bq/L

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

Nuclide Analysis Results of Radioactive Materials in Seawater <Offshore 1/2>

Reference

(Data summarized on December 28)

Place of Sampling	3 km offshore of Haramachi Ward Upper Layer		3 km offshore of Haramachi Ward Lower Layer		3 km offshore of Odaka Ward Upper Layer		3 km offshore of Odaka Ward Lower Layer		3 km offshore of Iwasawa shore Upper Layer		3 km offshore of Iwasawa shore Lower Layer		② Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)
	Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (about 8 days)	-	-	-	-	-	-	-	-	-	-	-	-	40
Cs-134 (about 2 years)	-	-	-	-	-	-	-	-	-	-	-	-	60
Cs-137 (about 30 years)	-	-	-	-	-	-	-	-	-	-	-	-	90

Place of Sampling	8 km offshore of Odaka Ward Upper Layer		8 km offshore of Odaka Ward Lower Layer		8 km offshore of Iwasawa shore Upper Layer		8 km offshore of Iwasawa shore Lower Layer		/		/		② Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)
	Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		/		/		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (about 8 days)	-	-	-	-	-	-	-	-	/	/	/	/	40
Cs-134 (about 2 years)	-	-	-	-	-	-	-	-	/	/	/	/	60
Cs-137 (about 30 years)	-	-	-	-	-	-	-	-	/	/	/	/	90

* Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm³ to Bq/L.

(Not all sampled due to bad weather)

Nuclide Analysis Results of Radioactive Materials in Seawater <Offshore 2/2>

Reference

(Data summarized on December 28)

Place of Sampling	3 km offshore of North of Iwaki Upper Layer		3 km offshore of North of Iwaki Lower Layer		3 km offshore of Natsui river Upper Layer		3 km offshore of Natsui river Lower Layer		3 km offshore of Onahama port Upper Layer		3 km offshore of Onahama port Lower Layer		② Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)
Time of Sampling	Dec 26, 2011 05:40 am		Dec 26, 2011 05:40 am		Dec 26, 2011 06:05 am		Dec 26, 2011 06:05 am		Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (about 8 days)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	40
Cs-134 (about 2 years)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	60
Cs-137 (about 30 years)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	90

Place of Sampling	3 km offshore of Ena Upper Layer		3 km offshore of Ena Lower Layer		3 km offshore of Numanouchi Upper Layer		3 km offshore of Numanouchi Lower Layer		3 km offshore of Toyoma Upper Layer		3 km offshore of Toyoma Lower Layer		② Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)
Time of Sampling	Dec 26, 2011 (Not sampled)		Dec 26, 2011 (Not sampled)		Dec 26, 2011 06:15 am		Dec 26, 2011 06:15 am		Dec 26, 2011 06:30 am		Dec 26, 2011 06:30 am		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (about 8 days)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (about 2 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	60
Cs-137 (about 30 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	90

* Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm³ to Bq/L.

* Data of other nuclides are under evaluation.

* In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.


* "ND" means the sampled data is below measurable limit.

I-131: approx. 0.71Bq/L, Cs-134: approx. 0.92Bq/L, Cs-137: approx. 1.1Bq/L


Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

(Not all sampled due to bad weather)


Radioactivity Density of Seawater (Bq/L)

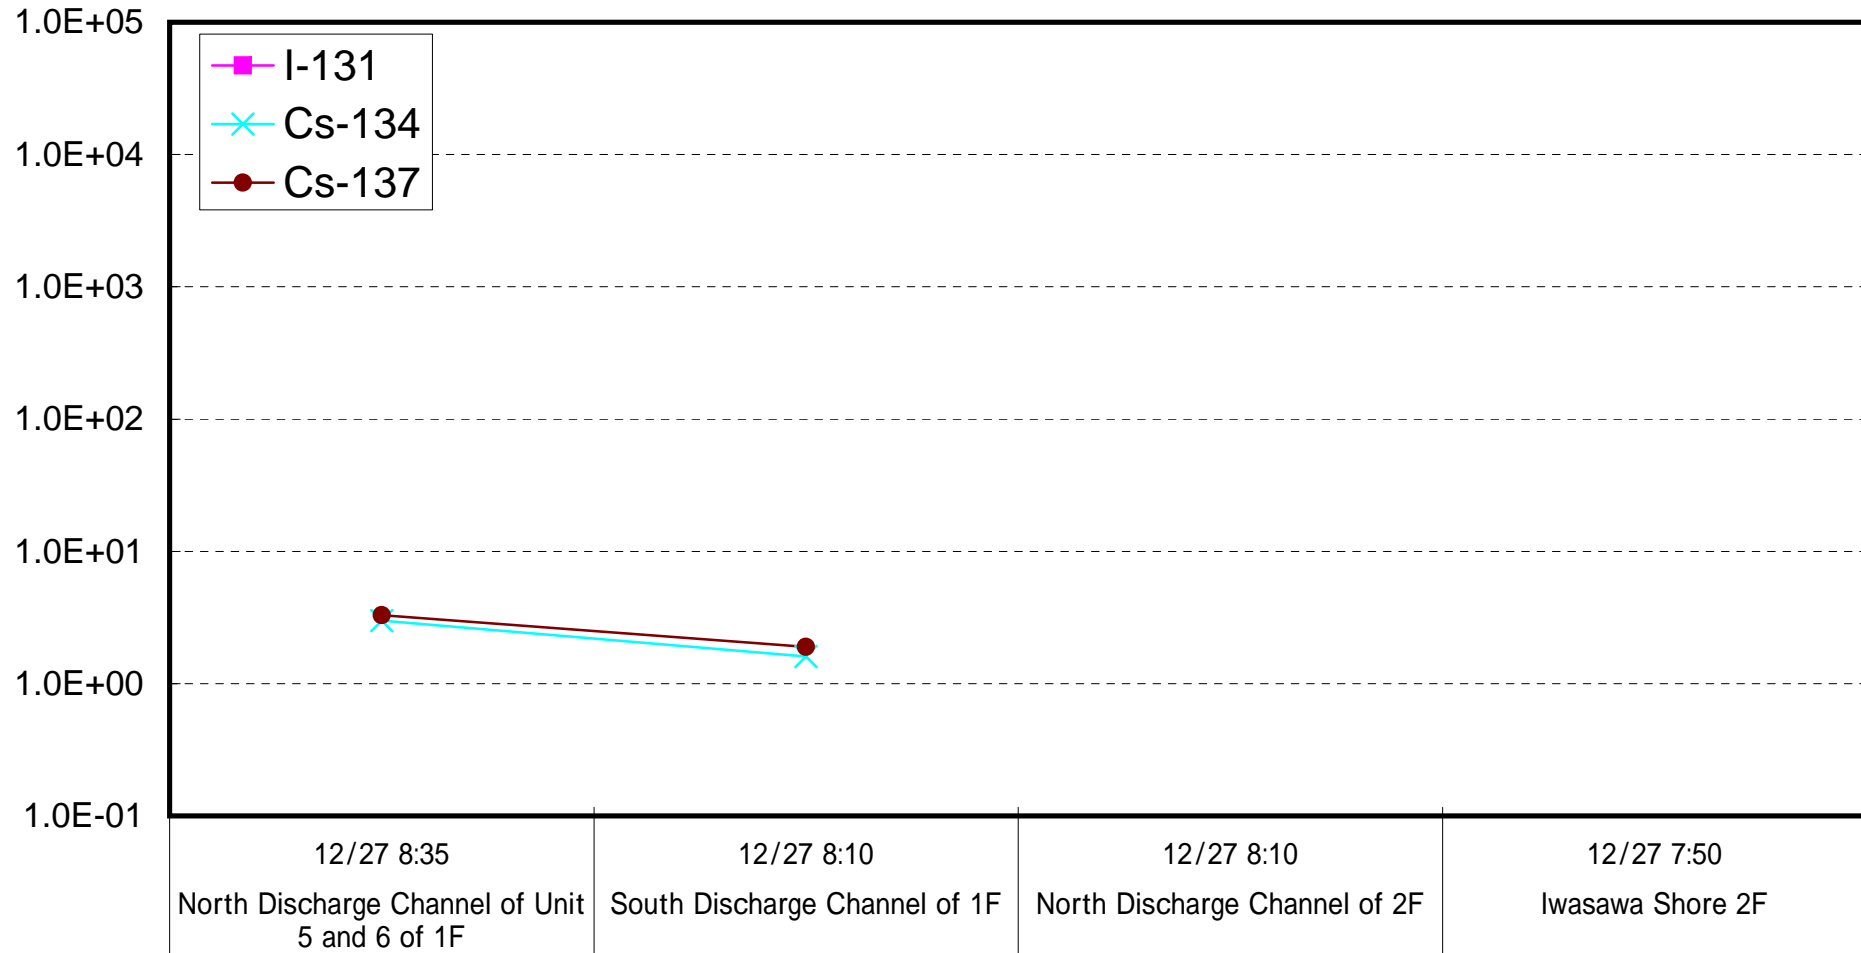


Radioactivity Density of Seawater at North of 1F5-6 Discharge Channel (Bq/L)

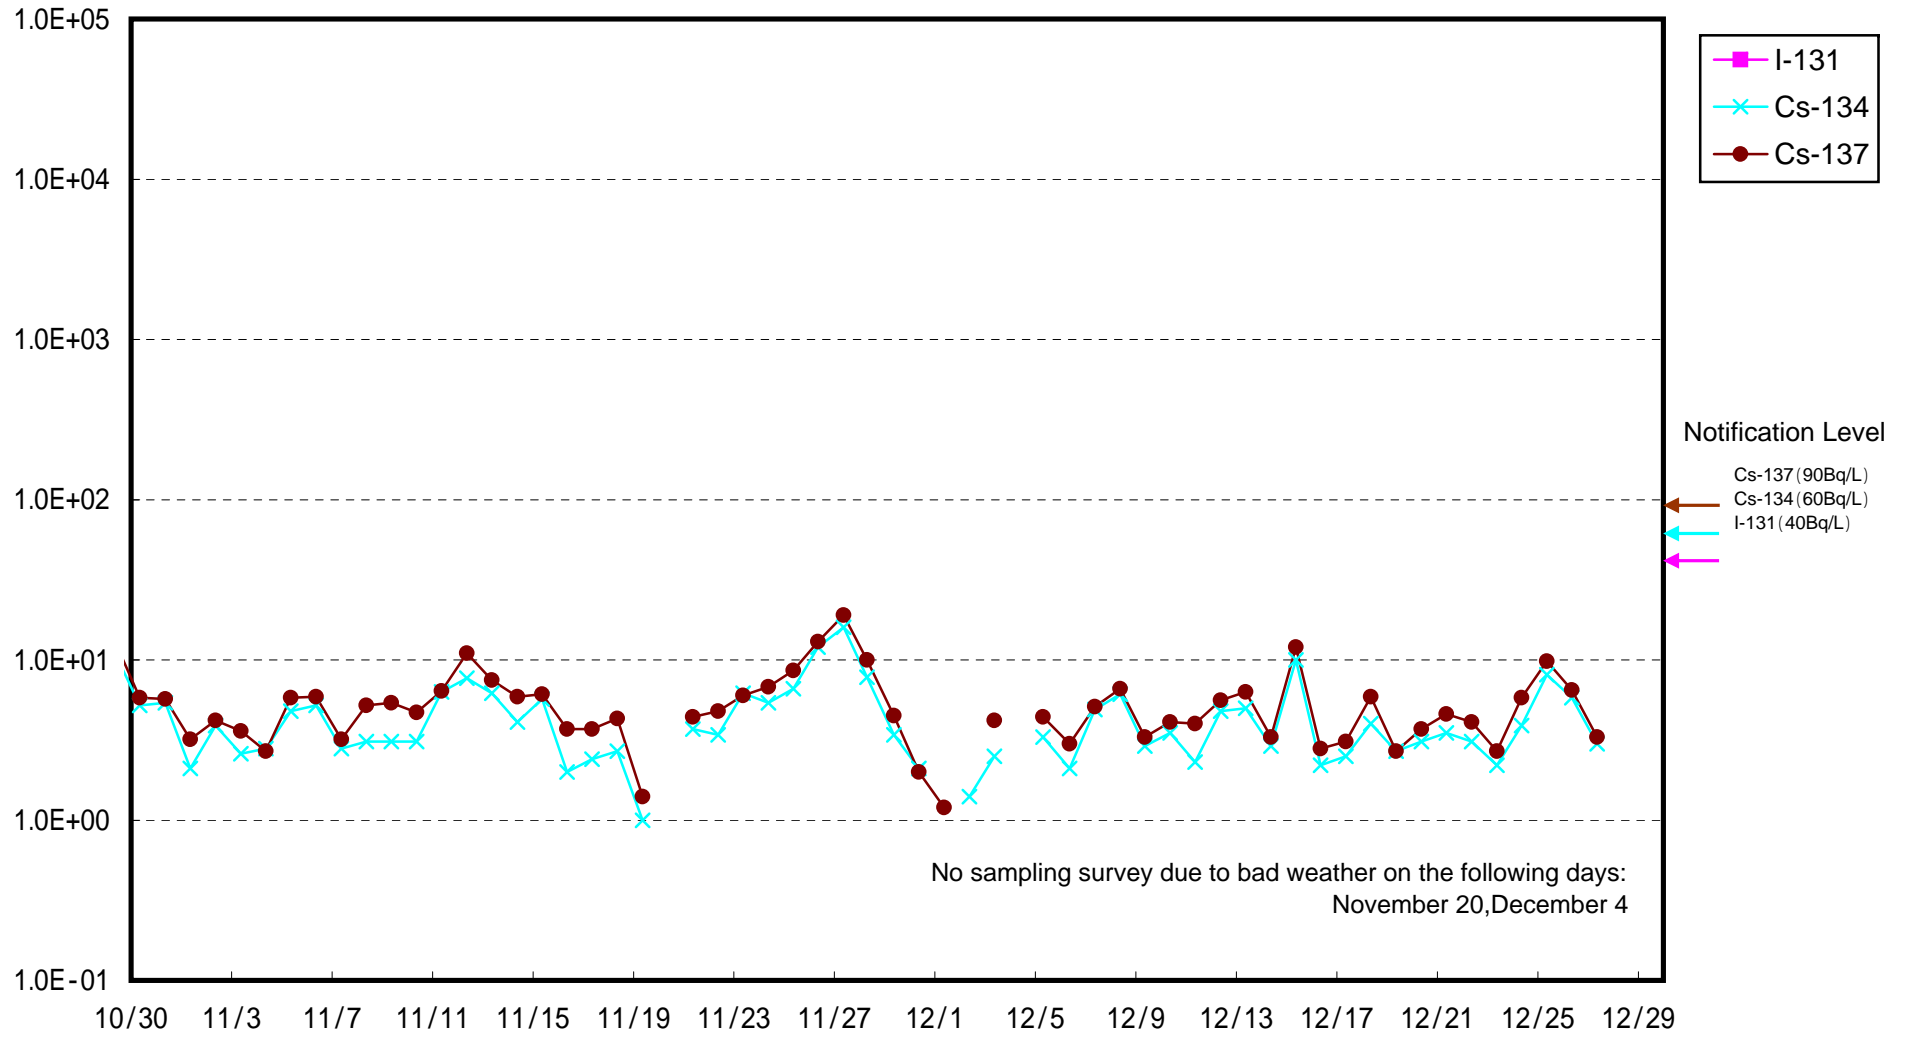


Radioactivity Density of Seawater at South Discharge Channel of 1F (Bq/L)

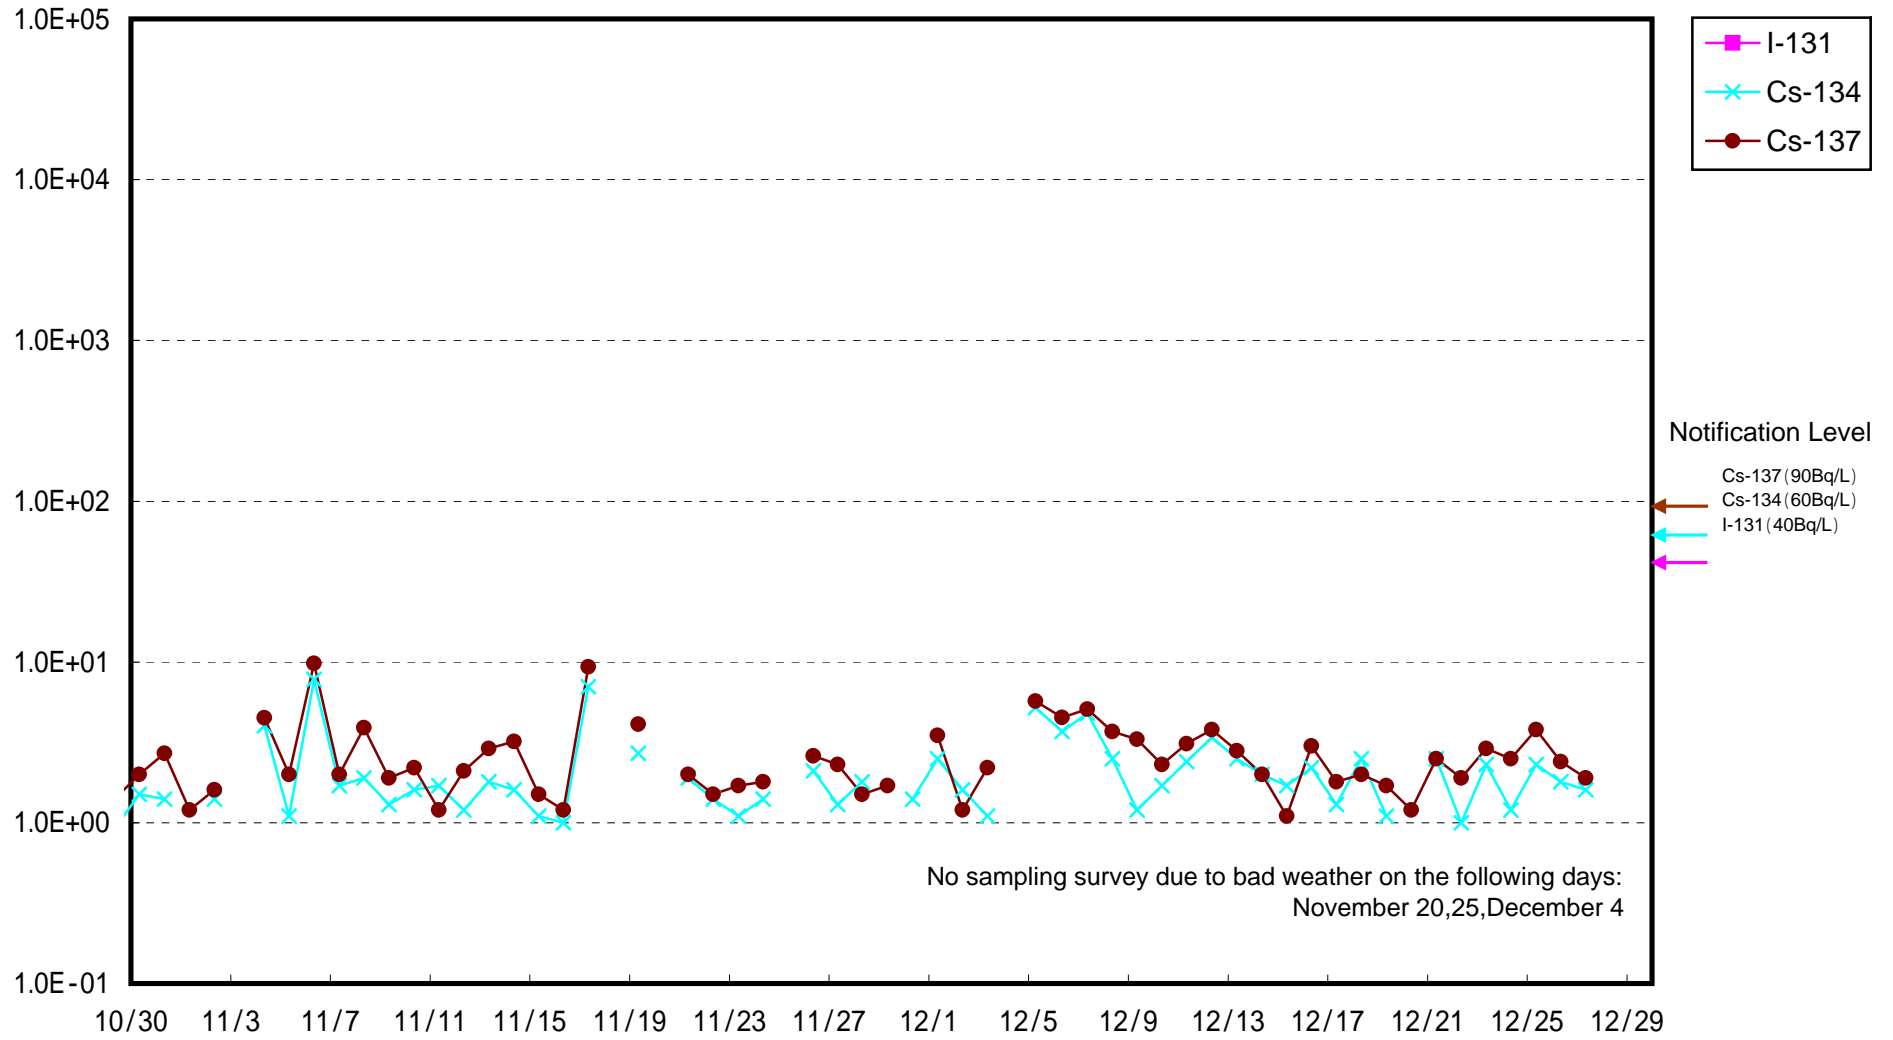


Radioactivity Density of Seawater at North Discharge Channel of 2F (Bq/L)

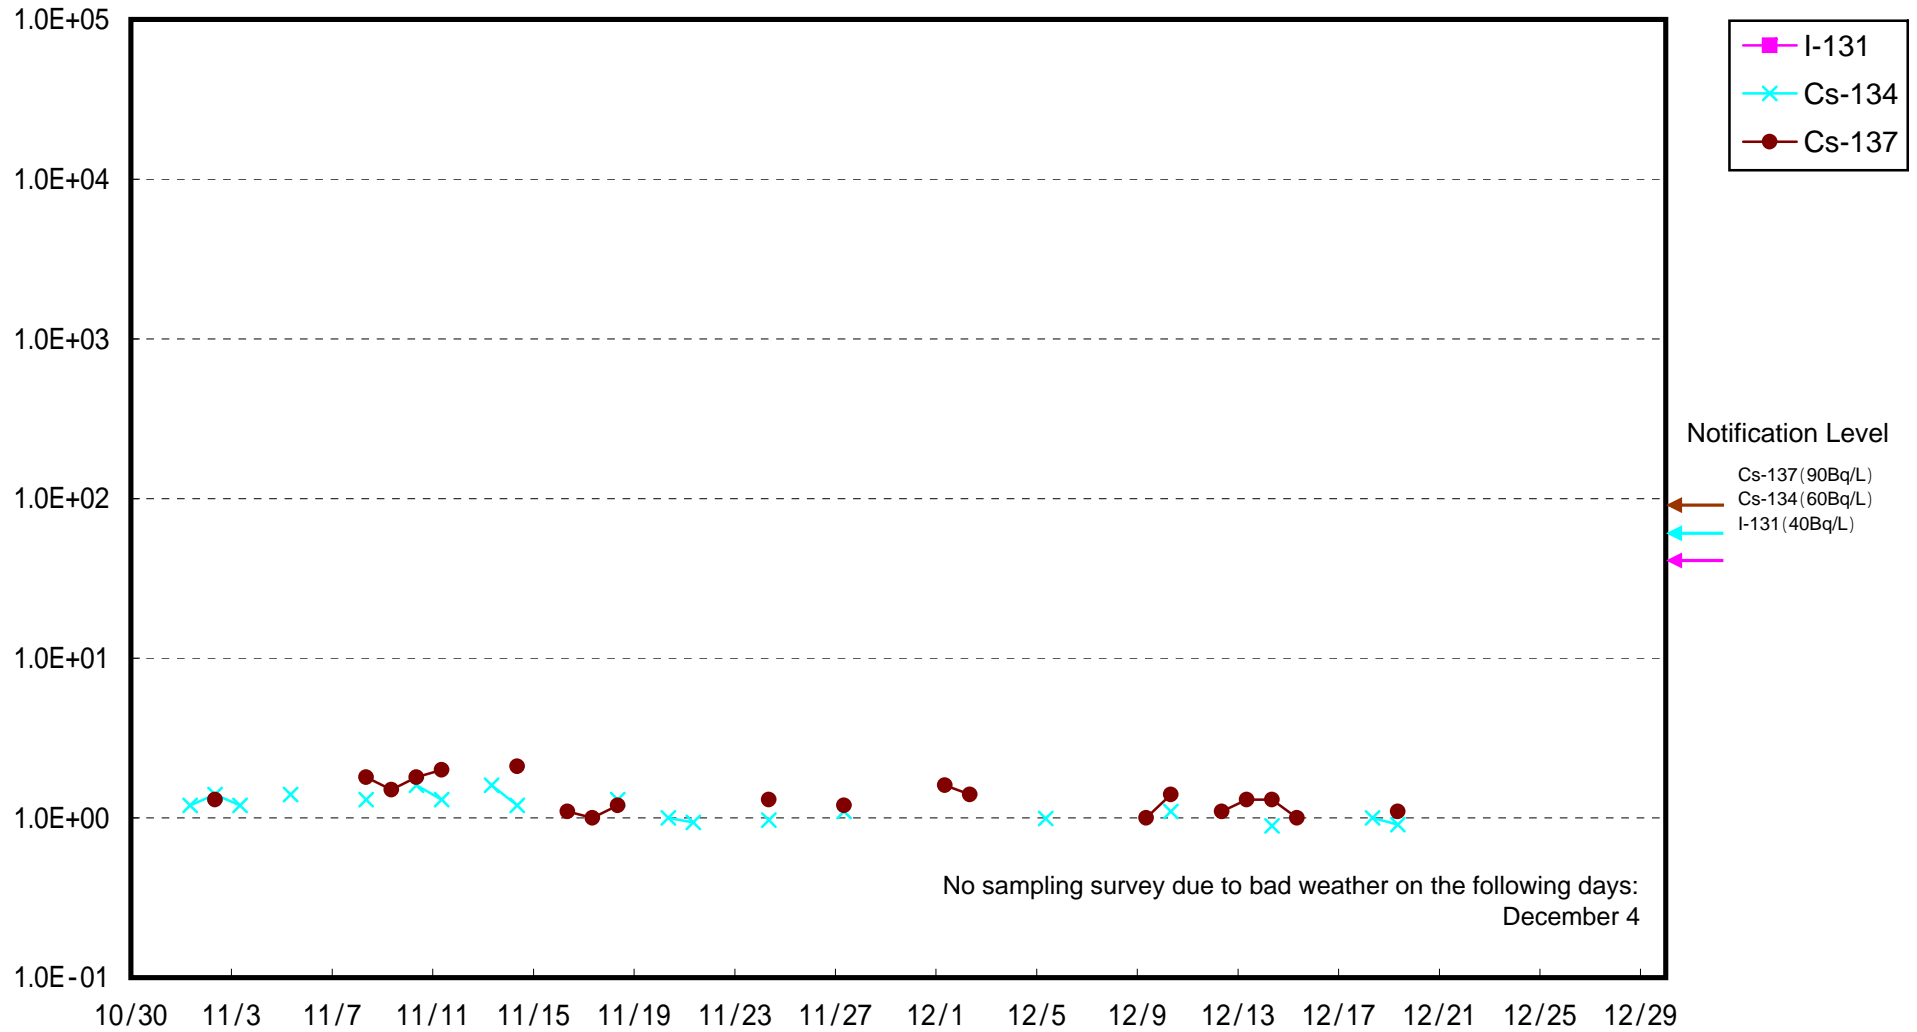


Radioactivity Density of Seawater at Iwasawa Shore 2F (Bq/L)

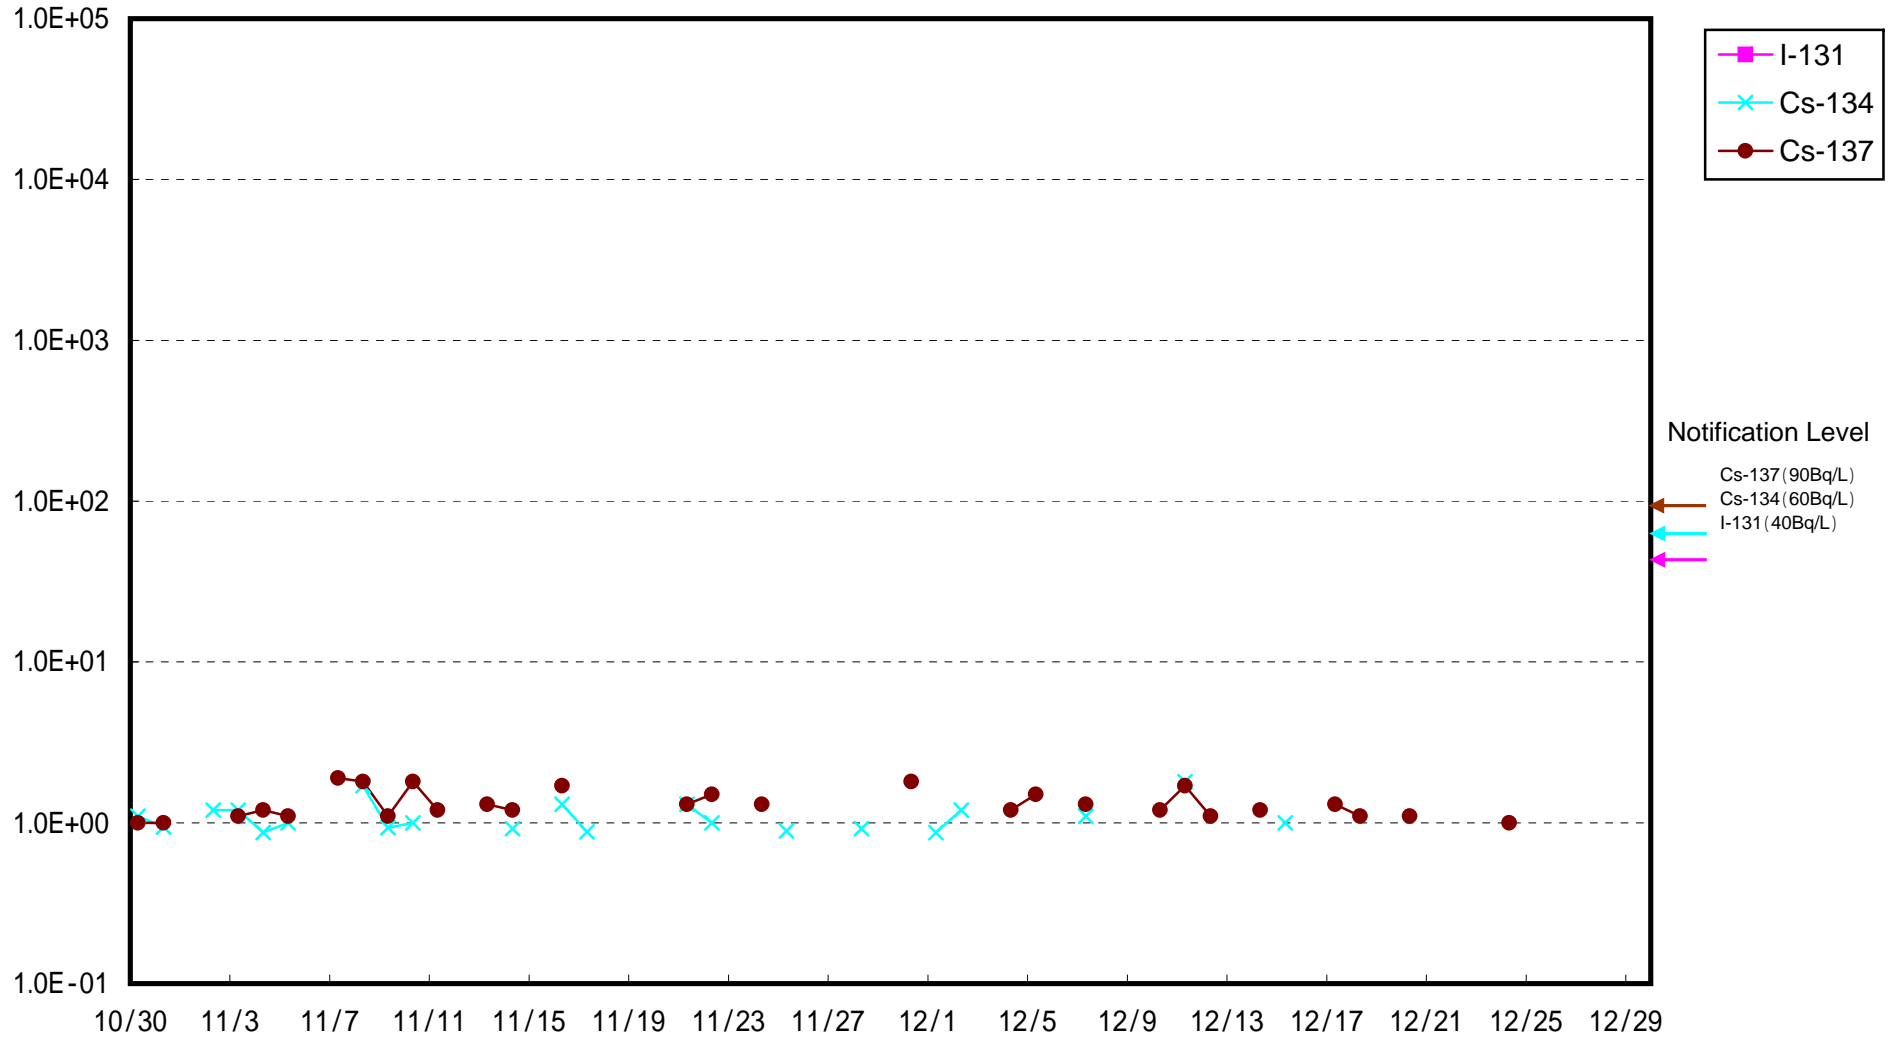


Radioactivity Density of Seawater around 3km offshore of North of Iwaki City Upper Layer(Bq/L)

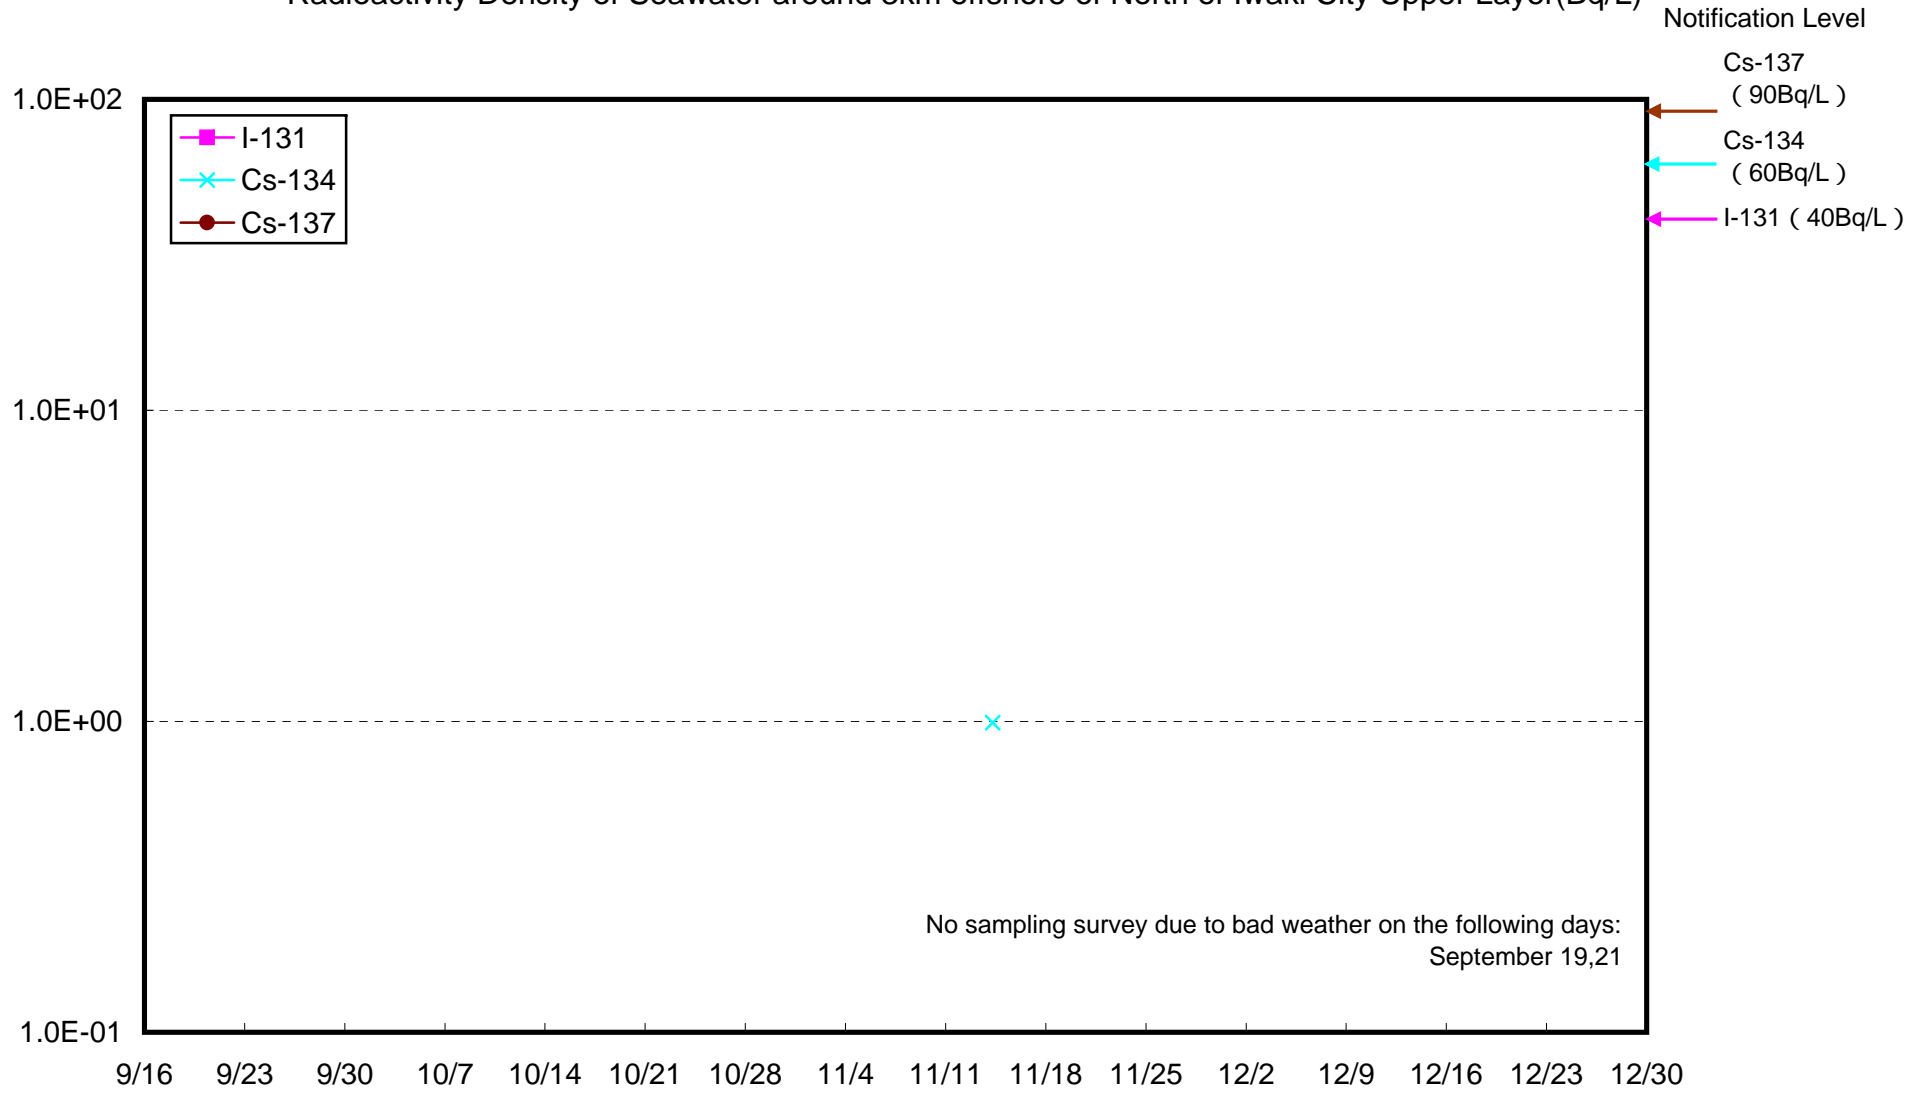

Radioactivity Density of Seawater around 3km offshore of North of Iwaki City Lower Layer(Bq/L)

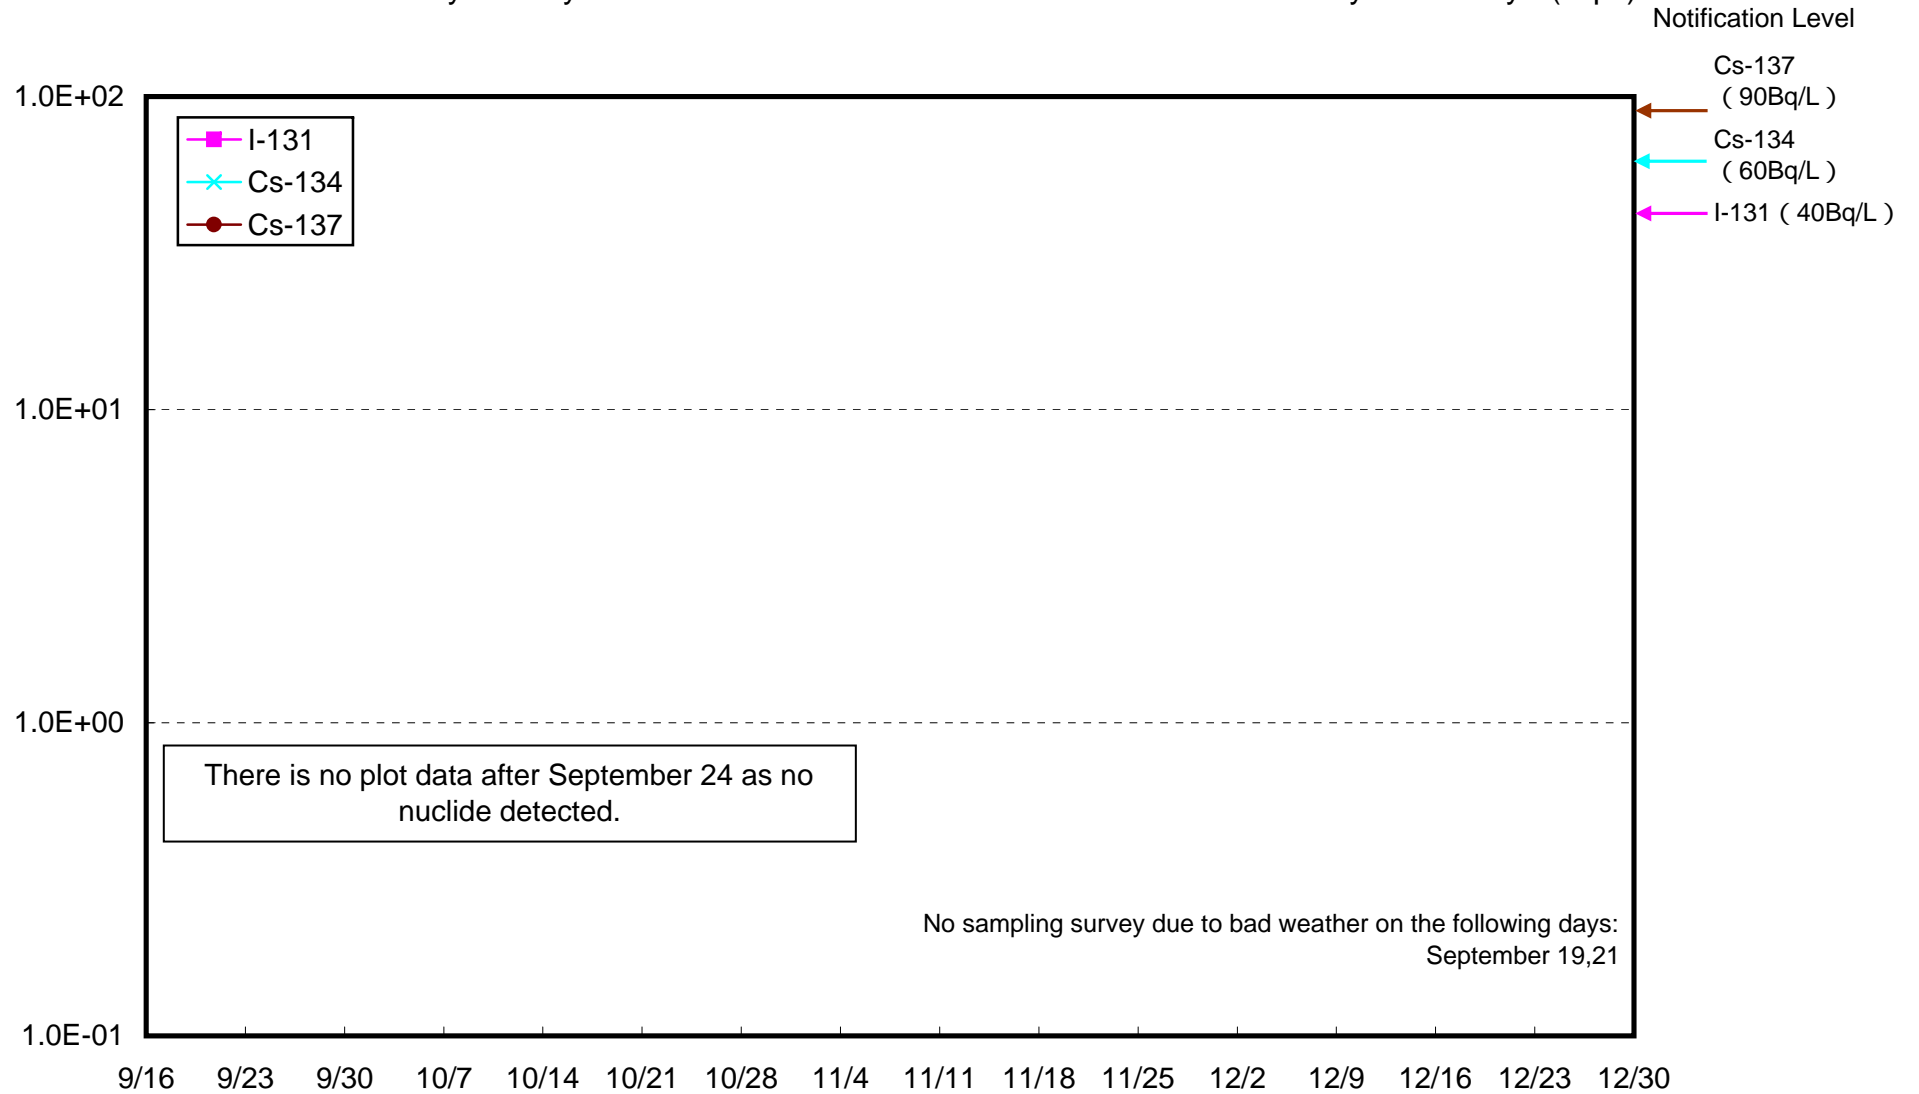

Radioactivity Density of Seawater around 3km offshore of Natsui River Upper Layer(Bq/L)

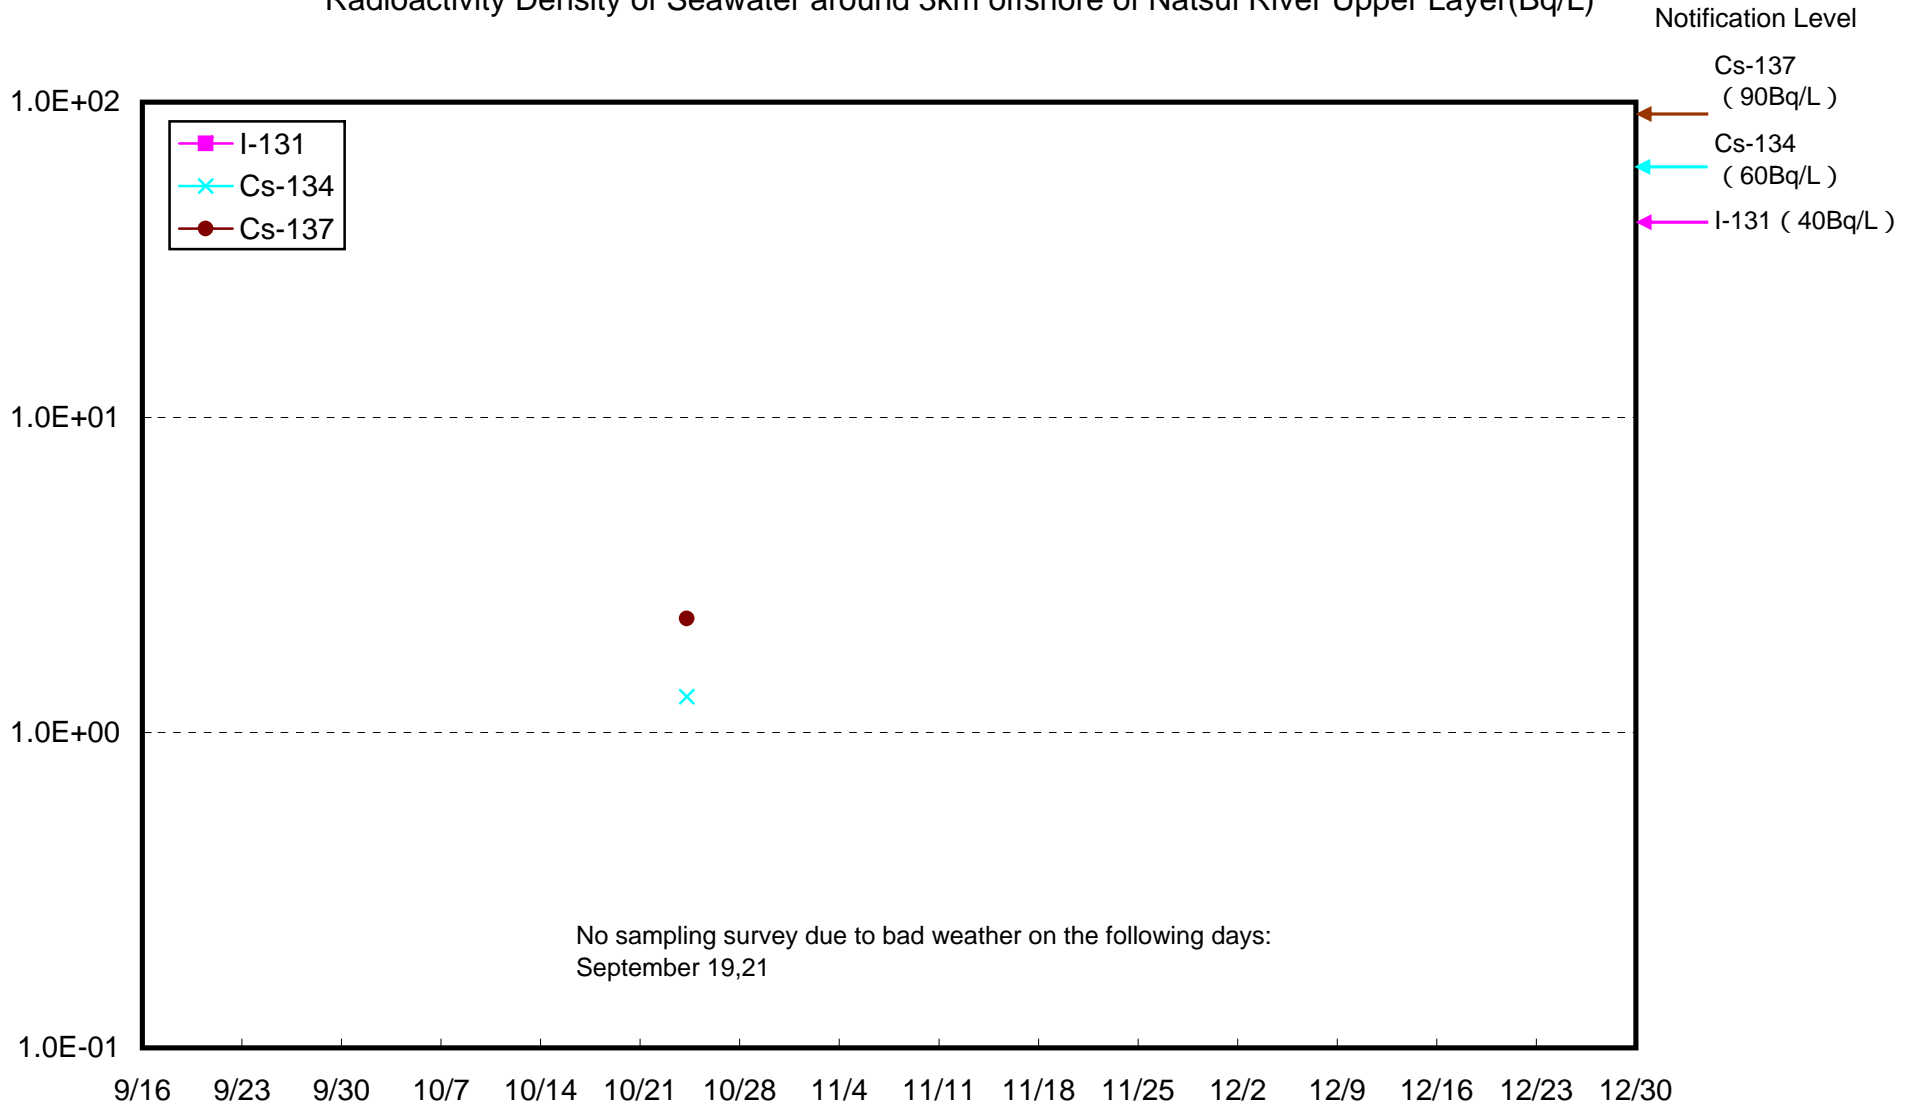


Radioactivity Density of Seawater around 3km offshore of Natsui River Lower Layer(Bq/L)

Notification Level


Cs-137
(90Bq/L)

Cs-134
(60Bq/L)


I-131 (40Bq/L)

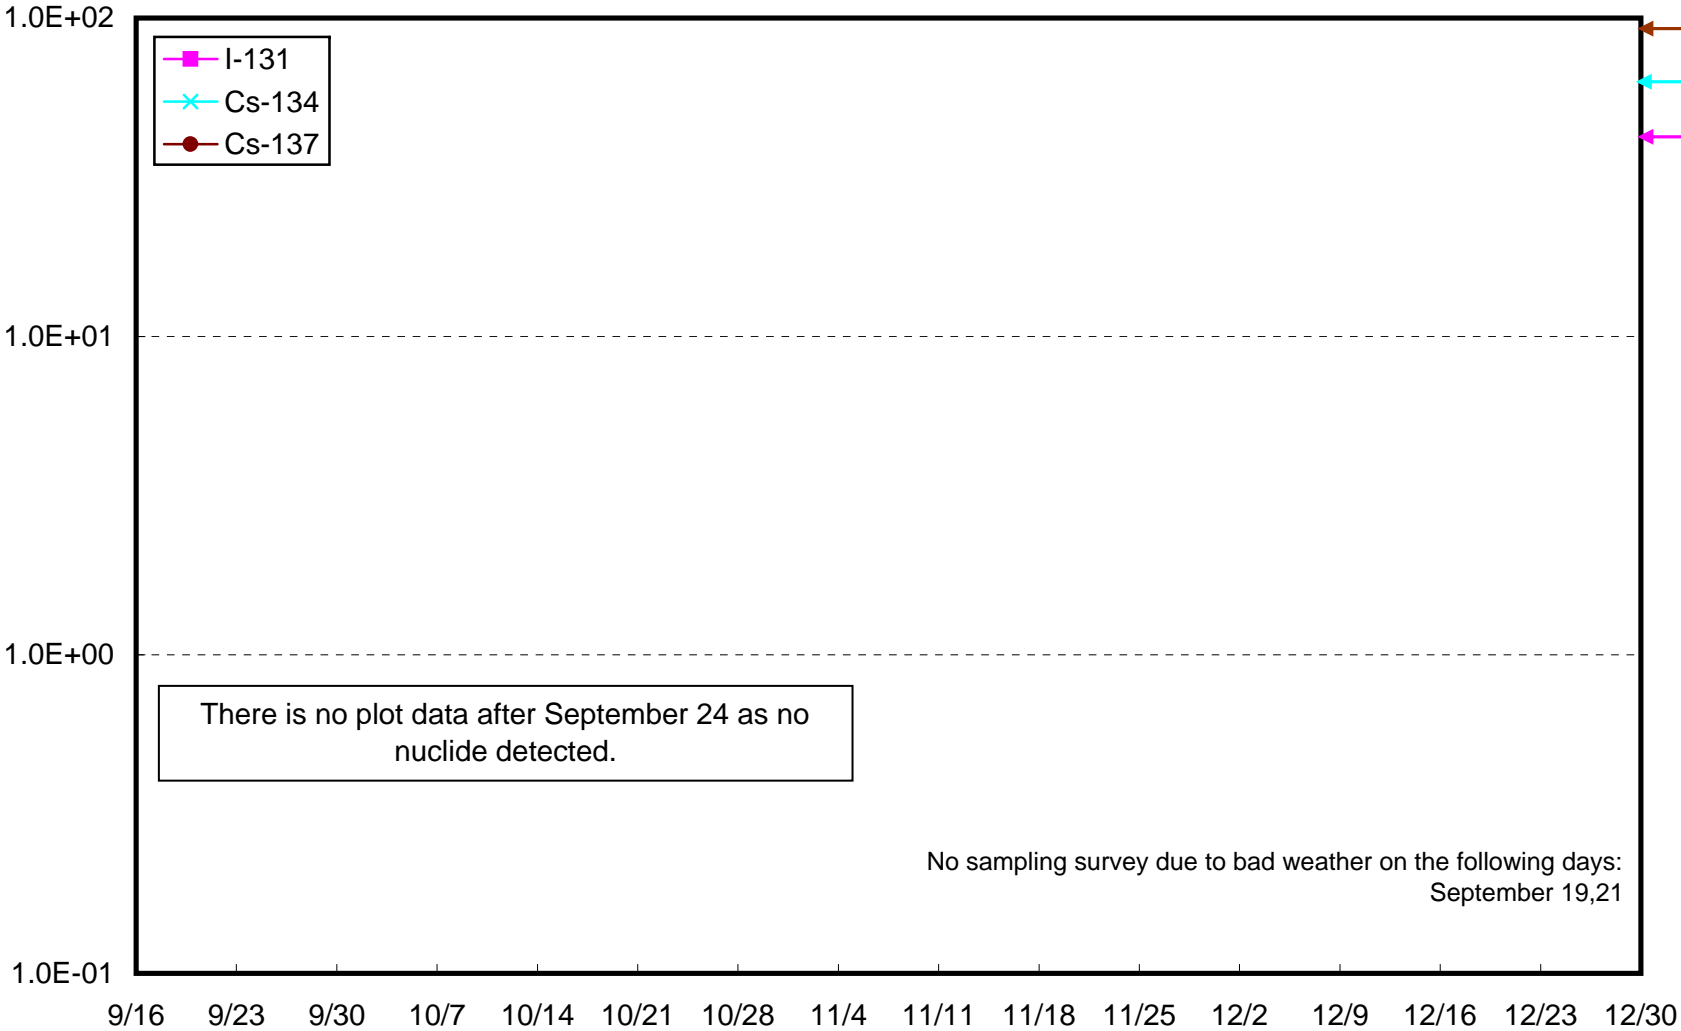


Radioactivity Density of Seawater around 3km offshore of Numanouchi Upper Layer(Bq/L)

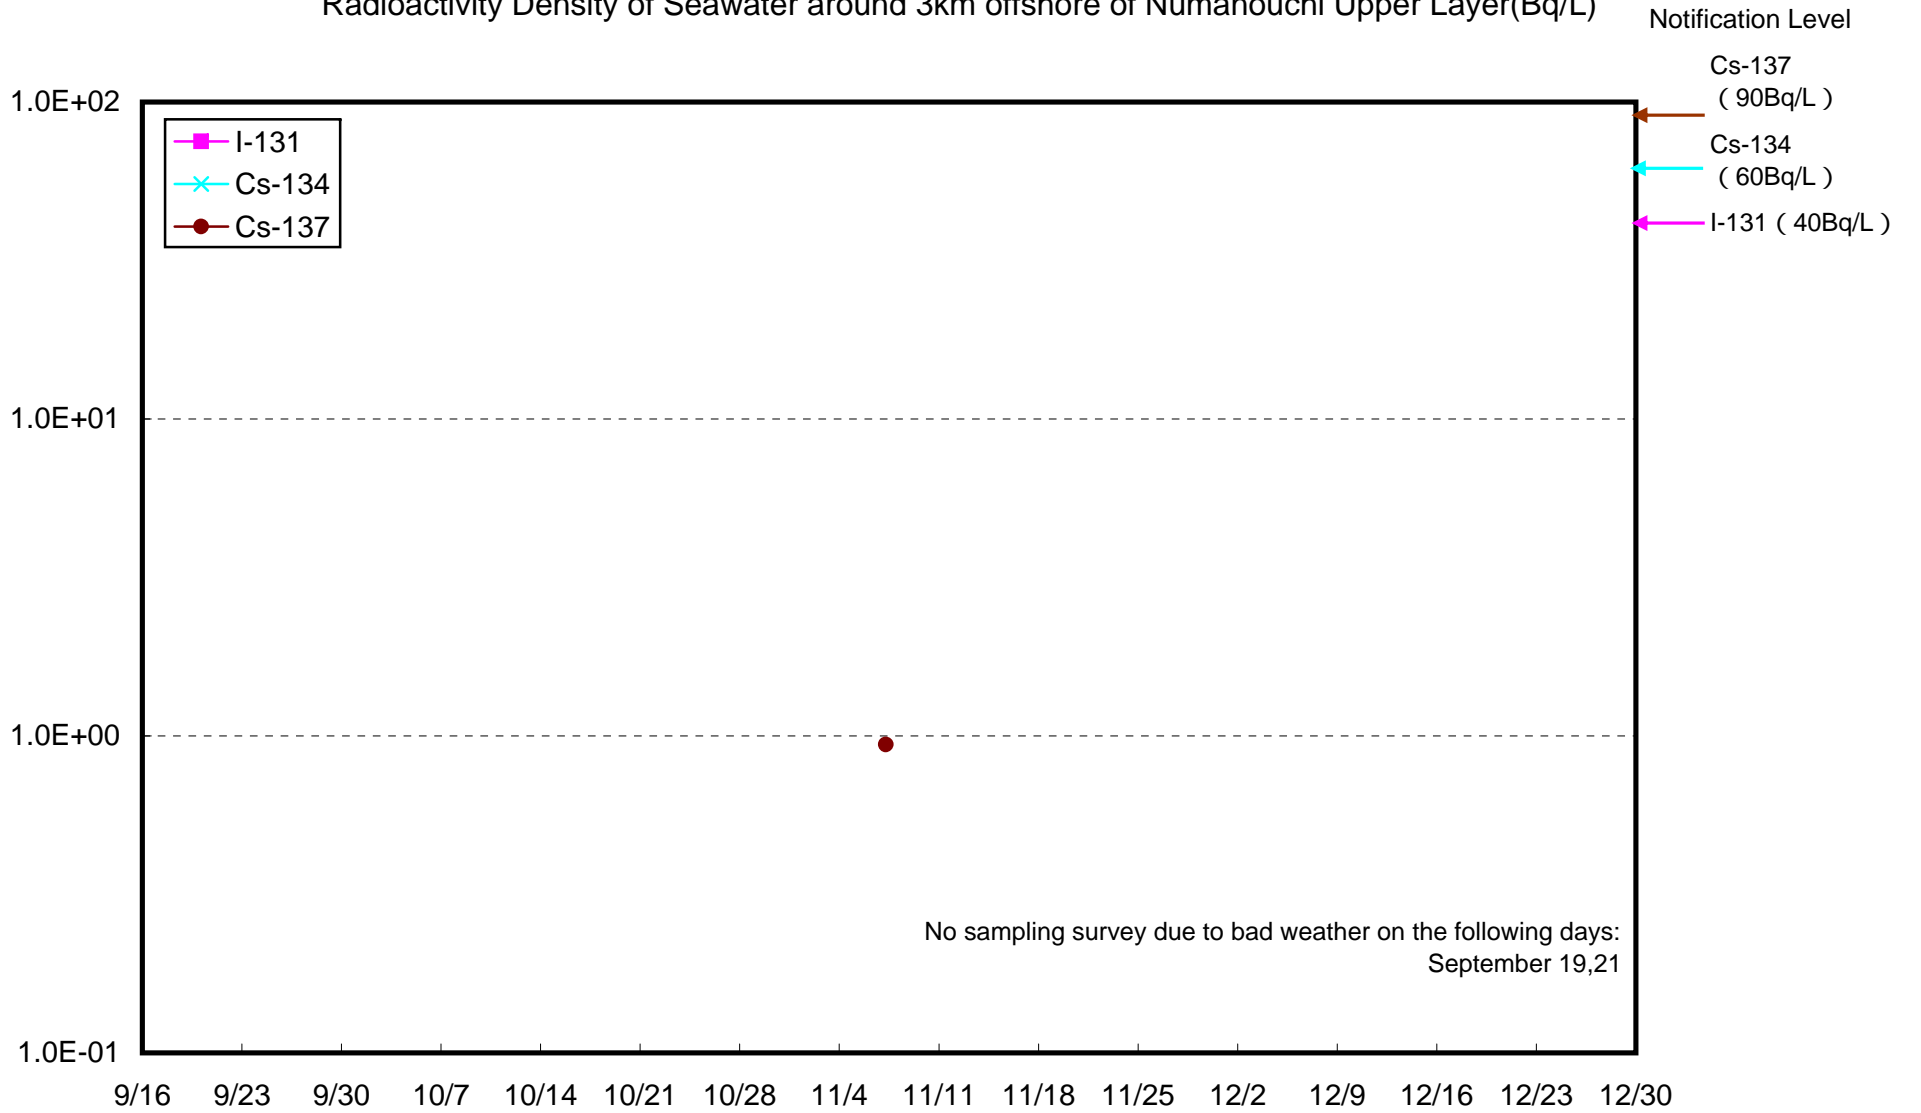

Radioactivity Density of Seawater around 3km offshore of Numanouchi Lower Layer(Bq/L)

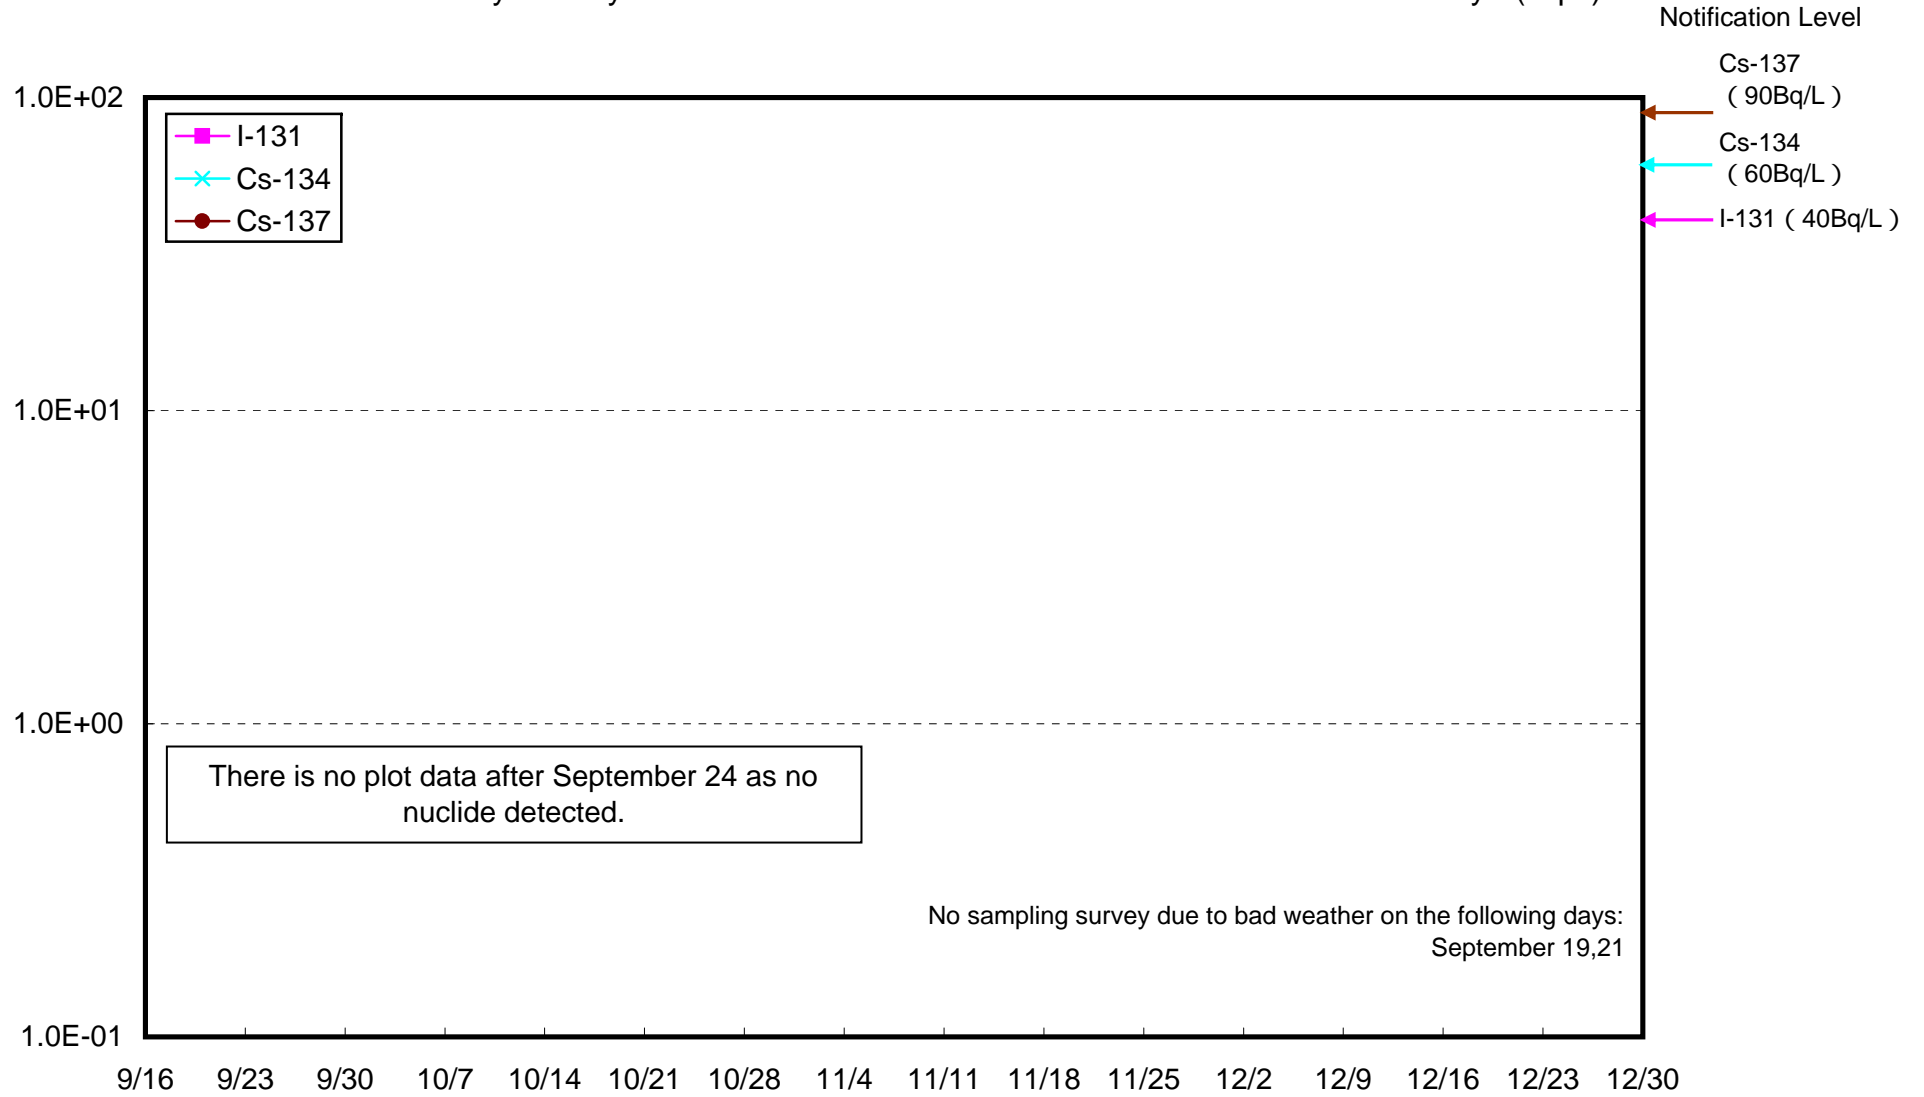

Radioactivity Density of Seawater around 3km offshore of Toyoma Upper Layer(Bq/L)

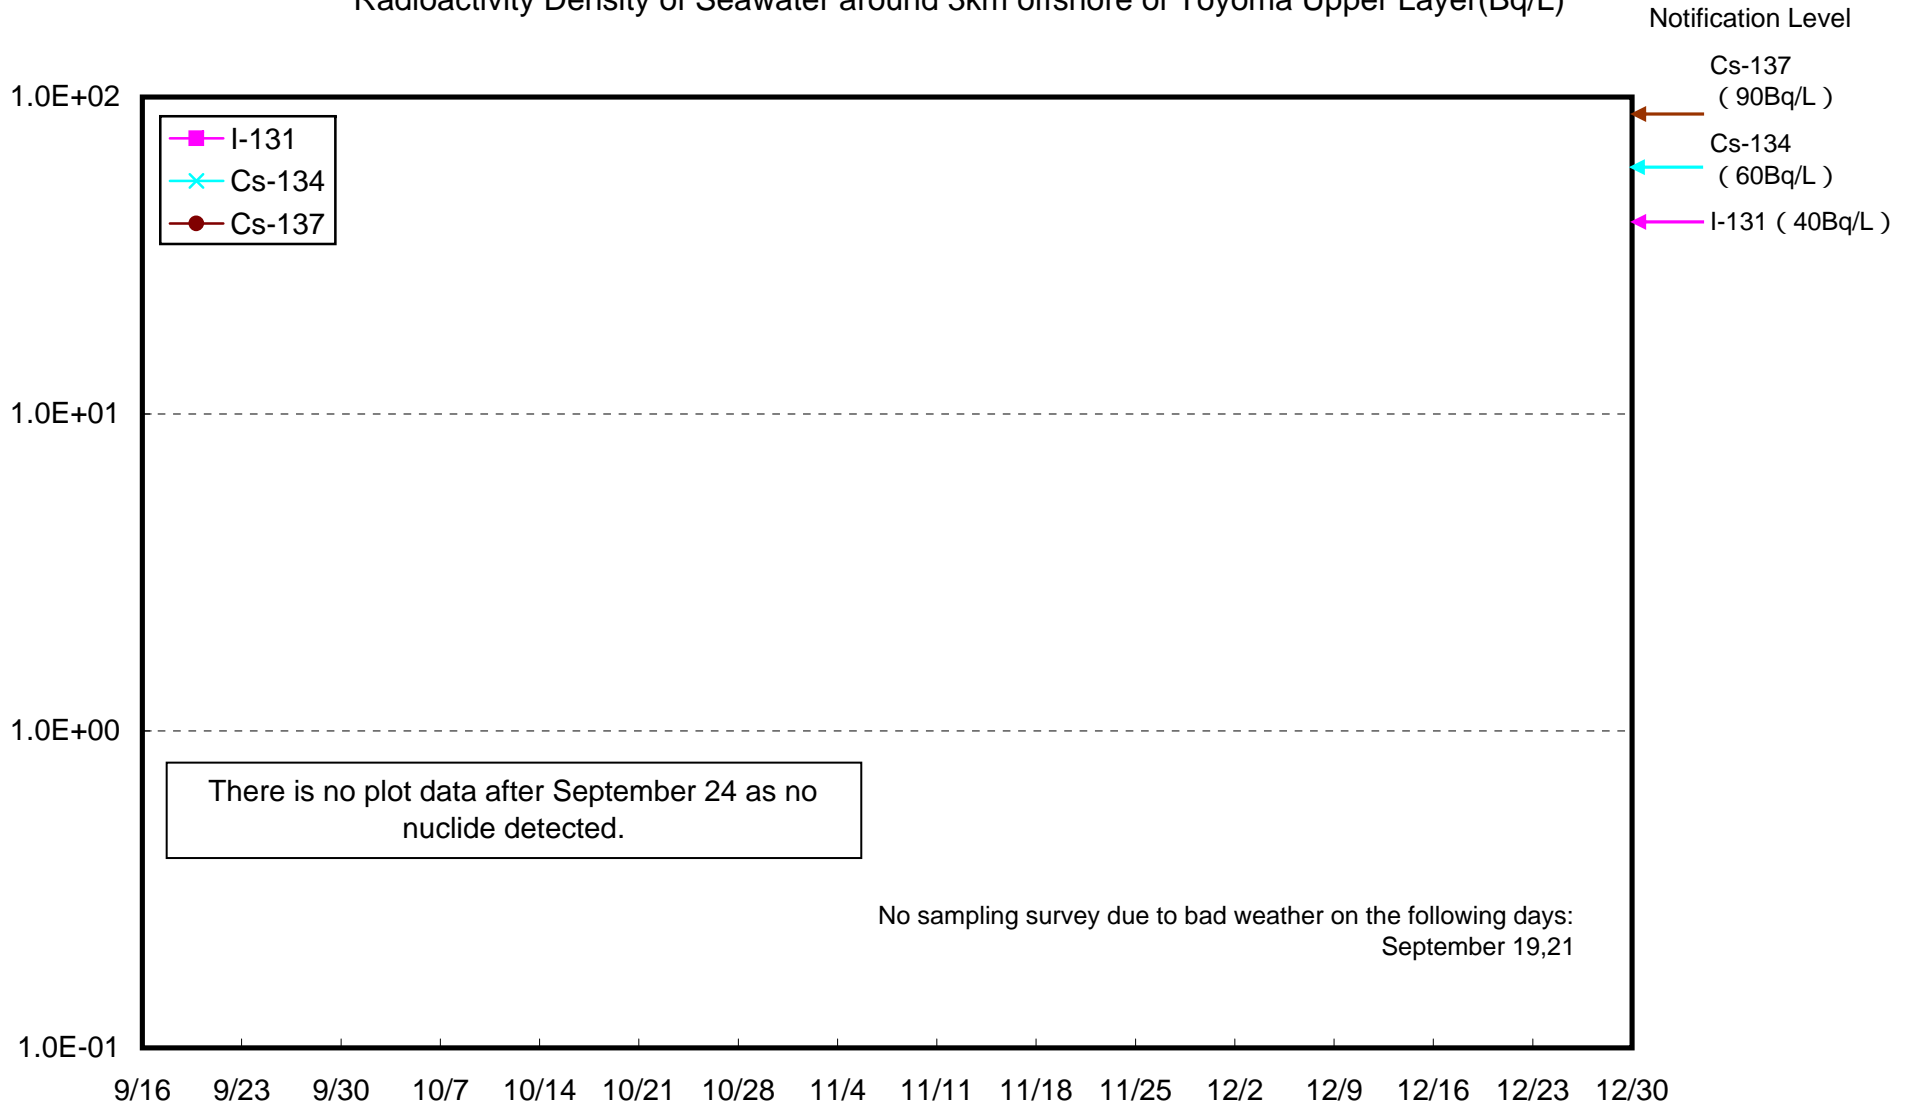

Radioactivity Density of Seawater around 3km offshore of Toyoma Lower Layer(Bq/L)

