

Nuclides Analysis Result of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations

(Data summarized on November 13)

| Place of Sampling | The West Gate of Fukushima Daiichi NPS | | MP-1 of Fukushima Daini NPS (Reference) | | | | ② Density Limit Specified by the Reactor Regulation (Bq/cm ³) (Density limit in the air which radiation workers breathe in is specified in section 4 of Appendix 2) |
|-------------------------------|--|----------------------|--|----------------------|--|----------------------|--|
| | ①Density of Sample (Bq/cm ³) | Scaling Factor (①/②) | ①Density of Sample (Bq/cm ³) | Scaling Factor (①/②) | | | |
| Time of Sampling | November 12, 2012 7:00 AM - 12:00 PM | | November 12, 2012 9:08 AM - 9:18 AM | | | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/cm ³) | Scaling Factor (①/②) | ①Density of Sample (Bq/cm ³) | Scaling Factor (①/②) | ①Density of Sample (Bq/cm ³) | Scaling Factor (①/②) | |
| I-131 (Approx. 8 days) | ND | - | ND | - | | | 1E-03 |
| Cs-134 (Approx. 2 years) | ND | - | ND | - | | | 2E-03 |
| Cs-137 (Approx. 30 years) | ND | - | ND | - | | | 3E-03 |

* The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE—O is the same as $O.O \times 10^0$


Data of other nuclides is under examination.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

The detection limits at the west gate of Fukushima Daiichi NPS are as follows: Volatile: I-131: Approx. 9E-8Bq/cm³, Cs-134: Approx.2E-7Bq/cm³, Cs-137: Approx.3E-7Bq/cm³ Particulate: I-131: Approx. 5E-8Bq/cm³, Cs-134: Approx.1E-7Bq/cm³, Cs-137: Approx.1E-7Bq/cm³ The detection limits at MP-1 of Fukushima Daini MPS are as follows: Volatile: I-131: Approx. 1E-6Bq/cm³, Cs-134: Approx.2E-6Bq/cm³, Cs-137: Approx.2E-6Bq/cm³ Particulate: I-131: Approx. 9E-7Bq/cm³, Cs-134: Approx.6E-7Bq/cm³, Cs-137: Approx.1E-6Bq/cm³

Dust Nuclides Analysis Result: The West Gate of Fukushima Daiichi Nuclear Power Station (Bq/cm³)

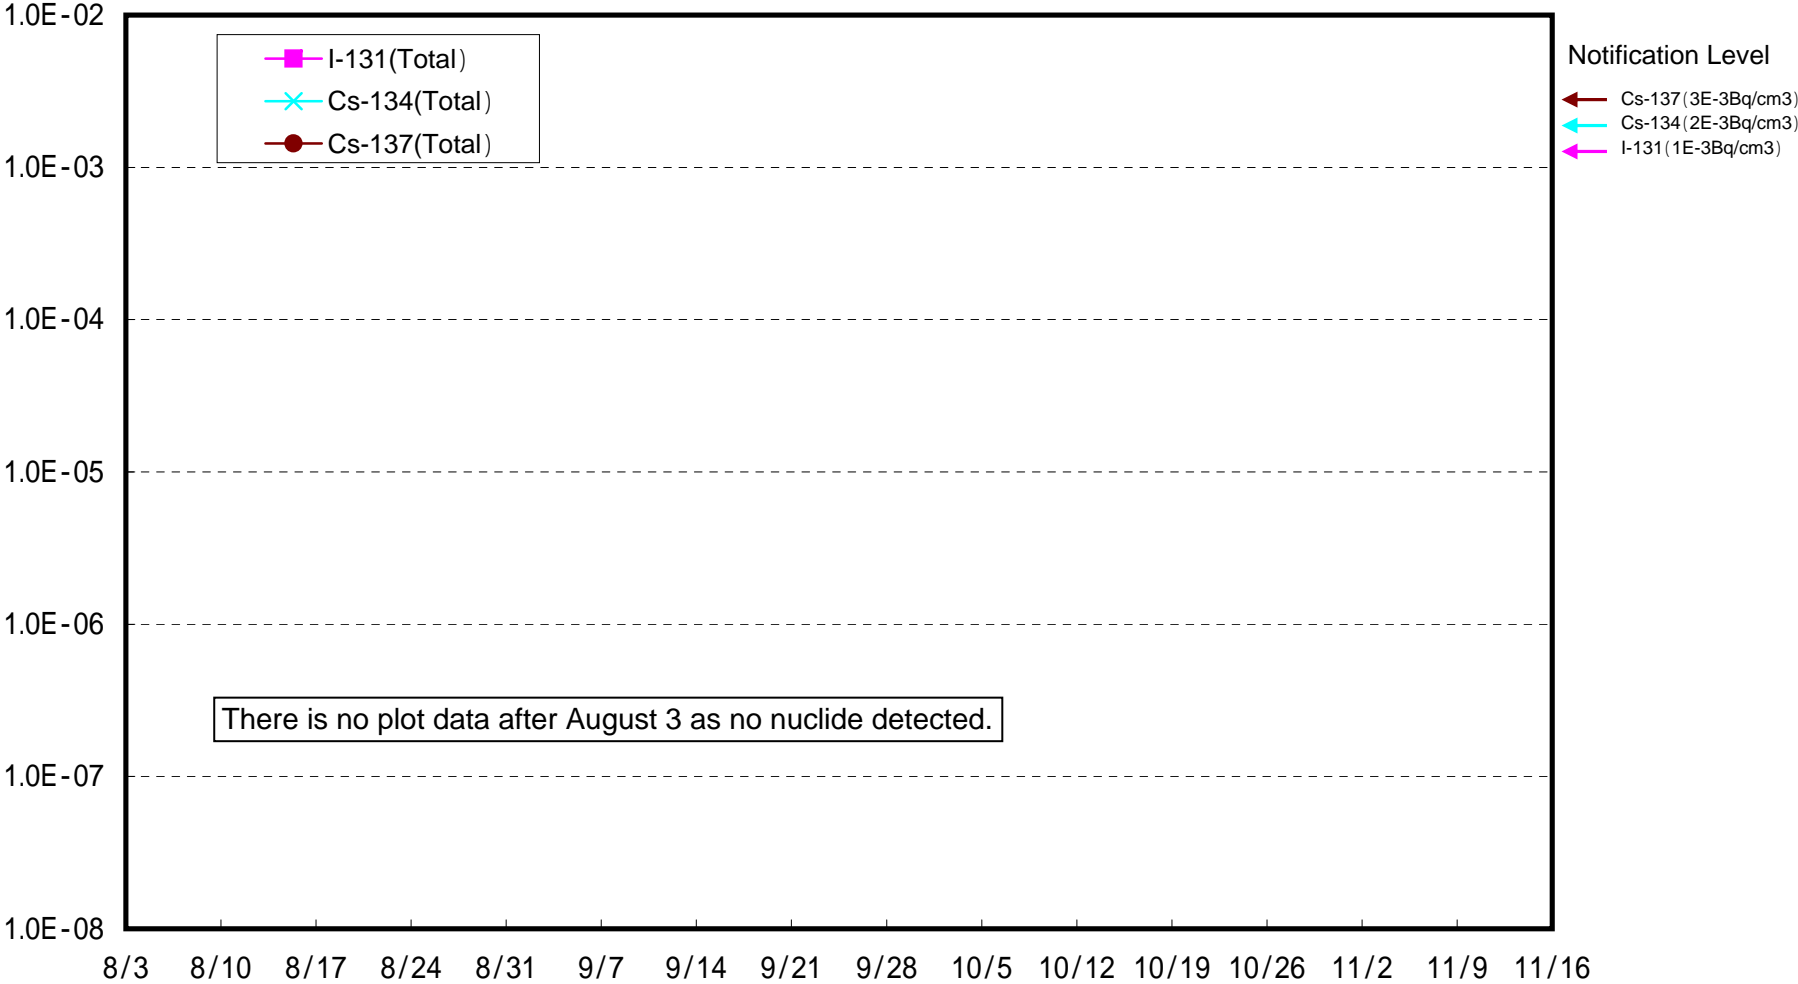

(Reference) Dust Nuclides Analysis Results of MP-1 at Fukushima Daini NPS (Bq/cm³)

