Nuclide Analysis Results of Radioactive Materials in Seawater < Coast>

Reference

(Data summarized on March 16)

Place of Sampling	North of Discha of 5-6u of (approx. 30m n discharge of	of 1F orth of 5-6u	Around South Channel (appox. 330m Discharge (of 1F south of 1-4u	Around North Channel (Around 3,4u Chanr (approx. 10 kr	of 2F I Discharge nel)	Around Iwasawa (appox. 7 km s Discharge ((appox. 16 kr	south of 1,2u Channel)	Density limit by the announcement of Reactor Regulation (Bq/L)	
Time of Sampling	Mar 15, 2012 09:05 am		Mar 15, 08:45		Mar 15, (Not sam		Mar 15, 2012 08:00 am		(the density limit in the water outside of	
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	surrounding monitored areas in the section 6 of the appendix 2)	
I-131 (about 8 days)	ND	-	ND	-	-	-	ND	-	40	
Cs-134 (about 2 years)	ND	-	ND	-	-	-	ND	-	60	
Cs-137 (about 30 years)	ND	-	ND	-	-	-	ND	-	90	

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

1 out of 4 samplings was cancelled due to bad weather.

^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

I-131: approx. 0.64Bq/L, Cs-134: approx. 0.89Bq/L, Cs-137: approx. 1.1Bq/L

Nuclide Analysis Results of Radioactive Materials in Seawater < Offshore>

Reference

(Data summarized on March 16)

Place of Sampling	15 km offsh Minami-So CityUpper	ouma	na Minami-Souma		15 km offshore of Ukedo-gawa Upper Layer		15 km offshore of Ukedo-gawa Lower Layer		15 km offshore of Fukushima Daiichi Upper Layer		15 km offshore of Fukushima Daiichi Lower Layer		Density limit by the announcement of Reactor Regulation
Time of Sampling	N/A		N/A		Mar 14, 2 09:00 a		Mar 14, 2 09:00 a		Mar 14, 2 08:25 a		Mar 14, 2012 08:25 am		(Bq/L) (the density limit in the water outside of
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	surrounding monitored areas in the section 6 of the appendix 2)
I-131 (about 8 days)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (about 2 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	60
Cs-137 (about 30 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	90

Place of Sampling	15 km offsh Fukushima Da Layer	aini Upper Fukushima Daini Lower		15 km offshore of Iwasawa Shore Upper Layer		15 km offshore of Iwasawa Shore Lower Layer		15 km offshore of Hirono-town Upper Layer		15 km offshore of Hirono-town Lower Layer		Density limit by the announcement of Reactor Regulation		
Time of Sampling	Mar 14, 2 07:45 a		Mar 14, 2 07:45 a		N/A		N/A		N/A		N/A		(Bq/L) (the density limit in the water outside of	
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	surrounding monitored areas in the section 6 of the appendix 2)	
I-131 (about 8 days)	ND	-	ND	-	-	-	-	-	-	-	-	-	40	
Cs-134 (about 2 years)	ND	-	ND	-	-	-	-	-	-	-	-	-	60	
Cs-137 (about 30 years)	ND	-	ND	-	-	-	-	-	-	-	-	-	90	

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

I-131: approx. 0.72Bq/L, Cs-134: approx. 0.98Bq/L, Cs-137: approx. 1.1Bq/L

Nuclide Analysis Results of Radioactive Materials in Seawater < offshore remeasured >

Reference

data collected on Mar 16 2012

Place of Sampling	15 km offshore of Fukushima	Daiichi Upper Layer	15 km offshore of Fukushim			
Time of Sampling	Mar 14, 20 08:25 an		Mar 14, 20 07:45 an	Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside		
Detected Nuclides (Half-life) Density of Sample (Bq/L)		Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	of surrounding monitored areas in the section 6 of the appendix 2)	
I-131 (about 8 days)	ND	-	ND	-	40	
Cs-134 (about 2 years)	ND	-	ND	-	60	
Cs-137 (about 30 years)	ND	-	ND	-	90	
Mn-54 (approx.310days)	ND	-	ND	-	1,000	
Co-60 (approx.5yrs)	ND	-	ND	-	200	
Ce-144 (approx. 280days)	ND	-	ND	-	200	

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.


^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.


^{* &}quot;ND" means the sampled data is below measurable limit.

I-131: approx. 0.15Bq/L, Cs-134: approx. 0.30Bq/L, Cs-137: approx. 0.33Bq/L, Mn-54 approx. 0.11Bq/L, Co-60 approx. 0.19Bq/L, Ce-144 approx. 1.0Bq/L Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.


Radioactivity Density of Seawater (Bq/L)

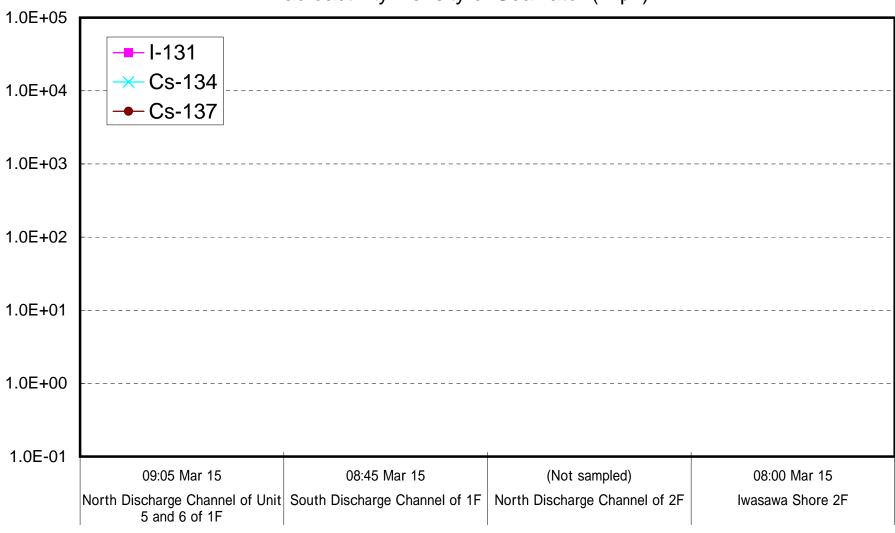

Radioactivity Density of Seawater at North of 1F5-6 Discharge Channel (Bq/L)

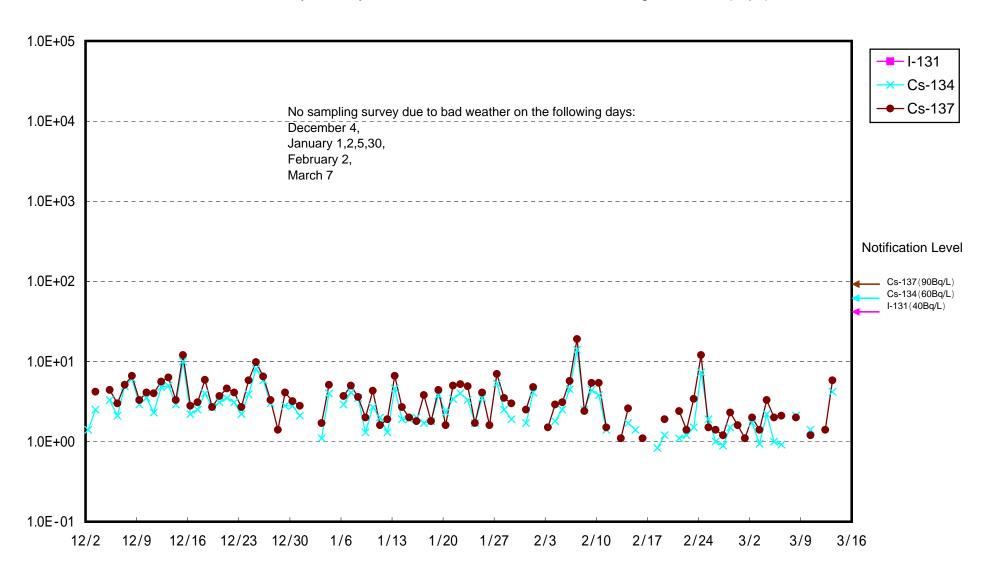

Radioactivity Density of Seawater at South Discharge Channel of 1F (Bq/L)

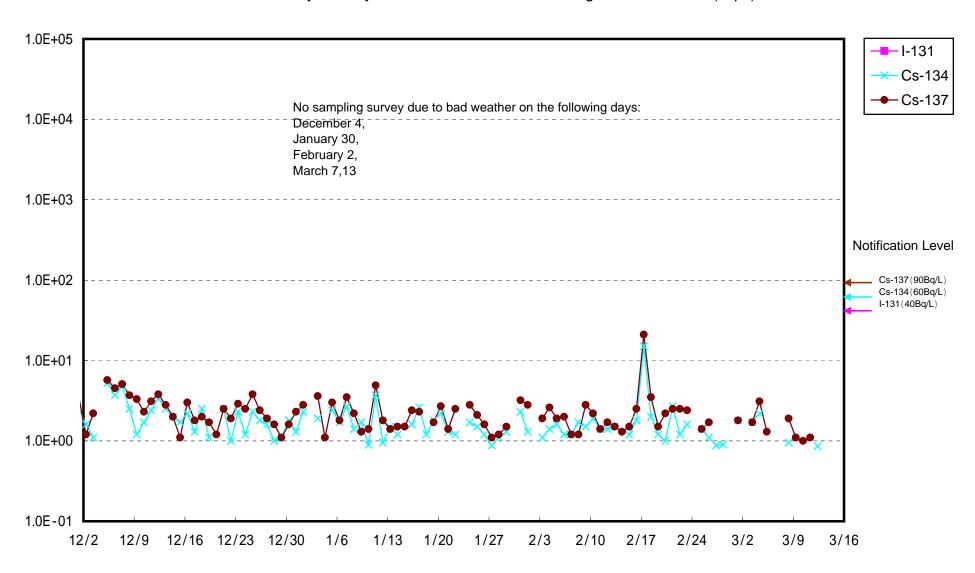

Radioactivity Density of Seawater at Iwasawa Shore 2F (Bq/L)

