

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on July 26)

Place of Sampling	North of Unit 5-6 Discharge Channel at 1F (Approx. 30m North of Unit 5-6 Discharge Channel)		Around 1F South Discharge Channel of 1F (Approx. 330m South of Unit 1-4 Discharge Channel)		Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling Jul 25, 2012 7:25 AM		Time of Sampling Jul 25, 2012 7:10 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	ND	-	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.48Bq/L, Cs-134: Approx.1.2Bq/L, Cs-137: Approx.1.6Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Offshore 1/3 >

(Data summarized on July 26)

Place of Sampling (Place No.)	*1 3km Offshore of Odaka Ward (T-14)				*2 3km Offshore of Ukedo River (T-D1)				*2 3km Offshore of Fukushima Daiichi NPS (T-D5)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jun 19, 2012 9:05 AM		Jun 19, 2012 9:05 AM		Jun 25, 2012 8:35 AM		Jun 25, 2012 8:35 AM		Jun 25, 2012 9:00 AM		Jun 25, 2012 9:00 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.079	0.00	0.043	0.00	0.050	0.00	0.11	0.00	0.049	0.00	0.020	0.00	60
Cs-137 (Approx. 30 years)	0.12	0.00	0.063	0.00	0.086	0.00	0.17	0.00	0.077	0.00	0.036	0.00	90

Place of Sampling (Place No.)	*2 3km Offshore of Fukushima Daini NPS (T-D9)				*1 15km Offshore of Fukushima Daiichi NPS (T-5)				*1 3km Offshore of Iwasawa Shore (T-11)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jun 25, 2012 8:20 AM		Jun 25, 2012 8:20 AM		Jun 19, 2012 10:00 AM		Jun 19, 2012 10:00 AM		Jun 19, 2012 7:00 AM		Jun 19, 2012 7:00 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.051	0.00	0.074	0.00	0.013	0.00	0.015	0.00	0.097	0.00	0.055	0.00	60
Cs-137 (Approx. 30 years)	0.075	0.00	0.10	0.00	0.018	0.00	0.023	0.00	0.14	0.00	0.081	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analyzed by: *1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD. *2 Tokyo Electric Power Environmental Engineering Co., Inc.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Offshore 2/3 >

(Data summarized on July 26)

Place of Sampling (Place No.)	15km Offshore of Iwasawa Shore (T-7)				3km Offshore of Onahama Port (T-18)				Around 3km Offshore of Ukedo River (T-S3)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jun 18, 2012 8:00 AM		Jun 18, 2012 8:00 AM		Jun 18, 2012 5:20 AM		Jun 18, 2012 5:20 AM		Jun 26, 2012 6:21 AM		Jun 26, 2012 6:21 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.012	0.00	0.0087	0.00	0.045	0.00	0.018	0.00	0.046	0.00	0.066	0.00	60
Cs-137 (Approx. 30 years)	0.017	0.00	0.013	0.00	0.064	0.00	0.025	0.00	0.071	0.00	0.093	0.00	90

Place of Sampling (Place No.)	Around 2km Offshore of Kido River (T-S5)				Around 2km Offshore of 2F (T-S7)				Around 15km Offshore of Odaka Ward (T-B1)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jun 15, 2012 6:20 AM		Jun 15, 2012 6:20 AM		Jun 24, 2012 6:37 AM		Jun 24, 2012 6:37 AM		Jun 14, 2012 9:40 AM		Jun 14, 2012 9:40 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.14	0.00	0.067	0.00	0.17	0.00	0.13	0.00	0.0086	0.00	0.012	0.00	60
Cs-137 (Approx. 30 years)	0.19	0.00	0.097	0.00	0.24	0.00	0.18	0.00	0.014	0.00	0.017	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analyzed by THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Offshore 3/3 >

(Data summarized on July 26)

Place of Sampling (Place No.)	Around 18km Offshore of Ukedo River (T-B2)												Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer										
Time of Sampling	Jun 14, 2012 10:20 AM		Jun 14, 2012 10:20 AM										
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.0094	0.00	0.011	0.00									60
Cs-137 (Approx. 30 years)	0.014	0.00	0.016	0.00									90


Place of Sampling (Place No.)													Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Time of Sampling													
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)													60
Cs-137 (Approx. 30 years)													90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.


* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analyzed by THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.


Radioactivity Density of the Seawater at the North of 1F Unit 5-6 Discharge Channel (Bq/L)

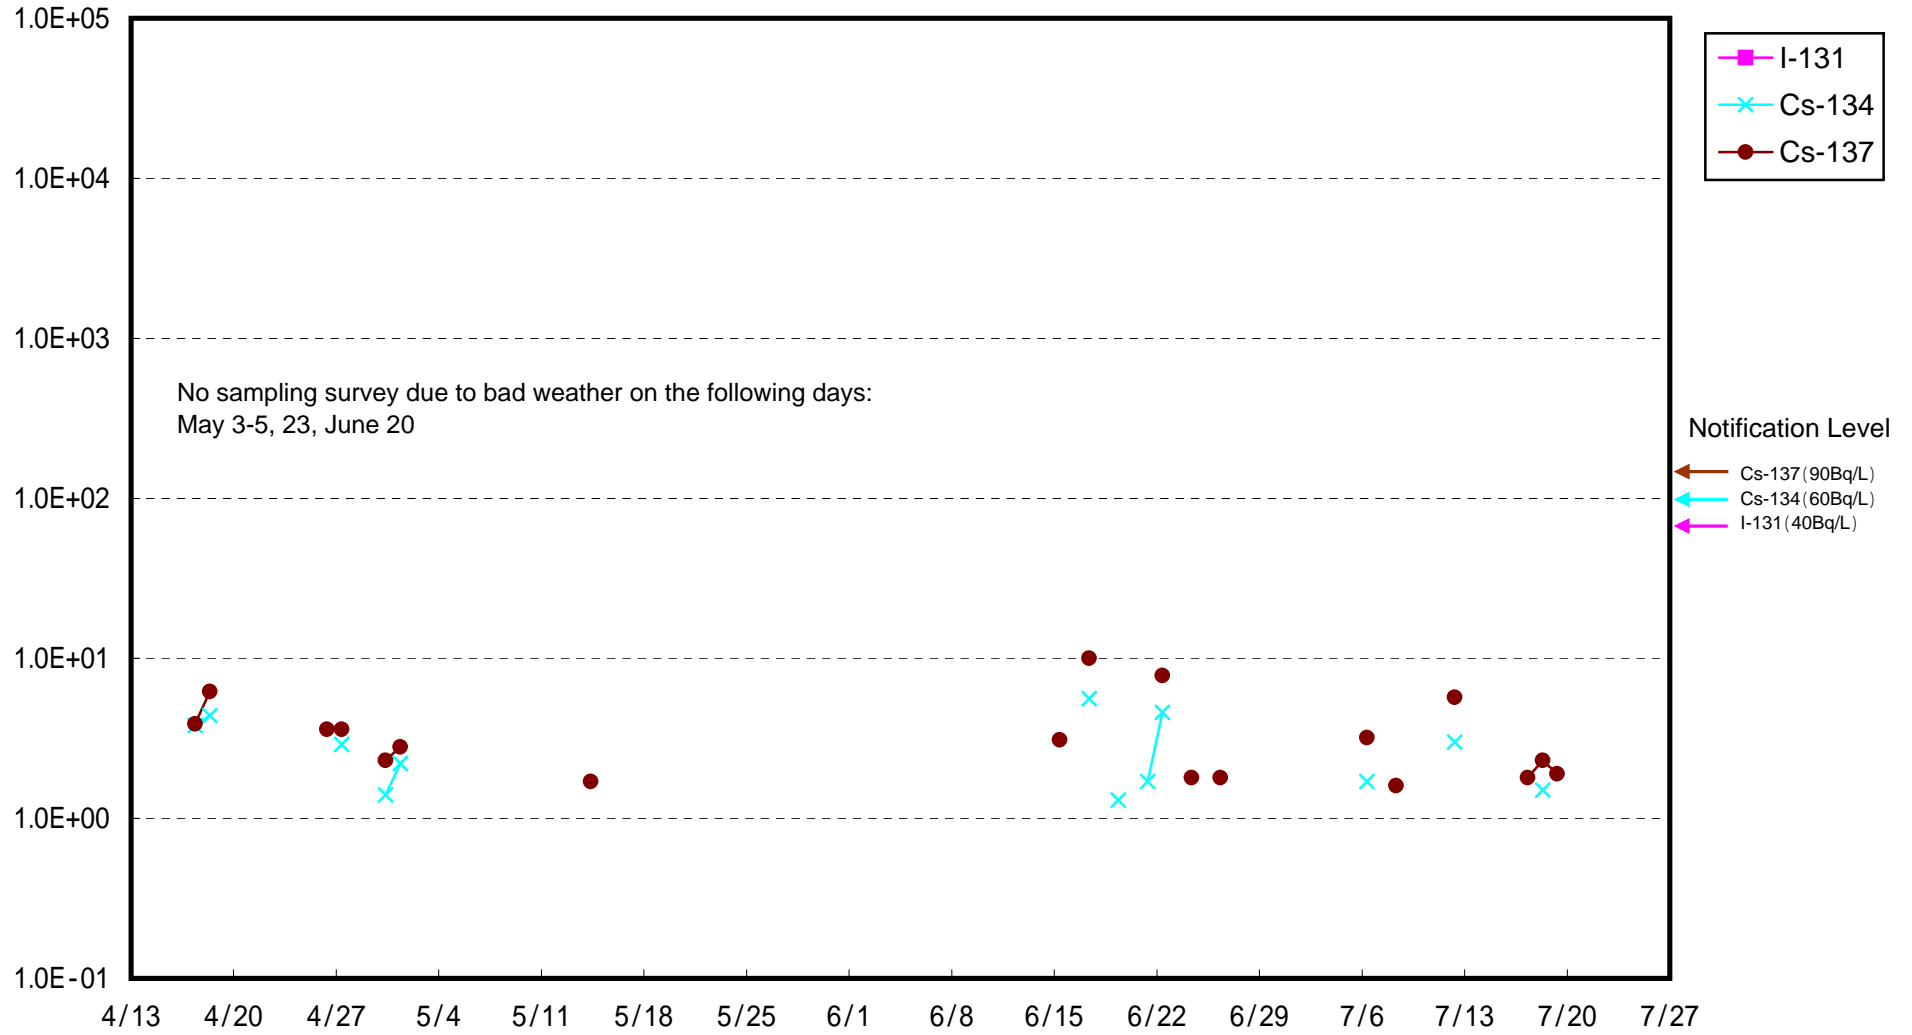


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

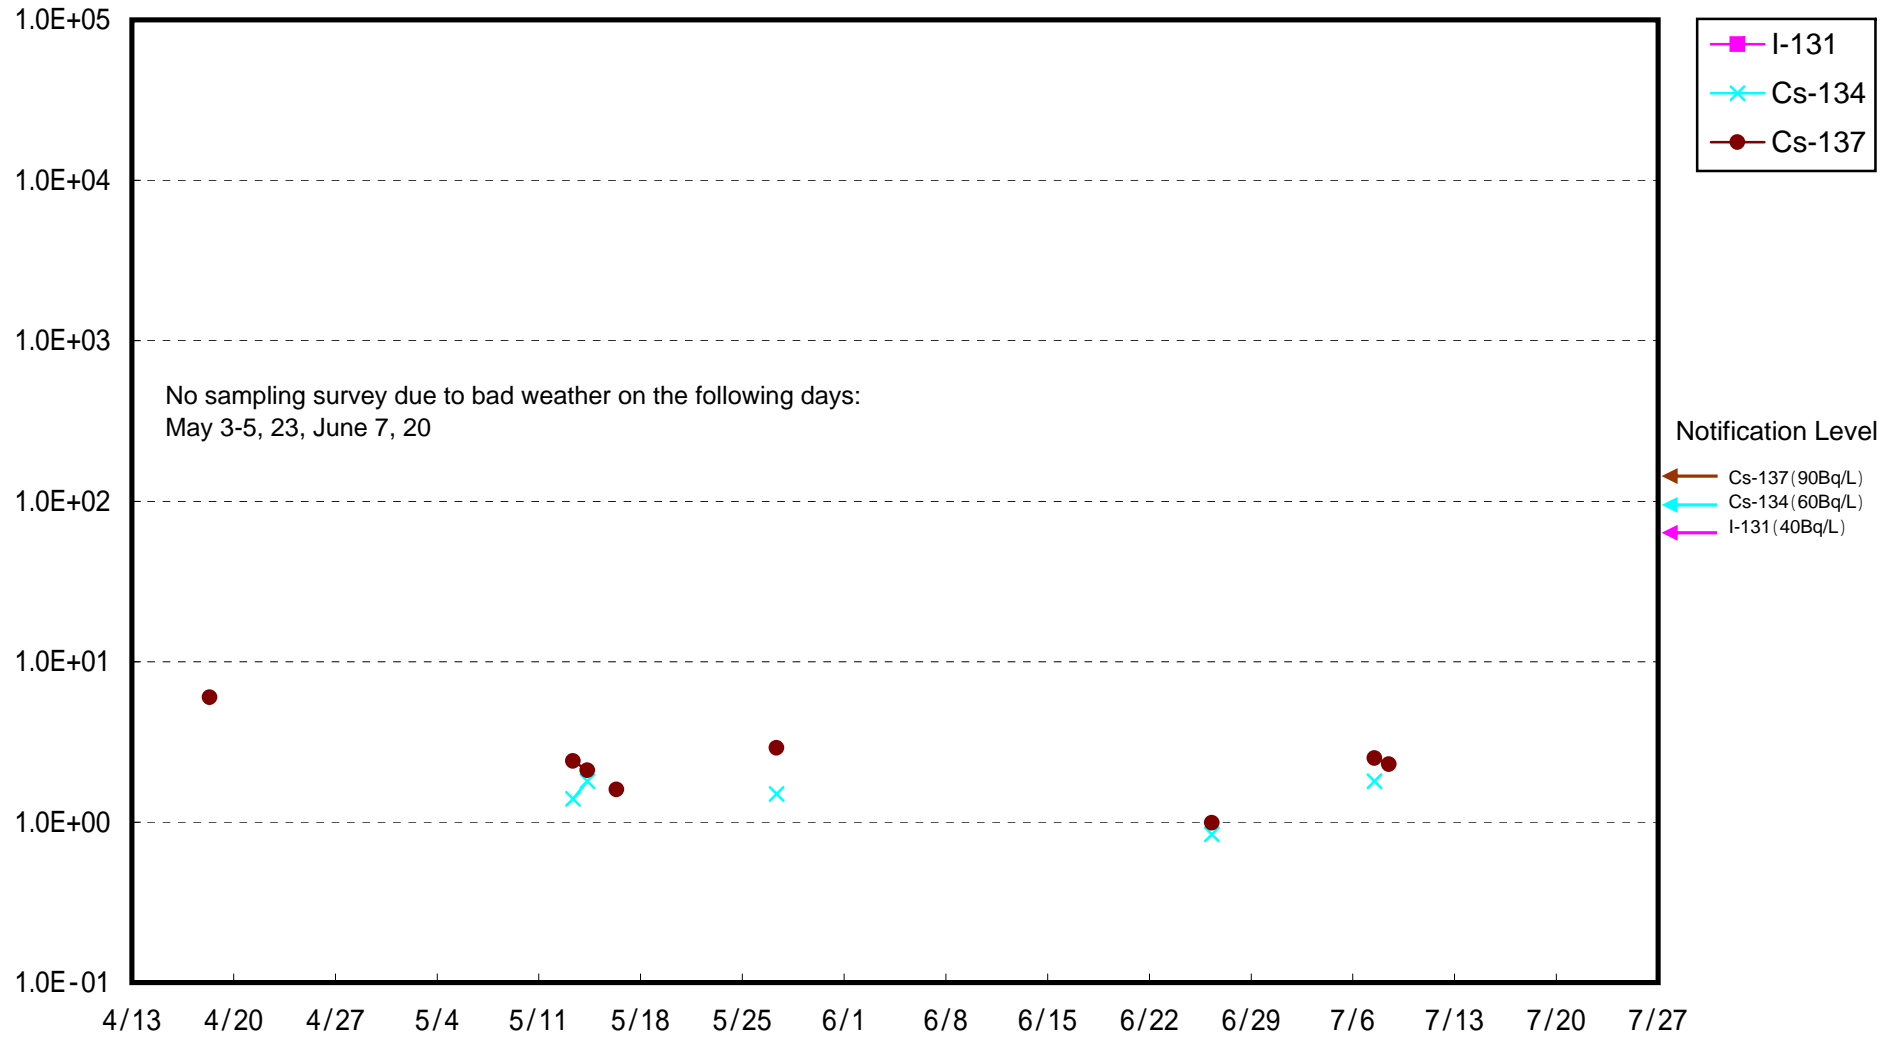


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Upper Layer (Bq/L)

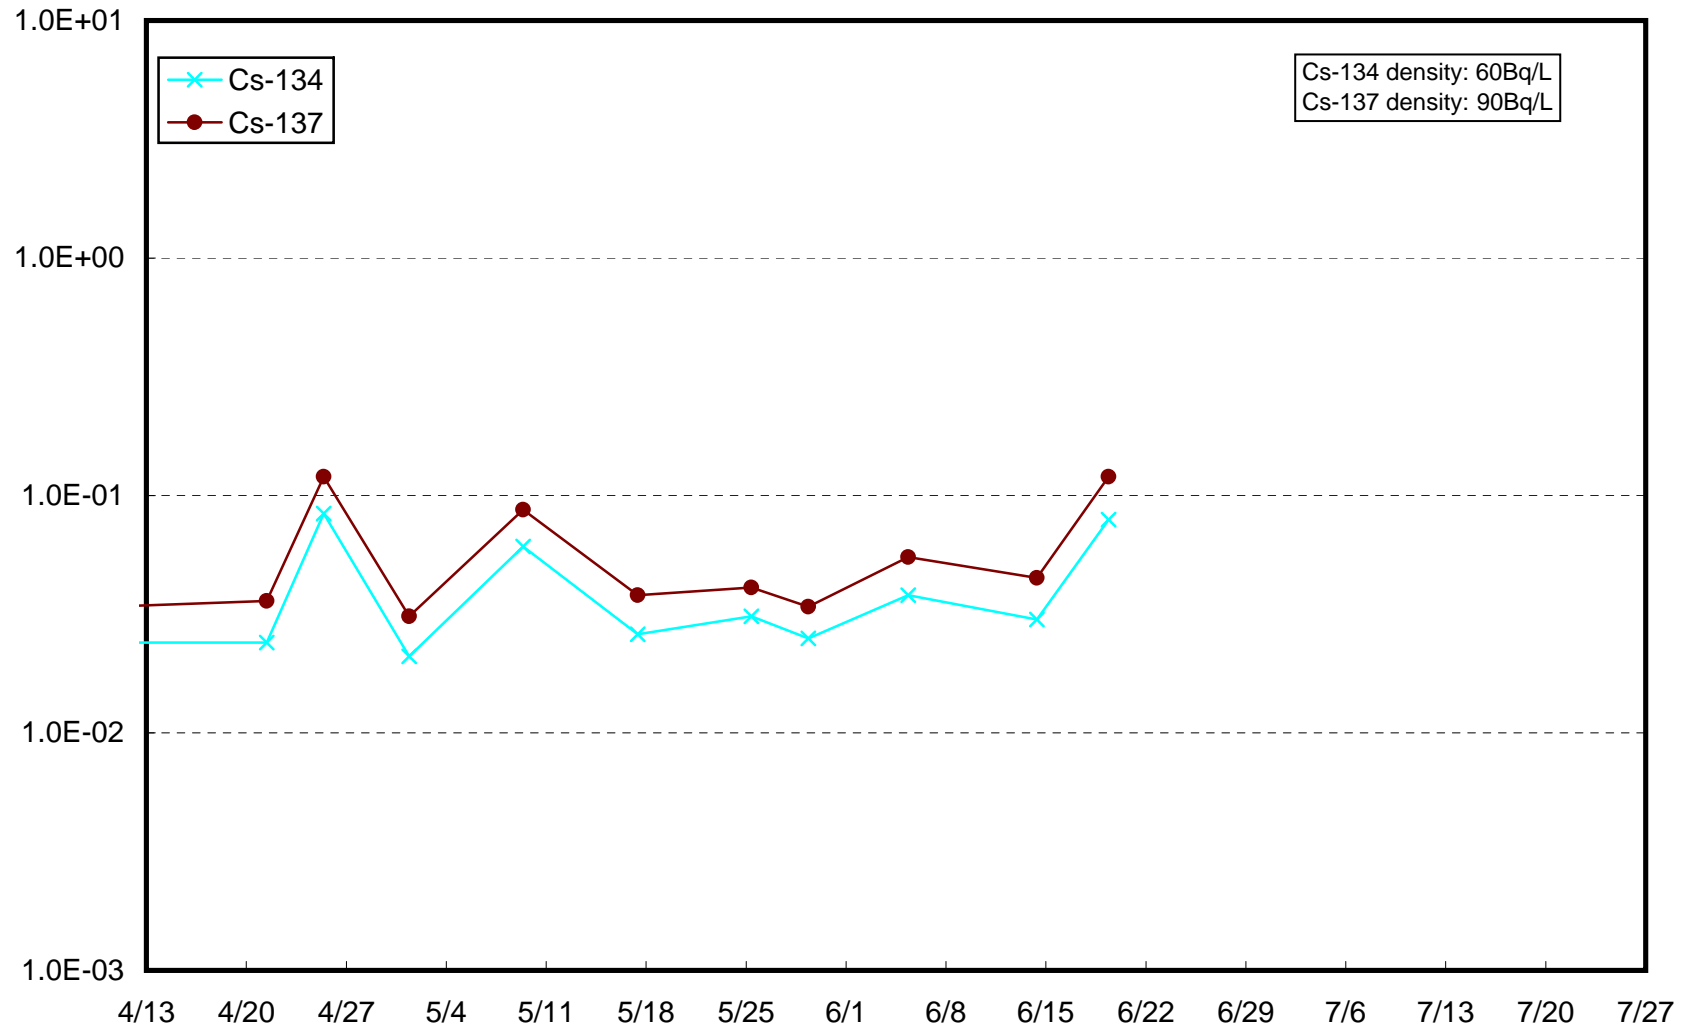


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Lower Layer (Bq/L)

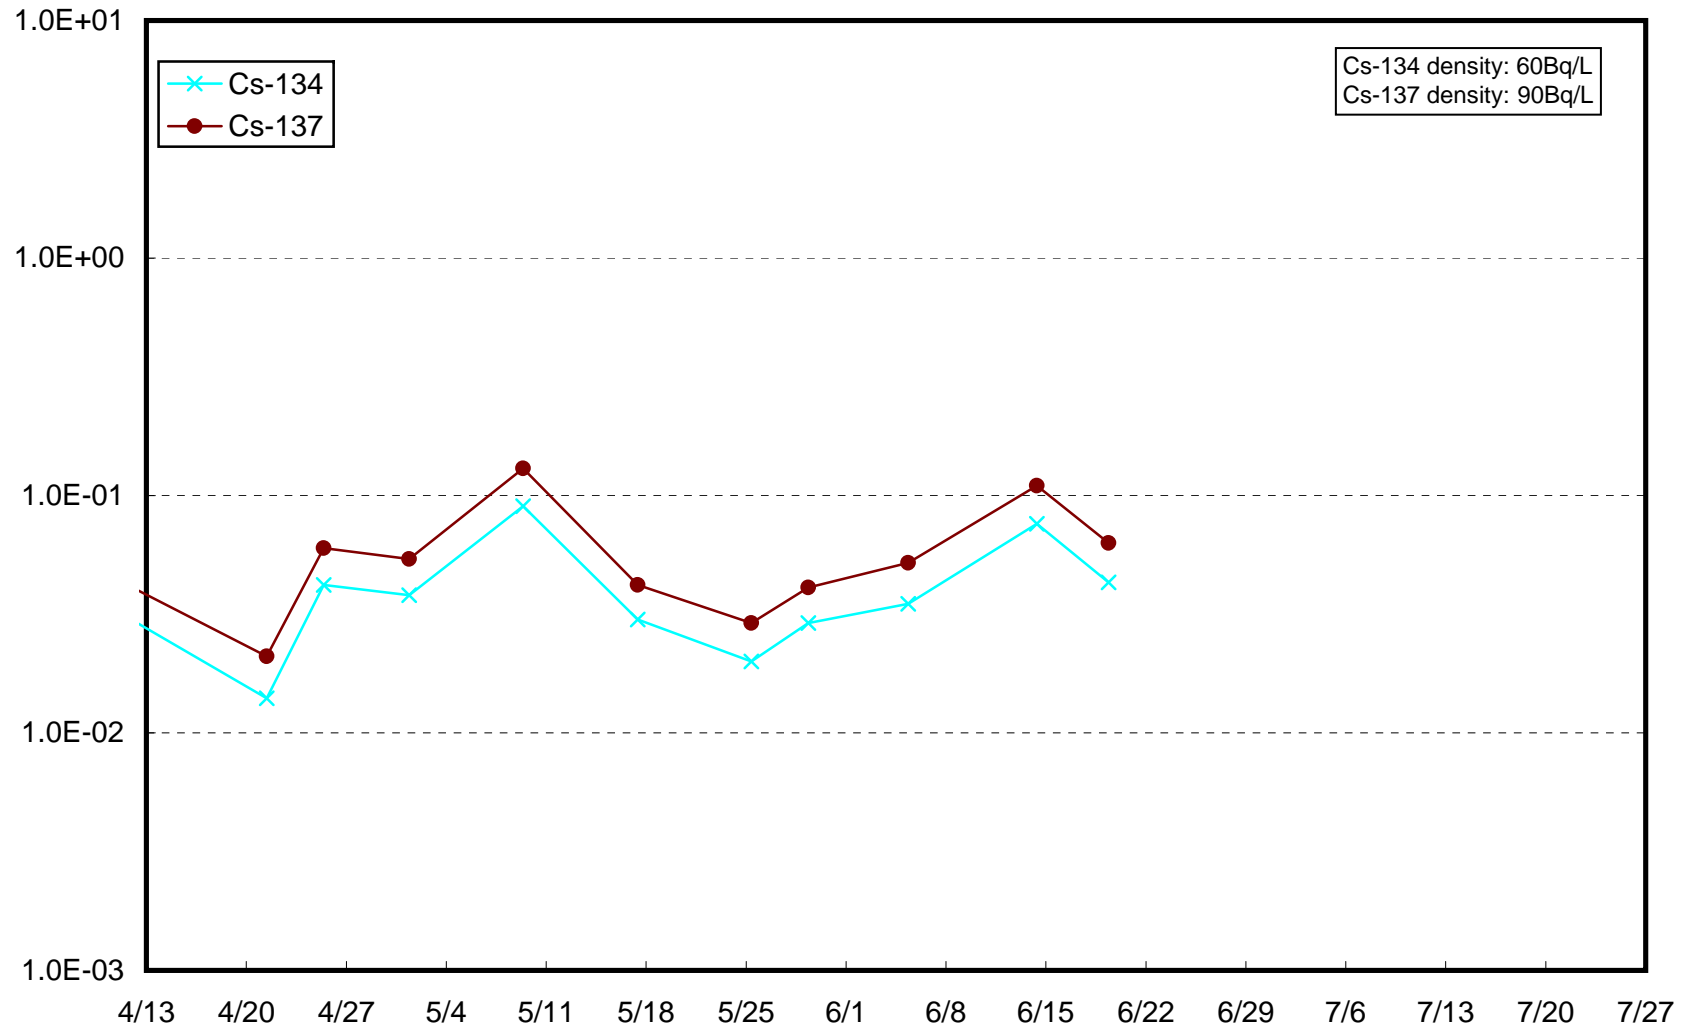


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Upper Layer (Bq/L)

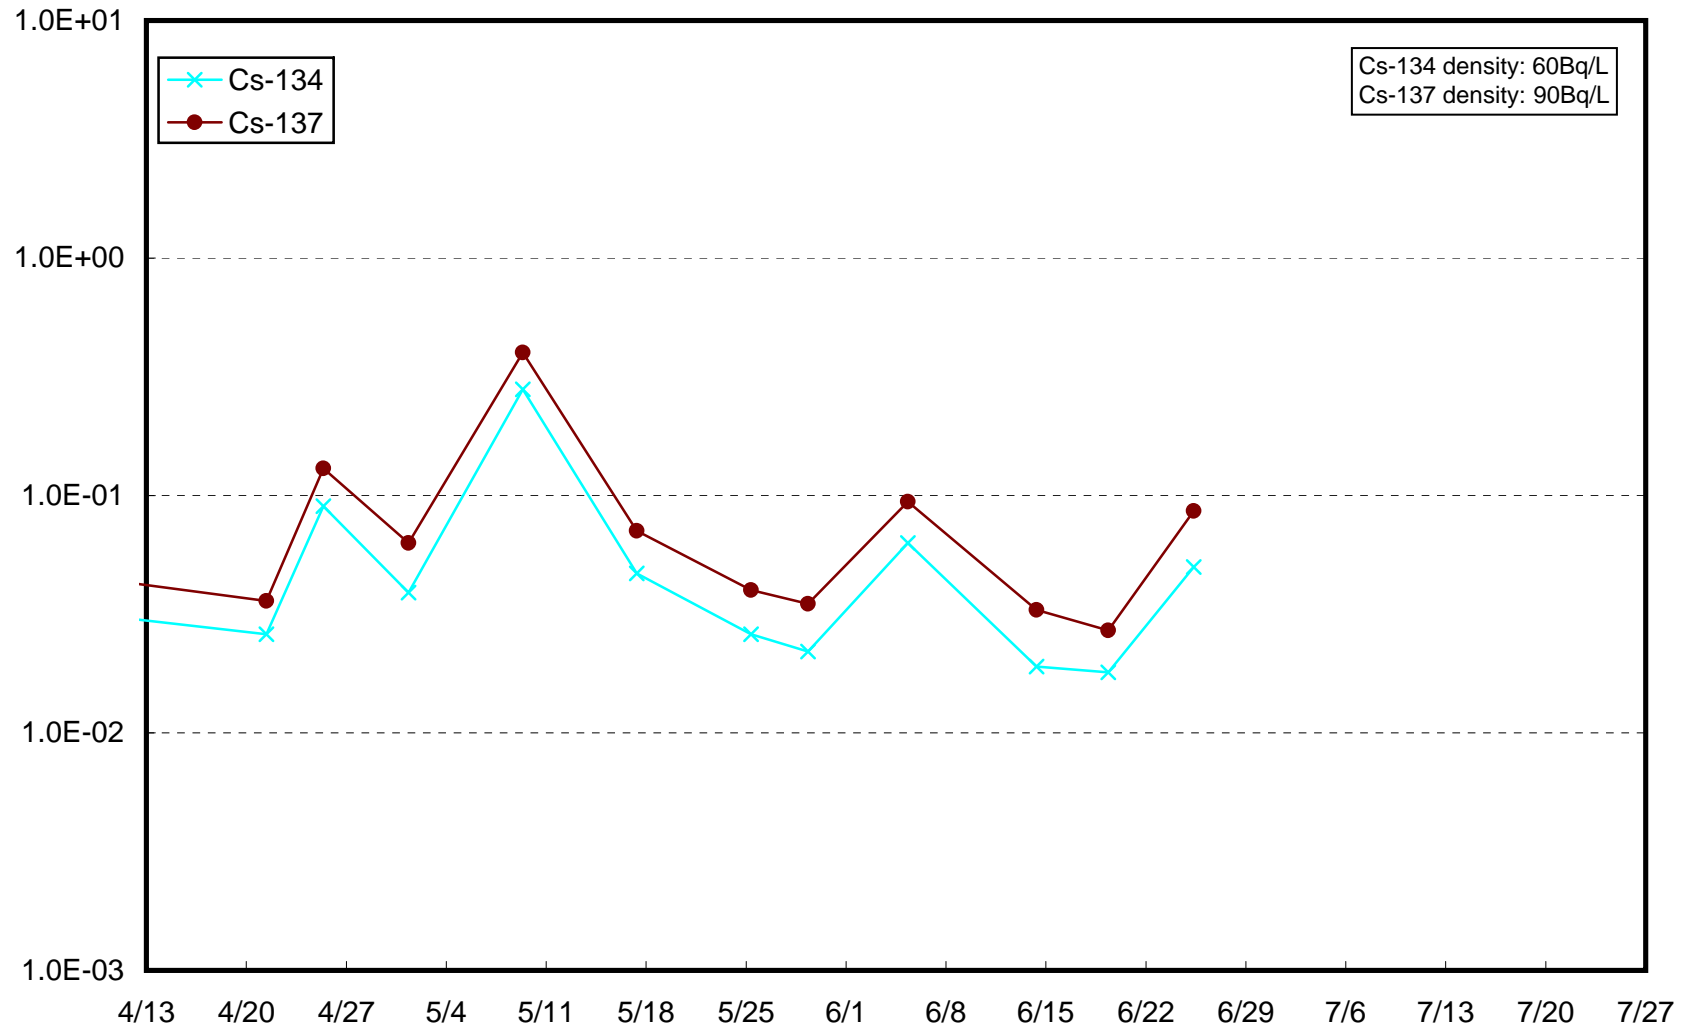


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Lower Layer (Bq/L)

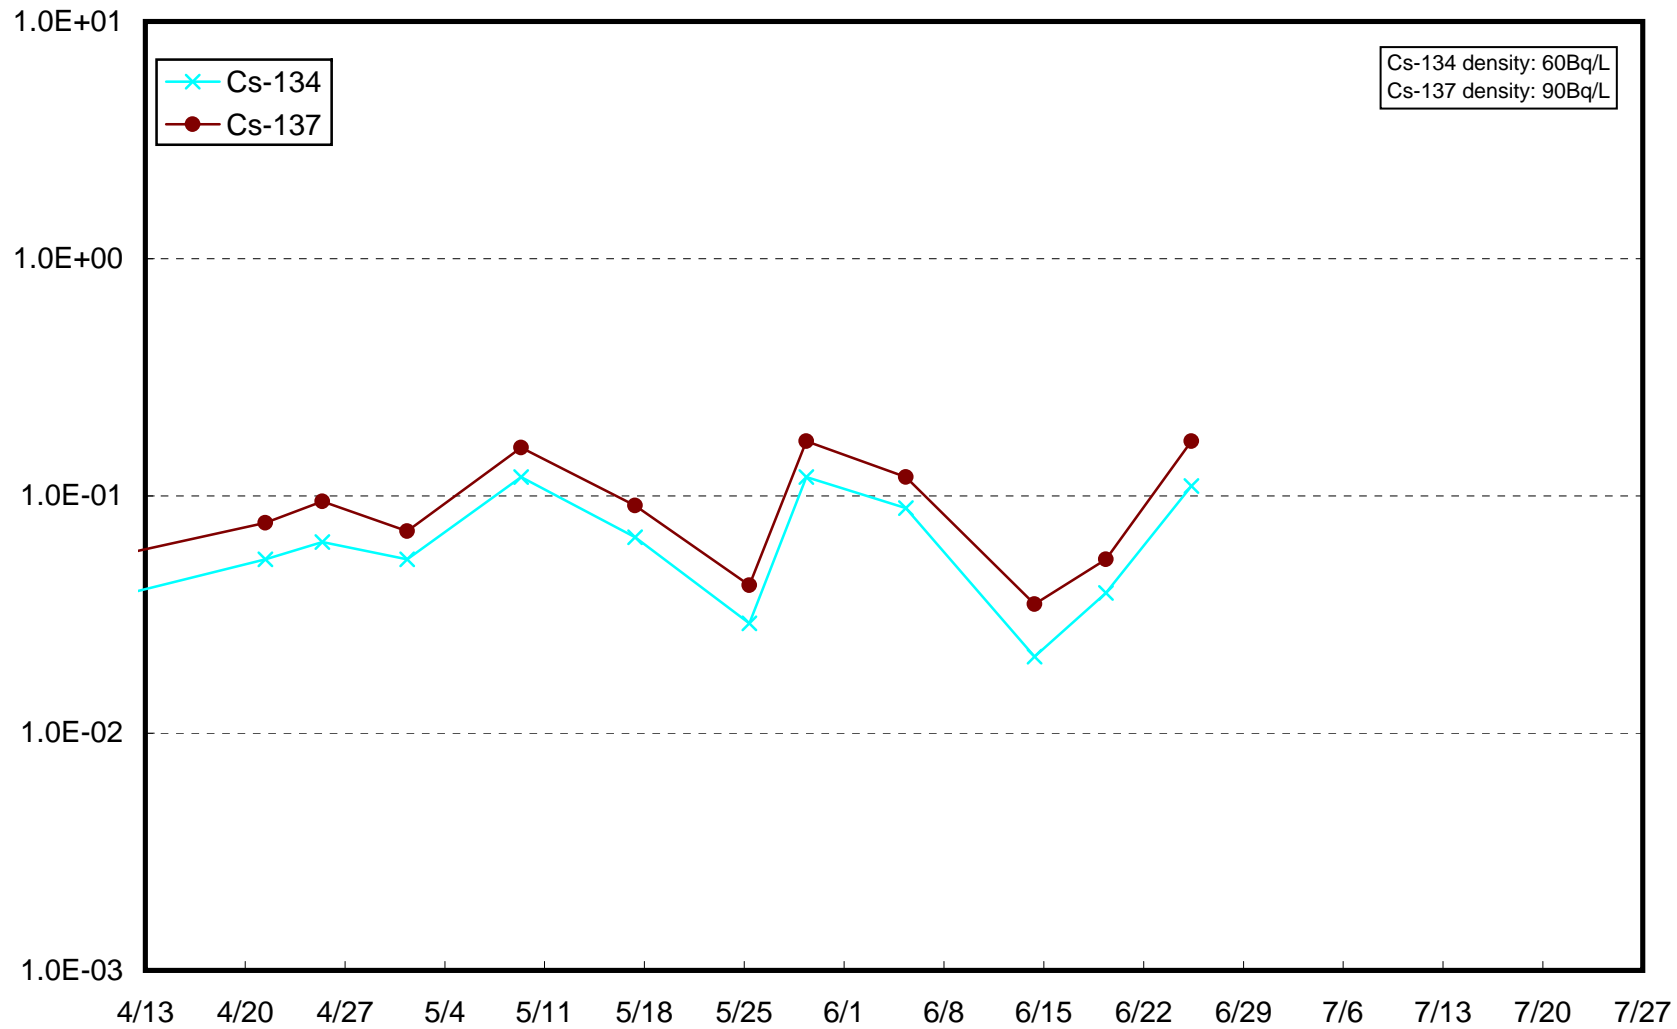


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer (Bq/L)

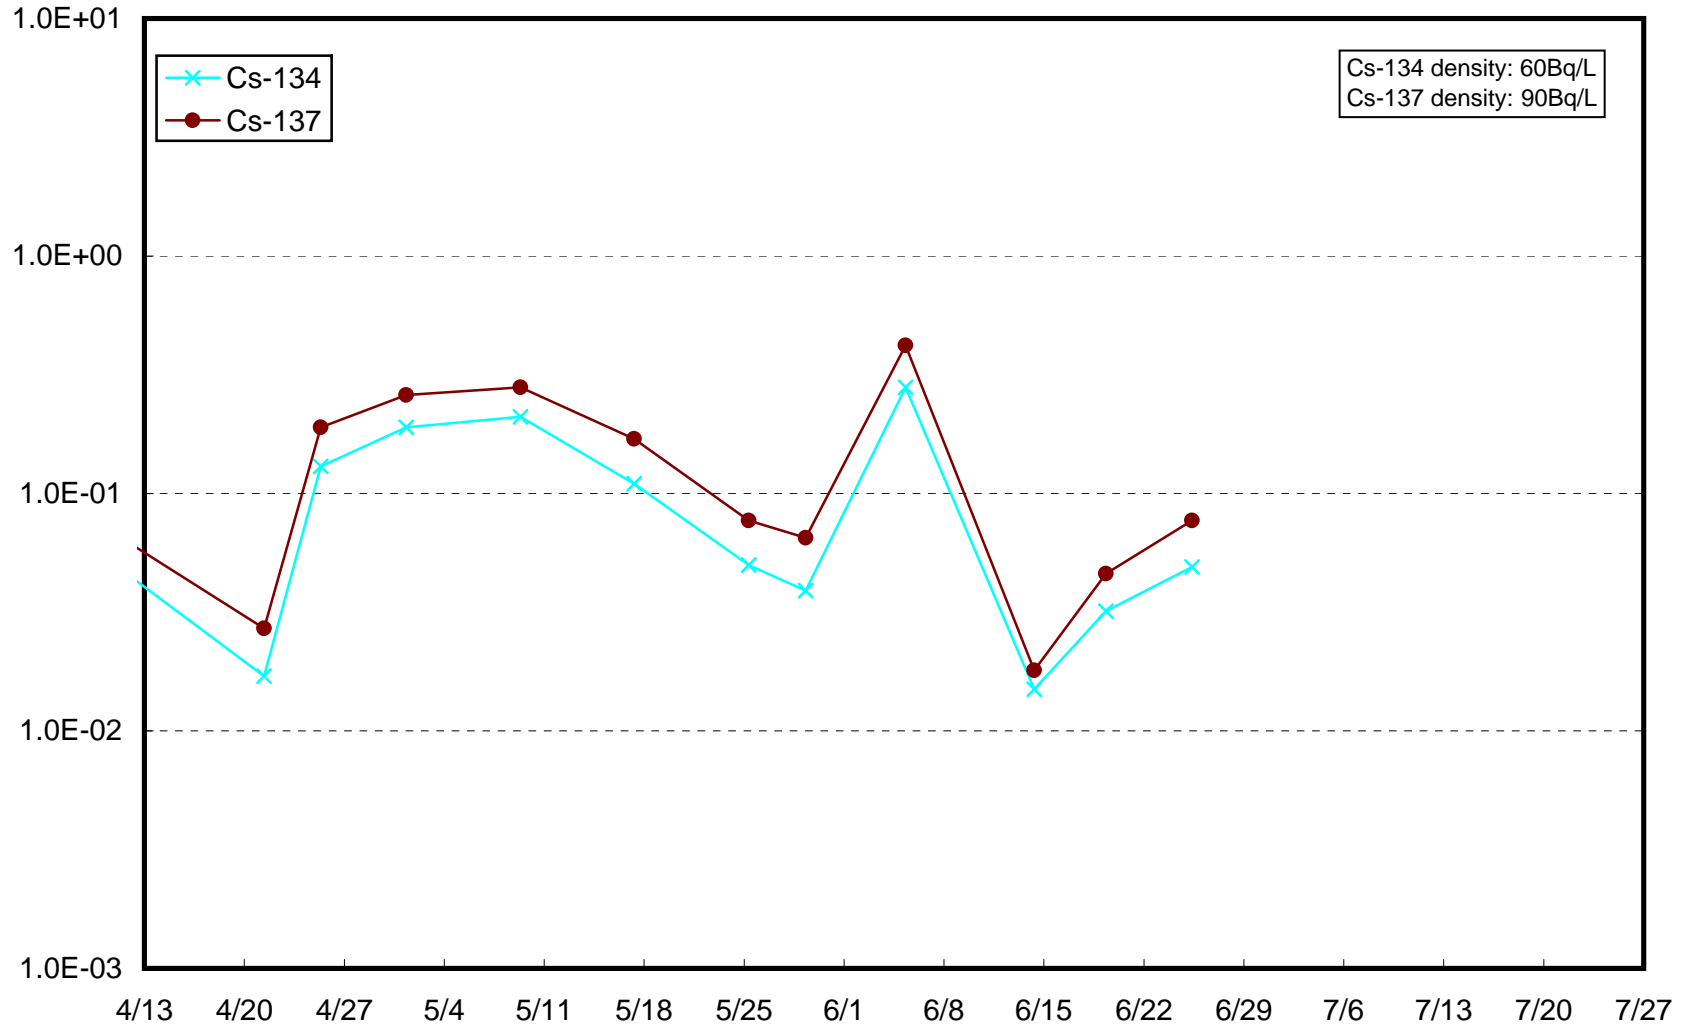


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Lower Layer (Bq/L)

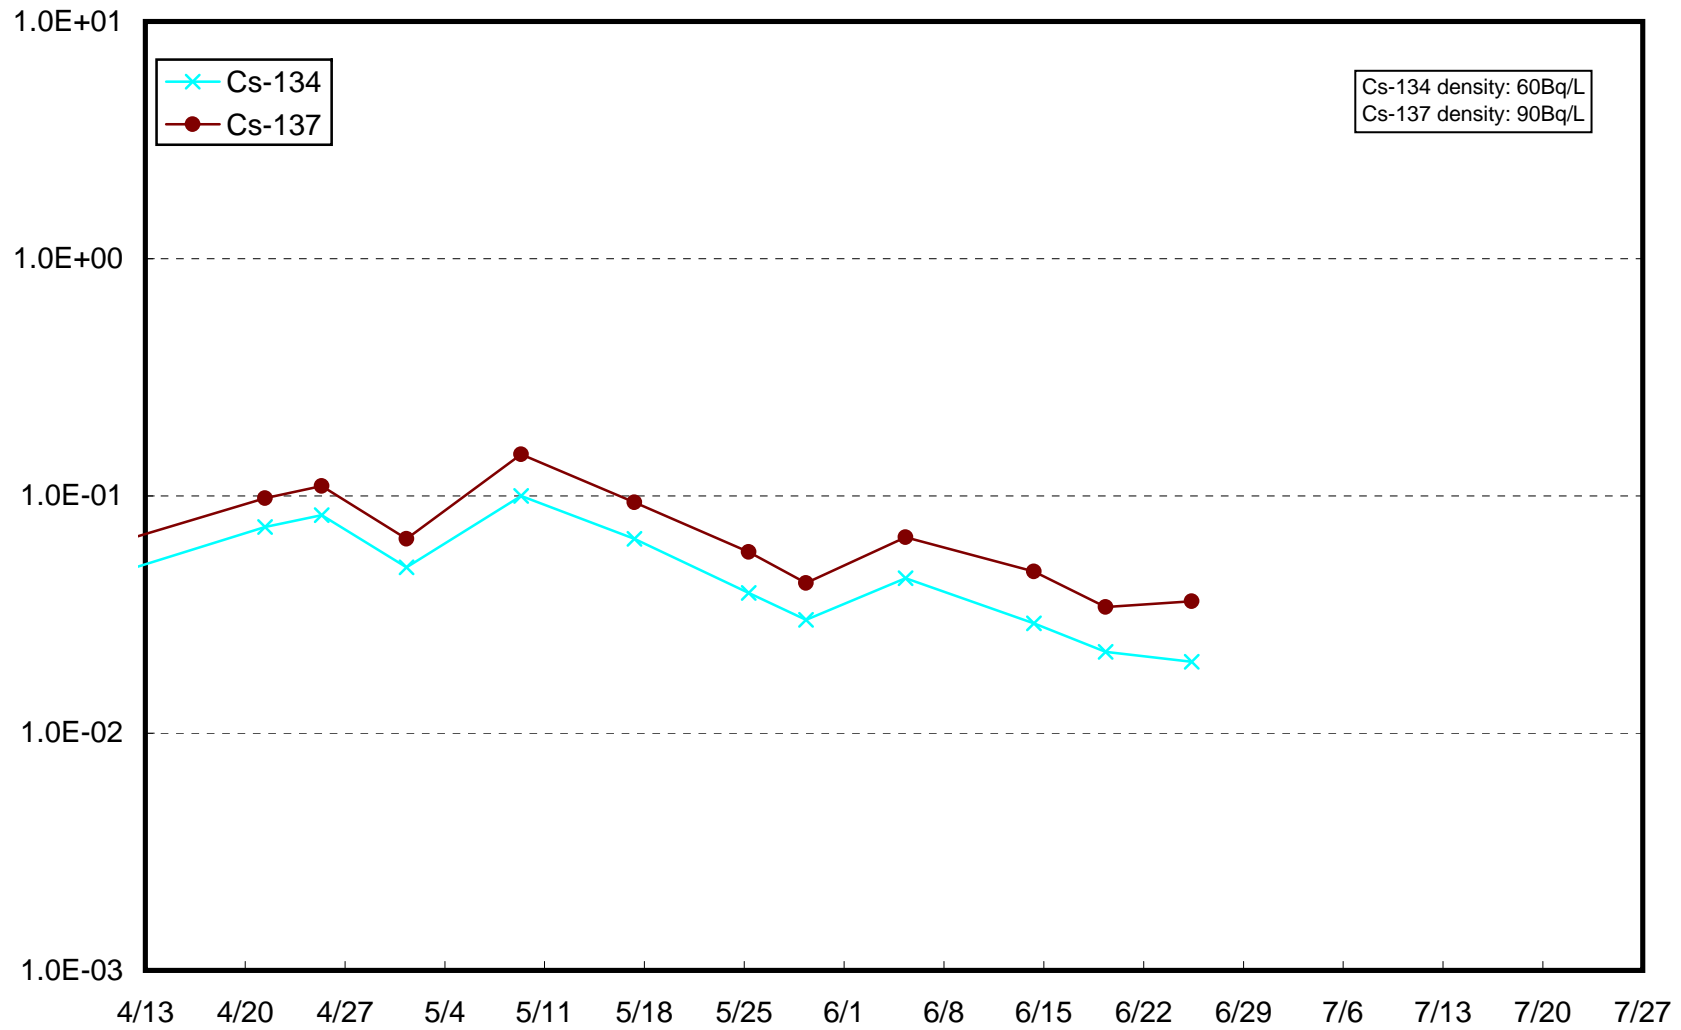


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer (Bq/L)

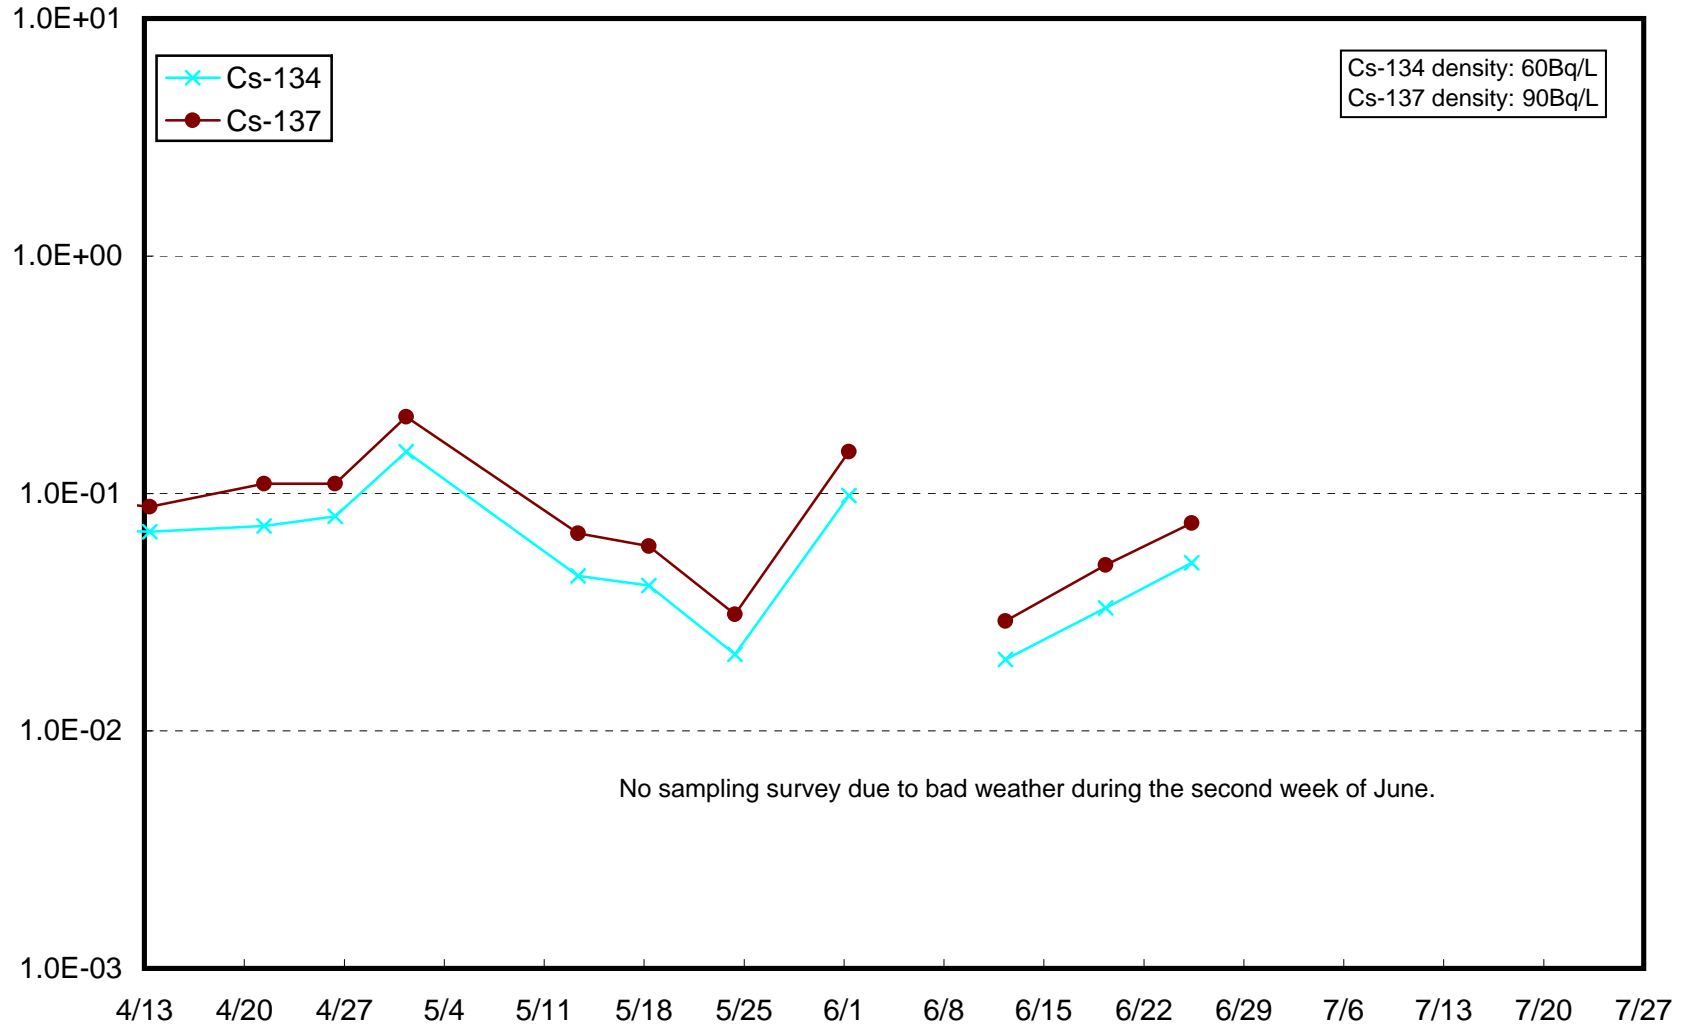


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Lower Layer (Bq/L)

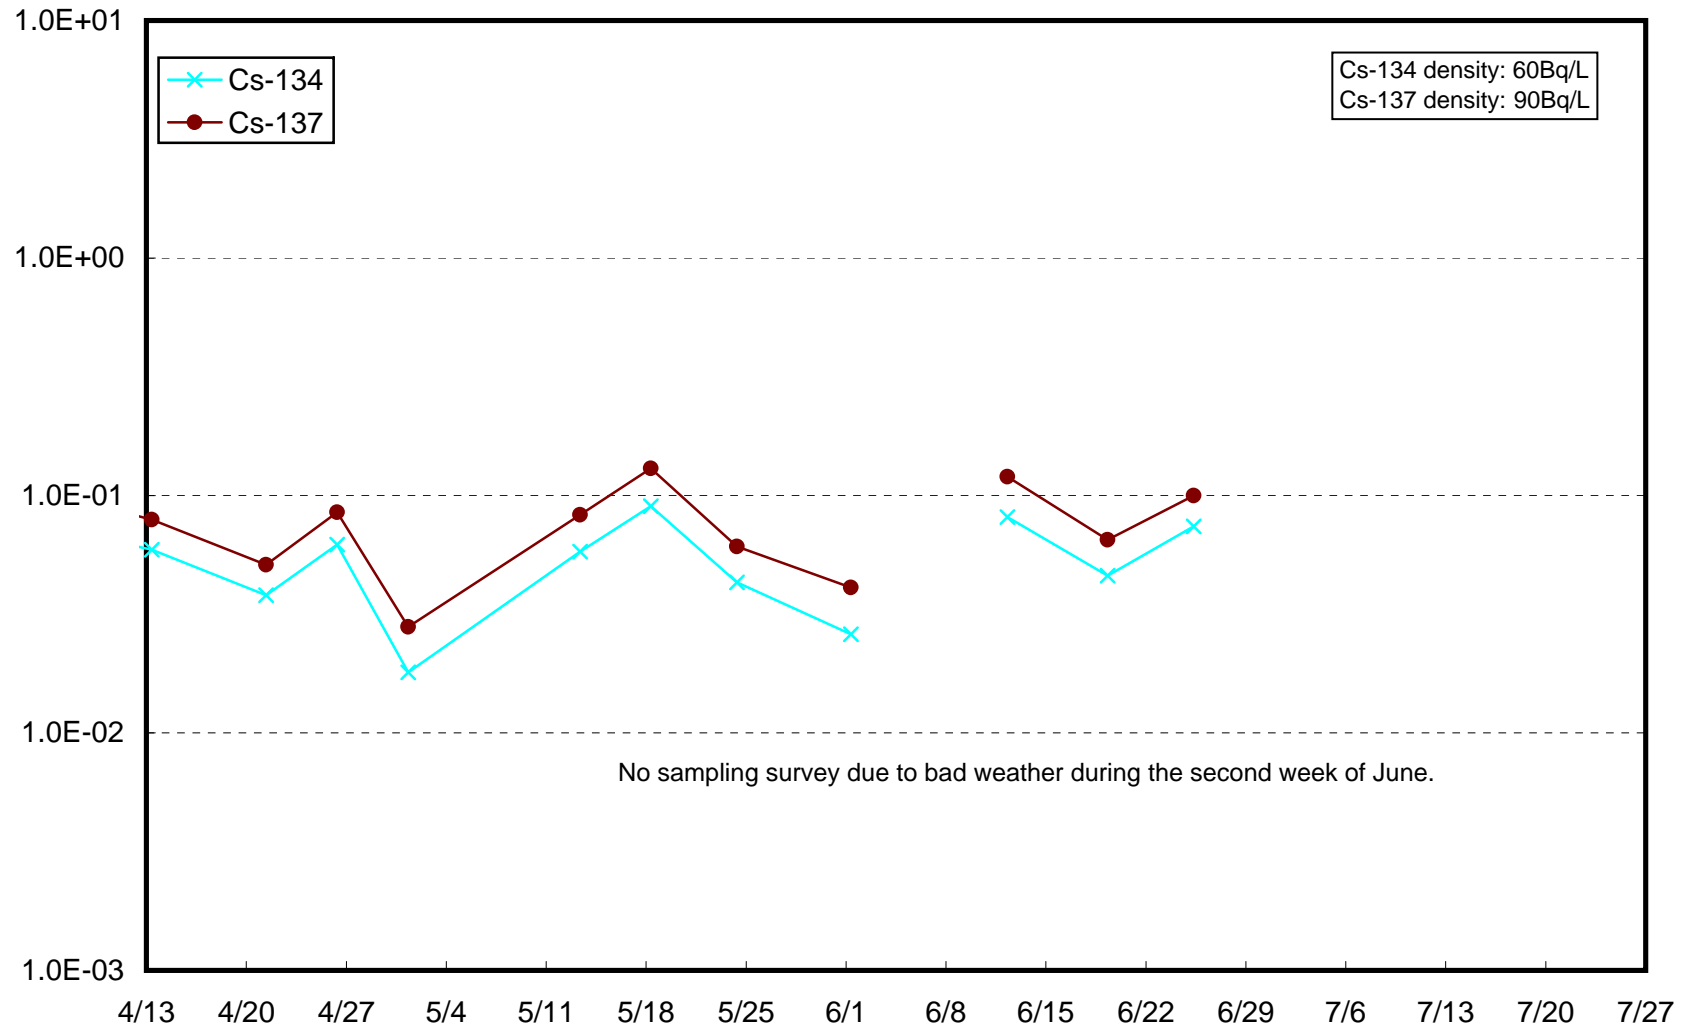


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Upper Layer (Bq/L)

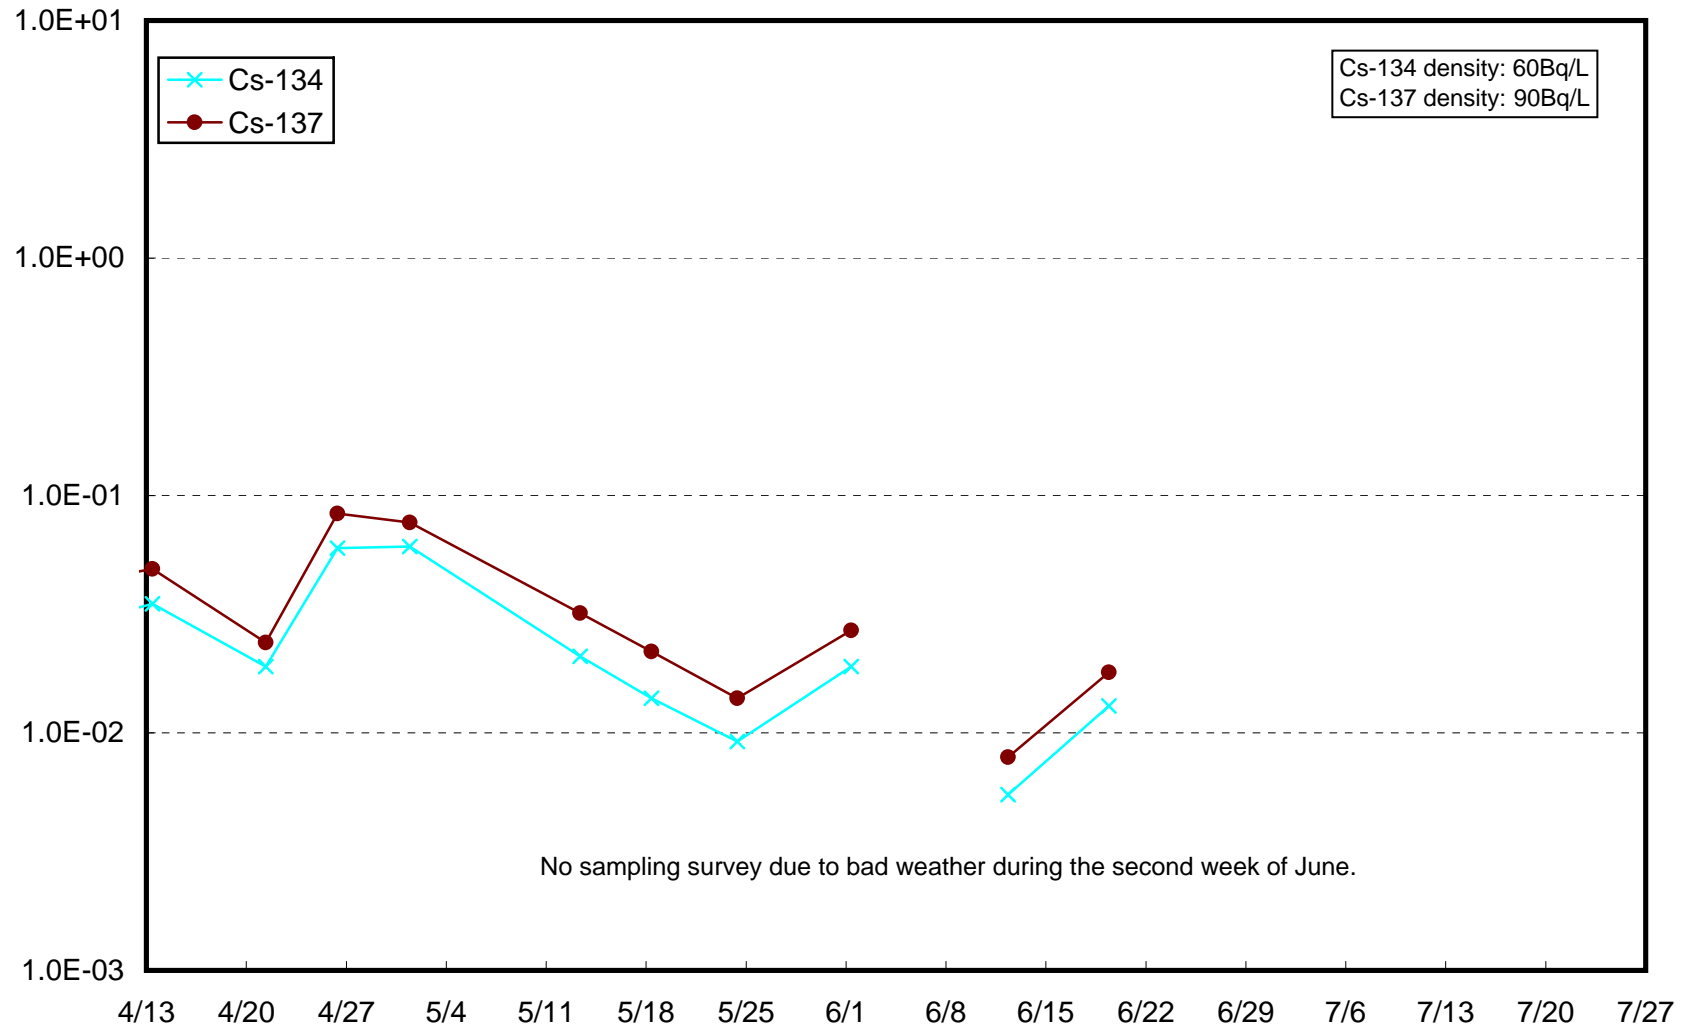


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Lower Layer (Bq/L)

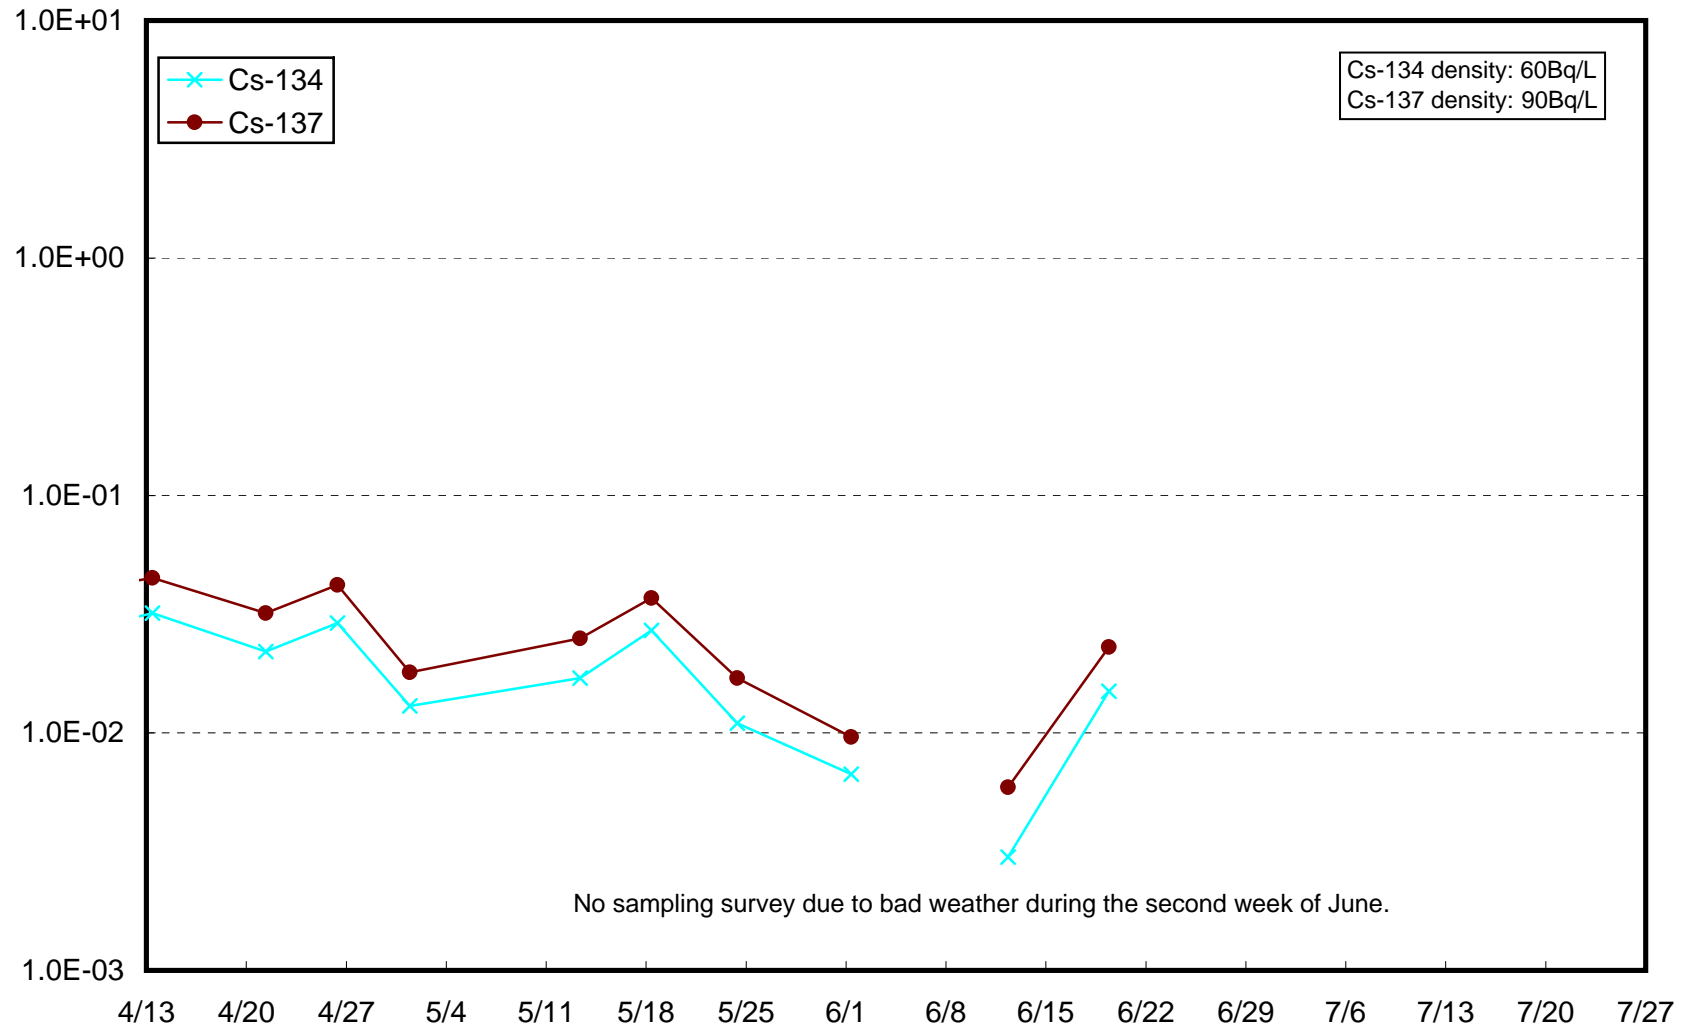


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Upper Layer (Bq/L)

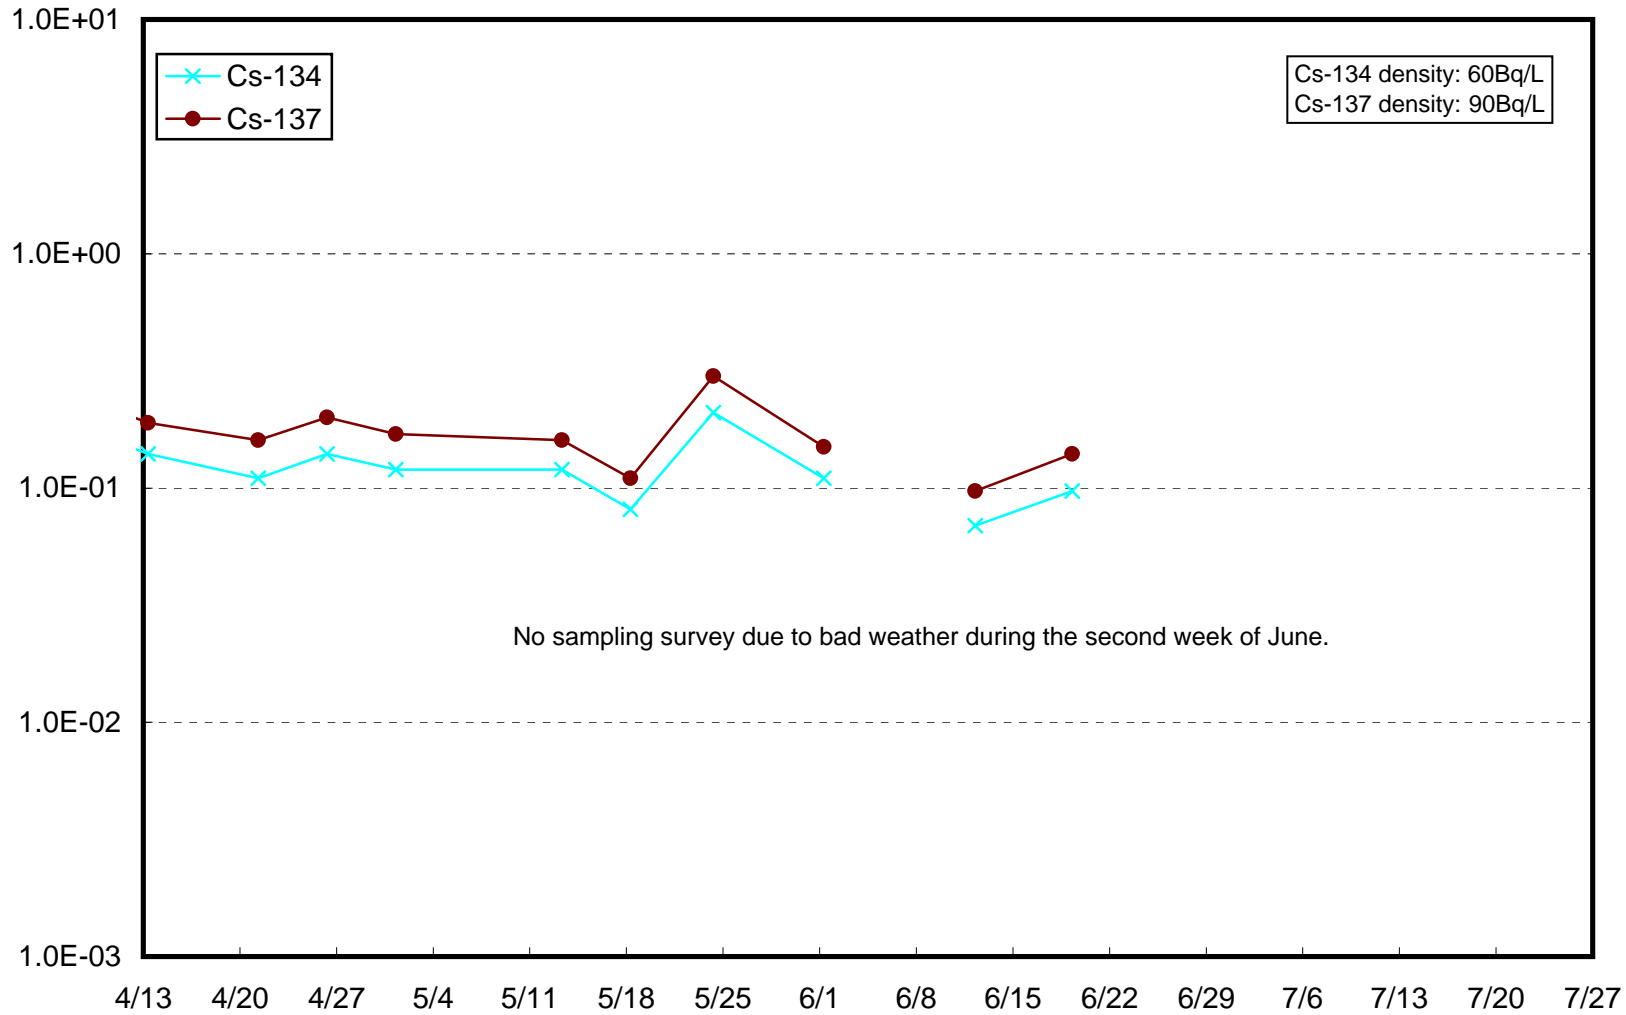


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Lower Layer (Bq/L)

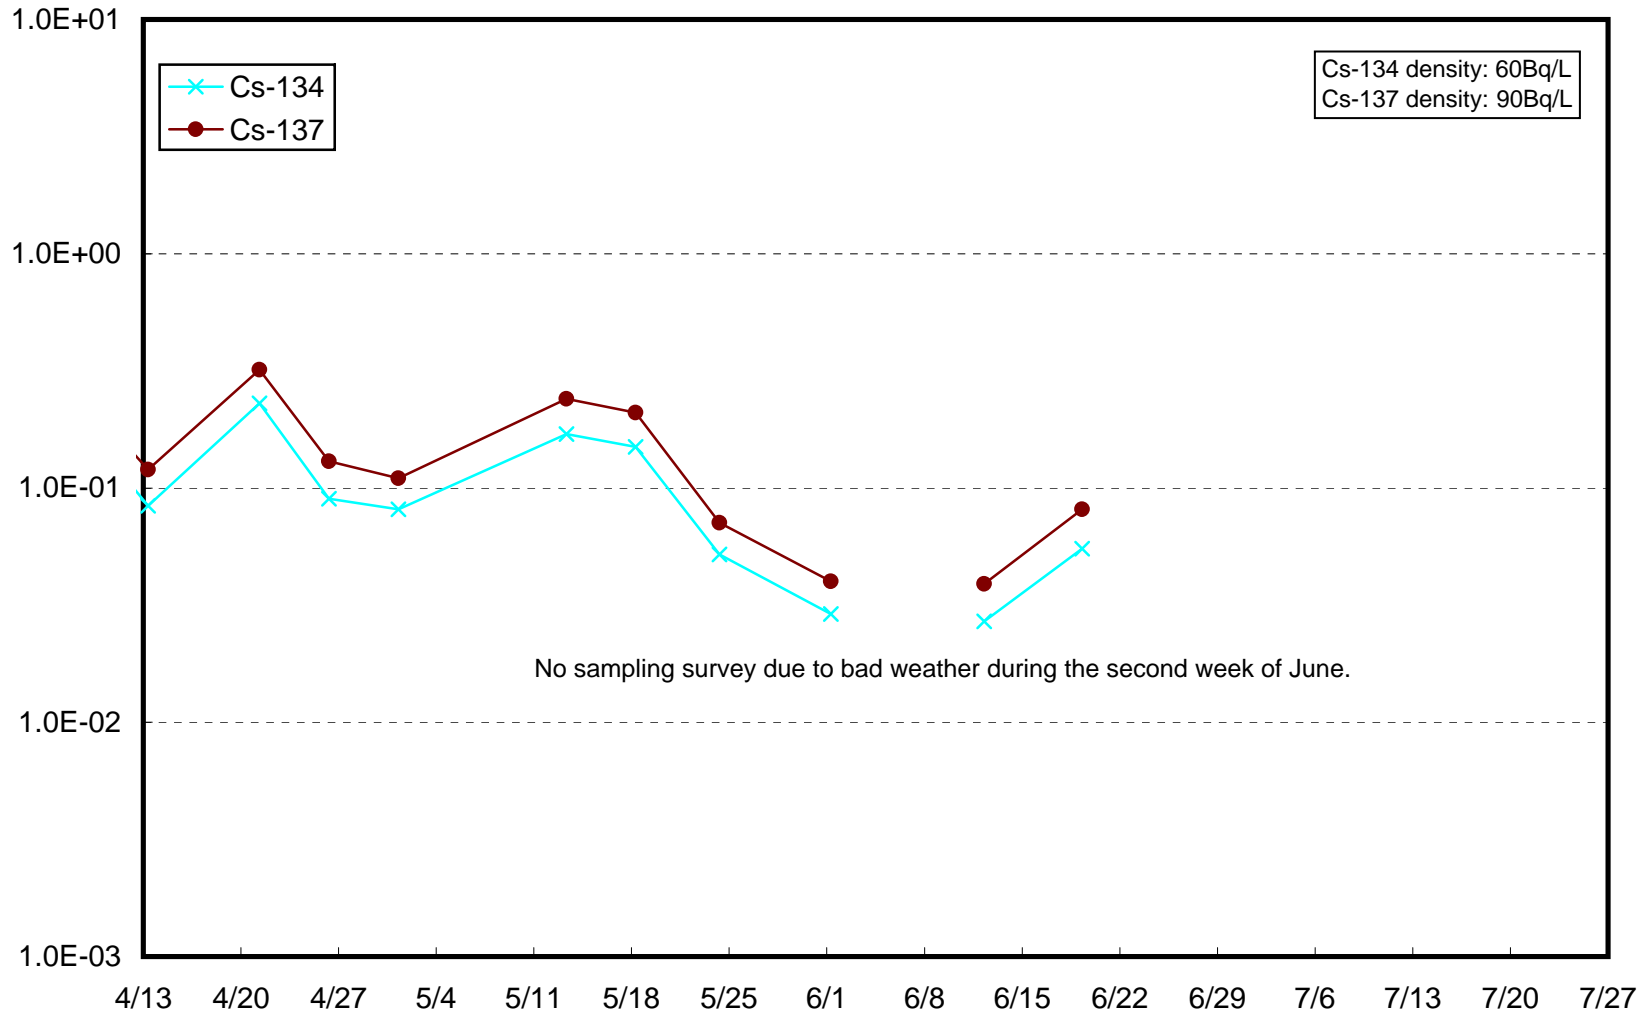


Radioactivity Density of the Seawater at 15km Offshore of Iwasawa Shore (T-7) Upper Layer (Bq/L)

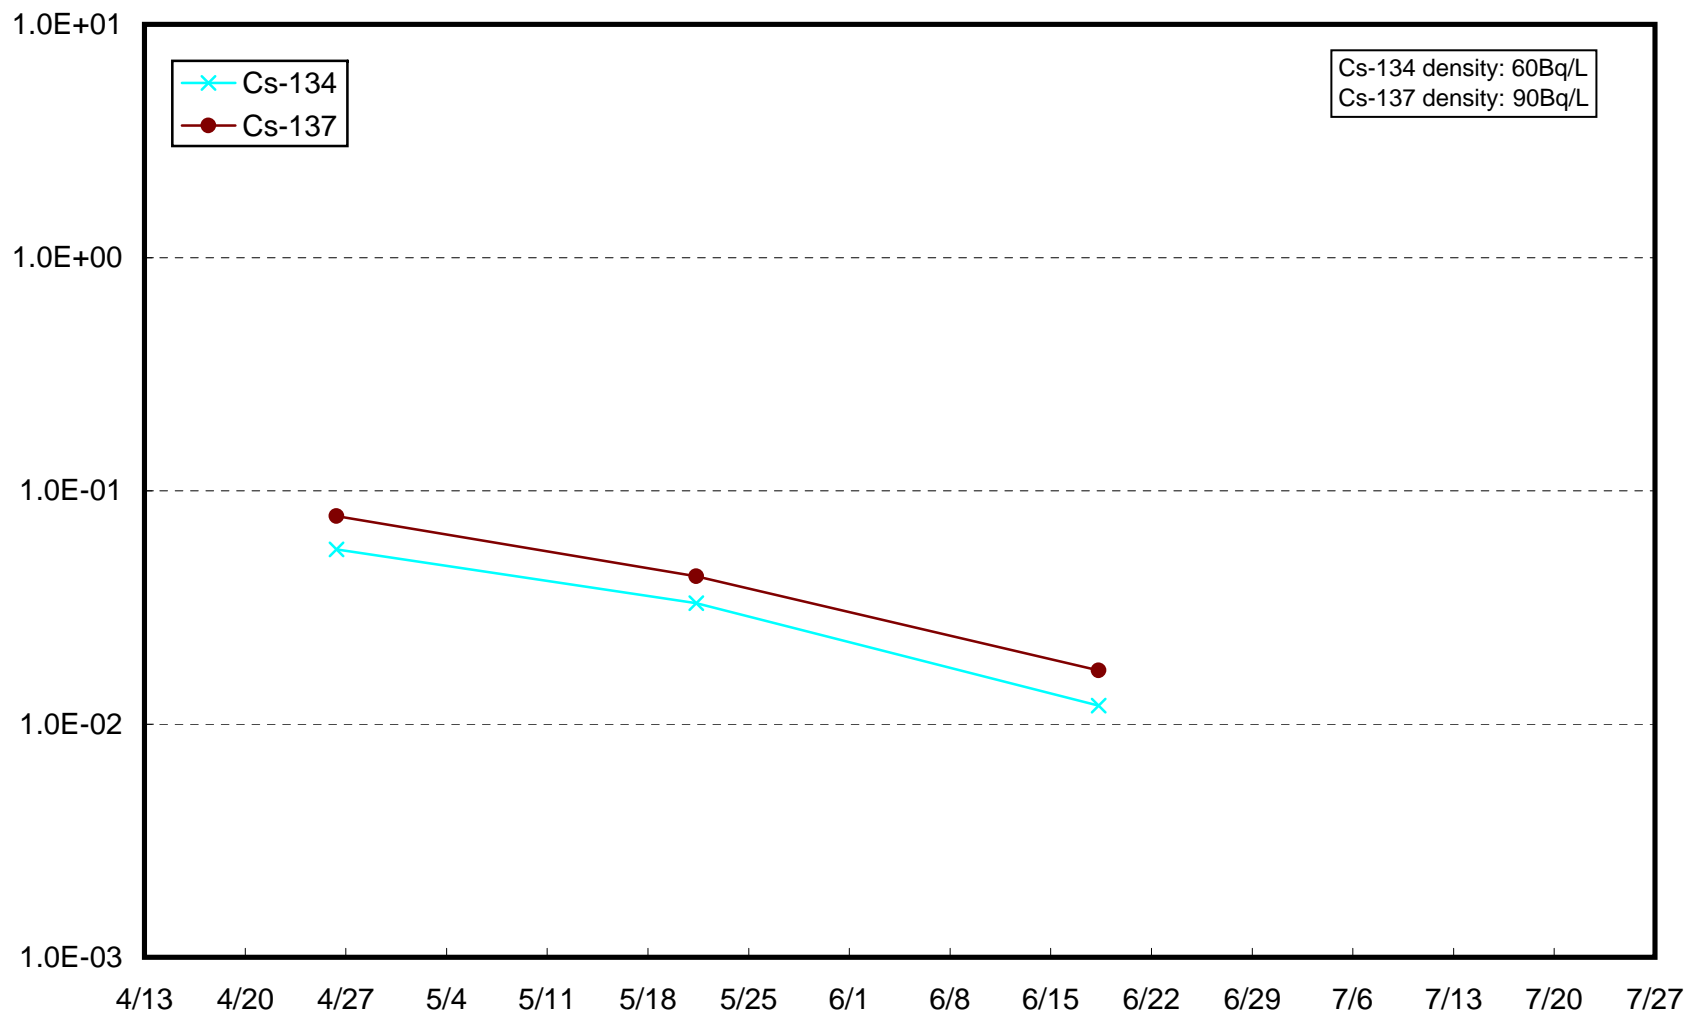


Radioactivity Density of the Seawater at 15km Offshore of Iwasawa Shore (T-7) Lower Layer (Bq/L)

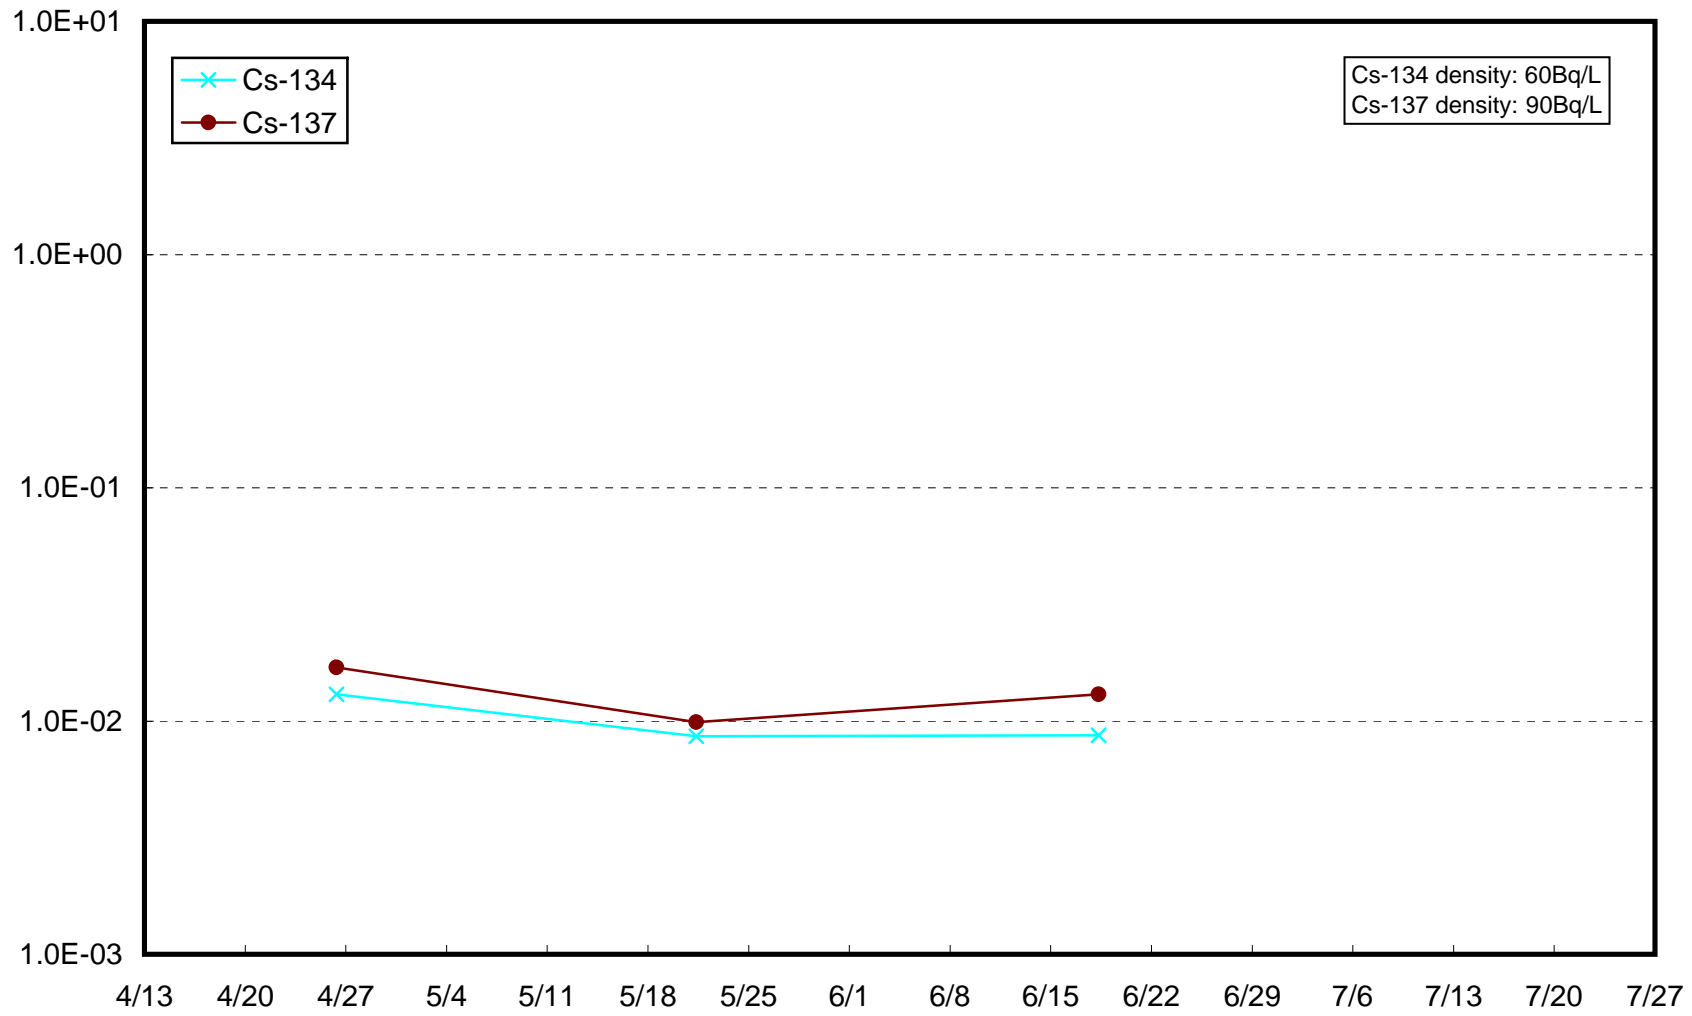


Radioactivity Density of the Seawater at 3km Offshore of Onahama Port (T-18) Upper Layer (Bq/L)

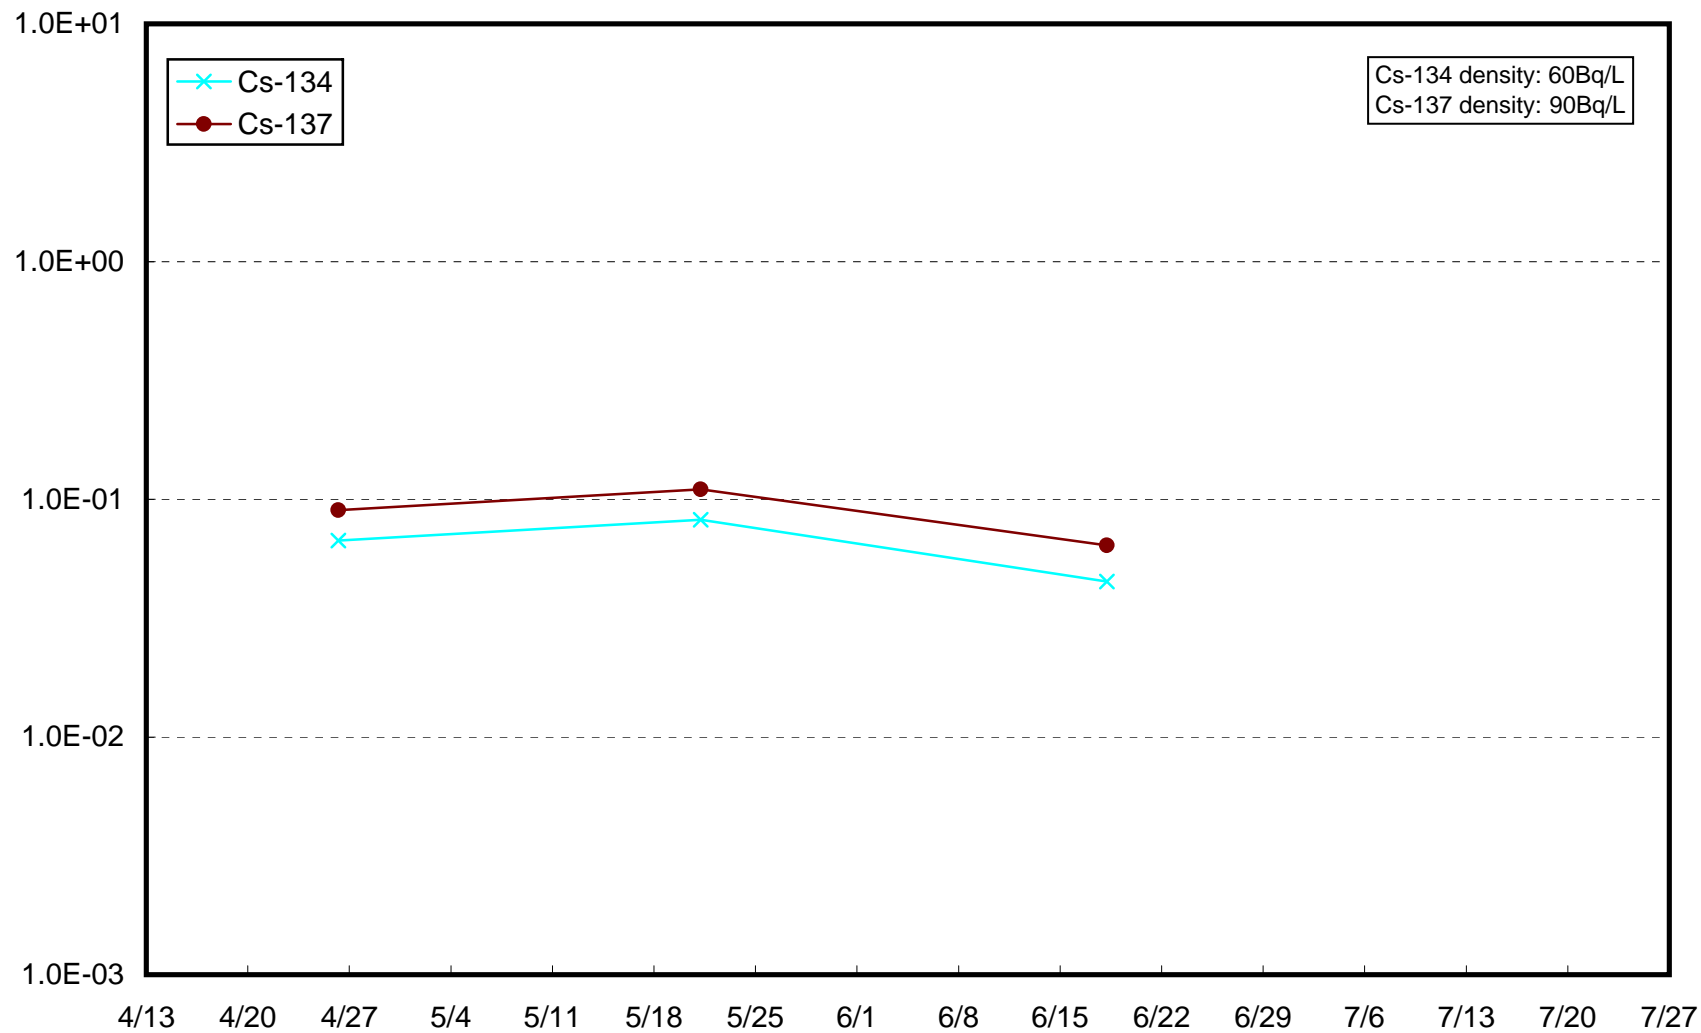


Radioactivity Density of the Seawater at 3km Offshore of Onahama Port (T-18) Lower Layer (Bq/L)

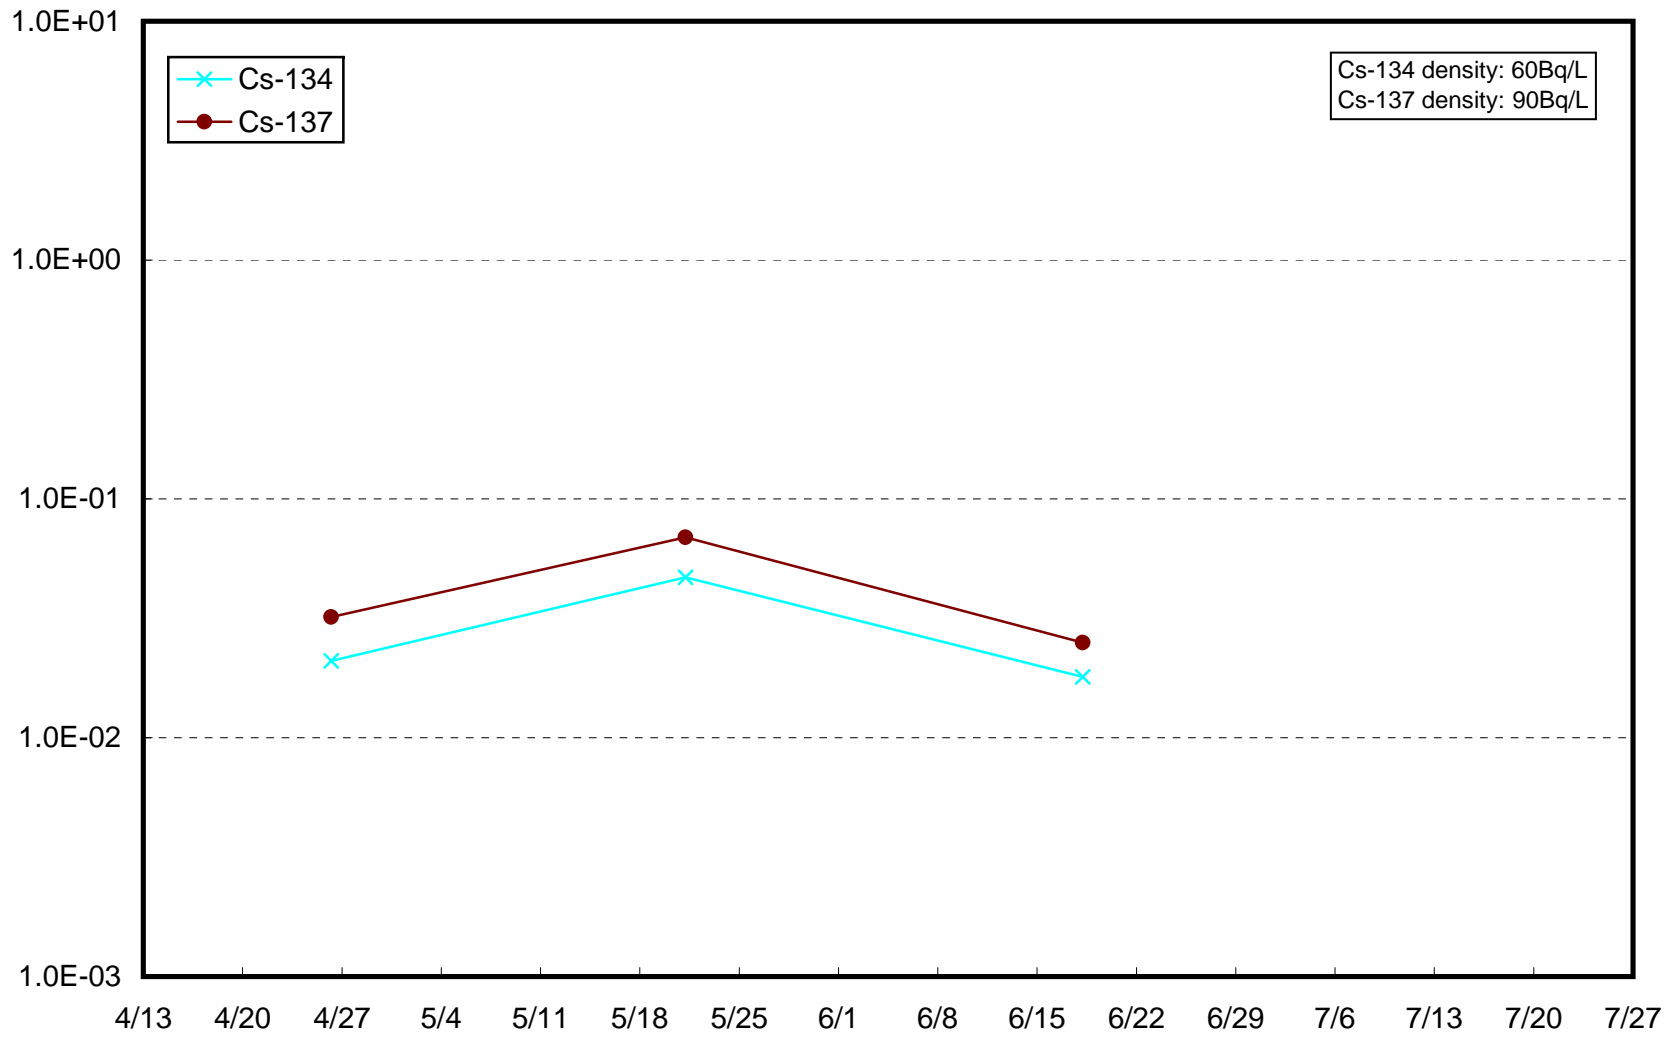


Radioactivity Density of the Seawater Around 3km Offshore of Ukedo River (T-S3) Upper Layer (Bq/L)

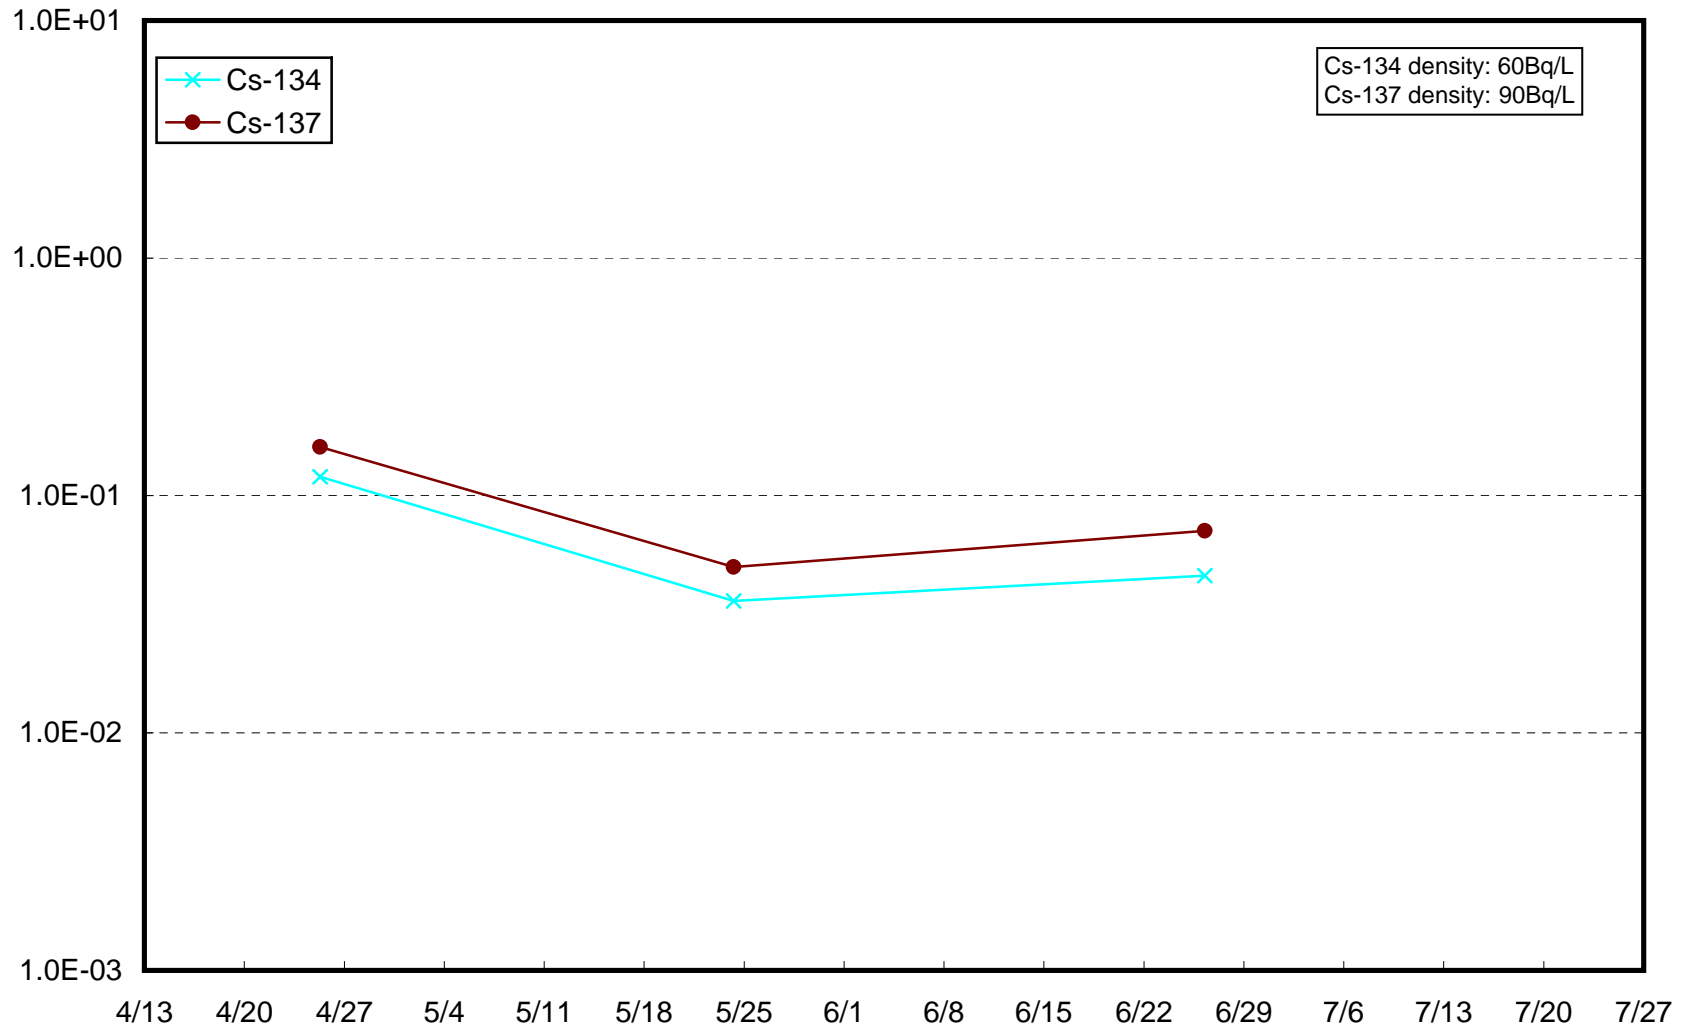


Radioactivity Density of the Seawater Around 3km Offshore of Ukedo River (T-S3) Lower Layer (Bq/L)

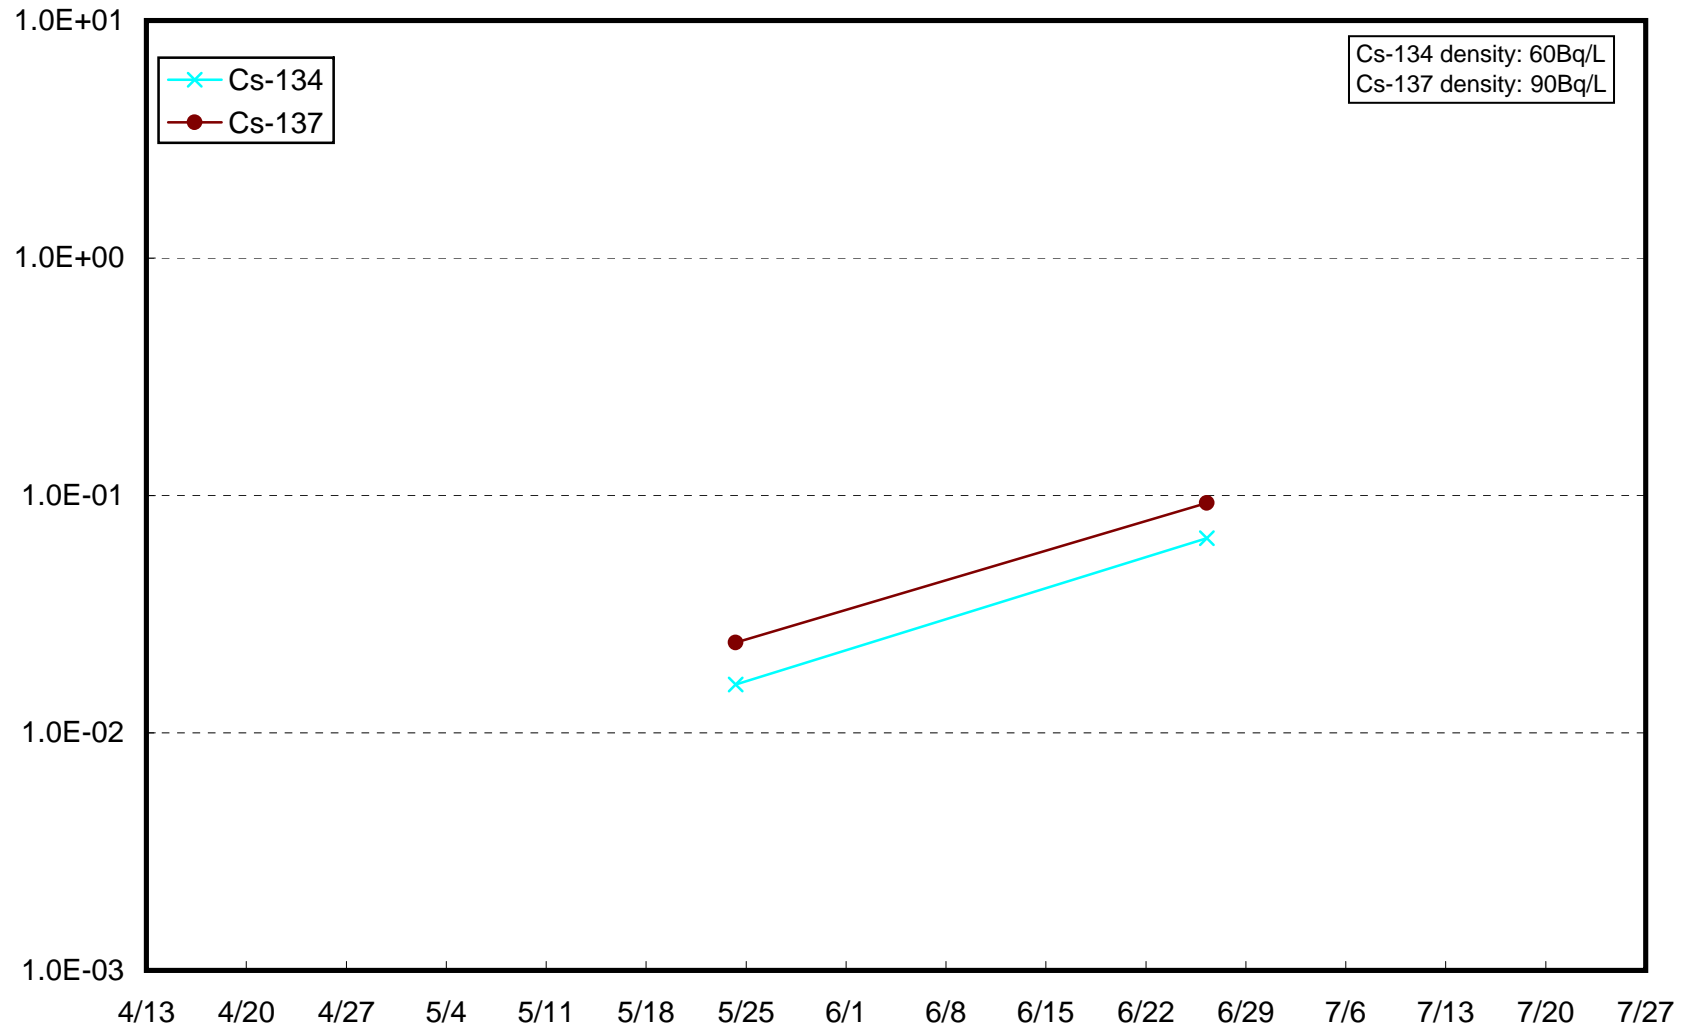


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Upper Layer (Bq/L)

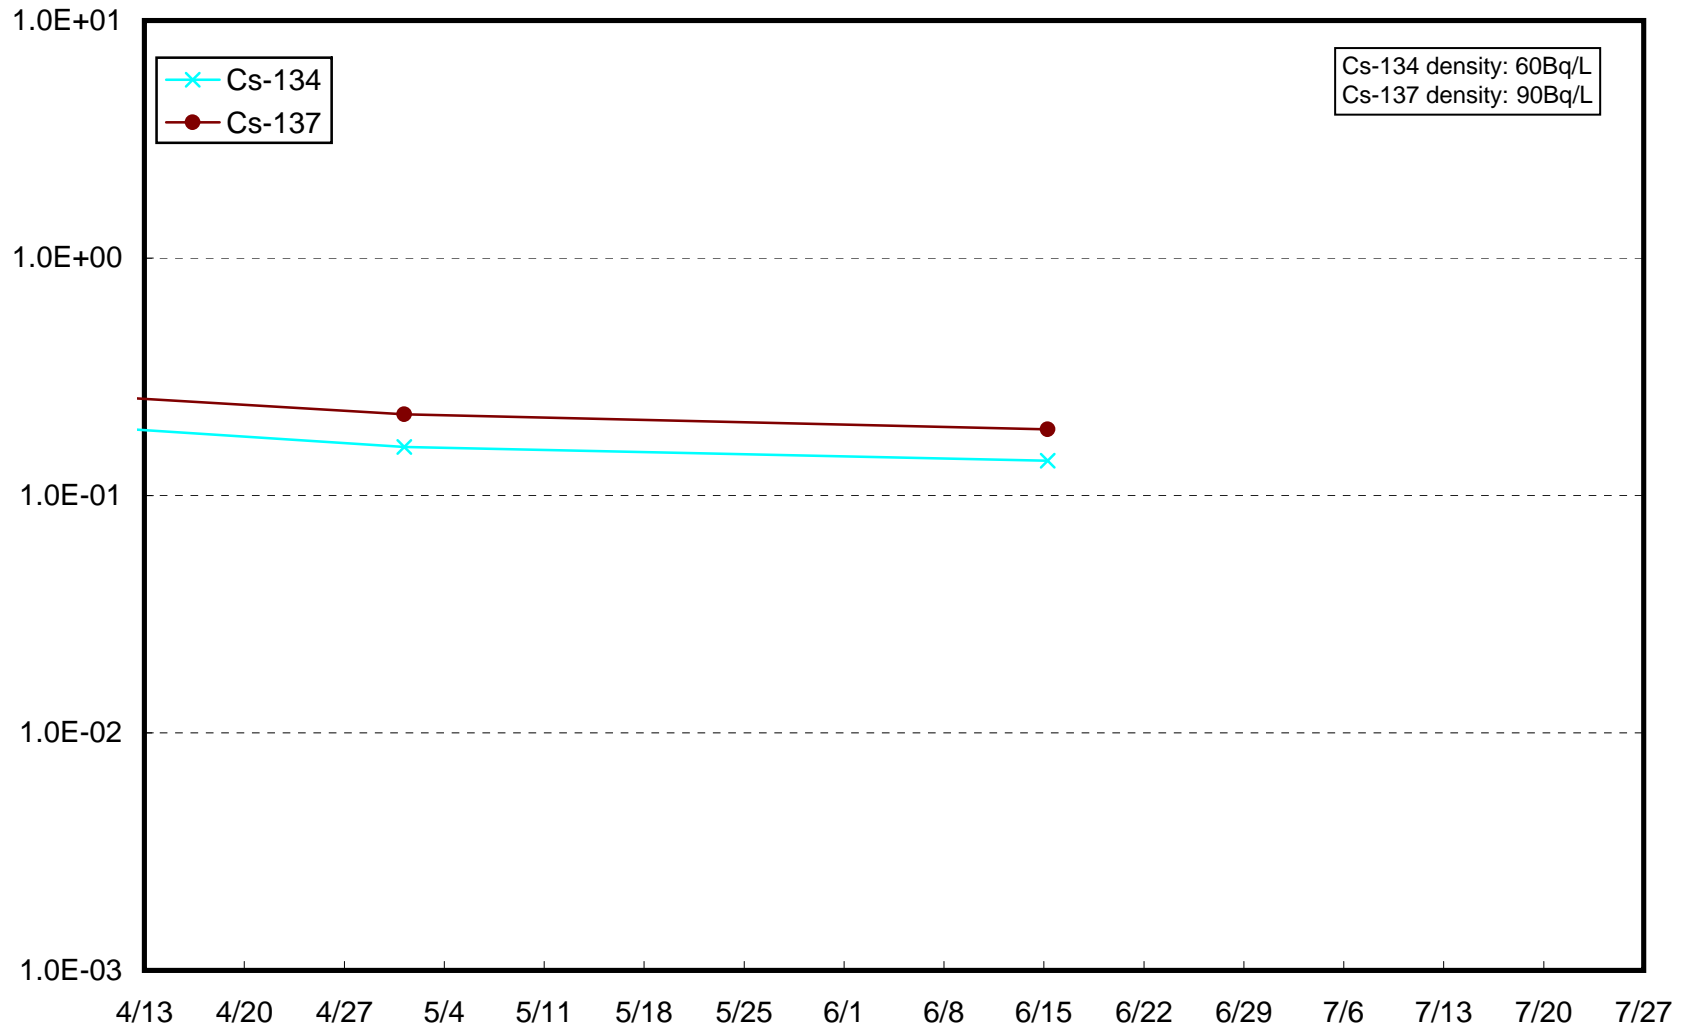


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Lower Layer (Bq/L)

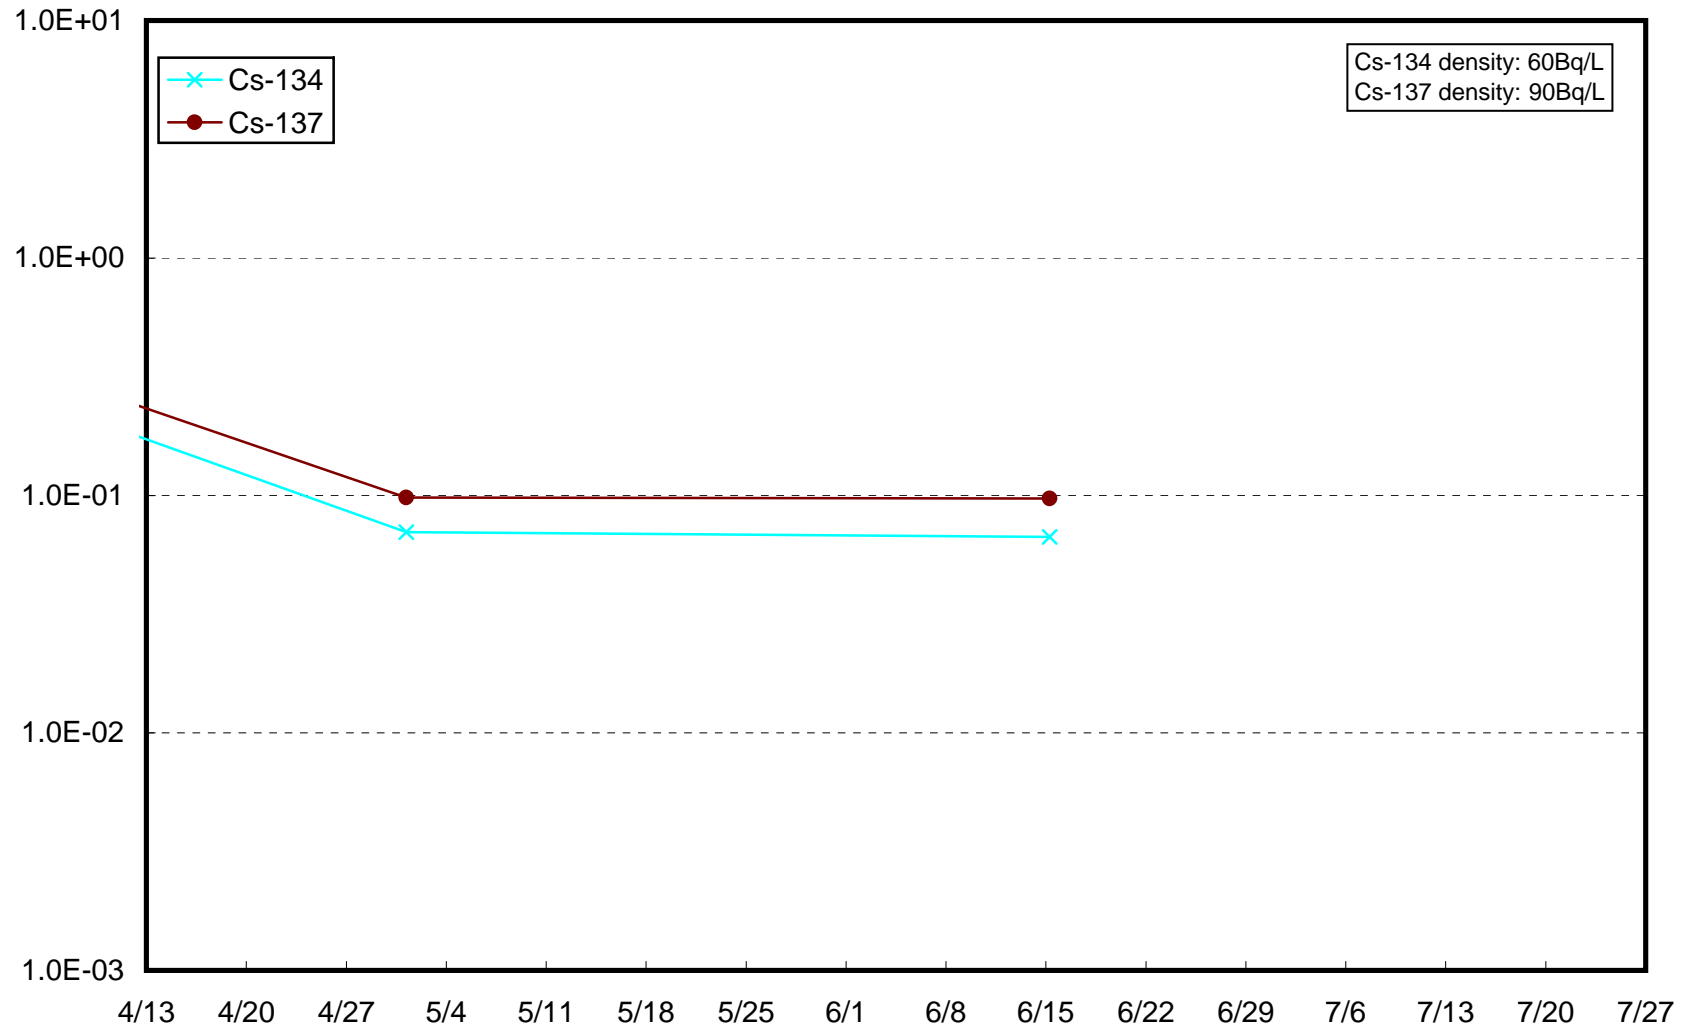


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Upper Layer (Bq/L)

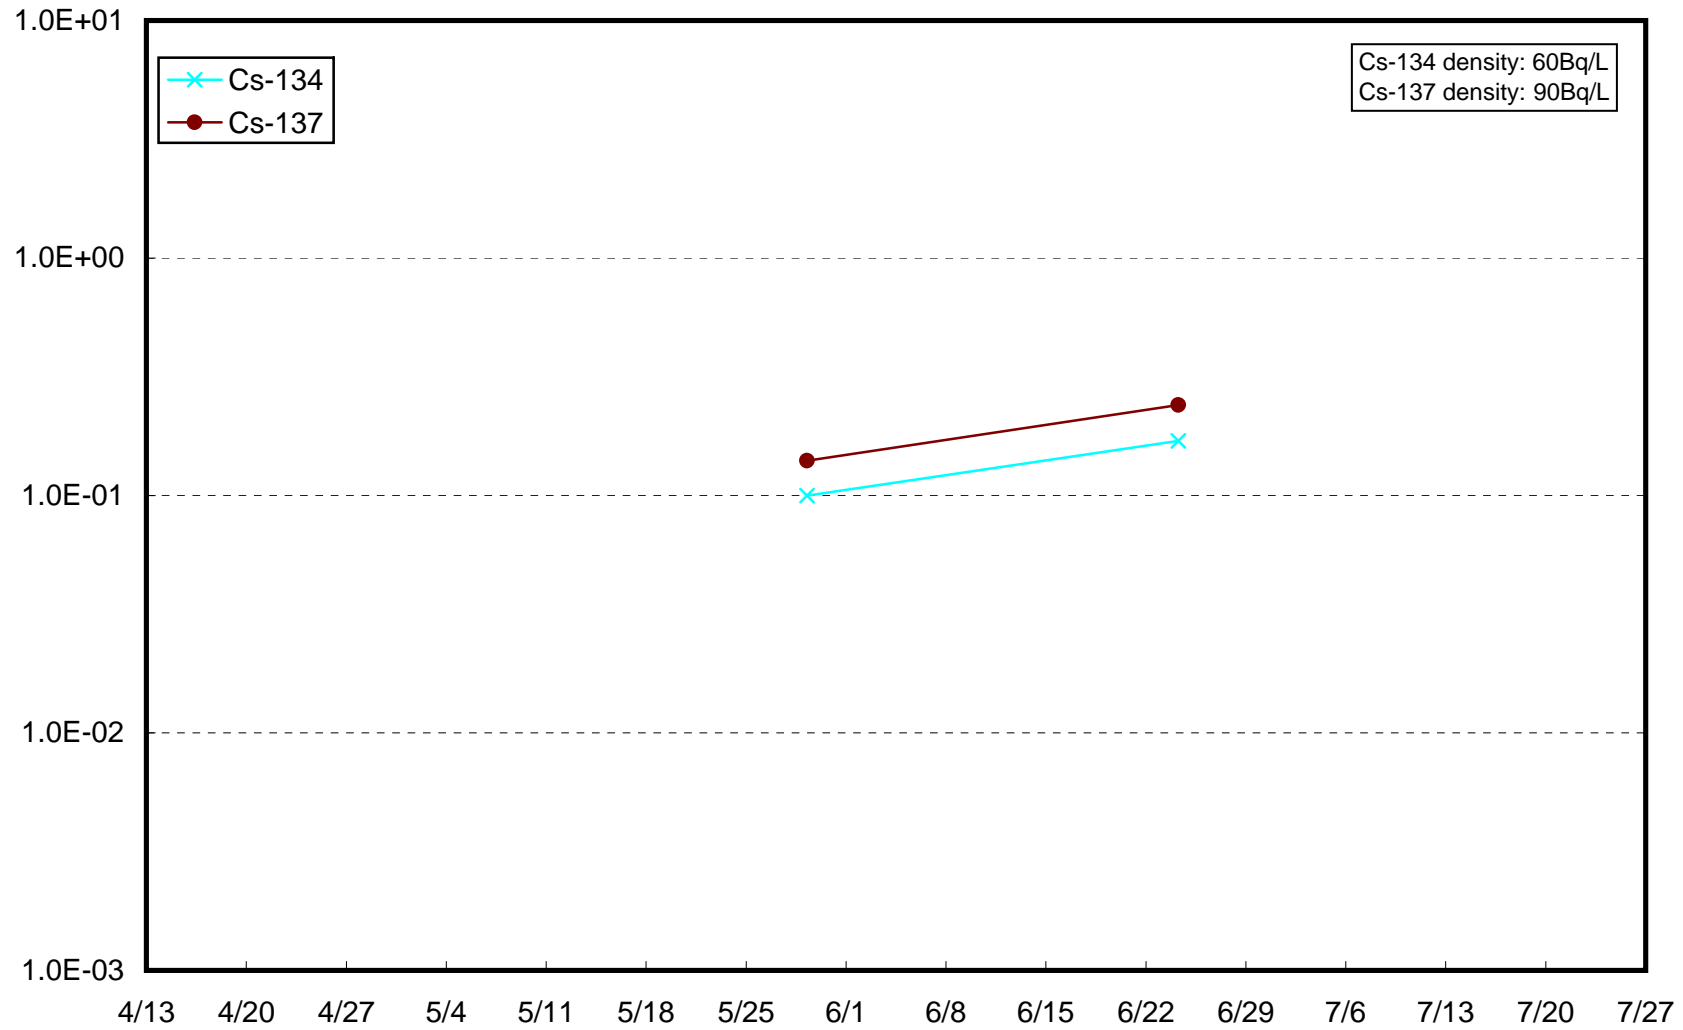


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Lower Layer (Bq/L)

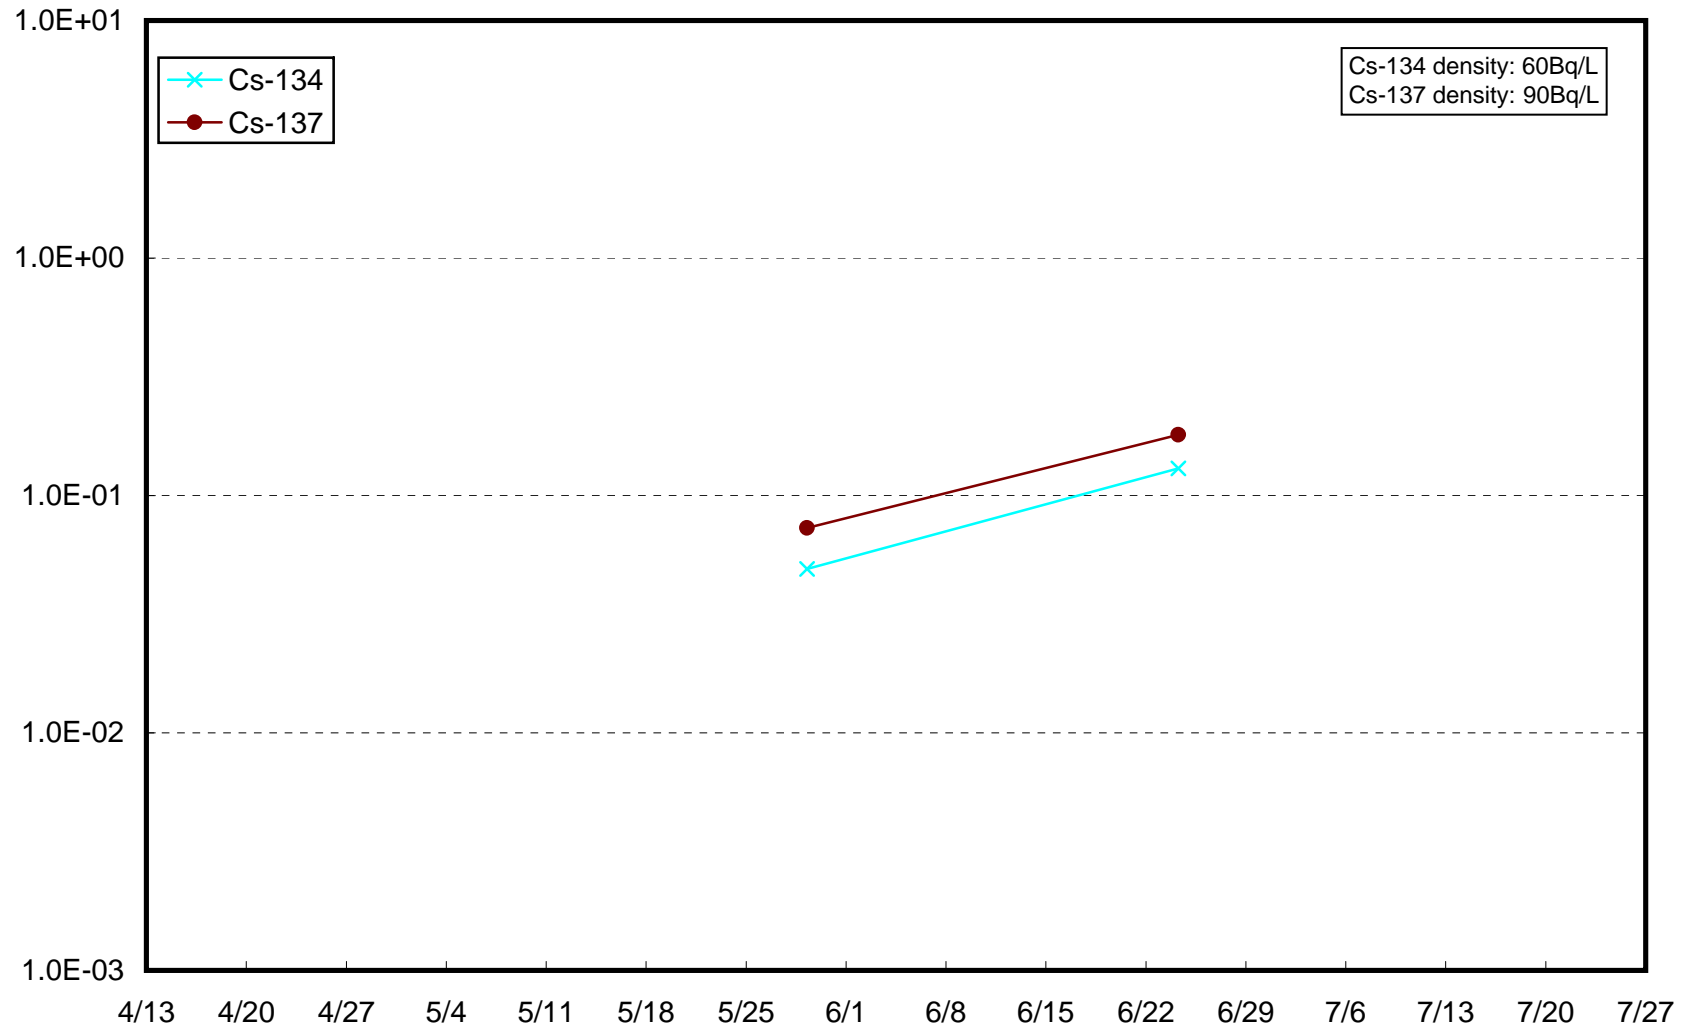


Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Upper Layer (Bq/L)

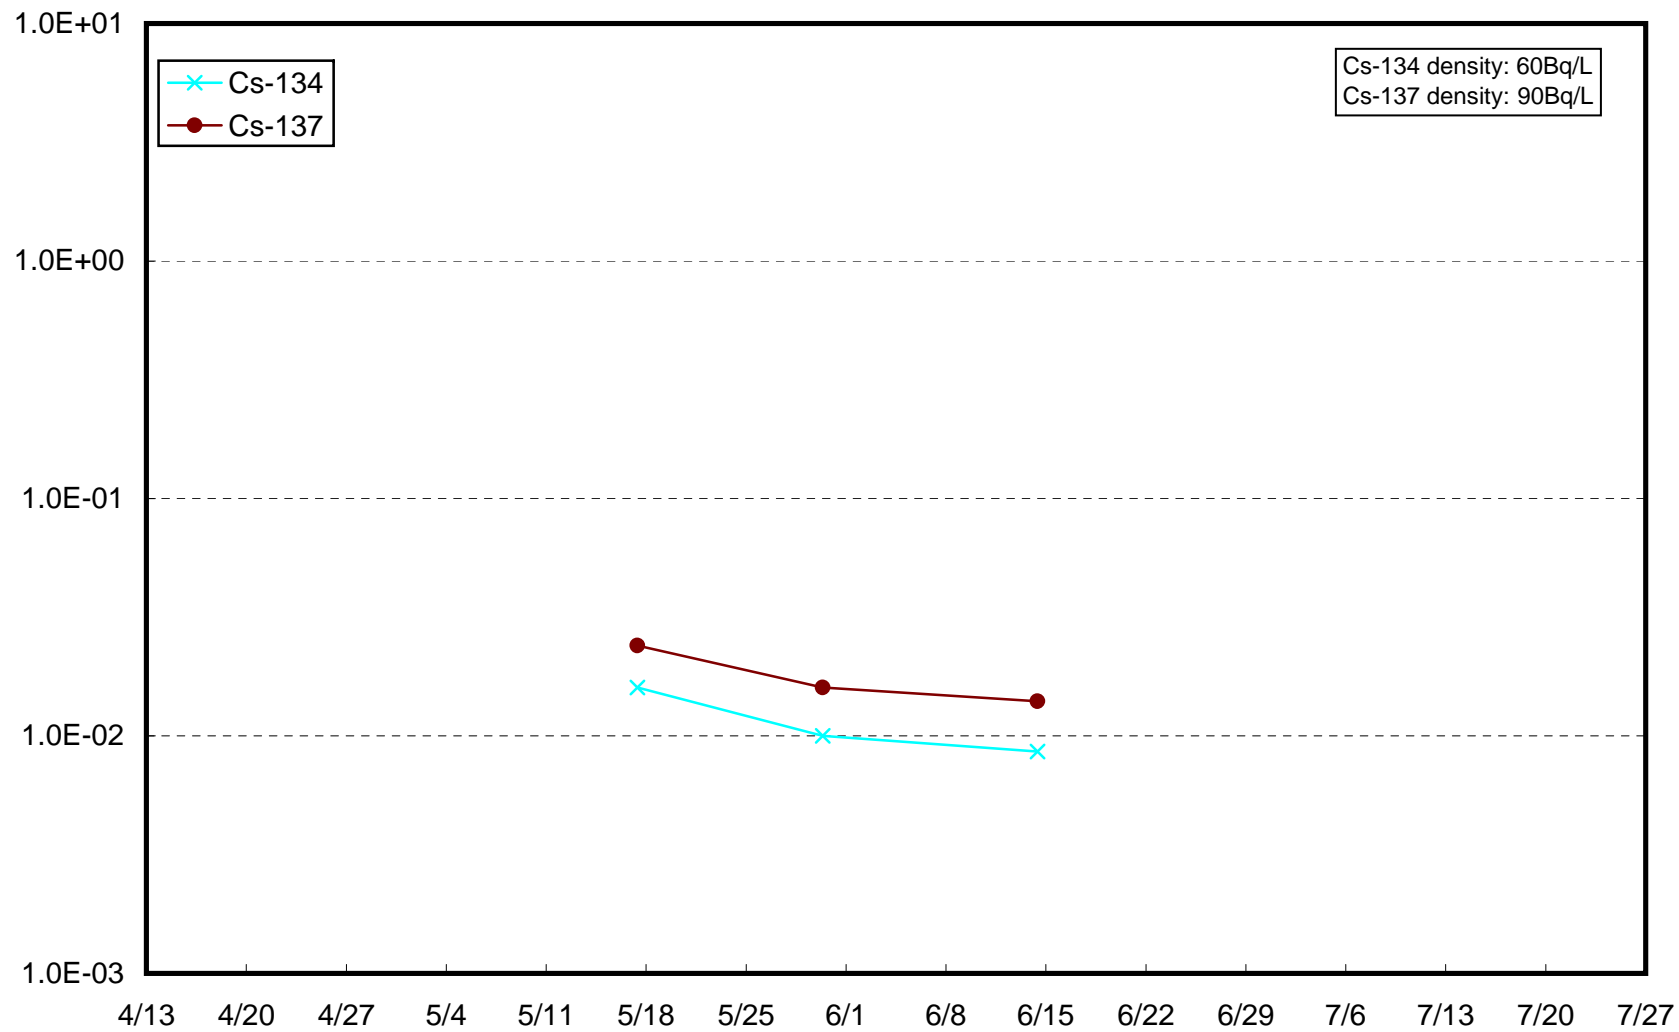

Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Lower Layer (Bq/L)

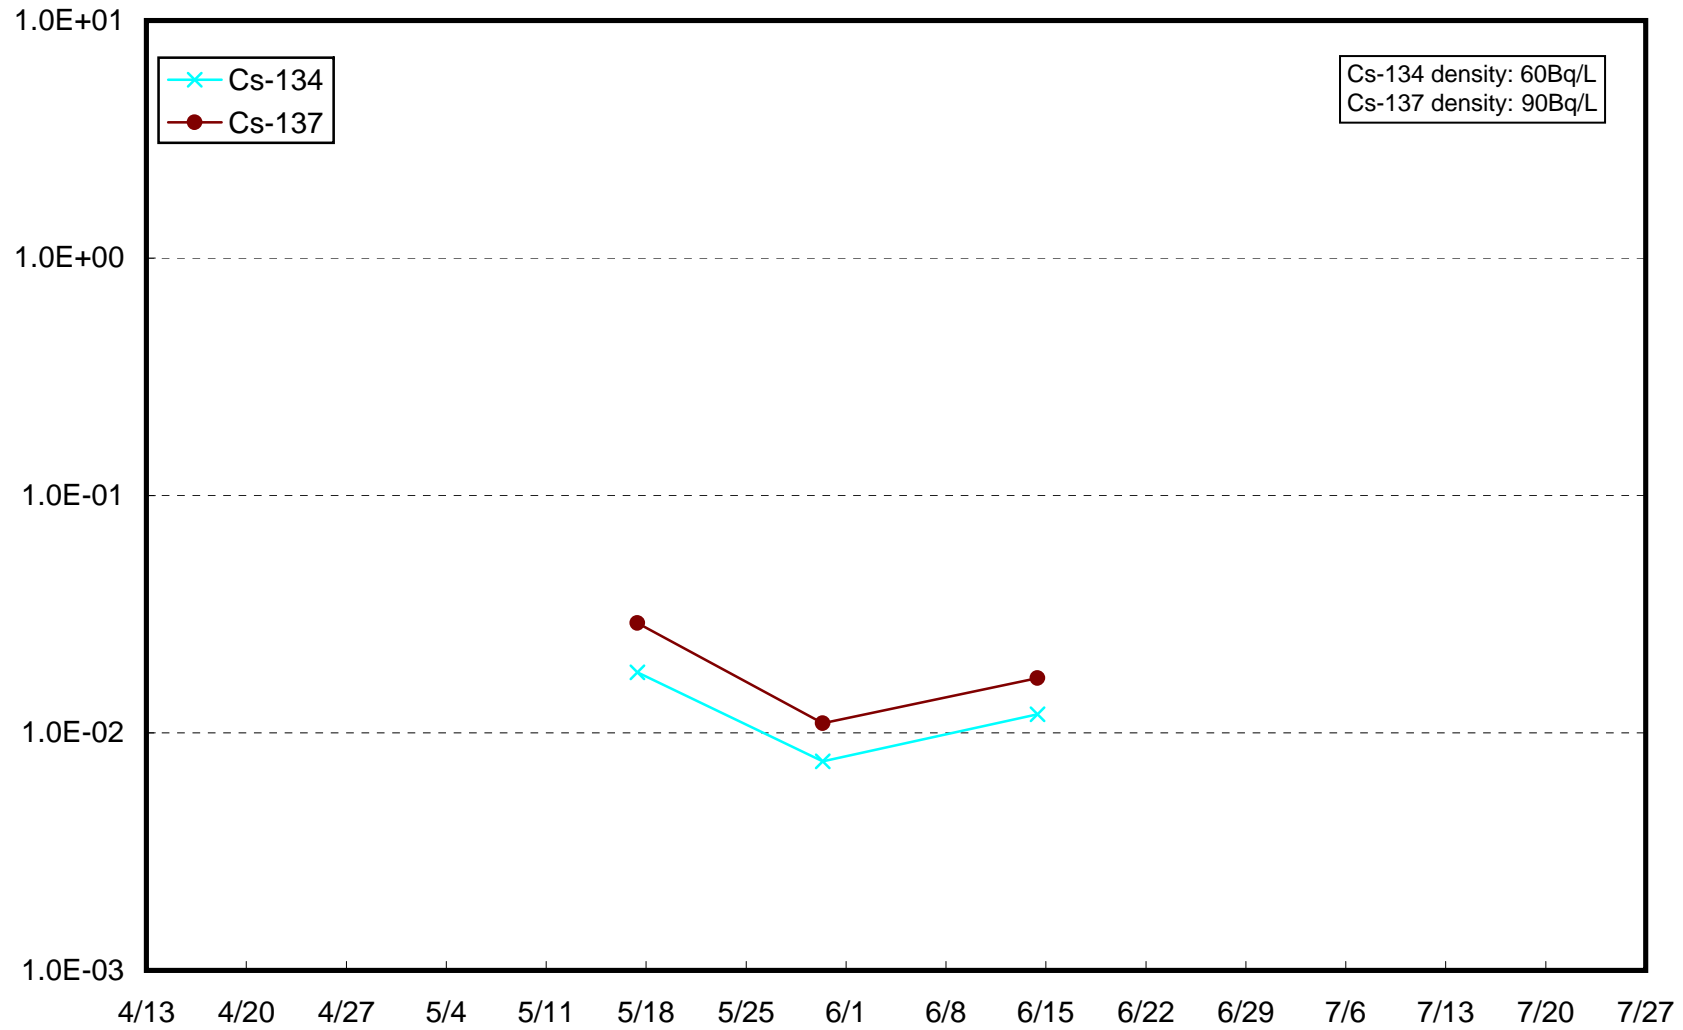

Radioactivity Density of the Seawater at 18km Offshore of Ukedo River (T-B2) Upper Layer (Bq/L)

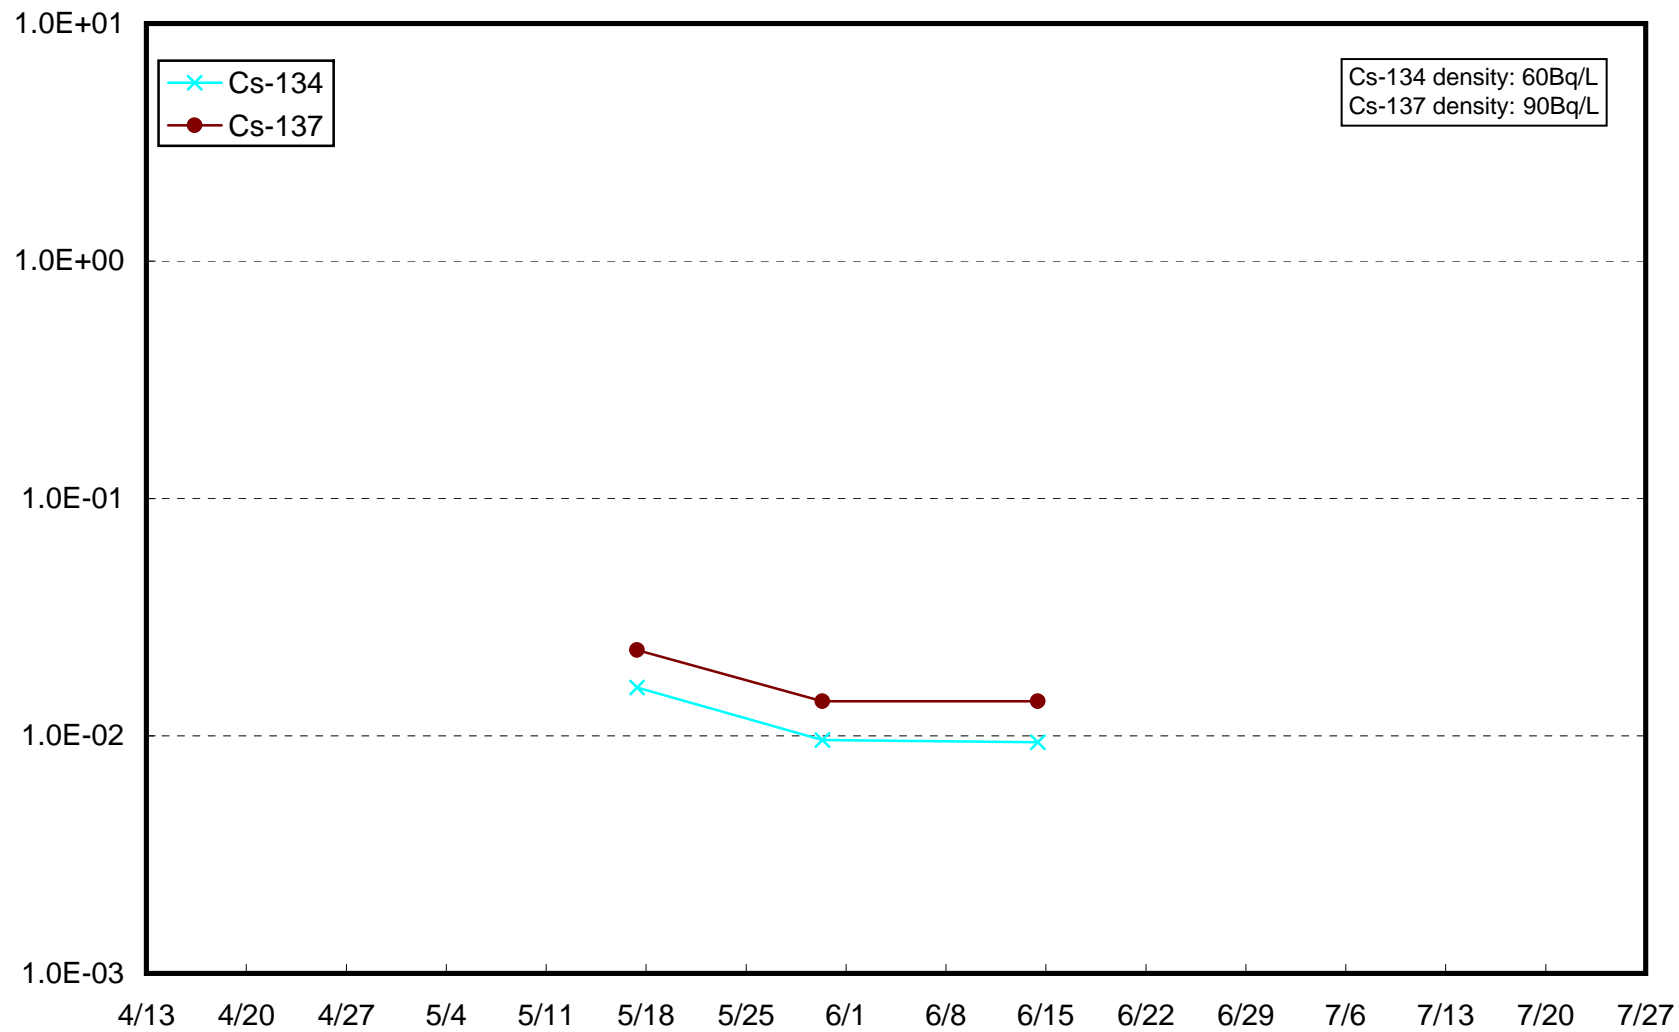

Radioactivity Density of the Seawater at 18km Offshore of Ukedo River (T-B2) Lower Layer (Bq/L)

