

Reference

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on August 2)

Place of Sampling	North of Unit 5-6 Discharge Channel at 1F (Approx. 30m North of Unit 5-6 Discharge Channel)	Scaling Factor (/)	Around 1F South Discharge Channel of 1F (Approx. 330m South of Unit 1-4 Discharge Channel)	Scaling Factor (/)	Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Time of Sampling	Aug 1, 2012 7:35 AM		Aug 1, 2012 7:10 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	ND	-	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.51Bq/L, Cs-134: Approx.1.2Bq/L, Cs-137: Approx.1.6Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of Radioactive Materials in the Seawater < Offshore >

(Data summarized on August 2)

Place of Sampling (Place No.)	3km Offshore of Ukedo River (T-D1)				3km Offshore of Fukushima Daiichi NPS (T-D5)				3km Offshore of Fukushima Daini NPS (T-D9)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jul 3, 2012 8:25 AM		Jul 3, 2012 8:25 AM		Jul 3, 2012 7:55 AM		Jul 3, 2012 7:55 AM		Jul 4, 2012 7:20 AM		Jul 4, 2012 7:20 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.042	0.00	0.067	0.00	0.029	0.00	0.086	0.00	0.027	0.00	0.022	0.00	60
Cs-137 (Approx. 30 years)	0.064	0.00	0.10	0.00	0.045	0.00	0.13	0.00	0.046	0.00	0.032	0.00	90


Place of Sampling (Place No.)	3km Offshore of Ukedo River (T-D1)				3km Offshore of Fukushima Daiichi NPS (T-D5)				3km Offshore of Fukushima Daini NPS (T-D9)				Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jul 10, 2012 8:50 AM		Jul 10, 2012 8:50 AM		Jul 10, 2012 8:15 AM		Jul 10, 2012 8:15 AM		Jul 11, 2012 7:50 AM		Jul 11, 2012 7:50 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Cs-134 (Approx. 2 years)	0.052	0.00	0.063	0.00	0.11	0.00	0.041	0.00	0.055	0.00	0.019	0.00	60
Cs-137 (Approx. 30 years)	0.081	0.00	0.087	0.00	0.18	0.00	0.062	0.00	0.079	0.00	0.031	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.


* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analyzed by Tokyo Electric Power Environmental Engineering Co., Inc.


Radioactivity Density of the Seawater at the North of 1F Unit 5-6 Discharge Channel (Bq/L)

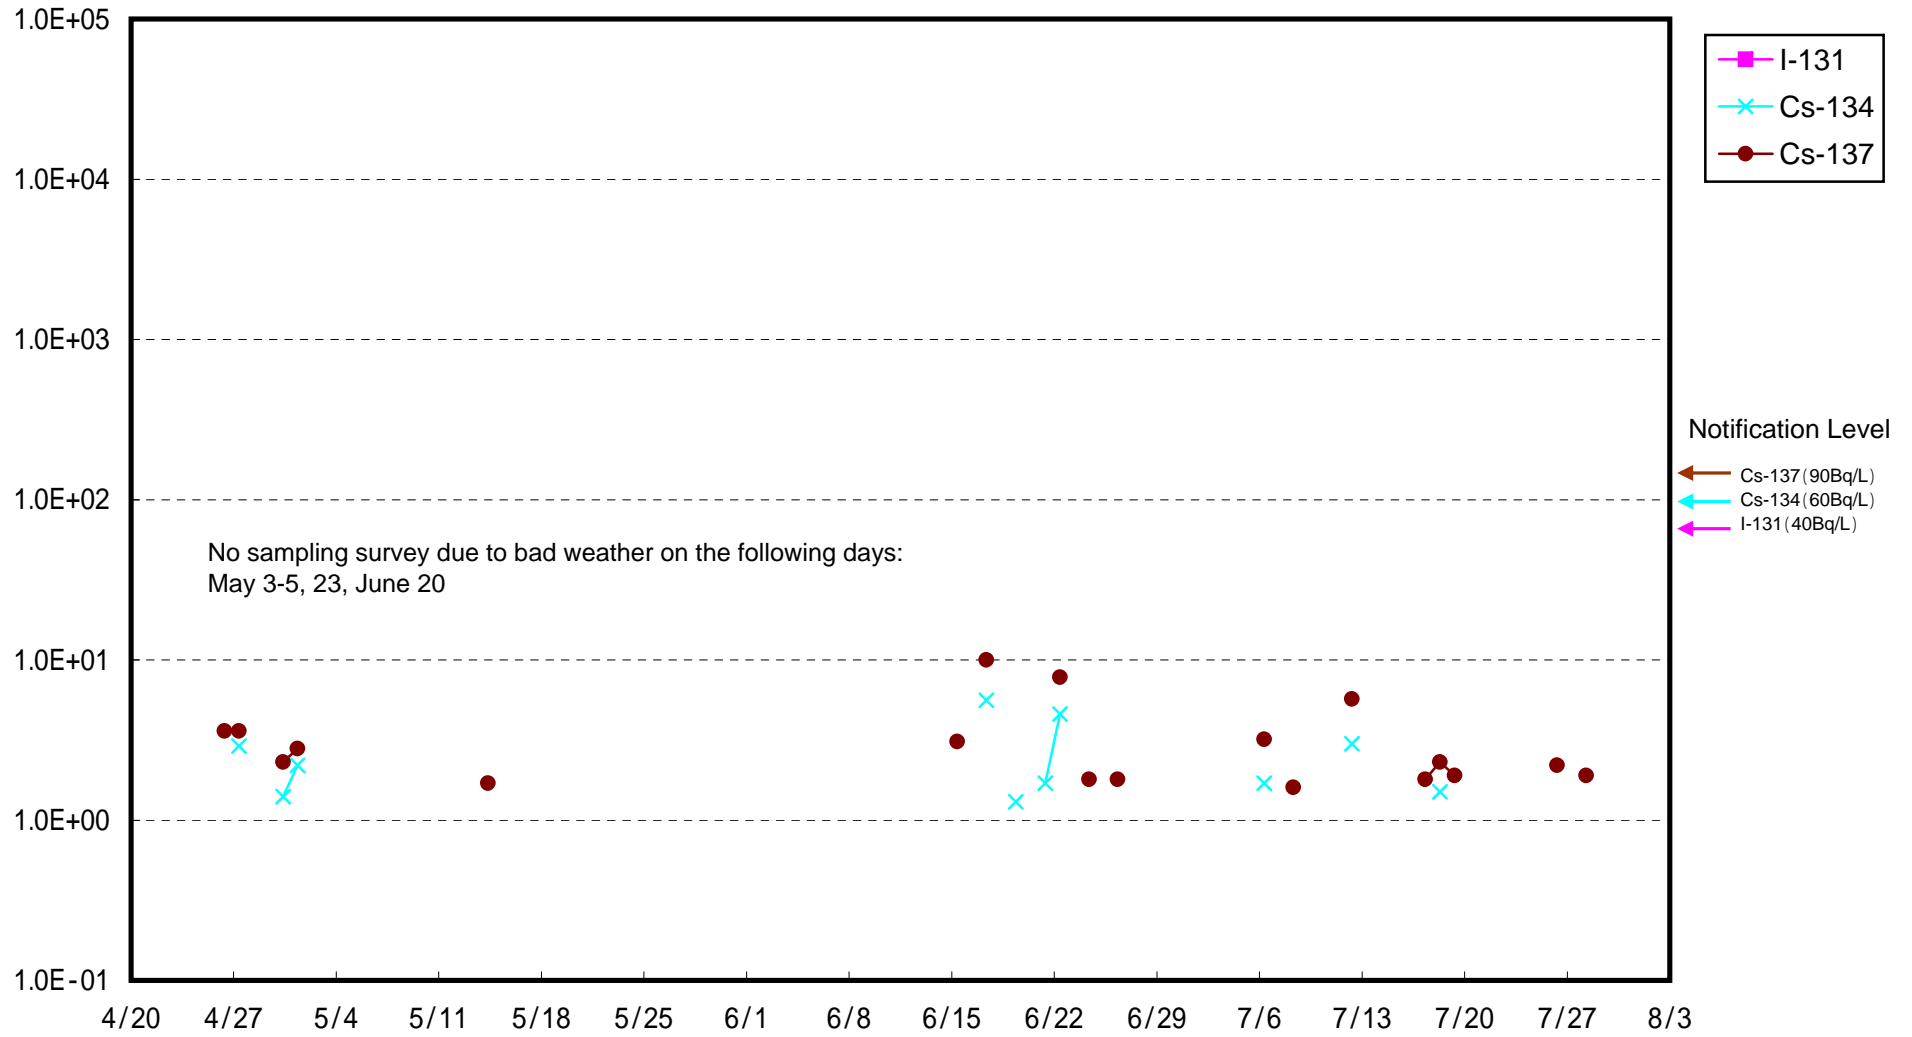


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

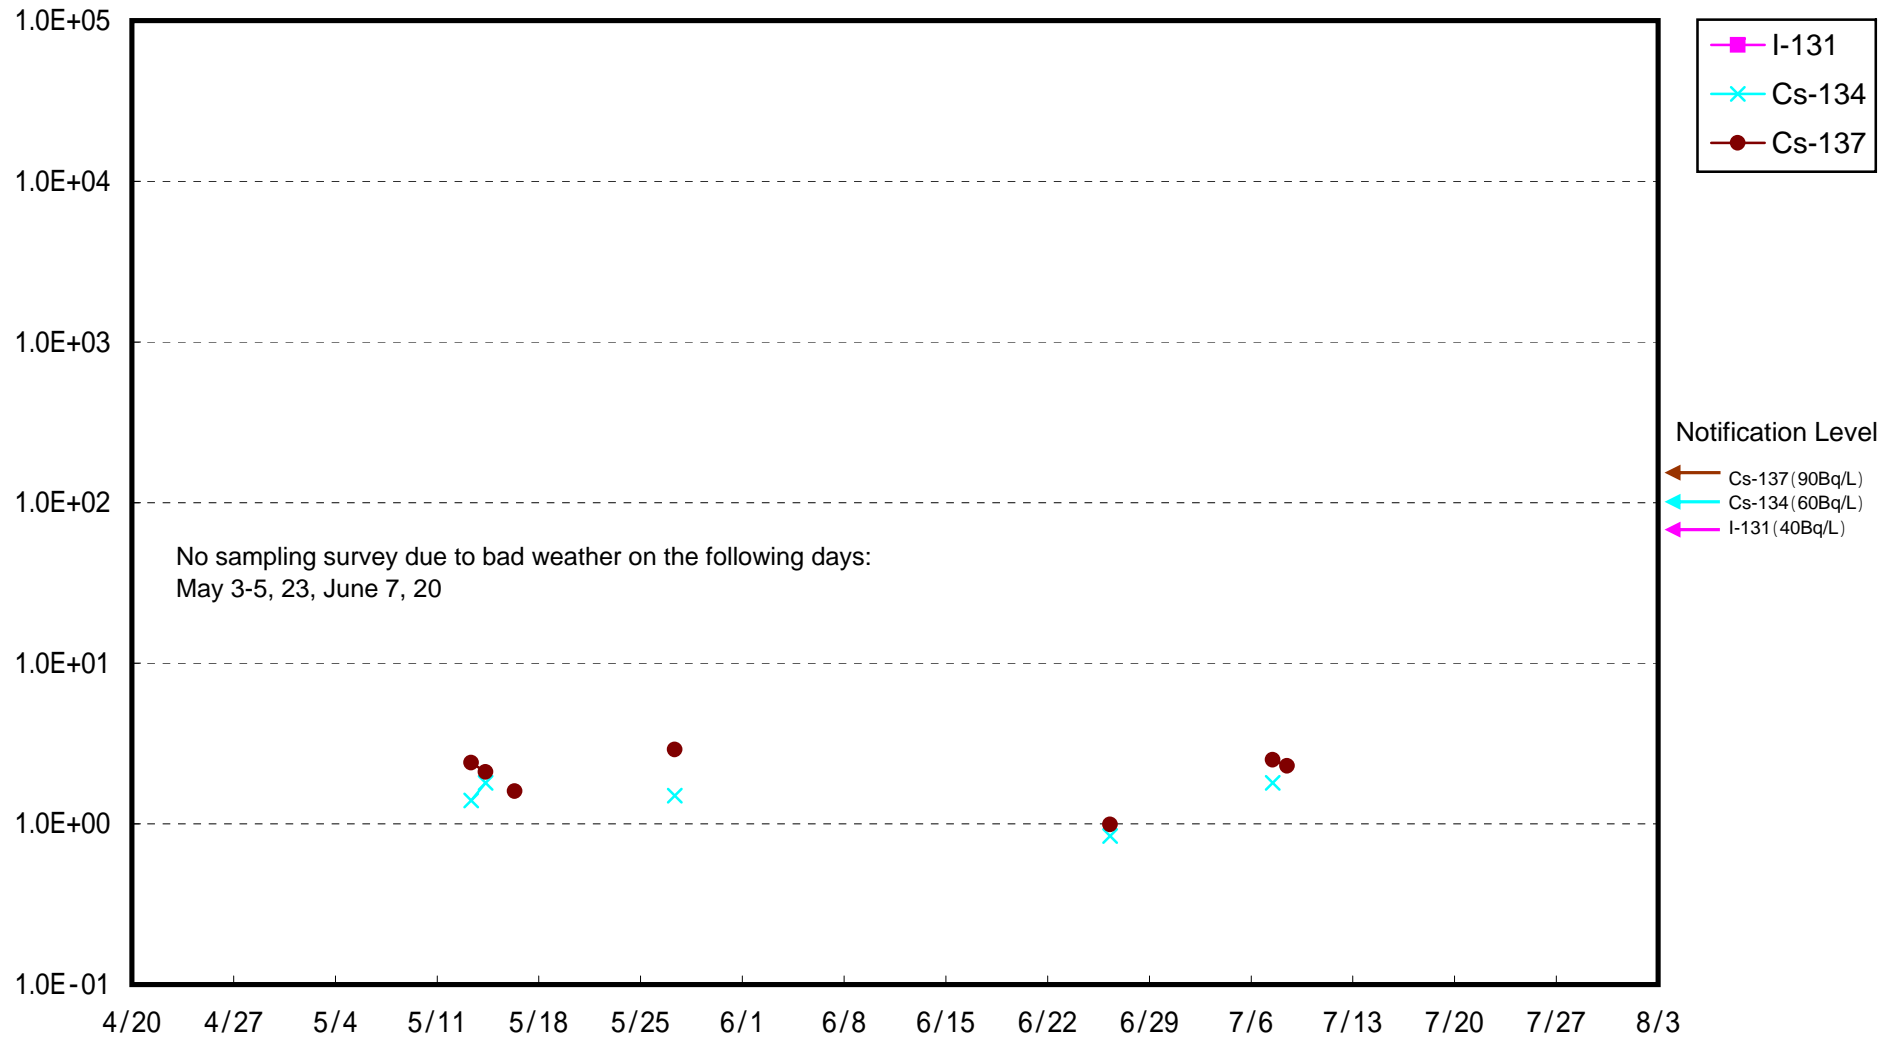


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Upper Layer (Bq/L)

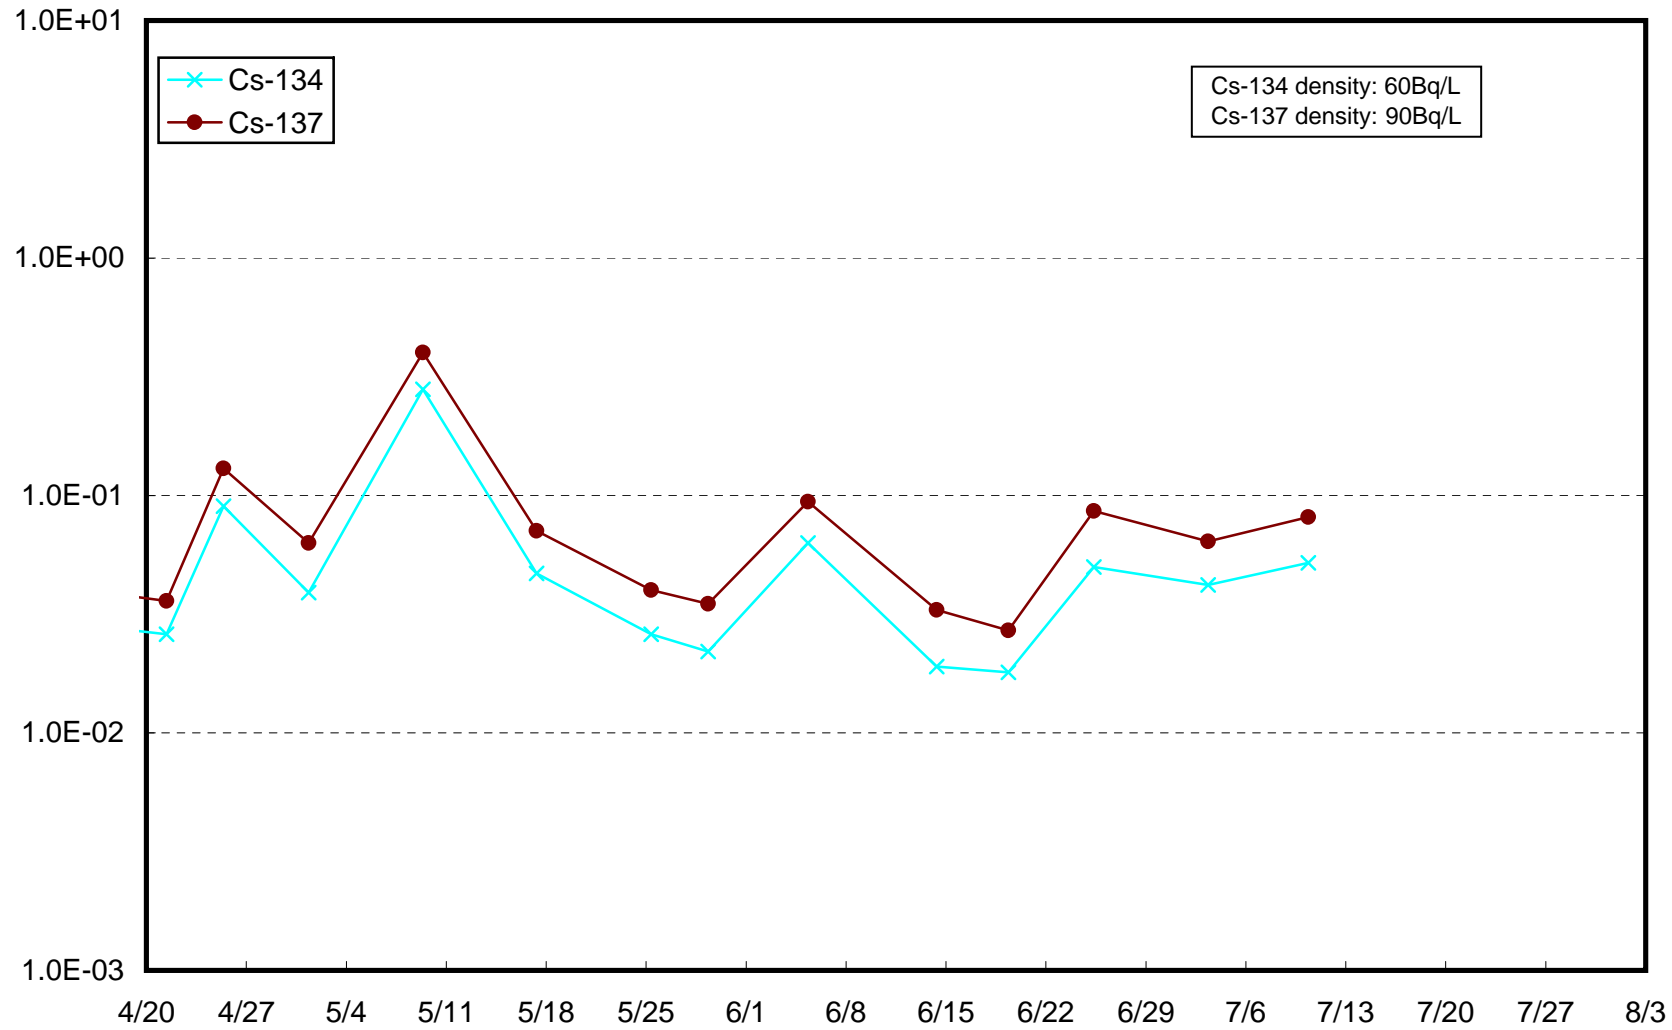


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Lower Layer (Bq/L)

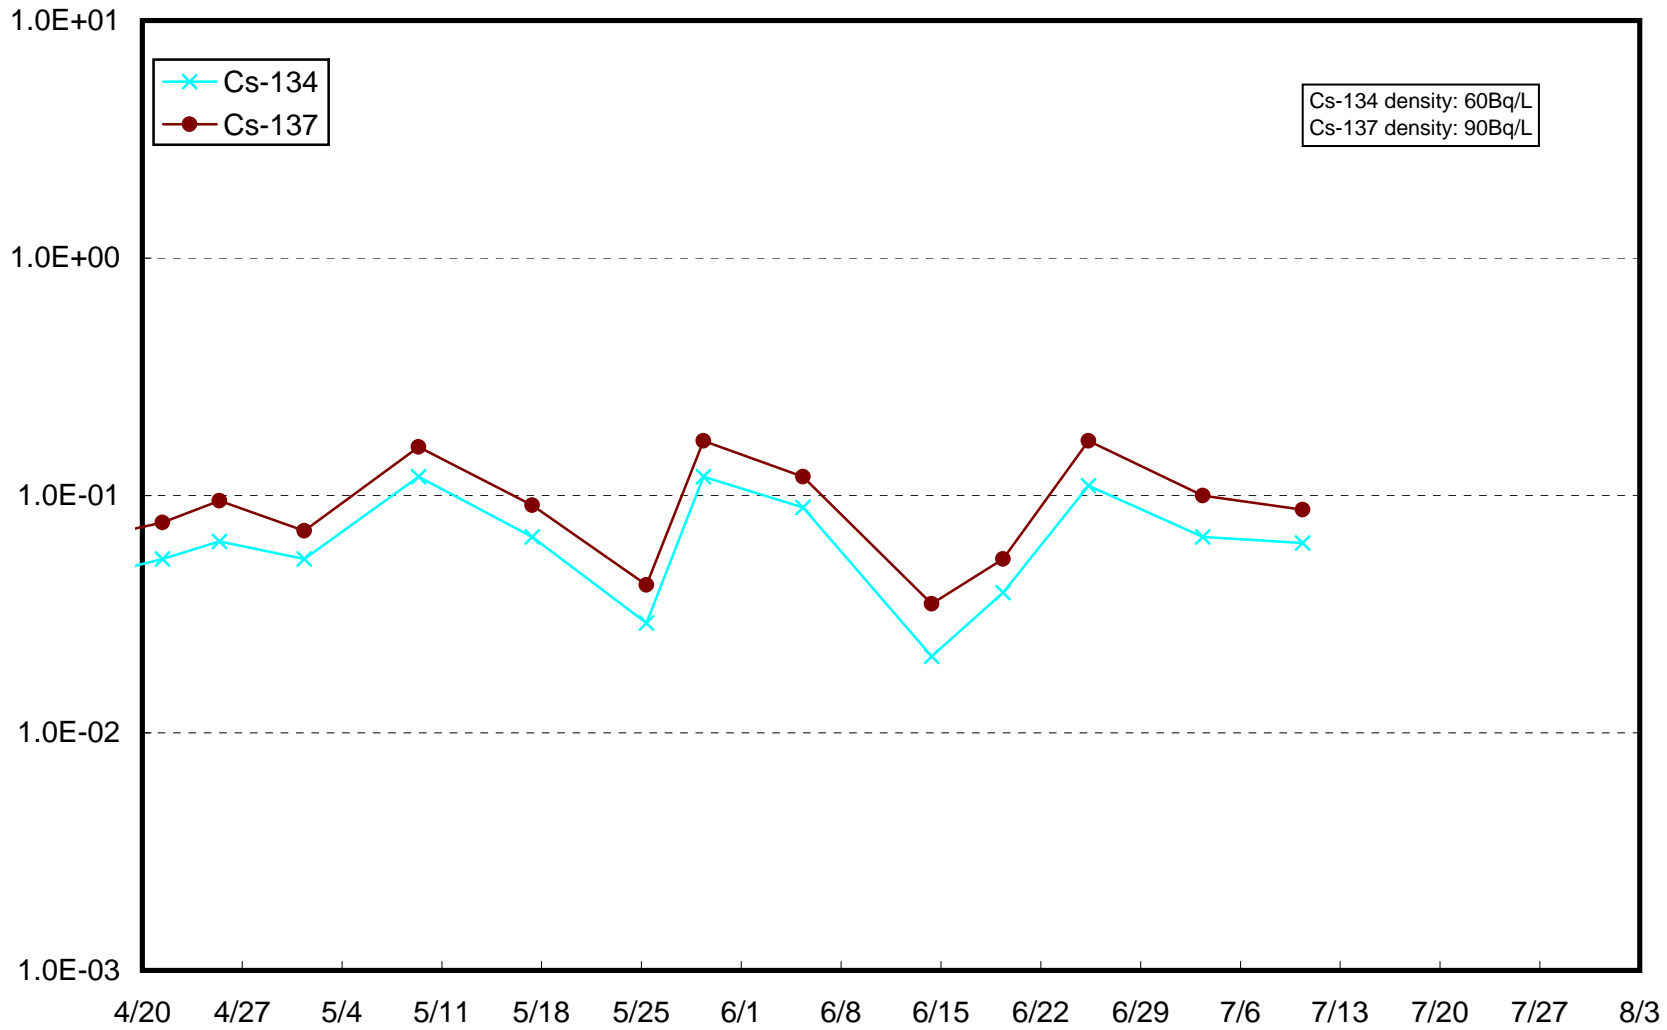

Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer (Bq/L)

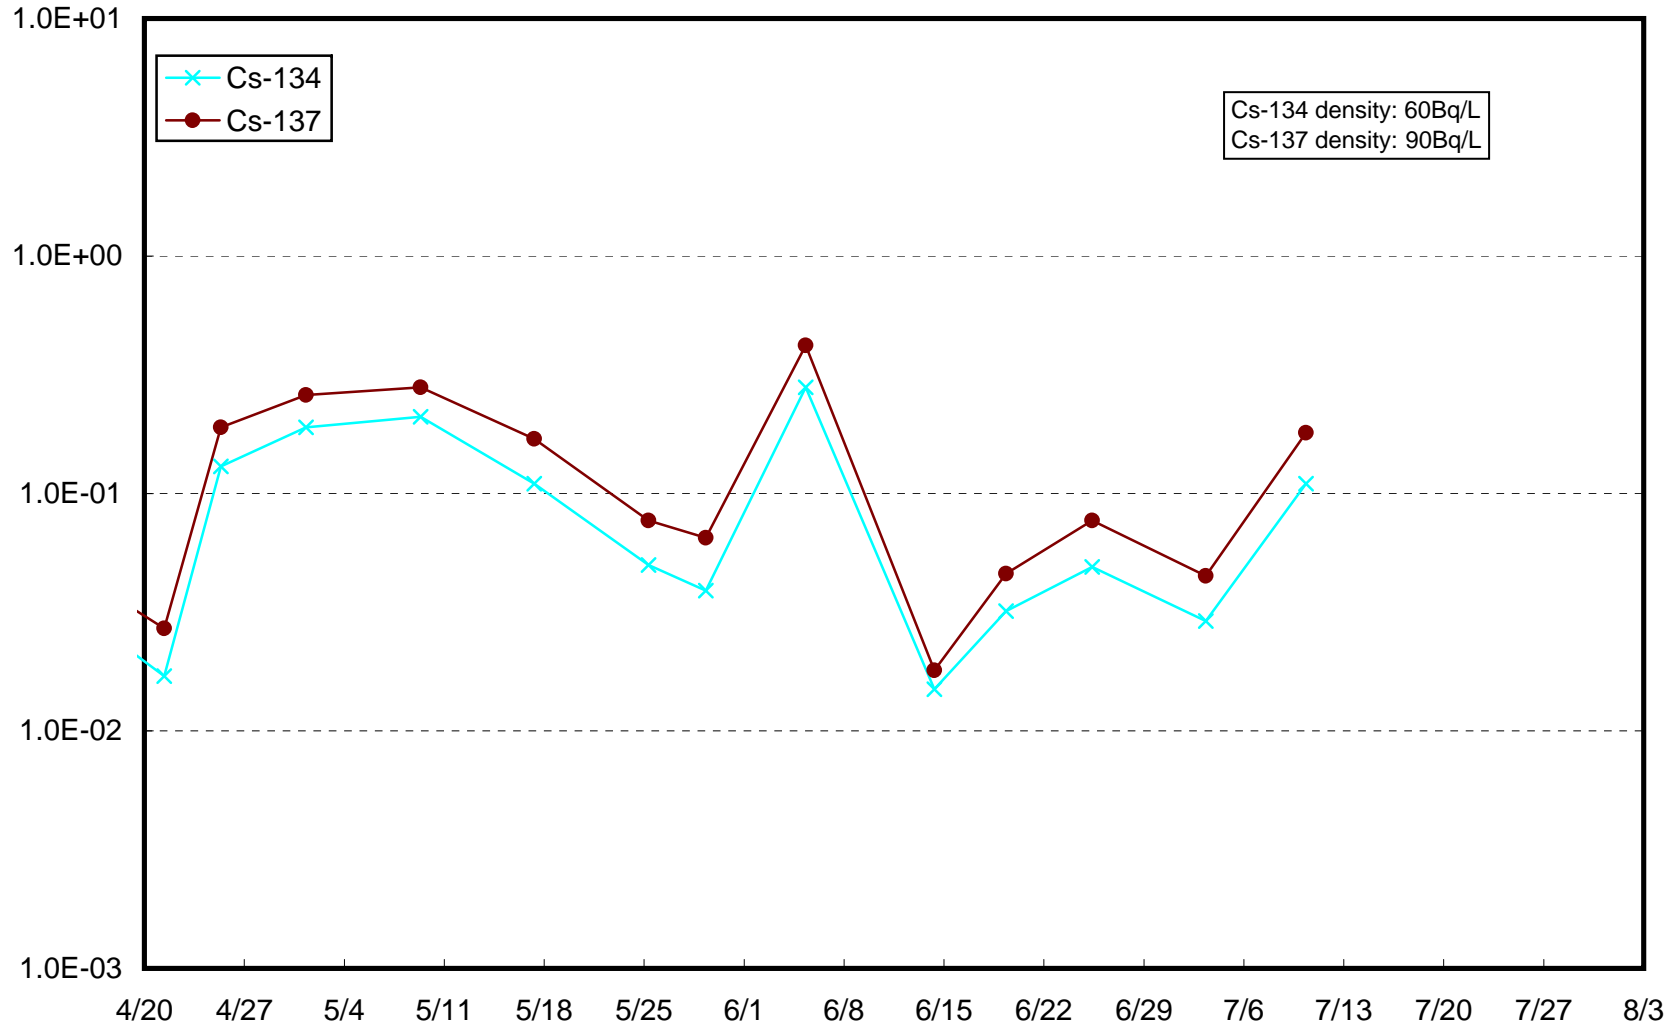

Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Lower Layer (Bq/L)

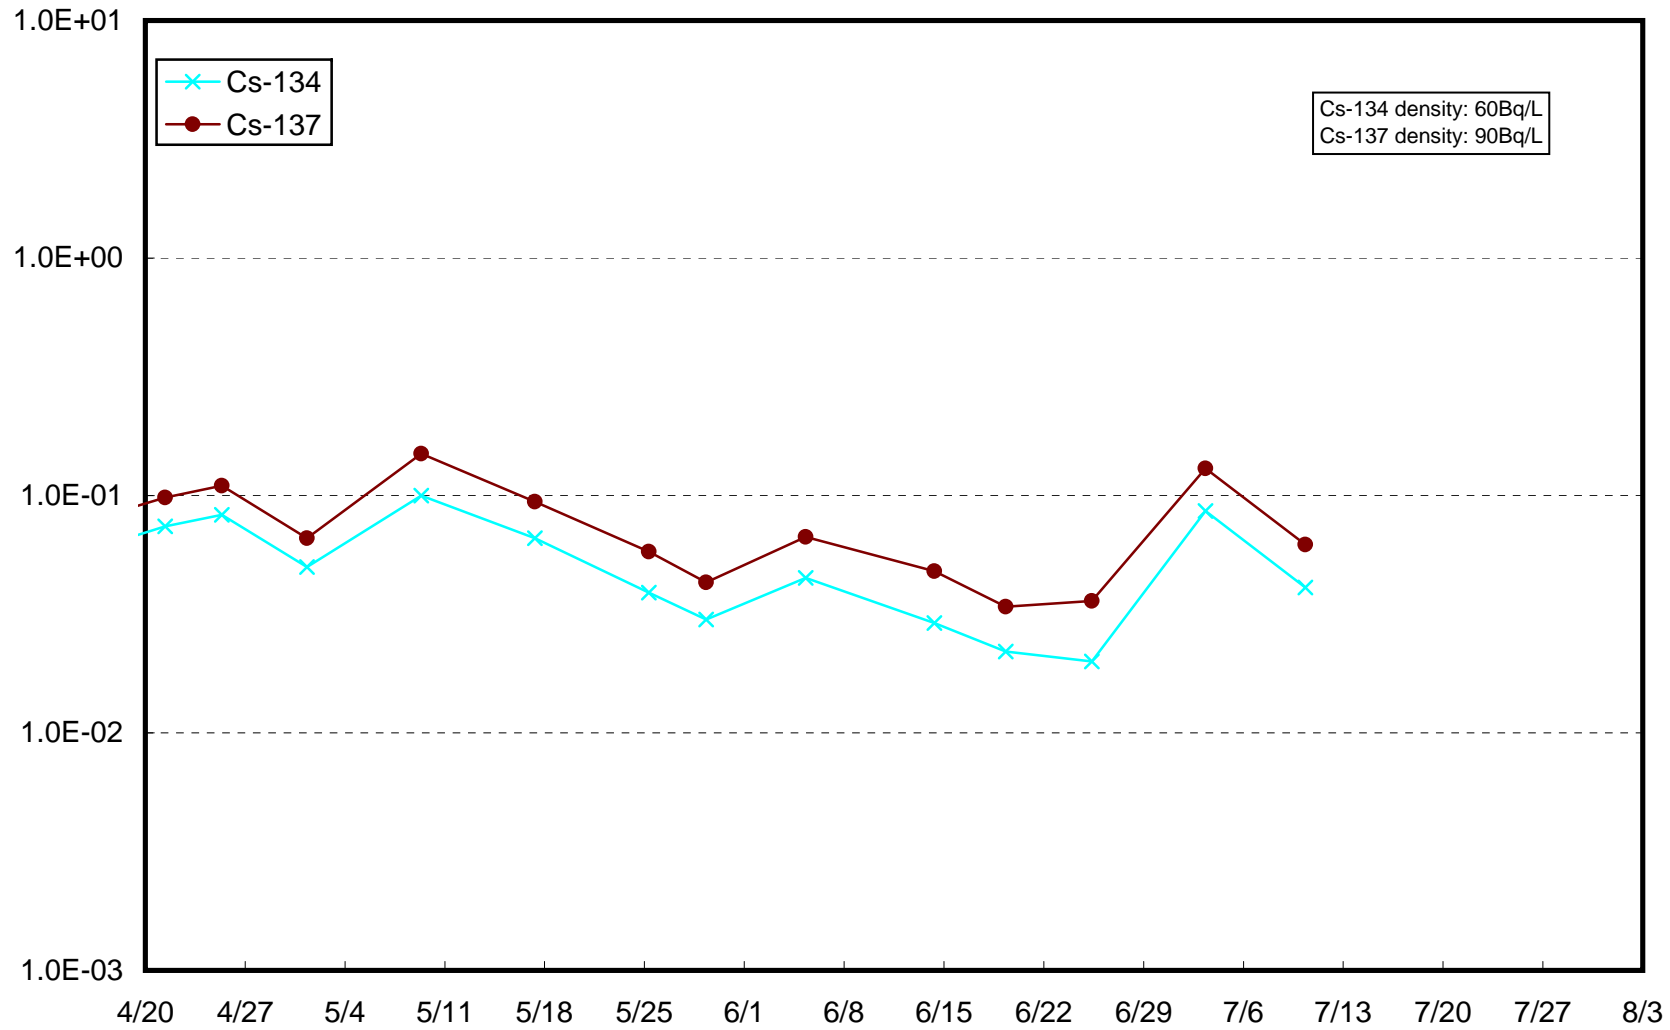

Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer (Bq/L)



Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Lower Layer (Bq/L)

