

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on August 29)

Place of Sampling	North of Unit 5-6 Discharge Channel at 1F (Approx. 30m North of Unit 5-6 Discharge Channel)		Around 1F South Discharge Channel of 1F (Approx. 330m South of Unit 1-4 Discharge Channel)		Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
Time of Sampling	Aug 28, 2012 7:25 AM		Aug 28, 2012 7:05 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	2.1	0.04	ND	-	60
Cs-137 (Approx. 30 years)	5.4	0.06	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.55Bq/L, Cs-134: Approx.1.1Bq/L, Cs-137: Approx.1.4Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >

(Data summarized on August 29)

Place of Sampling	North of Unit 5-6 Discharge Channel at 1F (Approx. 30m North of Unit 5-6 Discharge Channel)		Around 1F South Discharge Channel of 1F (Approx. 330m South of Unit 1-4 Discharge Channel)		Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Time of Sampling	Aug 13, 2012 7:40 AM		Aug 13, 2012 6:50 AM		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	1.6	0.03	0.63	0.01	60
Cs-137 (Approx. 30 years)	2.3	0.03	0.93	0.01	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.33Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of Radioactive Materials in the Seawater

(Data summarized on August 29)

Place of Sampling (Place No.)	Central Area of Sendai Bay (T-MG5) Upper Layer		3km Offshore of Oarai Shore (T-C) Upper Layer		/		Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Date of Sampling	May 25, 2012		May 17, 2012		/	
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	
I-131 (Approx. 8 days)	-	-	ND	-	/	/	40
Cs-134 (Approx. 2 years)	0.021	0.00	ND	-	/	/	60
Cs-137 (Approx. 30 years)	0.030	0.00	ND	-	/	/	90
Sr-89 (Approx. 51 days)	ND	-	ND	-	/	/	300
Sr-90 (Approx. 29 years)	0.011	0.00	0.018	0.00	/	/	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Radioactivity Density " - " means "not applicable".

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* I-131, Cs-134, Cs-137: announced on May 22, July 26

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 0.70Bq/L , Cs-134: Approx.1.1Bq/L , Cs-137: Approx.1.1Bq/L , Sr-89: Approx. 0.02Bq/L


As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis was done by Japan Chemical Analysis Center.

(Evaluation)

Although Sr-90 was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

Radioactivity Density of the Seawater at the North of 1F Unit 5-6 Discharge Channel (Bq/L)

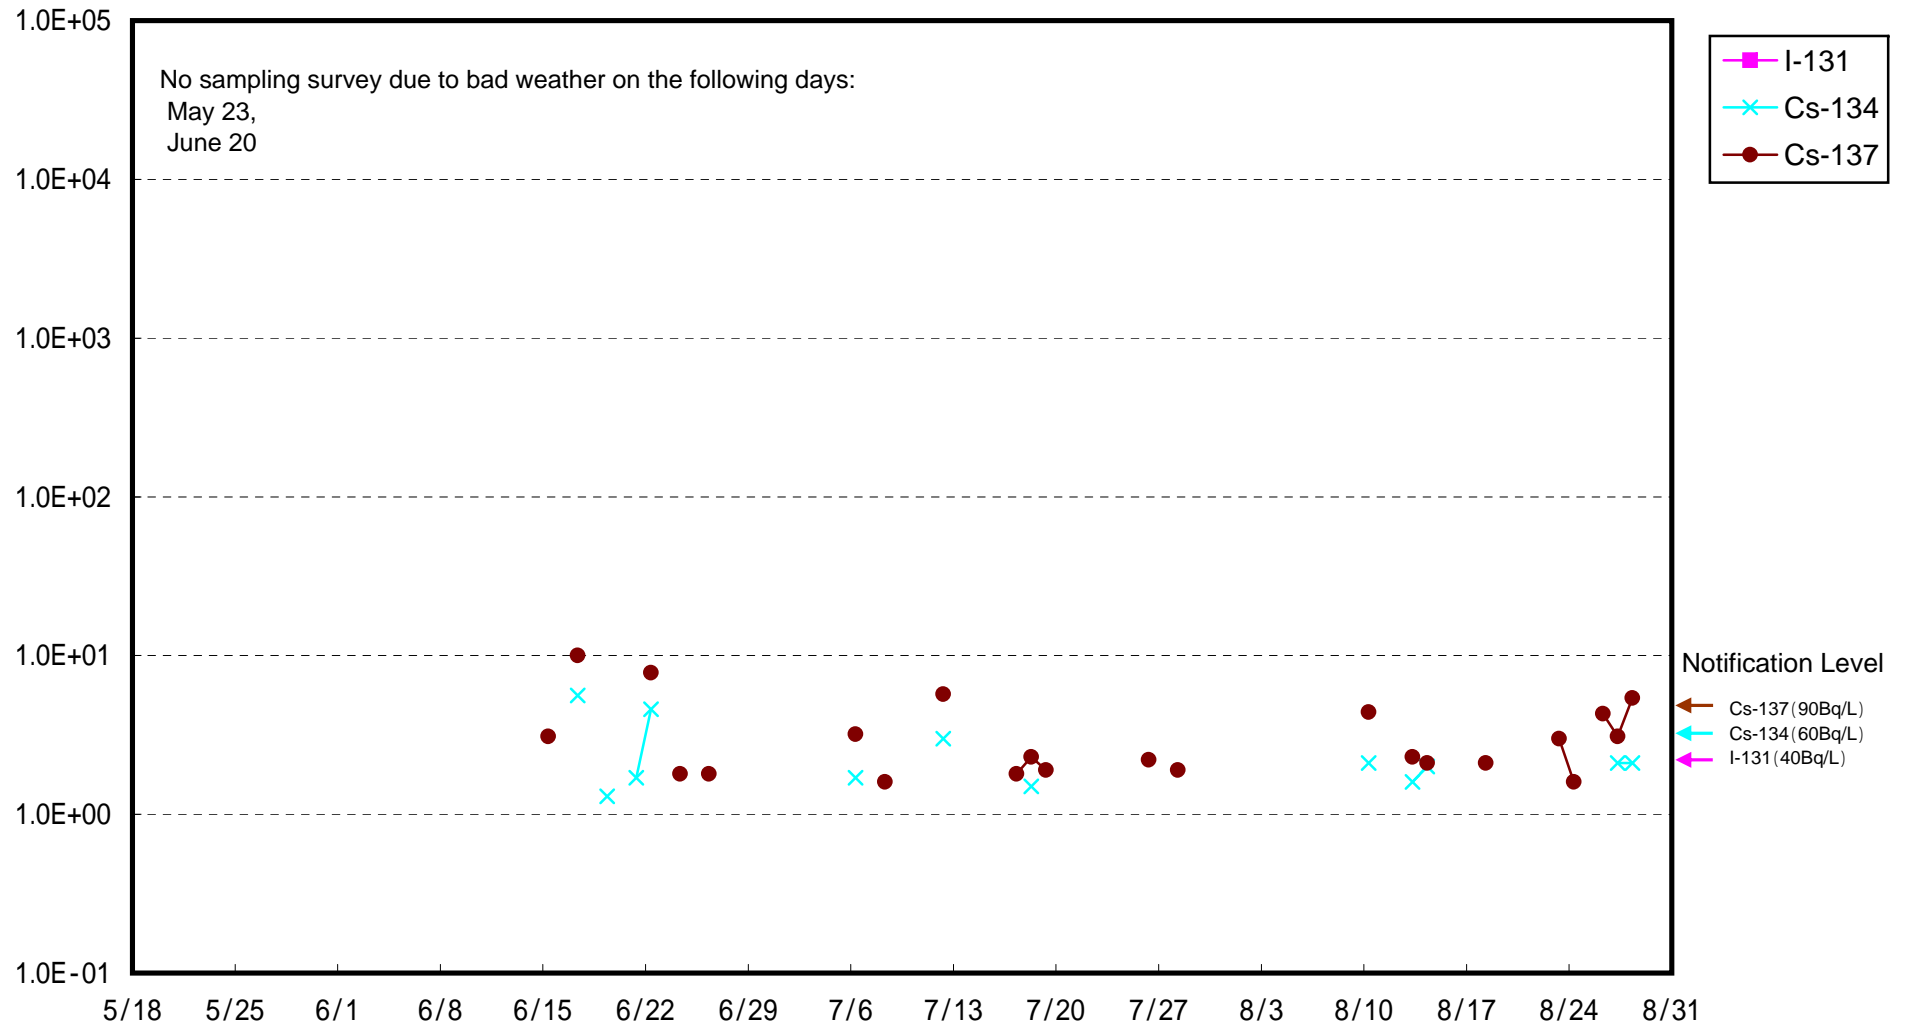

Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

