

Result of nuclide analysis of sub drain of Fukushima Daiichi NPS

Reference

(Data summarized on February 4)

Place of Sampling	Fukushima Daiichi NPS 1U sub-drain	Fukushima Daiichi NPS 2U sub-drain	Fukushima Daiichi NPS 3U sub-drain	Fukushima Daiichi NPS 4U sub-drain	Fukushima Daiichi NPS 5U sub-drain	Fukushima Daiichi NPS 6U sub-drain	Fukushima Daiichi NPS Deep well
Time of Sampling	Feb 03, 2012 09:30 am	Feb 03, 2012 09:35 am	Feb 03, 2012 09:50 am	Feb 03, 2012 09:49 am	Feb 03, 2012 10:44 am	Feb 03, 2012 09:20 am	Feb 03, 2012 09:00 am
Detected Nuclides (Half-life)	Density of sample (Bq/cm3)						
I-131 (about 8 days)	ND	ND	ND	ND	ND	ND	ND
Cs-134 (about 2 years)	2.7E-01	1.0E+00	7.5E-02	ND	ND	ND	ND
Cs-137 (about 30 years)	4.0E-01	1.5E+00	9.9E-02	ND	ND	ND	ND

* 0.OE - 0 means 0.0 x 10⁻⁰


* Data of other nuclides are under evaluation.

* "ND" means the sampled data is below measurable limit.


I-131: approx. 3E-2Bq/cm³, Cs-134: approx. 2E-2Bq/cm³, Cs-137: approx. 3E-2Bq/cm³)

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.


Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 1 (Bq/cm³)

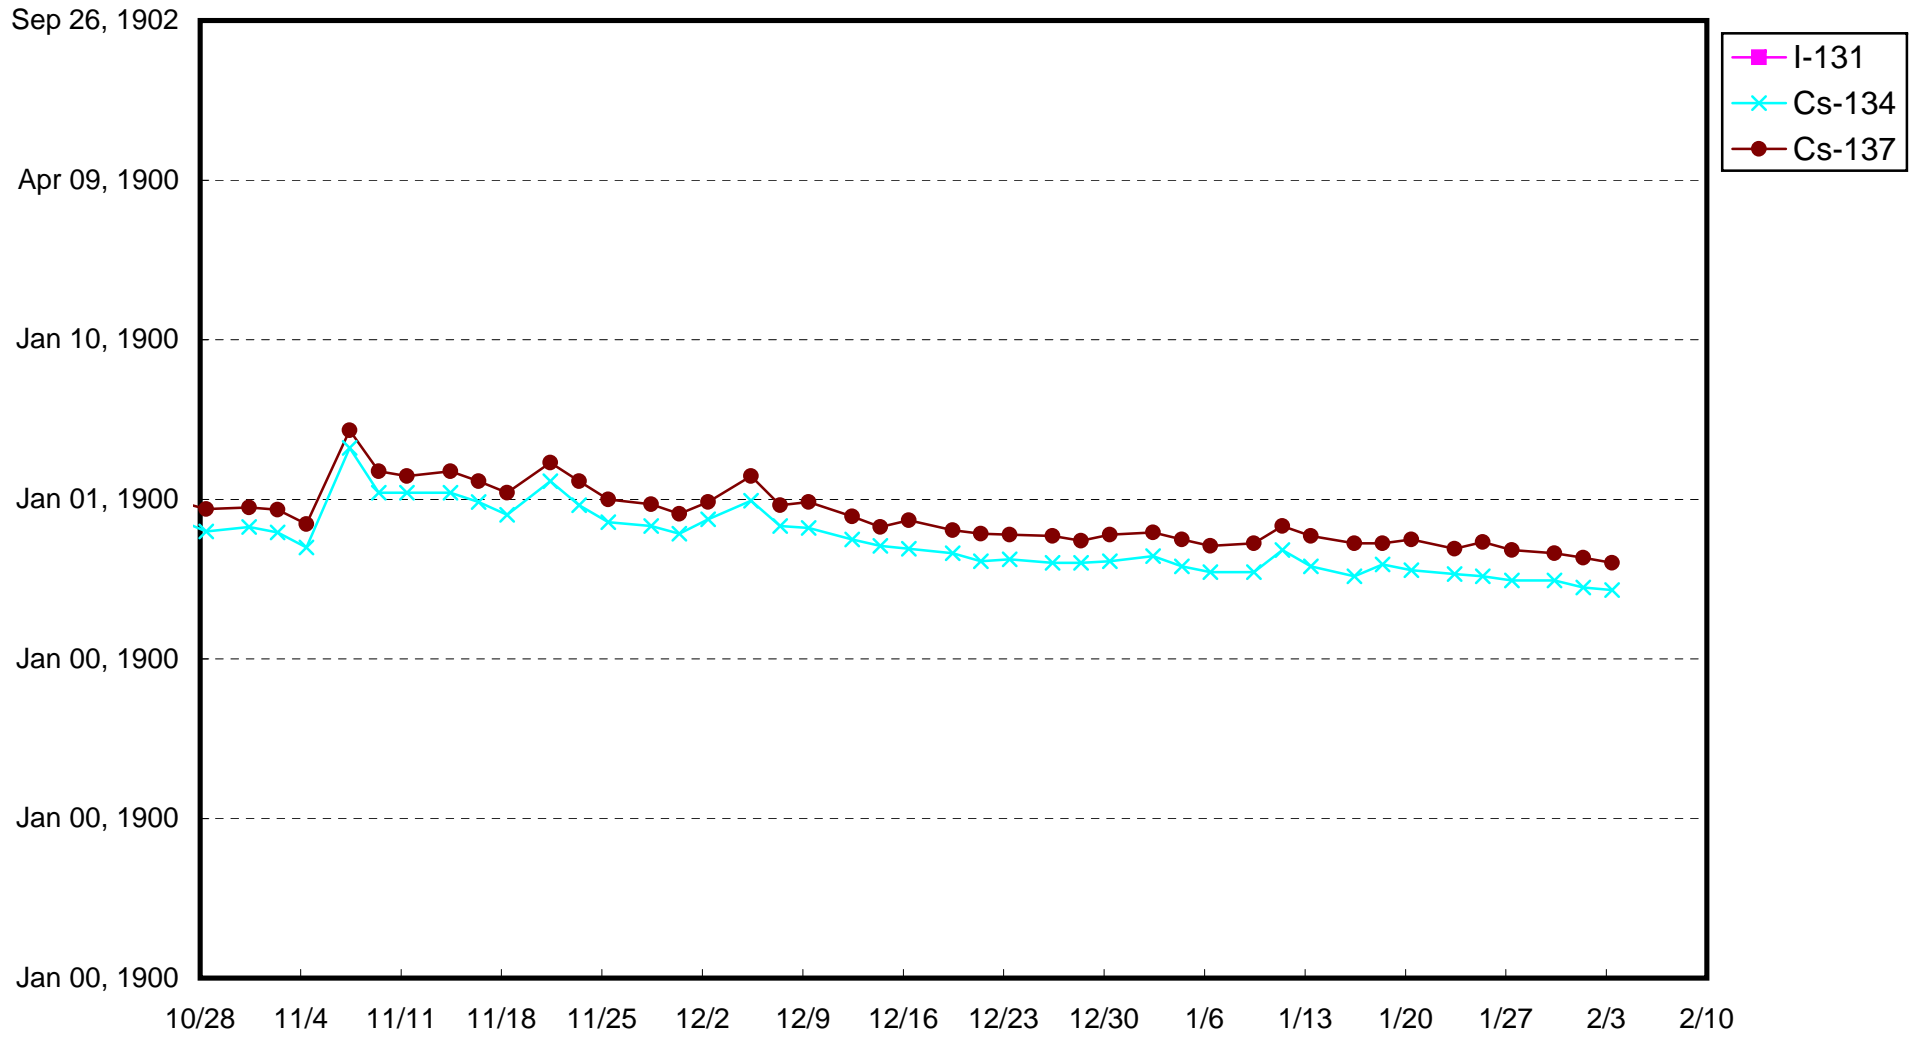


Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 2 (Bq/cm³)

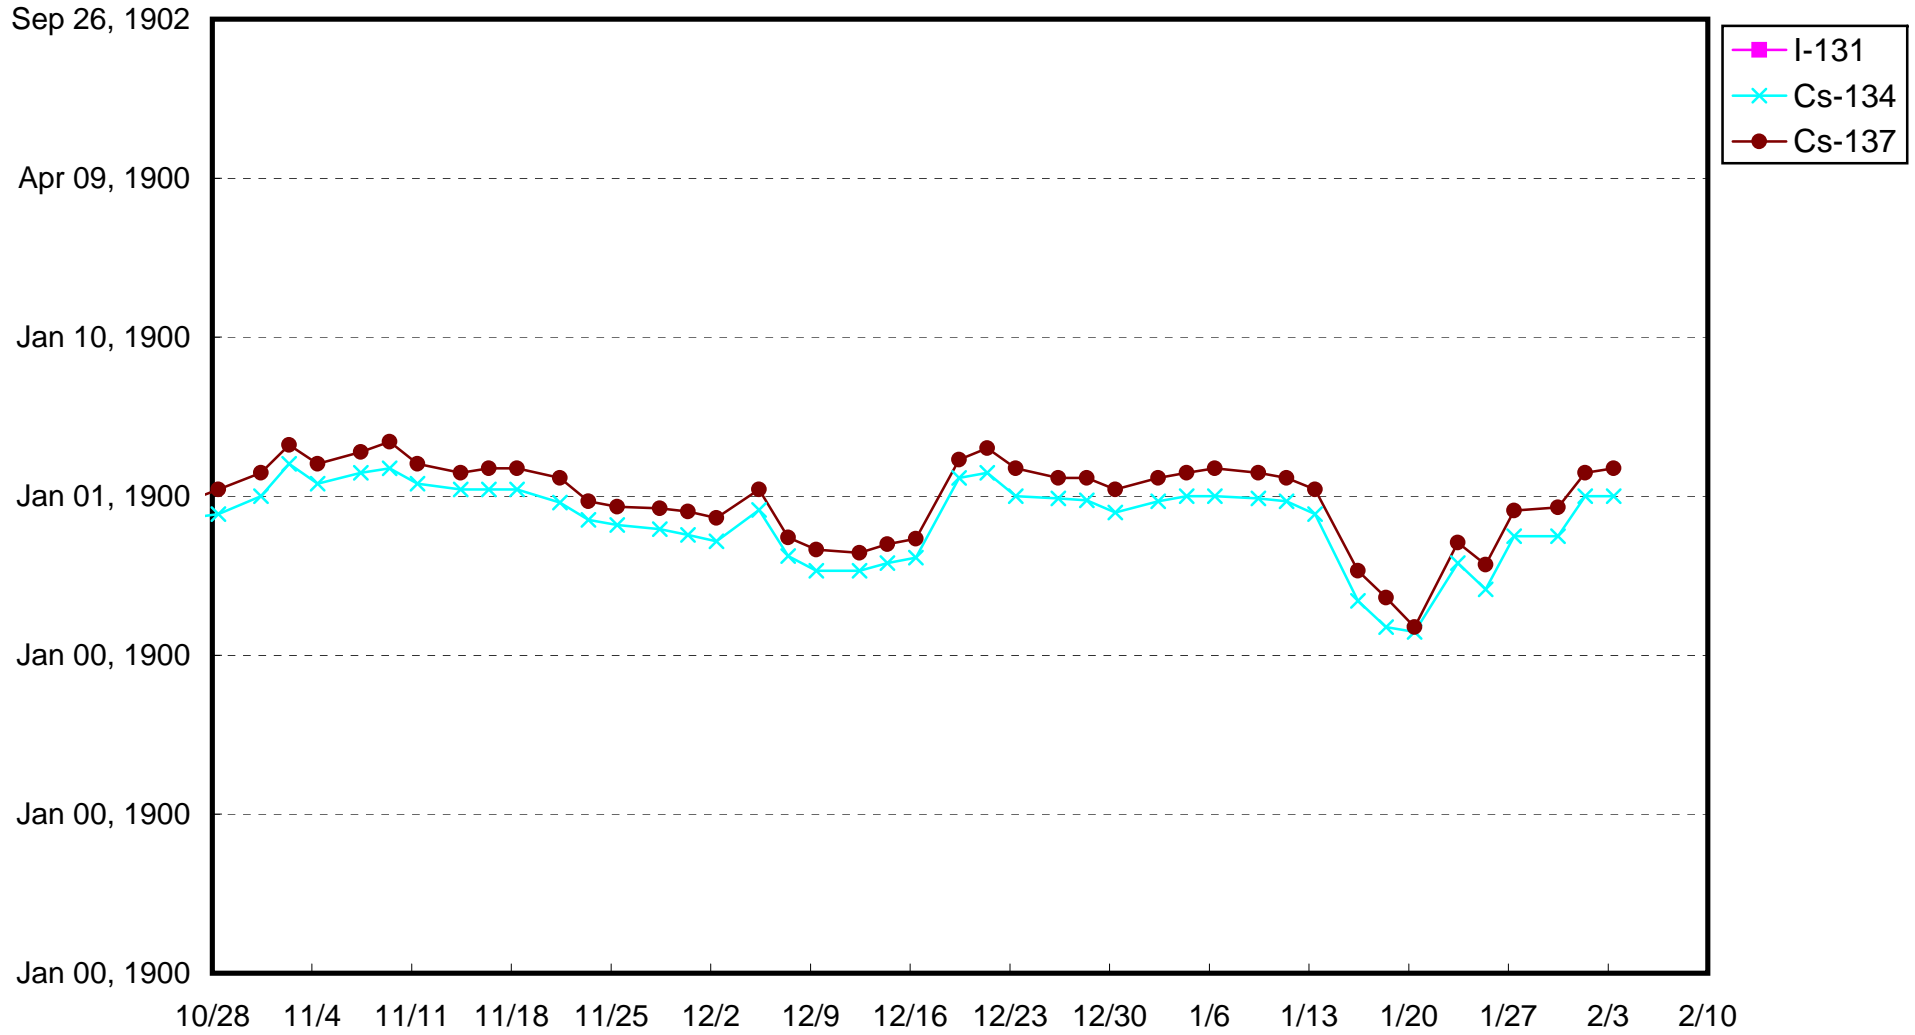


Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 3 (Bq/cm³)

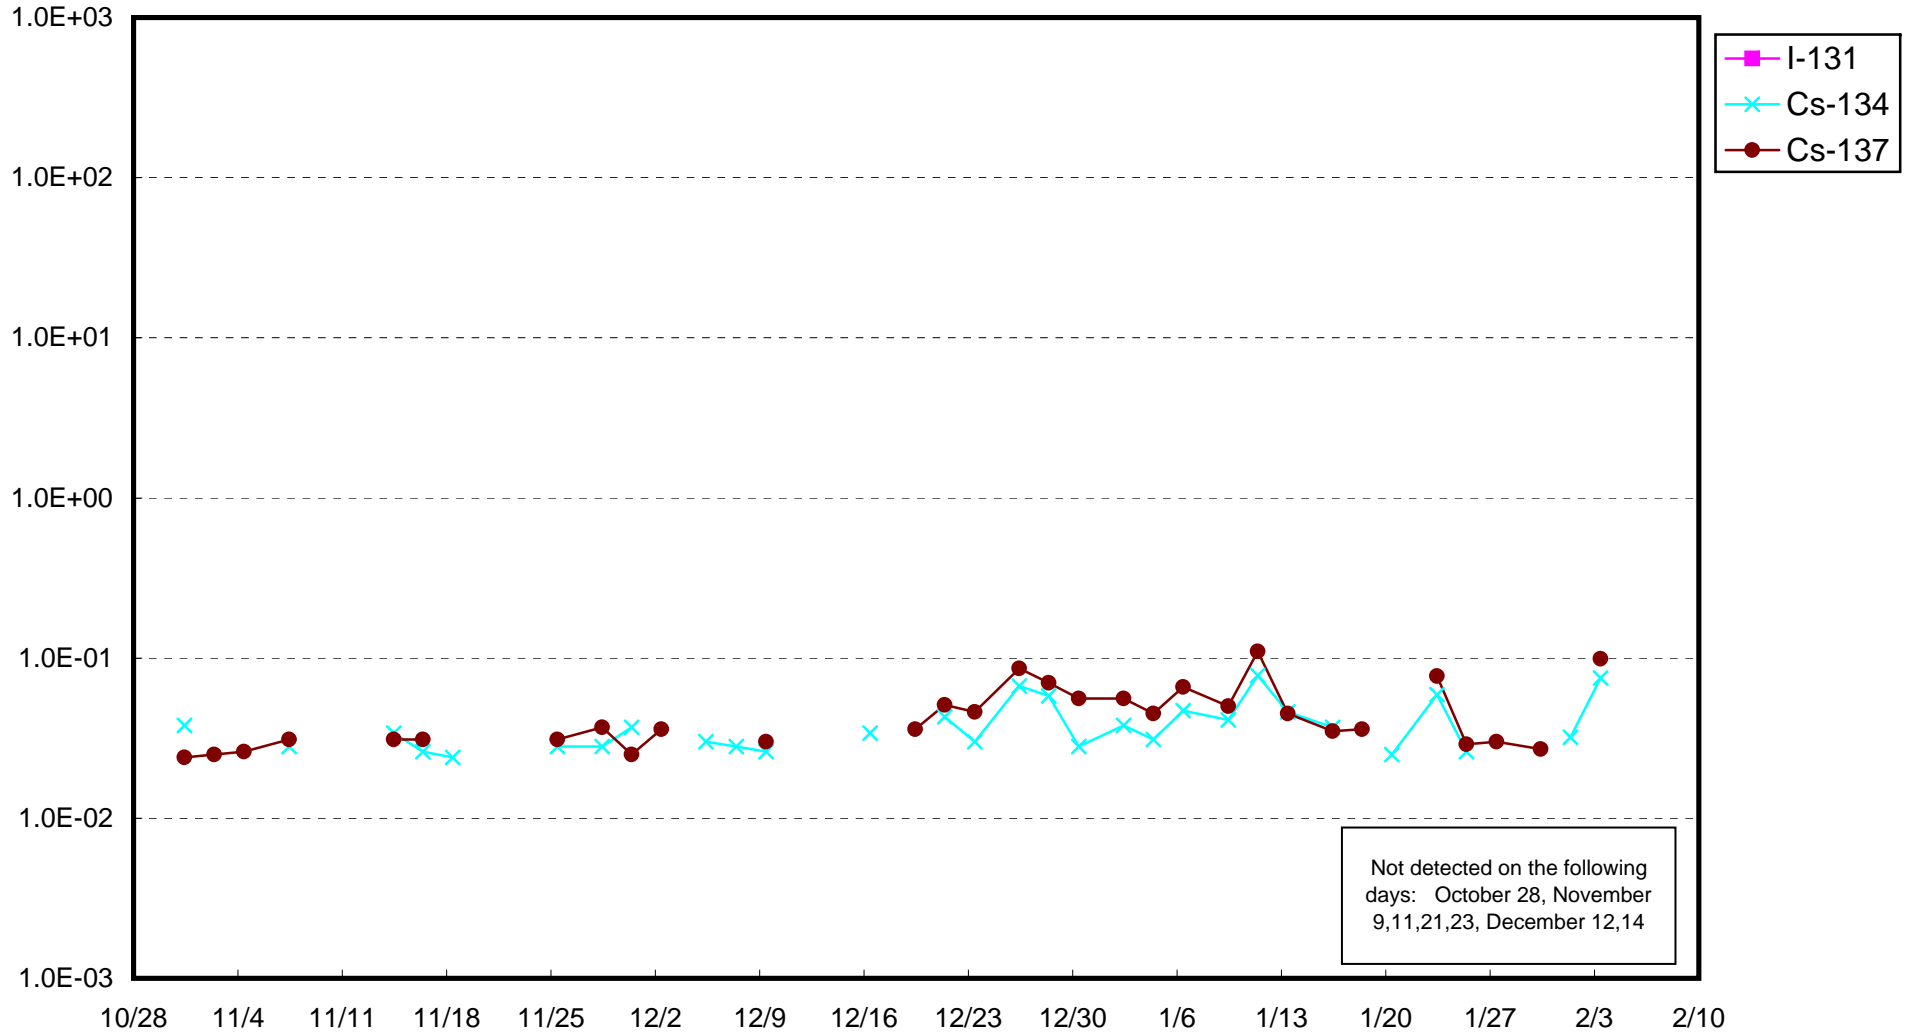


Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 4 (Bq/cm³)

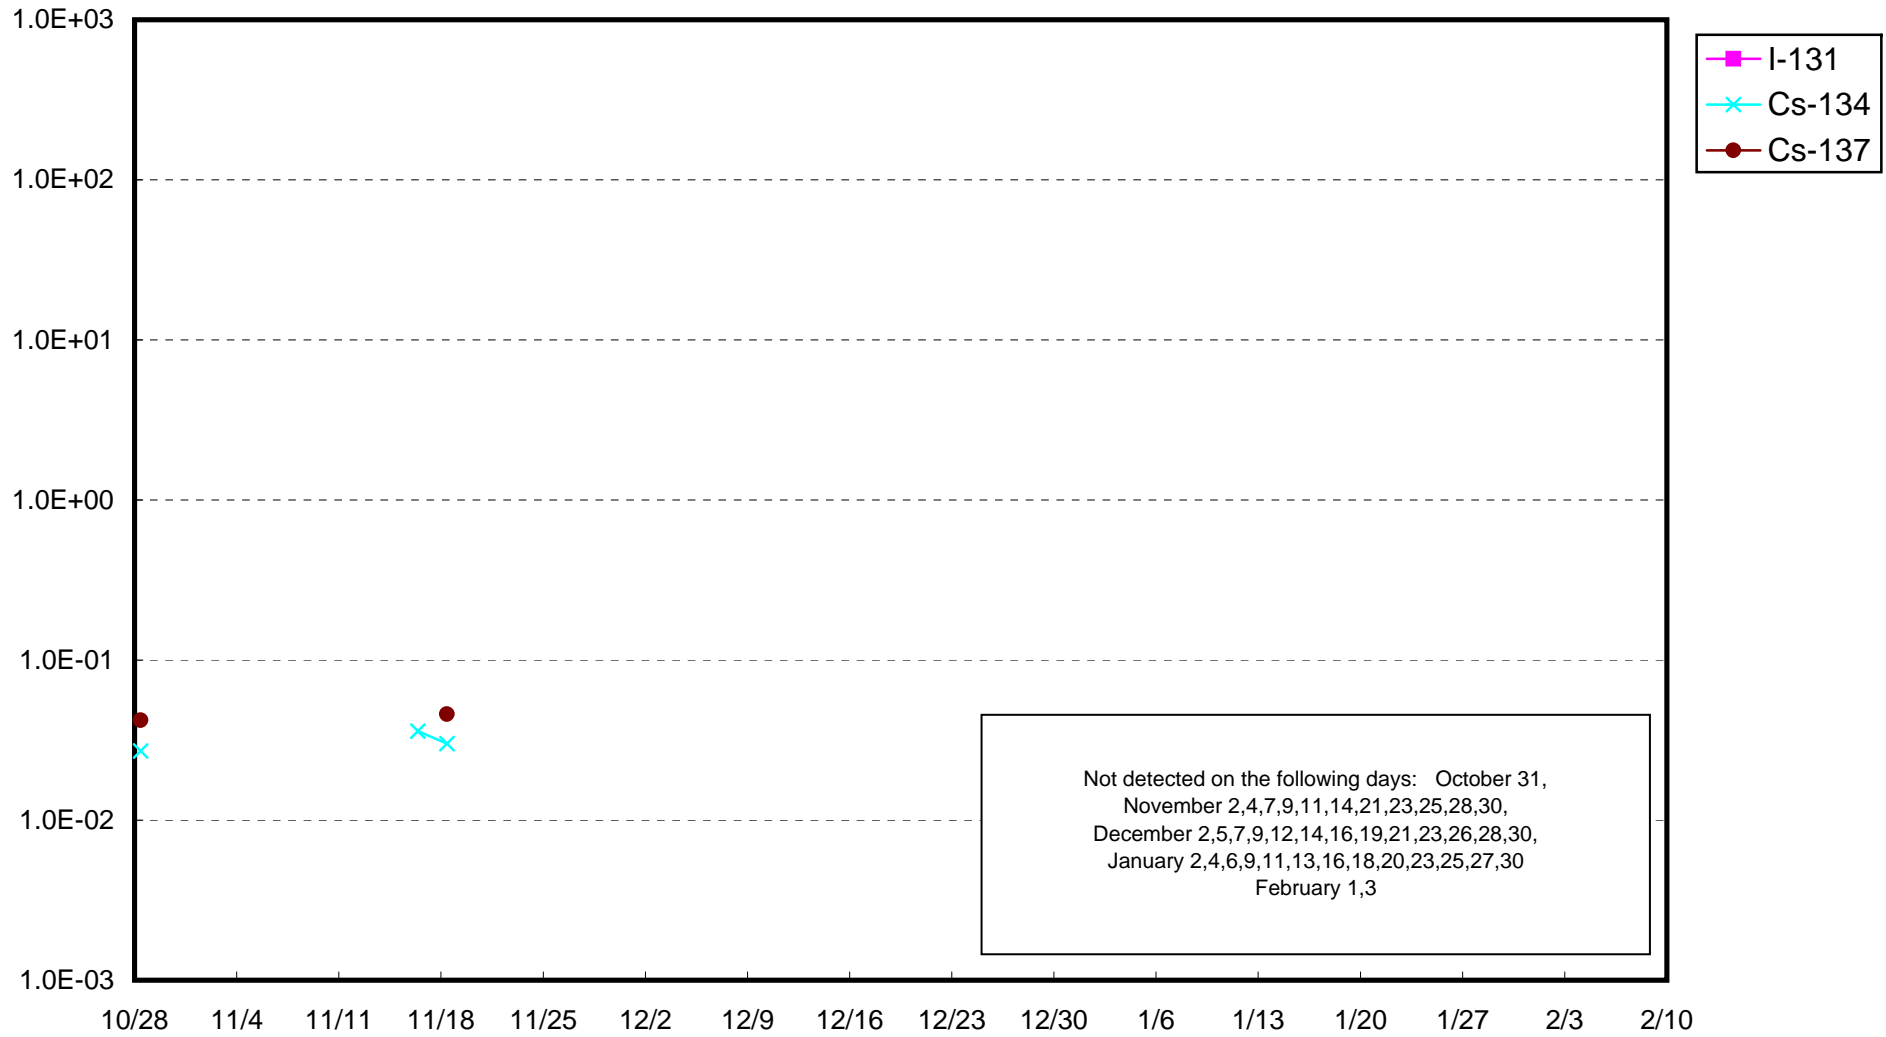

Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 5 (Bq/cm³)

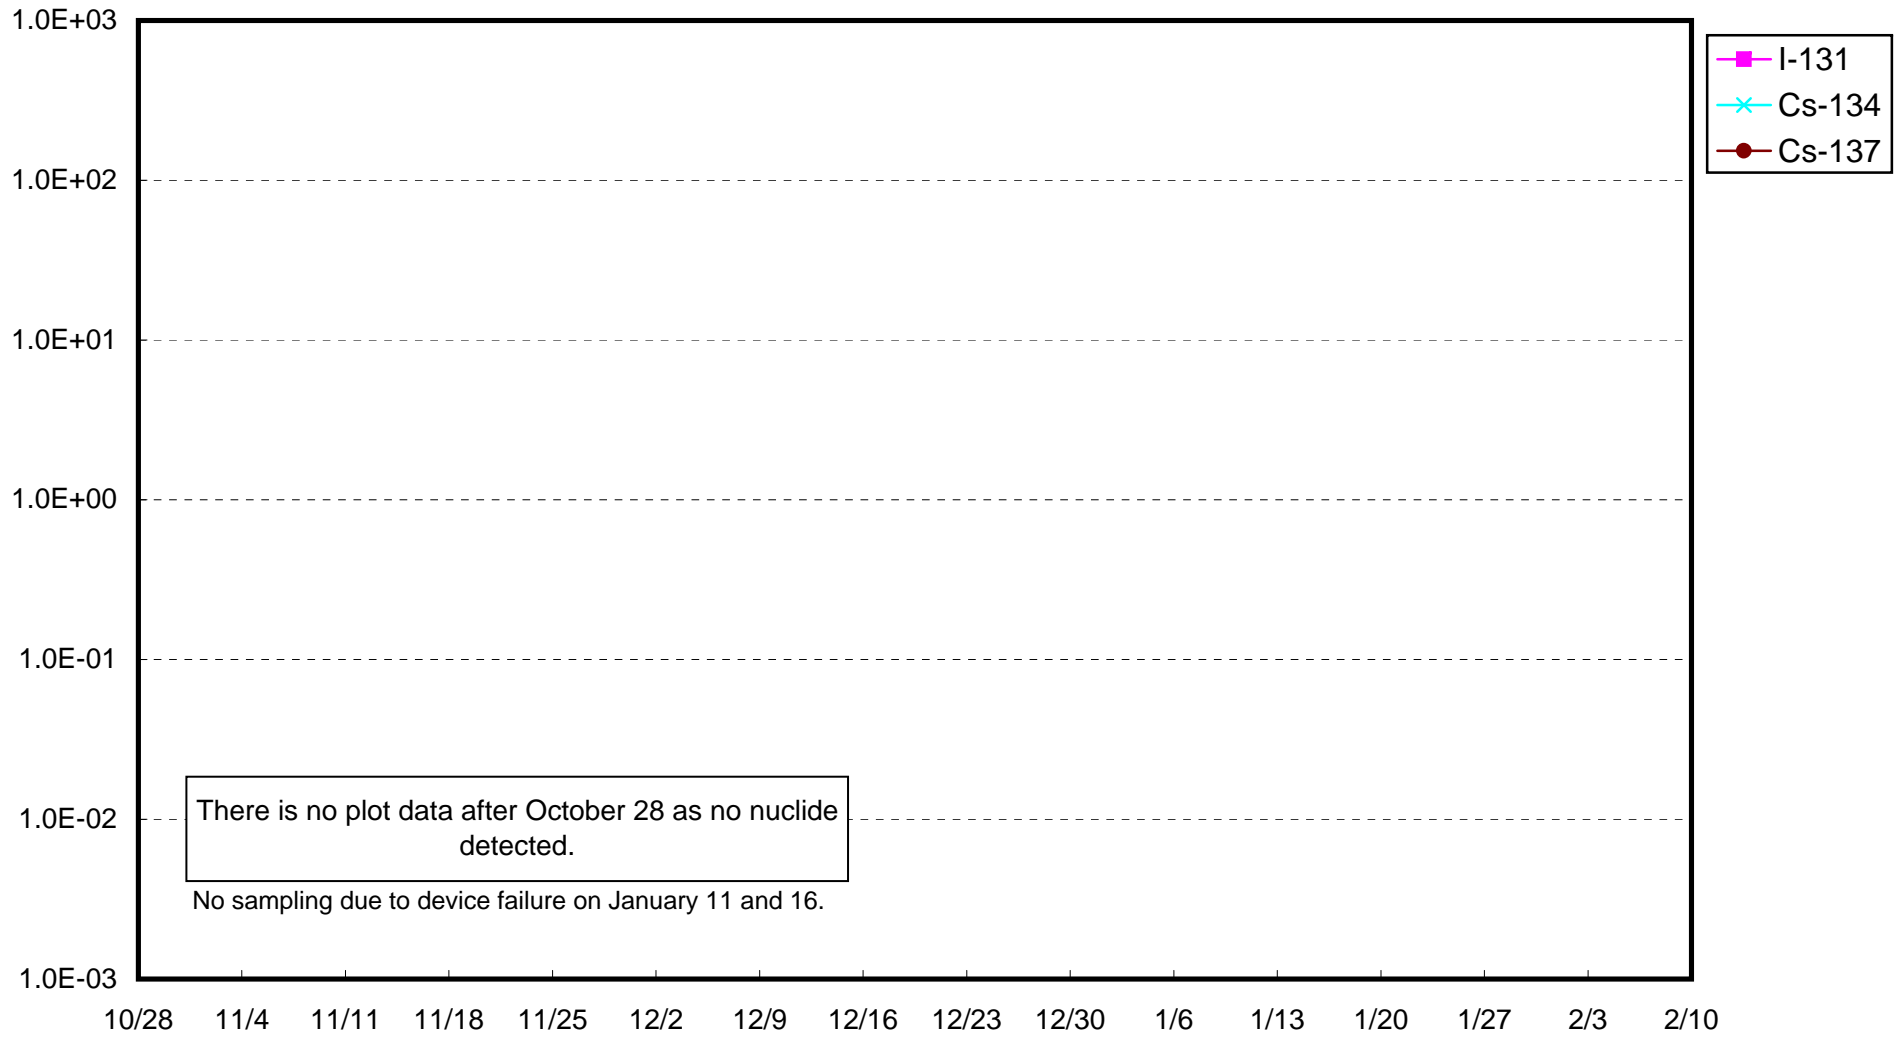

Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 6 (Bq/cm³)

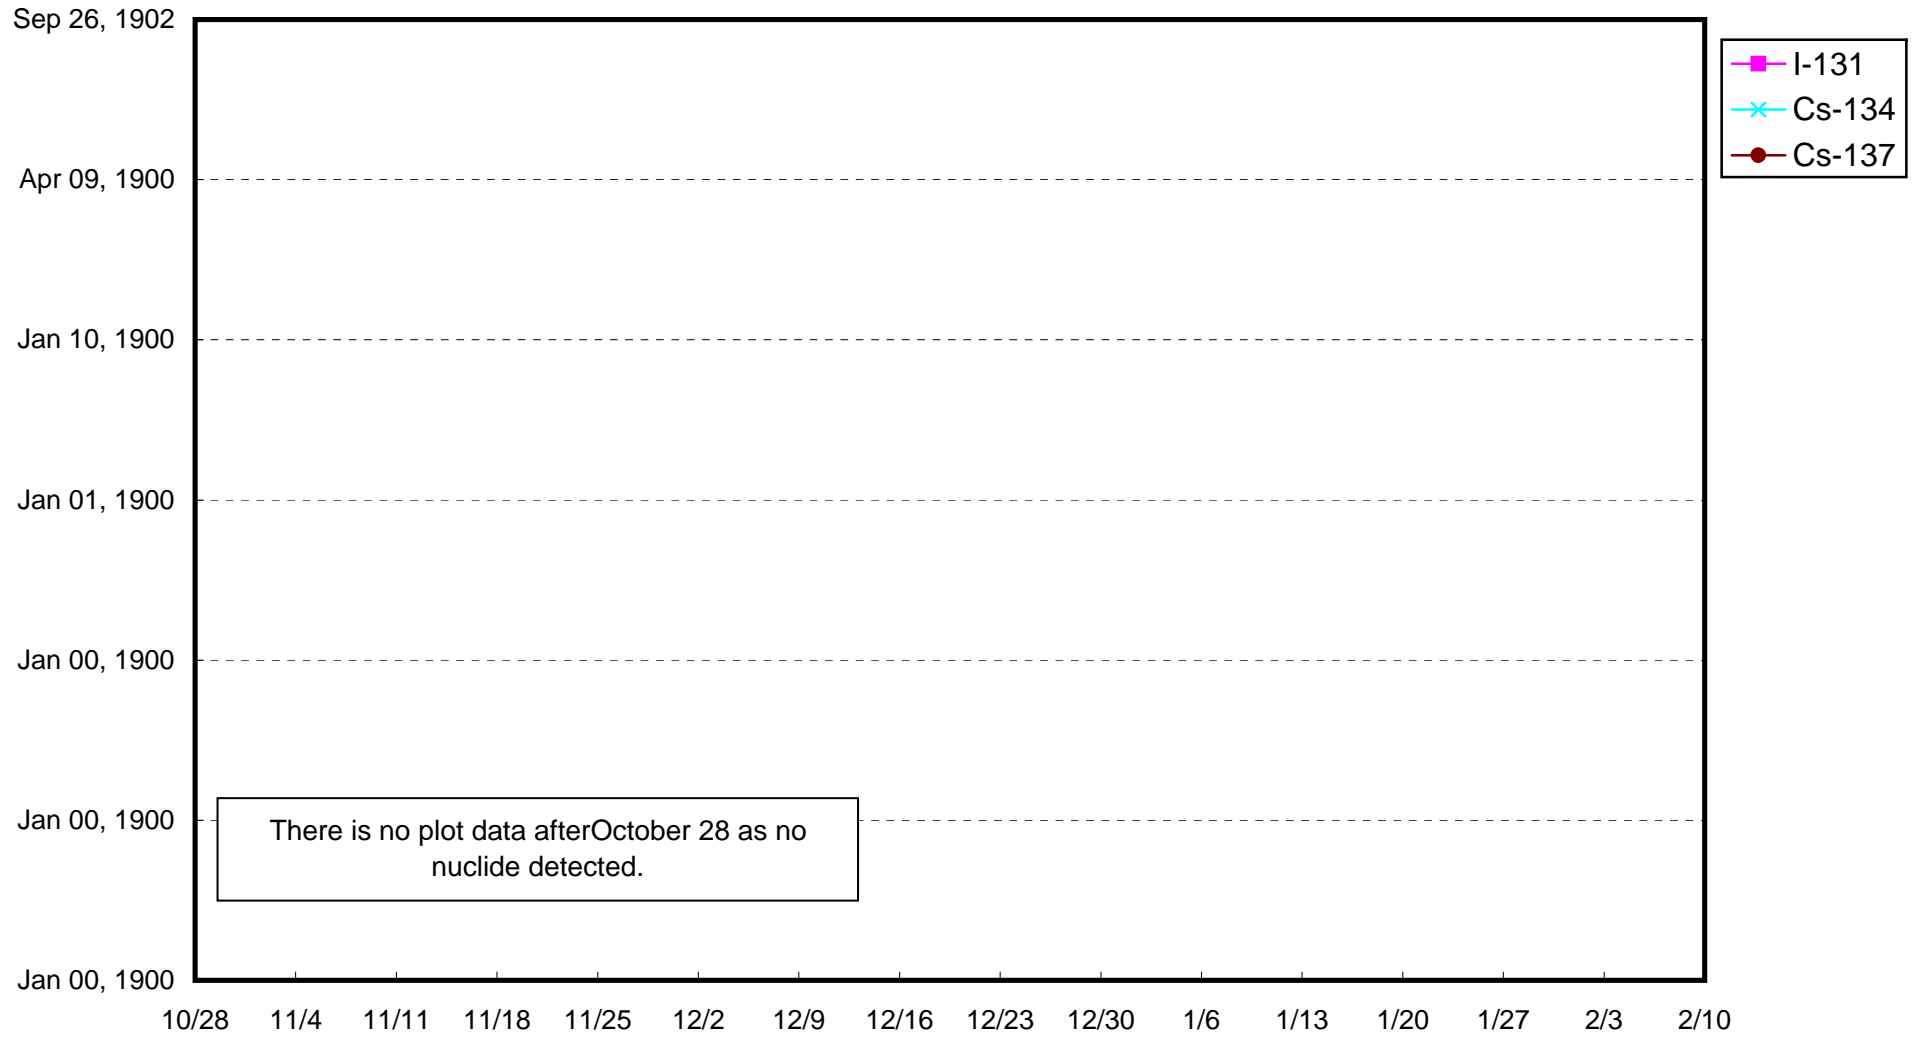

Fukushima Daiichi Nuclear Power Station : Radioactivity Density at the Deep Well at the Site (Bq/cm³)

