

### Result of nuclide analysis of sub drain of Fukushima Daiichi NPS

(Data summarized on May 12)

Place of Sampling	Fukushima Daiichi NPS 1U sub-drain	Fukushima Daiichi NPS 2U sub-drain	Fukushima Daiichi NPS 3U sub-drain	Fukushima Daiichi NPS 4U sub-drain	Fukushima Daiichi NPS 5U sub-drain	Fukushima Daiichi NPS 6U sub-drain	Fukushima Daiichi NPS Deep well
Time of Sampling	May 11, 2012 9:32 AM	May 11, 2012 9:55 AM	May 11, 2012 10:00 AM	May 11, 2012 9:00 AM	May 11, 2012 9:50 AM	May 11, 2012 9:35 AM	May 11, 2012 9:15 AM
Detected Nuclides (Half-life)	Density of sample ( Bq/cm <sup>3</sup> )						
I-131 (approx. 8 days)	ND	ND	ND	ND	ND	ND	ND
Cs-134 (approx. 2 years)	2.5E-01	4.1E-01	ND	ND	ND	ND	ND
Cs-137 (approx. 30 years)	3.8E-01	6.4E-01	2.9E-02	ND	ND	ND	ND

\* O.OE - O means O.O x 10-O


\* Data of other nuclides are under evaluation.

\* "ND" means the sampled data is below measurable limit.

I-131: approx. 2E-2Bq/cm<sup>3</sup>, Cs-134: approx. 2E-2Bq/cm<sup>3</sup>, Cs-137: approx. 3E-2Bq/cm<sup>3</sup> )


Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 1 (Bq/cm<sup>3</sup>)

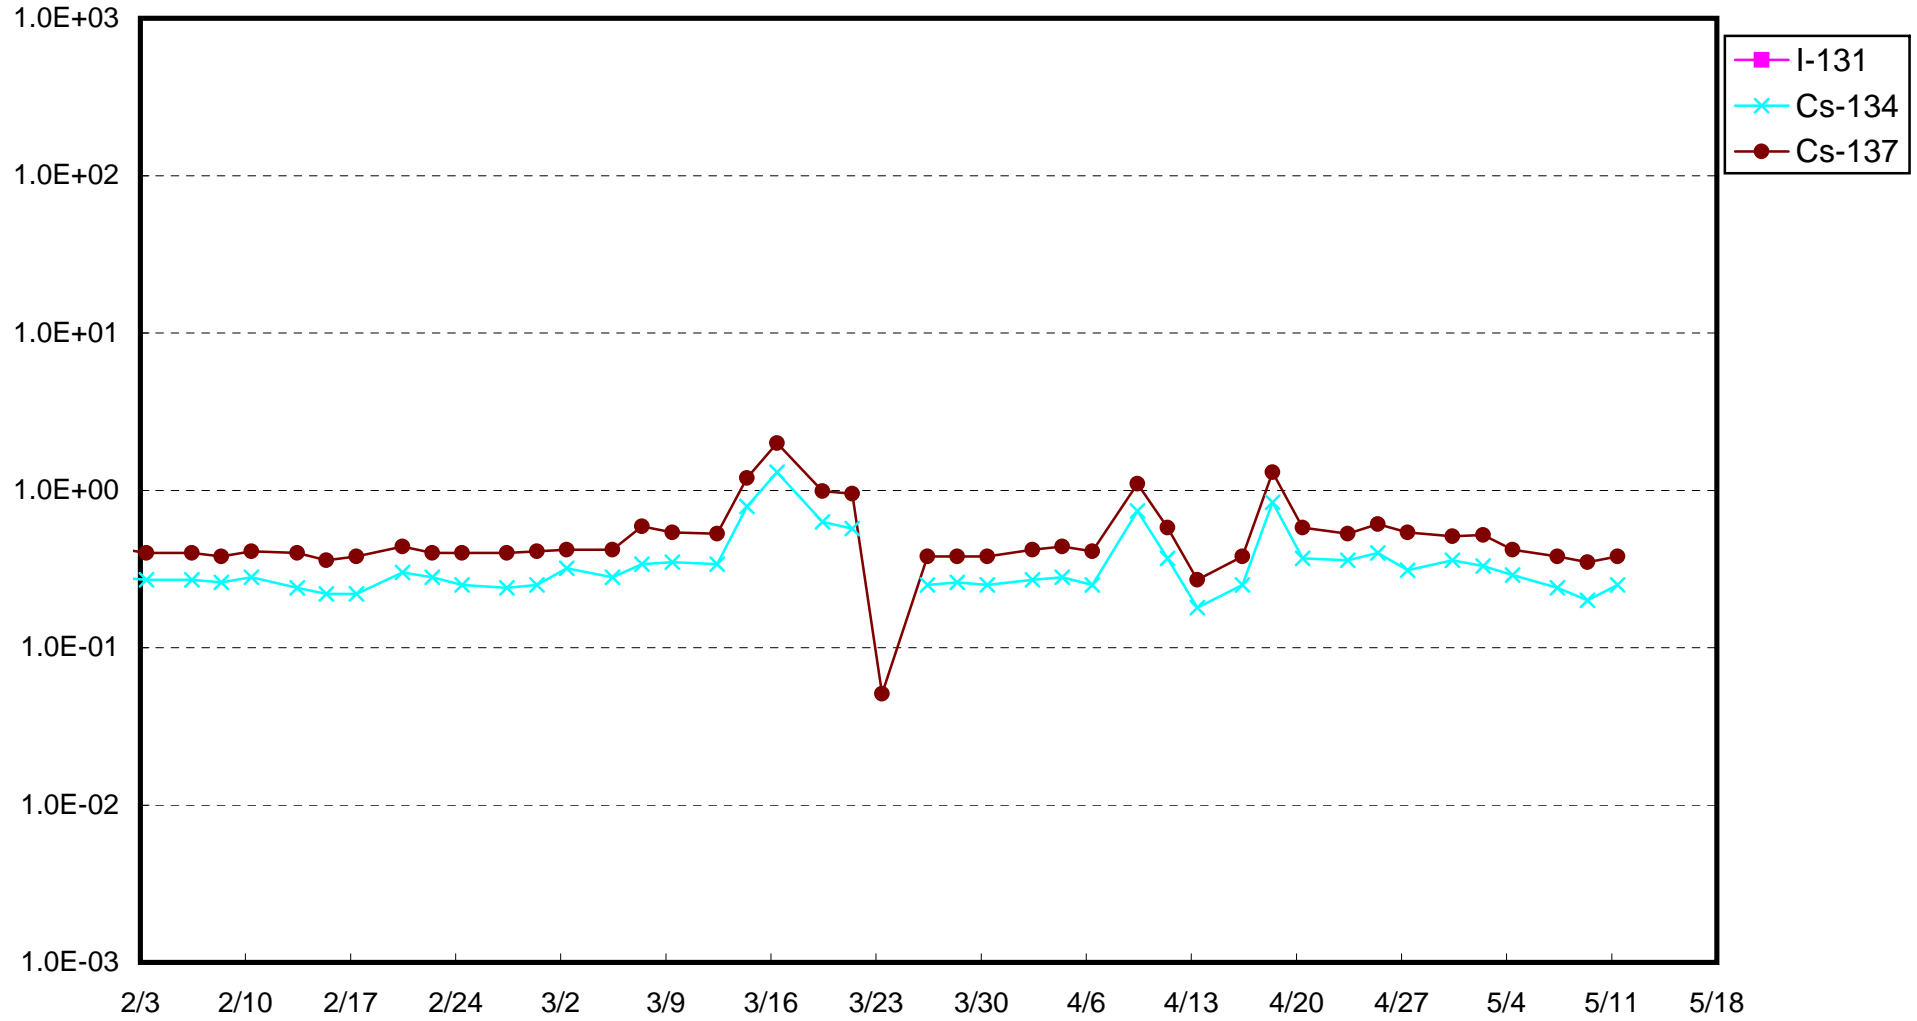





Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 3 (Bq/cm<sup>3</sup>)

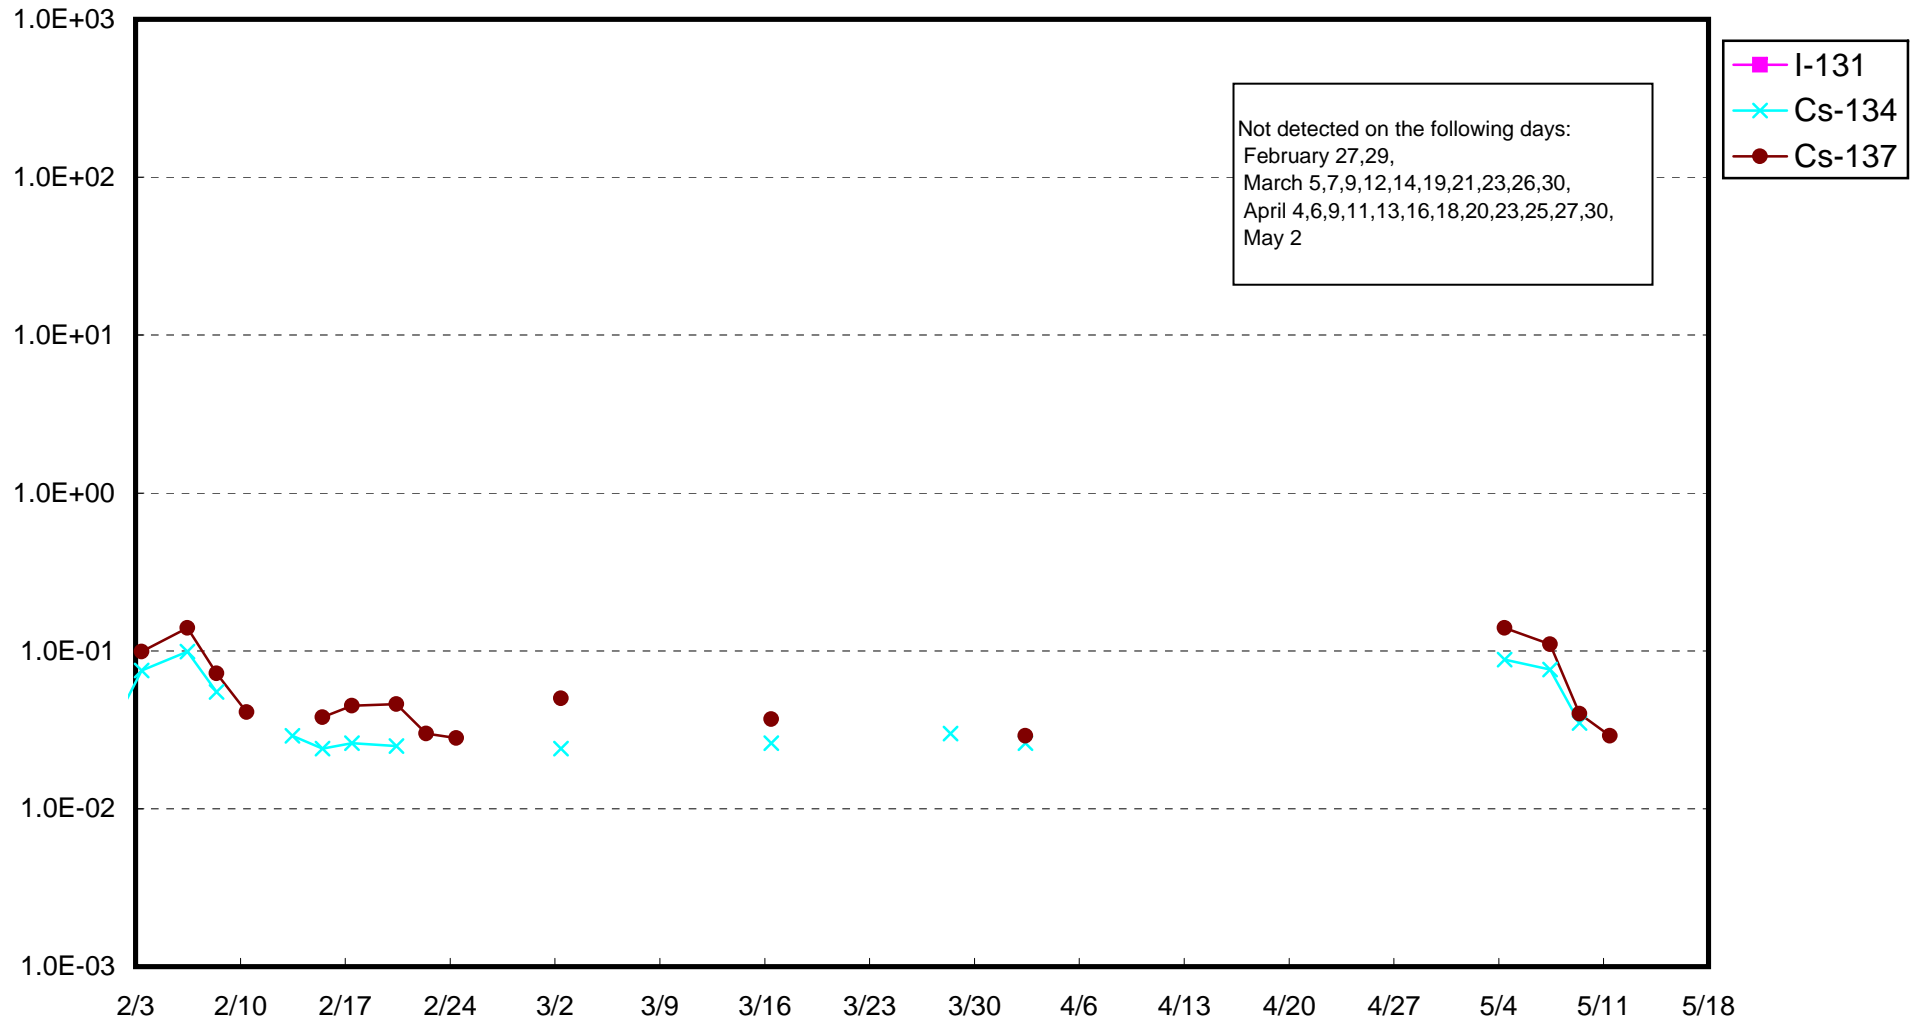


Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 4 (Bq/cm<sup>3</sup>)

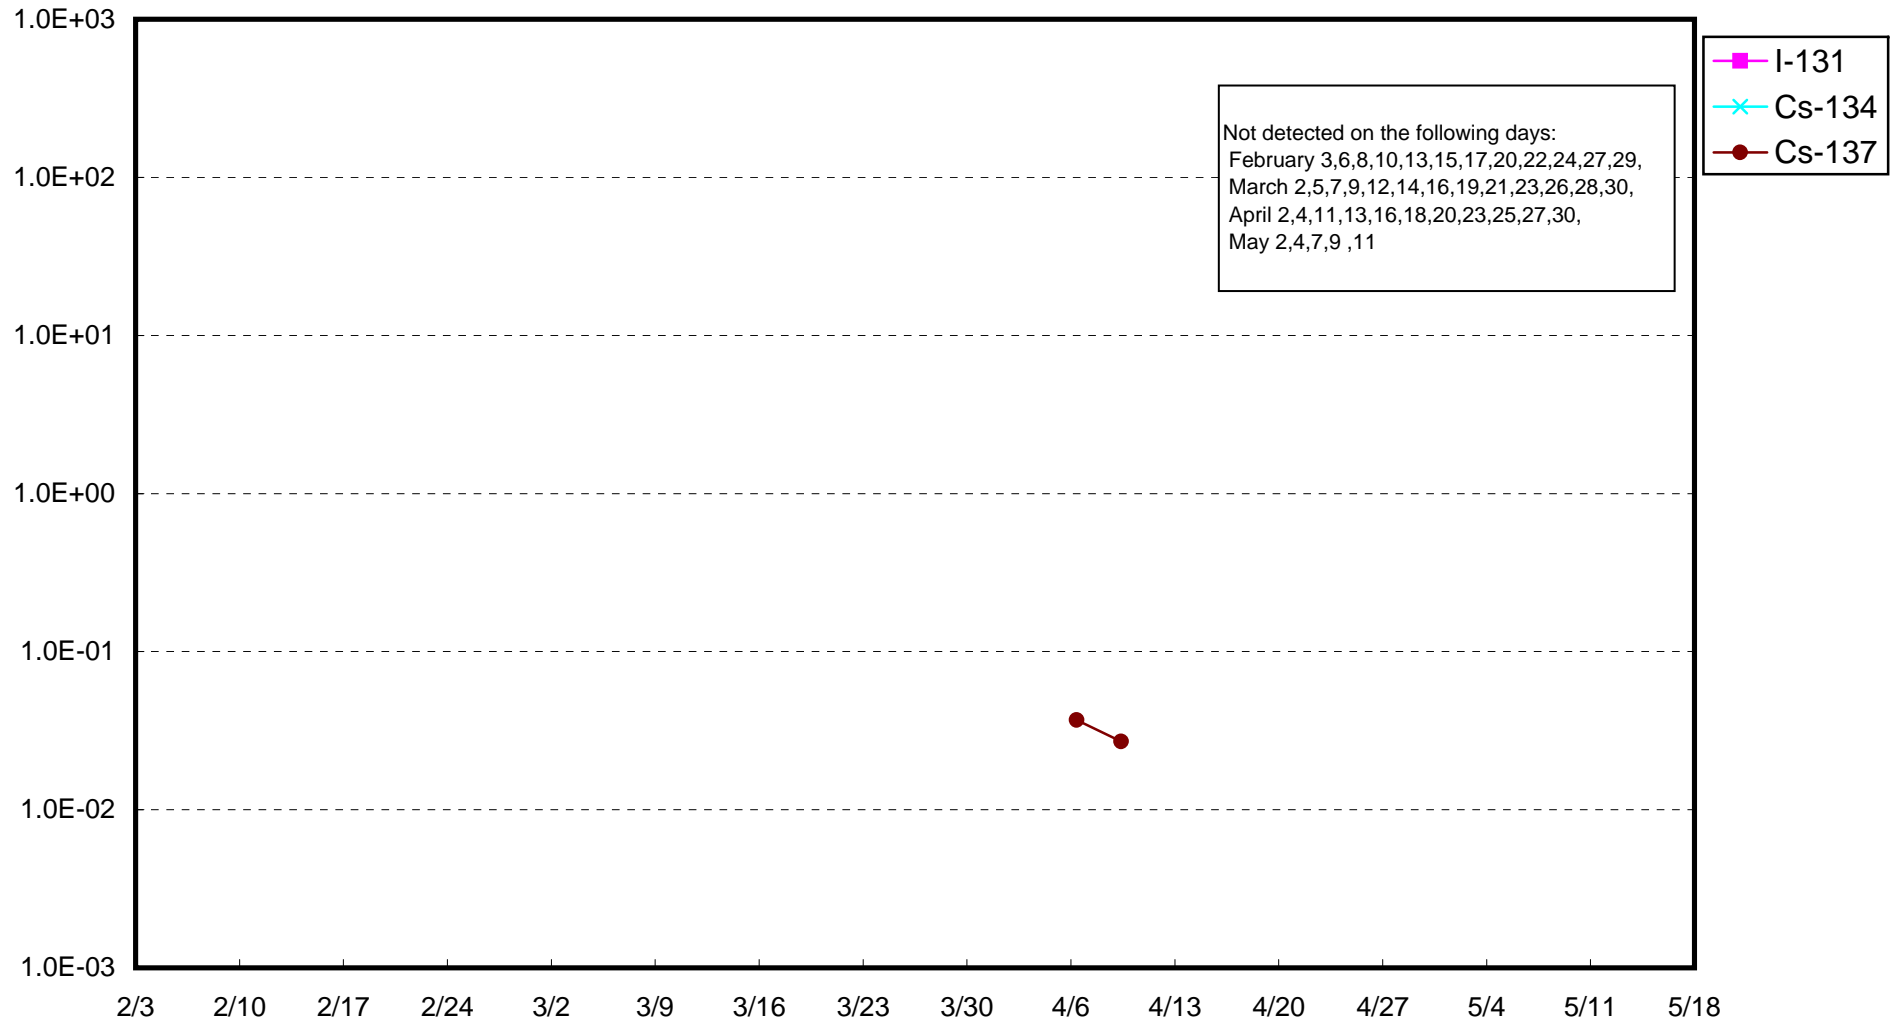

Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 5 (Bq/cm<sup>3</sup>)

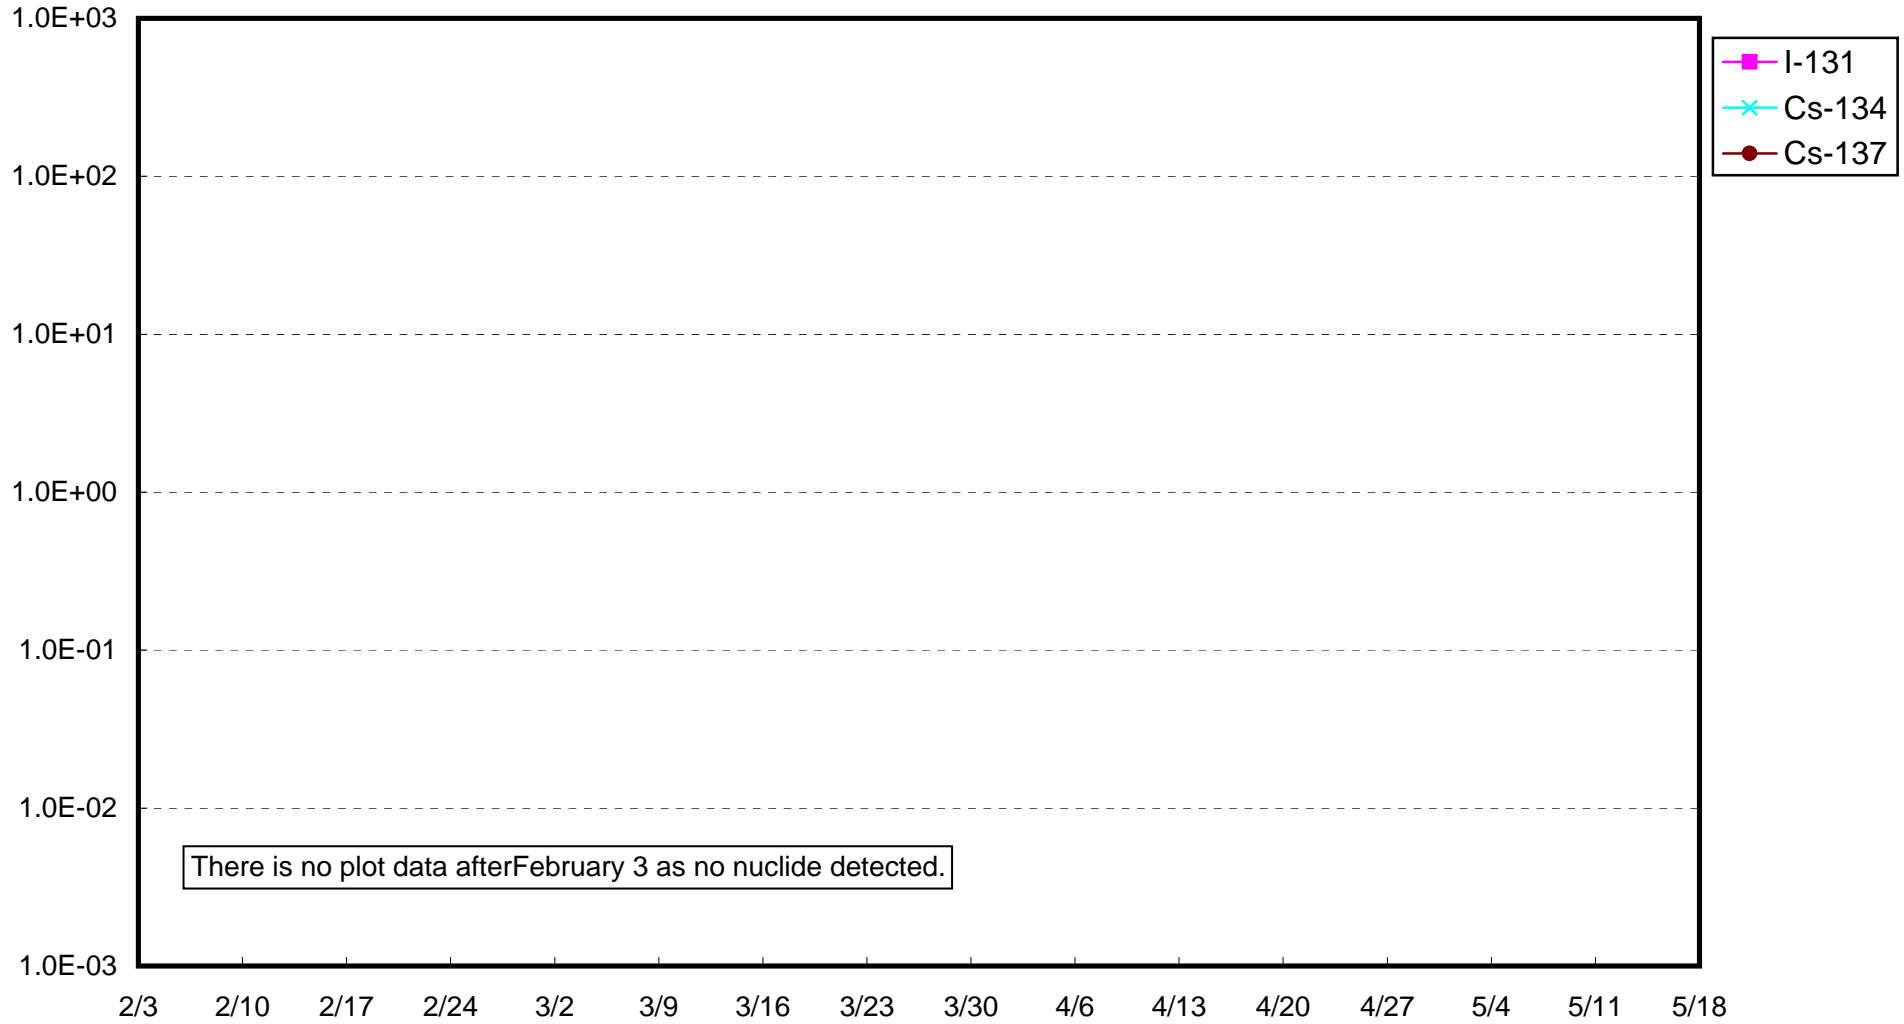

Fukushima Daiichi Nuclear Power Station : Radioactivity Density of Sub-drain at Unit 6 (Bq/cm<sup>3</sup>)

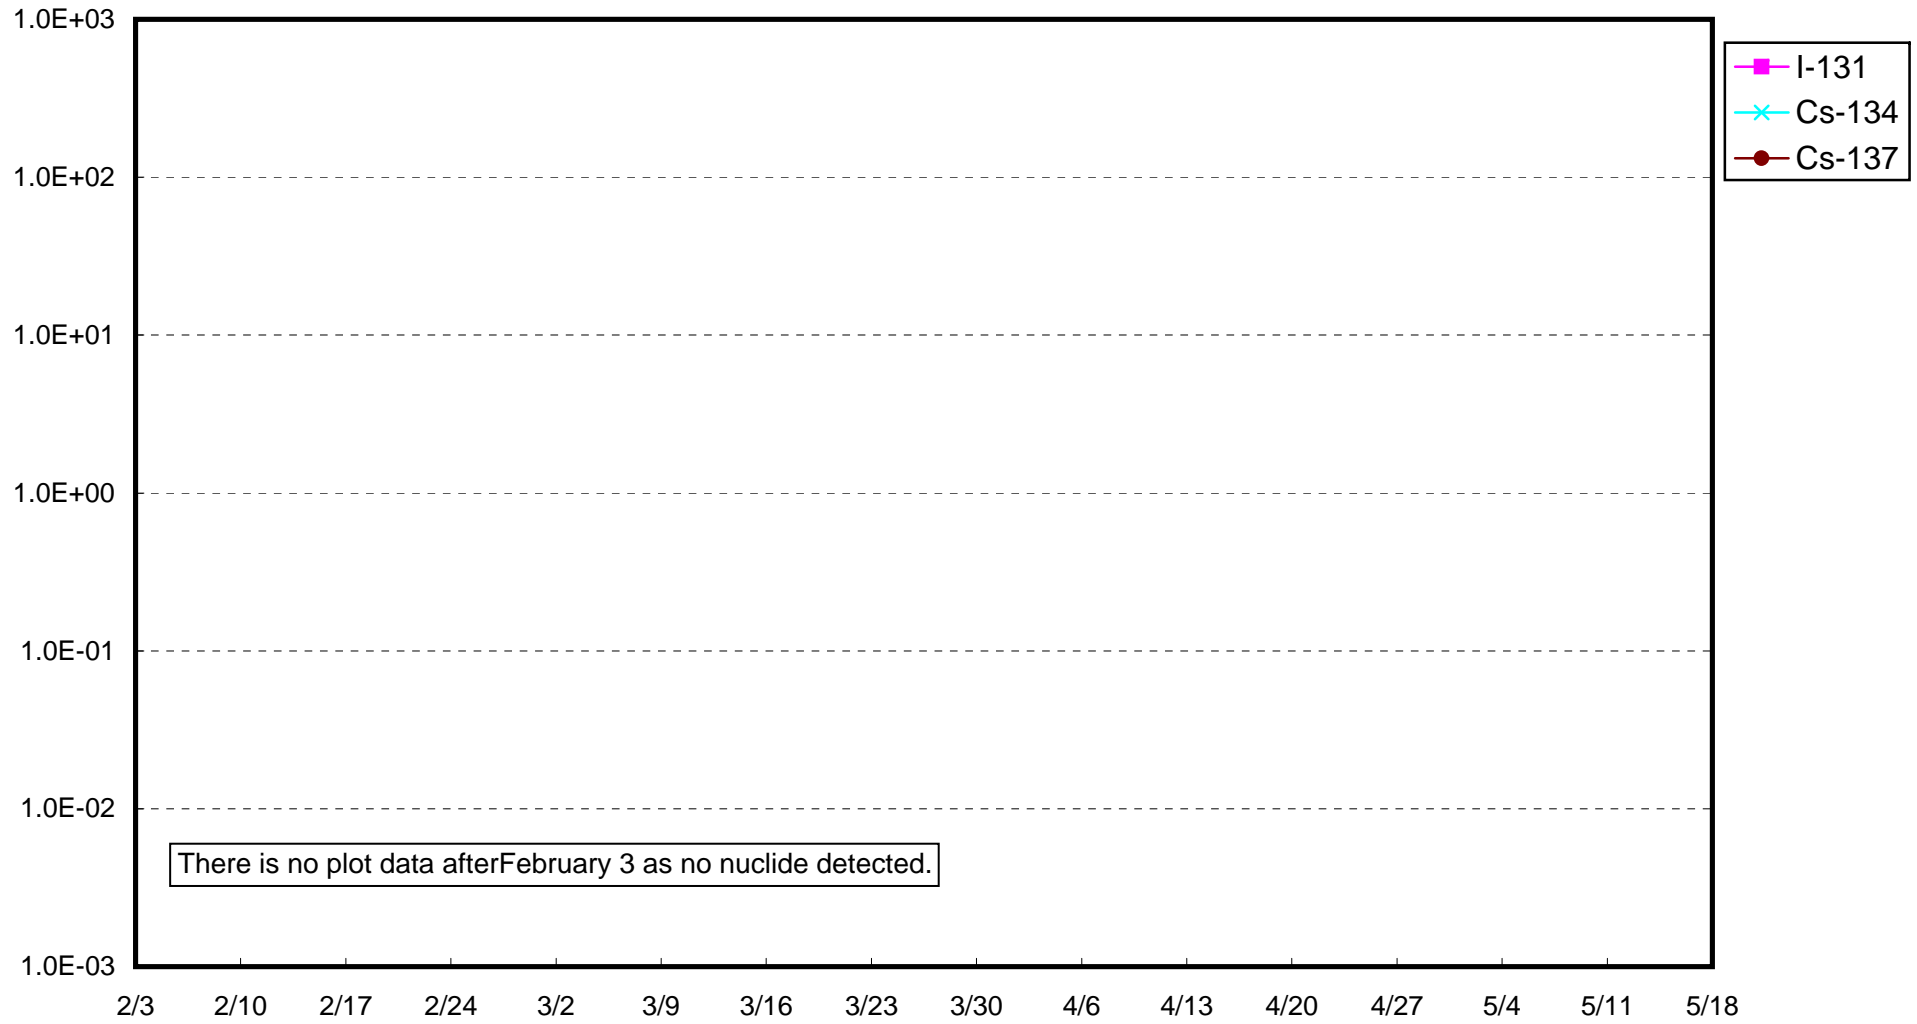

Fukushima Daiichi Nuclear Power Station : Radioactivity Density at the Deep Well at the Site (Bq/cm<sup>3</sup>)

