


Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Underground Water Obtained at Bank Protection)

<Reference>
September 21, 2013
Tokyo Electric Power Company

● Sampling locations of underground water obtained at bank protection

East seawall break

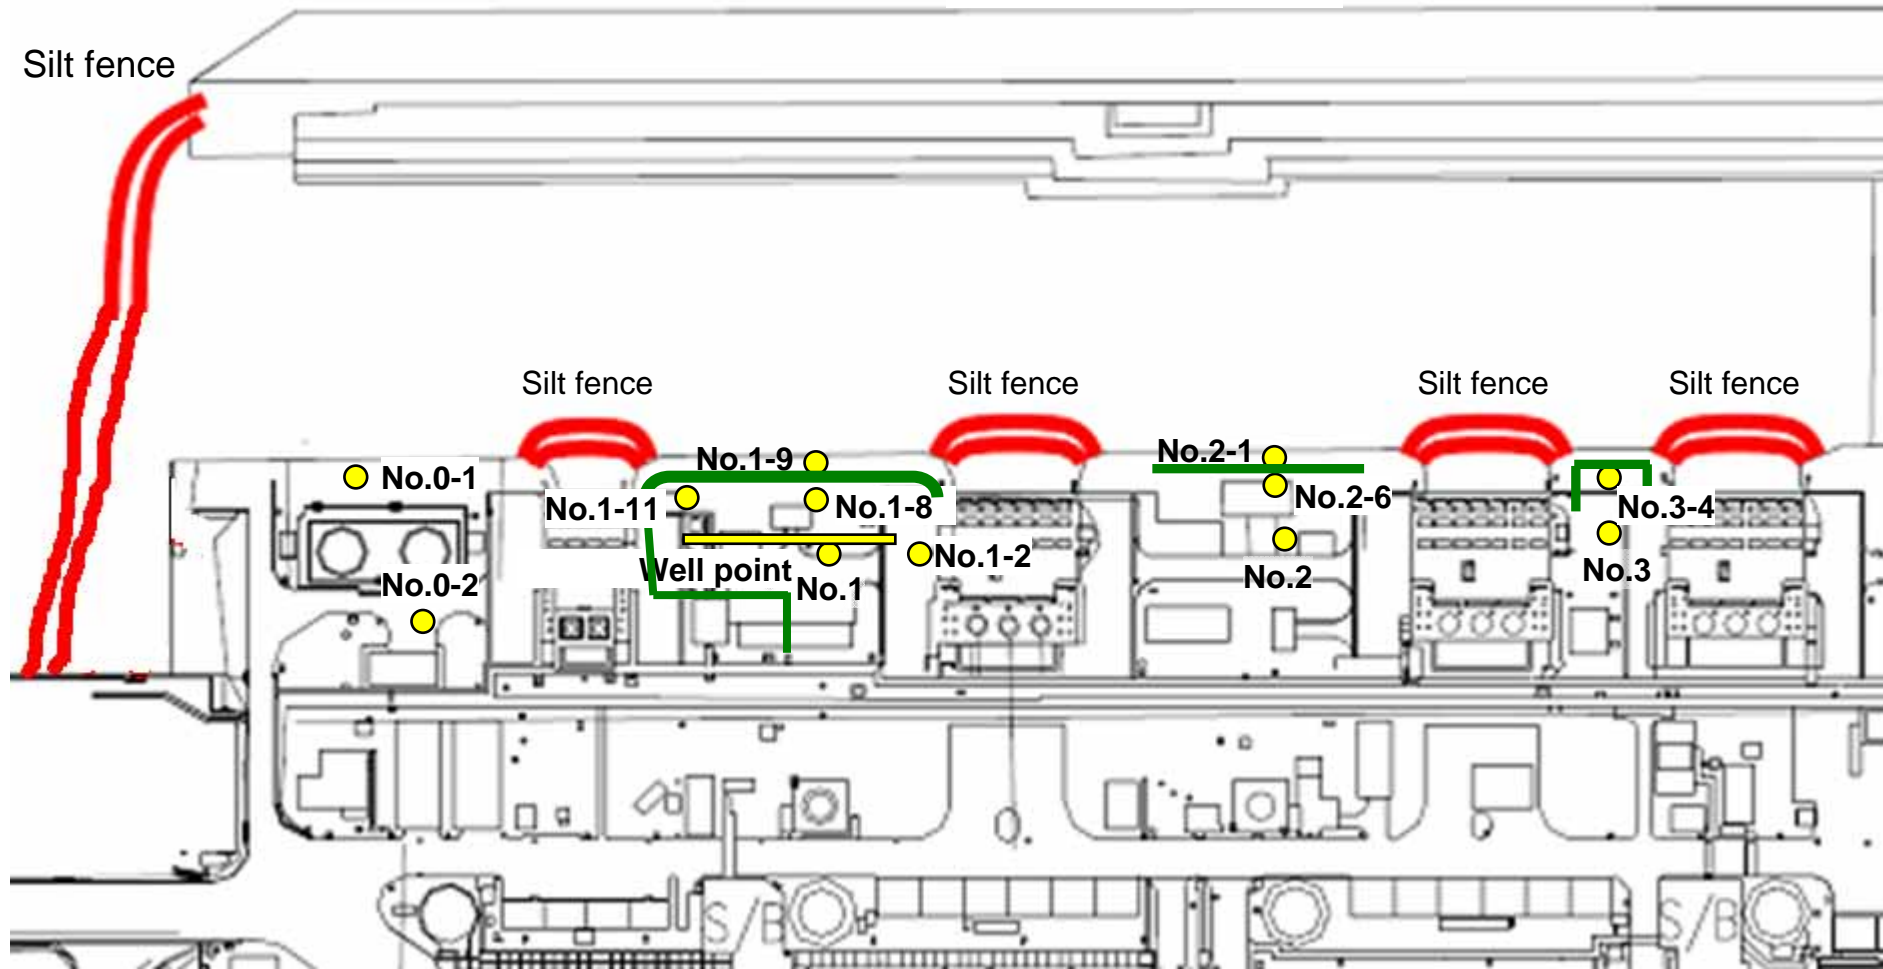

— : Location where ground improvement work was completed, or being implemented (as of September 20)

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection
Underground Water Obtained at Bank Protection

Unit: Bq/L (exclude chloride)

	Underground water observation hole No.0-1	Underground water observation hole No.0-2	Underground water observation hole No.1	Underground water observation hole No.1-2	Underground water observation hole No.1-8	Underground water observation hole No.1-9	Underground water observation hole No.1-11	Groundwater pumped up from the well point	Underground water observation hole No.2	Underground water observation hole No.2-1	Underground water observation hole No.2-6	Underground water observation hole No.3	Underground water observation hole No.3-4
Date of sampling											Sep 20, 2013		
Time of sampling											10:53 AM		
Chloride (unit: ppm)											-		
Cs-134 (Approx. 2 years)											ND(0.39)		
Cs-137 (Approx.30 years)											ND(0.45)		
The other γ													
All β											ND(18)		
H-3 (Approx. 12 years)											200		
Sr-90 (Approx. 29 years)											Under analysis		

* Data announced this time is provided in a thick-frame. The other data was announced on September 20.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* "-" indicates that the measurement was out of range.