


# Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Seawater)

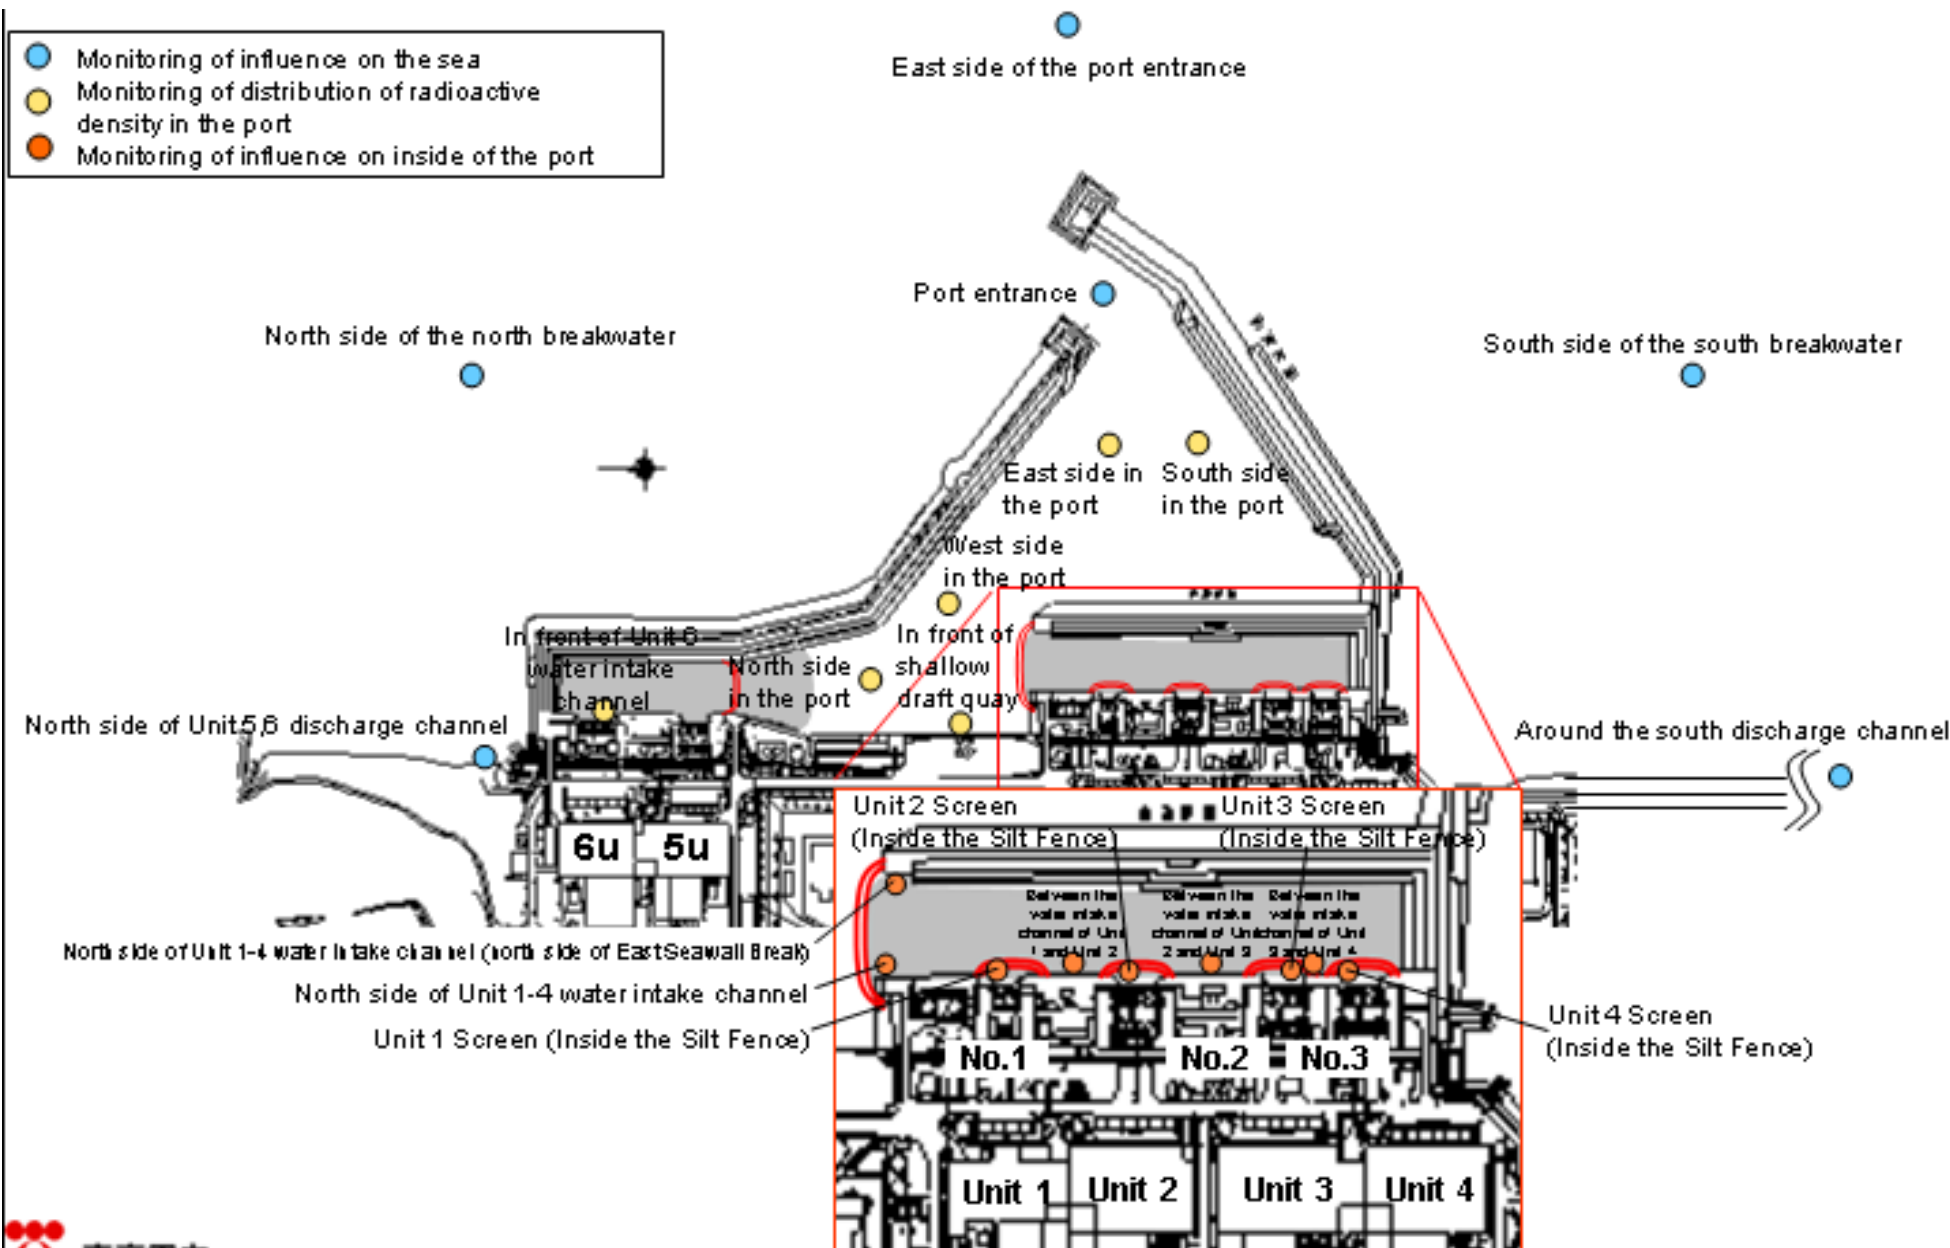

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (1/5)  
Seawater

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 8, 2013	Oct 7, 2013	Oct 7, 2013	Oct 8, 2013	Oct 8, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013		
Time of sampling	5:55 AM	6:00 AM	5:43 AM	6:20 AM	6:15 AM	5:52 AM	6:26 AM	6:26 AM	5:56 AM	6:00 AM	6:03 AM		
Cs-134(Approx. 2 years)	1.3	ND(3.3)	ND(2.1)	32	14	30	30	17	27	22	30	60	10
Cs-137(Approx.30 years)	1.7	ND(2.4)	5.7	74	28	67	65	39	61	58	61	90	10
All β	ND(17)	22	29	690	230	590	530	250	420	480	190		
H-3 (Approx. 12 years)	7.3	14	ND(120)	2,500	390	2000	1,600	450	1700	1200	290	60,000	10,000
Sr-90 (Approx. 29 years)	-	-	-	-	-	-	-	-	-	-	-	30	10

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 7, 2013	Oct 8, 2013	Oct 8, 2013	Oct 8, 2013		
Time of sampling	6:08 AM	6:06 AM	5:20 AM	9:42 AM	9:55 AM	10:00 AM	10:04 AM	9:49 AM	8:43 AM	8:25 AM	8:33 AM		
Cs-134(Approx. 2 years)	17	44	ND(1.3)	ND(1.9)	ND(1.3)	ND(2.1)	ND(2.1)	ND(1.4)	ND(0.64)	ND(0.76)	ND(0.88)	60	10
Cs-137(Approx.30 years)	36	98	ND(1.4)	1.7	2.3	ND(1.4)	1.9	1.7	ND(0.73)	1.4	ND(0.71)	90	10
All β	300	360	ND(21)	ND(16)	ND(16)	ND(16)	ND(16)	ND(16)	ND(15)	ND(15)	ND(15)		
H-3 (Approx. 12 years)	620	400	ND(1.8)	<b>6.8</b>	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	60,000	10,000
Sr-90 (Approx. 29 years)	-	-	-	-	-	-	-	-	-	-	-	30	10

\* Data announced this time is provided in a thick-frame. The other data was announced on October 8, 9 and 11.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

\* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm<sup>3</sup> to Bq/L]).

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (2/5)  
Seawater

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	Oct 9, 2013	/	Oct 9, 2013	Oct 9, 2013	/	/	Oct 9, 2013	/	Oct 9, 2013		
Time of sampling	/	/	6:19 AM	/	6:43 AM	6:26 AM	/	/	6:29 AM	/	6:34 AM		
Cs-134(Approx. 2 years)	/	/	ND(2.3)	/	27	51	/	/	370	/	49	60	10
Cs-137(Approx.30 years)	/	/	8.5	/	59	110	/	/	830	/	110	90	10
All β	/	/	25	/	250	690	/	/	1700	/	210		
H-3 (Approx. 12 years)	/	/	<b>ND(110)</b>	/	<b>260</b>	<b>1,300</b>	/	/	<b>1,900</b>	/	<b>190</b>	<b>60,000</b>	<b>10,000</b>
Sr-90 (Approx. 29 years)	/	/	-	/	-	-	/	/	-	/	-	30	10

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	Oct 9, 2013	/	/	/	/	/	/	/	/	/		
Time of sampling	/	6:37 AM	/	/	/	/	/	/	/	/	/		
Cs-134(Approx. 2 years)	/	36	/	/	/	/	/	/	/	/	/	60	10
Cs-137(Approx.30 years)	/	80	/	/	/	/	/	/	/	/	/	90	10
All β	/	140	/	/	/	/	/	/	/	/	/		
H-3 (Approx. 12 years)	/	<b>180</b>	/	/	/	/	/	/	/	/	/	<b>60,000</b>	<b>10,000</b>
Sr-90 (Approx. 29 years)	/	-	/	/	/	/	/	/	/	/	/	30	10

\* Data announced this time is provided in a thick-frame. The other data was announced on October 10 and 11.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

\* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm<sup>3</sup> to Bq/L]).

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (3/5)  
Seawater

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	Oct 10, 2013	/	Oct 10, 2013	Oct 10, 2013	/	/	Oct 10, 2013	/	Oct 10, 2013		
Time of sampling	/	/	6:06 AM	/	6:45 AM	6:15 AM	/	/	6:31 AM	/	6:36 AM		
Cs-134(Approx. 2 years)	/	/	4.3	/	27	73	/	/	300	/	47	60	10
Cs-137(Approx.30 years)	/	/	6.7	/	60	170	/	/	670	/	110	90	10
All β	/	/	26	/	150	710	/	/	1300	/	210		
H-3 (Approx. 12 years)	/	/	<b>ND(120)</b>	/	<b>160</b>	<b>1,500</b>	/	/	<b>1,500</b>	/	<b>ND(120)</b>	60,000	10,000
Sr-90 (Approx. 29 years)	/	/	-	/	-	-	/	/	-	/	-	30	10

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	Oct 10, 2013	/	Oct 10, 2013	/	/	/	/	Oct 10, 2013	Oct 10, 2013	Oct 10, 2013		
Time of sampling	/	6:39 AM	/	11:03 AM	/	/	/	/	11:54 AM	11:48 AM	11:42 AM		
Cs-134(Approx. 2 years)	/	30	/	ND(1.1)	/	/	/	/	ND(0.67)	ND(0.68)	ND(0.63)	60	10
Cs-137(Approx.30 years)	/	65	/	ND(0.90)	/	/	/	/	ND(0.80)	ND(0.50)	ND(0.71)	90	10
All β	/	120	/	ND(15)	/	/	/	/	-	-	-		
H-3 (Approx. 12 years)	/	<b>ND(120)</b>	/	<b>ND(2.0)</b>	/	/	/	/	-	-	-	60,000	10,000
Sr-90 (Approx. 29 years)	/	-	/	-	/	/	/	/	-	-	-	30	10

\* Data announced this time is provided in a thick-frame. The other data was announced on October 10 and 11.

\* We initially announced on October 10 that All β and H-3 obtained at "north side of the north breakwater", "east side of the port entrance" and "south side of the south breakwater" (sampled on October 10) were under analysis. However, the analysis will be performed for only γ nuclides.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

\* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm<sup>3</sup> to Bq/L]).

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (4/5)  
Seawater

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	Oct 11, 2013	/	Oct 11, 2013	/	/	/	Oct 11, 2013	Oct 11, 2013	/		
Time of sampling	/	/	1:30 PM	/	6:26 AM	/	/	/	6:11 AM	6:13 AM	/		
Cs-134(Approx. 2 years)	/	/	4.5	/	32	/	/	/	110	46	/	60	10
Cs-137(Approx.30 years)	/	/	8.3	/	73	/	/	/	250	110	/	90	10
All β	/	/	ND(21)	/	220	/	/	/	580	350	/		
H-3 (Approx. 12 years)	/	/	<b>ND(120)</b>	/	<b>310</b>	/	/	/	<b>1,200</b>	<b>480</b>	/	60,000	10,000
Sr-90 (Approx. 29 years)	/	/	-	/	-	/	/	/	-	-	/	30	10

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	/	Oct 11, 2013	/	/	/	/	/	/	/		
Time of sampling	/	/	/	1:10 PM	/	/	/	/	/	/	/		
Cs-134(Approx. 2 years)	/	/	/	2.7	/	/	/	/	/	/	/	60	10
Cs-137(Approx.30 years)	/	/	/	7.3	/	/	/	/	/	/	/	90	10
All β	/	/	/	ND(15)	/	/	/	/	/	/	/		
H-3 (Approx. 12 years)	/	/	/	<b>4.3</b>	/	/	/	/	/	/	/	60,000	10,000
Sr-90 (Approx. 29 years)	/	/	/	-	/	/	/	/	/	/	/	30	10

\* Data announced this time is provided in a thick-frame. The other data was announced on October 12.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

\* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm<sup>3</sup> to Bq/L]).

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (5/5)  
Seawater

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	Oct 12, 2013	/	Oct 12, 2013	/	/	/	Oct 12, 2013	Oct 12, 2013	/		
Time of sampling	/	/	6:02 AM	/	6:30 AM	/	/	/	6:14 AM	6:17 AM	/		
Cs-134(Approx. 2 years)	/	/	2.8	/	15	/	/	/	78	40	/	60	10
Cs-137(Approx.30 years)	/	/	7.4	/	30	/	/	/	180	77	/	90	10
All β	/	/	ND(19)	/	130	/	/	/	590	380	/		
H-3 (Approx. 12 years)	/	/	Under analysis	/	Under analysis	/	/	/	Under analysis	Under analysis	/	60,000	10,000
Sr-90 (Approx. 29 years)	/	/	-	/	-	/	/	/	-	-	/	30	10

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking-water quality
Date of Sampling	/	/	/	Oct 12, 2013	/	/	/	/	/	/	/		
Time of sampling	/	/	/	8:50 AM	/	/	/	/	/	/	/		
Cs-134(Approx. 2 years)	/	/	/	1.9	/	/	/	/	/	/	/	60	10
Cs-137(Approx.30 years)	/	/	/	4.1	/	/	/	/	/	/	/	90	10
All β	/	/	/	ND(17)	/	/	/	/	/	/	/		
H-3 (Approx. 12 years)	/	/	/	Under analysis	/	/	/	/	/	/	/	60,000	10,000
Sr-90 (Approx. 29 years)	/	/	/	-	/	/	/	/	/	/	/	30	10

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

\* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm<sup>3</sup> to Bq/L]).

<Reference> The Highest Dose Until the Previous Measurement\* (Seawater)

Unit: Bq/L

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3 (surface layer)	1F, Between the water intake channel of Unit 2 and Unit 3 (lower layer)	1F, Unit 3 Screen (Inside the Silt Fence)
Cs-134(Approx. 2 years)	1.8 [ 6/21]	2.4 [ 8/19]	5.3 [ 8/5]	54 [ 9/10]	32 [ 10/11]	73 [ 10/10]	87 [ 10/10]	93 [ 10/10]	370 [ 10/9]	46 [ 10/11]	3.5 [ 8/20]	350 [ 7/15]
Cs-137(Approx.30 years)	3.3 [ 6/26]	4.7 [ 8/19]	8.6 [ 8/5]	110 [ 9/10]	73 [ 10/11]	170 [ 10/10]	200 [ 10/10]	200 [ 10/10]	830 [ 10/9]	110 [ 10/11]	9.8 [ 8/20]	770 [ 7/15]
All β	ND	46 [ 8/19]	40 [ 7/3]	1,100 [ 8/15]	320 [ 8/12]	710 [ 10/10]	740 [ 8/15]	450 [ 7/16]	1700 [ 10/9]	480 [ 10/7]	85 [ 8/20]	1,000 [ 7/15]
H-3 (Approx. 12 years)	8.6 [ 6/26]	24 [ 8/19]	340 [ 6/26]	4,700 [ 8/15]	460 [ 7/15]	2,500 [ 8/12]	2,600 [ 8/15]	1,600 [ 9/1]	1,700 [ 10/7]	1,200 [ 10/7]	-	410 [ 9/2]
Sr-90 (Approx. 29 years)	5.8 [ 6/26]	-	7.4 [ 6/26]	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	-	Under analysis

Unit: Bq/L

	1F, Between the water intake channel of Unit 3 and Unit 4 (surface layer)	1F, Between the water intake channel of Unit 3 and Unit 4 (lower layer)	1F, Unit 4 Screen (Inside the Silt Fence)	1F, Around the south discharge channel	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	North side of the north breakwater	East side of the port entrance	South side of the south breakwater
Cs-134(Approx. 2 years)	22 [ 8/12]	4.8 [ 8/20]	62 [ 9/16]	ND	2.7 [ 10/11]	2.9 [ 8/19]	2.6 [ 8/19]	2.3 [ 10/3]	2.1 [ 8/19]	ND	ND	ND
Cs-137(Approx.30 years)	45 [ 8/12]	7.7 [ 8/20]	140 [ 9/16]	3.0 [ 7/15]	7.3 [ 10/11]	6.6 [ 8/19]	6.5 [ 8/19]	4.7 [ 8/19]	4.6 [ 8/19]	ND	1.4 [ 10/8]	ND
All β	390 [ 8/12]	57 [ 8/20]	360 [ 10/7]	ND	69 [ 8/19]	74 [ 8/19]	60 [ 7/4]	69 [ 8/19]	79 [ 8/19]	ND	ND	ND
H-3 (Approx. 12 years)	650 [ 8/12]	-	400 [ 8/12] [ 10/7]	ND	68 [ 8/19]	67 [ 8/19]	59 [ 8/19]	52 [ 8/19]	60 [ 8/19]	4.7 [ 8/14]	3.6 [ 9/18]	ND
Sr-90 (Approx. 29 years)	Under analysis	-	Under analysis	0.36 [ 6/26]	3.5 [ 6/20]	Under analysis	Under analysis	-	-	-	-	-

\* The highest result announced in "Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection" or the other handouts is provided.

As for "1F, North side of Unit 1-4 water intake channel", the data is obtained since January 14, 2013. For the other locations, the data is obtained since June 14.

\* "ND" indicates that the measurement result is below the detection limit.

\* Date of sampling is provided in parentheses.

\* "-" indicates that the measurement was out of range.

[Reference] Standard values

Unit: Bq/L

	Cs-134	Cs-137	H-3	Sr-90
Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)	60	90	60,000	30
WHO Guidelines for drinking-water quality	10	10	10,000	10