

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Pumped Water Obtained from Bank Protection) (1/2)


Unit: Bq/L

		Pumped water from groundwater observation hole No.0-3-2	Pumped water from groundwater observation hole No.1-16
Date of Sampling		Dec 12, 2013	/
Time of sampling		12:00 PM	
Cs-134 (Approx. 2 years)		ND(0.40)	
Cs-137 (Approx.30 years)		0.56	
The other γ			
Gross β		ND(17)	
H-3 (Approx. 12 years)		67,000	

* Data announced this time is provided in a thick-frame. The other data was announced on December 13.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* "-" indicates that the measurement was out of range.

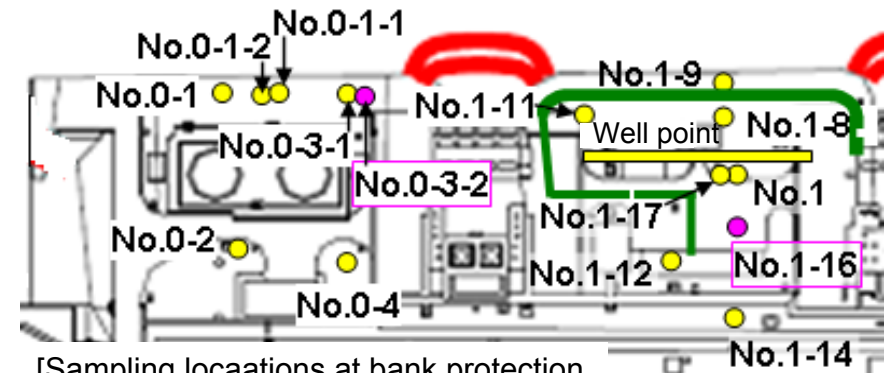

[Sampling locations at bank protection]


Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Pumped Water Obtained from Bank Protection) (2/2)

Unit: Bq/L

		Pumped water from groundwater observation hole No.0-3-2	Pumped water from groundwater observation hole No.1-16
Date of Sampling		Dec 13, 2013	12月13日
Time of sampling		12:00 PM	12:00 PM
Cs-134 (Approx. 2 years)		ND(0.41)	3.1
Cs-137 (Approx.30 years)		ND(0.47)	1.3
The other γ	Co-60 (Approx. 5 years)	ND	0.86
	Sb-125 (Approx. 3 years)	ND	5.5
Gross β		ND(18)	1,400,000
H-3 (Approx. 12 years)		Under analysis	Under analysis

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* "-" indicates that the measurement was out of range.

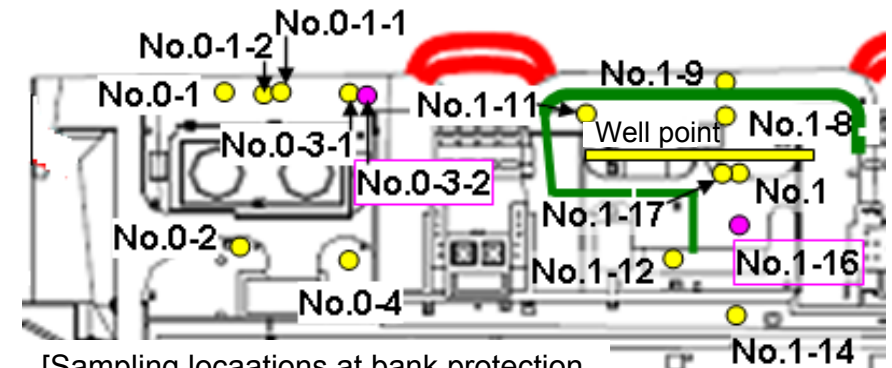

[Sampling locations at bank protection]