

## Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS &lt; 1/3 &gt;

(Data summarized on June 19)

Place of Sampling	Shallow Draft Quay at 1F				Inside Unit 1-4 Water Intake Canal (North) at 1F				1F Unit 1 Screen (Outside the Silt Fence)		1F Unit 1 Screen (Inside the Silt Fence)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Jun 18, 2013 5:55 AM		N/A		Jun 18, 2013 5:59 AM		N/A		Jun 18, 2013 6:02 AM		Jun 18, 2013 6:06 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	-	-	ND	-	-	-	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	-	-	9.4	0.16	-	-	2.3	0.04	2.1	0.04	60
Cs-137 (Approx. 30 years)	3.9	0.04	-	-	15	0.17	-	-	4.9	0.05	3.5	0.04	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides is under evaluation.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 2Bq/L, Cs-134: Approx.2Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

## Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS &lt; 2/3 &gt;

(Data summarized on June 19)

Place of Sampling	1F Unit 2 Screen (Outside the Silt Fence)		1F Unit 2 Screen (Inside the Silt Fence)		1F Unit 3 Screen (Outside the Silt Fence)		1F Unit 3 Screen (Inside the Silt Fence)		1F Unit 4 Screen (Outside the Silt Fence)		1F Unit 4 Screen (Inside the Silt Fence)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Time of Sampling	Jun 18, 2013 6:08 AM		Jun 18, 2013 6:09 AM		Jun 18, 2013 6:11 AM		Jun 18, 2013 6:13 AM		Jun 18, 2013 6:15 AM		Jun 18, 2013 6:16 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	2.2	0.04	ND	-	ND	-	ND	-	19	0.32	60
Cs-137 (Approx. 30 years)	4.3	0.05	4.8	0.05	7.7	0.09	21	0.23	ND	-	35	0.39	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides is under evaluation.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 8Bq/L, Cs-134: Approx.15Bq/L, Cs-137: Approx.20Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS < 3/3 >

(Data summarized on June 19)

Place of Sampling	Inside Unit 1-4 Water Intake Canal (South) at 1F		Port Entrance of Fukushima Daiichi NPS		In Front of Unit 6 Water Intake Canal at 1F								② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling	Jun 18, 2013 6:20 AM	N/A		Jun 18, 2013 6:45 AM								
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	-	-	ND	-							40
Cs-134 (Approx. 2 years)	5.2	0.09	-	-	ND	-							60
Cs-137 (Approx. 30 years)	12	0.13	-	-	ND	-							90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides is under evaluation.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 2Bq/L, Cs-134: Approx.2Bq/L, Cs-137: Approx.1Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Dec 10, 2012		
Detected Nuclides (Half-life)	① Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	6.5	0.11	60
Cs-137 (Approx. 30 years)	13	0.14	90
H-3 (approx. 12yrs)	100	0.00	60,000
All α	ND	—	—
All β	170	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on December 11.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 1.4Bq/L, All α: Approx. 0.12Bq/L

\* "\*" indicates the samples are under analysis.

(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Jan 14, 2013		
Detected Nuclides (Half-life)	① Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	3.5	0.06	60
Cs-137 (Approx. 30 years)	5.7	0.06	90
H-3 (approx. 12yrs)	110	0.00	60,000
All α	ND	—	—
All β	170	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on January 15.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 0.87Bq/L, All α: Approx. 0.10Bq/L

\* "\*" indicates the samples are under analysis.

(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Feb 11, 2013		
Detected Nuclides (Half-life)	① Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	3.7	0.06	60
Cs-137 (Approx. 30 years)	10	0.11	90
H-3 (approx. 12yrs)	170	0.00	60,000
All α	ND	—	—
All β	260	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on February 12.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 1.1Bq/L, All α: Approx. 0.10Bq/L

\* "\*" indicates the samples are under analysis.

(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Mar 11, 2013		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	31	0.52	60
Cs-137 (Approx. 30 years)	56	0.62	90
H-3 (approx. 12yrs)	120	0.00	60,000
All α	ND	—	—
All β	230	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on March 12.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 1.5Bq/L, All α: Approx. 0.11Bq/L

\* "\*" indicates the samples are under analysis.

(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Apr 15, 2013		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	ND	—	60
Cs-137 (Approx. 30 years)	6	0.07	90
H-3 (approx. 12yrs)	110	0.00	60,000
All α	ND	—	—
All β	140	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on April 16.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 1.2Bq/L, Cs-134: Approx. 2.5Bq/L, All α: Approx. 0.13Bq/L

\* "\*" indicates the samples are under analysis.

(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.



## Nuclides Analysis Result of Radioactive Materials in the Unit 1-4 Water Intake

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	May 13, 2013		
Detected Nuclides (Half-life)	① Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	9.2	0.15	60
Cs-137 (Approx. 30 years)	16	0.18	90
H-3 (approx. 12yrs)	290	0.00	60,000
All α	ND	—	—
All β	490	—	—
Sr-89 (Approx. 51 days)	*	—	300
Sr-90 (Approx. 29 years)	*	—	30

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on May 14.

\* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.


I-131: Approx. 1.3Bq/L, All α: Approx. 0.13Bq/L

\* "\*" indicates the samples are under analysis.


(Evaluation)

Although H-3 and all β was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.


Radioactivity Density of the Seawater in Front of the Shallow Draft Quay at 1F (Bq/L)

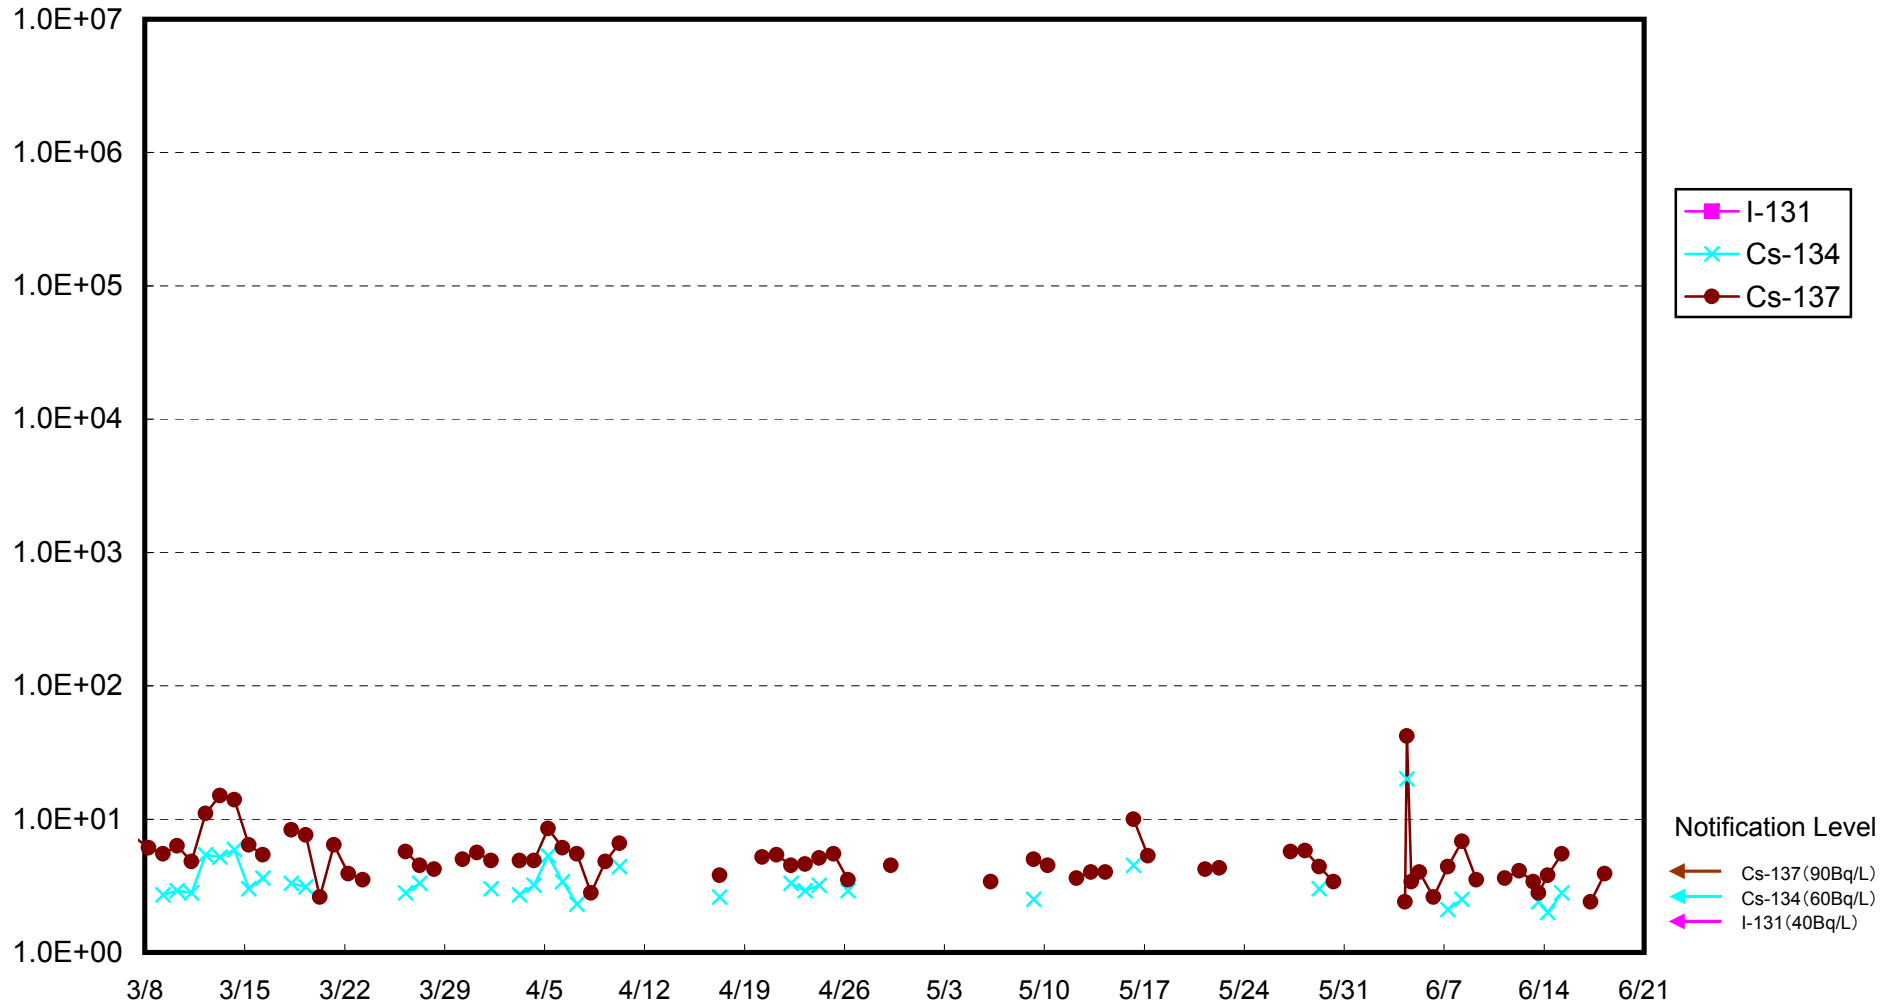


Radioactivity Density of the Seawater at the North of Unit 1-4 Water Intake of Fukushima Daiichi NPS (Bq/ L)

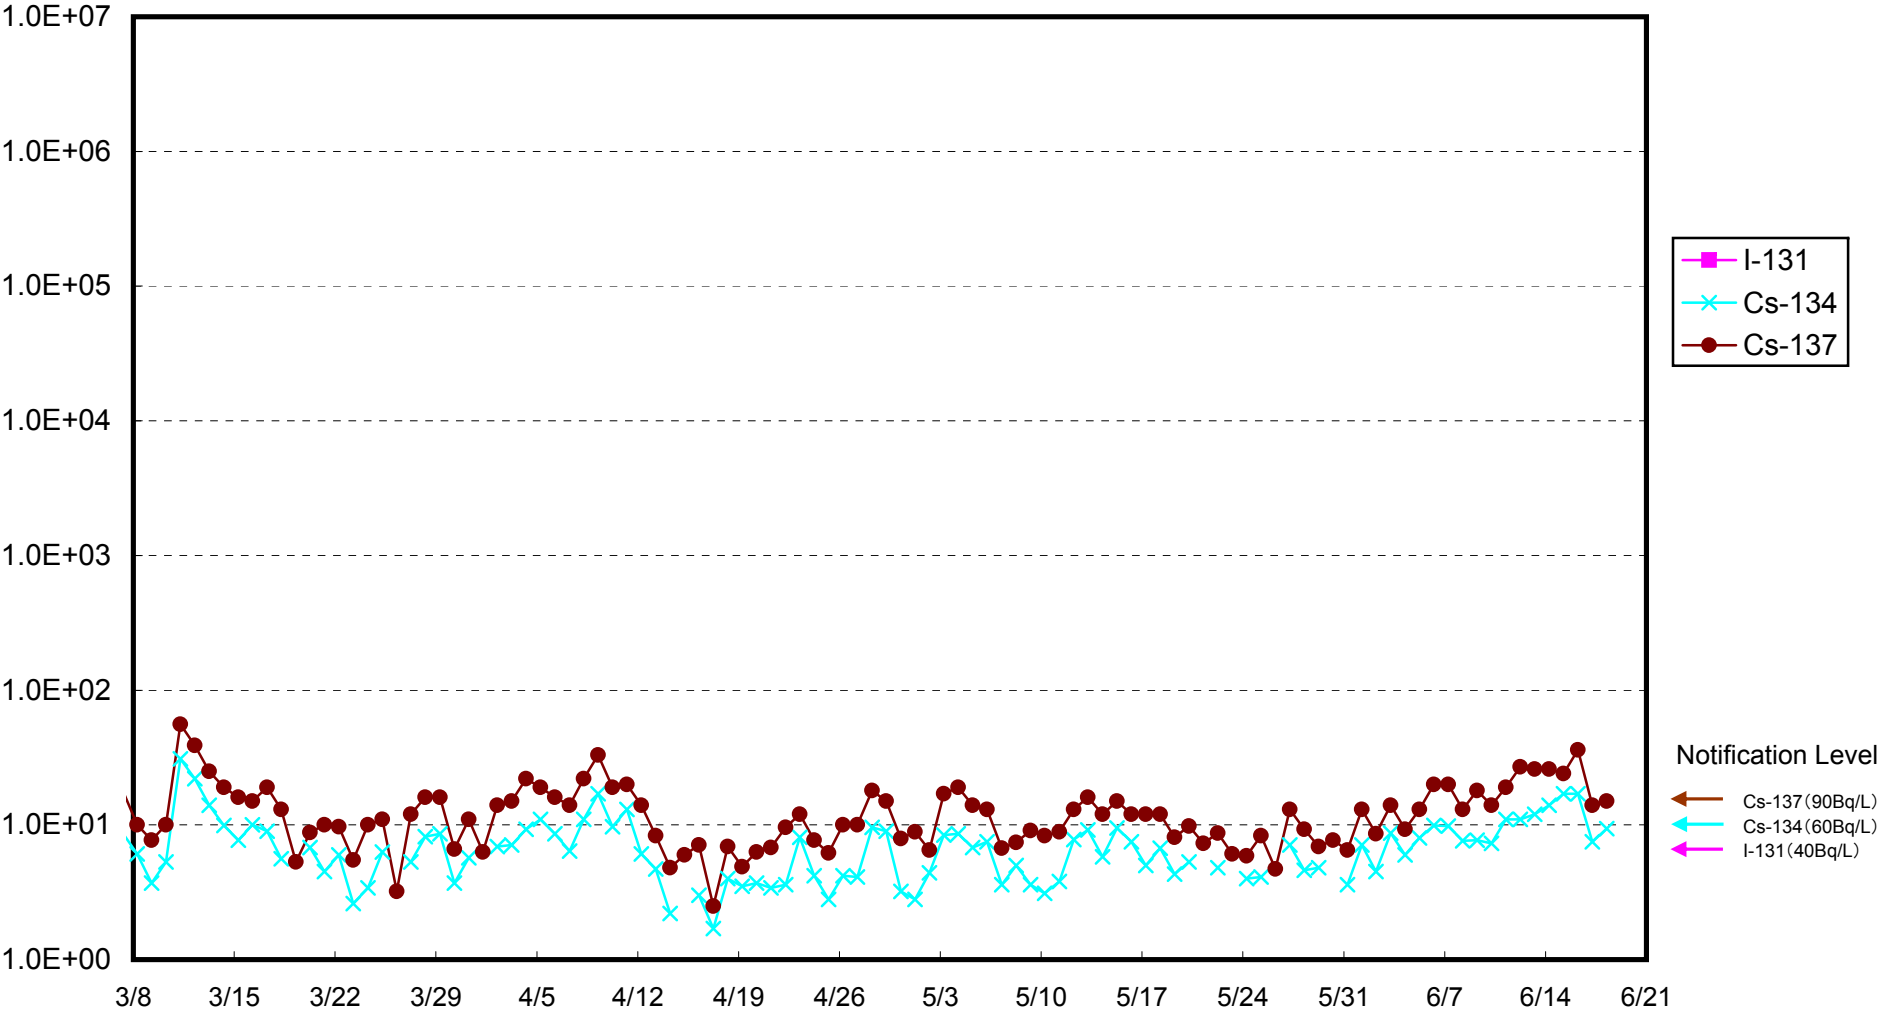


Radioactivity Density of the Seawater at Unit 1 Screen at 1F (Outside the Silt Fence) (Bq/L)

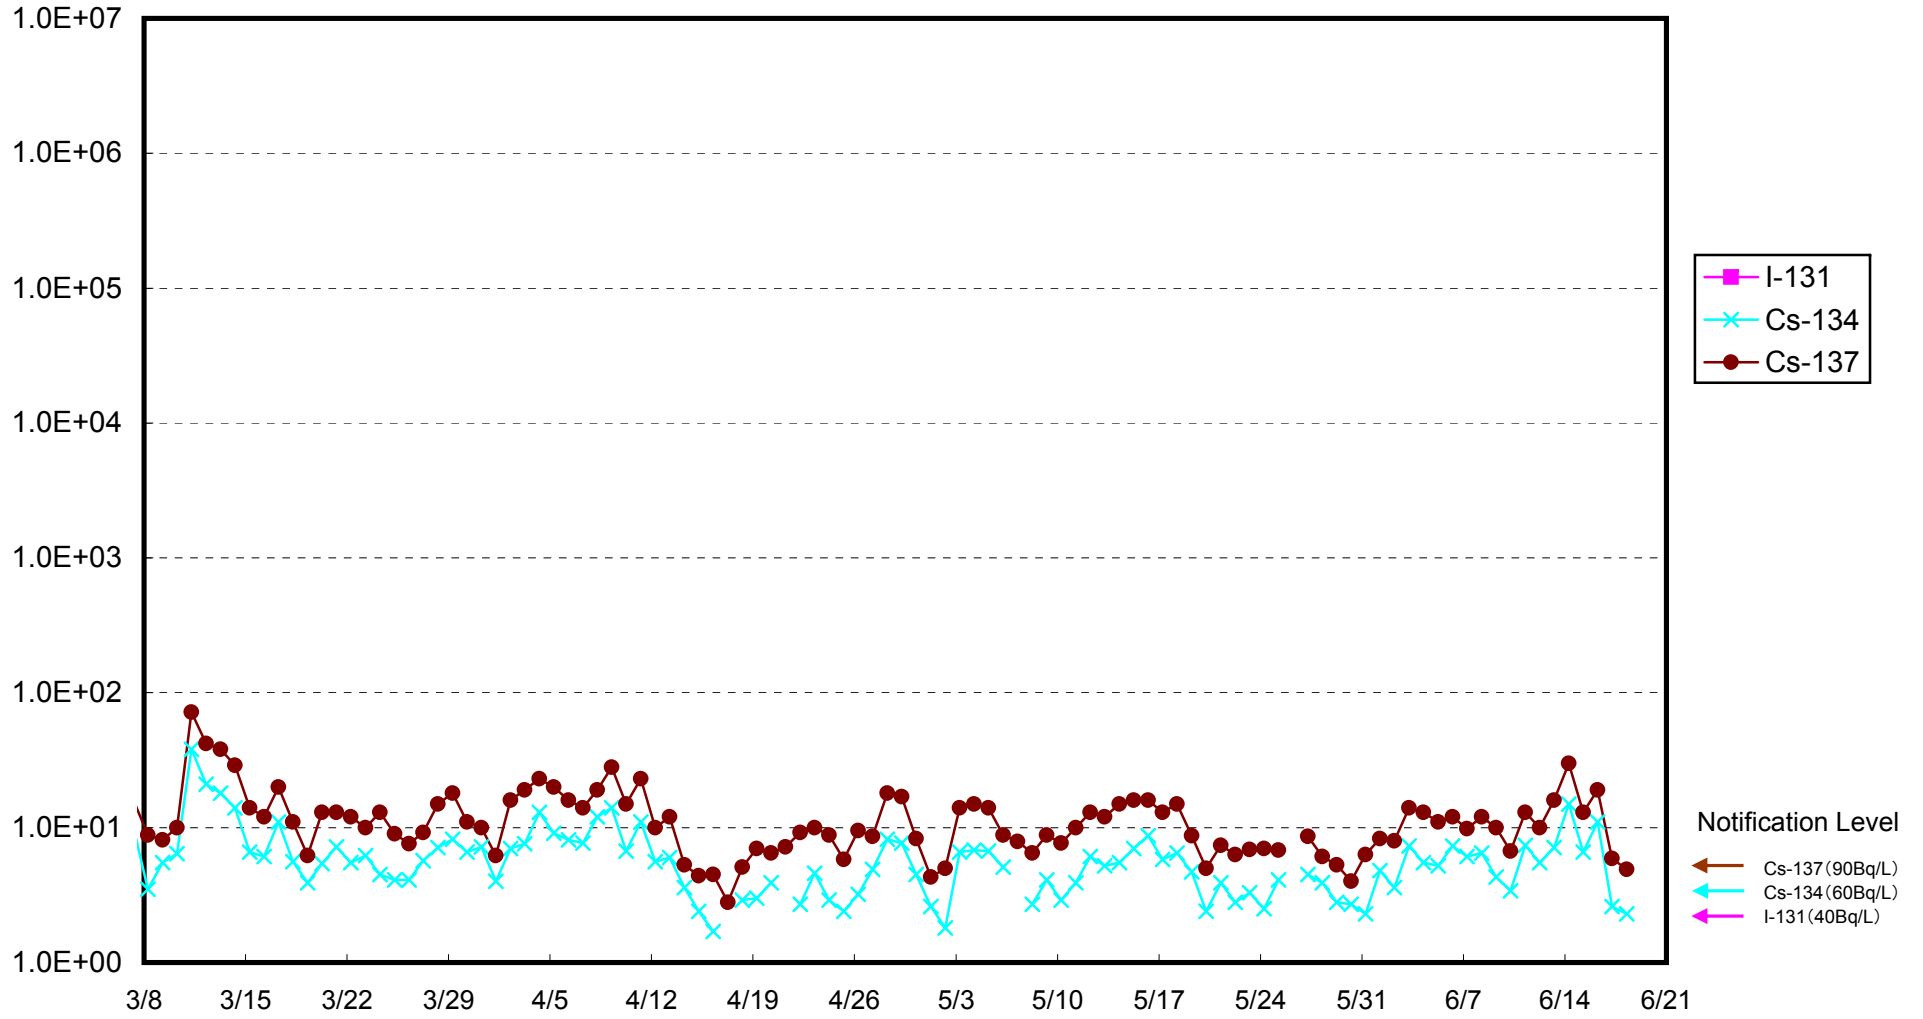


Radioactivity Density of the Seawater at Unit 1 Screen at 1F (Inside the Silt Fence) (Bq/L)

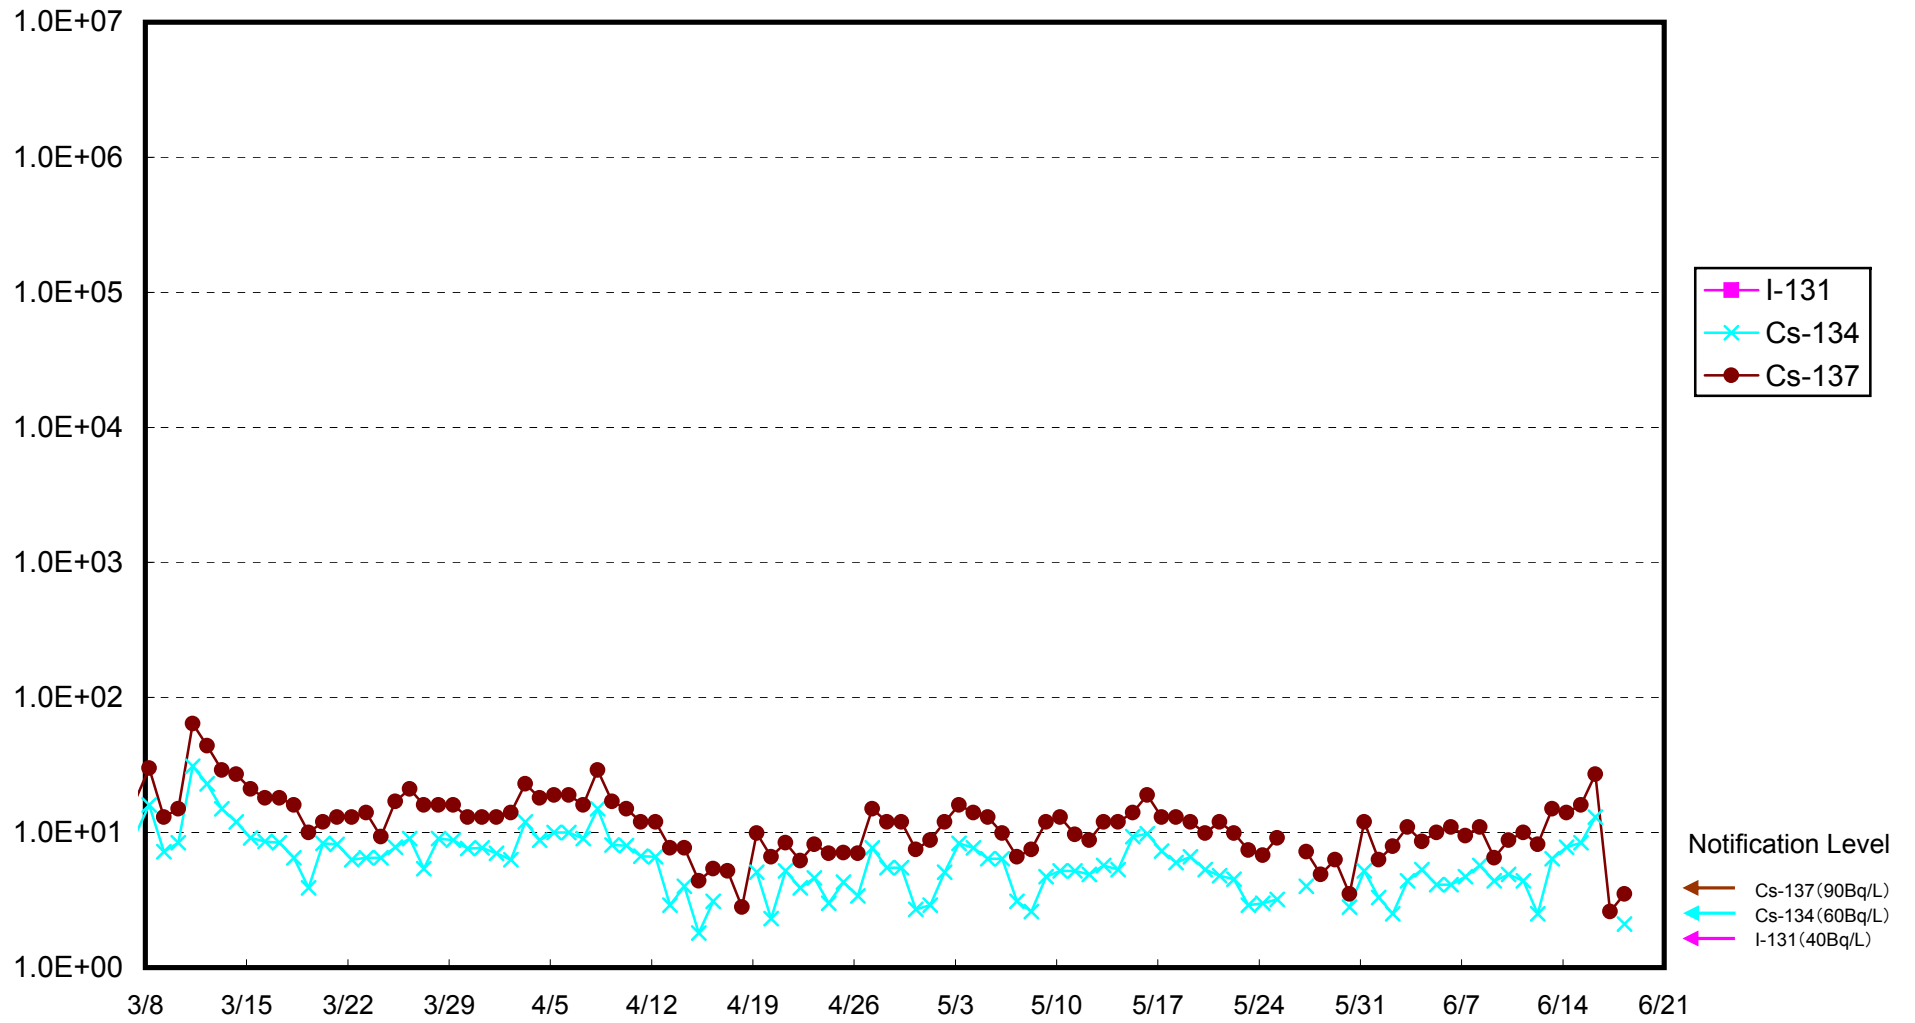


Radioactivity Density of the Seawater at Unit 2 Screen at 1F (Outside the Silt Fence) (Bq/L)

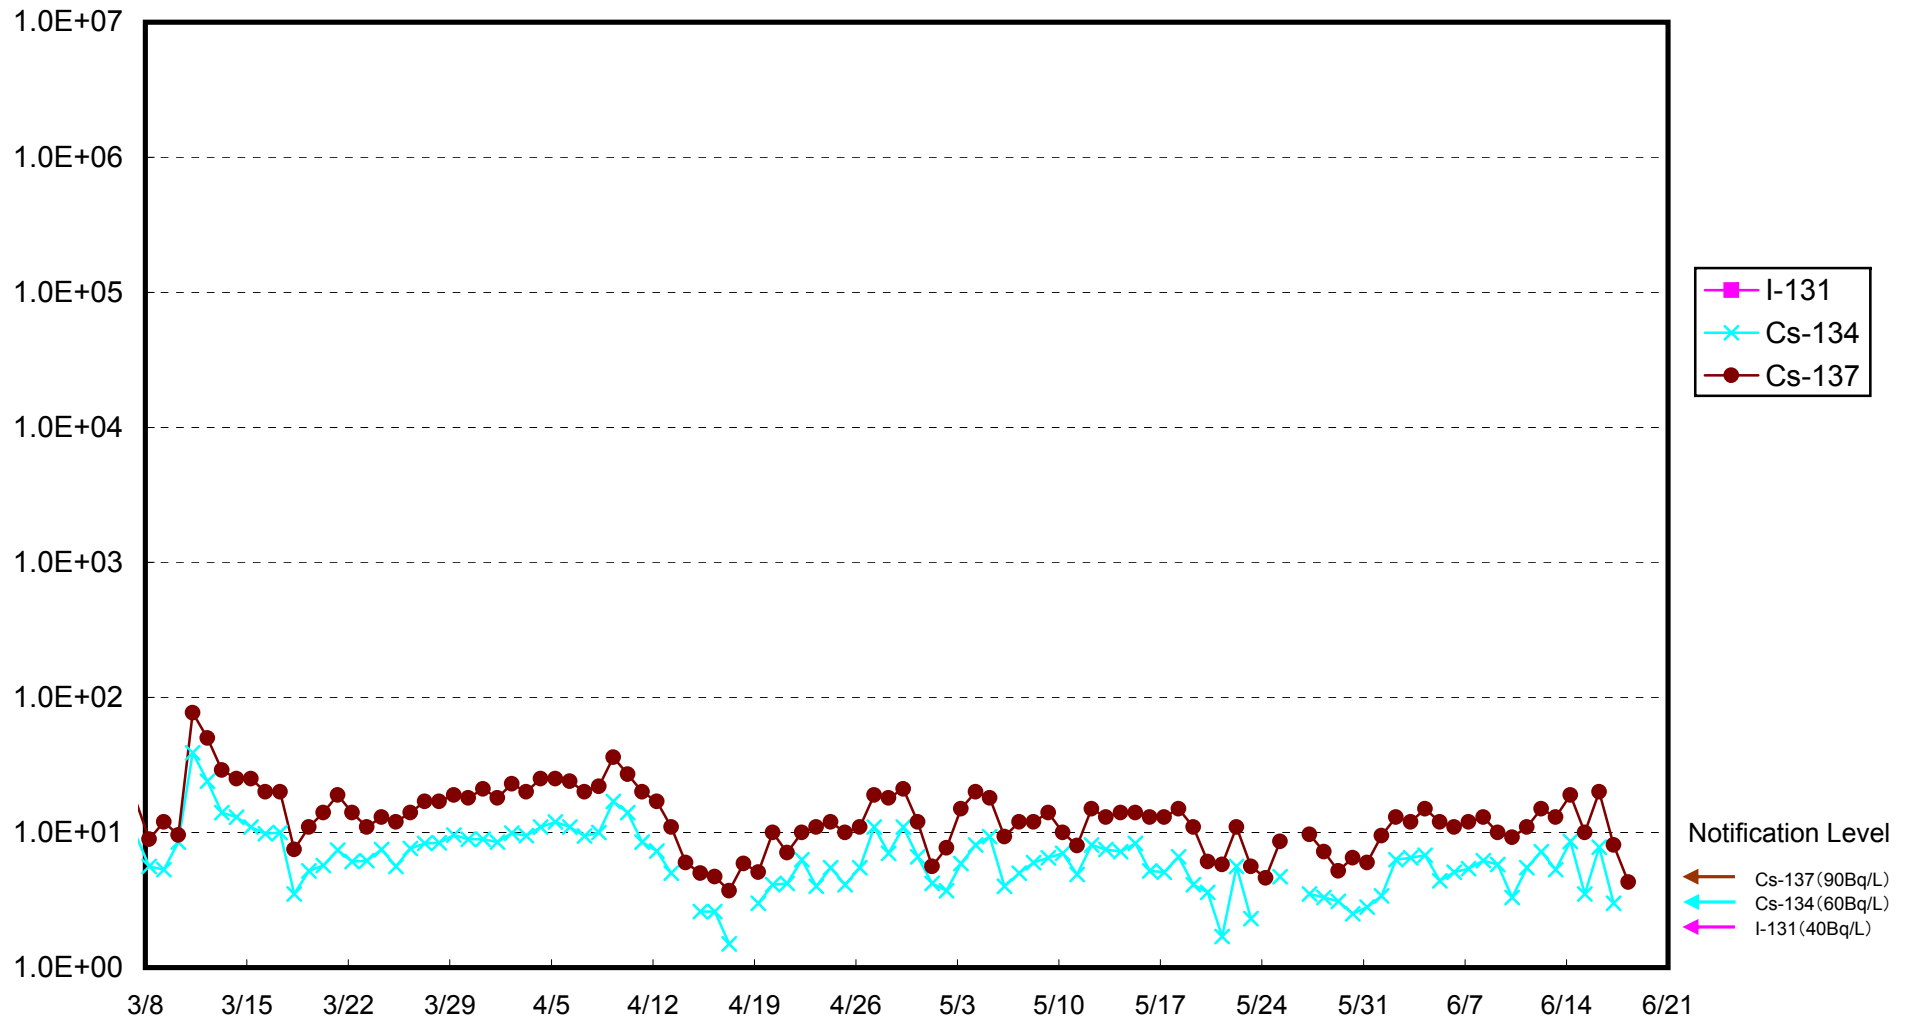

Radioactivity Density of the Seawater at Unit 2 Screen at 1F (Inside the Silt Fence) (Bq/L)

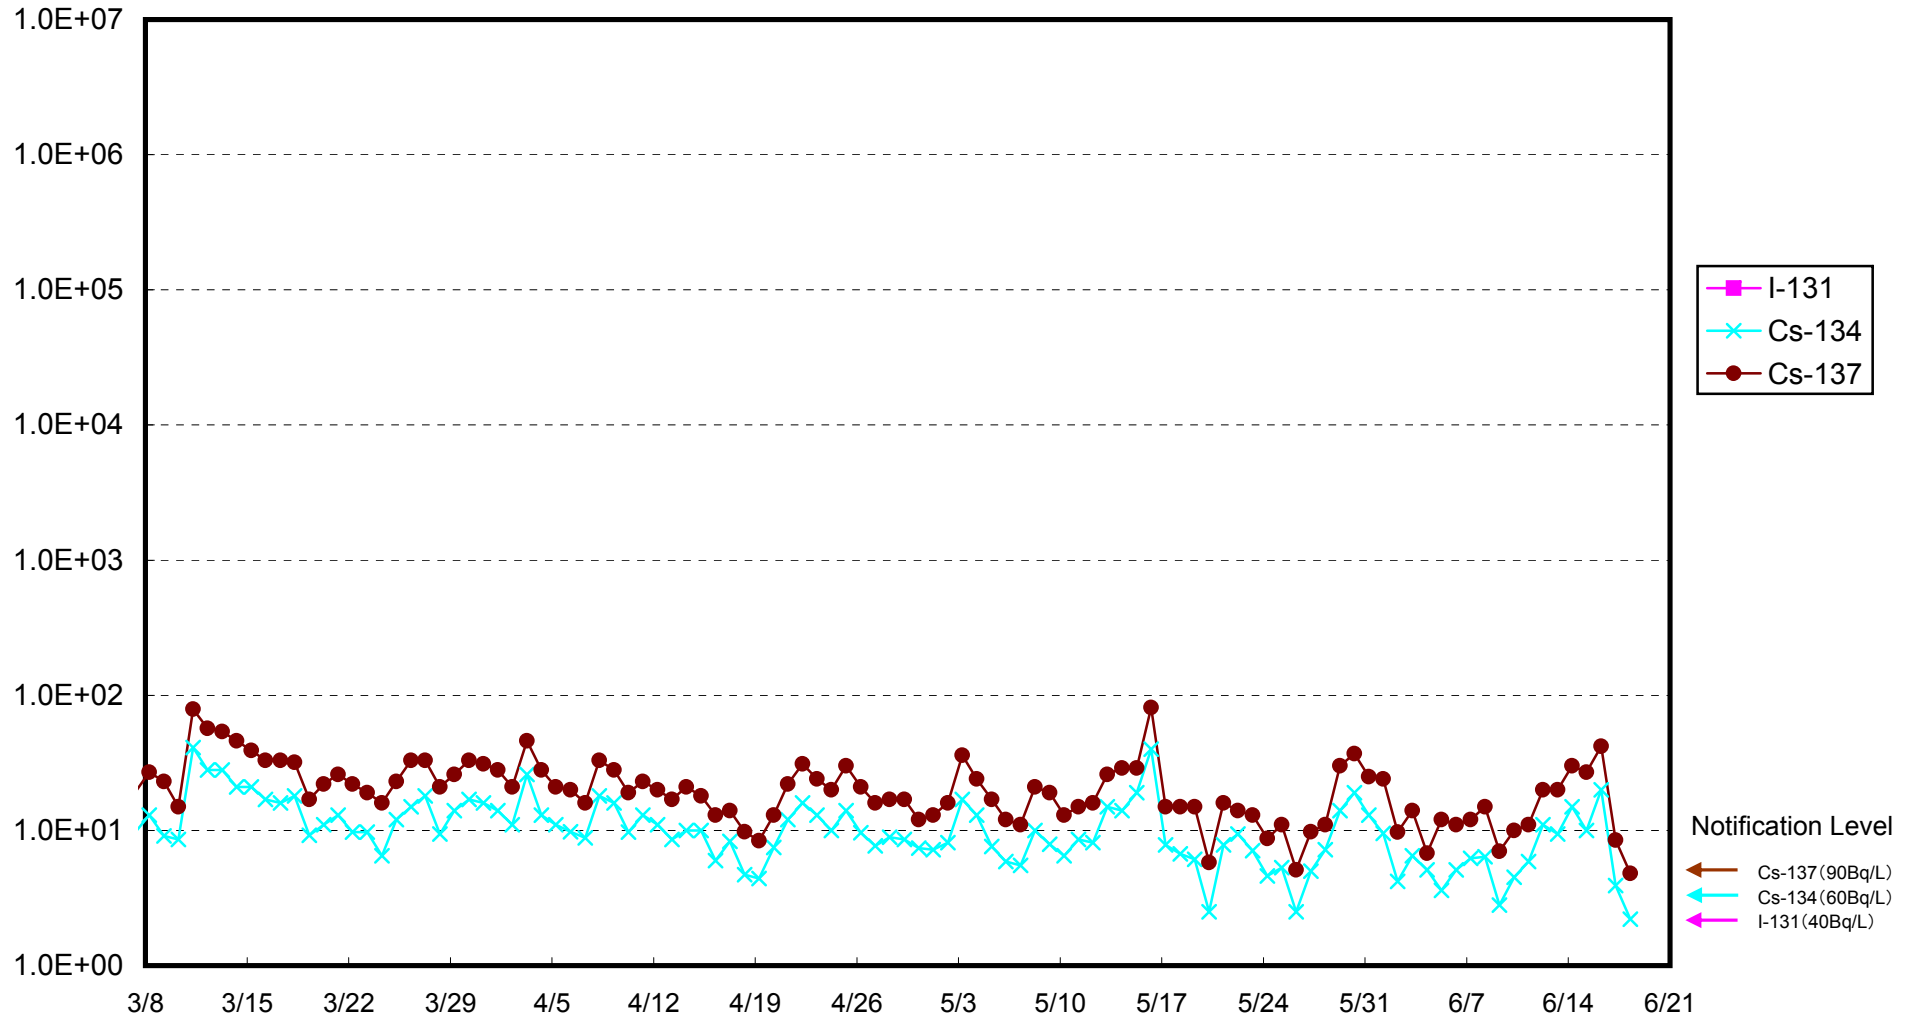


Radioactivity Density of the Seawater at Unit 3 Screen at 1F (Outside the Silt Fence) (Bq/L)

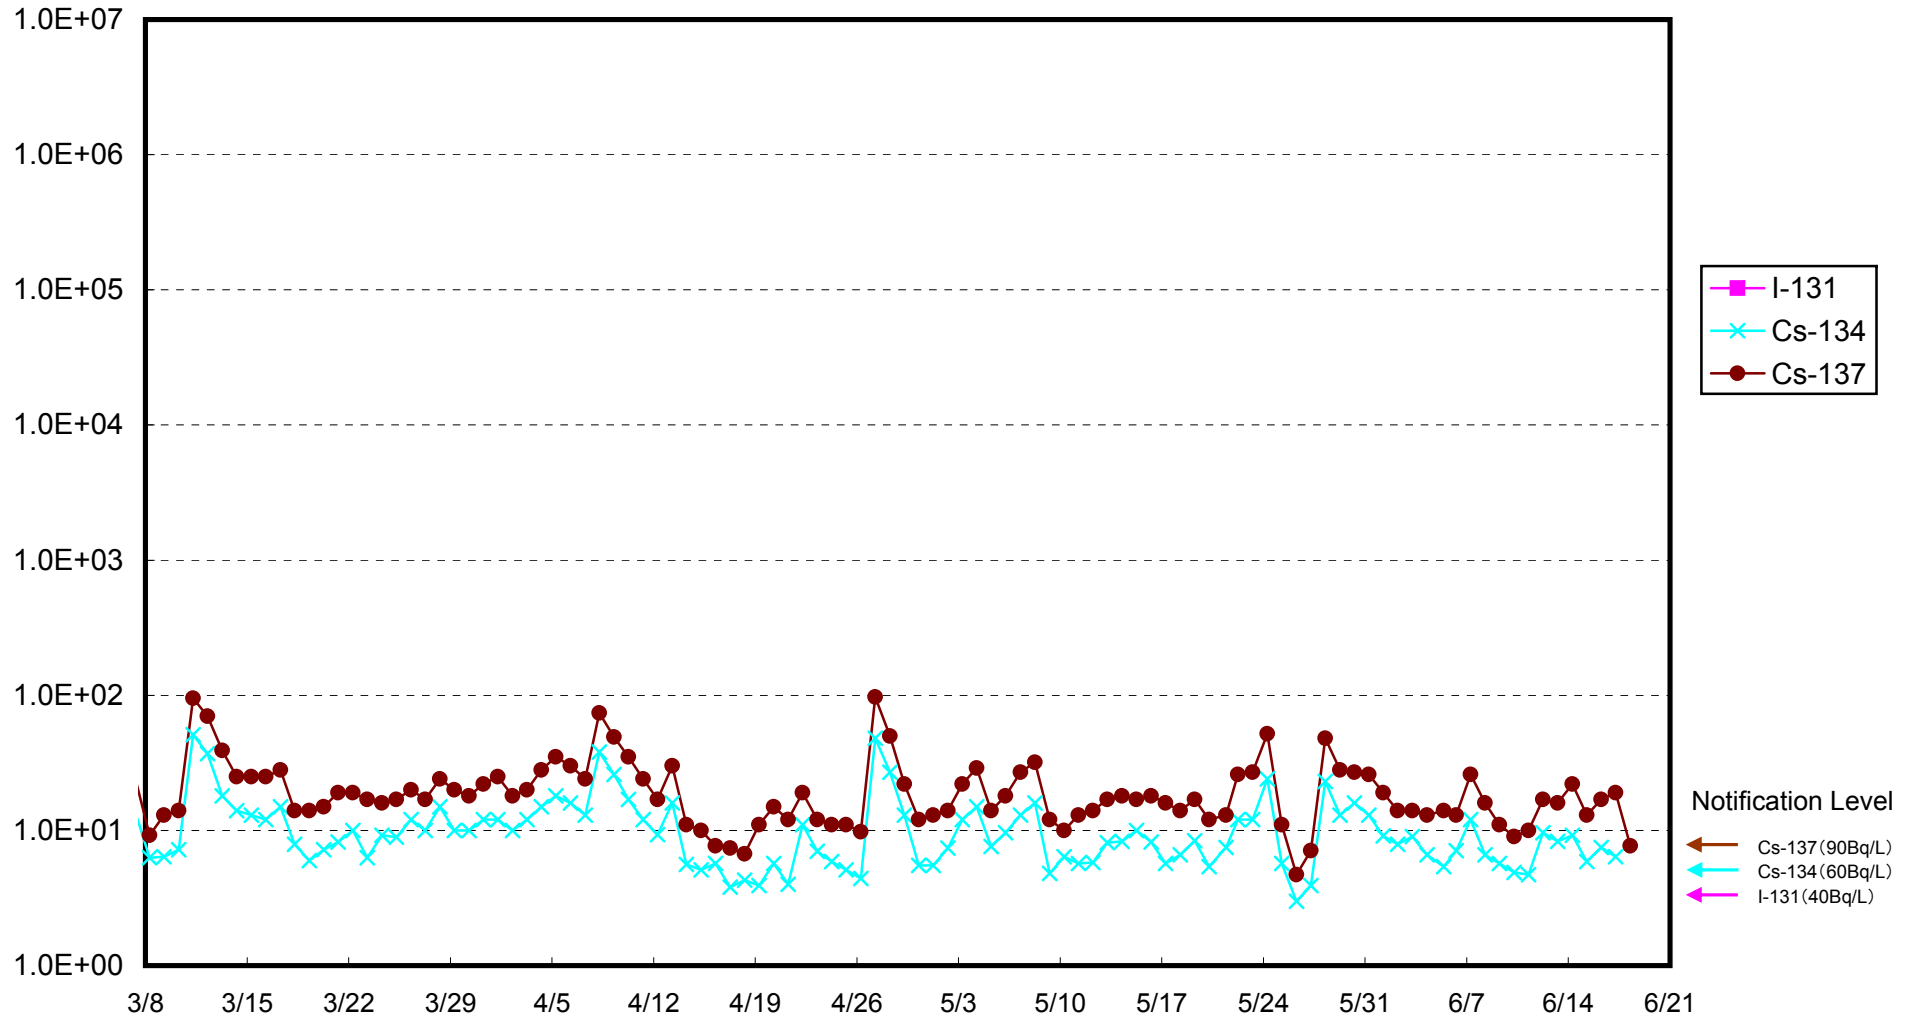





Radioactivity Density of the Seawater at Unit 3 Screen at 1F (Inside the Silt Fence) (Bq/L)

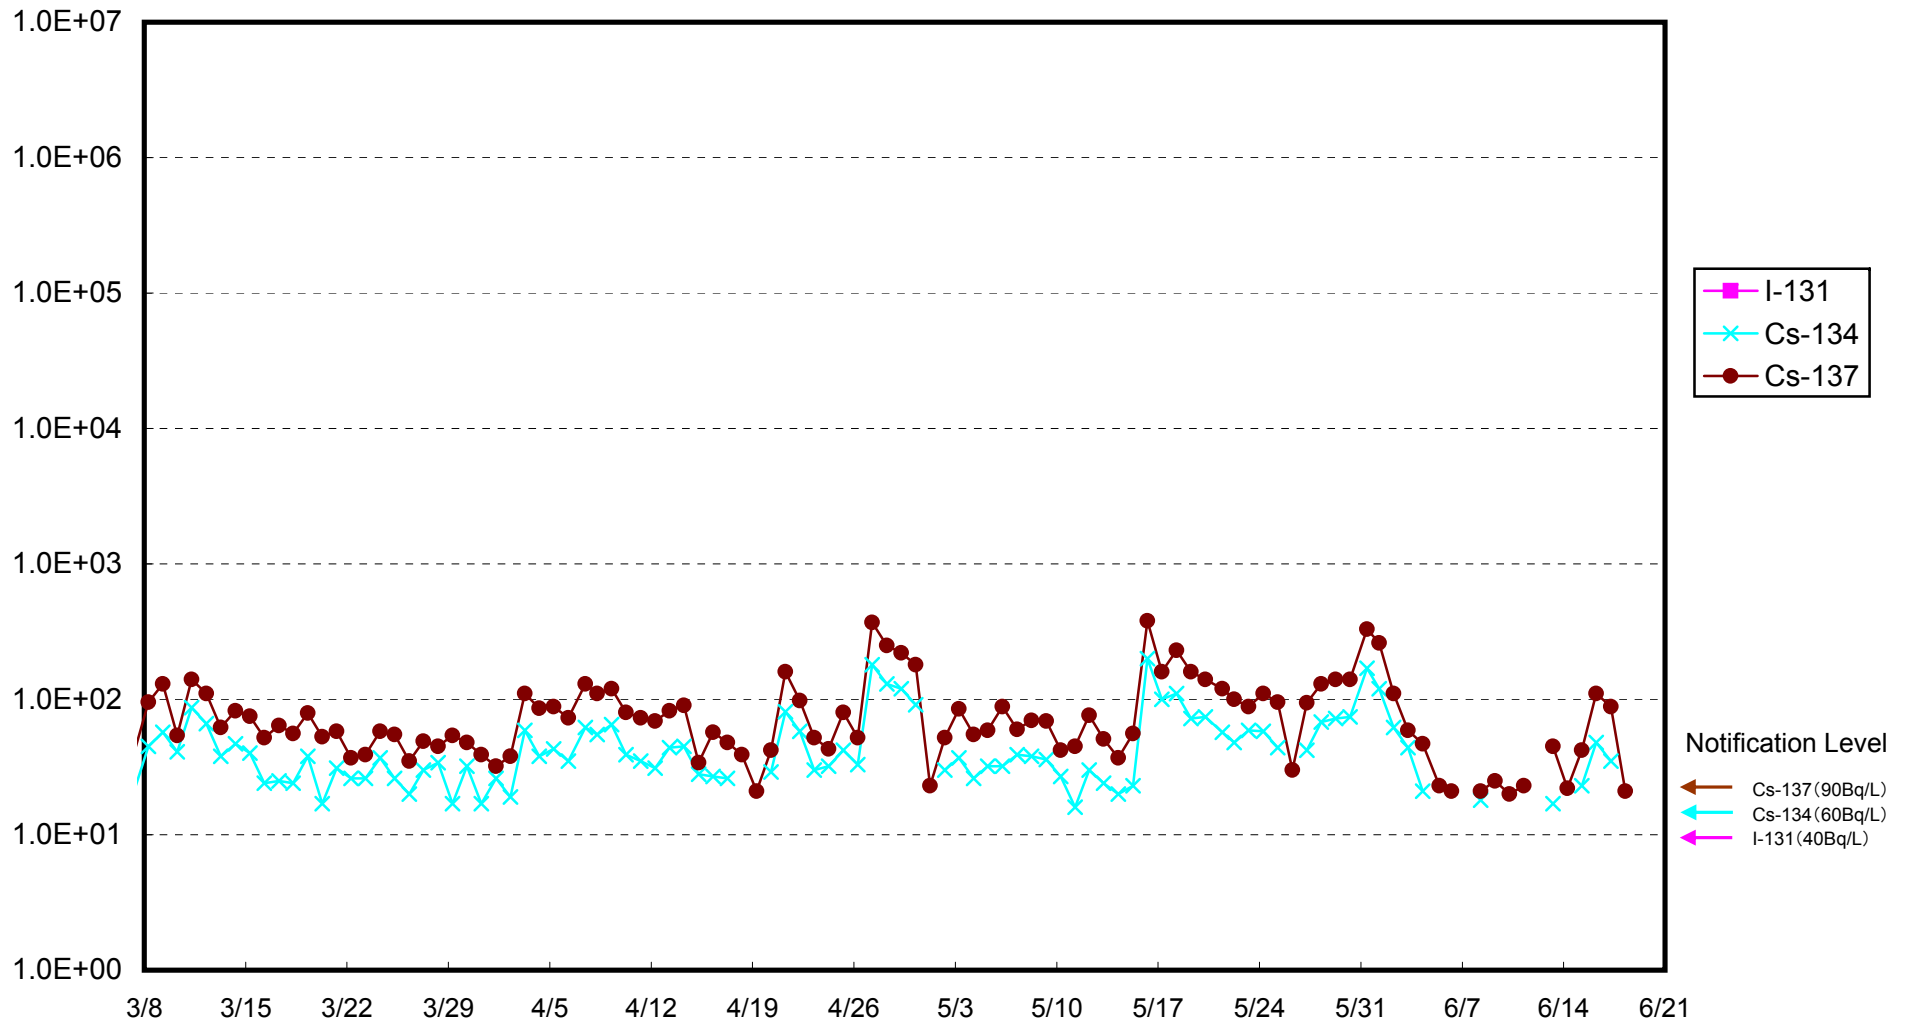


Radioactivity Density of the Seawater at Unit 4 Screen at 1F (Outside the Silt Fence) (Bq/L)

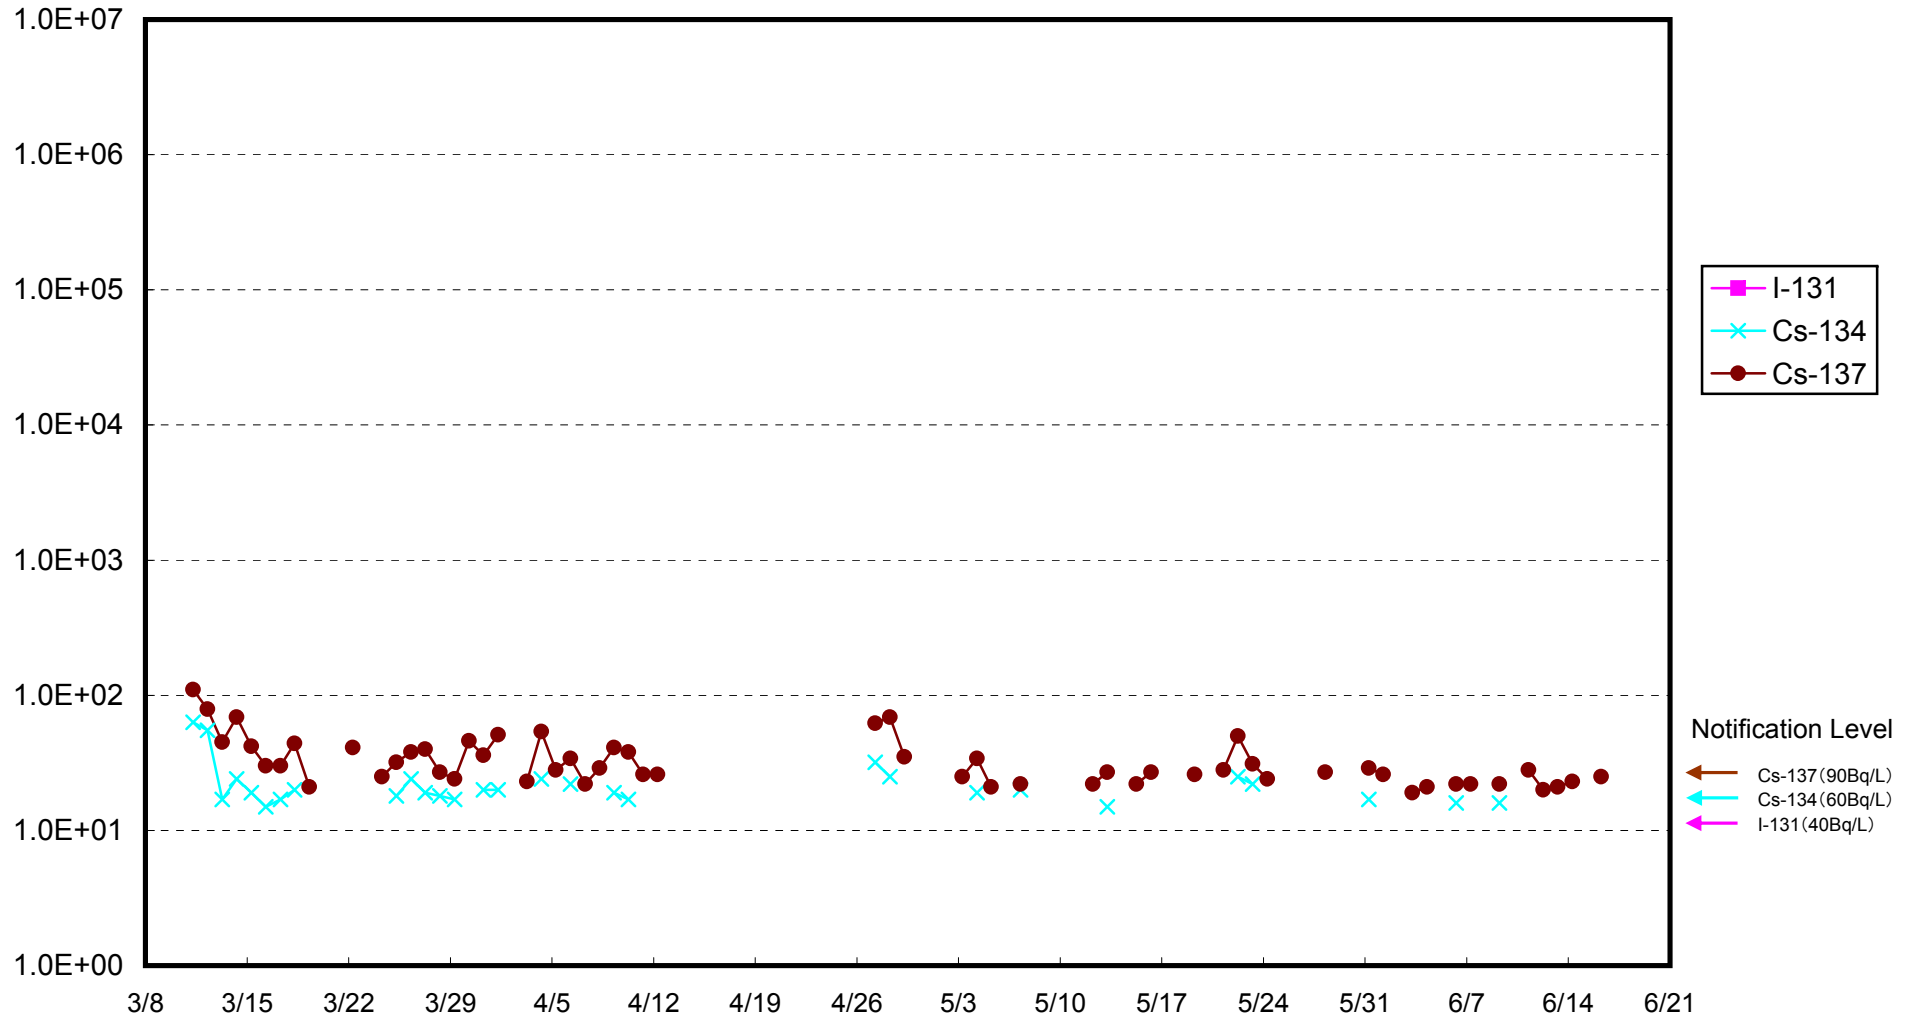

Radioactivity Density of the Seawater at Unit 4 Screen at 1F (Inside the Silt Fence) (Bq/L)

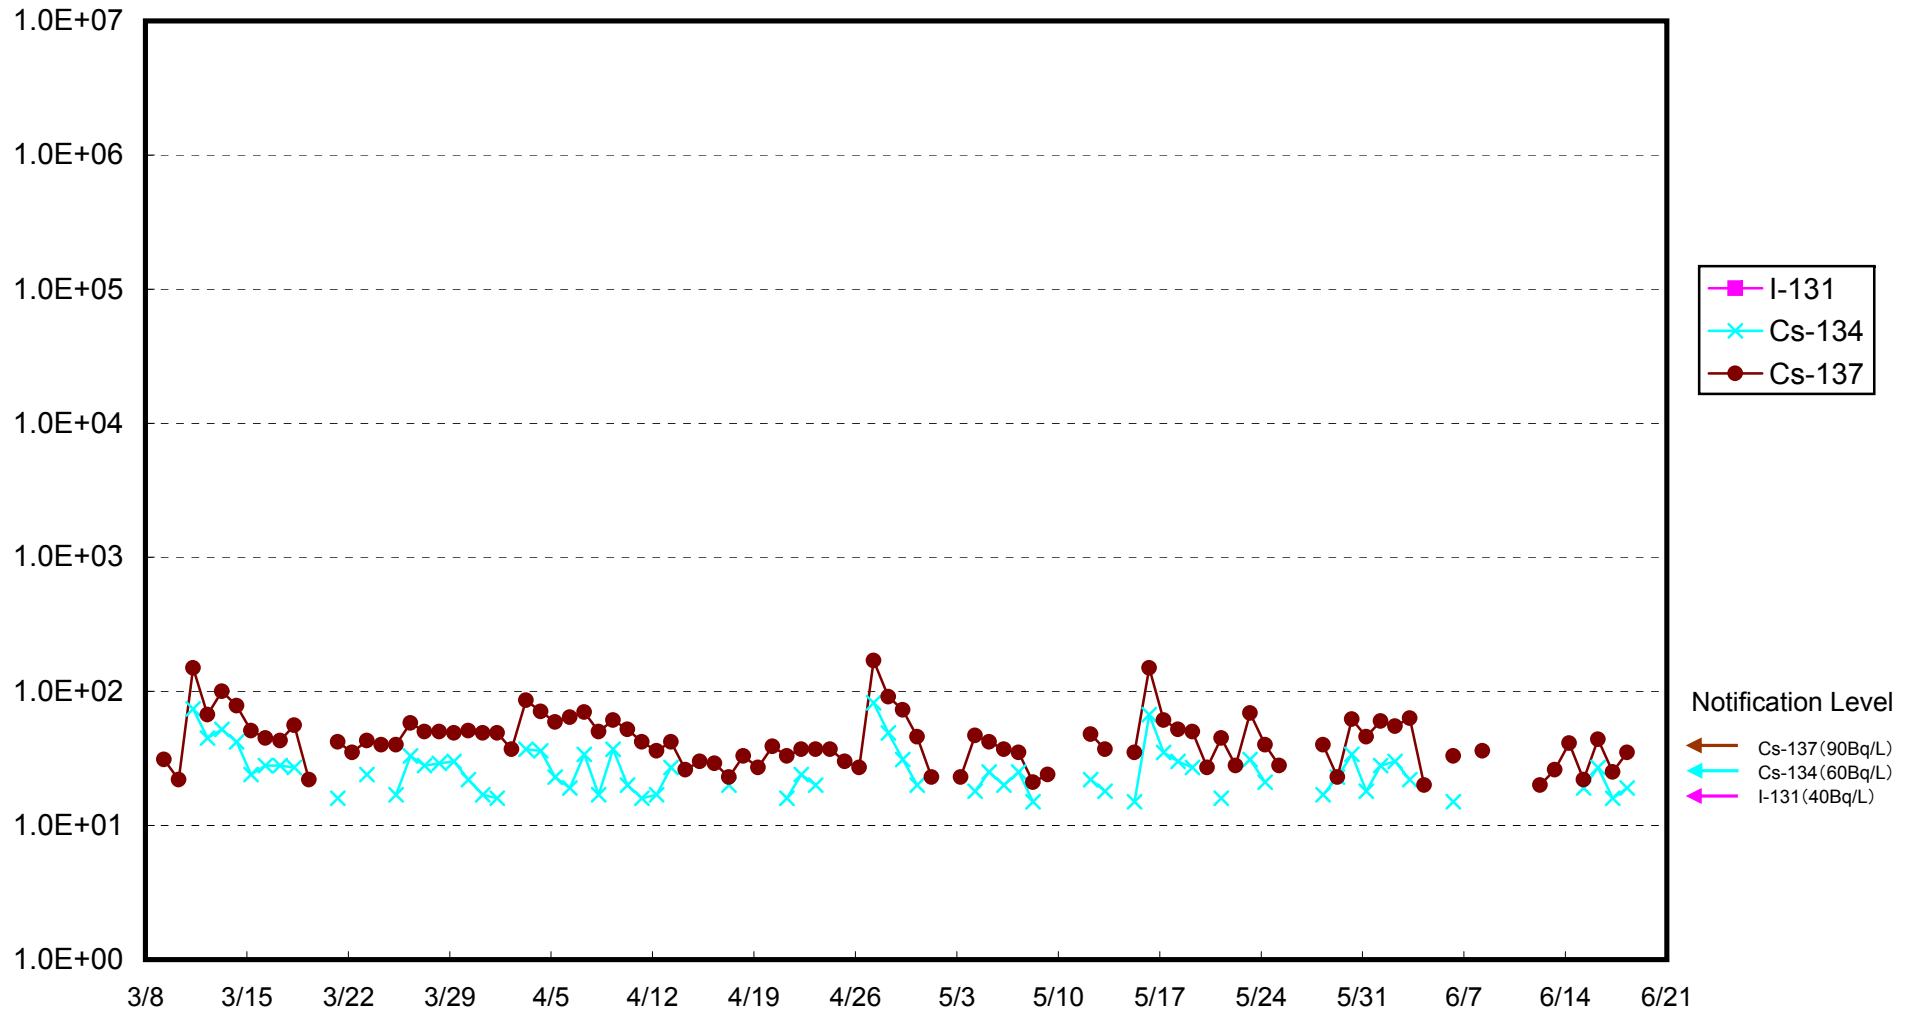

Radioactivity Density of the Seawater at the South of Unit 1-4 Water Intake of Fukushima Daiichi NPS (Bq/ L)

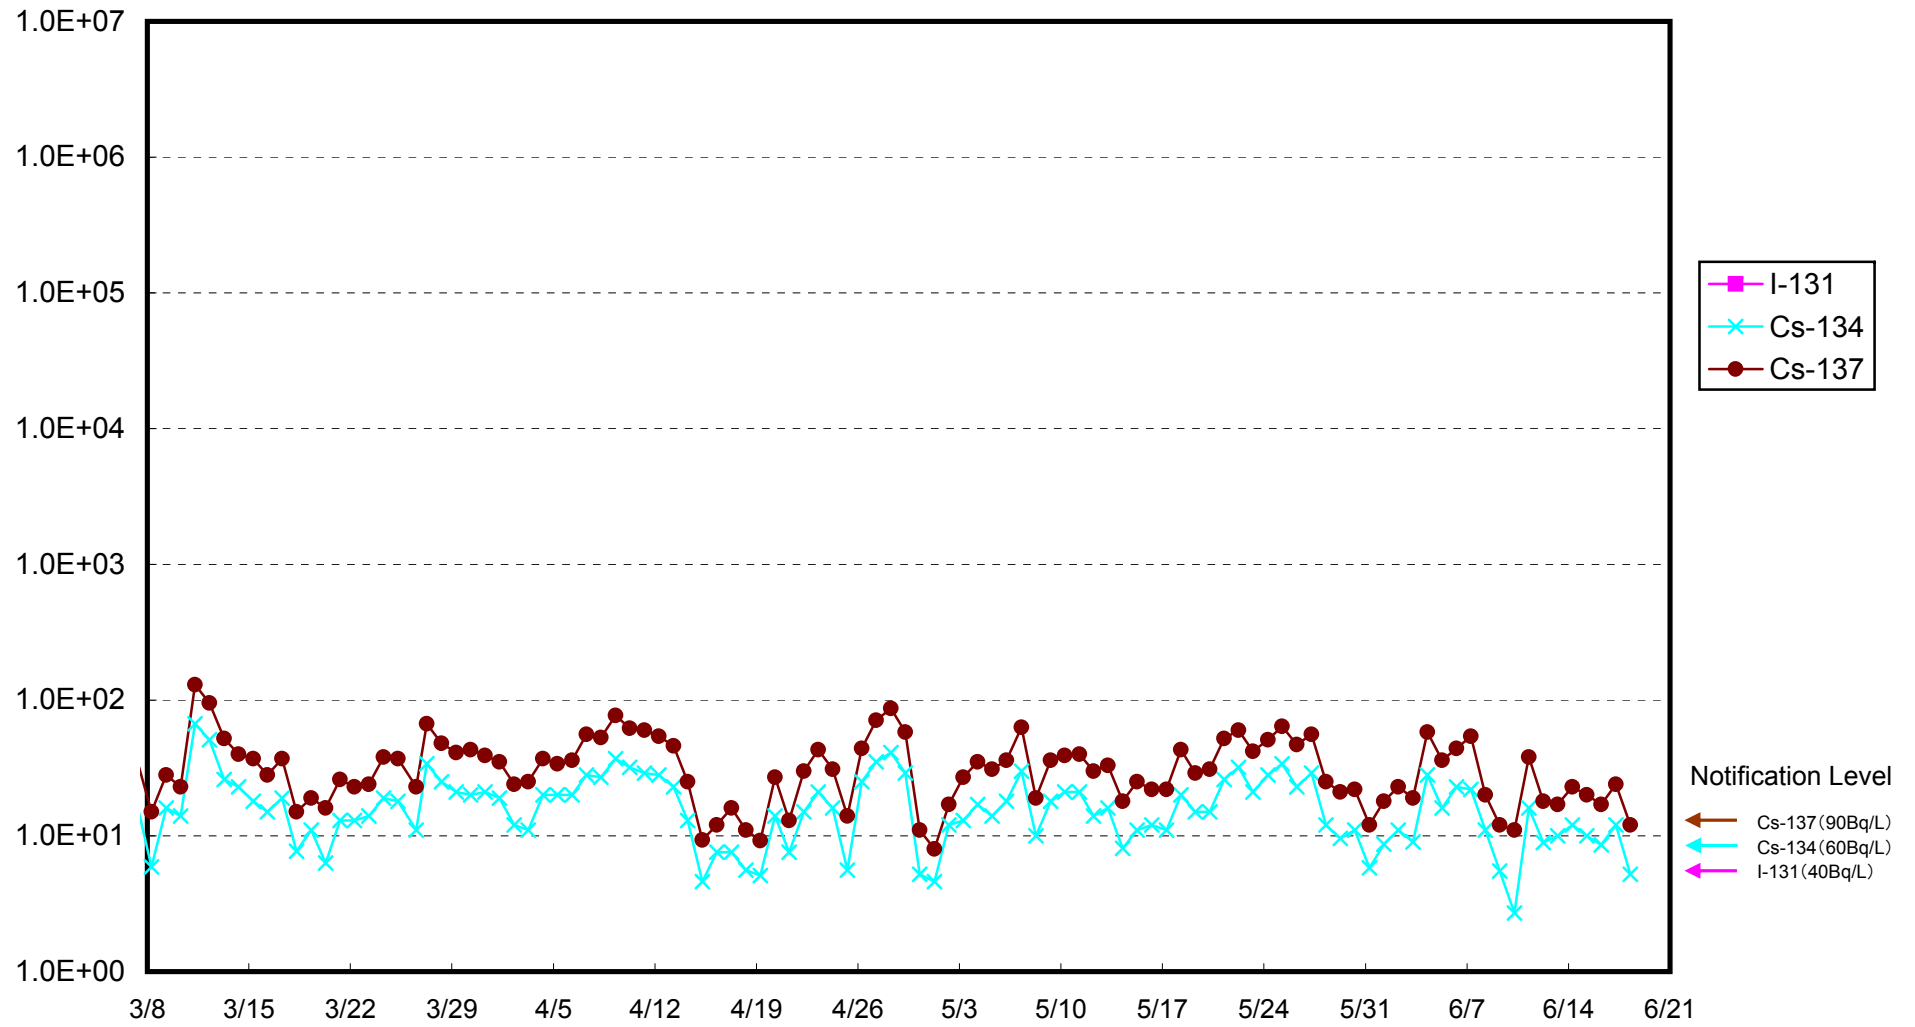

Radioactive Density of the Seawater in Front of Unit 6 Water Intake at Fukushima Daiichi NPS (Bq/L)

