

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on July 23)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling Jul 22, 2013 5:50 AM		Time of Sampling Jul 22, 2013 5:15 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	ND	-	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 1.2Bq/L, Cs-134: Approx. 1.4Bq/L, Cs-137: Approx. 1.4Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of Radioactive Materials in the Seawater

(Data summarized on July 23)

Place of Sampling (Place No.)	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel) (T-1)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel) (T-2-1)		/		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Date of Sampling	Jun 10, 2013		Jun 10, 2013		/	
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	ND	—	/	/	40
Cs-134 (Approx. 2 years)	ND	—	ND	—	/	/	60
Cs-137 (Approx. 30 years)	ND	—	ND	—	/	/	90
H-3 (approx. 12yrs)	ND	—	ND	—	/	/	60,000
All α	ND	—	ND	—	/	/	—
All β	ND	—	ND	—	/	/	—
Sr-90 (Approx. 29 years)	0.26	0.01	0.15	0.01	/	/	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of I-131, Cs-134, Cs-137 and All β obtained at "Around South Discharge Channel of Fukushima Daiichi NPS" were announced on Ju

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 0.90Bq/L, Cs-134: Approx. 1.4Bq/L, Cs-137: Approx. 1.3Bq/L,

H-3: Approx. 3.1Bq/L, All α: Approx. 2.8Bq/L, All β: Approx. 20Bq/L,

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis of Sr-90 was done by Japan Chemical Analysis Center.

(Evaluation)

Although Sr-90 was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

Nuclides Analysis Result of Radioactive Materials in the Seawater <1/2>

(Data summarized on July 23)

Place of Sampling (Place No.)	15km Offshore of Fukushima Daiichi NPS (T-5) Upper Layer		3km Offshore of Ukedo River (T- D1) Upper Layer		3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Jun 5, 2013		Jun 4, 2013		Jun 4, 2013		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0023	0.00	0.014	0.00	0.011	0.00	60
Cs-137 (Approx. 30 years)	0.0065	0.00	0.026	0.00	0.024	0.00	90
H-3 (approx. 12yrs)	ND	—	ND	—	ND	—	60,000
All α	ND	—	ND	—	ND	—	—
All β	ND	—	ND	—	ND	—	—
Sr-90 (Approx. 29 years)	ND	—	ND	—	ND	—	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of Cs-134, Cs-137 were announced on July 12.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

H-3: Approx. 3.1Bq/L, All α: Approx. 3.6Bq/L, All β: Approx. 19Bq/L, Sr-90: 0.009Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis of Sr-90 was done by Japan Chemical Analysis Center.

(Evaluation)

H-3, All α radiation, All β radiation and Sr-90 were not detected in the sample collected this time.

Nuclides Analysis Result of Radioactive Materials in the Seawater <2/2>

(Data summarized on July 23)

Place of Sampling (Place No.)	3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Jun 5, 2013						
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0037	0.00					60
Cs-137 (Approx. 30 years)	0.0082	0.00					90
H-3 (approx. 12yrs)	ND	—					60,000
All α	ND	—					—
All β	ND	—					—
Sr-90 (Approx. 29 years)	ND	—					30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of Cs-134, Cs-137 were announced on July 12.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

H-3: Approx. 3.1Bq/L, All α: Approx. 3.6Bq/L, All β: Approx. 19Bq/L, Sr-90: Approx. 0.008Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis of Sr-90 was done by Japan Chemical Analysis Center.

(Evaluation)

H-3, All α radiation, All β radiation and Sr-90 were not detected in the sample collected this time.

Analysis Result of Pu in the Seawater

1. Measurement Result:

(Unit: Bq/L)

Place of Sampling	Date	Pu-238	Pu-239+Pu-240
1F, North of Unit 5-6 Discharge Channel	Jun 4, 2013	N.D. [$<5.2 \times 10^{-6}$]	N.D. [$<5.3 \times 10^{-6}$]
1F, Around South Discharge Channel	Jun 4, 2013	N.D. [$<6.3 \times 10^{-6}$]	N.D. [$<6.4 \times 10^{-6}$]
15km Offshore of Fukushima Daiichi NPS, Upper Layer	Jun 5, 2013	N.D. [$<6.5 \times 10^{-6}$]	N.D. [$<6.5 \times 10^{-6}$]
Around 3km Offshore of Ukedo River, Upper Layer	Jun 4, 2013	N.D. [$<6.1 \times 10^{-6}$]	N.D. [$<6.1 \times 10^{-6}$]
3km Offshore of Fukushima Daiichi NPS, Upper Layer	Jun 4, 2013	N.D. [$<5.9 \times 10^{-6}$]	N.D. [$<5.5 \times 10^{-6}$]
3km Offshore of Fukushima Daini NPS, Upper Layer	Jun 5, 2013	N.D. [$<5.9 \times 10^{-6}$]	N.D. [$<5.6 \times 10^{-6}$]
The range of the past measurement results obtained in the ocean near Fukushima Daiichi and Daini Nuclear Power Stations (FY2001 - FY2008)*		—	ND $\sim 1.3 \times 10^{-5}$

[] shows below the detection limit.

*: Source "Report on the environmental radioactivity measurement around the Nuclear Power Plant (2008)", Committee on the safety technology of Nuclear Power Plants in Fukushima.


2. Analytical Institution: Japan Chemical Analysis Center

3. Evaluation:

Pu-238 and Pu-239+Pu-240 were not detected in the sample collected this time.

End

Radioactivity Density of the Seawater at 1F Units 5-6 North Discharge Channel (Bq/L)

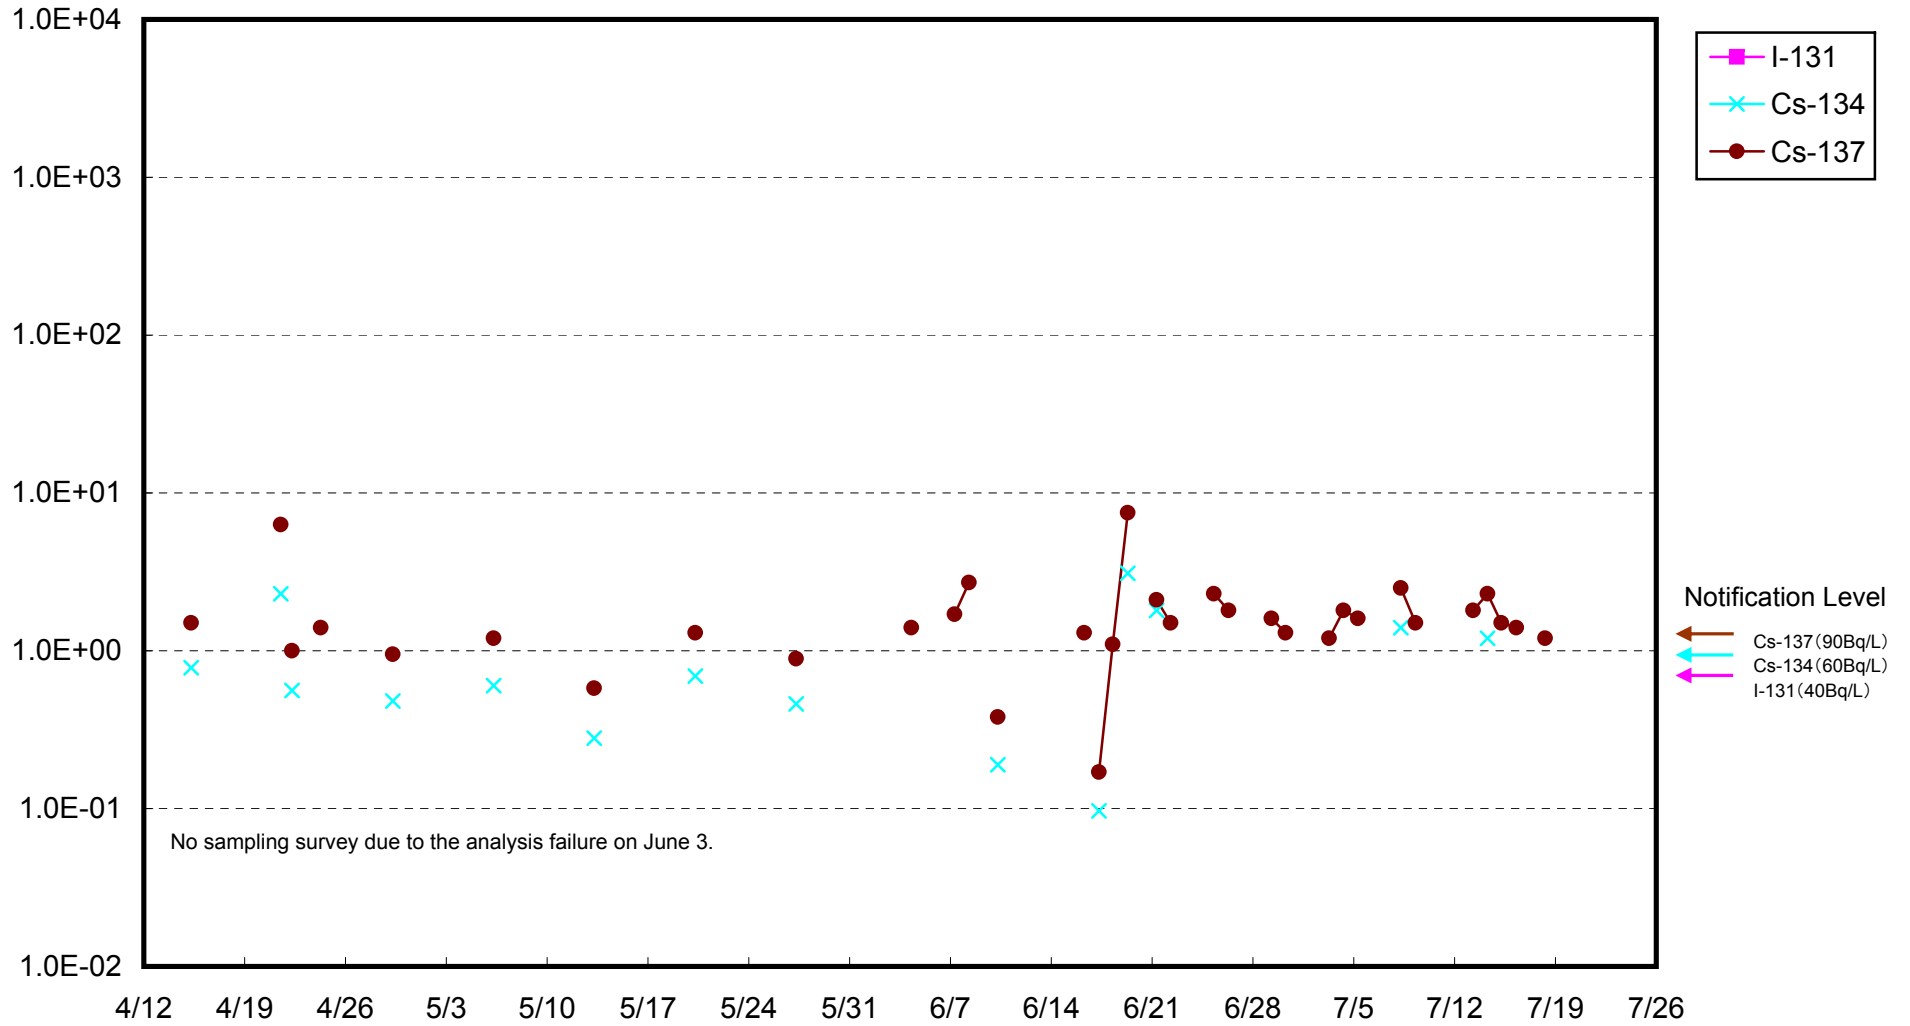

Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

