


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

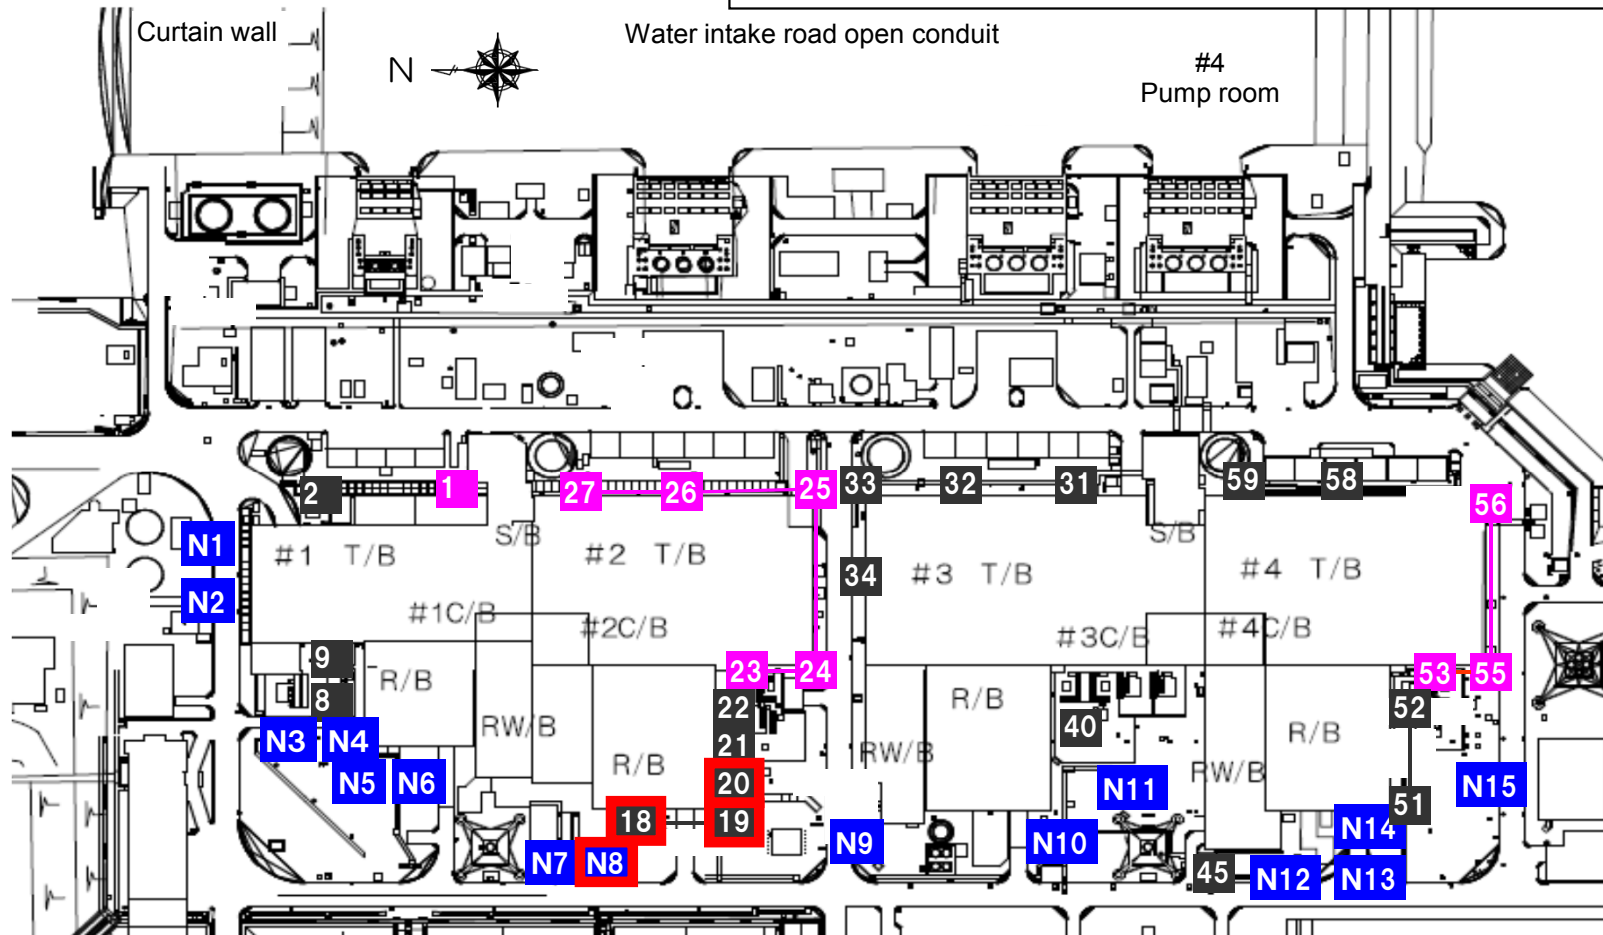

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <1/2>

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling		Oct 26, 2014	Oct 26, 2014	Oct 26, 2014	Oct 26, 2014
Time of sampling		9:50 AM	10:00 AM	10:20 AM	10:10 AM
Cs-134(Approx. 2 years)		ND(18)	1,000	110	44
Cs-137(Approx.30 years)		31	3,700	360	94
The other γ					
All β		70	4,400	490	140
H-3(Approx.12 years)		ND(110)	1,500	460	1,300

* Data announced this time is provided in a thick-frame. The other data was announced c October 26, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <2/2>

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling		Oct 27, 2014	Oct 27, 2014	Oct 27, 2014	Oct 27, 2014
Time of sampling		10:30 AM	10:40 AM	10:50 AM	10:40 AM
Cs-134(Approx. 2 years)		ND(8.4)	940	100	22
Cs-137(Approx.30 years)		27	3,300	330	43
The other γ					
All β		53	6,900	480	110
H-3(Approx.12 years)		Under analysis	Under analysis	Under analysis	Under analysis

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".