


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

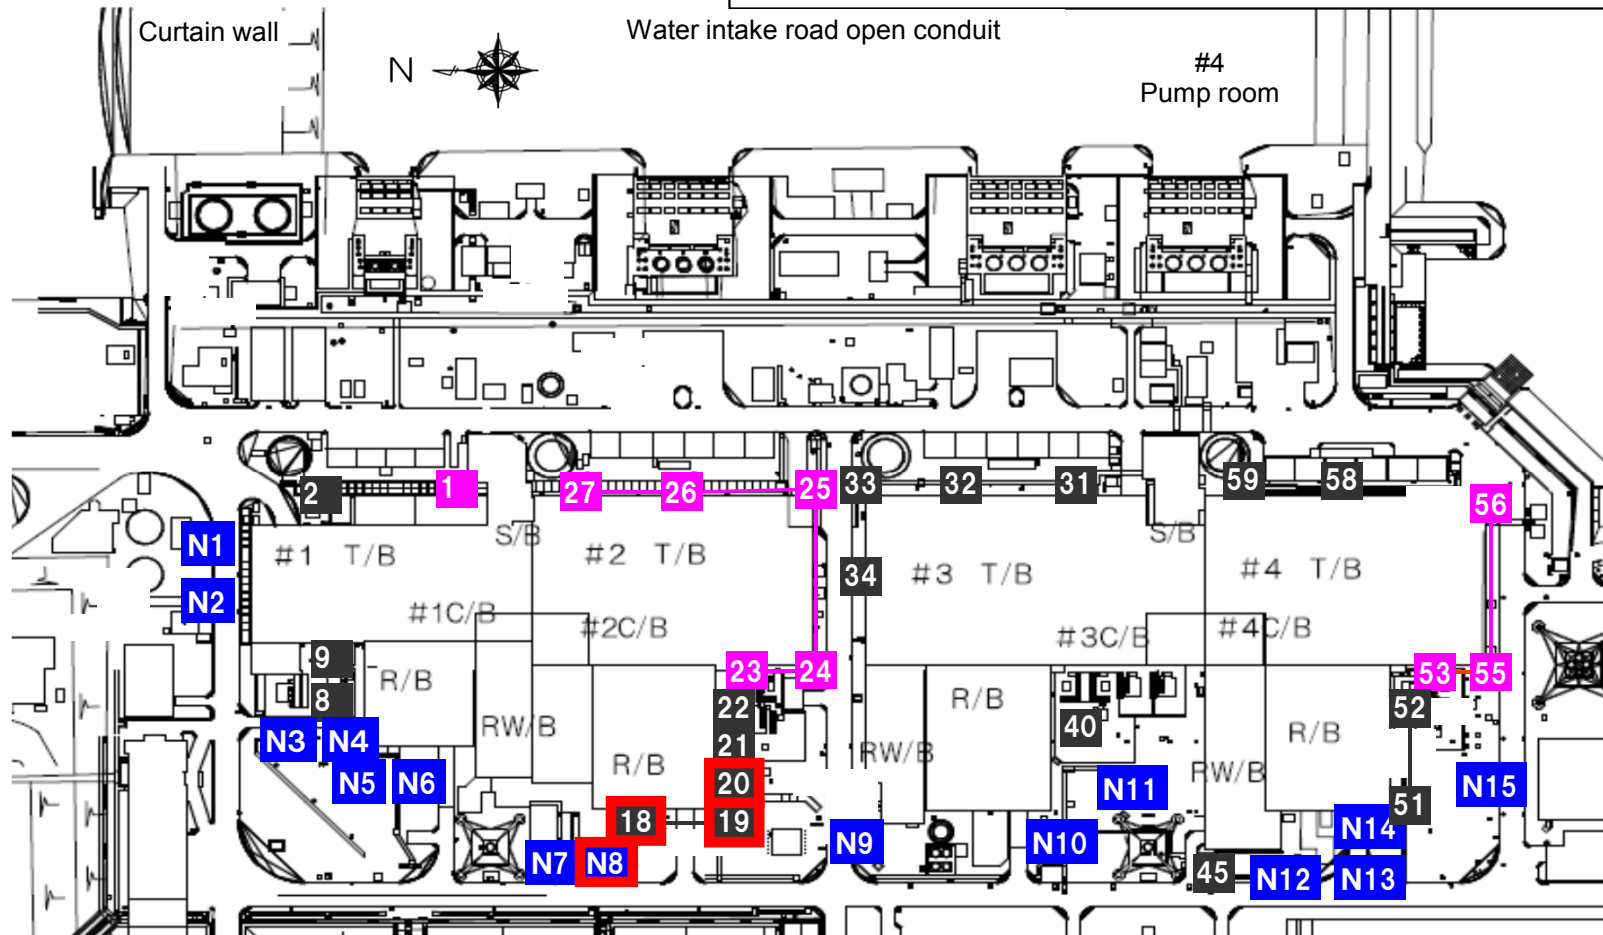

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

Unit: Bq/L

| | | Place of Sampling | | | |
|-------------------------|--|-------------------|--------------|--------------|--------------|
| | | N8 | No.18 | No.19 | No.20 |
| Date of Sampling | | Dec 16, 2014 | Dec 16, 2014 | Dec 16, 2014 | Dec 16, 2014 |
| Time of sampling | | 9:30 AM | 9:40 AM | 10:00 AM | 9:50 AM |
| Cs-134(Approx. 2 years) | | ND(12) | 4,200 | 1,600 | ND(16) |
| Cs-137(Approx.30 years) | | ND(17) | 15,000 | 5,600 | 36 |
| The other γ | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| All β | | ND(16) | 17,000 | 6,800 | 74 |
| H-3(Approx.12 years) | | ND(100) | 970 | 1500 | 1200 |

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".