

Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS < 1/2 >

(Data summarized on August 20)

| Place of Sampling | Shallow Draft Quay at Fukushima Daiichi NPS* | | | | Inside Unit 1-4 Water Intake Canal (North) at Fukushima Daiichi NPS (North side of the East Seawall Break) | | Unit 1 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) | | Unit 2 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) | | Seawater at Unit 4 Screen | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|-------------------------------|--|----------------------|---------------------------|----------------------|--|----------------------|---|----------------------|---|----------------------|---------------------------|----------------------|--|
| Time of Sampling | Aug 19, 2014 7:33 AM | | N/A | | Aug 19, 2014 7:10 AM | | Aug 19, 2014 7:18 AM | | Aug 19, 2014 7:20 AM | | Aug 19, 2014 7:15 AM | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| I-131 (Approx. 8 days) | ND | - | - | - | ND | - | ND | - | ND | - | ND | - | 40 |
| Cs-134 (Approx. 2 years) | ND | - | - | - | 3.9 | 0.07 | 6.1 | 0.10 | 9.2 | 0.15 | 15 | 0.25 | 60 |
| Cs-137 (Approx. 30 years) | ND | - | - | - | 13 | 0.14 | 15 | 0.17 | 22 | 0.24 | 46 | 0.51 | 90 |

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 3Bq/L, Cs-134: Approx.2Bq/L, Cs-137: Approx.2Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* The sampling will be performed after opening and closing of the silt fence.

Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS < 2/2 >

(Data summarized on August 20)

| Place of Sampling | Inside Unit 1-4 Water Intake Canal (South) at Fukushima Daiichi NPS (in front of Impermeable Wall) | | Port Entrance of Fukushima Daiichi NPS* | | | | In Front of Unit 6* Water Intake Canal at Fukushima Daiichi NPS | | | | | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|-------------------------------|--|-------------------------|---|----------------------|---------------------------|----------------------|---|----------------------|---------------------------|----------------------|---------------------------|----------------------|--|
| | Time of Sampling | Aug 19, 2014 7:17 AM | N/A | | N/A | | N/A | | | | | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| I-131 (Approx. 8 days) | ND | - | - | - | - | - | - | - | | | | | 40 |
| Cs-134 (Approx. 2 years) | 11 | 0.18 | - | - | - | - | - | - | | | | | 60 |
| Cs-137 (Approx. 30 years) | 29 | 0.32 | - | - | - | - | - | - | | | | | 90 |

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.


* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 2Bq/L


As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* The sampling will be performed after opening and closing of the silt fence.


Radioactivity Density of the Seawater in Front of the Shallow Draft Quay at 1F (Bq/L)

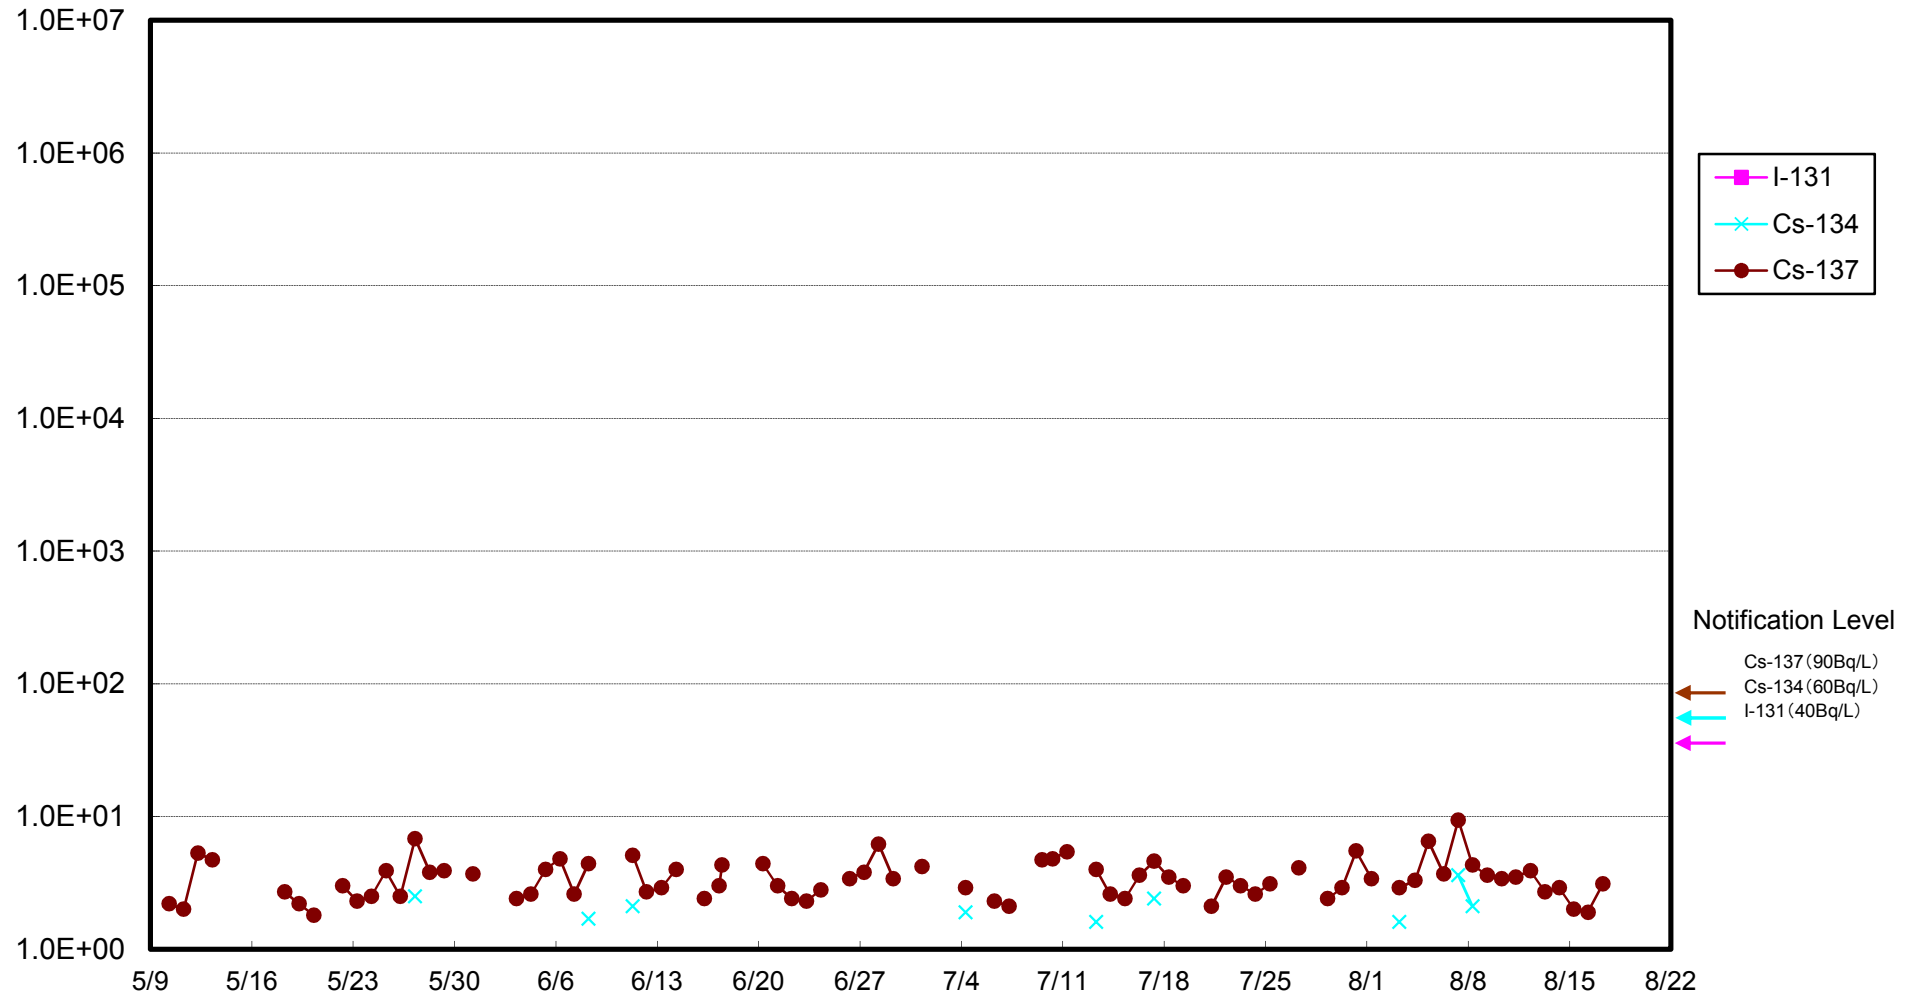


Radioactivity Density of the Seawater at the North of Unit 1-4 Water Intake (North of East Seawater Break of Fukushima Daiichi NPS (Bq/ L)

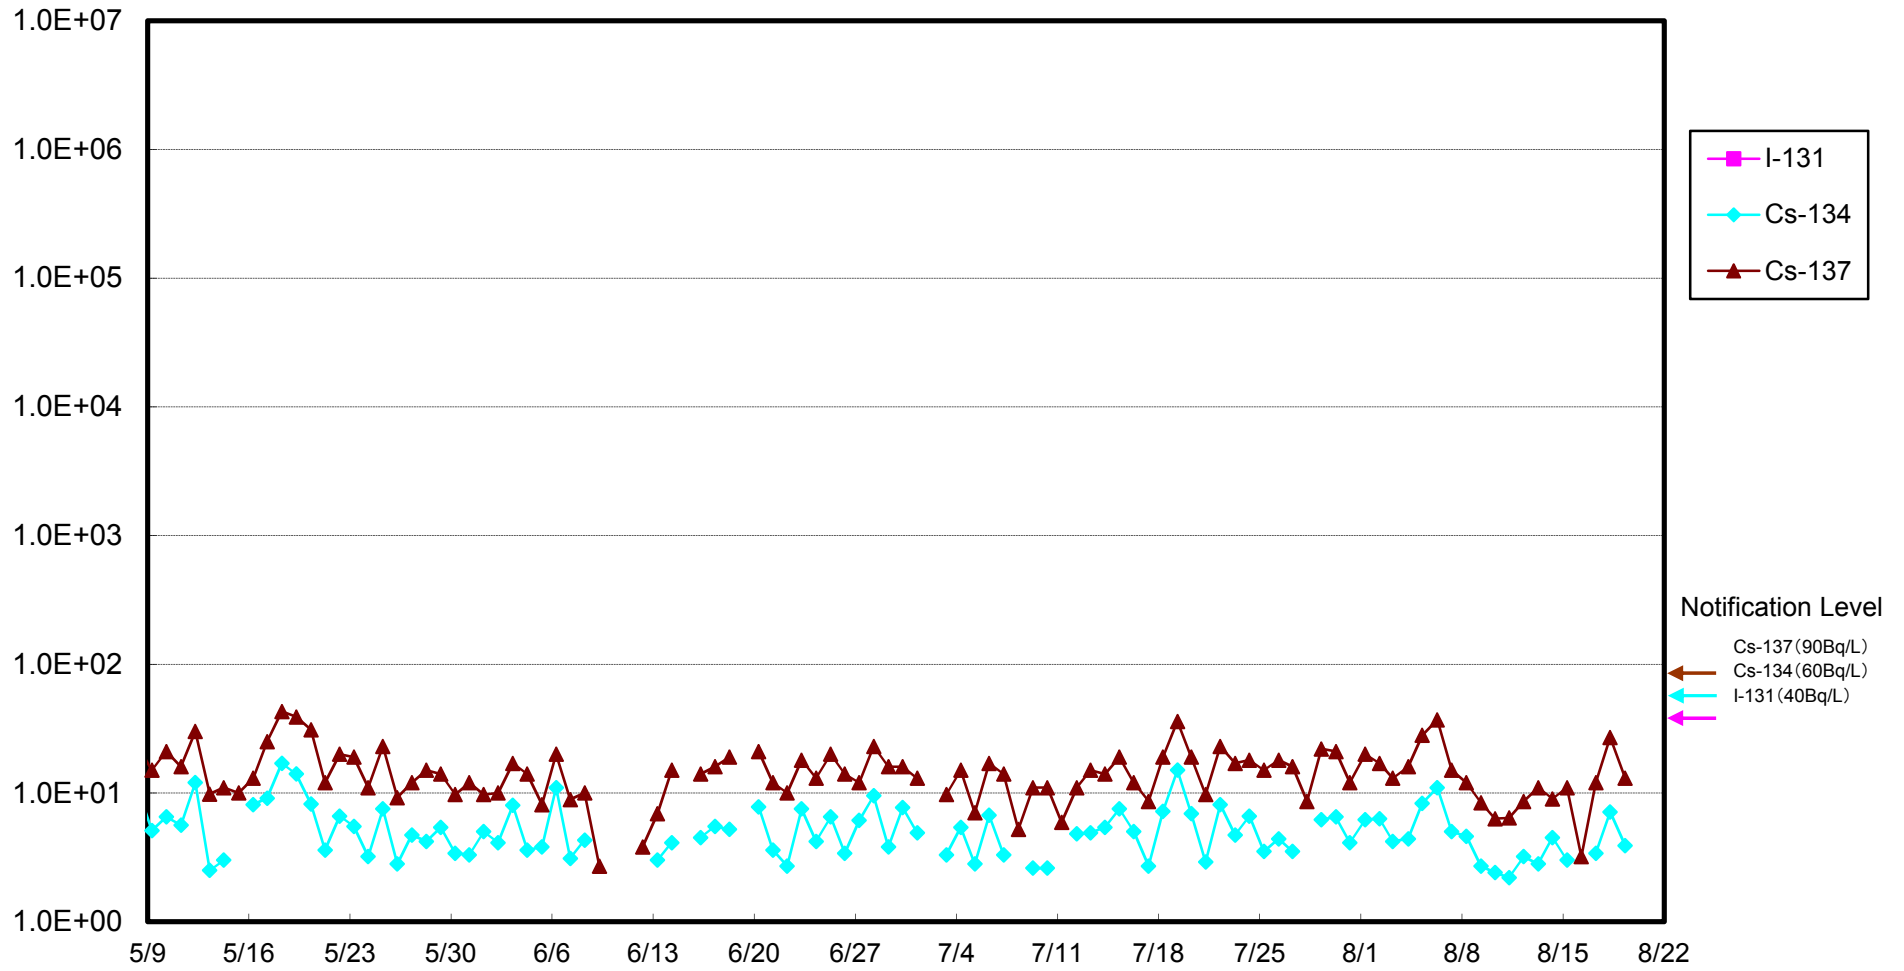


Radioactivity Density of the Seawater of Unit 1 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) (Bq/L)

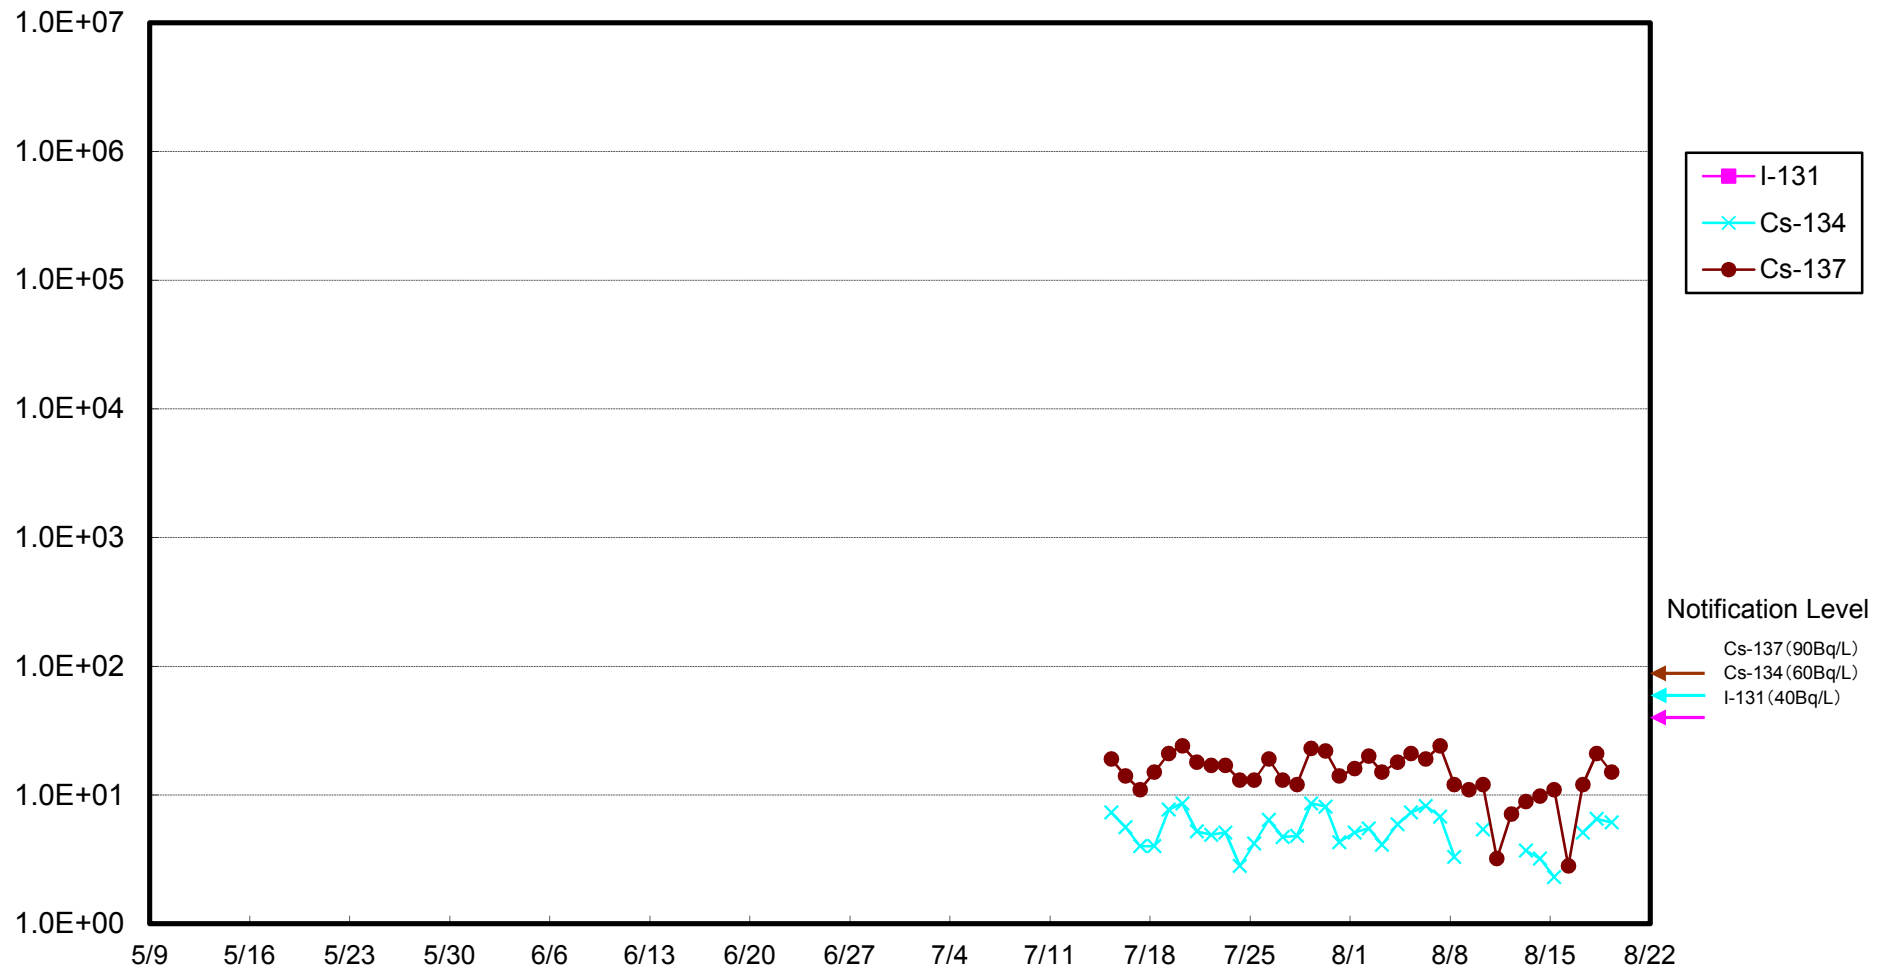

Radioactivity Density of the Seawater of Unit 2 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) (Bq/L)

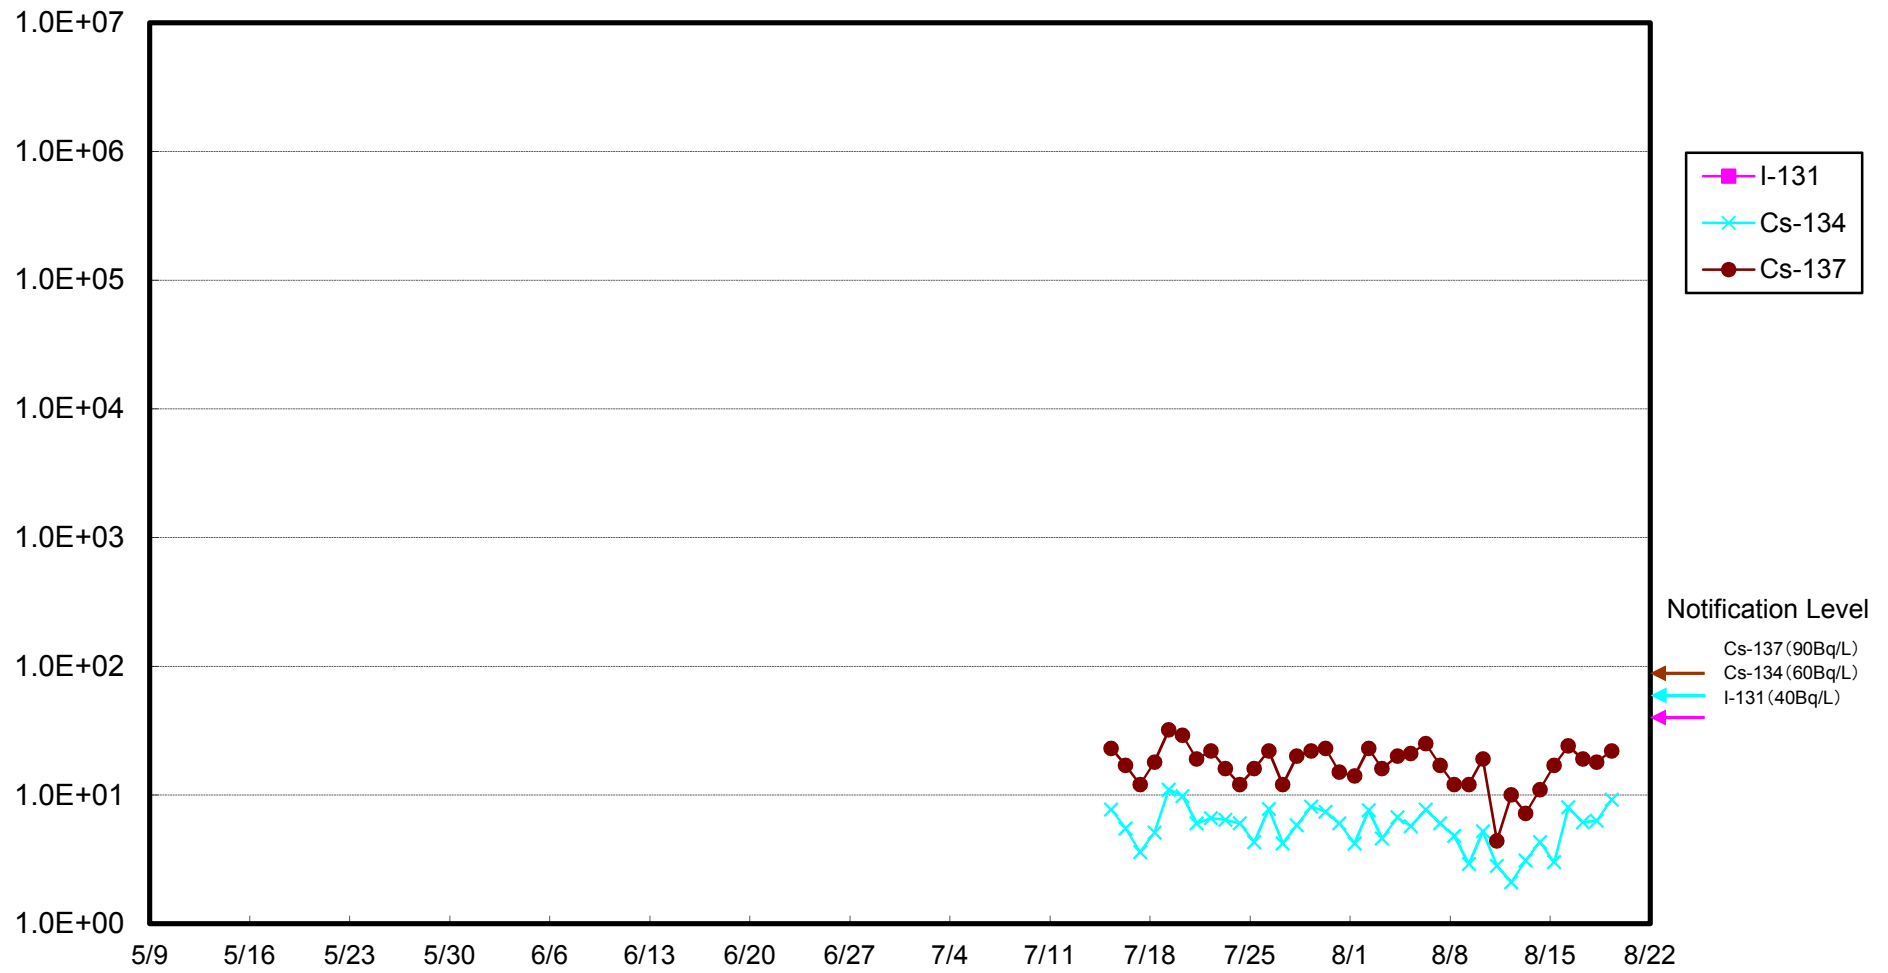

Radioactivity Density of the Seawater at Unit 4 Screen at Fukushima Daiichi NPS (Bq/L)

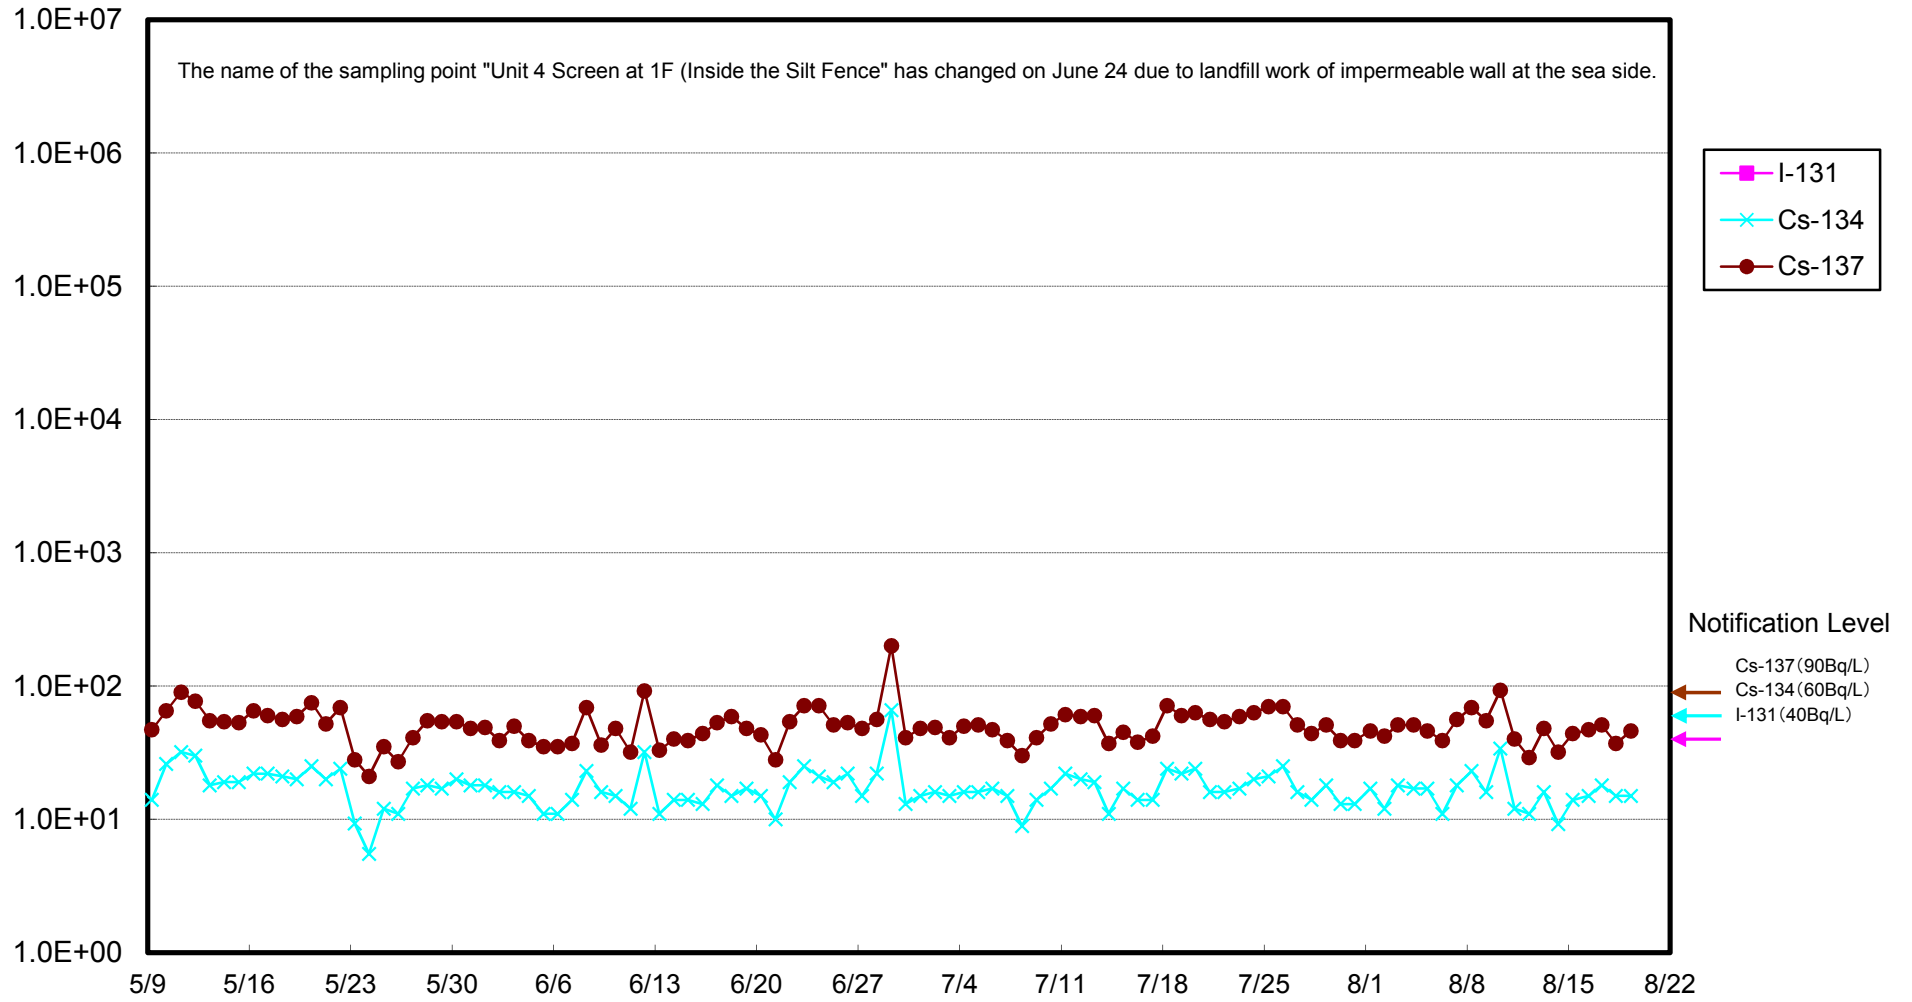

Radioactivity Density of the Seawater at the South of Unit 1-4 Water Intake (in front of Impermeable Wall)
at Fukushima Daiichi NPS (Bq/L)

