

Reference

Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS <1/2>

(Data summarized on September 25)

Place of Sampling	Shallow Draft Quay at Fukushima Daiichi NPS*				Inside Unit 1-4 Water Intake Canal (North) at Fukushima Daiichi NPS (North side of the East Seawall Break)		Unit 1 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall)		Unit 2 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall)		Seawater at Unit 4 Screen		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling	Sep 24, 2014 6:51 AM		N/A		Sep 24, 2014 7:08 AM		Sep 24, 2014 7:20 AM		Sep 24, 2014 7:17 AM		Sep 24, 2014 7:12 AM	
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	-	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	-	-	10	0.17	14	0.23	13	0.22	110	1.8	60
Cs-137 (Approx. 30 years)	5.2	0.06	-	-	26	0.29	34	0.38	41	0.46	310	3.4	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 7Bq/L, Cs-134: Approx. 2Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* The sampling will be performed after opening and closing of the silt fence.

Reference

Radioactivity Density of the Seawater in the Port of Fukushima Daiichi NPS <2/2>

(Data summarized on September 25)

Place of Sampling	Inside Unit 1-4 Water Intake Canal (South) at Fukushima Daiichi NPS (in front of Impermeable Wall)		Port Entrance of Fukushima Daiichi NPS*				In Front of Unit 6* Water Intake Canal at Fukushima Daiichi NPS						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling	Sep 24, 2014 7:15 AM	N/A		N/A		N/A						
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	-	-	-	-	-	-					40
Cs-134 (Approx. 2 years)	21	0.35	-	-	-	-	-	-					60
Cs-137 (Approx. 30 years)	58	0.64	-	-	-	-	-	-					90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 3Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* The sampling will be performed after opening and closing of the silt fence.

Nuclides Analysis Result of Radioactive Materials in the Seawater of Unit 1 - 4 Intake<1/2>

(Data summarized on September 25)

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Jun 09, 2014		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	ND	—	60
Cs-137 (Approx. 30 years)	2.7	0.03	90
H-3 (approx. 12yrs)	ND	—	60,000
All α	ND	—	—
All β	ND	—	—
Sr-90 (Approx. 29 years)	2.4	0.08	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on June 10. H-3, All α and All β were announced on June 13.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

I-131: Approx. 2.2Bq/L, Cs-134: Approx.2.2Bq/L, H-3: Approx. 110Bq/L, All α : Approx. 2.4Bq/L, All β : Approx.

(Evaluation)

Although Sr-90 was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

Nuclides Analysis Result of Radioactive Materials in the Seawater of Unit 1 - 4 Intake<2/2>

(Data summarized on September 25)

Place of Sampling	North of Unit 1-4 Water Intake at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Jul 07, 2014		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	—	40
Cs-134 (Approx. 2 years)	3.3	0.06	60
Cs-137 (Approx. 30 years)	14	0.16	90
H-3 (approx. 12yrs)	200	0.00	60,000
All α	ND	—	—
All β	78	—	—
Sr-90 (Approx. 29 years)	44	1.5	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of I-131, Cs-134, Cs-137 were announced on July 8. H-3, All α and All β were announced on July 11.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.


I-131: Approx. 1.6Bq/L, All α : Approx. 2.6Bq/L

(Evaluation)


H-3, All β radiations, and Sr-90 were detected supposedly as a result of this accident.

The concentration of H3 was below the limit in the water determined in the announcement.


Radioactivity Density of the Seawater in Front of the Shallow Draft Quay at 1F (Bq/L)

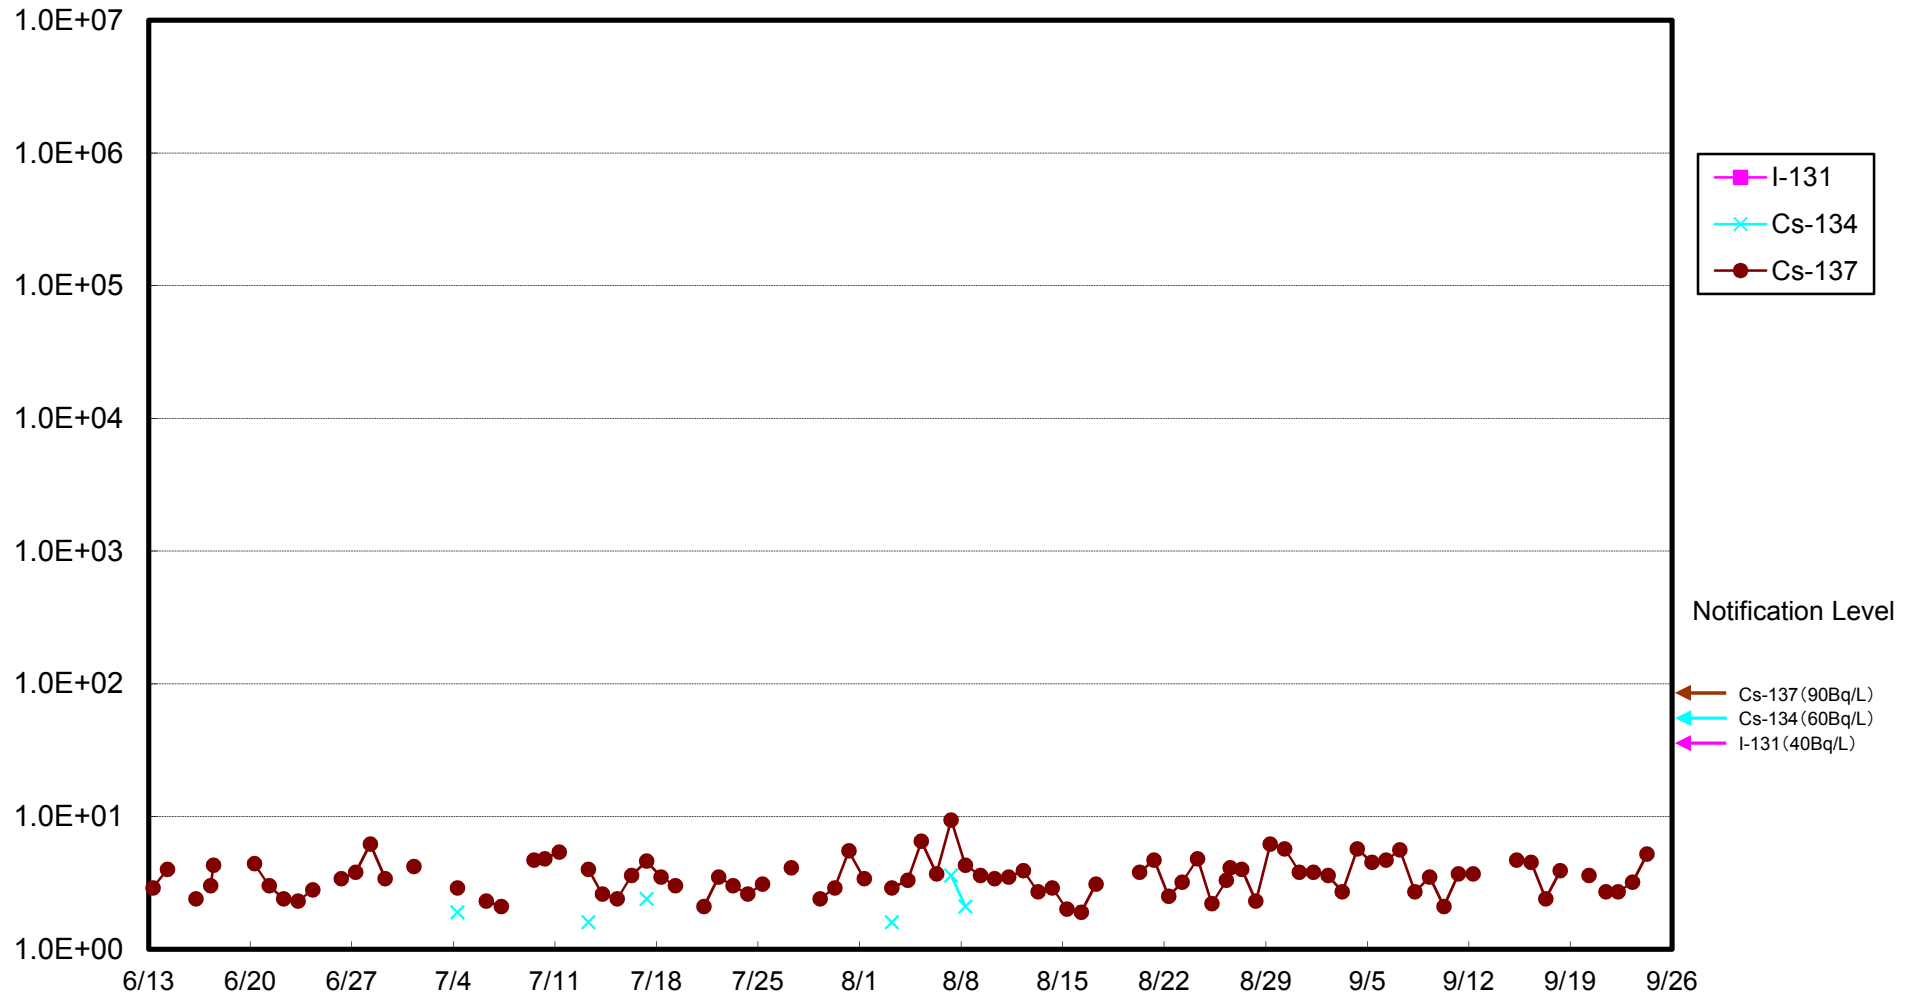


Radioactivity Density of the Seawater at the North of Unit 1-4 Water Intake (North of East Seawater Break of Fukushima Daiichi NPS (Bq/ L)

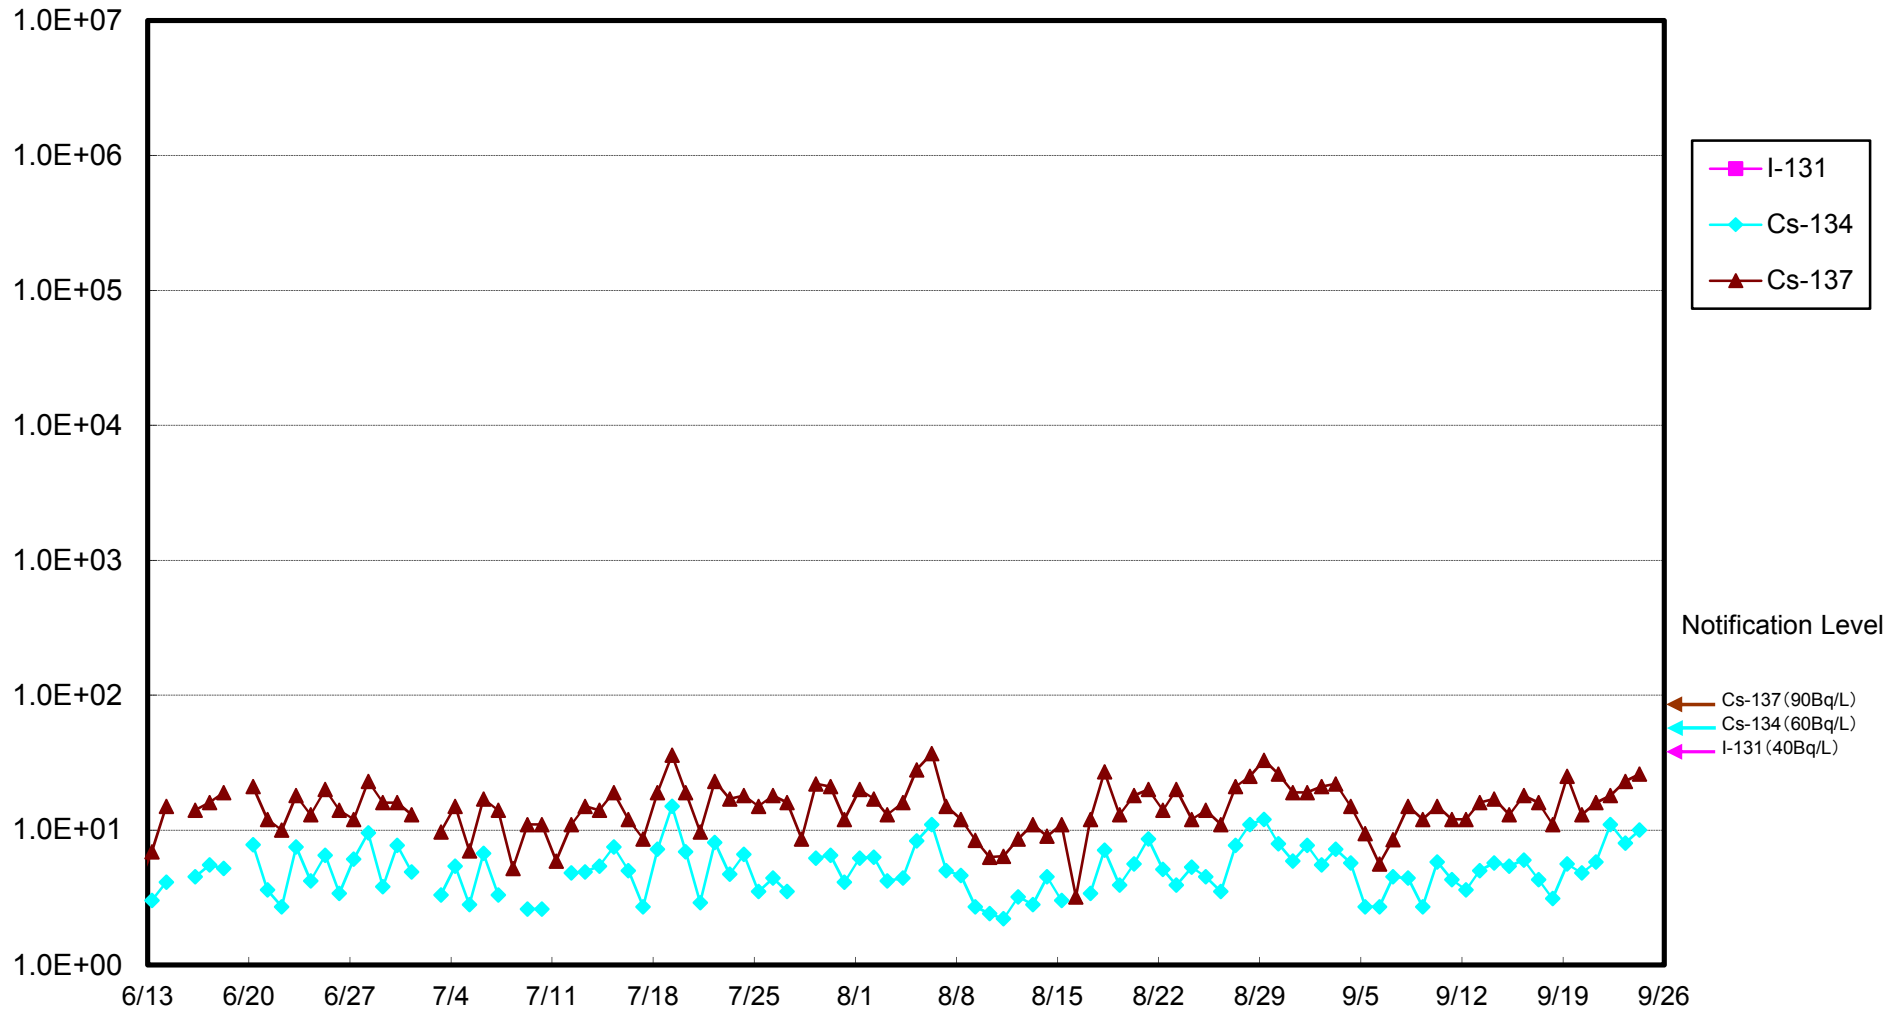


Radioactivity Density of the Seawater of Unit 1 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) (Bq/L)

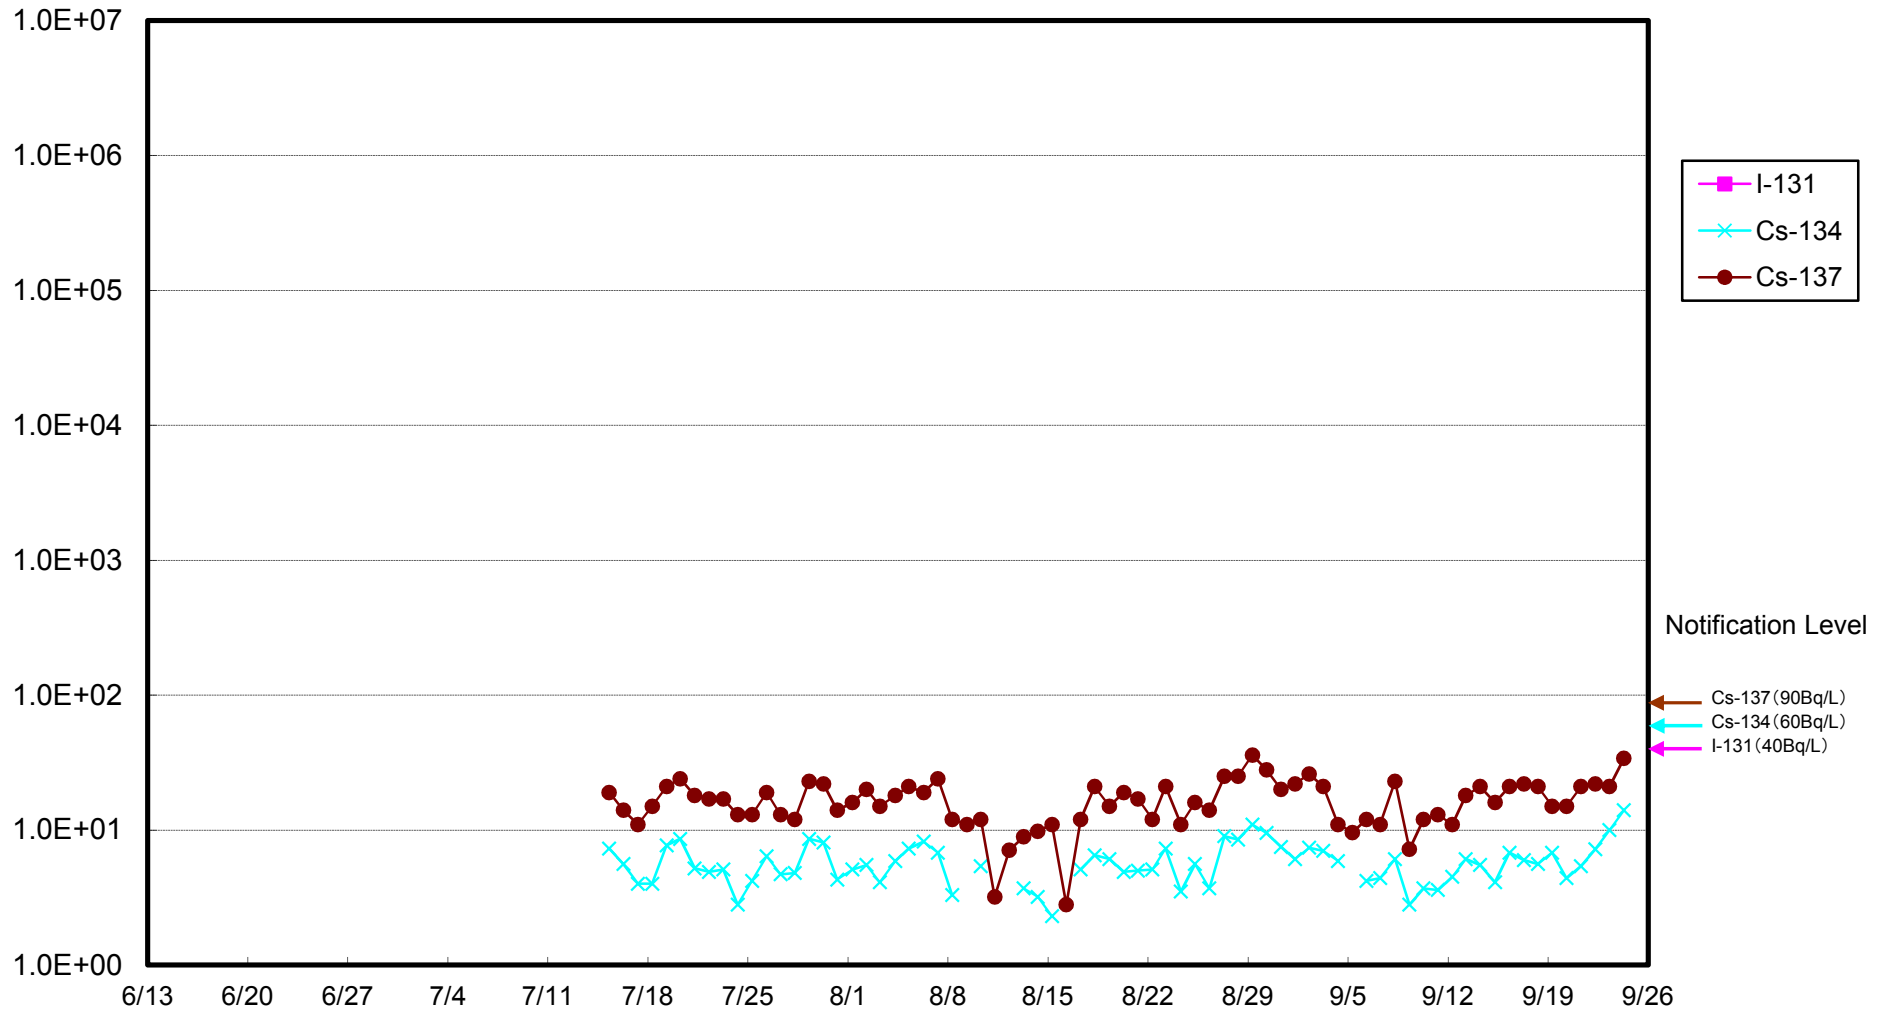

Radioactivity Density of the Seawater of Unit 2 Water Intake Canal at Fukushima Daiichi NPS (In front of Impermeable Wall) (Bq/L)

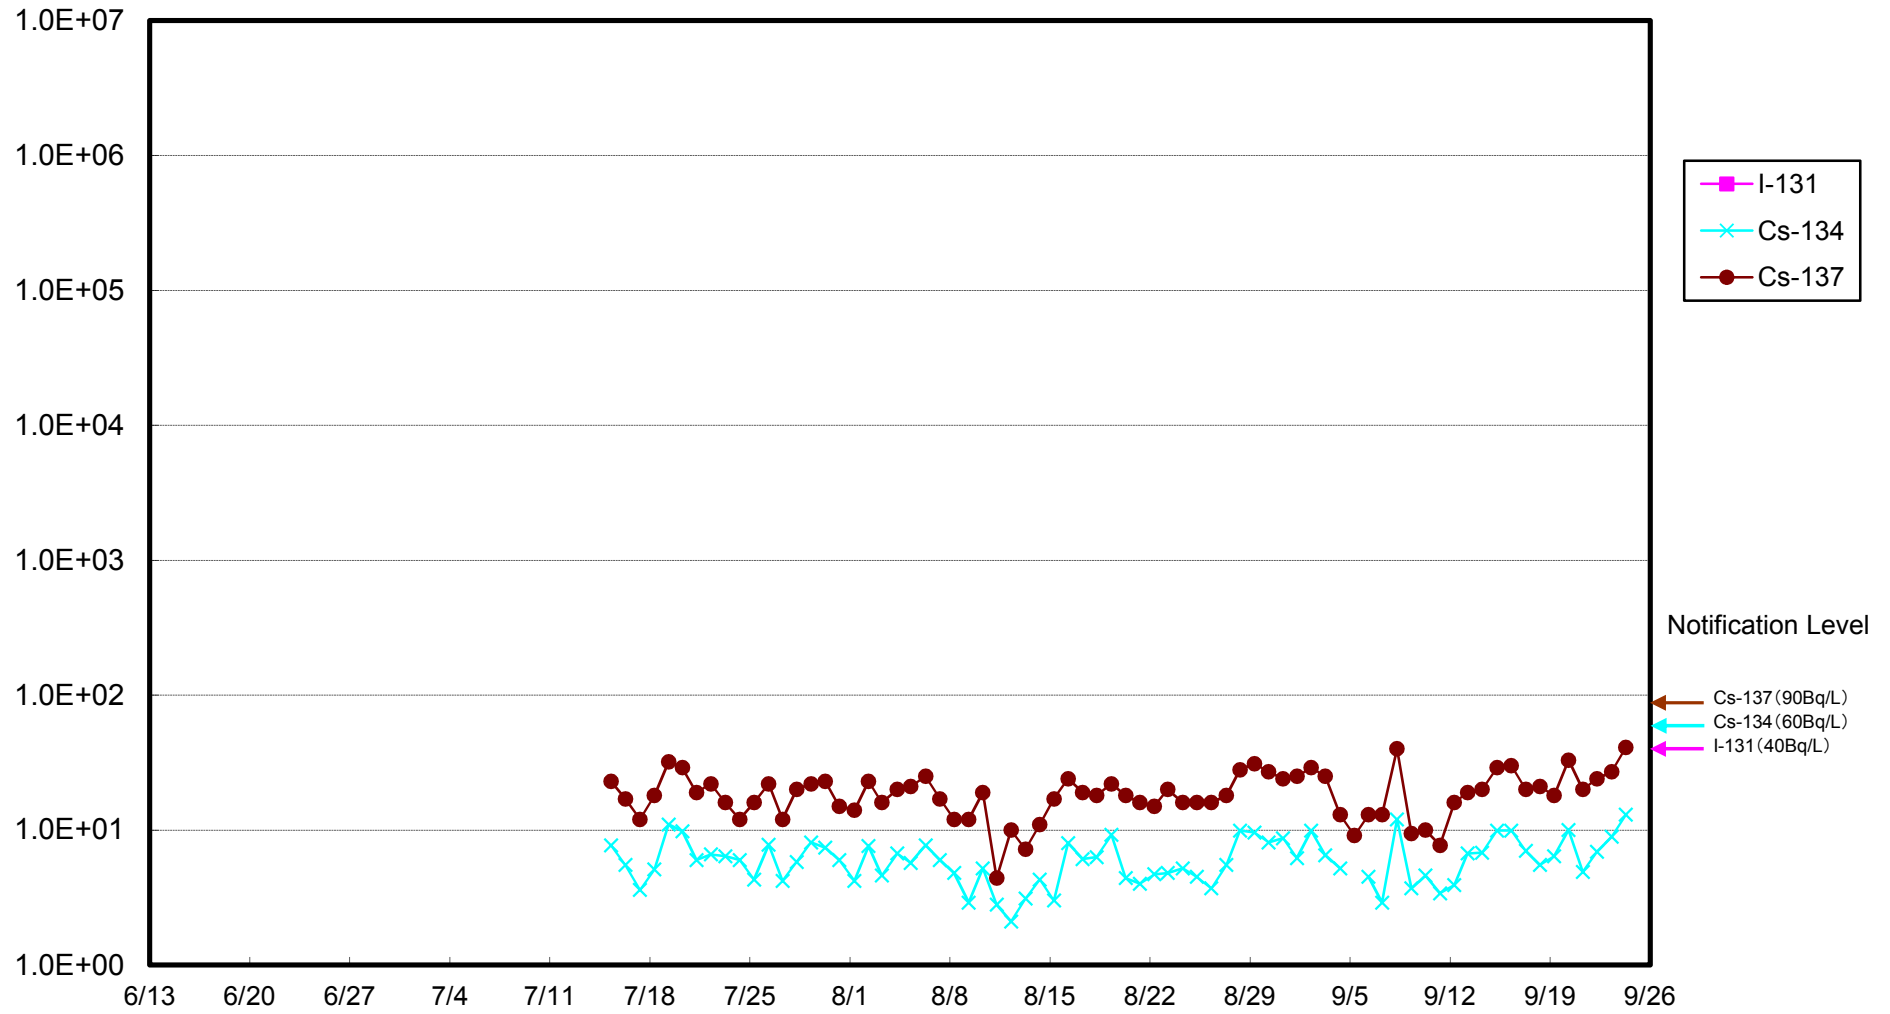

Radioactivity Density of the Seawater at Unit 4 Screen at Fukushima Daiichi NPS (Bq/L)

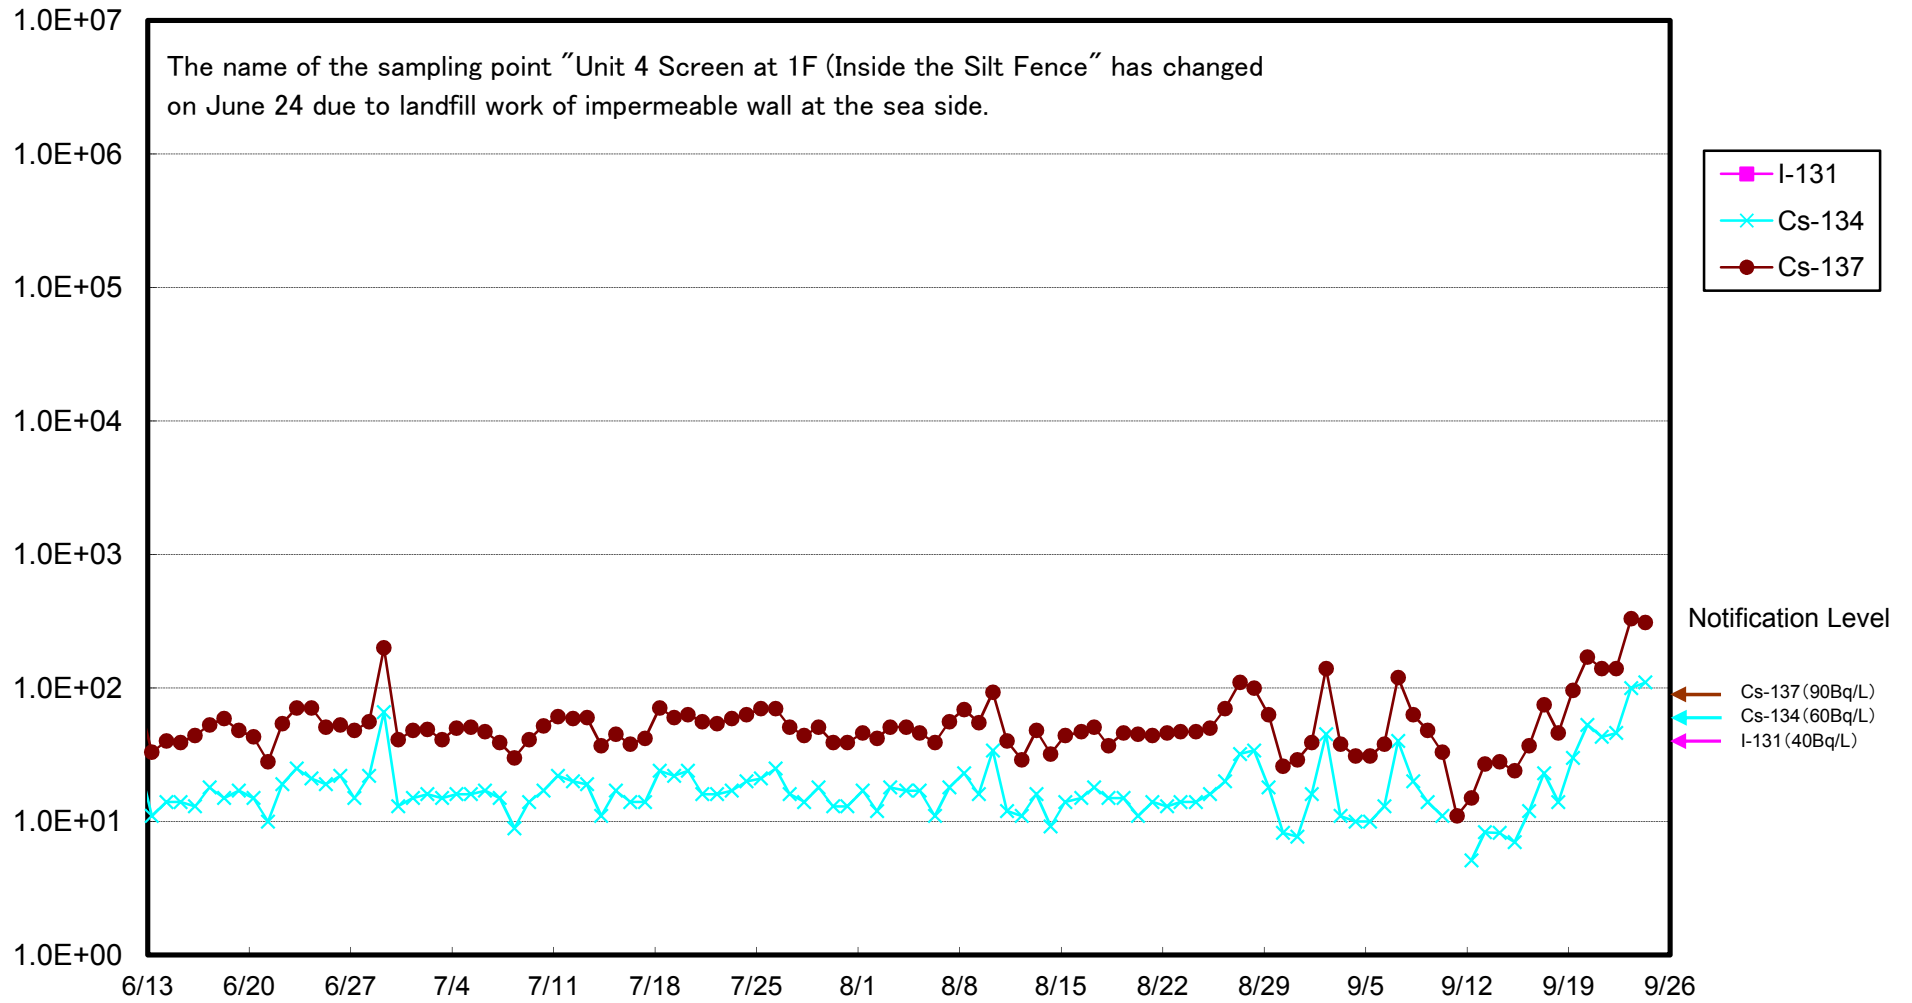

Radioactivity Density of the Seawater at the South of Unit 1-4 Water Intake (in front of Impermeable Wall) at Fukushima Daiichi NPS (Bq/L)

