


## Sampling Results of Sub-drain Water Regarding Wrong Transfer of Accumulated Water to the Incineration Workshop Building (1/3)

	West side of the Incineration Workshop Building					
	Apr 16, 2014					
	(1) 4:00 AM	(2) 8:00 AM	(3) 12:00 PM	(4) 4:00 PM	(5) 8:00 PM	(6) 12:00 AM
Time of sampling	4:00 AM	8:00 AM	12:00 PM	4:00 PM	8:00 PM	12:15 AM
Gross $\beta$ (Bq/cm <sup>3</sup> )	0.095	0.1	0.13	0.12	0.12	0.12
Tritium (Bq/cm <sup>3</sup> )	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)

Half-life of tritium: Approx 12 years

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

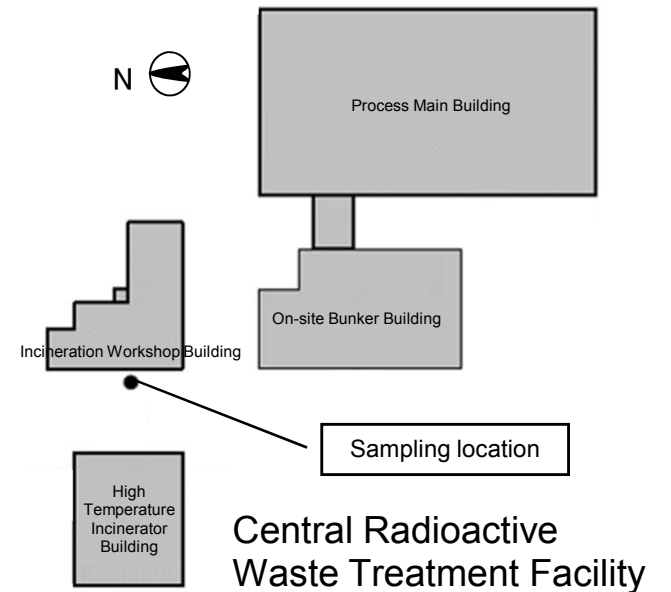


## Sampling Results of Sub-drain Water Regarding Wrong Transfer of Accumulated Water to the Incineration Workshop Building (2/3)

	West side of the Incineration Workshop Building					
	Apr 17, 2014					
	(1) 4:00 AM	(2) 8:00 AM	(3) 12:00 PM	(4) 4:00 PM	(5) 8:00 PM	(6) 12:00 AM
Time of sampling	4:00 AM	8:00 AM	12:00 PM	4:00 PM	8:00 PM	12:15 AM
Gross $\beta$ (Bq/cm <sup>3</sup> )	0.11	0.12	0.10	0.15	0.12	0.13
Tritium (Bq/cm <sup>3</sup> )	ND(0.11)	ND(0.11)	ND(0.11)	Under analysis	Under analysis	Under analysis

Half-life of tritium: Approx 12 years

\* Data announced this time is provided in a thick-frame. The other data was announced on April 16 and 17.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

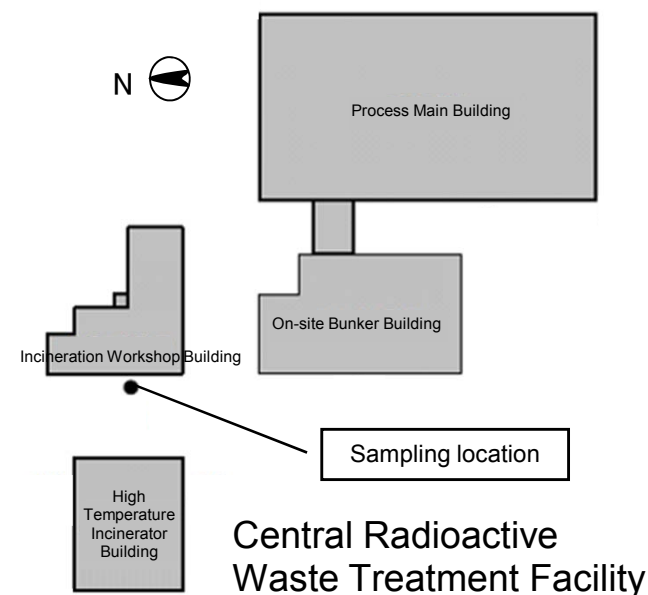

## Sampling Results of Sub-drain Water Regarding Wrong Transfer of Accumulated Water to the Incineration Workshop Building (3/3)

	West side of the Incineration Workshop Building					
	Apr 18, 2014					
	(1) 4:00 AM	(2) 8:00 AM	(3) 12:00 PM	(4) 4:00 PM	(5) 8:00 PM	(6) 12:00 AM
Time of sampling	4:00 AM	8:00 AM	12:00 PM	4:00 PM	8:00 PM	12:15 AM
Gross $\beta$ (Bq/cm <sup>3</sup> )	0.1	0.1	0.12	0.11	0.12	0.12
Tritium (Bq/cm <sup>3</sup> )	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis

Half-life of tritium: Approx 12 years

\* Data announced this time is provided in a thick-frame. The other data was announced on April 17.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

