

<Reference>

April 25, 2014

Tokyo Electric Power Company


Sampling Results of Sub-drain Water Regarding Wrong Transfer of Accumulated Water to the Incineration Workshop Building (1/2)

	West side of the Incineration Workshop Building					
	Apr 22, 2014					
	(1) 4:00 AM	(2) 8:00 AM	(3) 12:00 PM	(4) 4:00 PM	(5) 8:00 PM	(6) 12:00 AM
Time of sampling	4:00 AM	8:00 AM	12:00 PM	4:00 PM	8:00 PM	12:15 AM
Gross β (Bq/cm ³)	0.11	0.14	0.11	0.11	0.14	0.13
Tritium (Bq/cm ³)	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)	ND(0.11)

Half-life of tritium: Approx 12 years

* Data announced this time is provided in a thick-frame. The other data was announced on April 22, 23, and 24.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

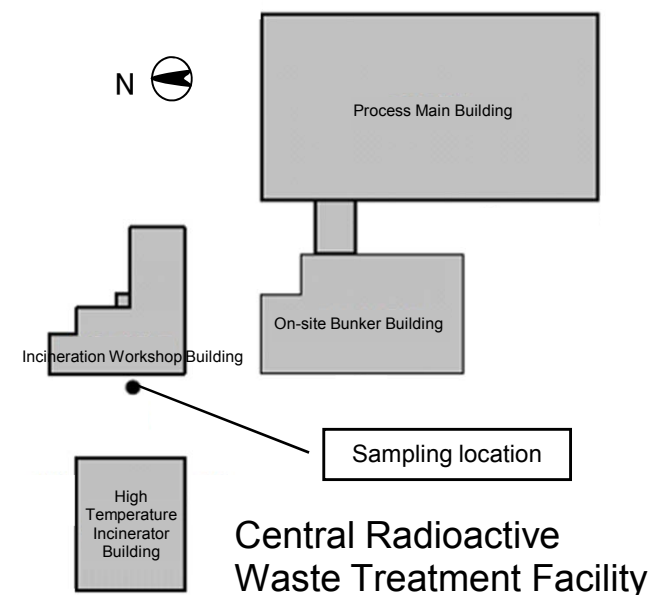

Sampling Results of Sub-drain Water Regarding Wrong Transfer of Accumulated Water to the Incineration Workshop Building (2/2)

	West side of the Incineration Workshop Building					
	Apr 23, 2014					
	(1) 4:00 AM	(2) 8:00 AM	(3) 12:00 PM	(4) 4:00 PM	(5) 8:00 PM	(6) 12:00 AM
Time of sampling	4:00 AM	8:00 AM	/	/	/	/
Gross β (Bq/cm ³)	0.12	0.12	/	/	/	/
Tritium (Bq/cm ³)	ND(0.11)	ND(0.11)	/	/	/	/

Half-life of tritium: Approx 12 years

* Data announced this time is provided in a thick-frame. The other data was announced on April 23.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

