

## Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on May 21)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	May 20, 2014 7:30 AM		May 20, 2014 5:40 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND(0.72)	-	ND(0.58)	-	40
Cs-134 (Approx. 2 years)	ND(0.76)	-	ND(0.76)	-	60
Cs-137 (Approx. 30 years)	1.0	0.01	ND(0.78)	-	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides is under evaluation.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* "ND" indicates that the measurement result is below the detection limit, which is provided in parentheses.

**Nuclides Analysis Result of the Radioactive Materials in the Seawater  
< Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >**

(Data summarized on May 21)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)				Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Apr 14, 2014 6:10 AM		Apr 21, 2014 6:30 AM		Apr 14, 2014 5:30 AM		Apr 21, 2014 5:40 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.13	0.00	0.079	0.00	0.11	0.00	0.078	0.00	60
Cs-137 (Approx. 30 years)	0.34	0.00	0.23	0.00	0.28	0.00	0.22	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: Tokyo Power Tecnology Ltd.

## Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >

(Data summarized on May 21)

Place of Sampling	2F Around the North Discharge Channel (Around Unit 3-4 Discharge Channel) (Approx. 10km from 1F)				Around Iwasawa Shore of 2F (Approx. 7km South of Unit 1 & 2 Discharge Channel) (Approx. 16km from 1F)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Apr 15, 2014 9:40 AM		Apr 22, 2014 10:00 AM		Apr 15, 2014 7:20 AM		Apr 22, 2014 7:30 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.032	0.00	0.020	0.00	0.021	0.00	0.023	0.00	60
Cs-137 (Approx. 30 years)	0.092	0.00	0.060	0.00	0.060	0.00	0.061	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: Tokyo Power Tecnology Ltd.

## Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 1/4>

(Data summarized on May 21)

Place of Sampling (Place No.)	*1 3km Offshore of Odaka Ward (T-14)				*2 3km Offshore of Ukedo River (T-D1)				*2 3km Offshore of Fukushima Daiichi NPS (T-D5)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 17, 2014 9:04 AM		Apr 17, 2014 9:04 AM		Apr 23, 2014 9:32 AM		Apr 23, 2014 9:32 AM		Apr 23, 2014 10:36 AM		Apr 23, 2014 10:36 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0051	0.00	0.0055	0.00	0.0083	0.00	0.0035	0.00	0.0089	0.00	0.0033	0.00	60
Cs-137 (Approx. 30 years)	0.016	0.00	0.017	0.00	0.019	0.00	0.0093	0.00	0.025	0.00	0.010	0.00	90

Place of Sampling (Place No.)	*2 3km Offshore of Fukushima Daini NPS (T-D9)				*1 15km Offshore of Fukushima Daiichi NPS (T-5)				*1 3km Offshore of Iwasawa Shore (T-11)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 23, 2014 9:17 AM		Apr 23, 2014 9:17 AM		Apr 17, 2014 8:32 AM		Apr 17, 2014 8:32 AM		Apr 17, 2014 10:03 AM		Apr 17, 2014 10:03 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.010	0.00	0.0052	0.00	0.0027	0.00	0.0028	0.00	0.0048	0.00	0.0053	0.00	60
Cs-137 (Approx. 30 years)	0.027	0.00	0.011	0.00	0.0075	0.00	0.0077	0.00	0.015	0.00	0.016	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: \*1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD., \*2 Tokyo Power Technology Ltd.

## Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 2/4>

(Data summarized on May 21)

Place of Sampling (Place No.)	3km Offshore of Northern Iwaki City (T-12)				1km Offshore of Natsui River (T-17-1)				3km Offshore of Toyoma (T-20)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 9, 2014 6:19 AM		Apr 9, 2014 6:19 AM		Apr 9, 2014 6:43 AM		Apr 9, 2014 6:43 AM		Apr 9, 2014 7:05 AM		Apr 9, 2014 7:05 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.013	0.00	0.0083	0.00	0.014	0.00	0.011	0.00	0.0075	0.00	0.010	0.00	60
Cs-137 (Approx. 30 years)	0.034	0.00	0.020	0.00	0.039	0.00	0.028	0.00	0.020	0.00	0.030	0.00	90

Place of Sampling (Place No.)	1km Offshore of Nida River (T-13-1)				3km Offshore of Soma (T-22)				5km Offshore of Kashima (T-MA)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 10, 2014 6:45 AM		Apr 10, 2014 6:45 AM		Apr 10, 2014 5:31 AM		Apr 10, 2014 5:31 AM		Apr 10, 2014 5:57 AM		Apr 10, 2014 5:57 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0040	0.00	0.0048	0.00	0.0050	0.00	0.0048	0.00	0.0039	0.00	0.0024	0.00	60
Cs-137 (Approx. 30 years)	0.011	0.00	0.014	0.00	0.013	0.00	0.015	0.00	0.011	0.00	0.0080	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

## Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 3/4>

(Data summarized on May 21)

Place of Sampling (Place No.)	Around 1km Offshore of Ota River (T-S1)				Around 3km Offshore of Odaka Ward (T-S2)				Around 2km Offshore of Kido River(T-S5)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 15, 2014 6:42 AM		Apr 15, 2014 6:42 AM		Apr 15, 2014 6:00 AM		Apr 15, 2014 6:00 AM		Apr 13, 2014 6:54 AM		Apr 13, 2014 6:54 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.011	0.00	0.0036	0.00	0.0071	0.00	0.0060	0.00	0.0025	0.00	0.0059	0.00	60
Cs-137 (Approx. 30 years)	0.030	0.00	0.0089	0.00	0.021	0.00	0.016	0.00	0.0094	0.00	0.014	0.00	90

Place of Sampling (Place No.)	Around 2km Offshore of Fukushima Daini NPS (T-S7)				Around 4km Offshore of Kumagawa (T-S8)				Arounmd 15km Offshore of Odaka Ward (T-B1)				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 13, 2014 6:30 AM		Apr 13, 2014 6:30 AM		Apr 19, 2014 6:16 AM		Apr 19, 2014 6:16 AM		Apr 22, 2014 5:38 AM		Apr 22, 2014 5:38 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0047	0.00	0.0067	0.00	0.0077	0.00	0.0062	0.00	0.0046	0.00	0.0022	0.00	60
Cs-137 (Approx. 30 years)	0.015	0.00	0.017	0.00	0.025	0.00	0.016	0.00	0.013	0.00	0.0080	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

## Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 4/4>

(Data summarized on May 21)

Place of Sampling (Place No.)	Around 10km Offshore of 1F (T-B3)				Around 10km Offshore of 2F (T-B4)				/				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Apr 12, 2014 5:29 AM		Apr 12, 2014 5:29 AM		Apr 12, 2014 6:07 AM		Apr 12, 2014 6:07 AM		/				
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0027	0.00	0.0036	0.00	0.0021	0.00	0.0021	0.00	/	/	/	/	60
Cs-137 (Approx. 30 years)	0.0082	0.00	0.010	0.00	0.0074	0.00	0.0094	0.00	/	/	/	/	90

Place of Sampling (Place No.)	/				/				/				② Density Limit Specified by the Reactor Regulation (Bq/L)  (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	/				/				/				
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	/	/	/	/	/	/	/	/	/	/	/	/	60
Cs-137 (Approx. 30 years)	/	/	/	/	/	/	/	/	/	/	/	/	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

\* Analyzed by: THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

Nuclides Analysis Result of the Radioactive Materials in the Seawater  
< Coast, Fukushima Daiichi Nuclear Power Station, Within 20km Radius >

(Data summarized on May 21)

Place of Sampling	South side of the Ukedo Port (Approx. 5.5km north of Unit 5-6 Discharge Channel)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Apr 15, 2014 8:30 AM		Apr 22, 2014 8:00 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.040	0.00	0.018	0.00	60
Cs-137 (Approx. 30 years)	0.11	0.00	0.053	0.00	90

\* The density specified by the Reactor Regulation is converted from Bq/cm<sup>3</sup> to Bq/L.


\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.


\* Analyzed by: Tokyo Power Technology Ltd.




Radioactivity Density of the Seawater at 1F Units 5-6 North Discharge Channel (Bq/L)

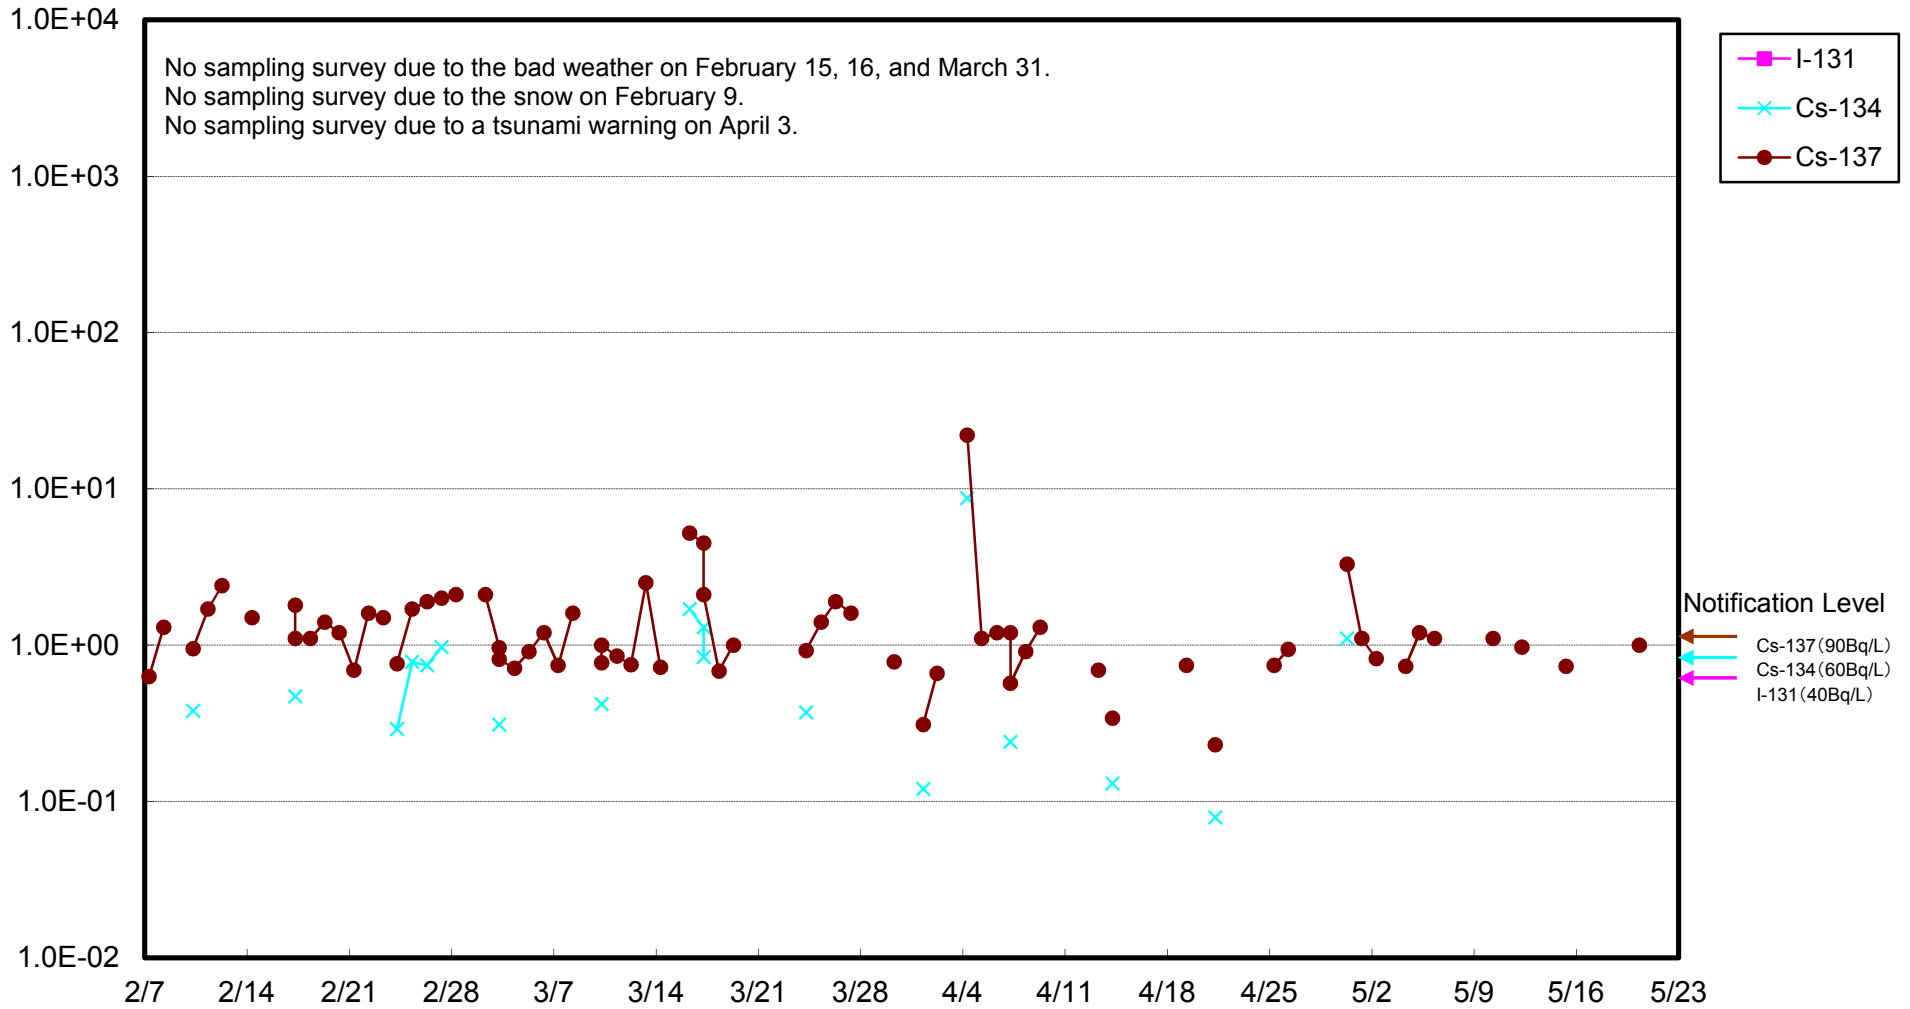


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

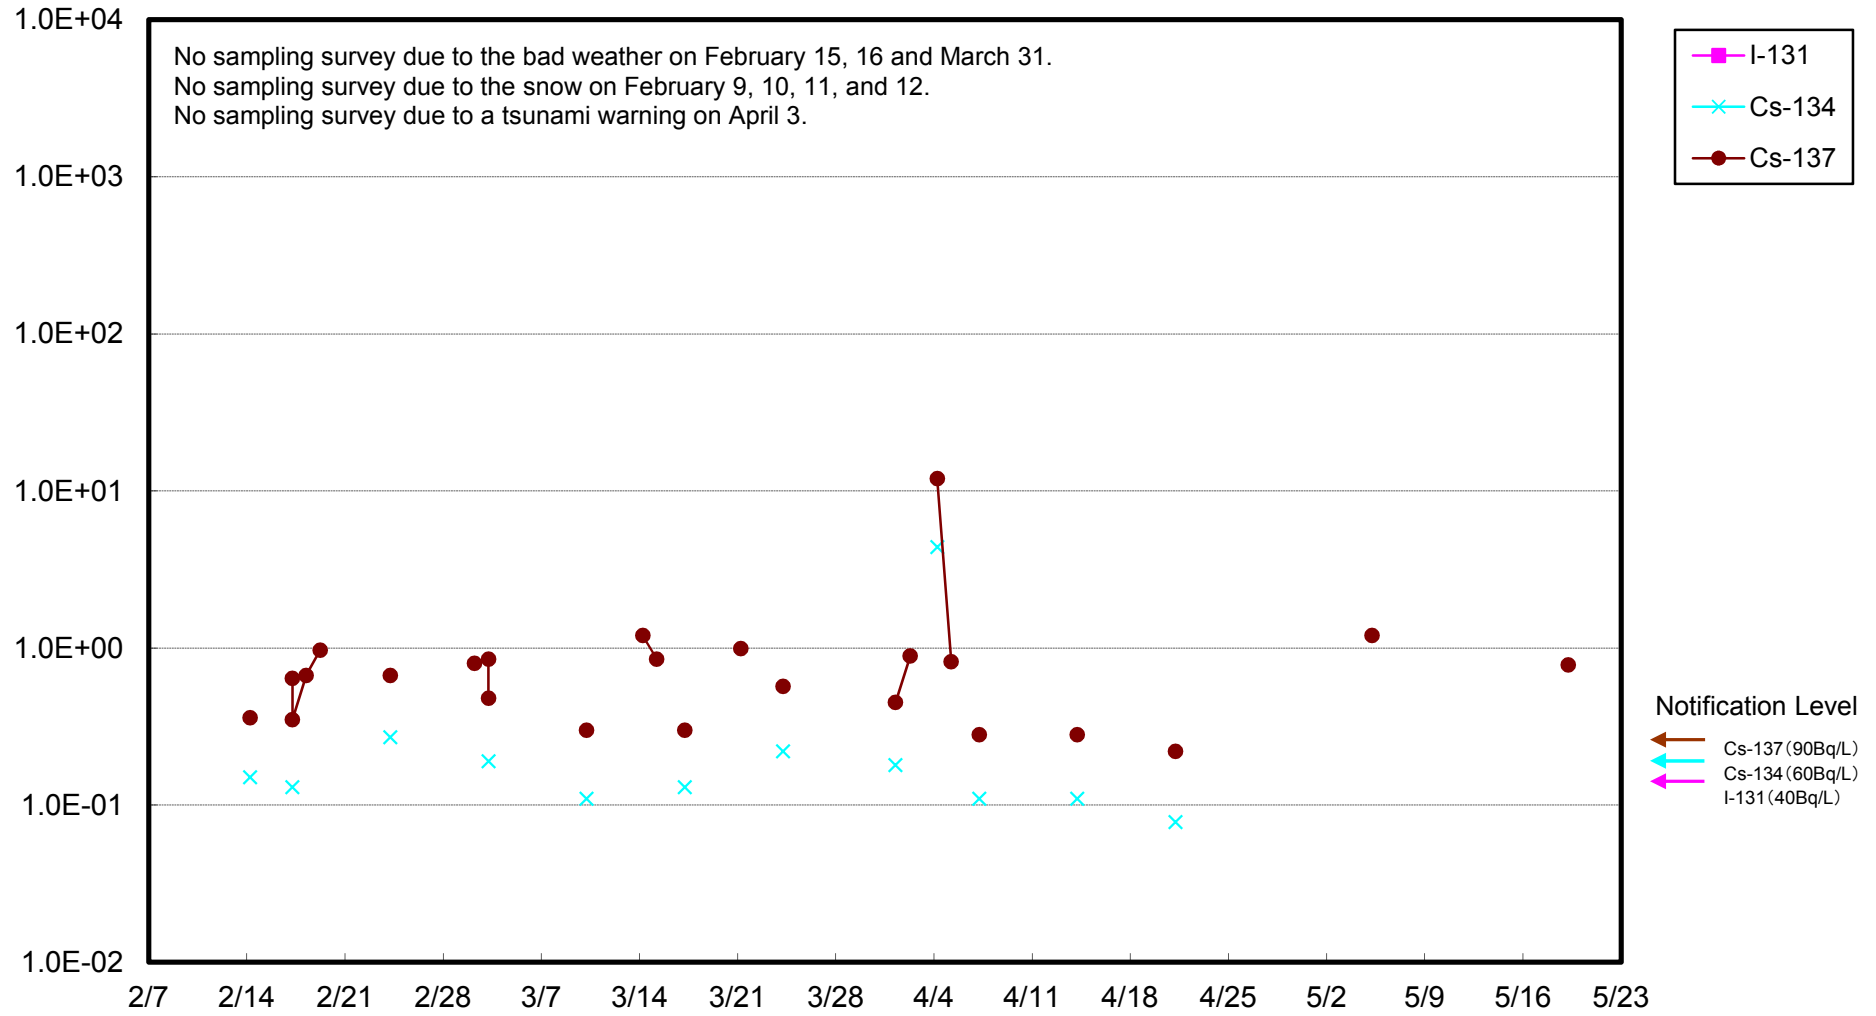


Radioactivity Density of the Seawater at 2F North Discharge Channel (Bq/L)

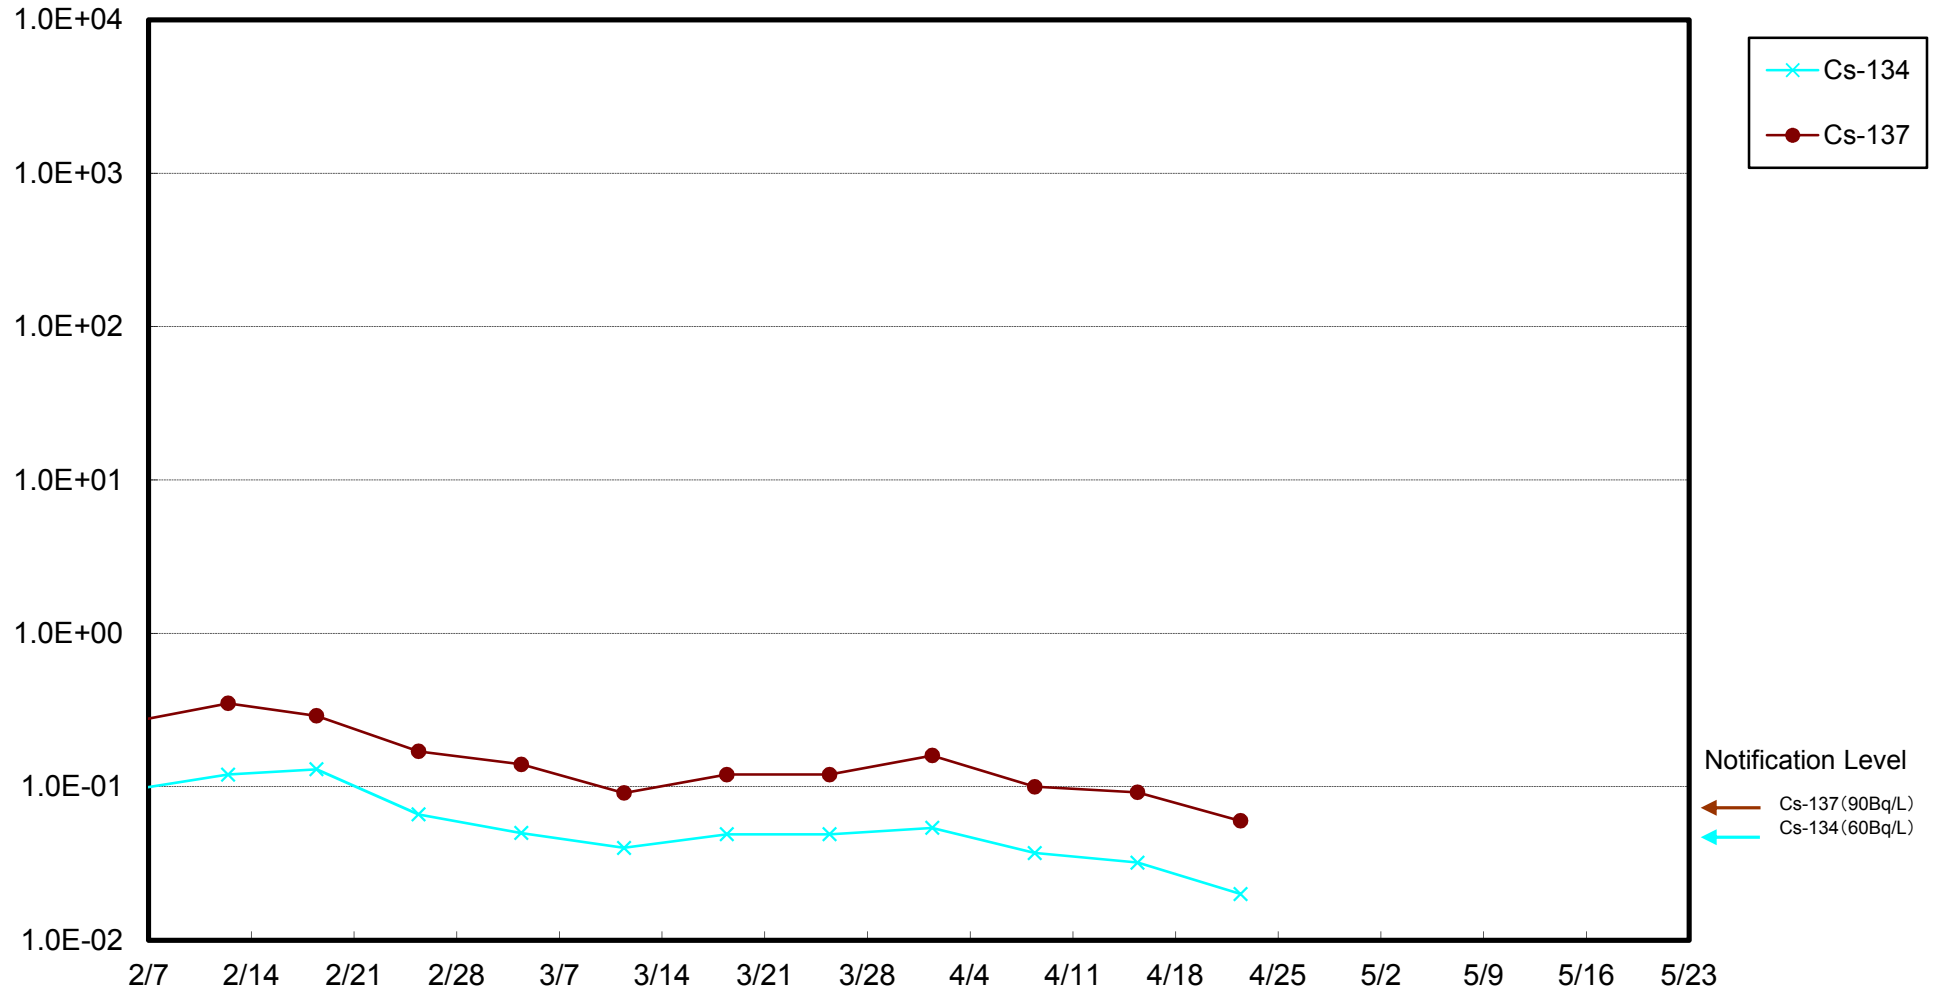


Radioactivity Density of the Seawater Around the Iwasawa Shore of 2F (Bq/L)

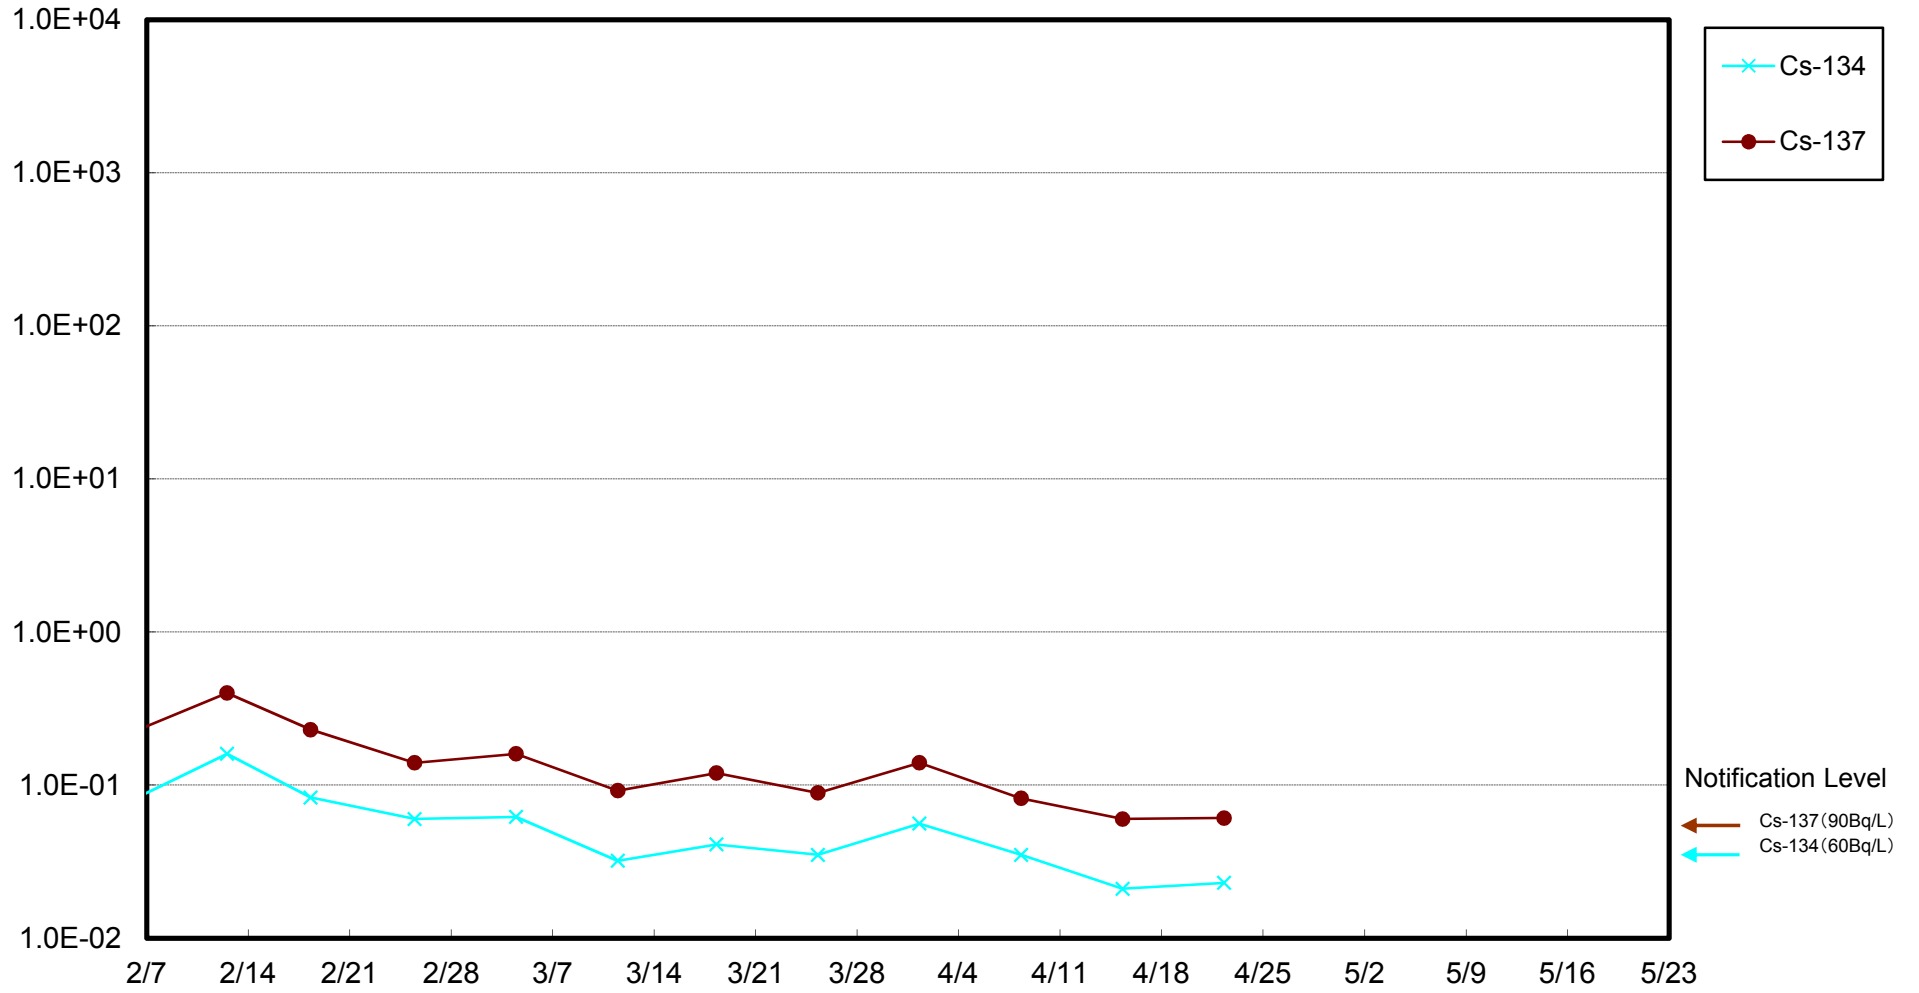


Radioactivity Density of the South Side of the Ukedo Port (Bq/L)

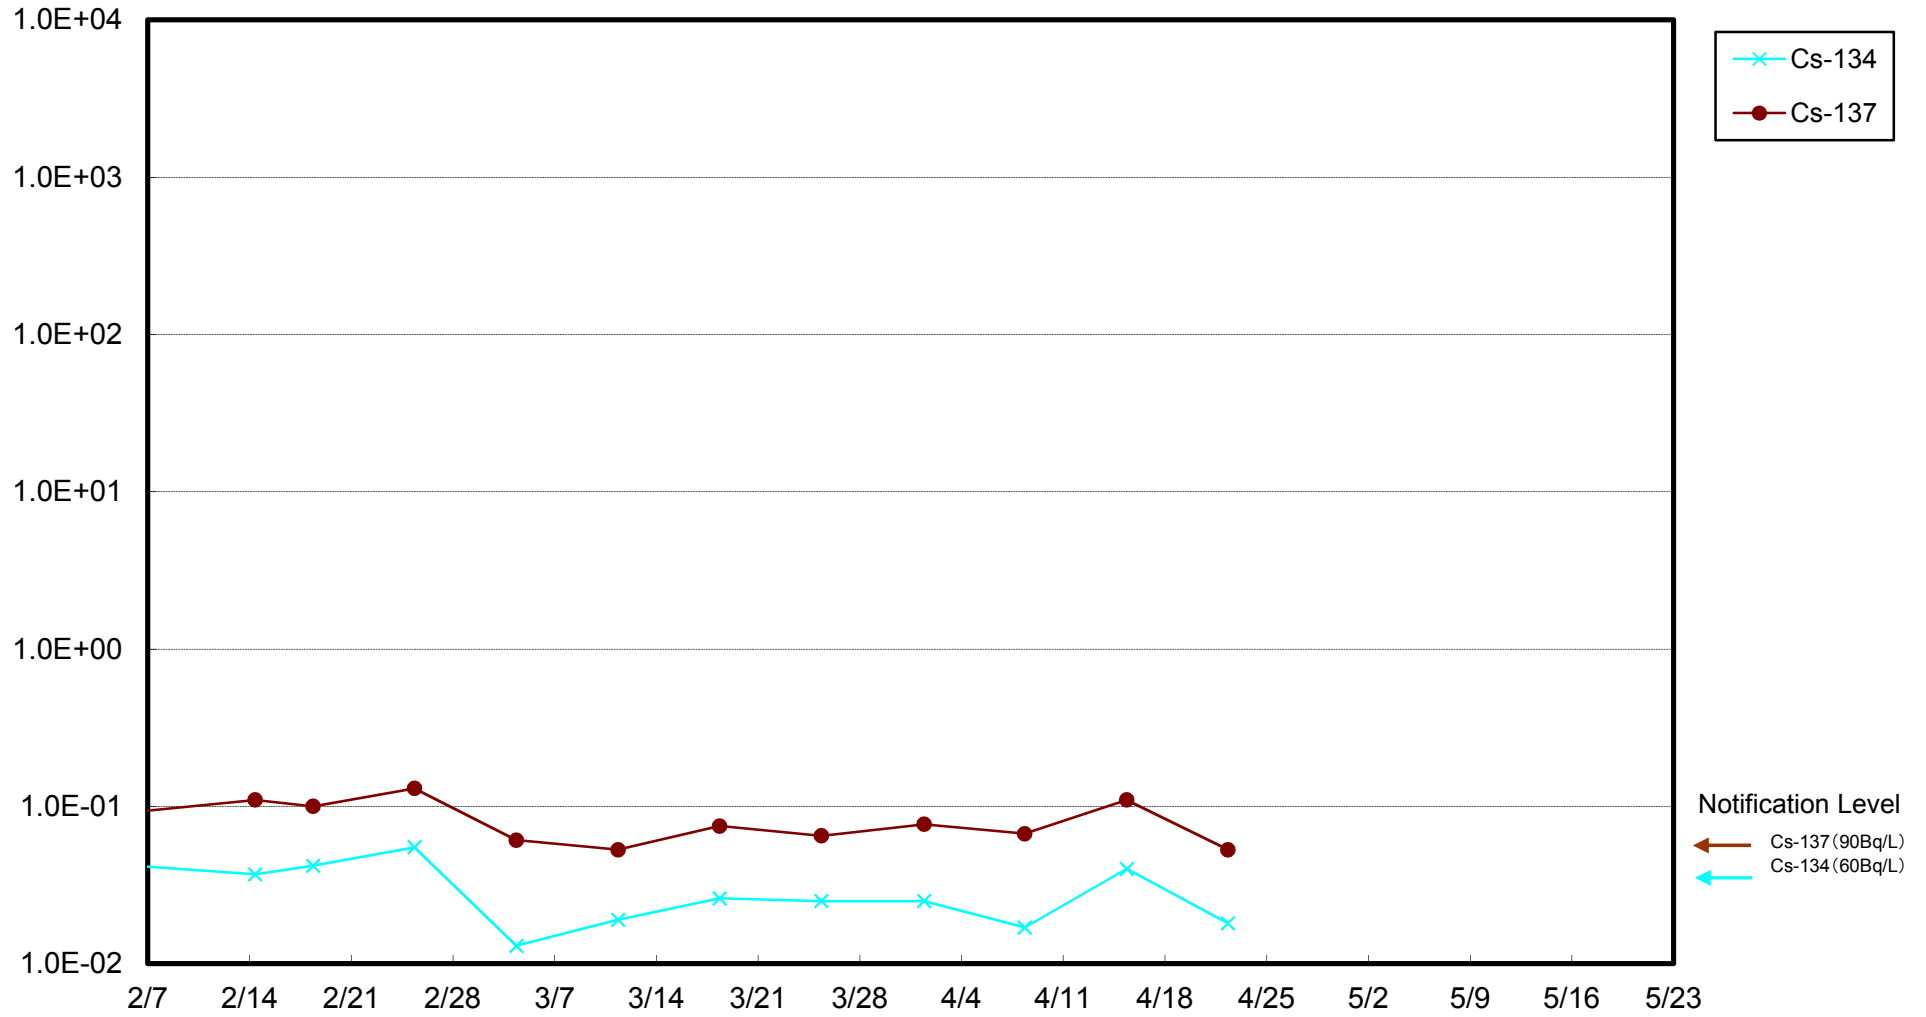


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Upper Layer (Bq/L)

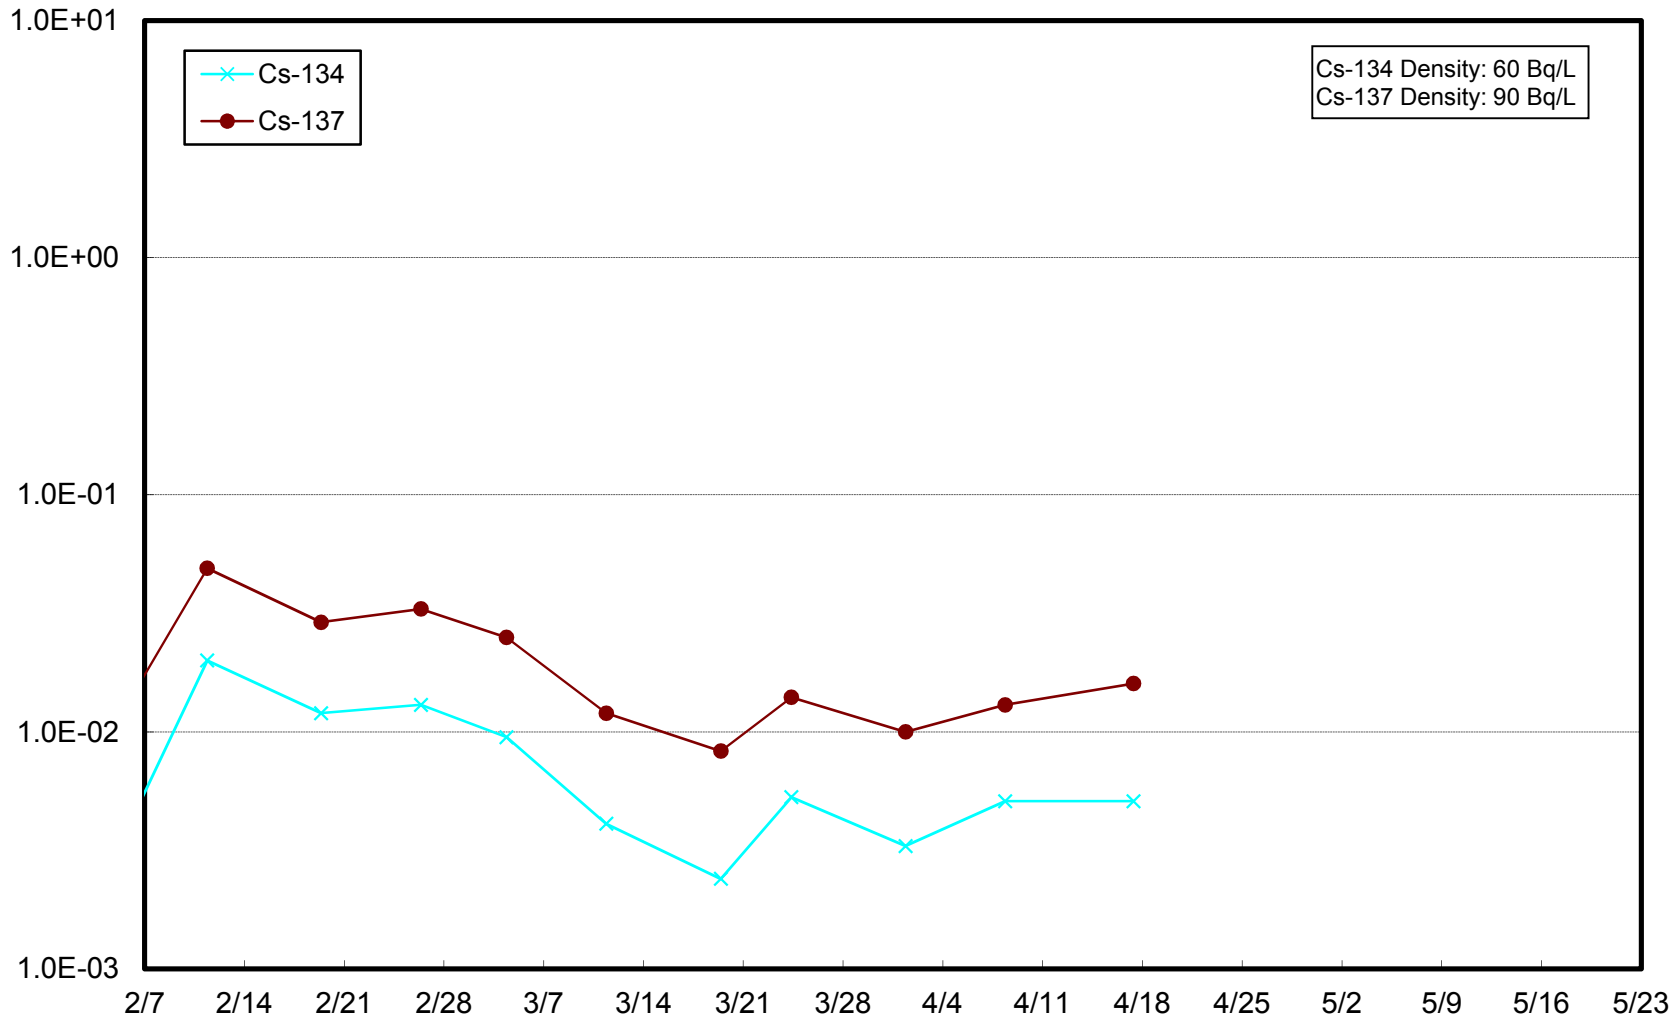

Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Lower Layer (Bq/L)

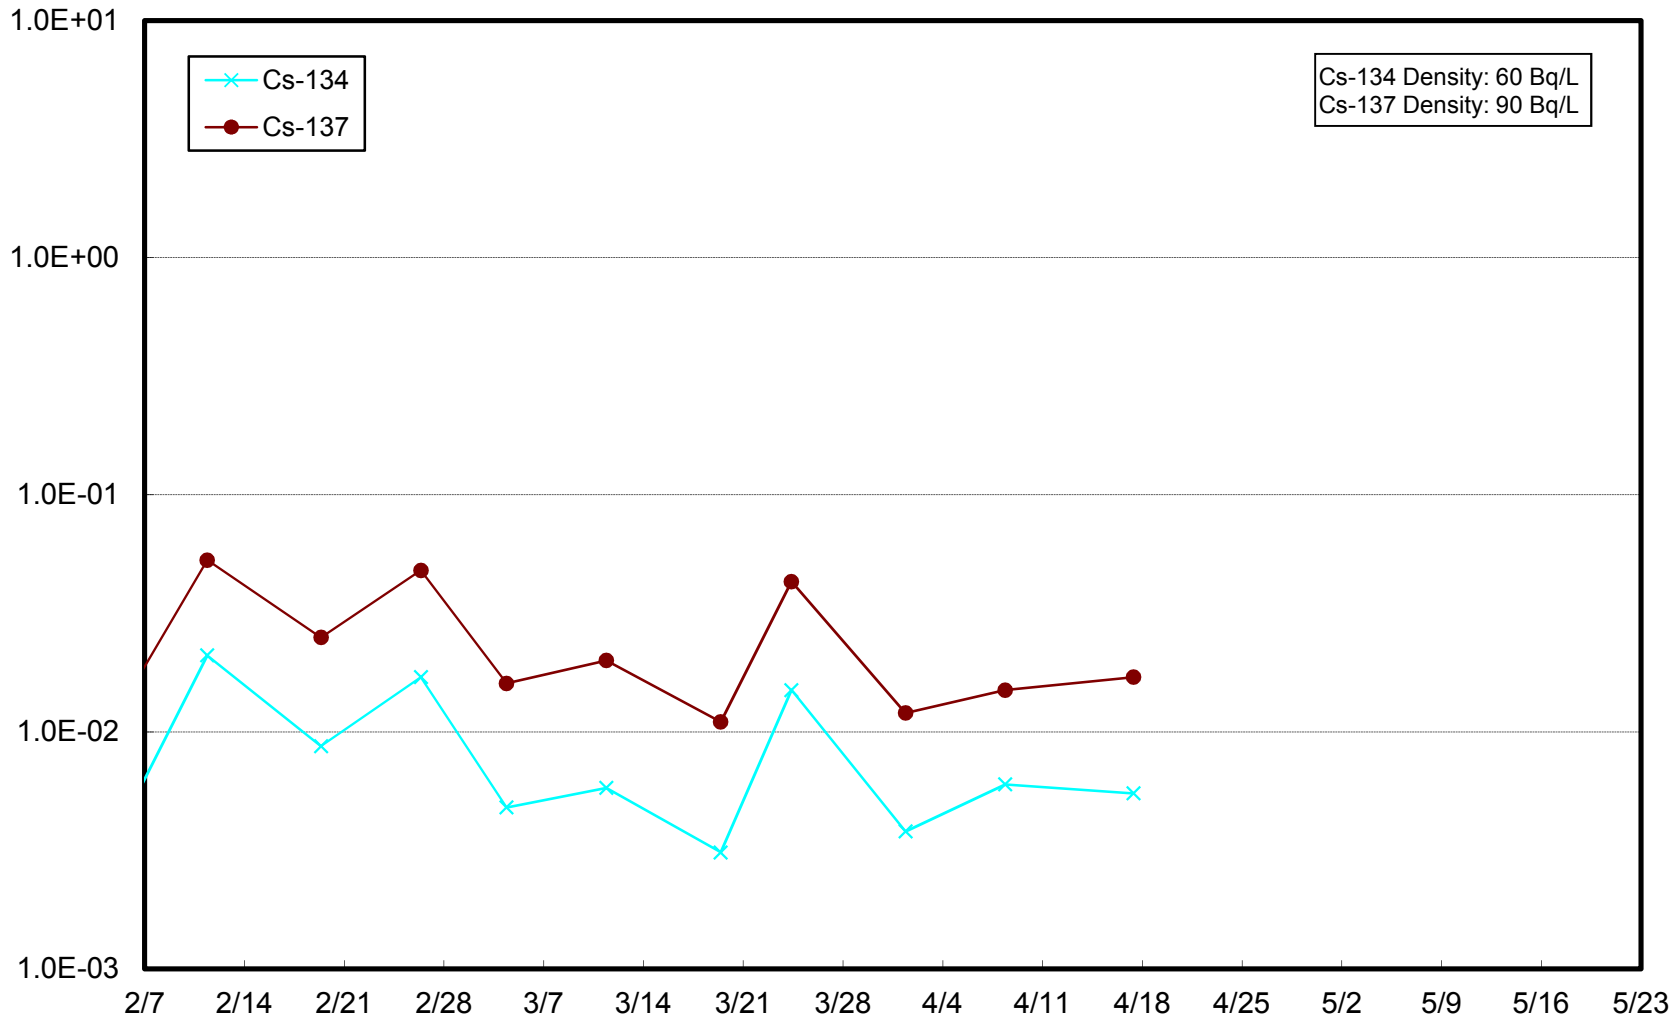


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Upper Layer (Bq/L)

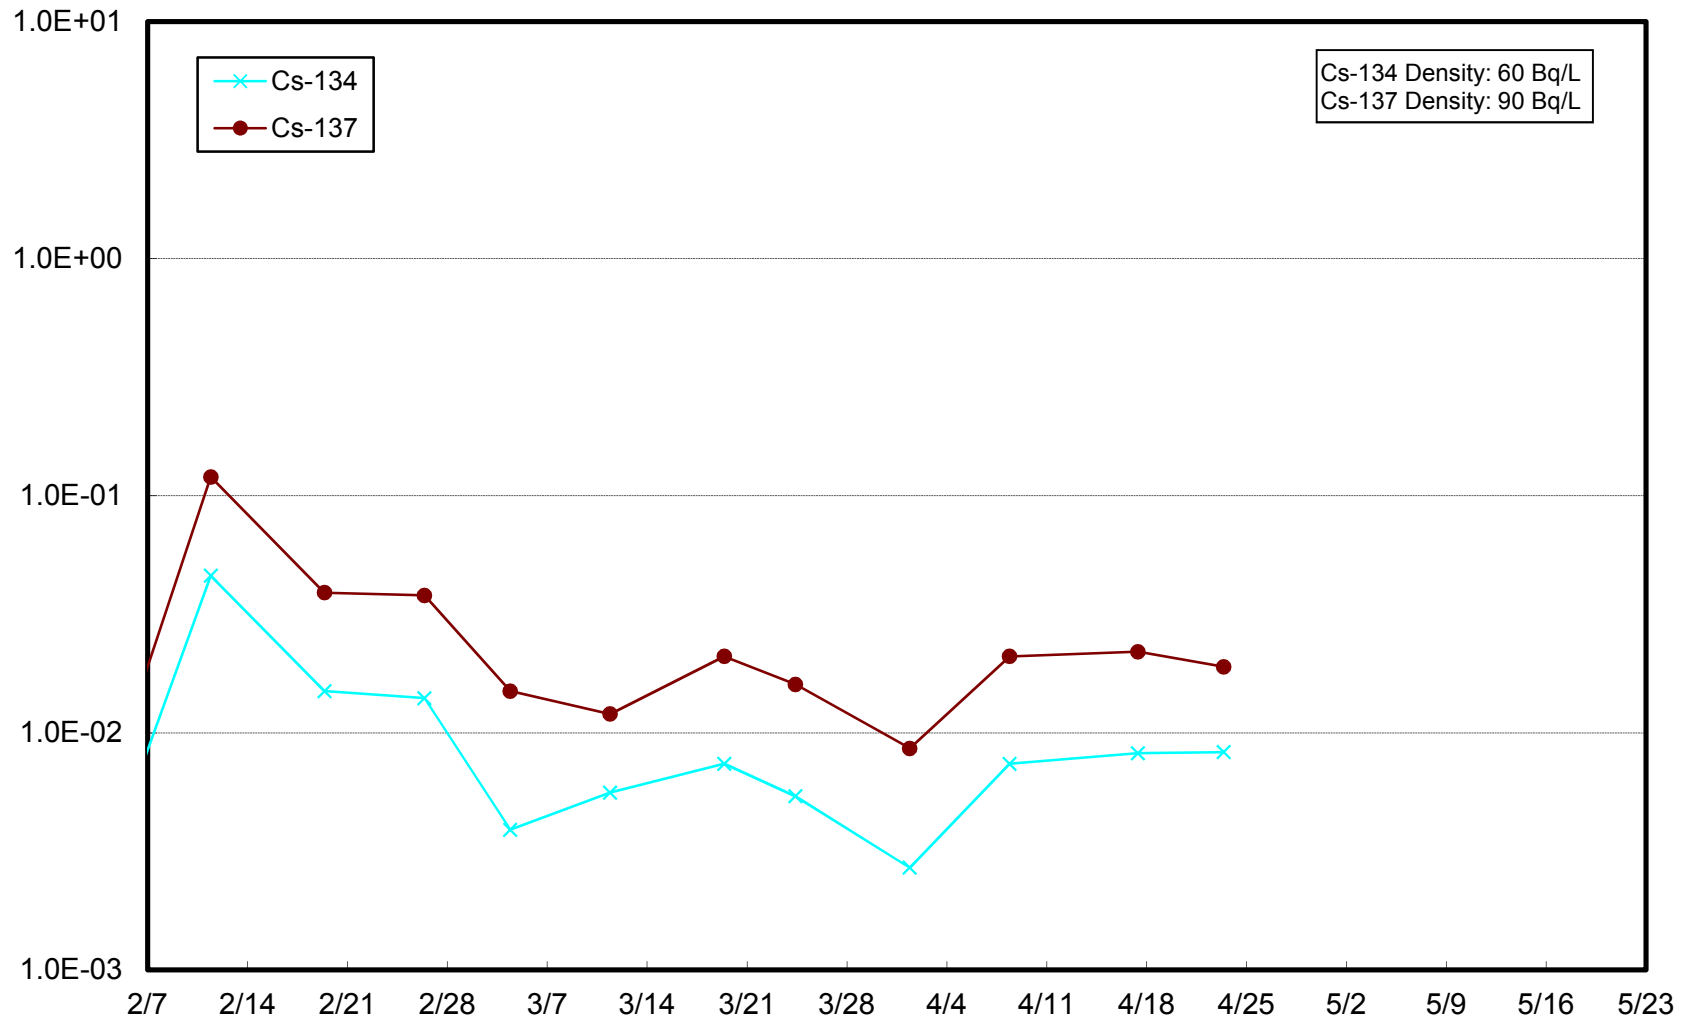





Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Lower Layer (Bq/L)

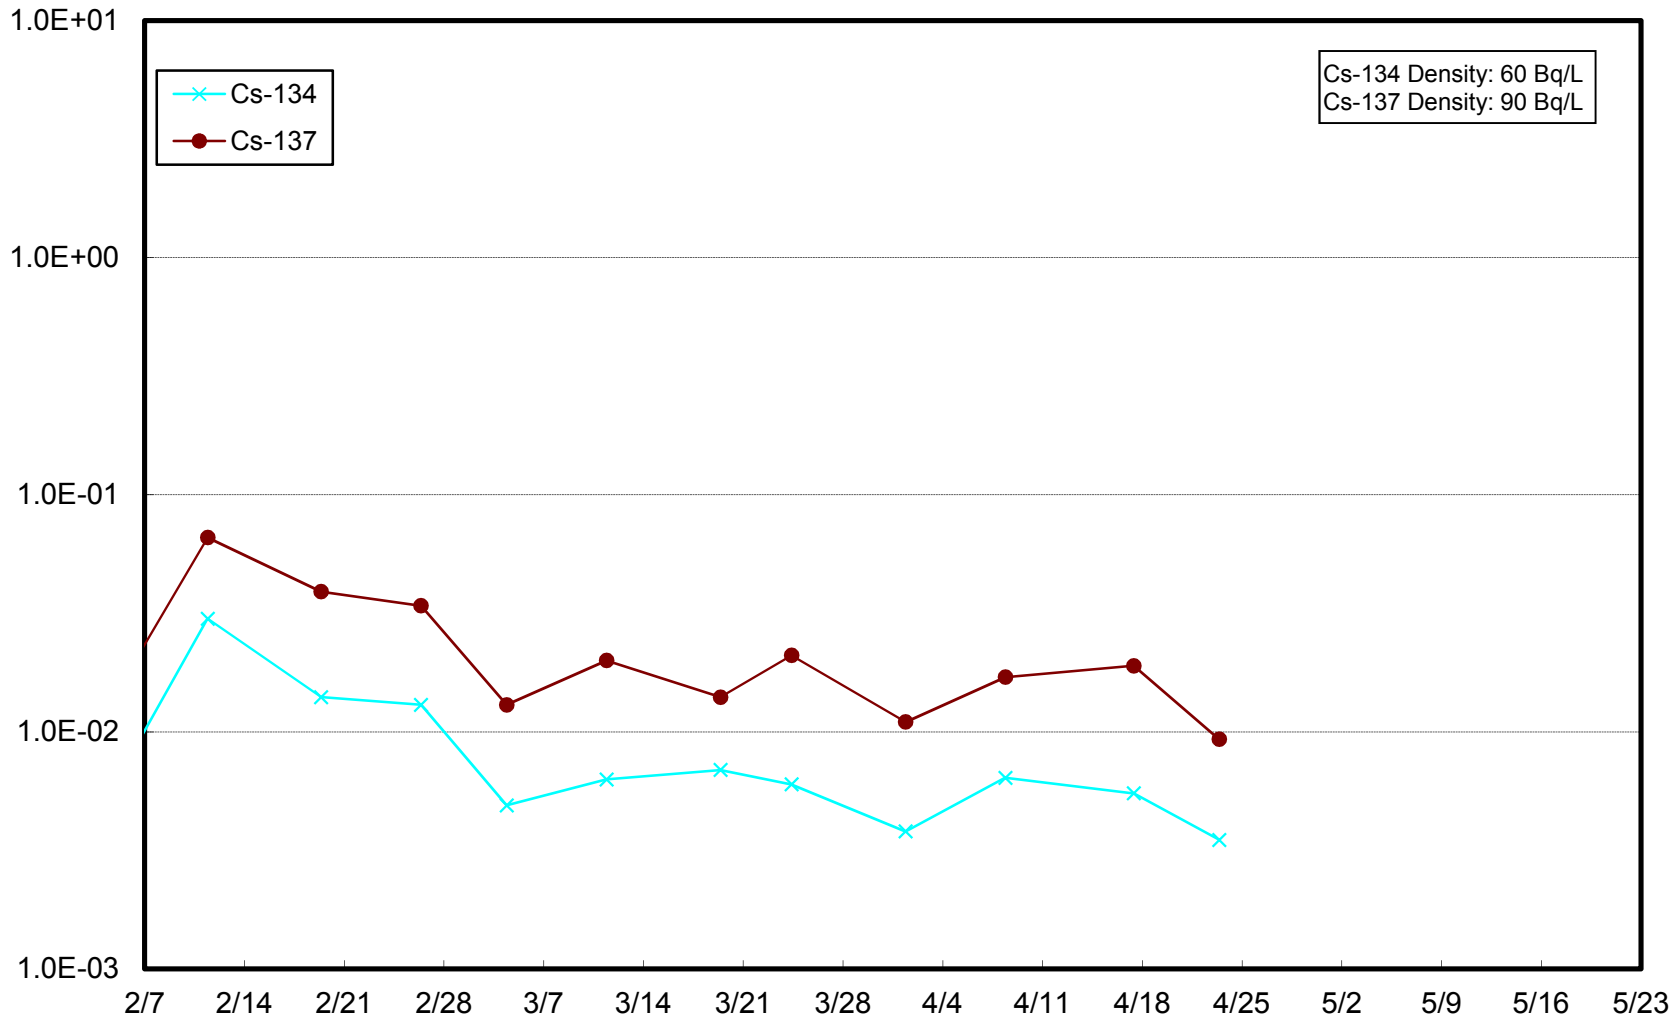


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer (Bq/L)

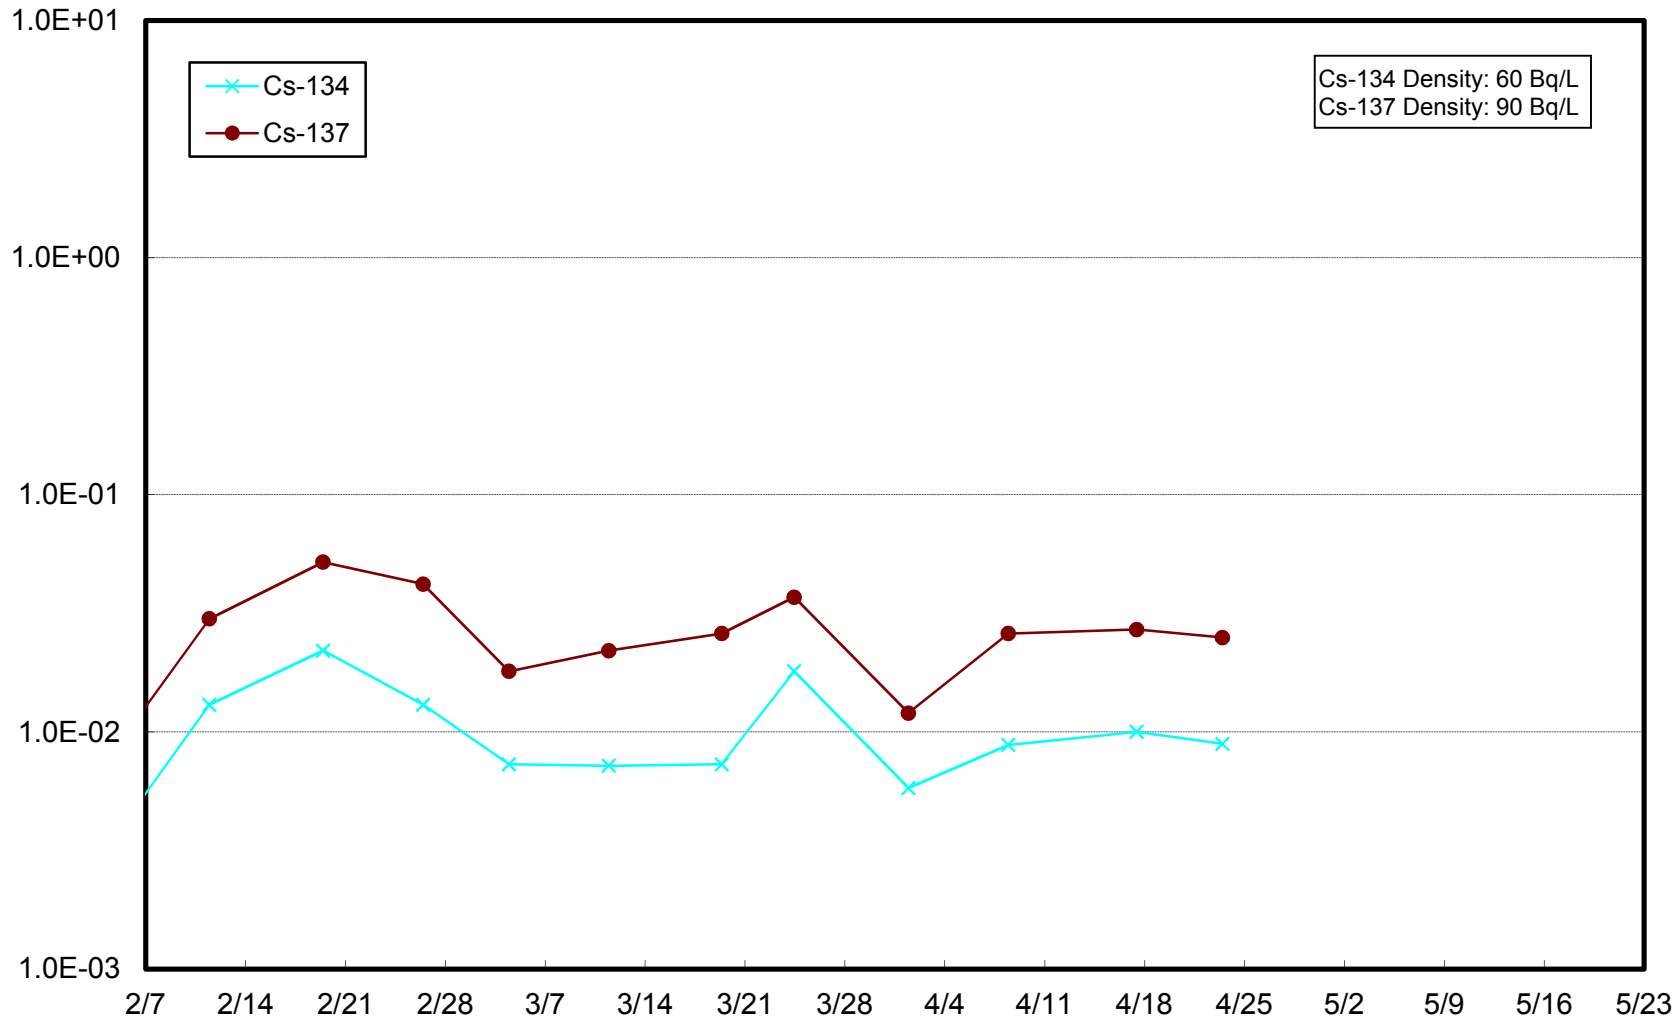


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Lower Layer (Bq/L)

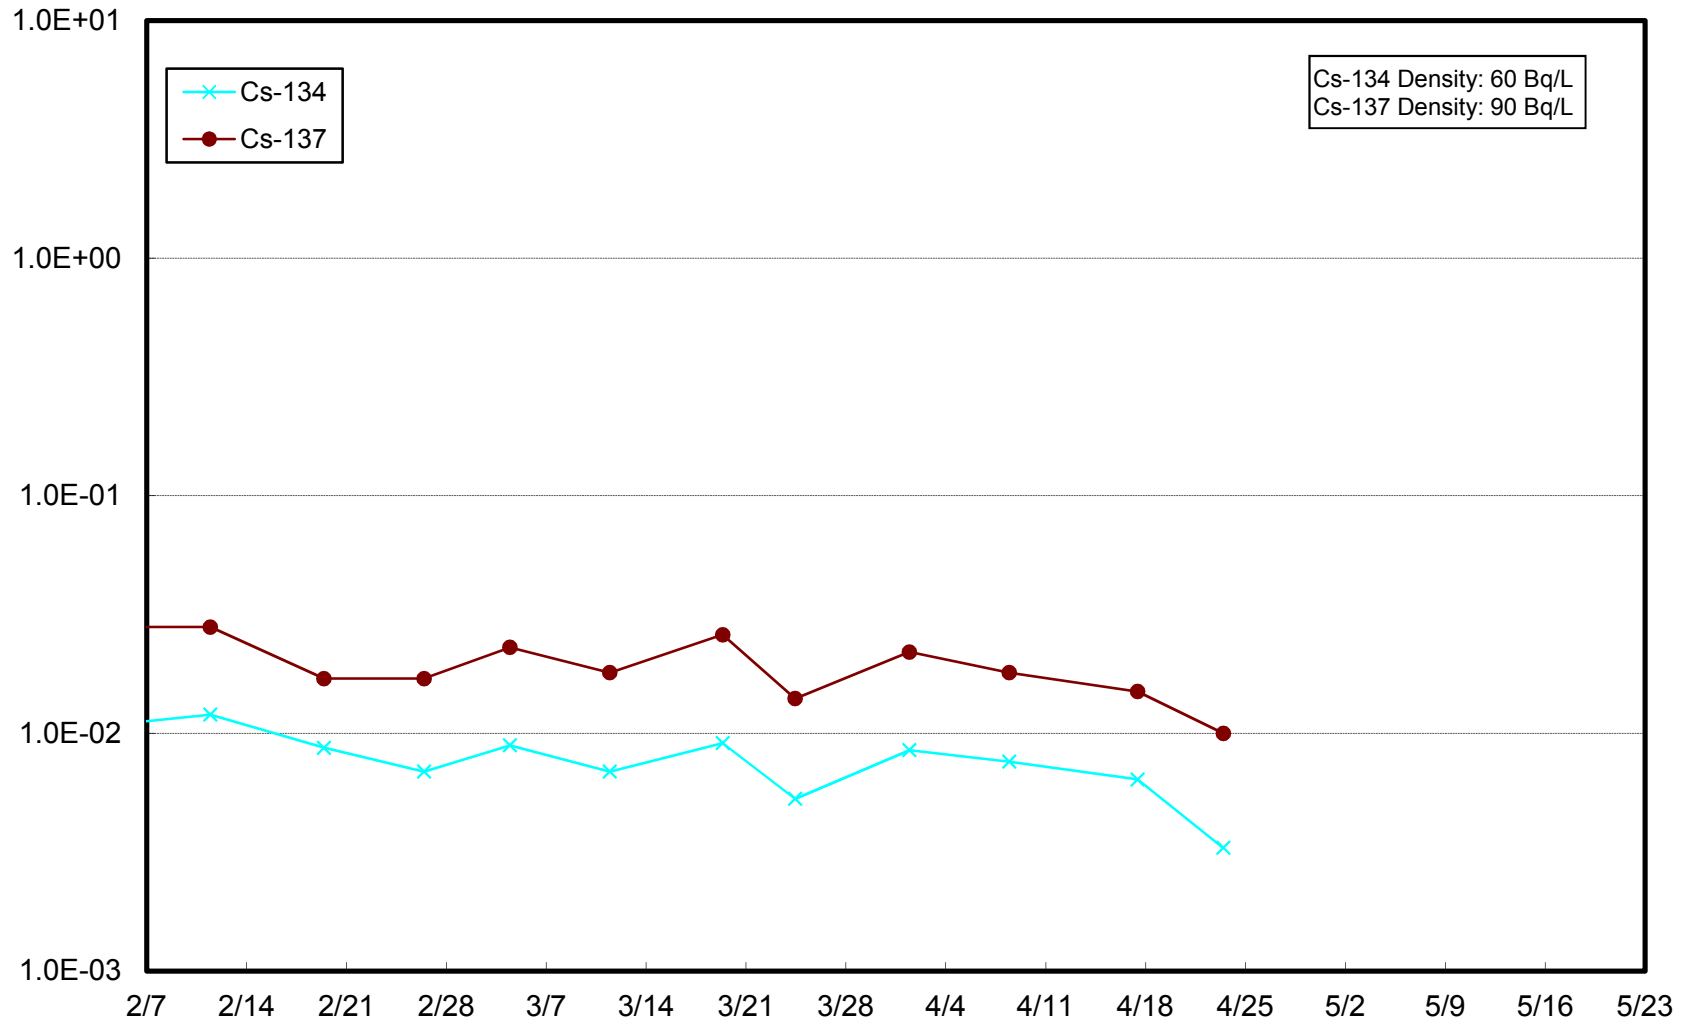


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer (Bq/L)

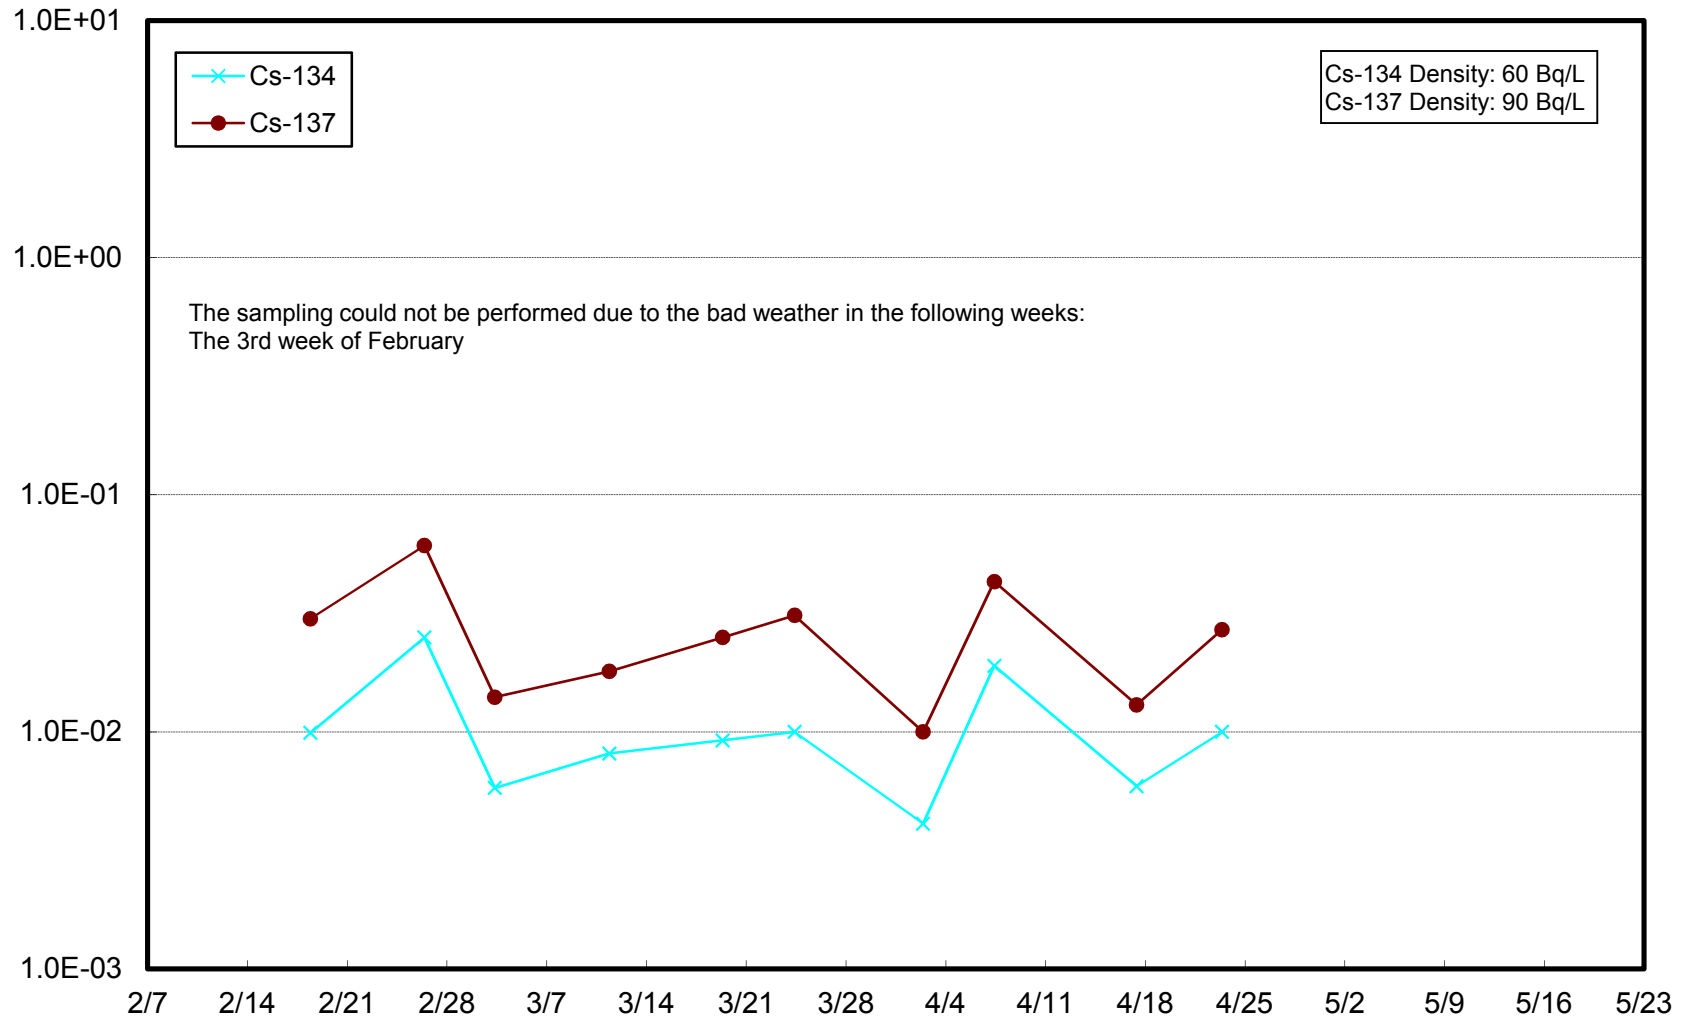


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Lower Layer (Bq/L)

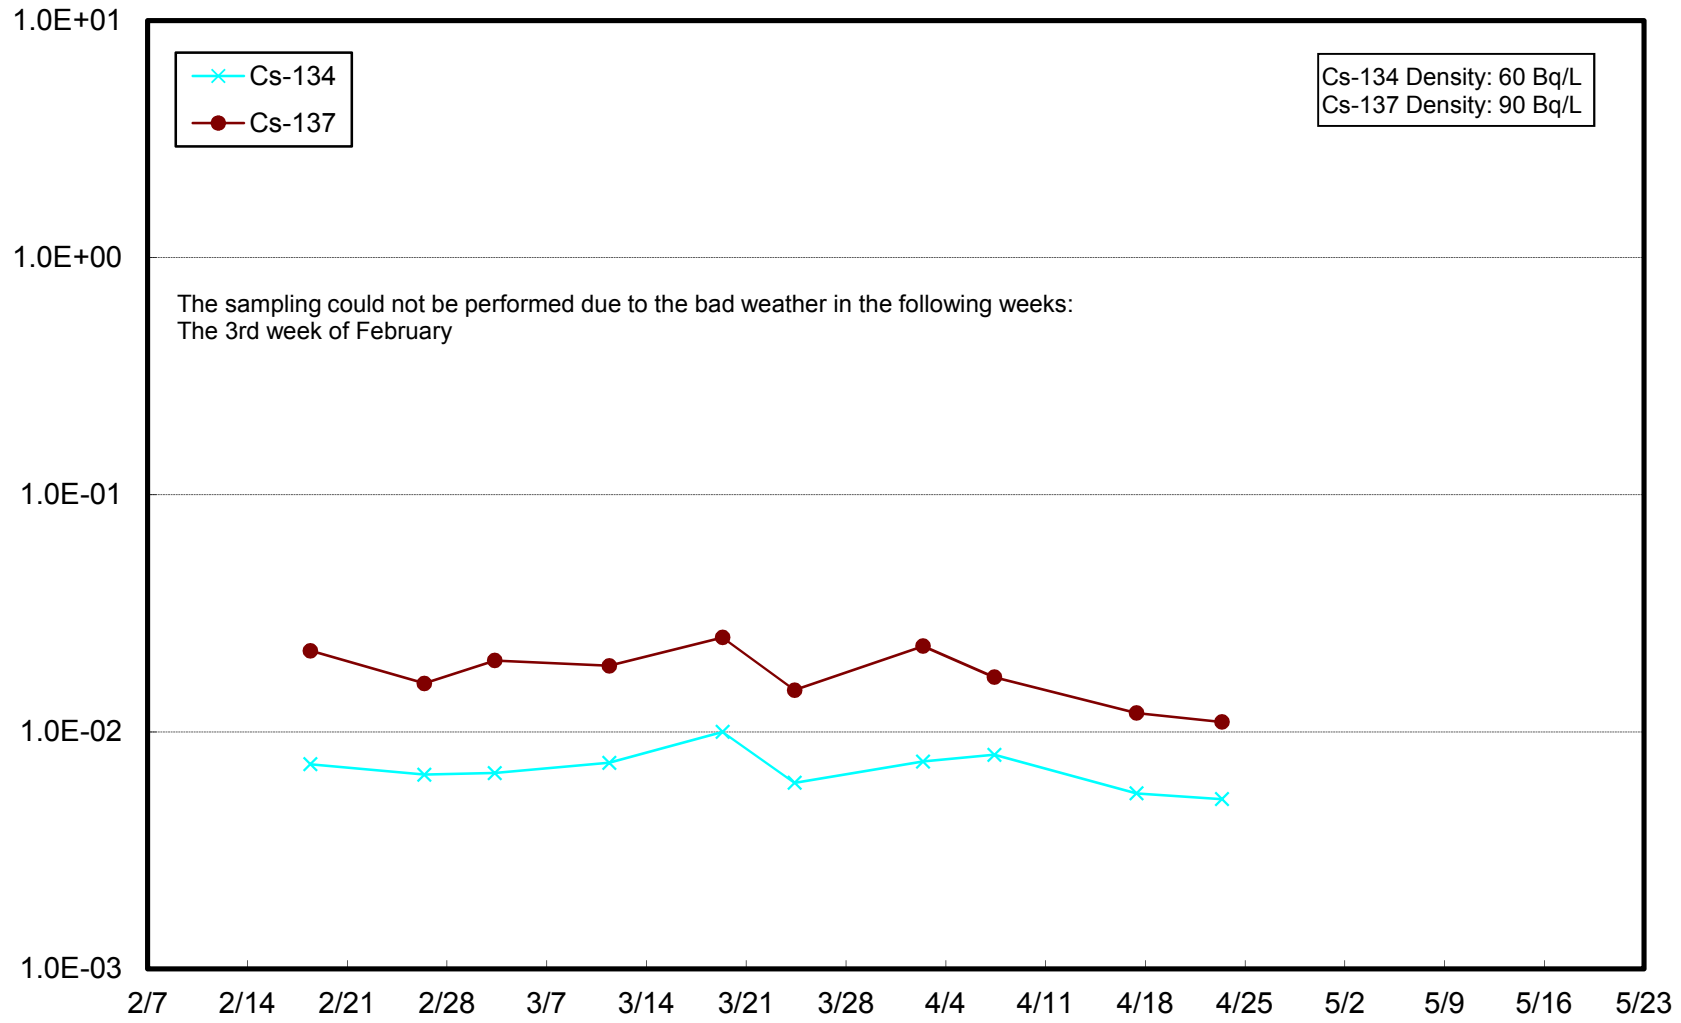


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Upper Layer (Bq/L)

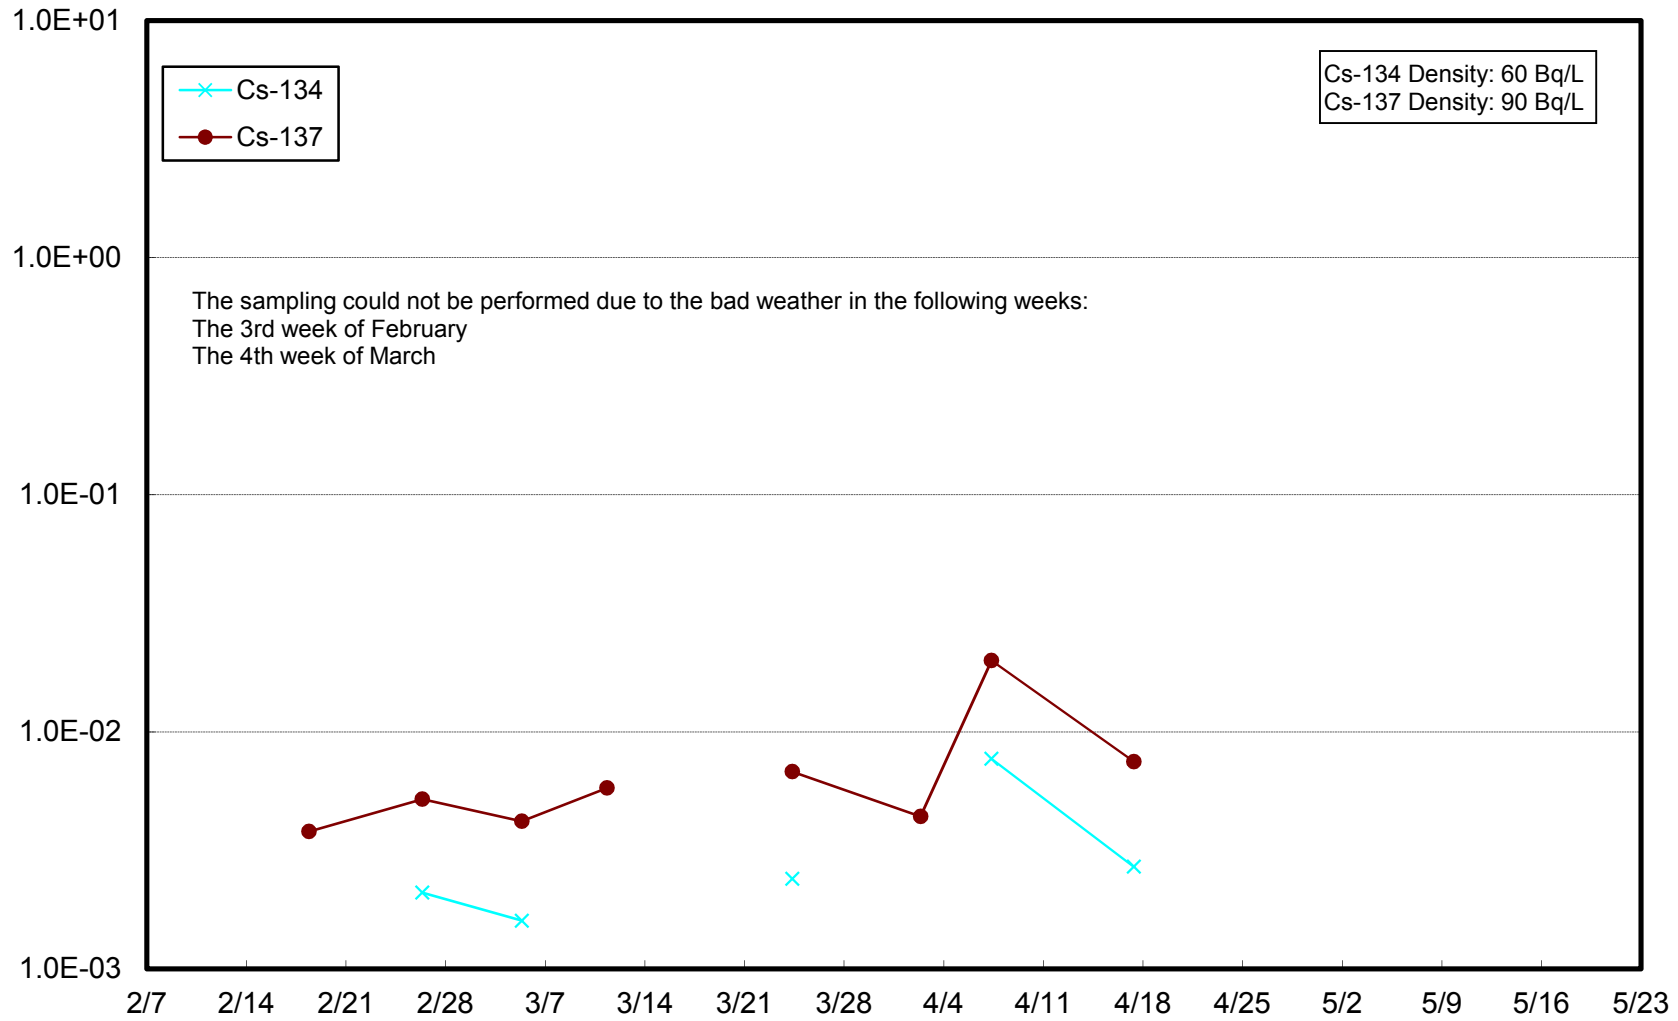

Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Lower Layer (Bq/L)

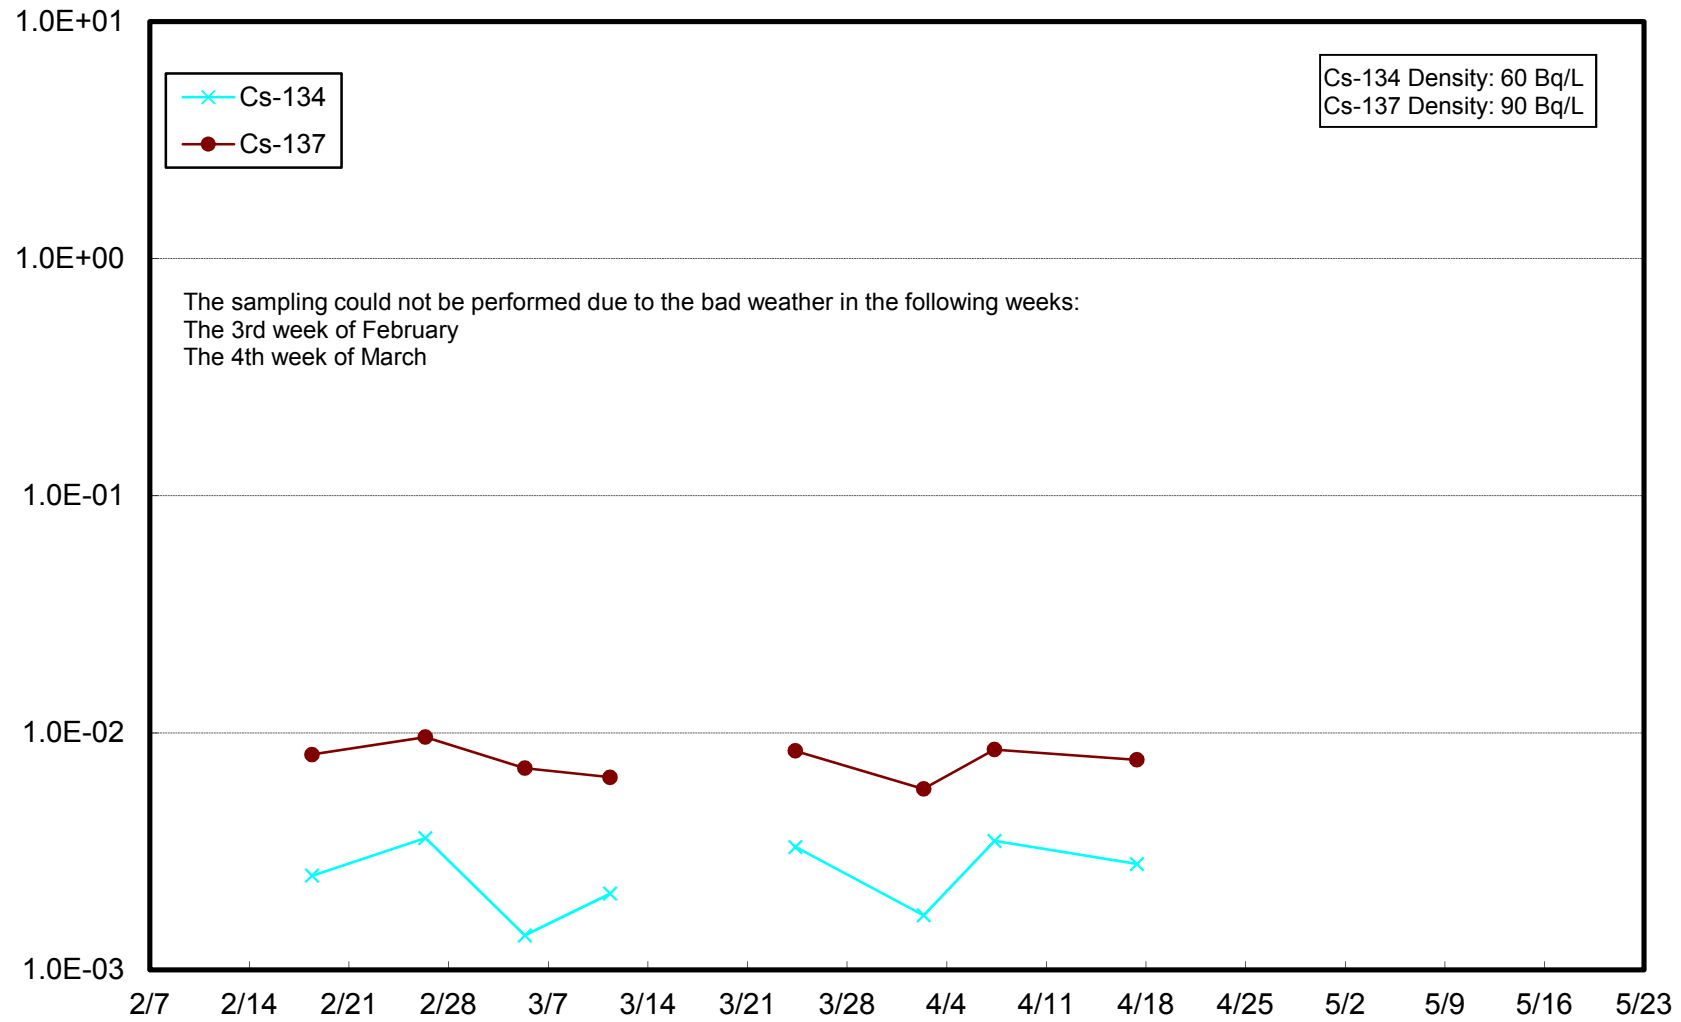


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Upper Layer (Bq/L)

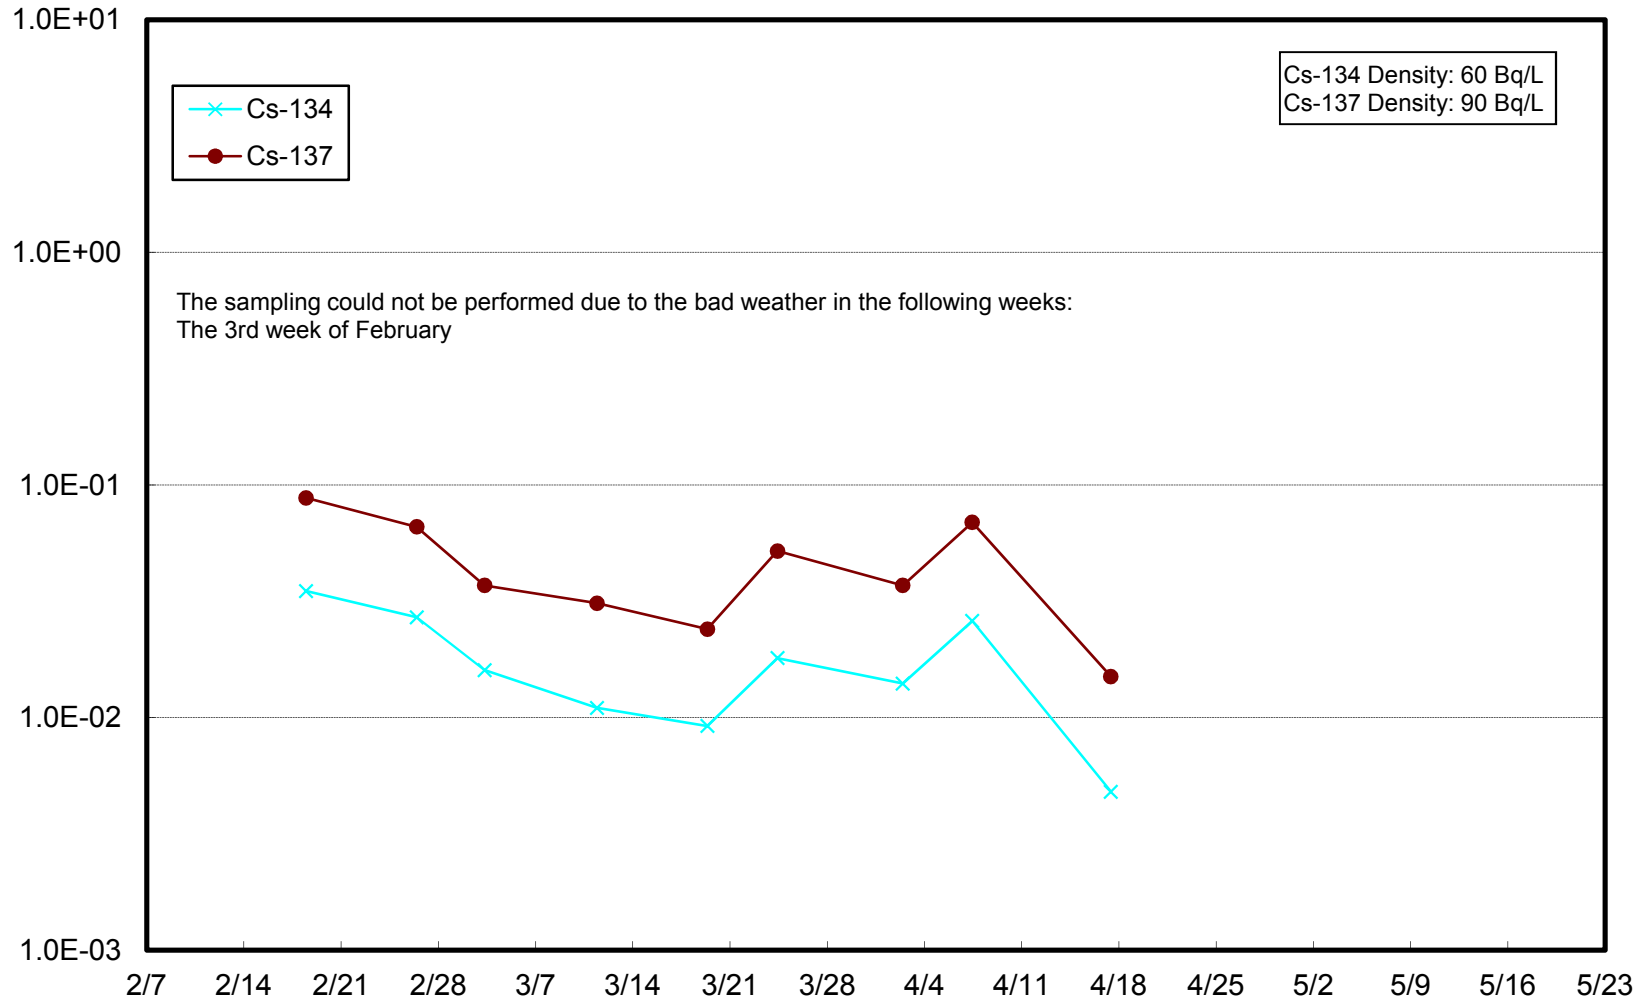





Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Lower Layer (Bq/L)

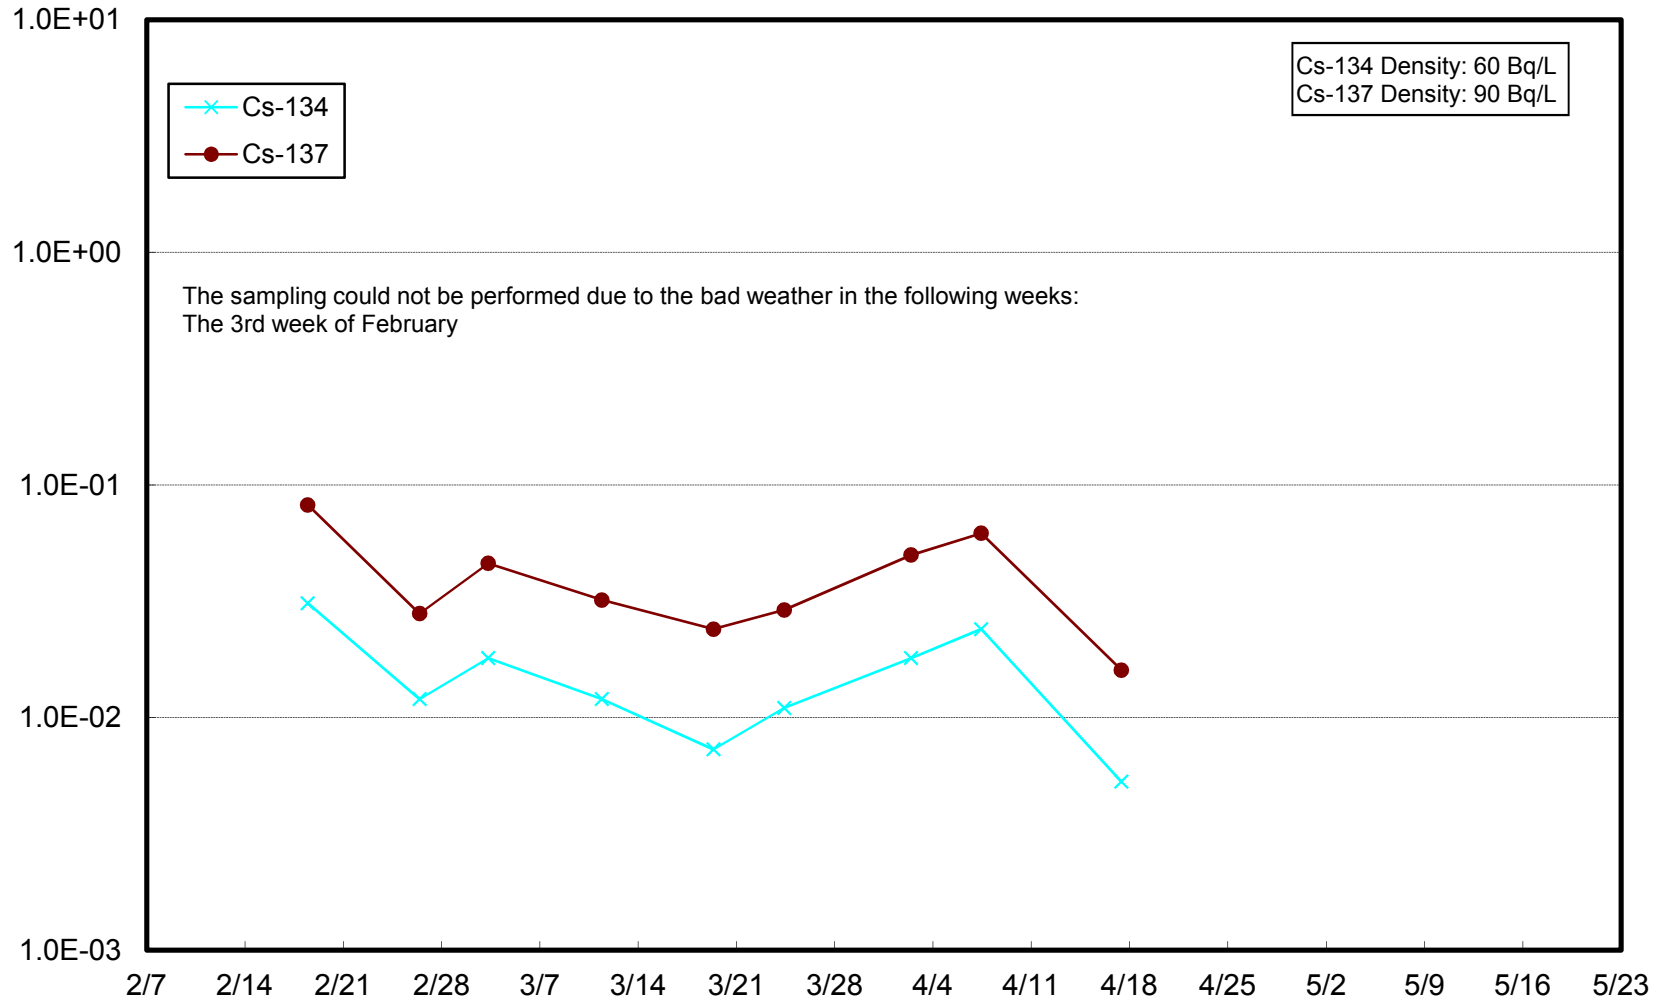


Radioactivity Density of the Seawater at 3km Offshore of North of Iwaki City(T-12) Upper Layer (Bq/L)

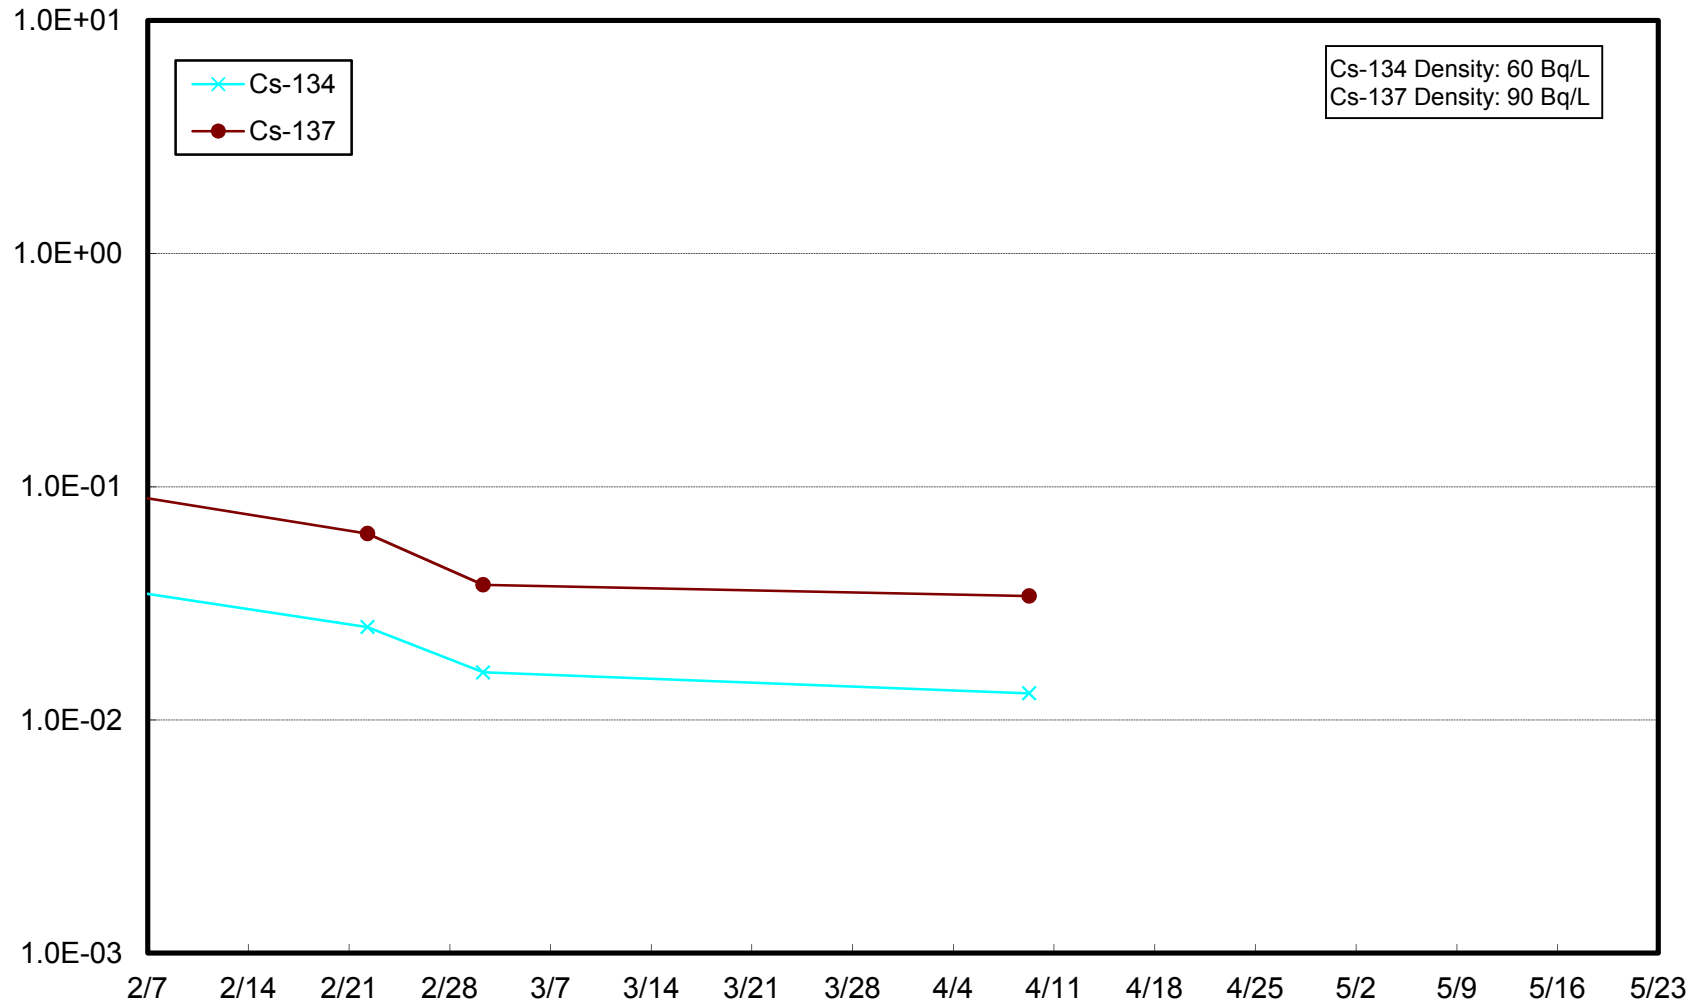


Radioactivity Density of the Seawater at 3km Offshore of North of Iwaki City(T-12) Lower Layer (Bq/L)

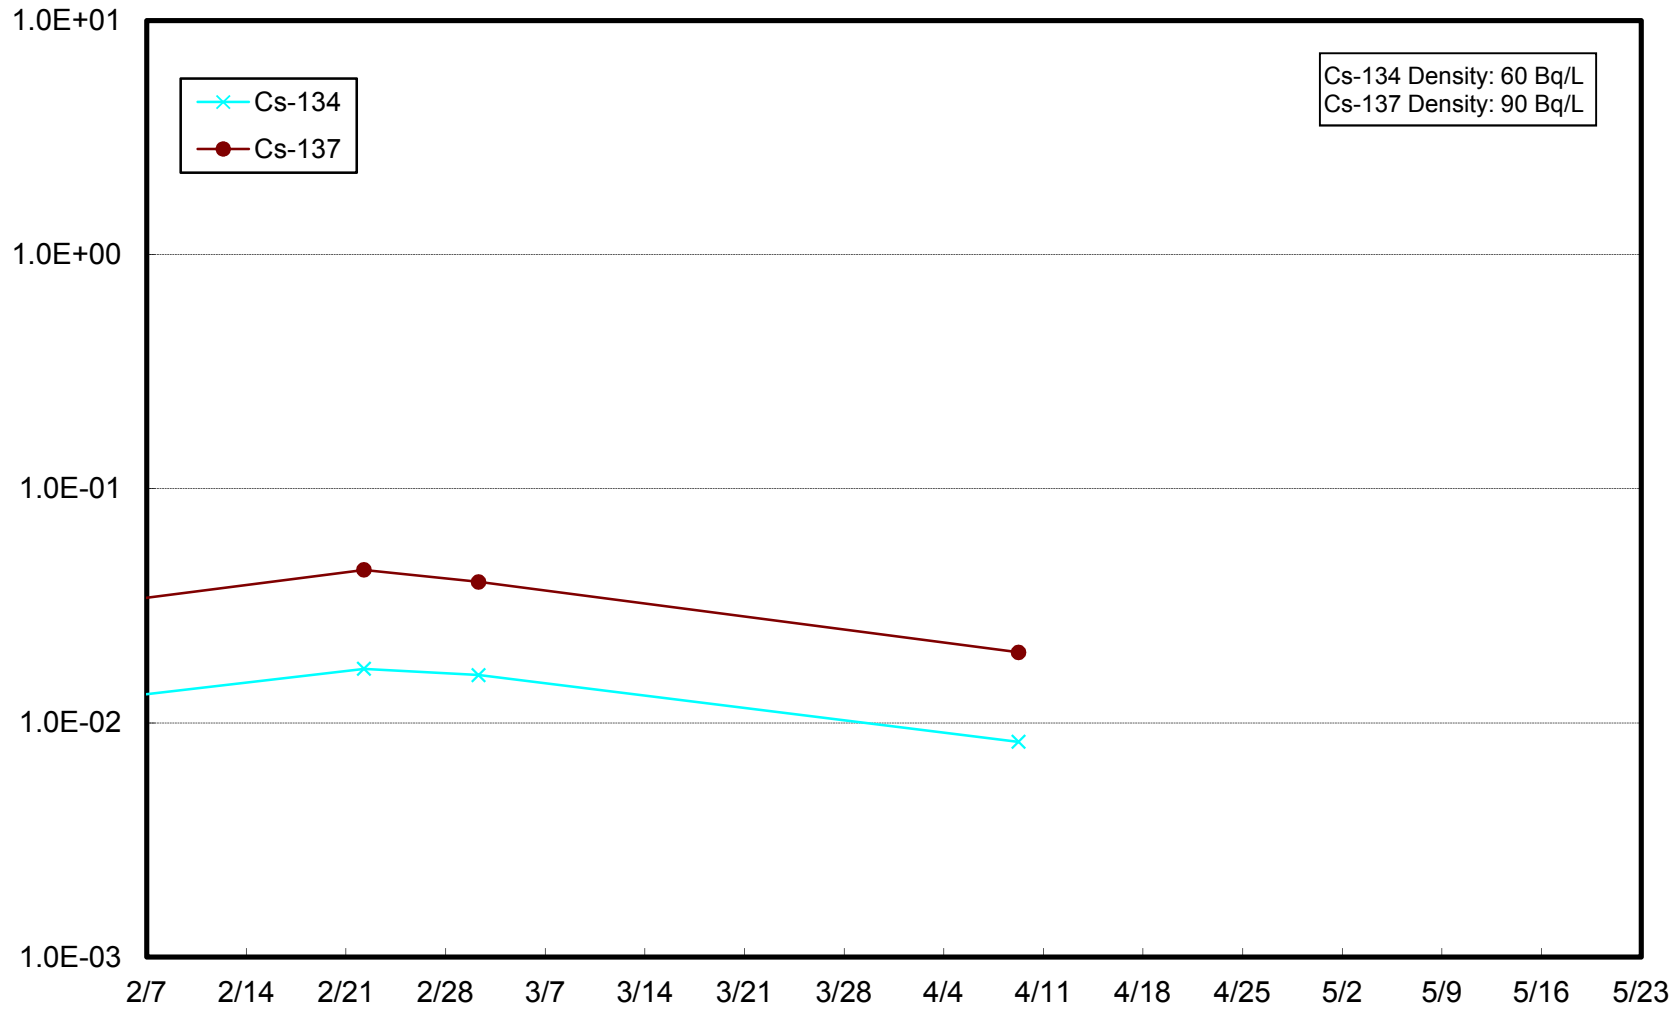


Radioactivity Density of the Seawater at 1km Offshore of Natsui River (T-17-1) Upper Layer (Bq/L)

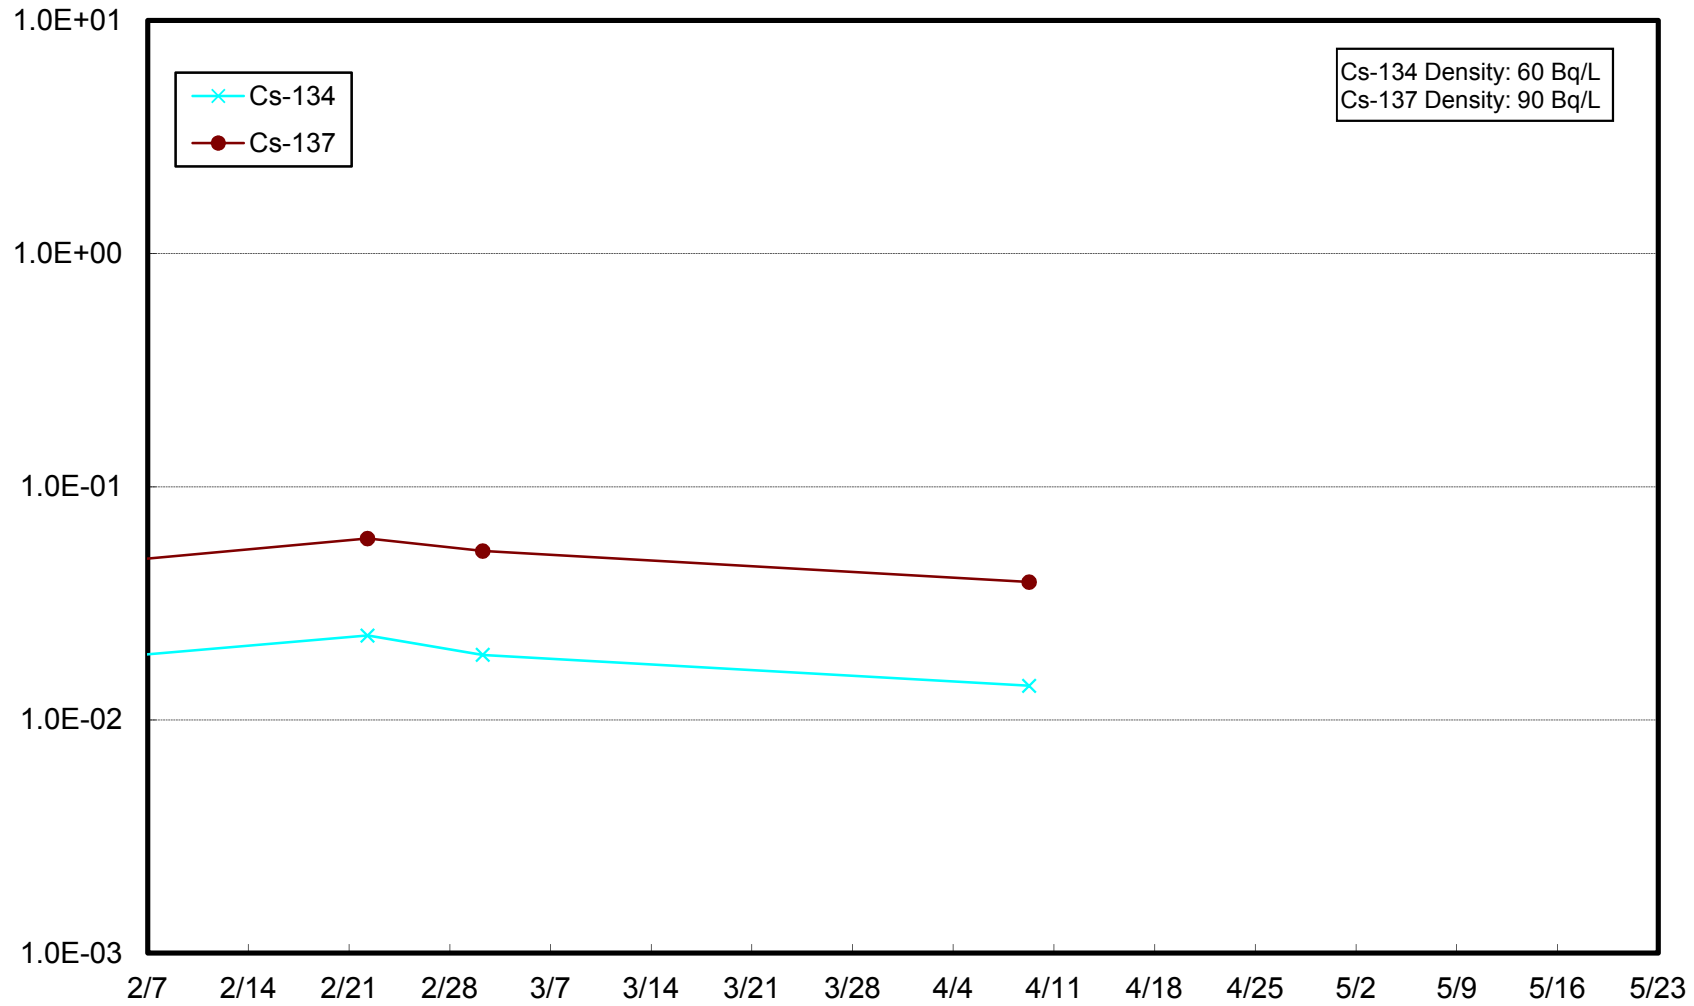


Radioactivity Density of the Seawater at 1km Offshore of Natsui River (T-17-1) Lower Layer (Bq/L)

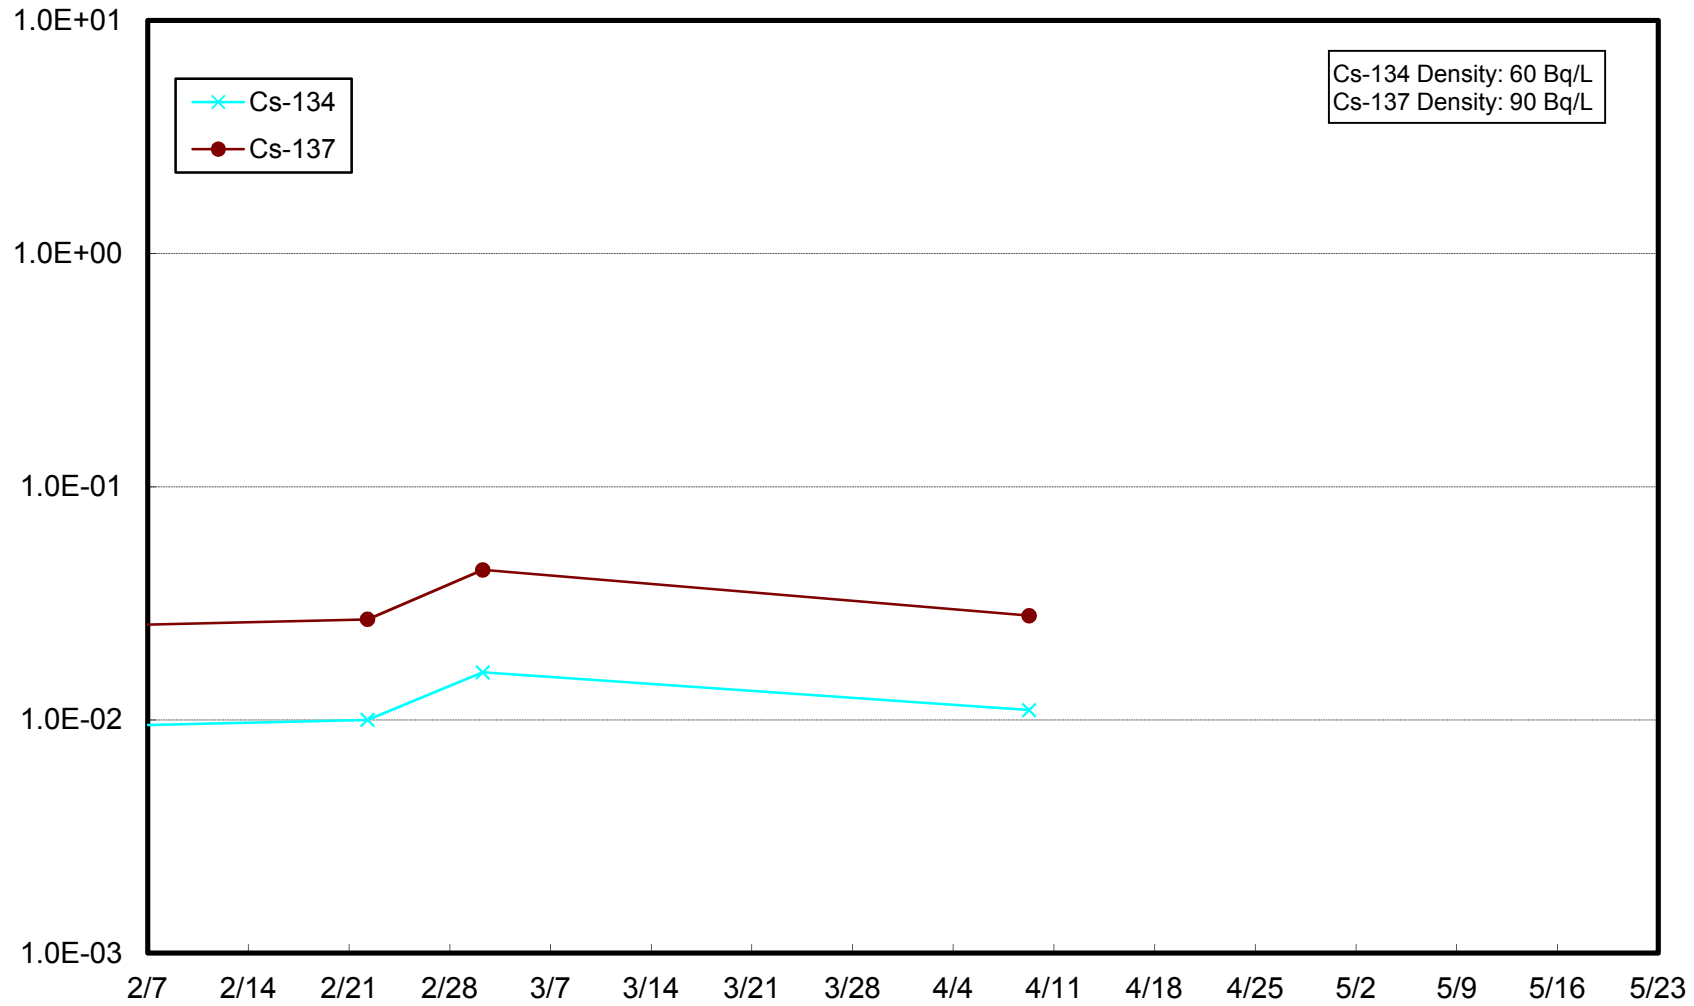


Radioactivity Density of the Seawater at 3km Offshore of Toyoma (T-20) Upper Layer (Bq/L)

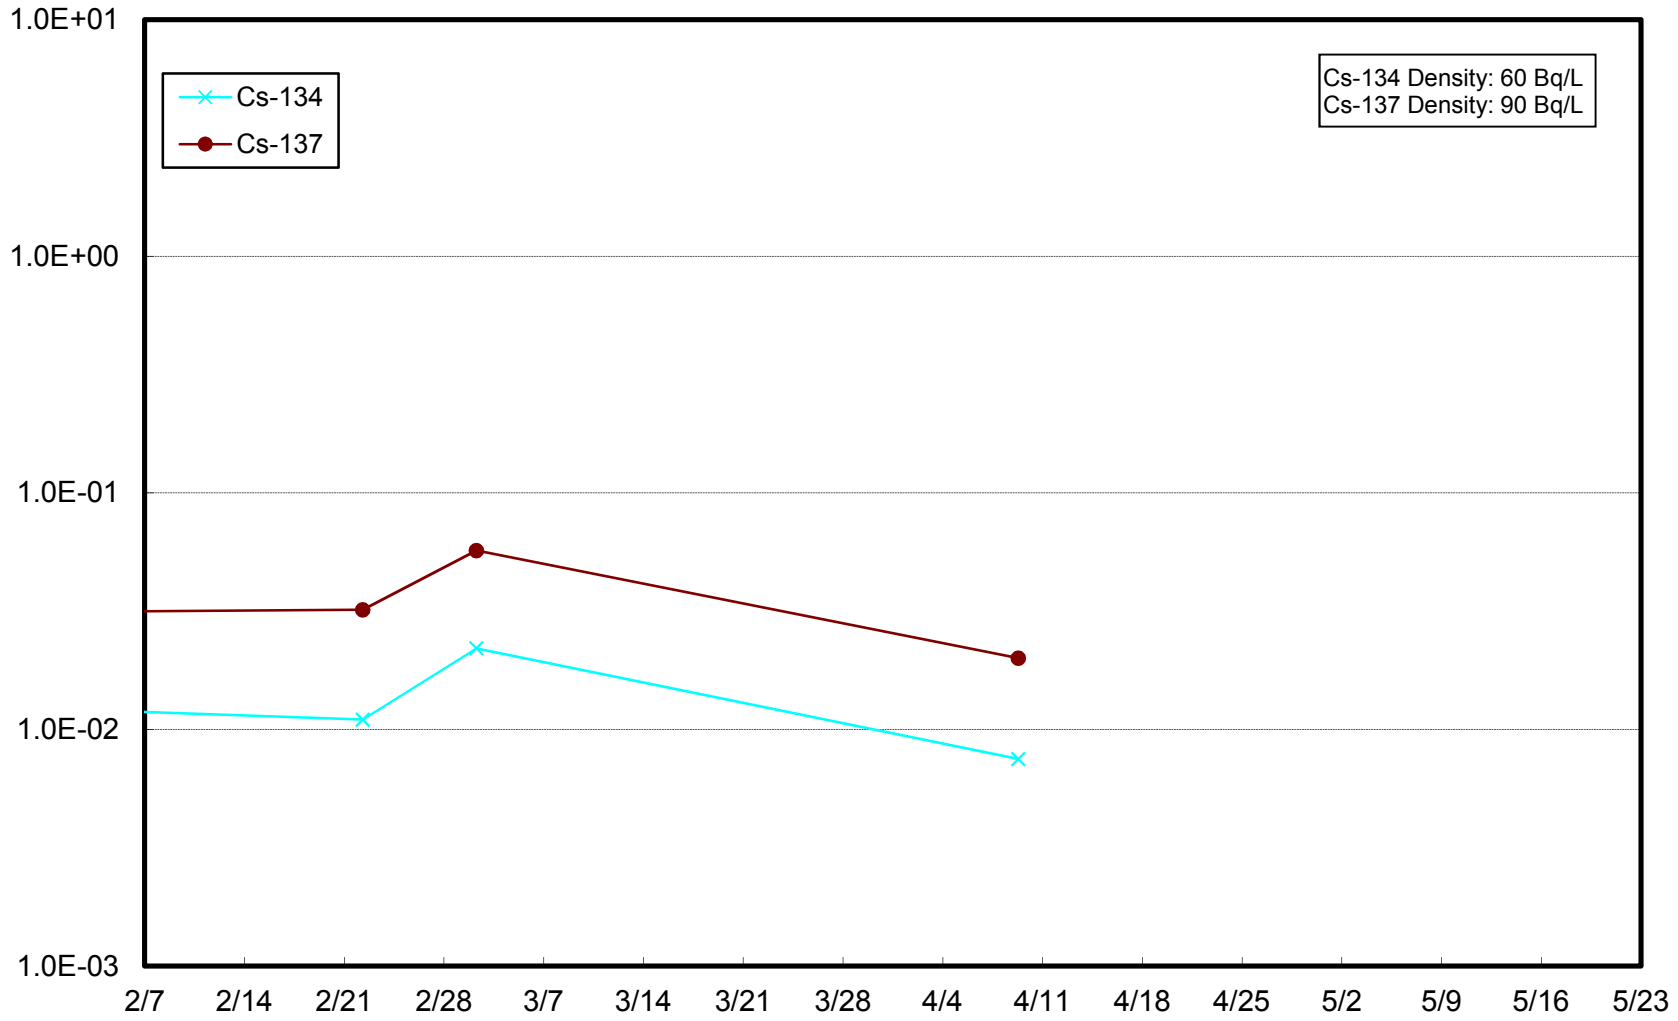

Radioactivity Density of the Seawater at 3km Offshore of Toyoma (T-20) Upper Layer (Bq/L)

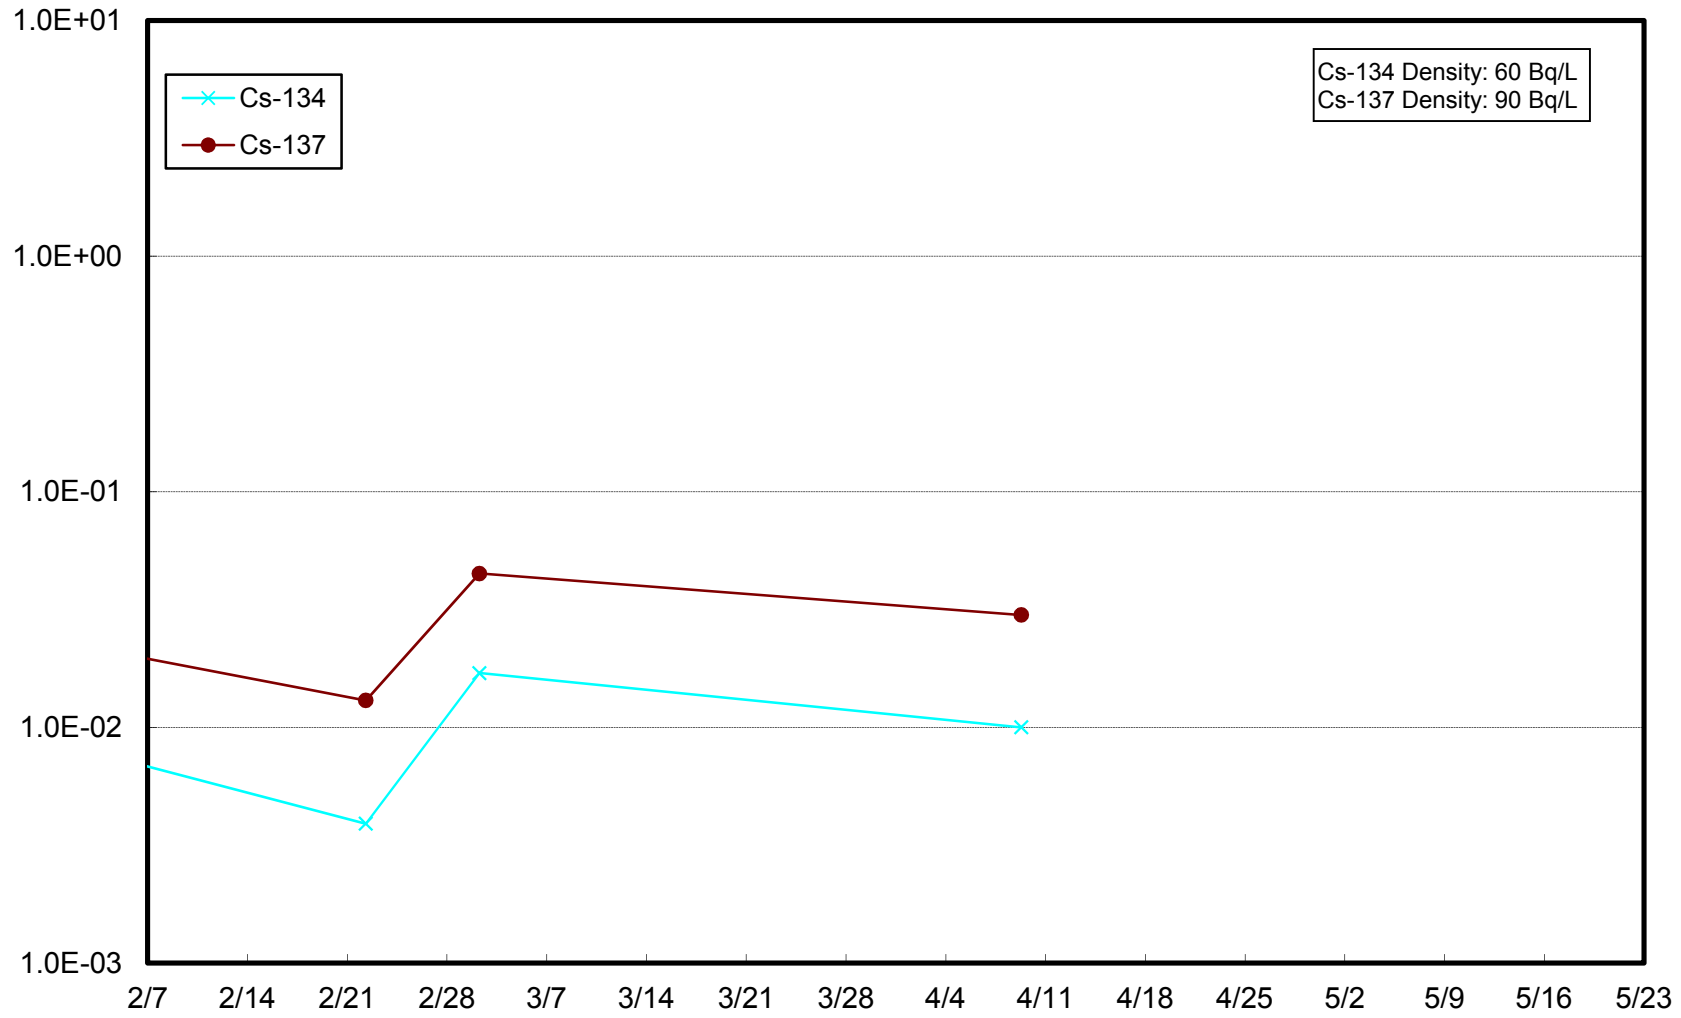


Radioactivity Density of the Seawater at 1km Offshore of Nida River (T-13-1) Upper Layer (Bq/L)

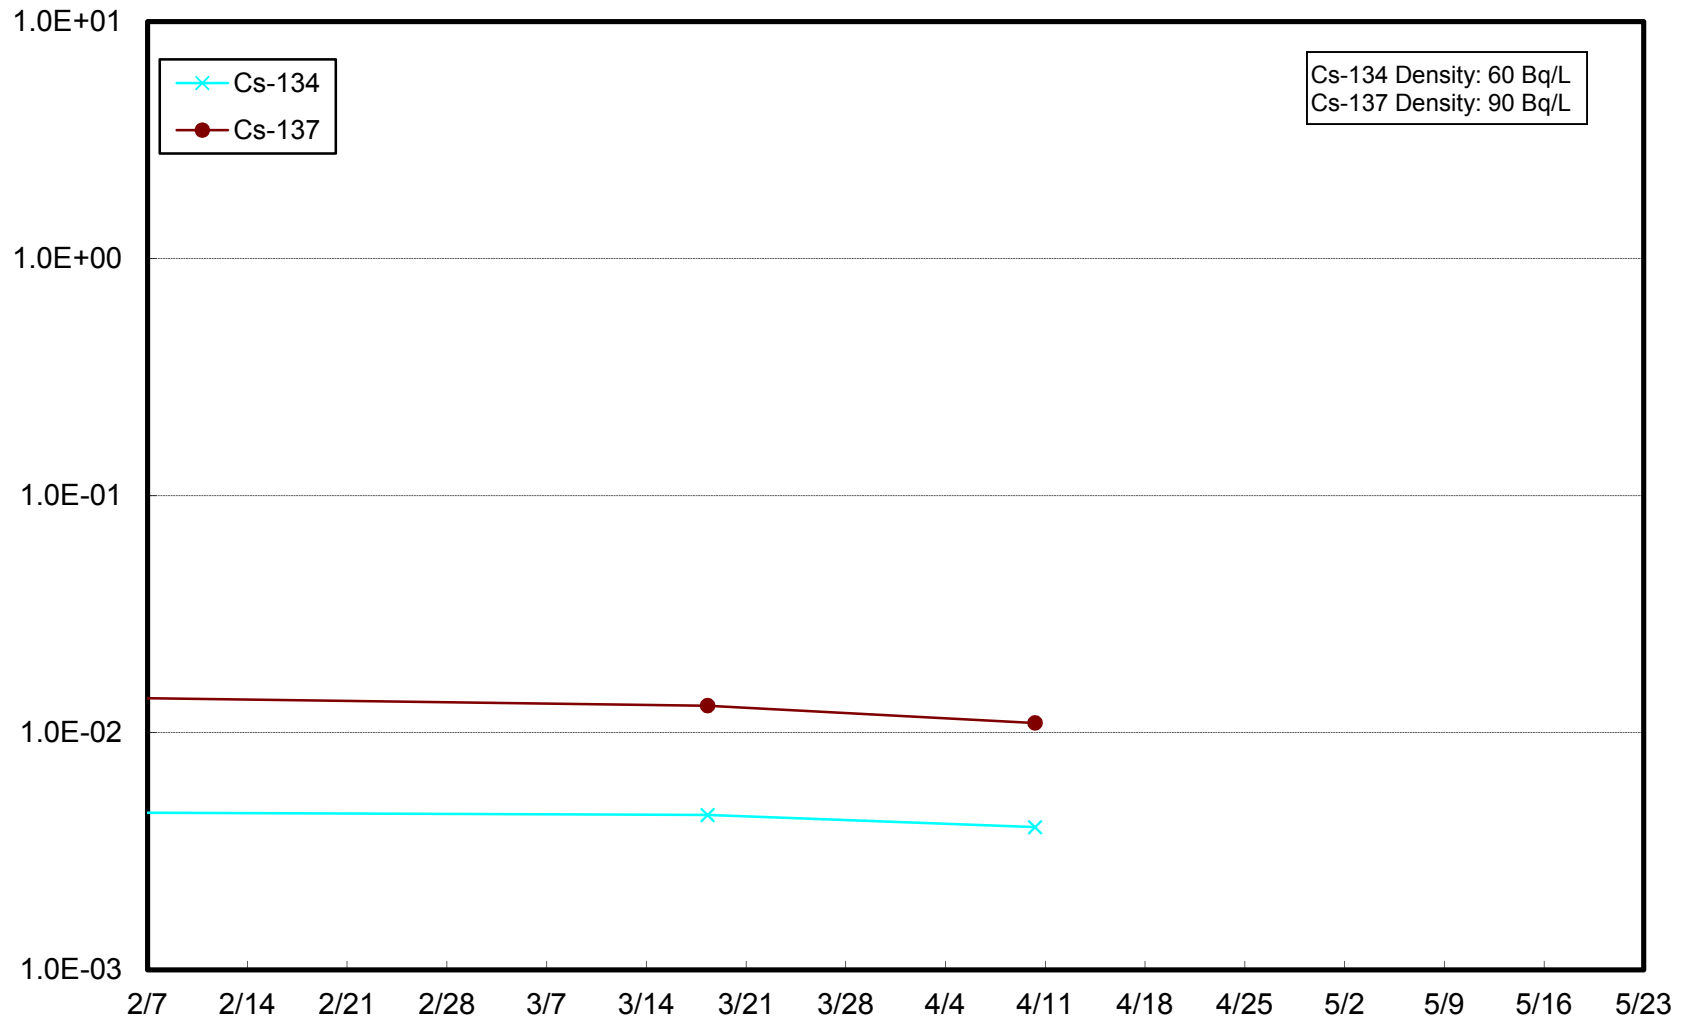





Radioactivity Density of the Seawater at 1km Offshore of Nida River (T-13-1) Lower Layer (Bq/L)

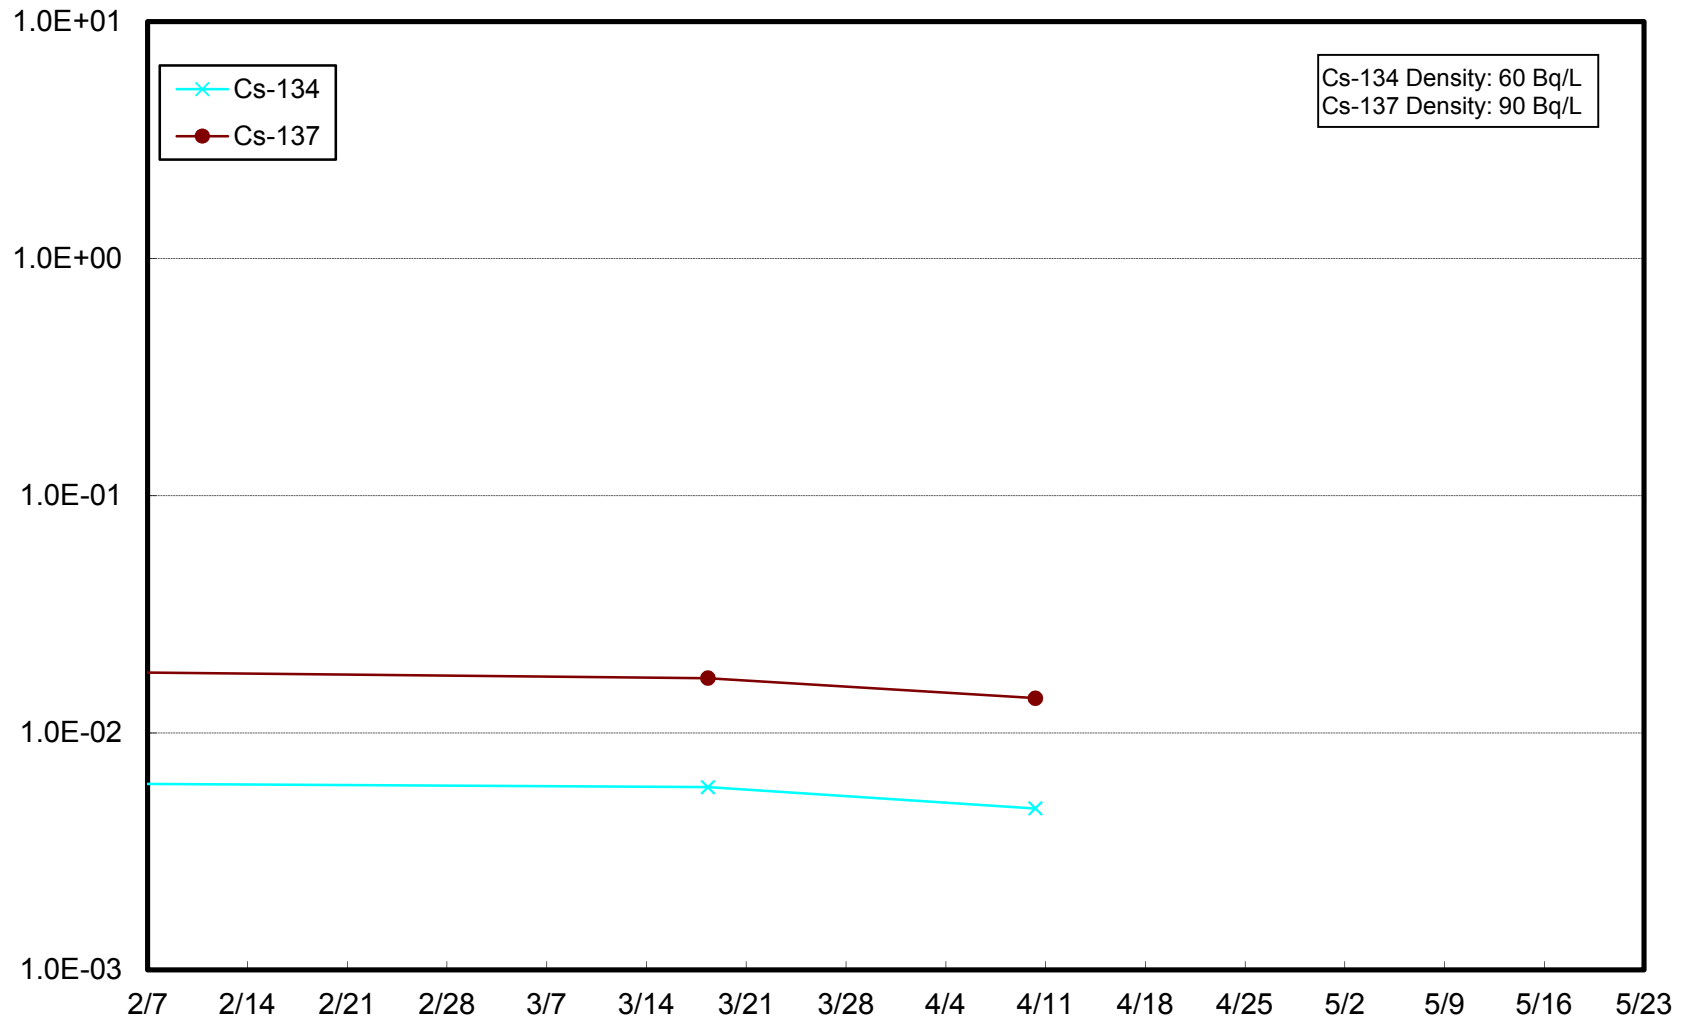


Radioactivity Density of the Seawater at 3km Offshore of Soma (T-22) Upper Layer (Bq/L)

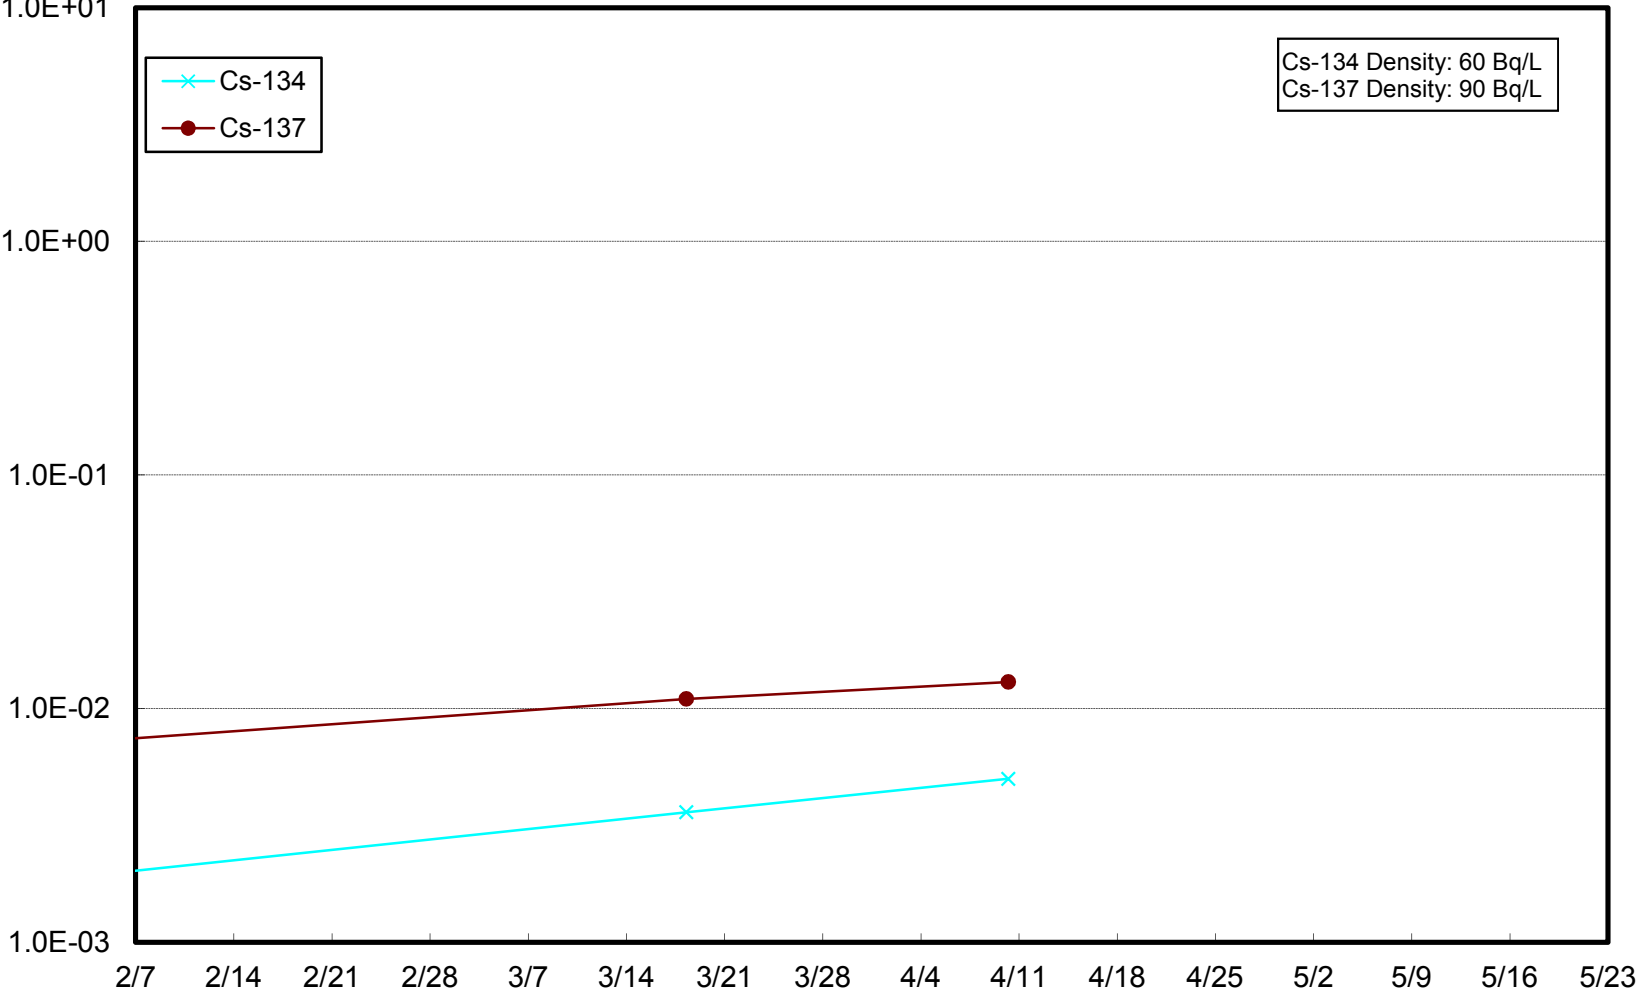


Radioactivity Density of the Seawater at 3km Offshore of Soma (T-22) Lower Layer (Bq/L)

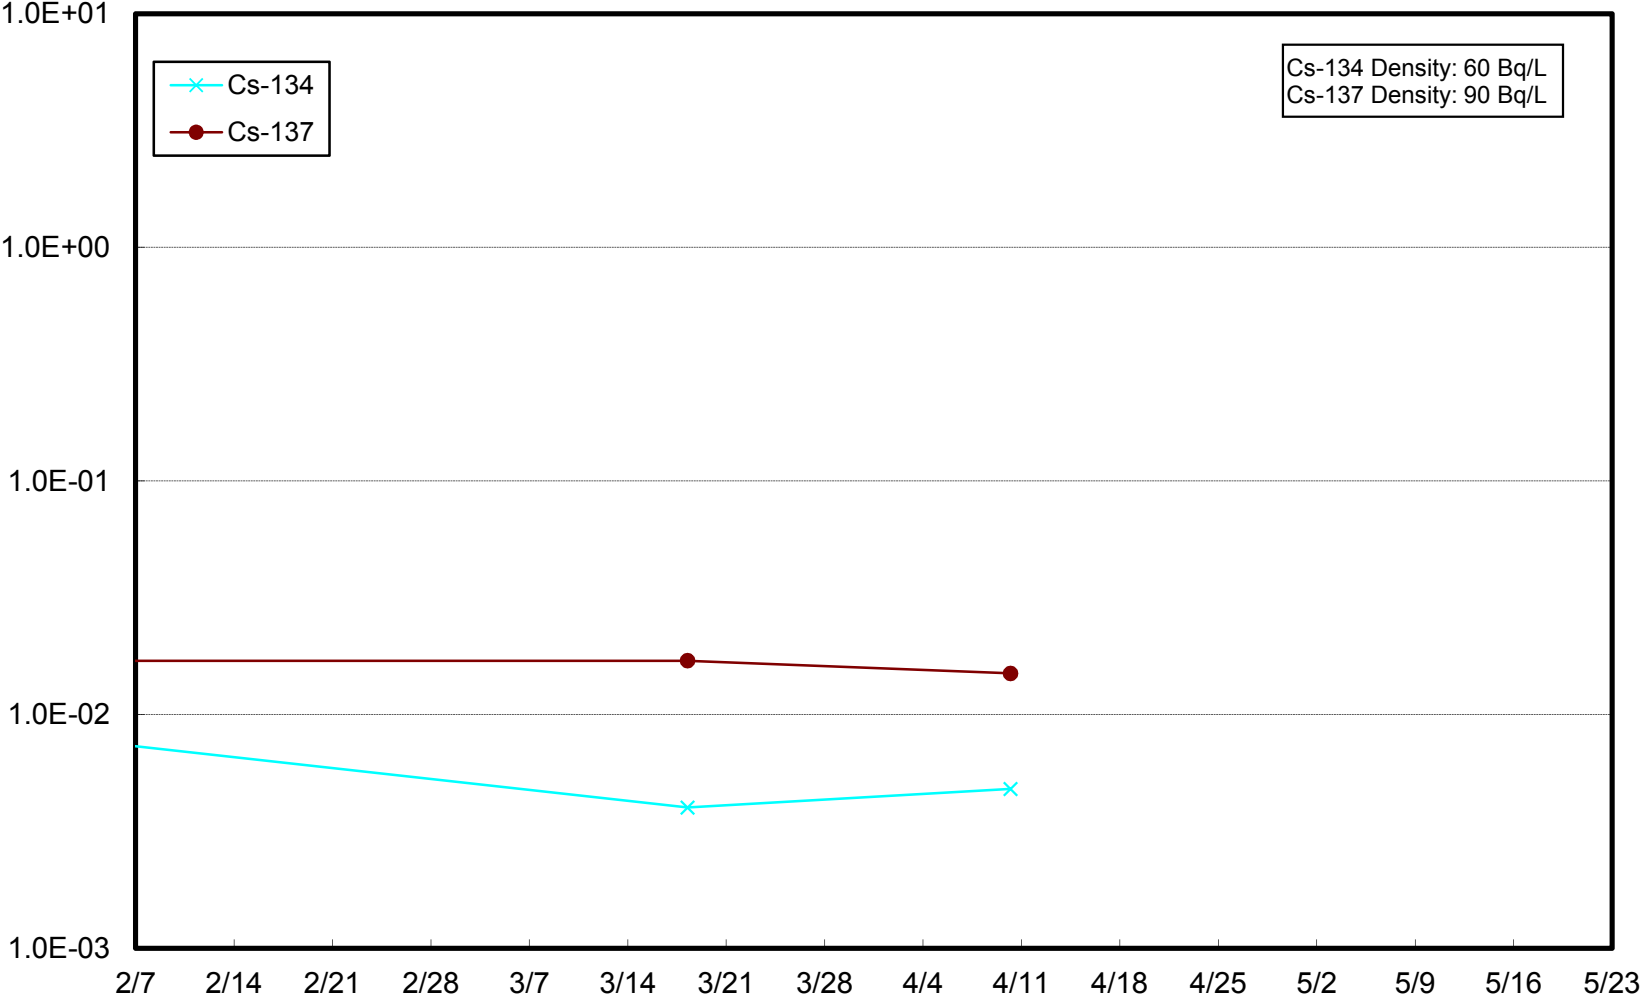


Radioactivity Density of the Seawater at 5km Offshore of Kashima (T-MA) Upper Layer (Bq/L)

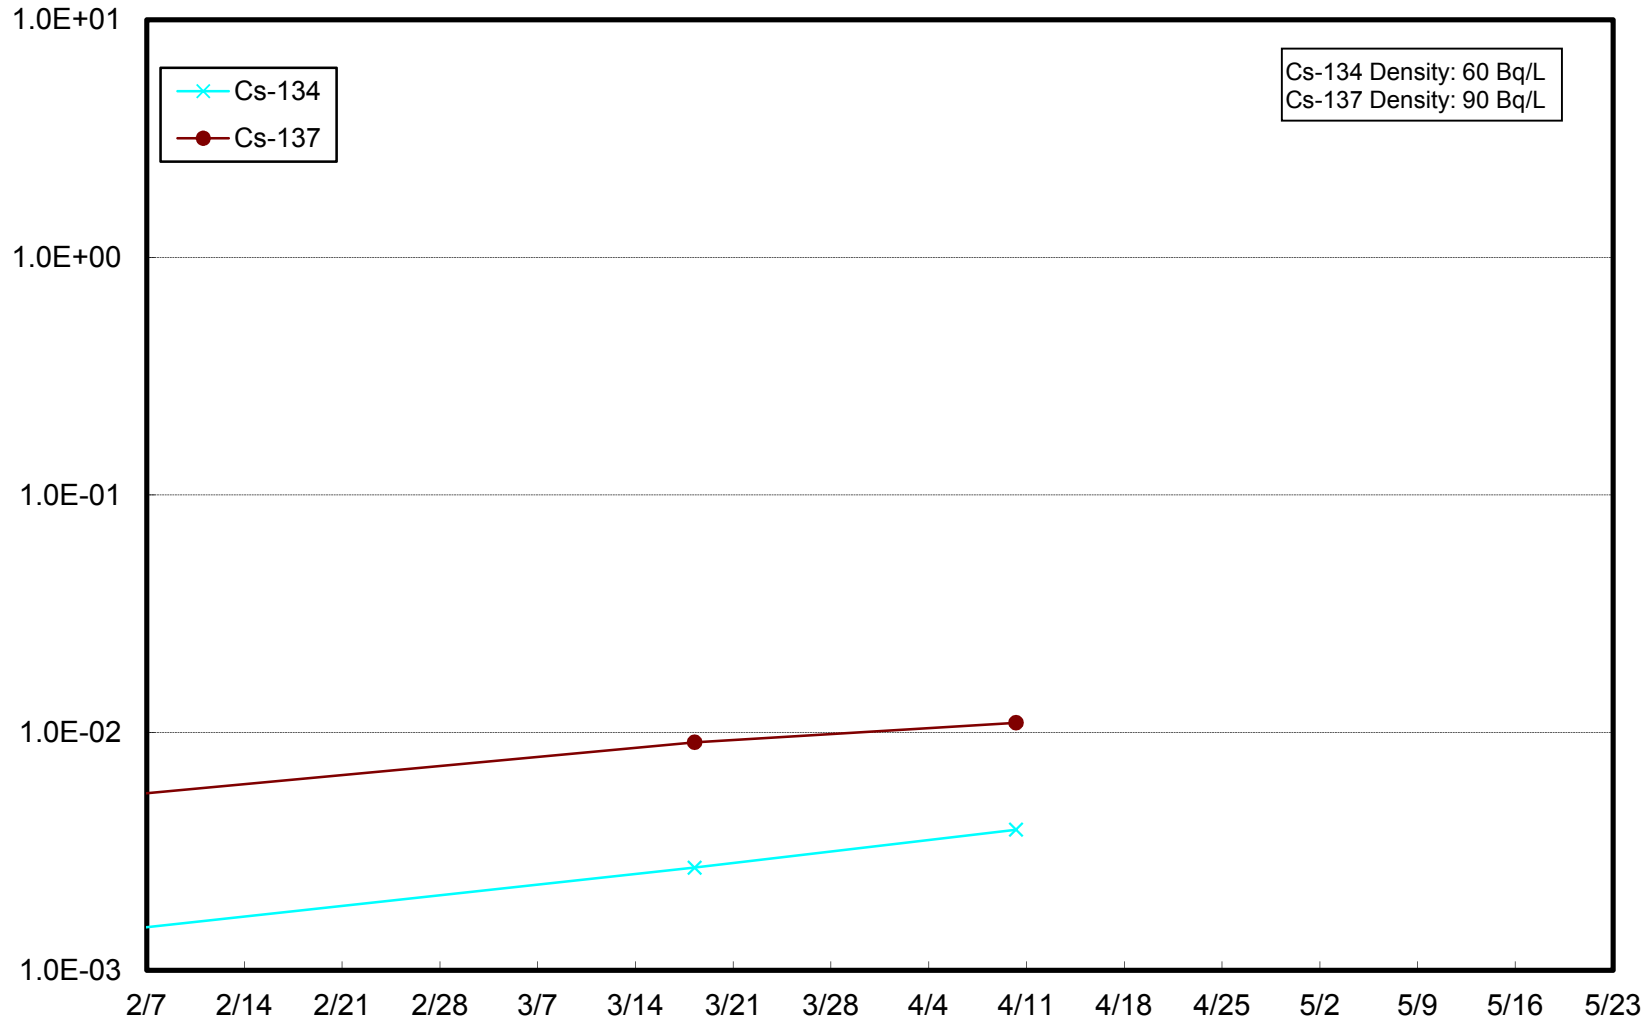


Radioactivity Density of the Seawater at 5km Offshore of Kashima (T-MA) Lower Layer (Bq/L)

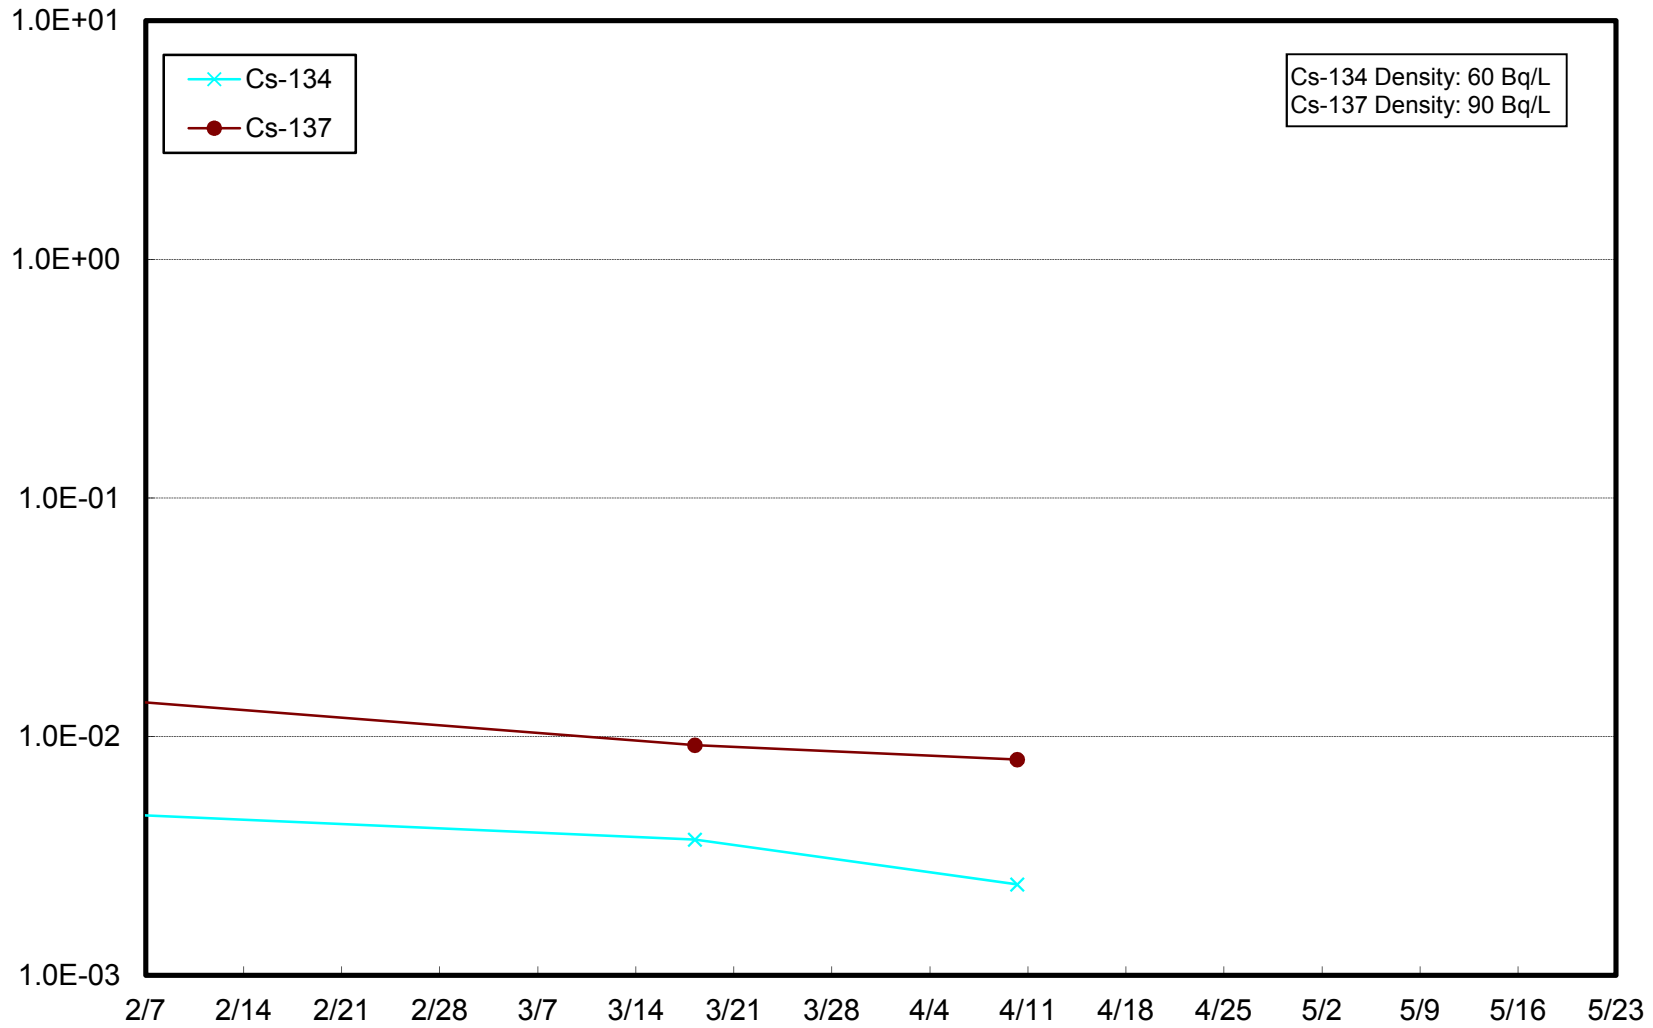


Radioactivity Density of the Seawater Around 1km Offshore of Ota River (T-S1) Upper Layer (Bq/L)

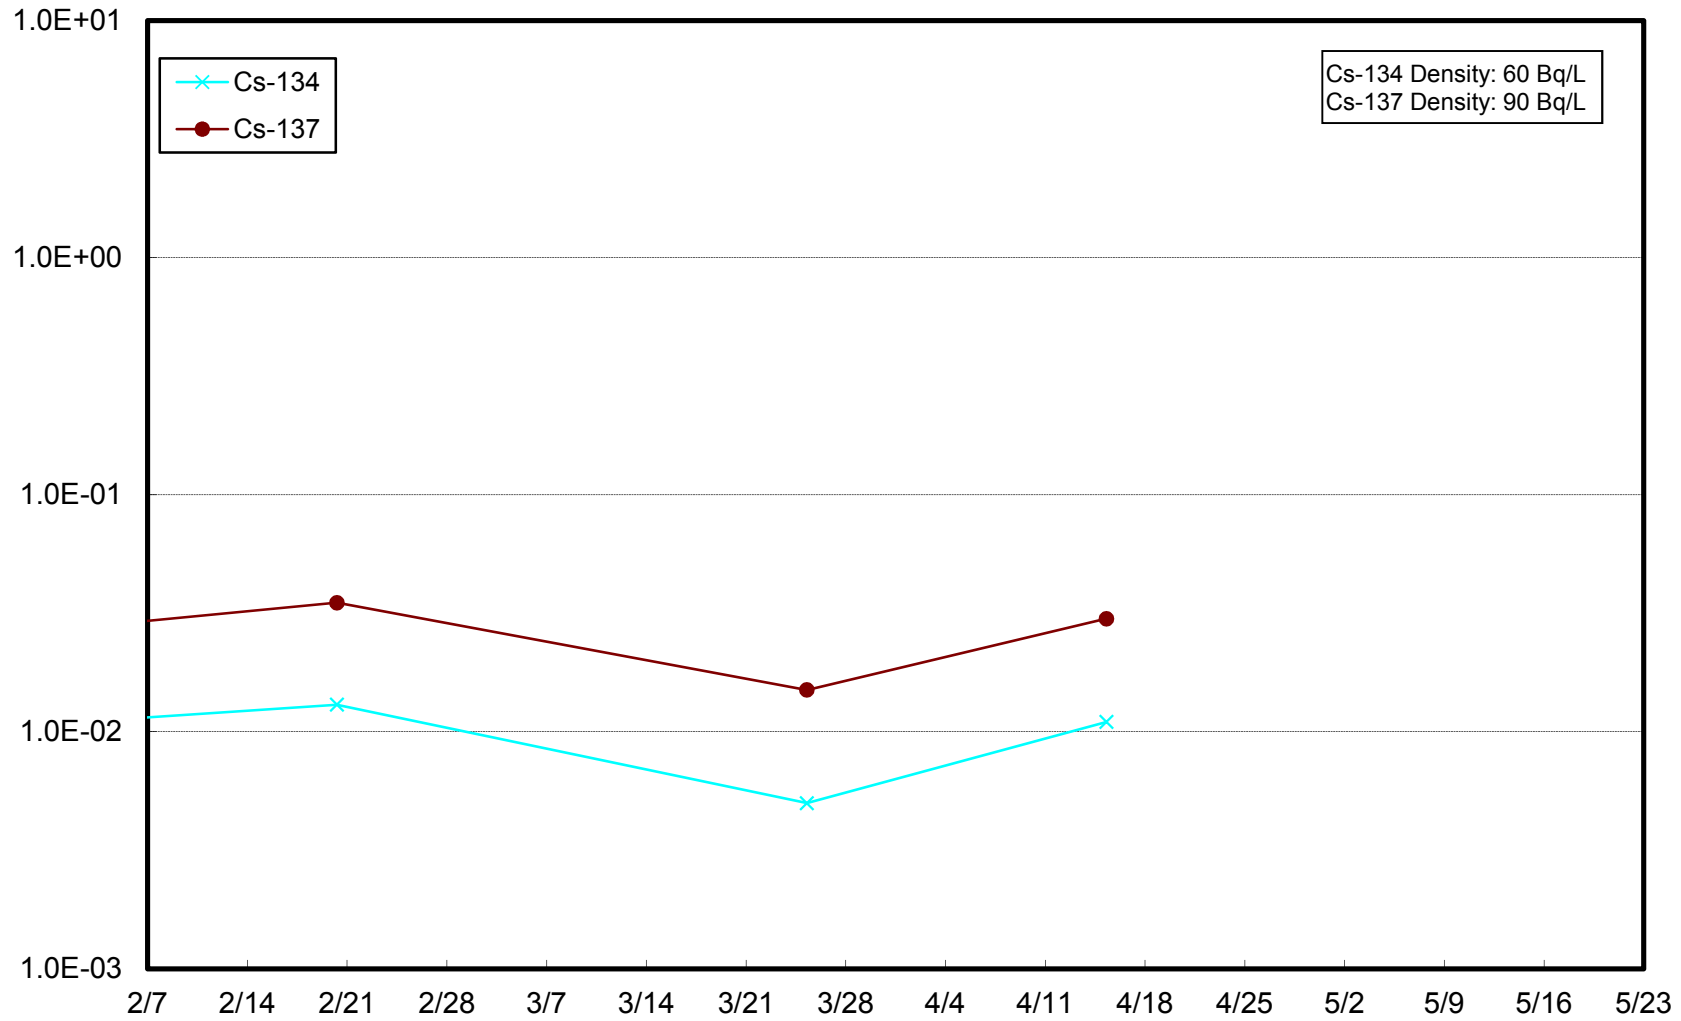

Radioactivity Density of the Seawater Around 1km Offshore of Ota River (T-S1) Lower Layer (Bq/L)

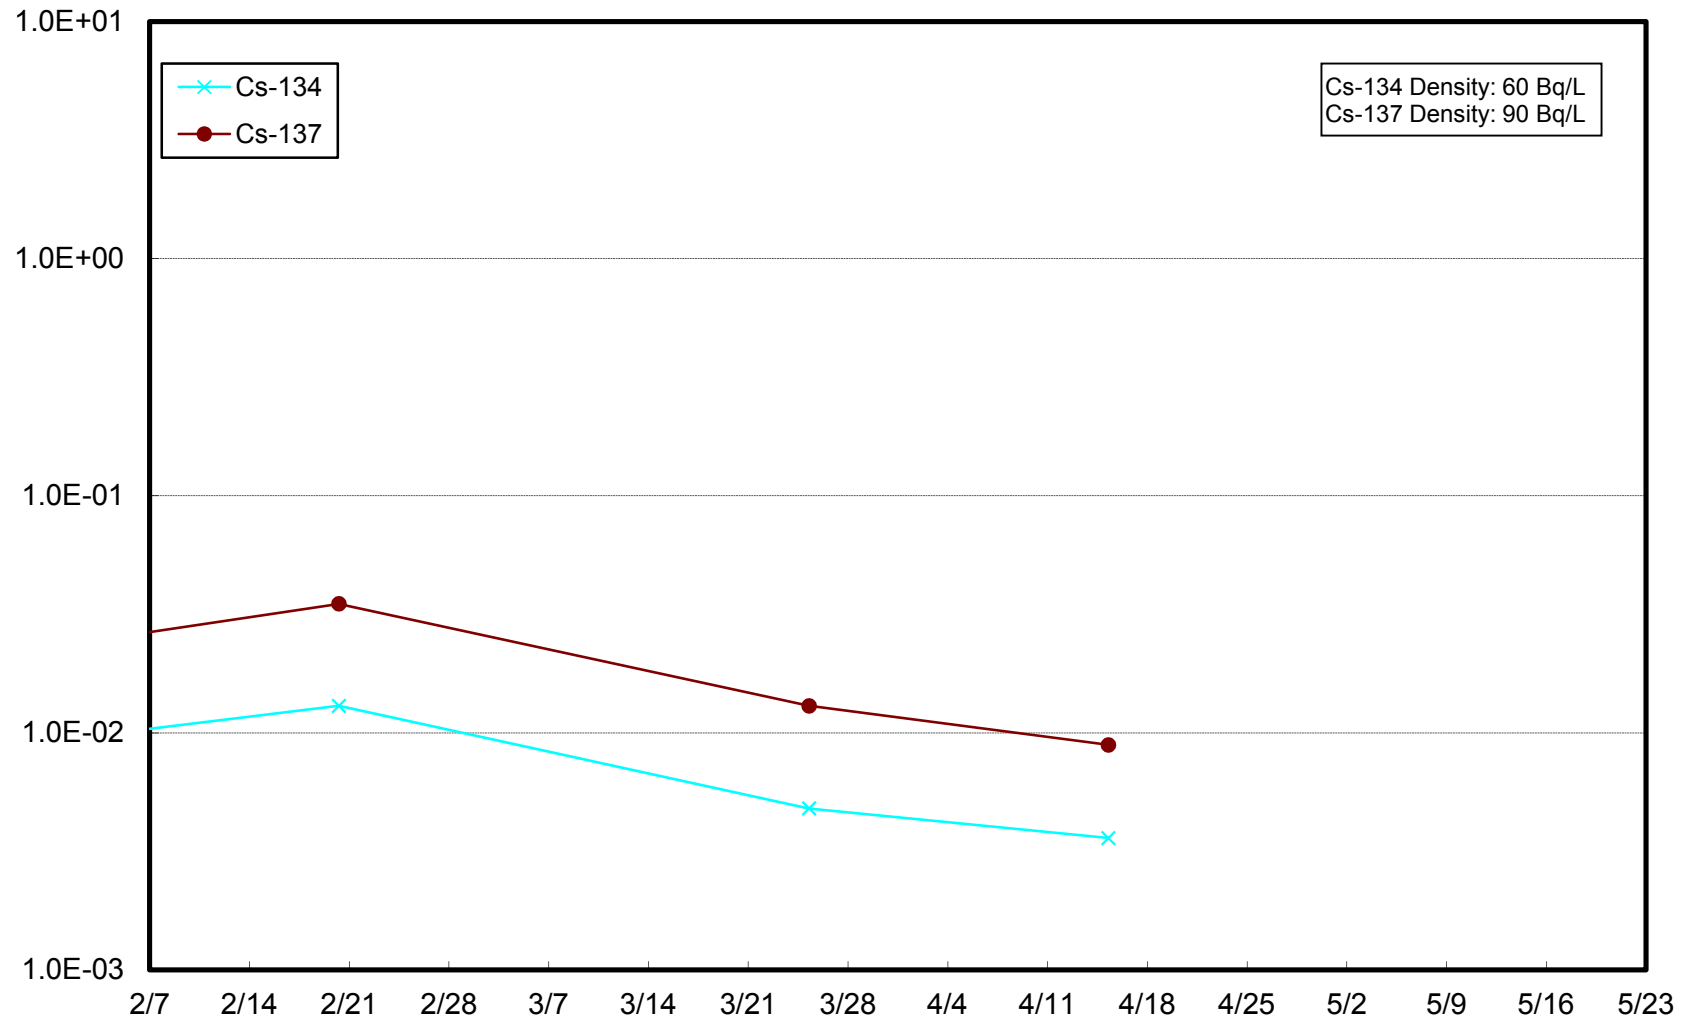


Radioactivity Density of the Seawater Around 3km Offshore of Odaka Ward (T-S2) Upper Layer (Bq/L)

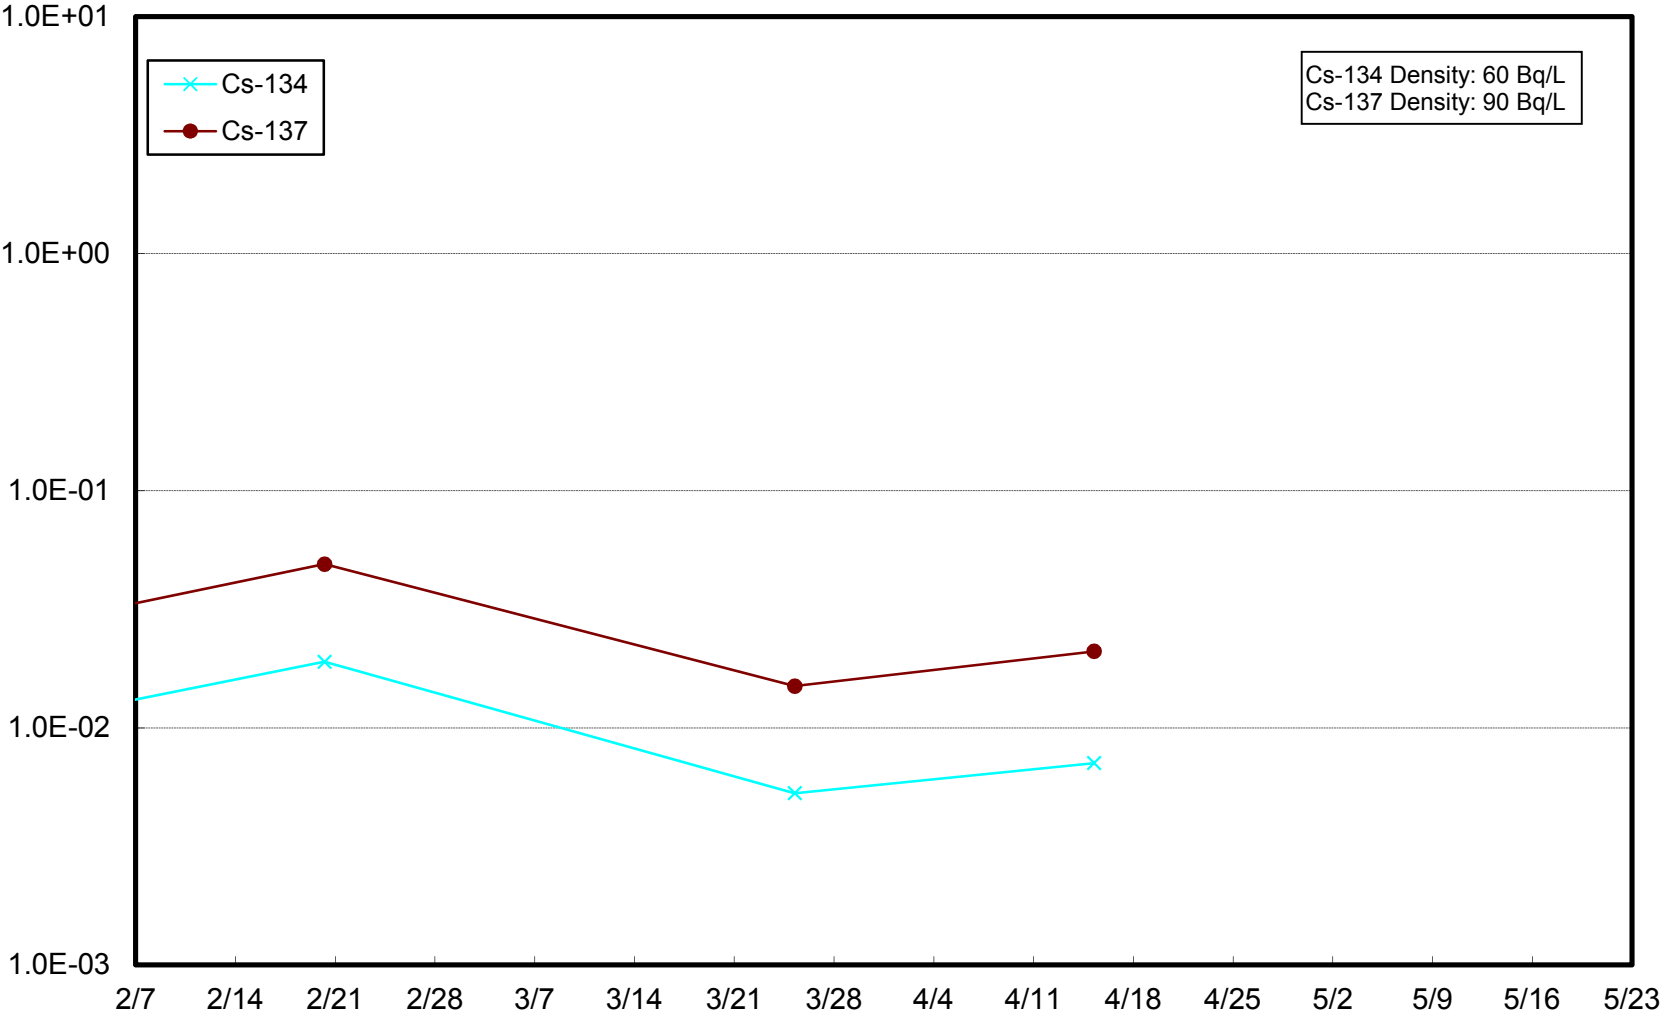





Radioactivity Density of the Seawater Around 3km Offshore of Odaka Ward (T-S2) Lower Layer (Bq/L)

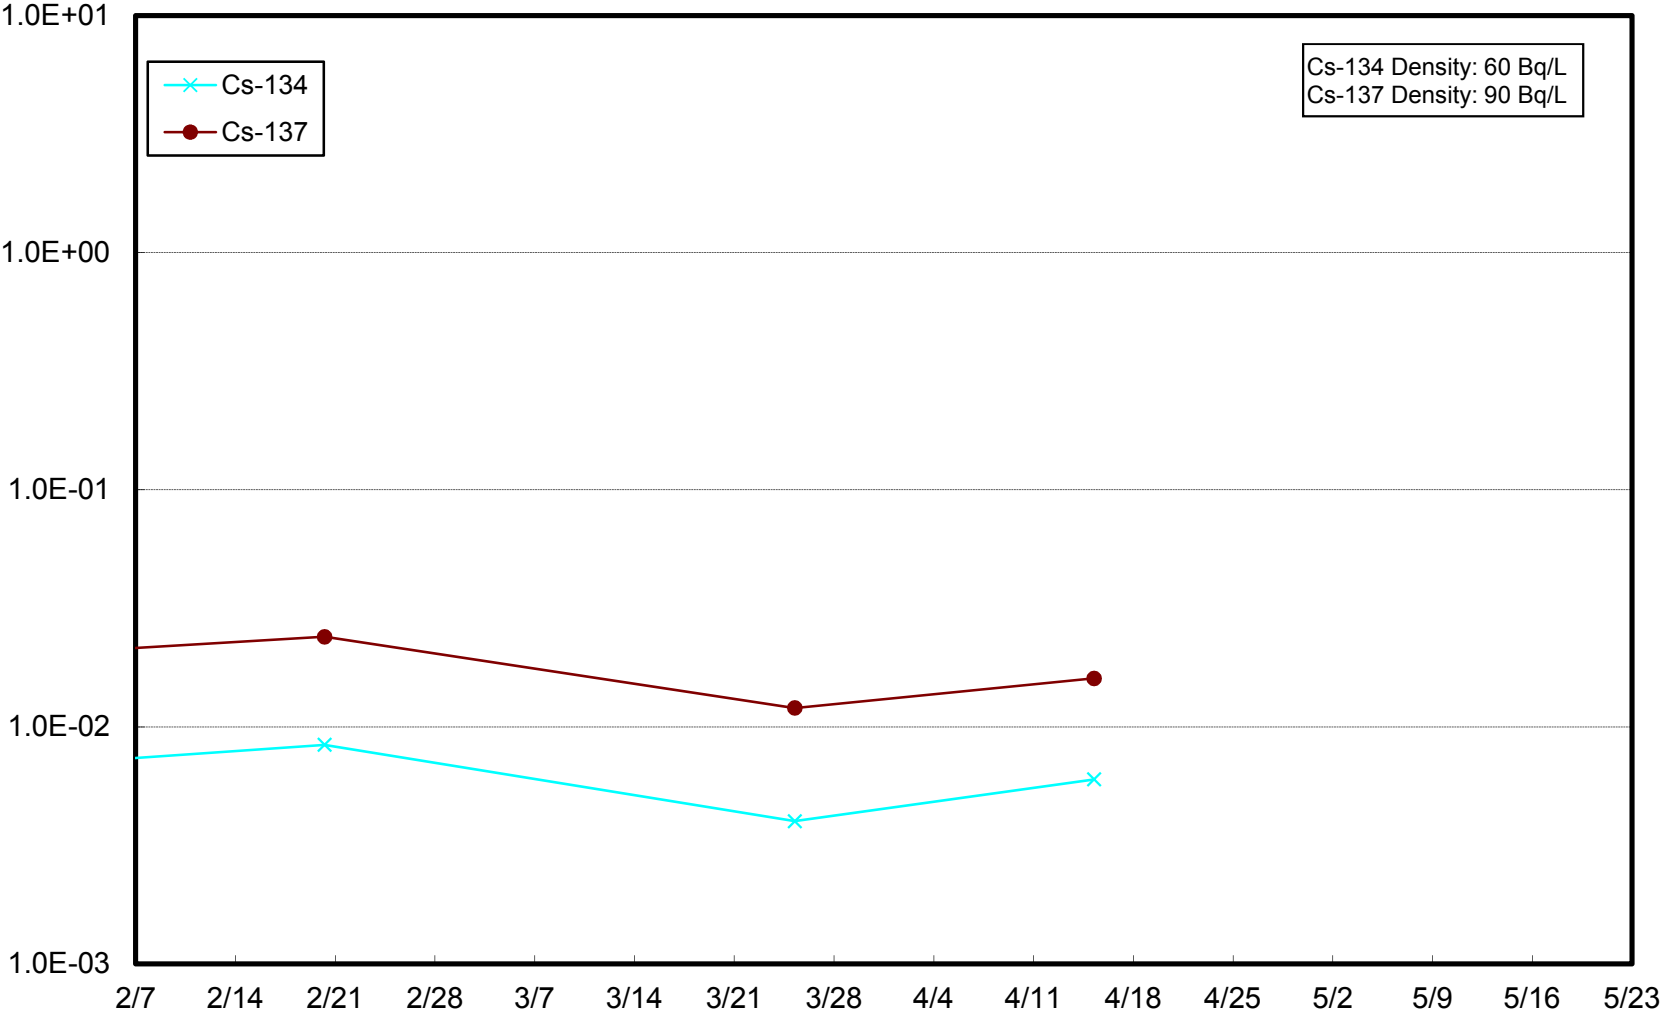


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Upper Layer (Bq/L)

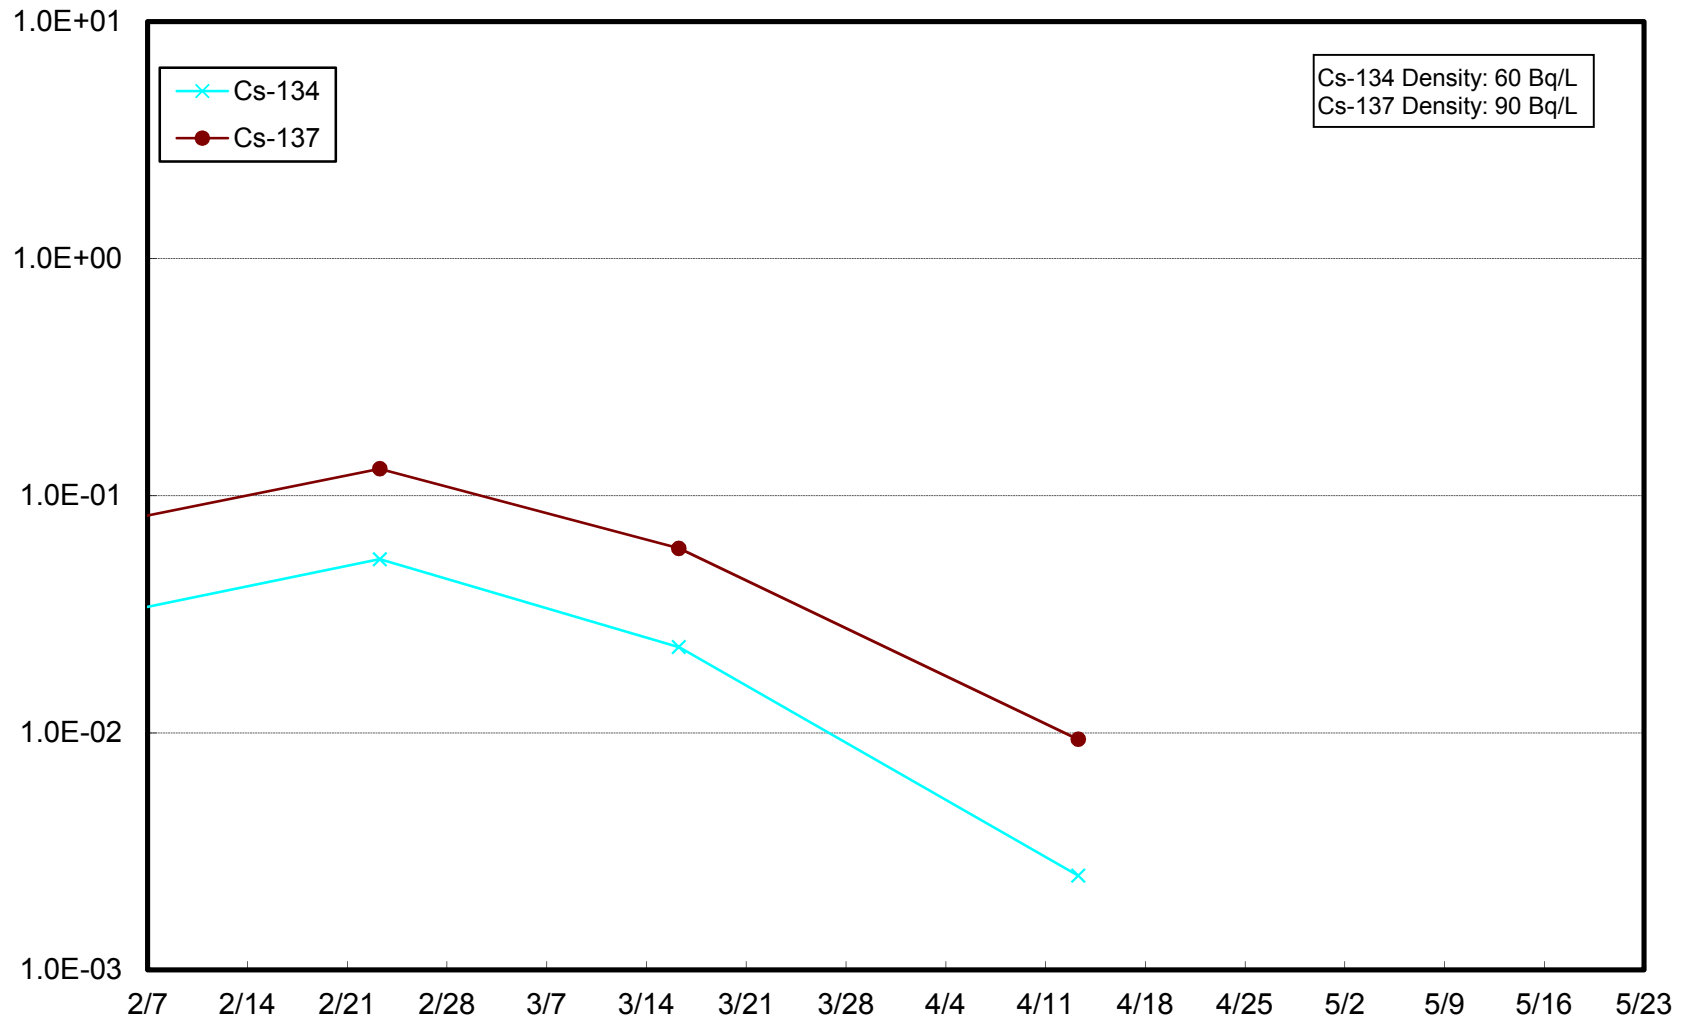


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Lower Layer (Bq/L)

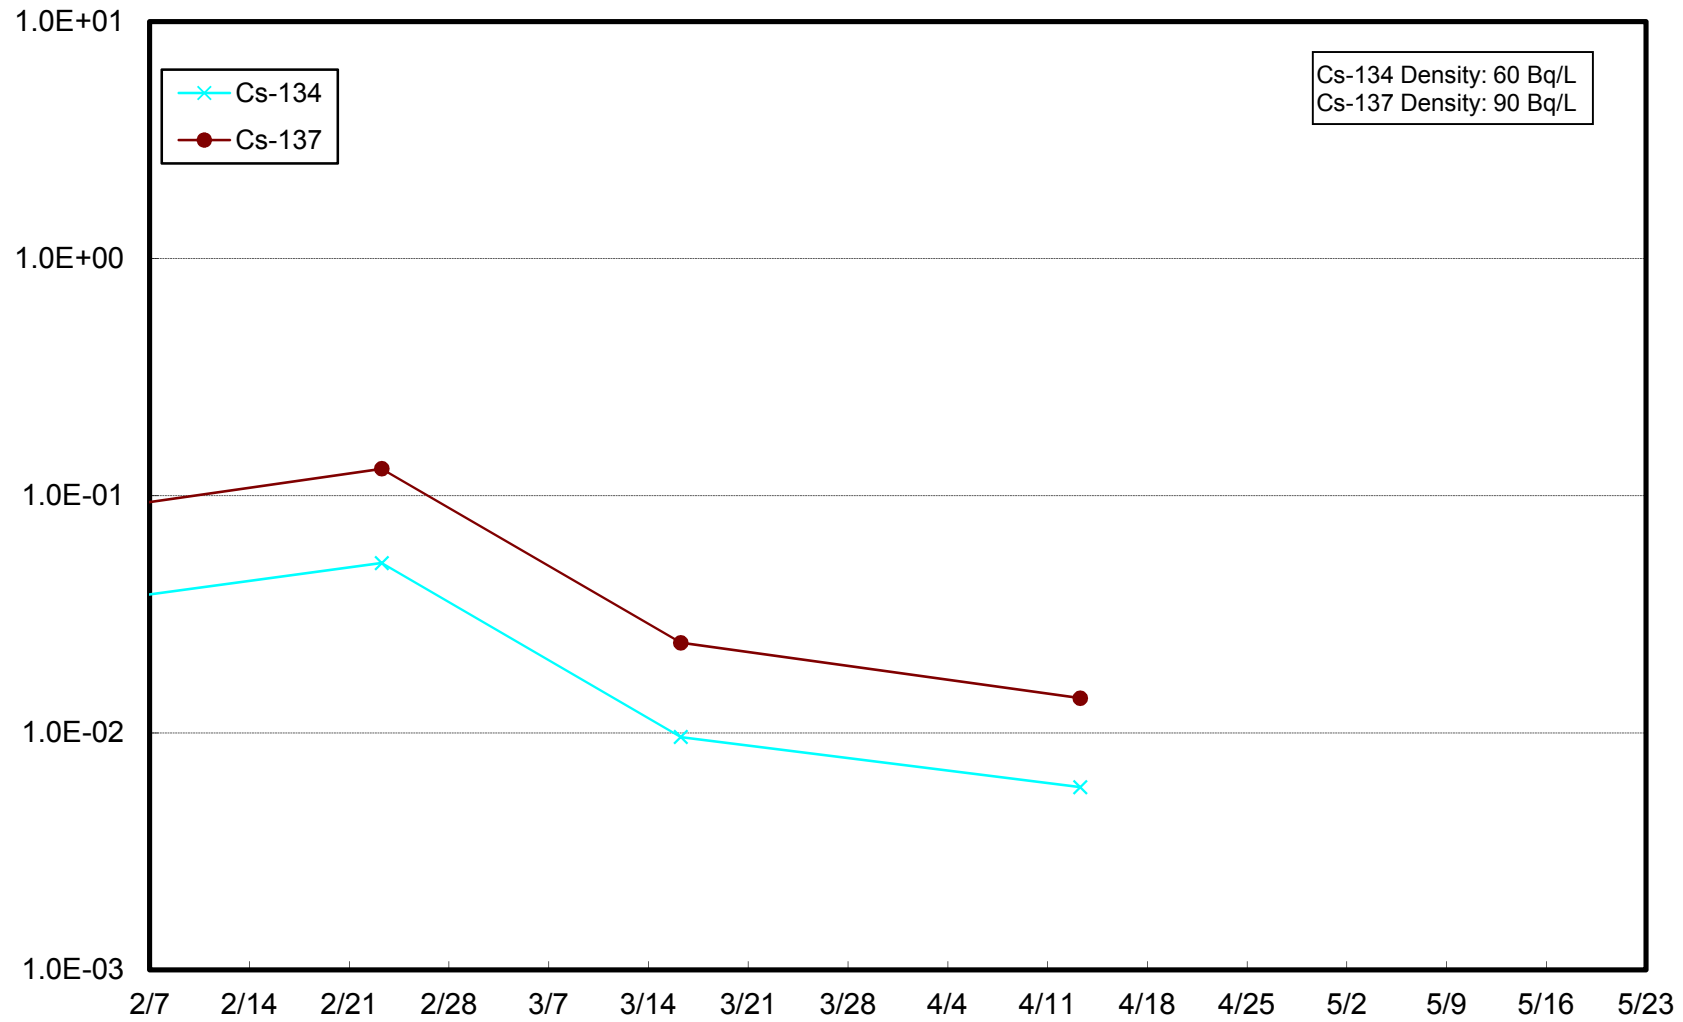


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Upper Layer (Bq/L)

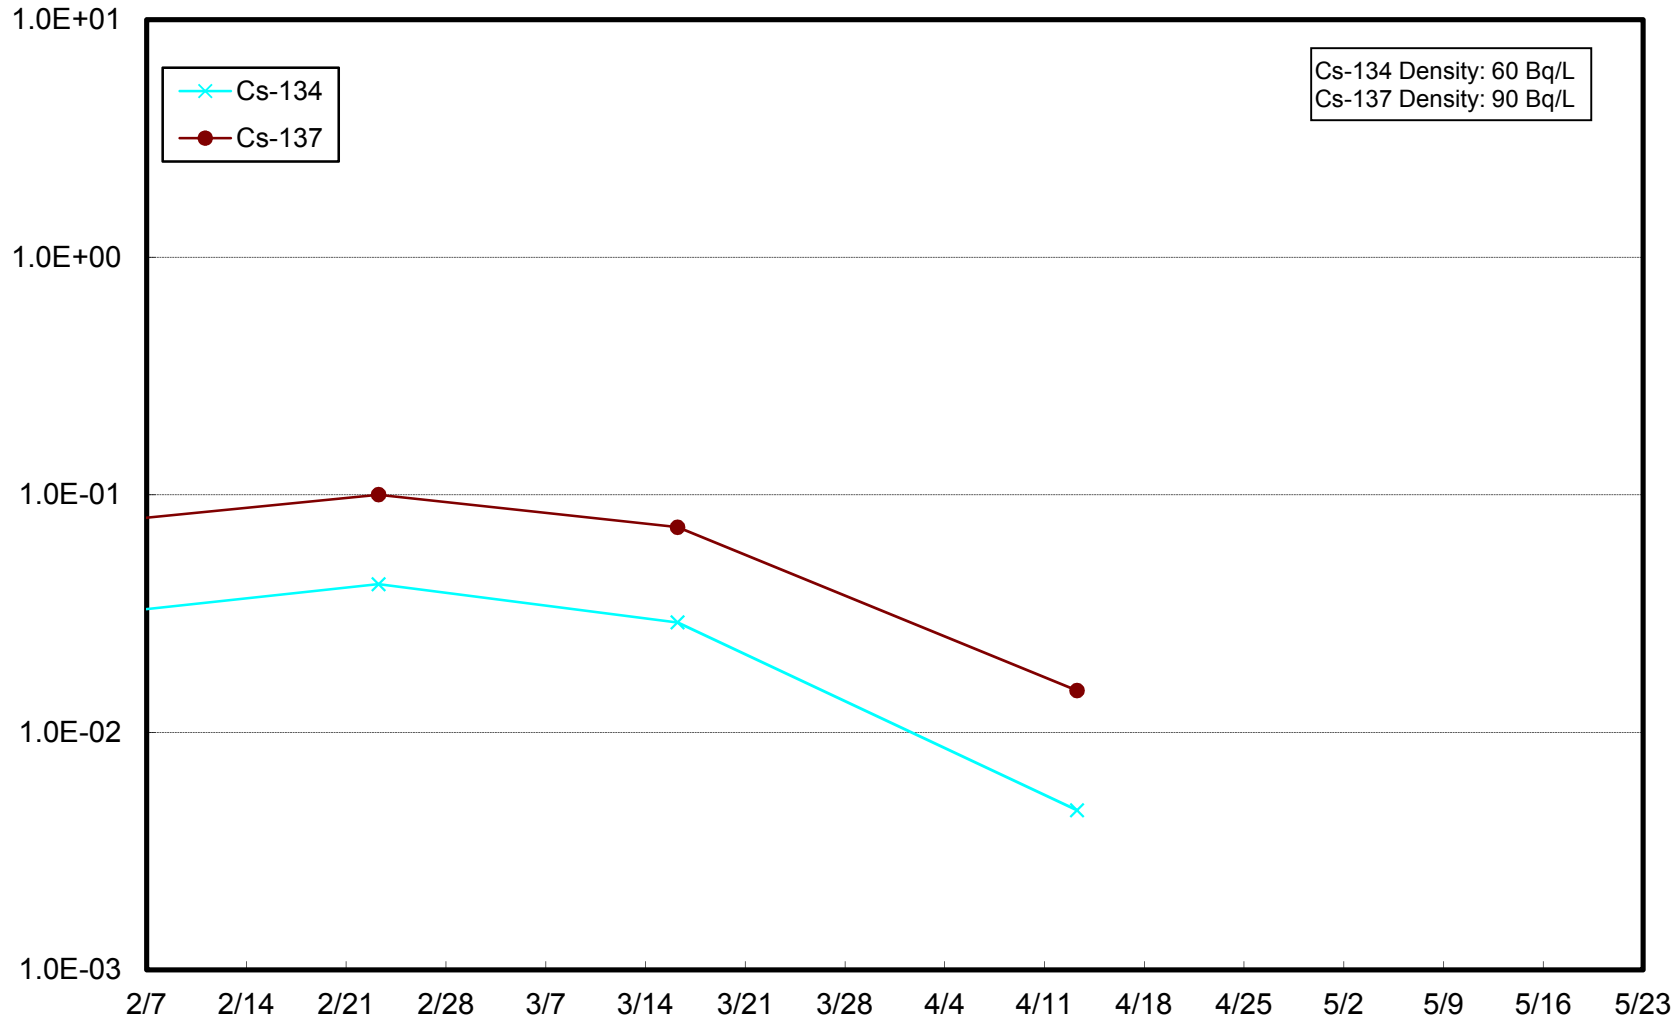


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Lower Layer (Bq/L)

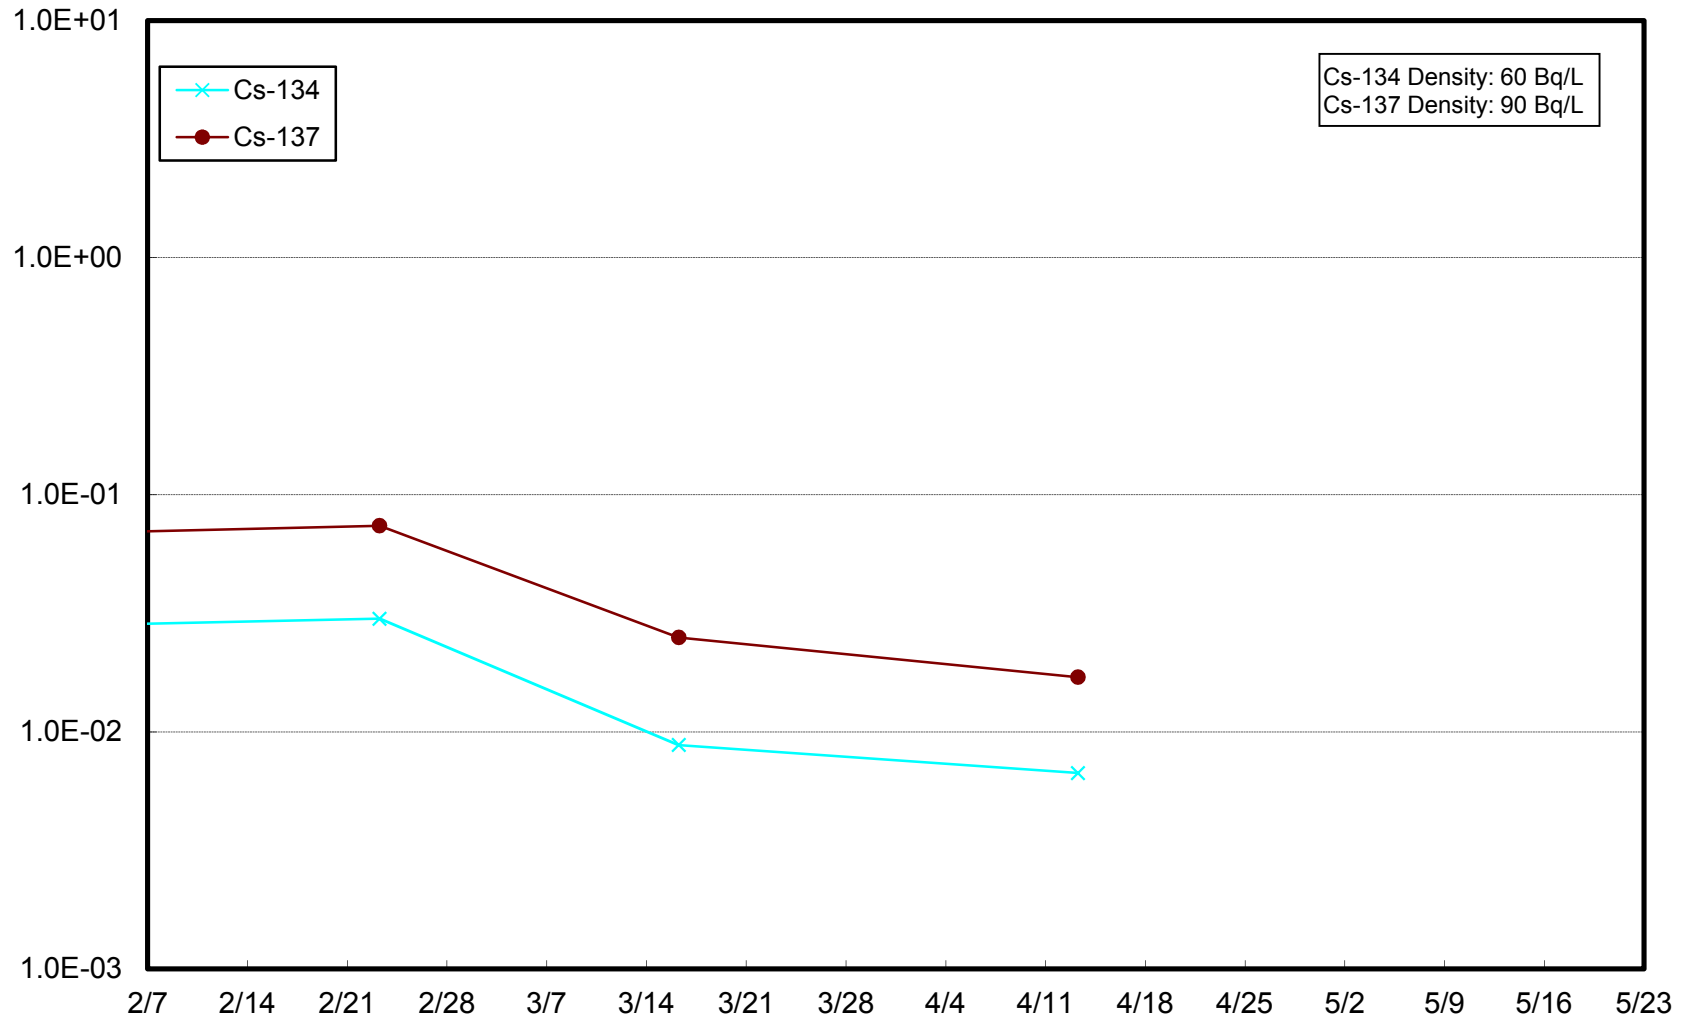


Radioactivity Density of the Seawater Around 4km Offshore of Kumagawa (T-S8) Upper Layer (Bq/L)

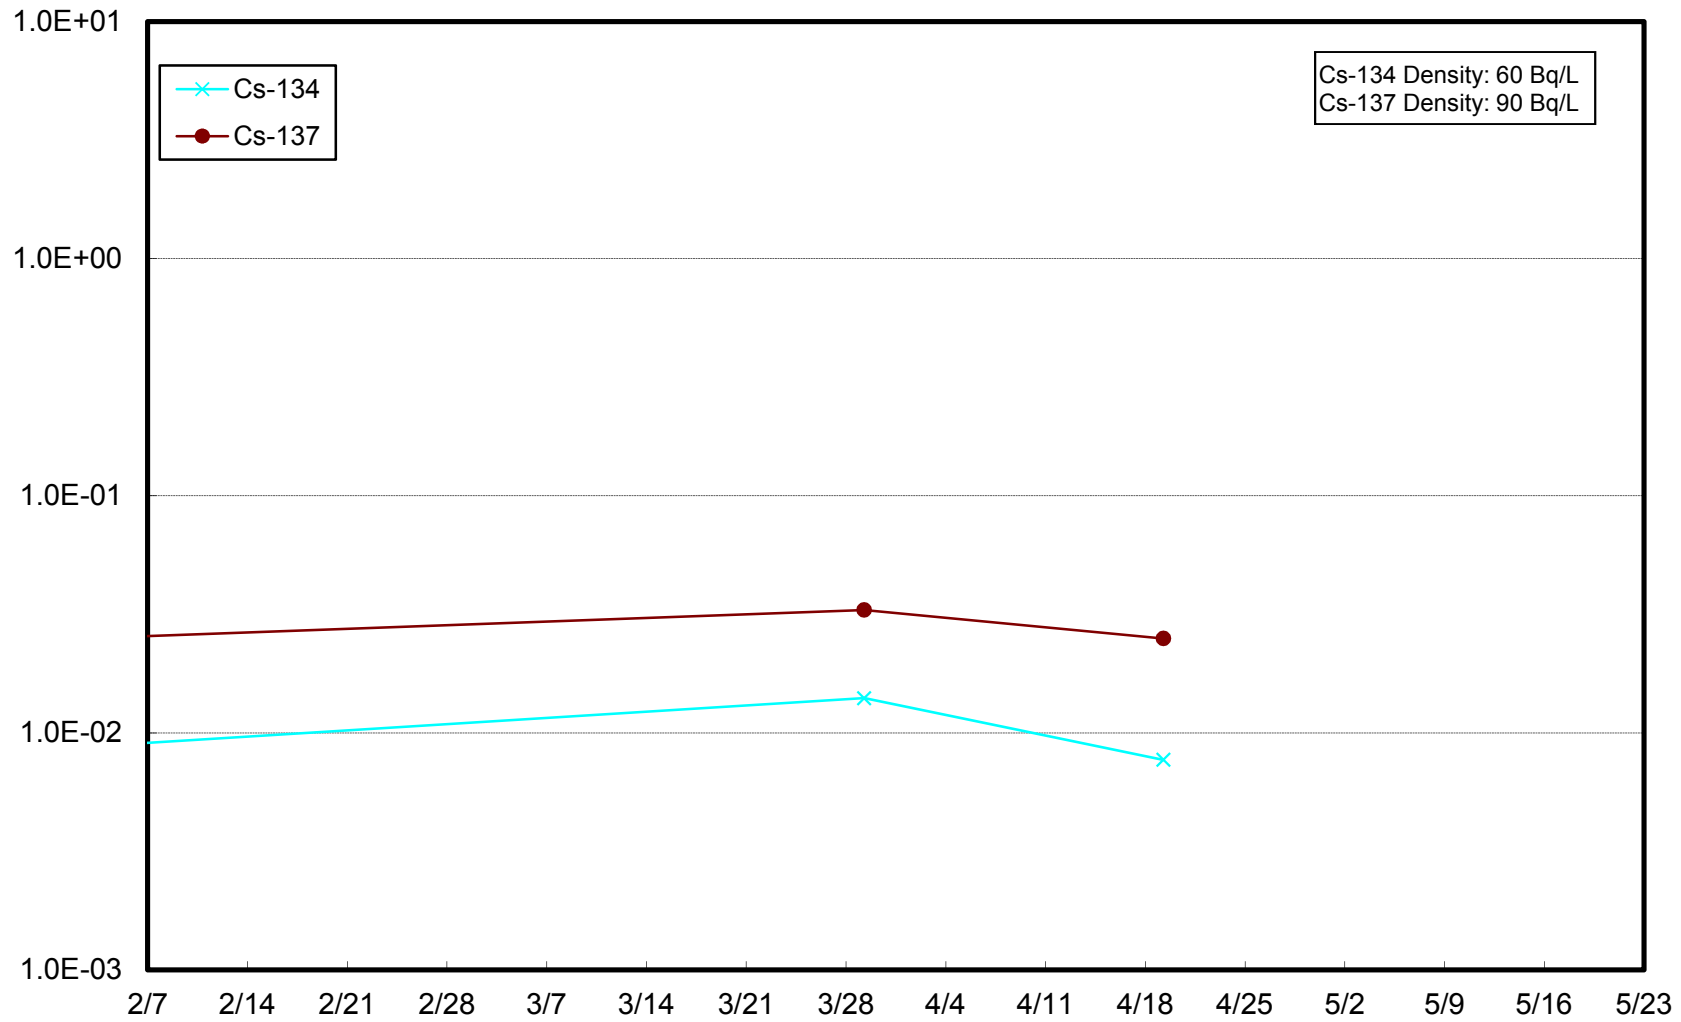

Radioactivity Density of the Seawater Around 4km Offshore of Kumagawa (T-S8) Lower Layer (Bq/L)

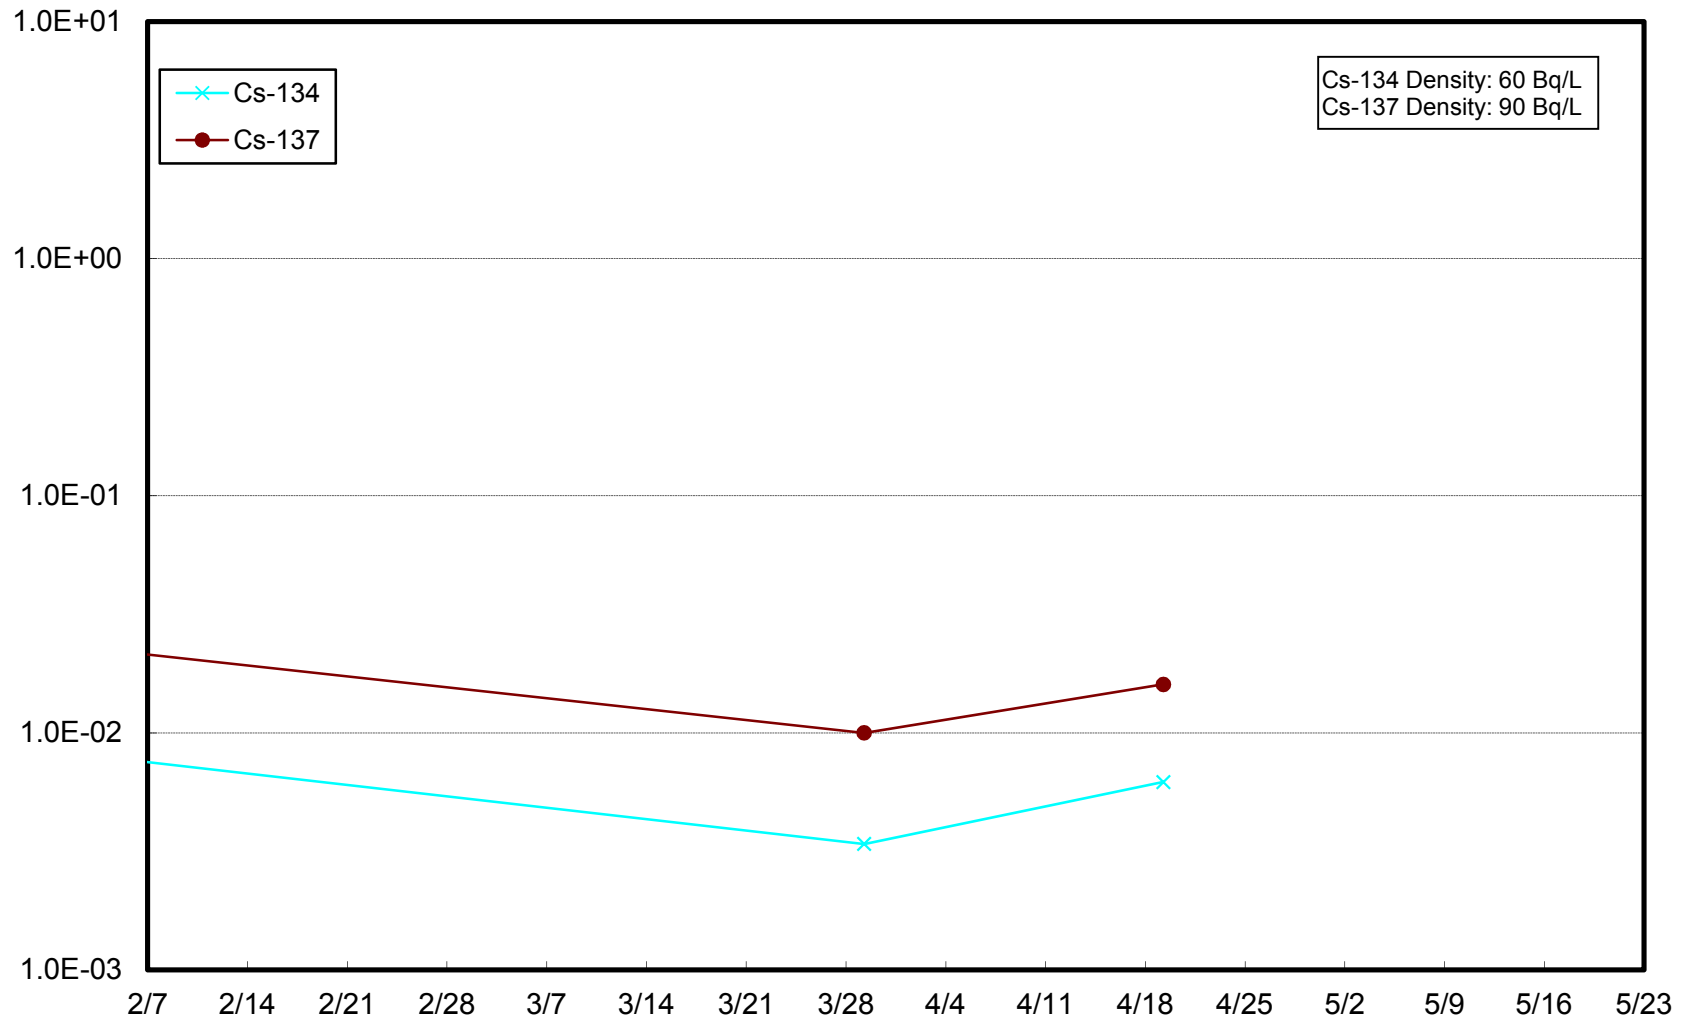


Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Upper Layer (Bq/L)

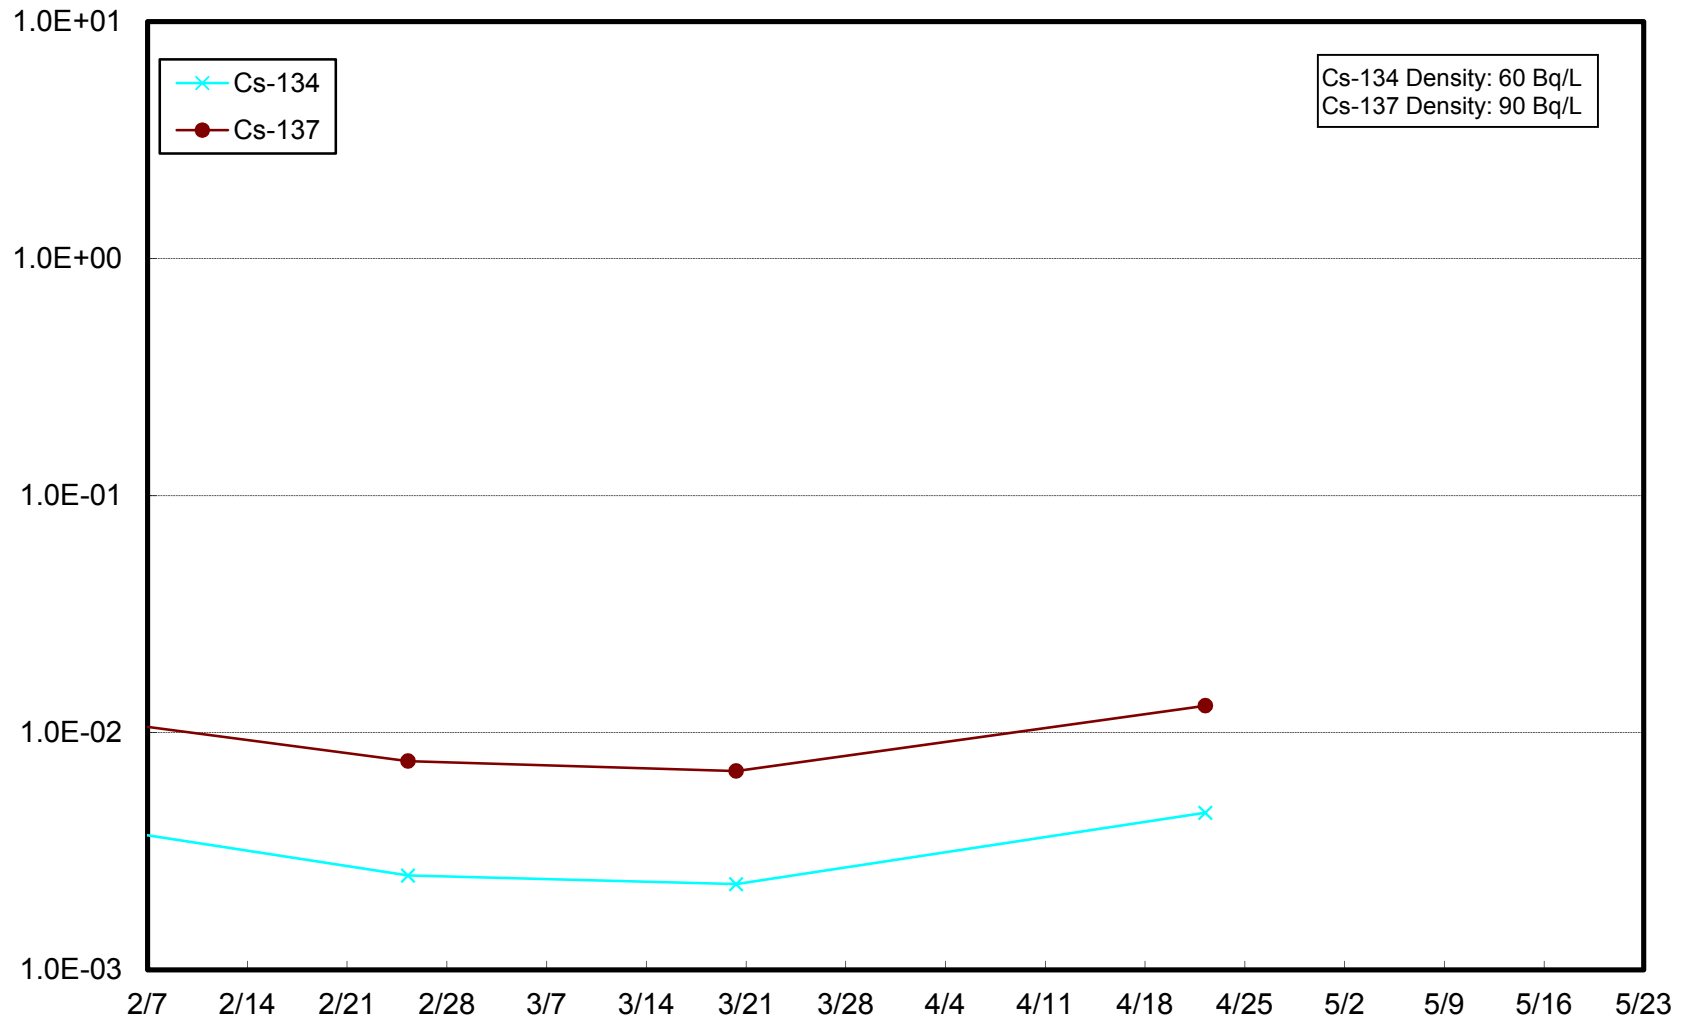





Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Lower Layer (Bq/L)

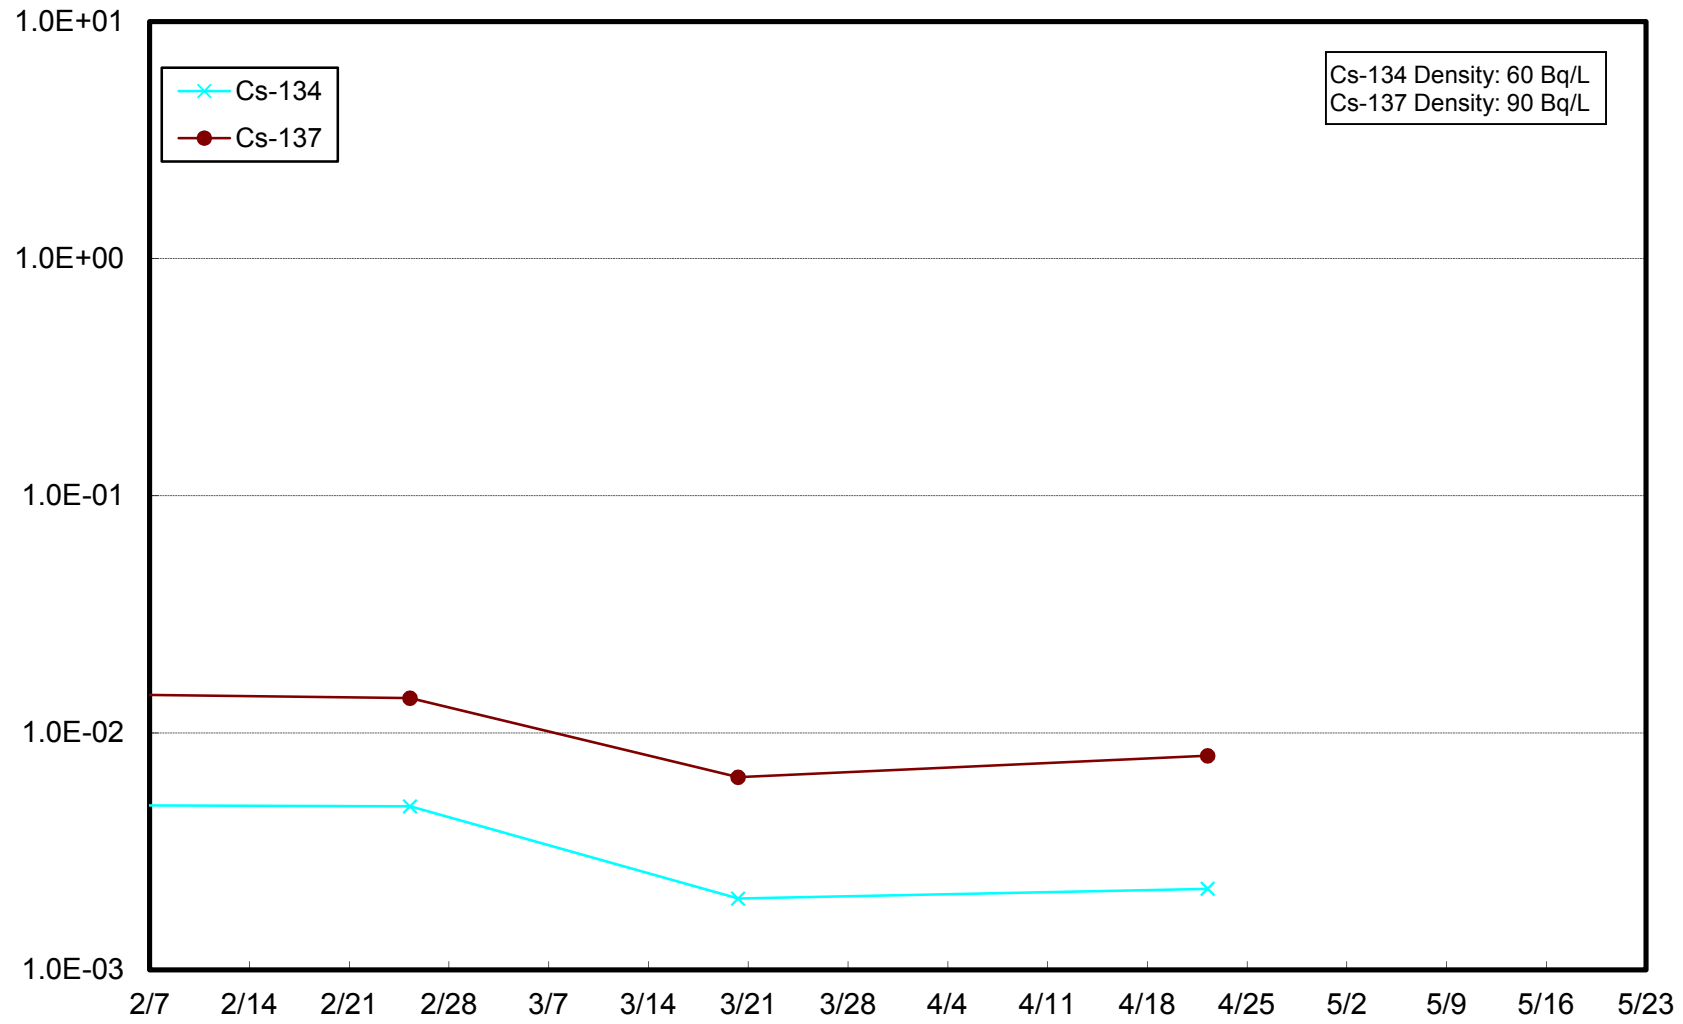


Radioactivity Density of the Seawater Around 10km Offshore of Fukushima Daiichi NPS (T-B3) Upper Layer (Bq/L)

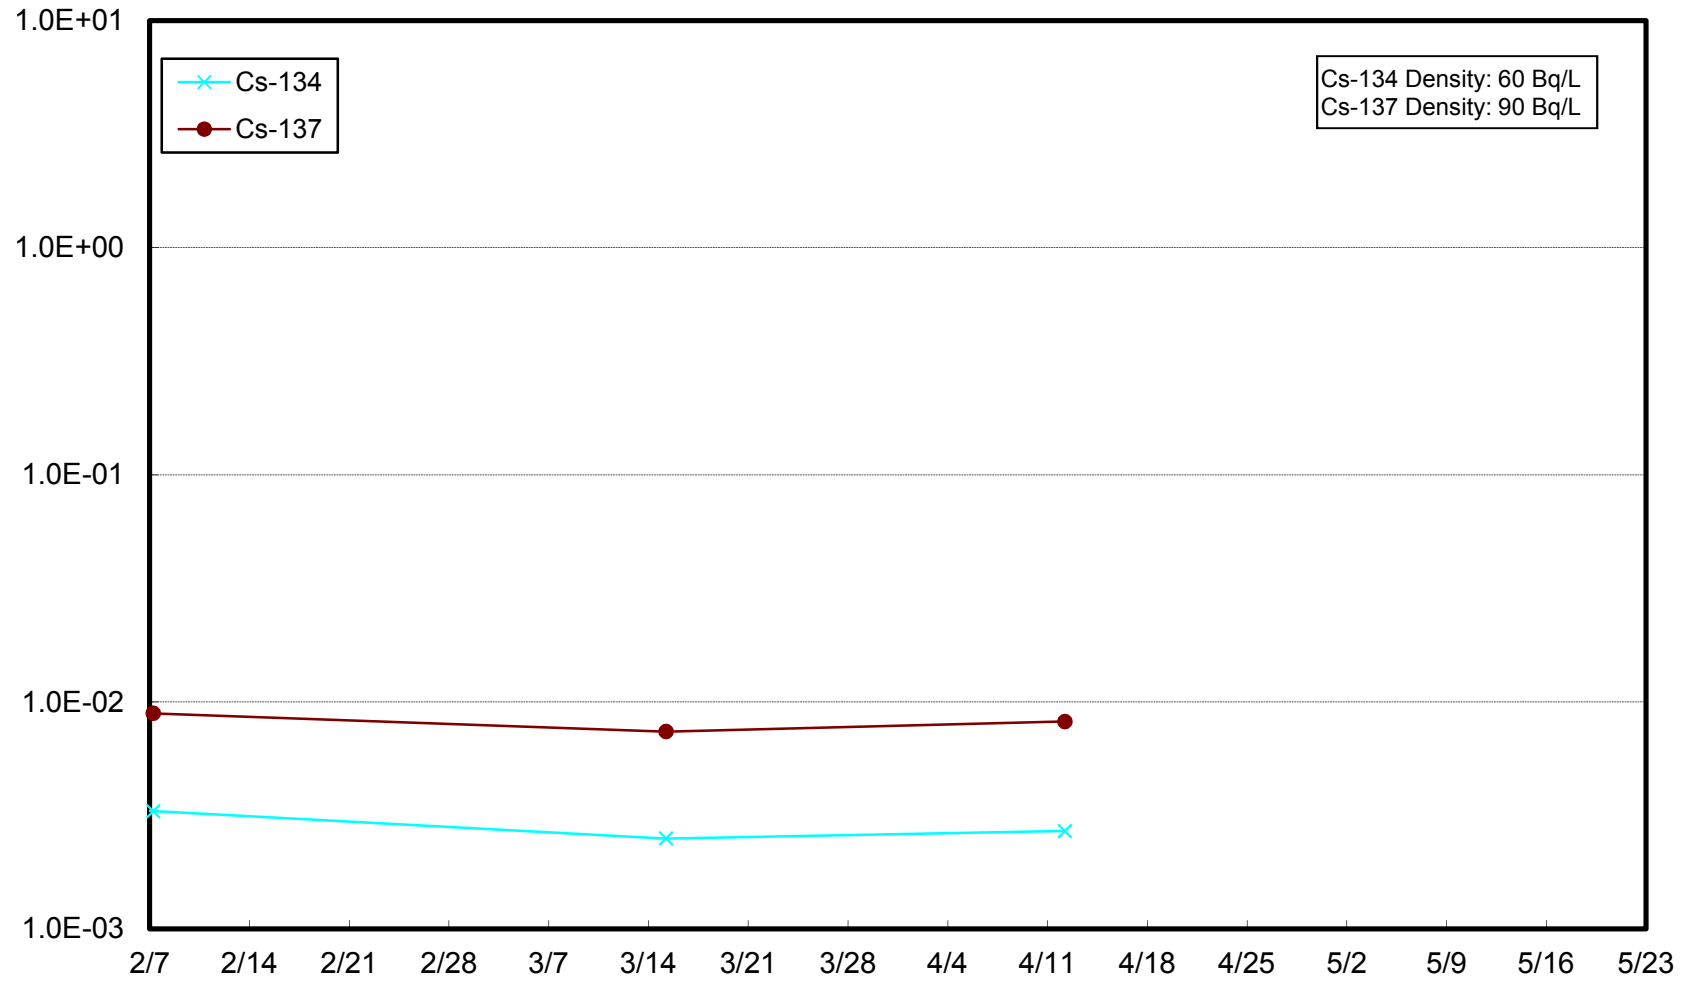

Radioactivity Density of the Seawater Around 10km Offshore of Fukushima Daiichi NPS (T-B3) Lower Layer (Bq/L)

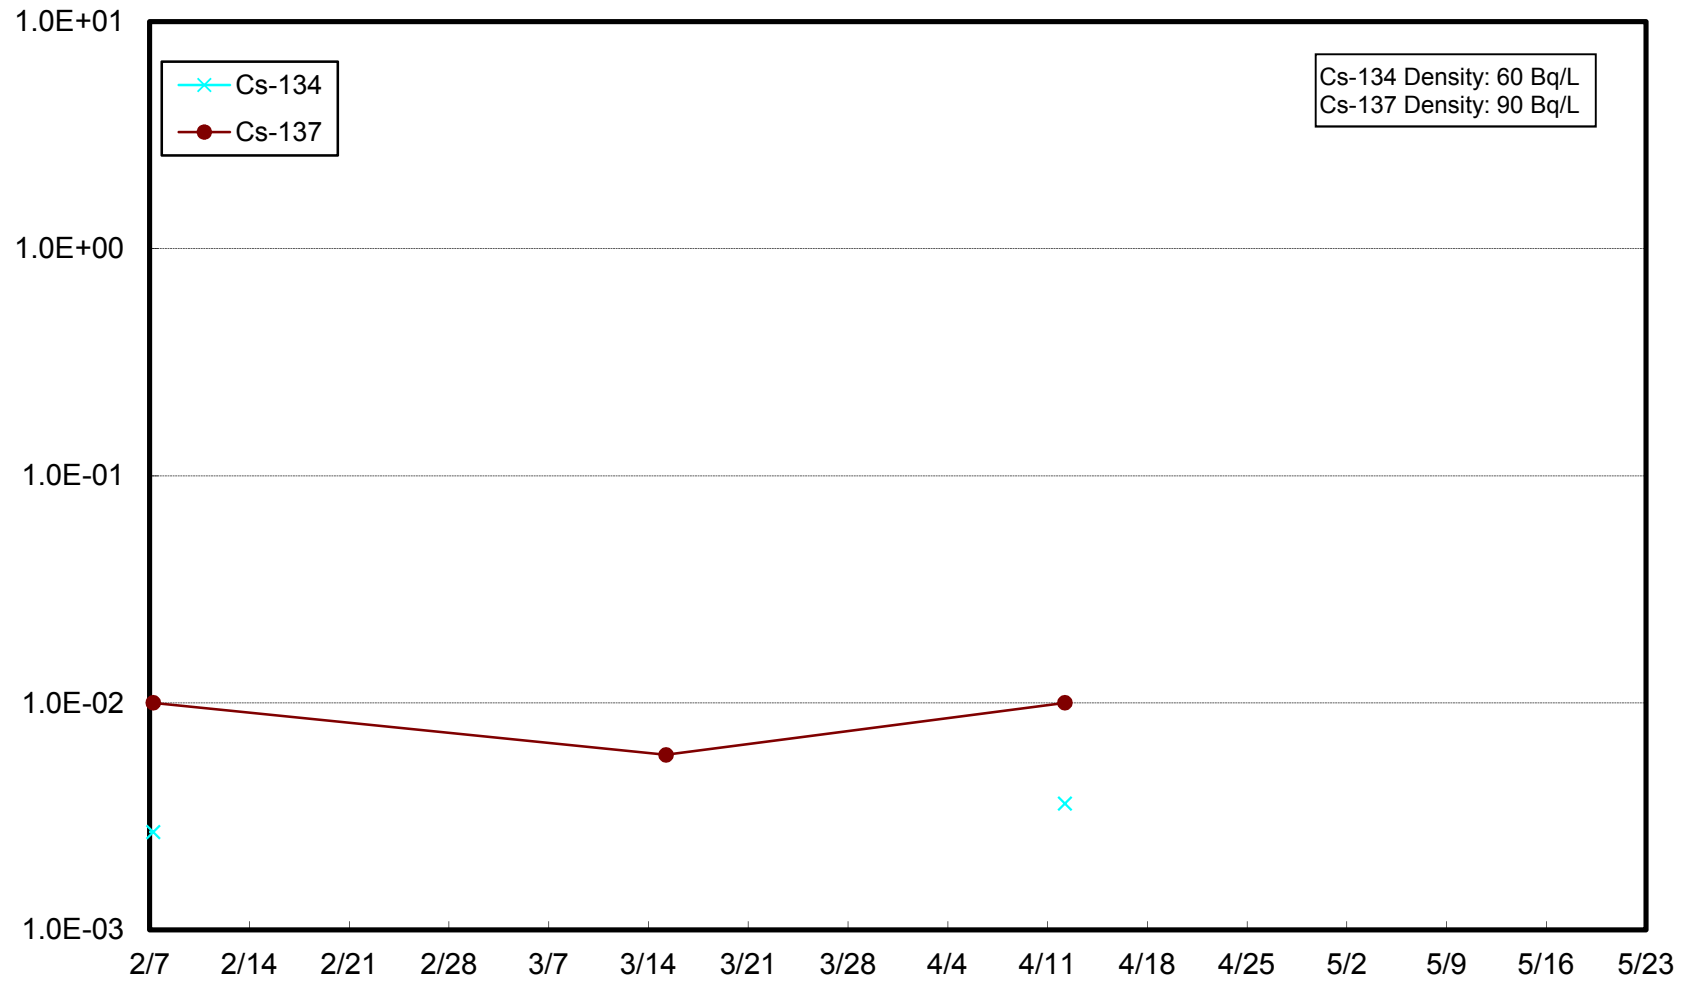

Radioactivity Density of the Seawater Around 10km Offshore of Fukushima Daini (T-B4) Upper Layer (Bq/L)

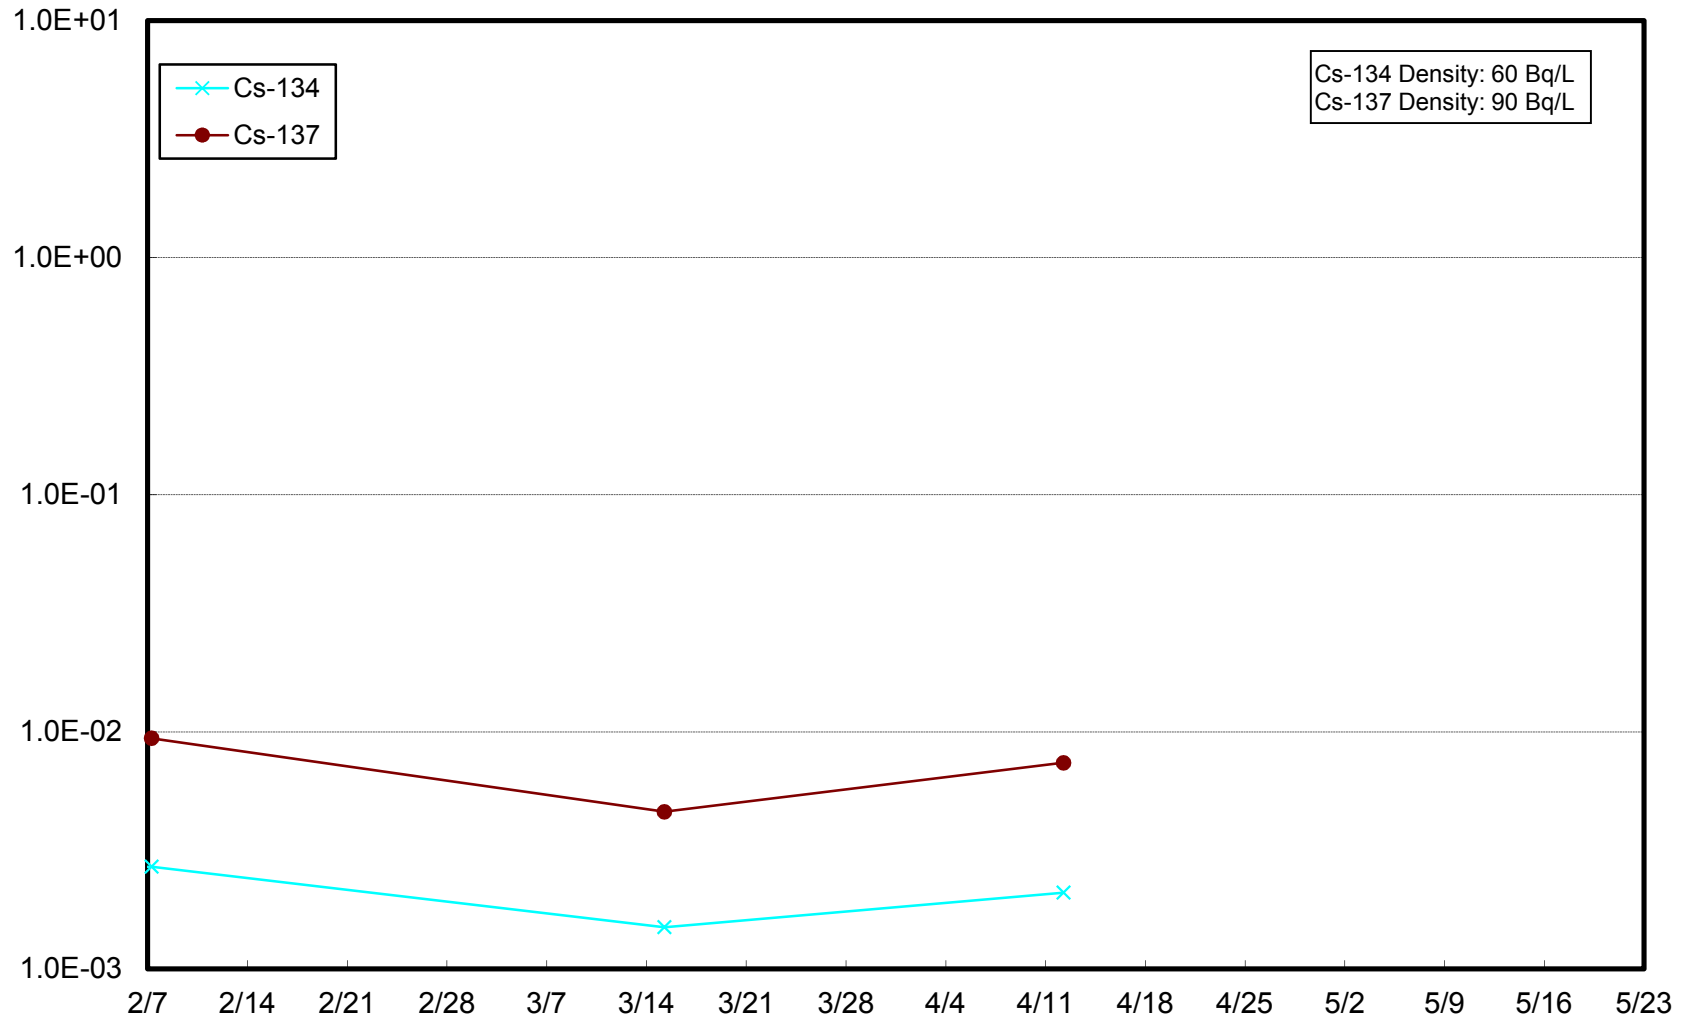

Radioactivity Density of the Seawater Around 10km Offshore of Fukushima Daini (T-B4) Lower Layer (Bq/L)

