

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on September 10)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)	Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)			
Time of Sampling	Sep 9, 2014 6:40 AM	Sep 9, 2014 5:20 AM		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)	
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)		Scaling Factor (①/②)
I-131 (Approx. 8 days)	0.61	0.02	0.63	0.02	40
Cs-134 (Approx. 2 years)	0.63	0.01	ND(0.78)	-	60
Cs-137 (Approx. 30 years)	0.76	0.01	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit, which is provided in parentheses.

Nuclides Analysis Result of Radioactive Materials in the Seawater< Offshore 1/5 >

(Data summarized on September 10)

Place of Sampling (Place No.)	*1				*2				*2				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	3km Offshore of Odaka Ward (T-14)		3km Offshore of Ukedo River (T-D1)		3km Offshore of Ukedo River (T-D1)		3km Offshore of Ukedo River (T-D1)		Upper Layer		Lower Layer		
Time of Sampling	Jul 31, 2014 8:45 AM		Jul 31, 2014 8:45 AM		Jul 22, 2014 9:16 AM		Jul 22, 2014 9:16 AM		Jul 31, 2014 9:09 AM		Jul 31, 2014 9:09 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0014	0.00	ND	-	0.0041	0.00	0.0040	0.00	0.0044	0.00	0.0024	0.00	60
Cs-137 (Approx. 30 years)	0.0059	0.00	0.0071	0.00	0.0095	0.00	0.014	0.00	0.014	0.00	0.0091	0.00	90

Place of Sampling (Place No.)	*2				*2				*2				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	3km Offshore of Ukedo River (T-D1)		3km Offshore of Fukushima Daiichi NPS (T-D5)		3km Offshore of Fukushima Daiichi NPS (T-D5)		3km Offshore of Fukushima Daiichi NPS (T-D5)		Upper Layer		Lower Layer		
Time of Sampling	Aug 4, 2014 9:56 AM		Aug 4, 2014 9:56 AM		Jul 22, 2014 10:31 AM		Jul 22, 2014 10:31 AM		Jul 31, 2014 10:09 AM		Jul 31, 2014 10:09 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	ND	-	0.0028	0.00	0.0093	0.00	0.0049	0.00	0.010	0.00	0.0018	0.00	60
Cs-137 (Approx. 30 years)	0.0059	0.00	0.0090	0.00	0.026	0.00	0.013	0.00	0.031	0.00	0.0075	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

Cs-134: Approx.0.0015Bq/L As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : *1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD., *2 Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 2/5>

(Data summarized on September 10)

Place of Sampling (Place No.)	*2 3km Offshore of Fukushima Daiichi NPS (T-D5)				*2 3km Offshore of Fukushima Daini NPS (T-D9)				*2 3km Offshore of Fukushima Daini NPS (T-D9)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Aug 4, 2014 10:48 AM		Aug 4, 2014 10:48 AM		Jul 22, 2014 9:31 AM		Jul 22, 2014 9:31 AM		Jul 28, 2014 9:17 AM		Jul 28, 2014 9:17 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0019	0.00	0.0035	0.00	0.014	0.00	0.0038	0.00	0.0041	0.00	0.0067	0.00	60
Cs-137 (Approx. 30 years)	0.0079	0.00	0.0072	0.00	0.035	0.00	0.017	0.00	0.012	0.00	0.023	0.00	90

Place of Sampling (Place No.)	*2 3km Offshore of Fukushima Daini NPS (T-D9)				*1 15km Offshore of Fukushima Daiichi NPS (T-5)				*1 3km Offshore of Iwasawa Shore (T-11)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Aug 5, 2014 9:54 AM		Aug 5, 2014 9:54 AM		Jul 28, 2014 8:16 AM		Jul 28, 2014 8:16 AM		Jul 28, 2014 9:57 AM		Jul 28, 2014 9:57 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0021	0.00	0.0037	0.00	0.0024	0.00	0.0027	0.00	0.0063	0.00	0.0075	0.00	60
Cs-137 (Approx. 30 years)	0.0075	0.00	0.010	0.00	0.0094	0.00	0.0099	0.00	0.018	0.00	0.021	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : *1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD., *2 Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 3/5>

(Data summarized on September 10)

Place of Sampling (Place No.)	3km Offshore of Northern Iwaki City (T-12)				1km Offshore of Natsui River (T-17-1)				3km Offshore of Toyoma (T-20)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Aug 2, 2014 11:33 AM		Aug 2, 2014 11:33 AM		Aug 2, 2014 11:55 AM		Aug 2, 2014 11:55 AM		Aug 2, 2014 12:16 PM		Aug 2, 2014 12:16 PM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0046	0.00	0.0047	0.00	0.0026	0.00	0.0030	0.00	0.0015	0.00	0.0019	0.00	60
Cs-137 (Approx. 30 years)	0.014	0.00	0.020	0.00	0.0089	0.00	0.010	0.00	0.0068	0.00	0.0077	0.00	90

Place of Sampling (Place No.)	1km Offshore of Nida River (T-13-1)				3km Offshore of Soma (T-22)				5km Offshore of Kashima (T-MA)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jul 24, 2014 5:44 AM		Jul 24, 2014 5:44 AM		Jul 24, 2014 7:12 AM		Jul 24, 2014 7:12 AM		Jul 24, 2014 6:43 AM		Jul 24, 2014 6:43 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0048	0.00	0.0024	0.00	0.0025	0.00	0.0023	0.00	0.0020	0.00	0.0021	0.00	60
Cs-137 (Approx. 30 years)	0.015	0.00	0.0064	0.00	0.0079	0.00	0.0086	0.00	0.0082	0.00	0.0081	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 4/5>

(Data summarized on September 10)

Place of Sampling (Place No.)	Around 1km Offshore of Ota River (T-S1)				Around 3km Offshore of Odaka Ward (T-S2)				Around 2km Offshore of Kido River(T-S5)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jul 25, 2014 5:51 AM		Jul 25, 2014 5:51 AM		Jul 25, 2014 6:18 AM		Jul 25, 2014 6:18 AM		Aug 3, 2014 6:40 AM		Aug 3, 2014 6:40 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0067	0.00	0.0044	0.00	0.0027	0.00	0.0038	0.00	0.0060	0.00	0.0055	0.00	60
Cs-137 (Approx. 30 years)	0.021	0.00	0.013	0.00	0.0086	0.00	0.011	0.00	0.021	0.00	0.018	0.00	90

Place of Sampling (Place No.)	Around 2km Offshore of Fukushima Daini NPS (T-S7)				Around 4km Offshore of Kumagawa (T-S8)				Arounmd 15km Offshore of Odaka Ward (T-B1)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Aug 3, 2014 6:19 AM		Aug 3, 2014 6:19 AM		Jul 27, 2014 6:15 AM		Jul 27, 2014 6:15 AM		Jul 29, 2014 6:46 AM		Jul 29, 2014 6:46 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0057	0.00	0.0074	0.00	0.012	0.00	0.0033	0.00	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	0.020	0.00	0.022	0.00	0.034	0.00	0.012	0.00	0.0037	0.00	0.0031	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

Cs-134: Approx.0.0014Bq/L As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.

Nuclides Analysis Result of Radioactive Materials in the Seawater < Offshore 5/5 >

(Data summarized on September 10)

Place of Sampling (Place No.)	Around 18km Offshore of Ukedo River (T-B2)												② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Jul 29, 2014 6:18 AM		Jul 29, 2014 6:18 AM										
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	ND	-	0.026	0.00									60
Cs-137 (Approx. 30 years)	0.0062	0.00	0.083	0.00									90

Place of Sampling (Place No.)													② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling													
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)													60
Cs-137 (Approx. 30 years)													90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.


* "ND" indicates that the measurement result is below the detection limit.

Cs-134: Approx.0.0014Bq/L As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.


* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.


Radioactivity Density of the Seawater at 1F Units 5-6 North Discharge Channel (Bq/L)

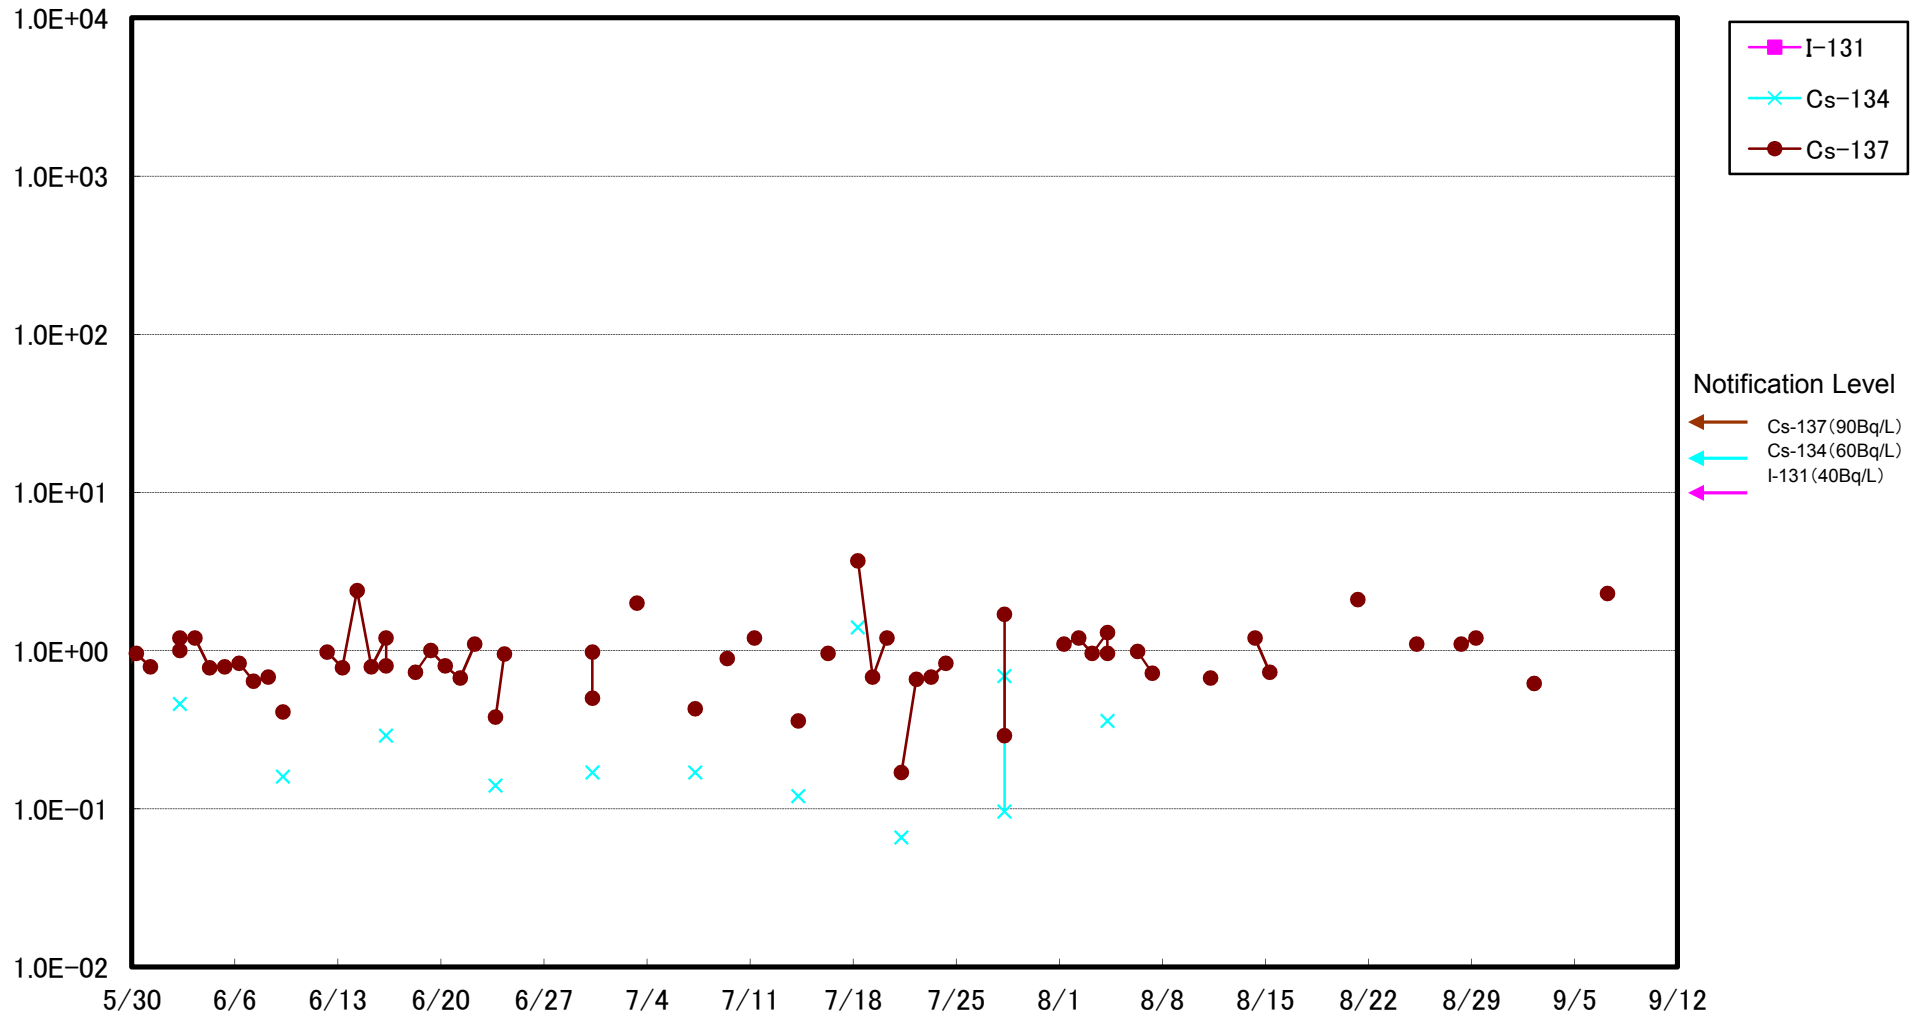


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

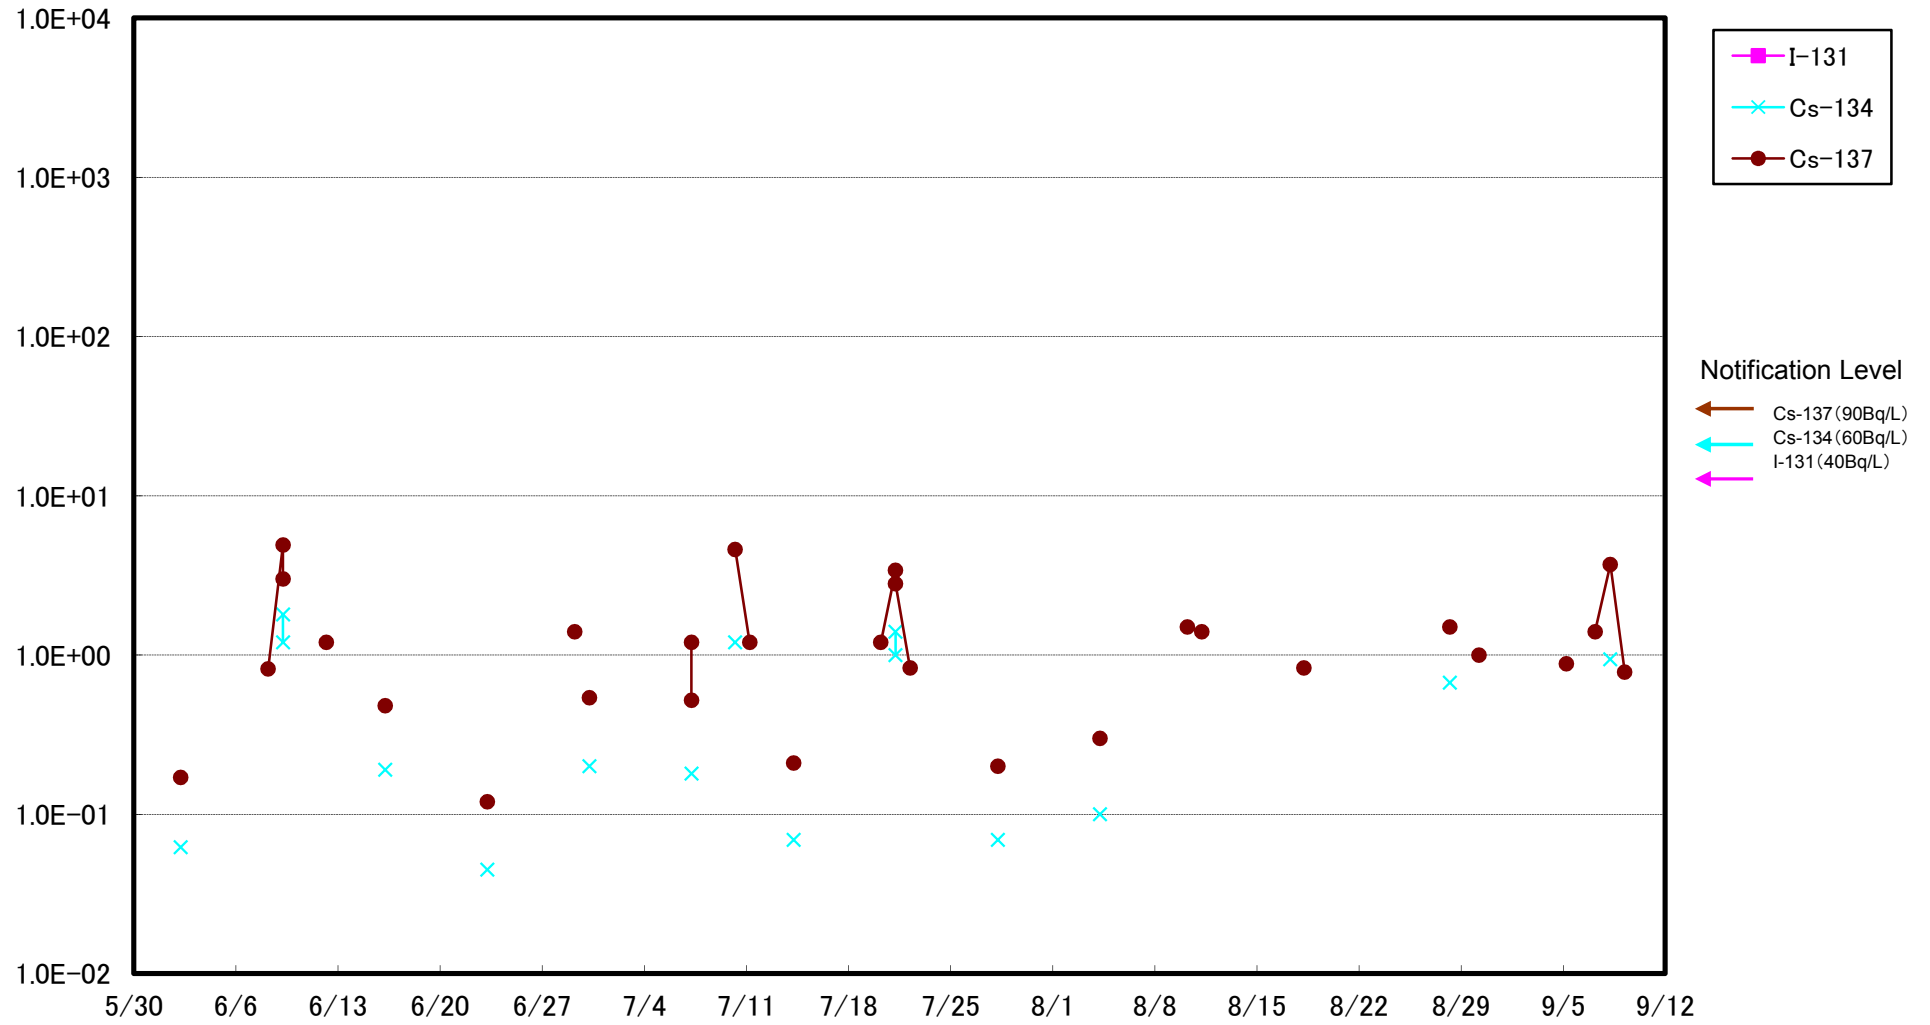


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Upper Layer (Bq/L)

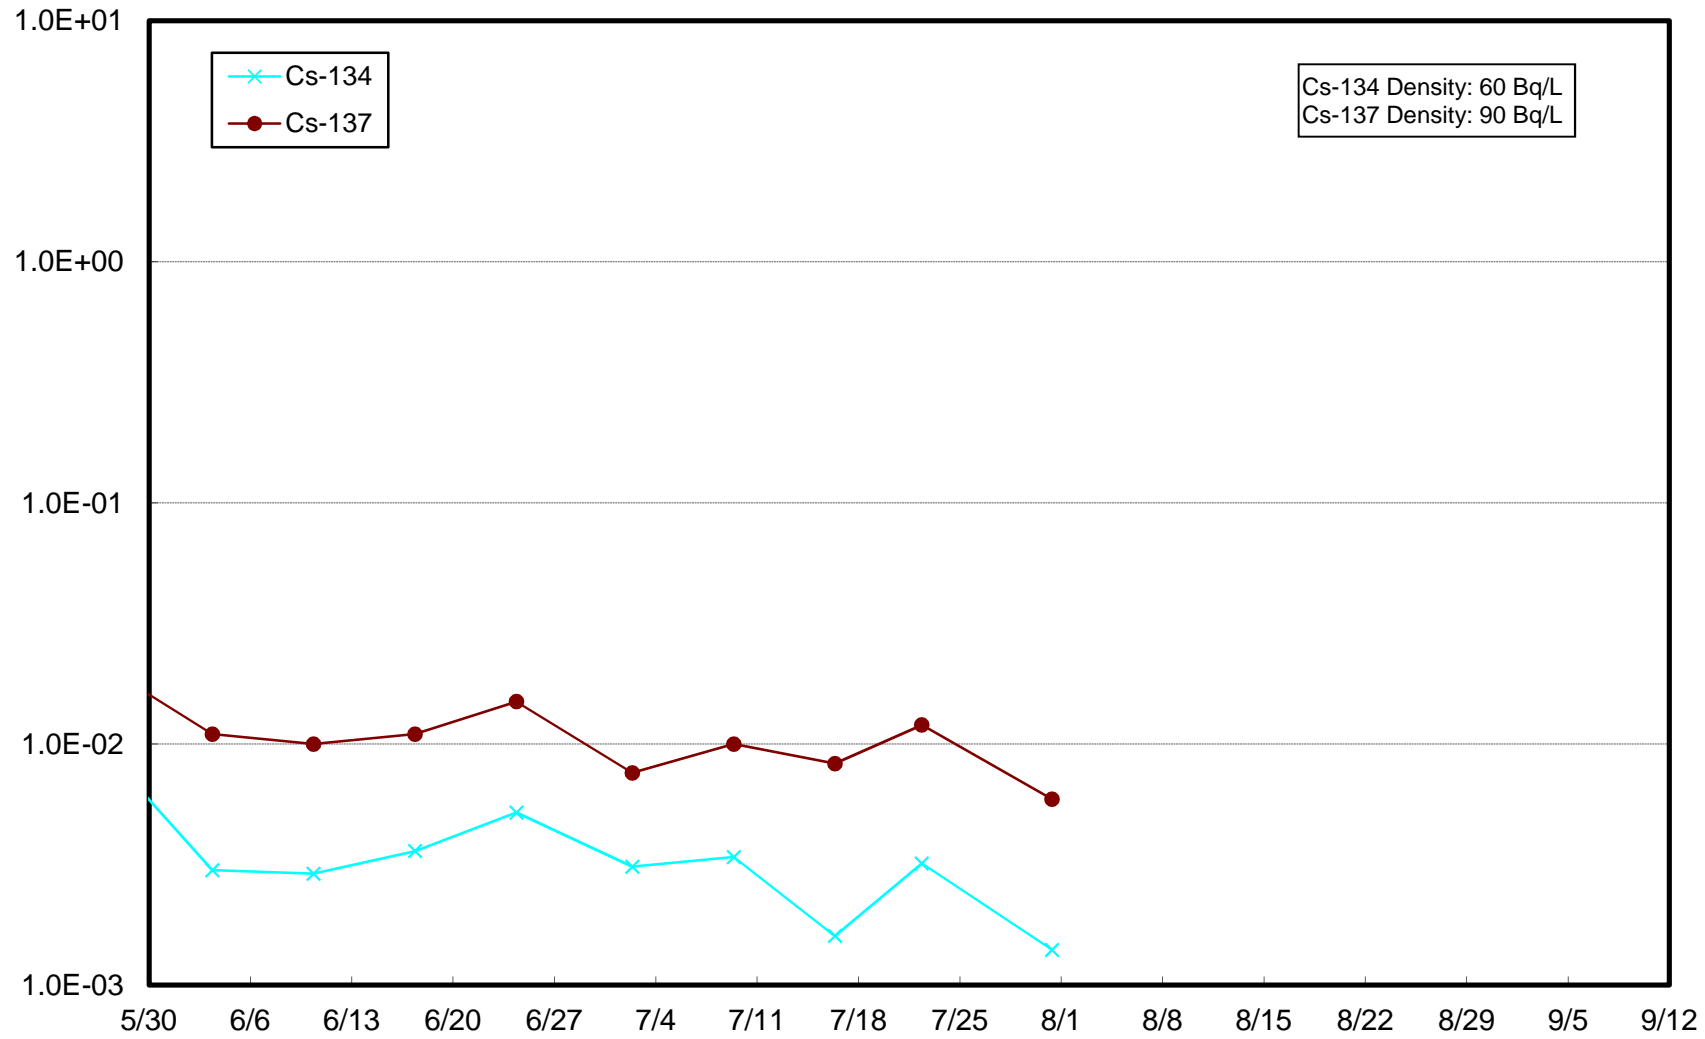


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Lower Layer (Bq/L)

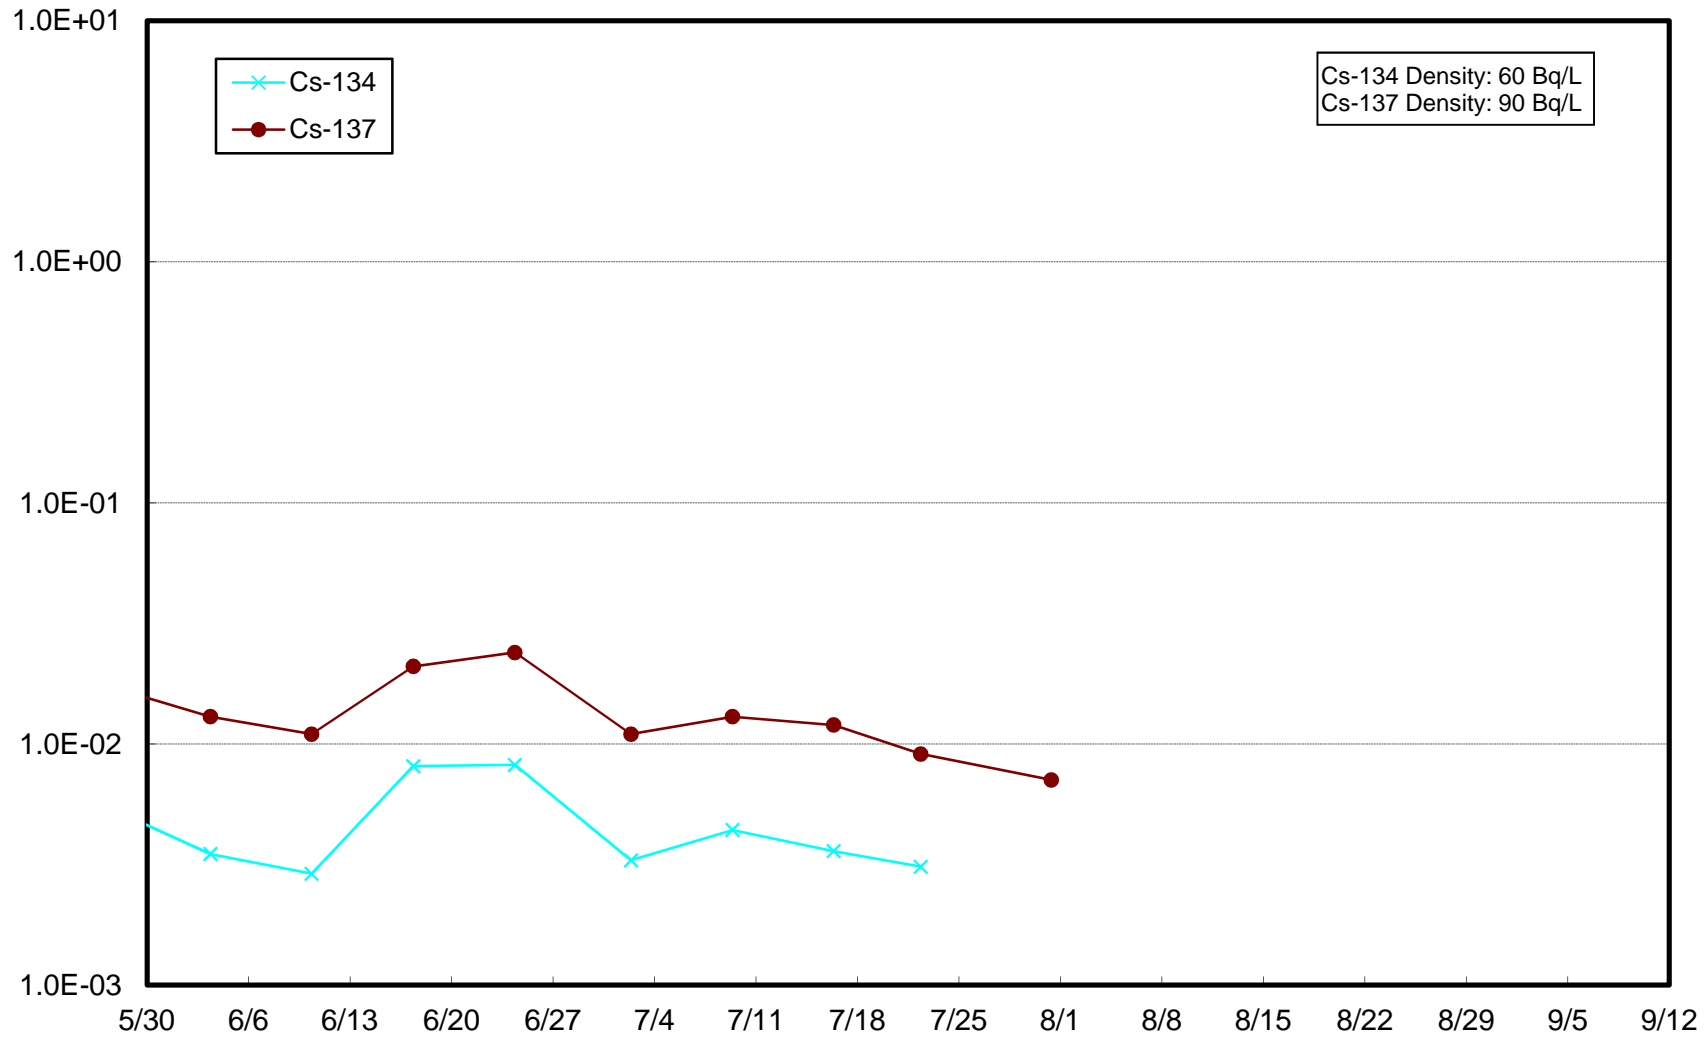


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Upper Layer (Bq/L)

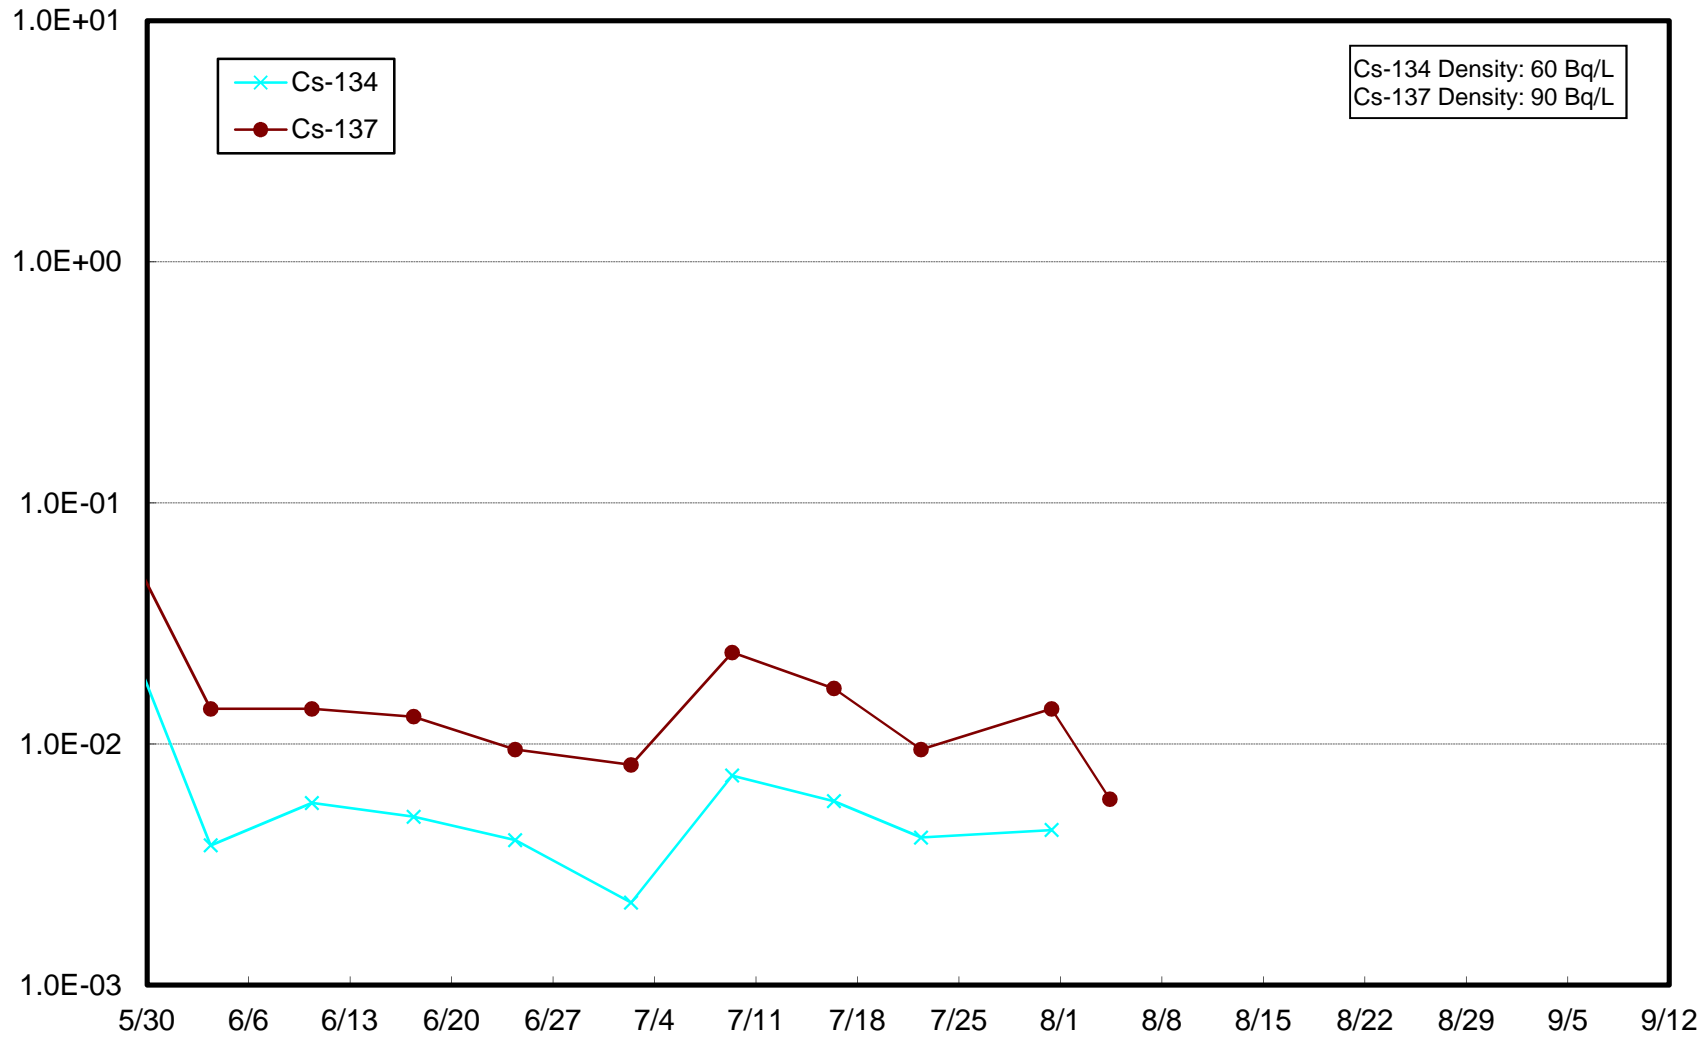


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Lower Layer (Bq/L)

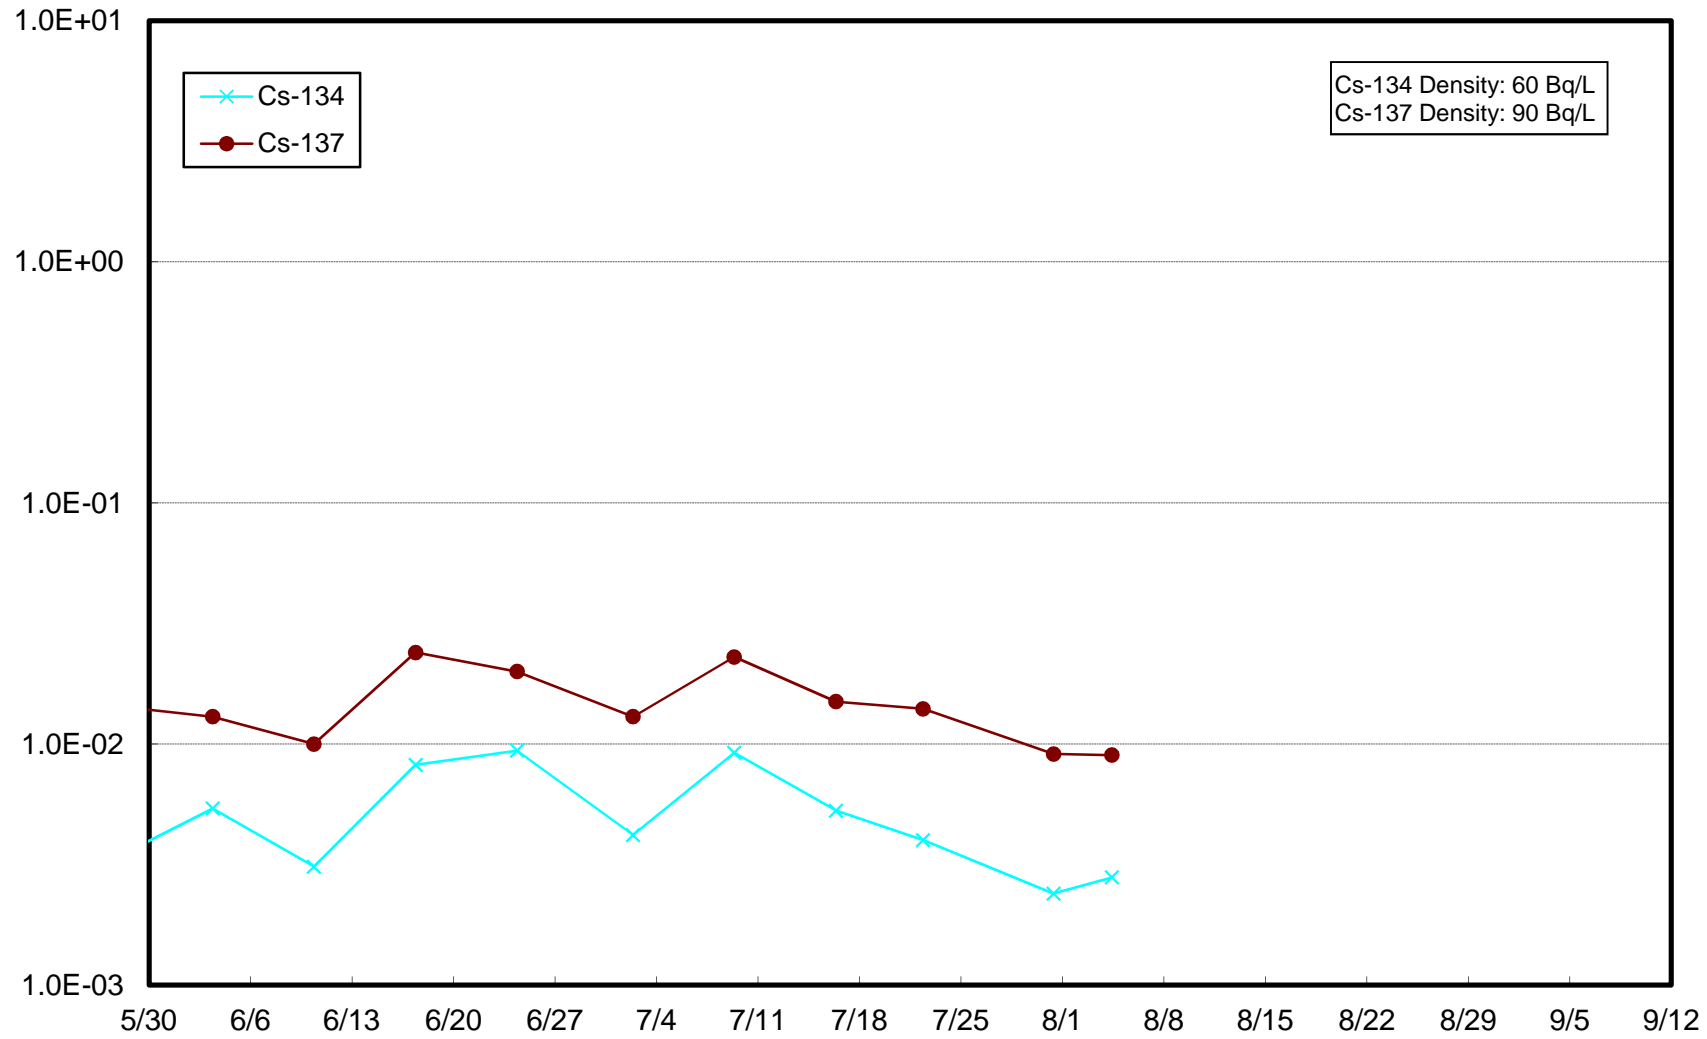


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer (Bq/L)

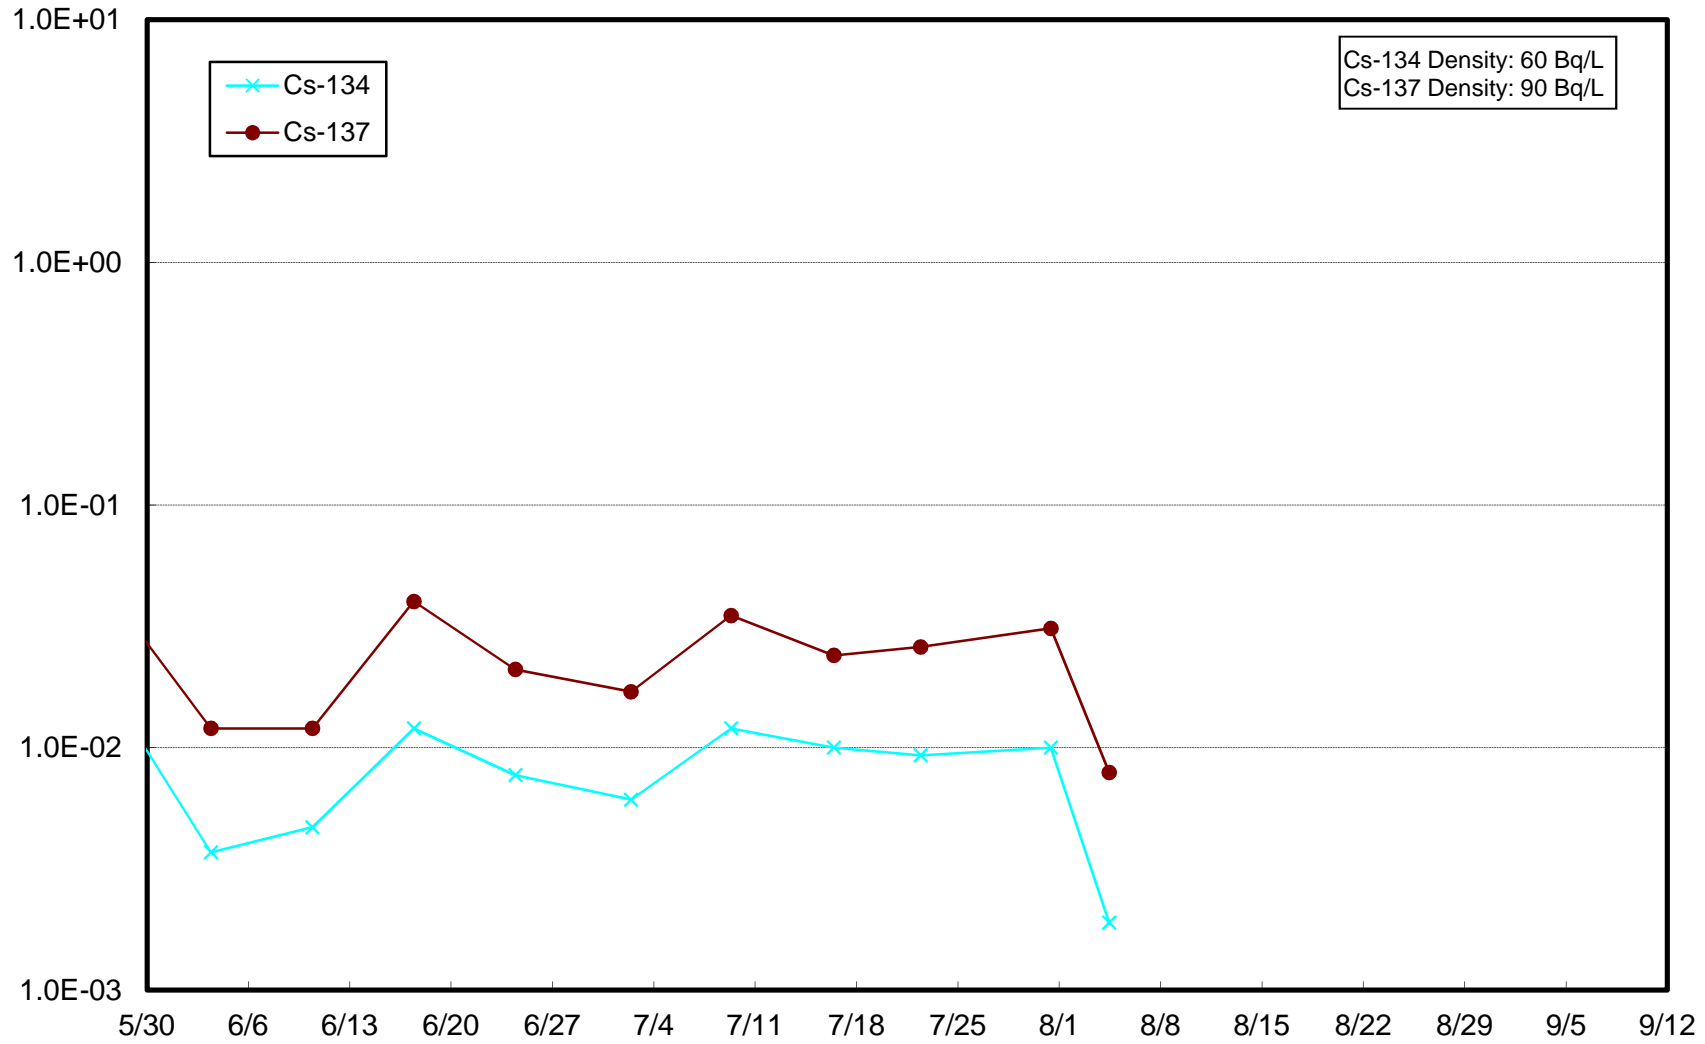


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Lower Layer (Bq/L)

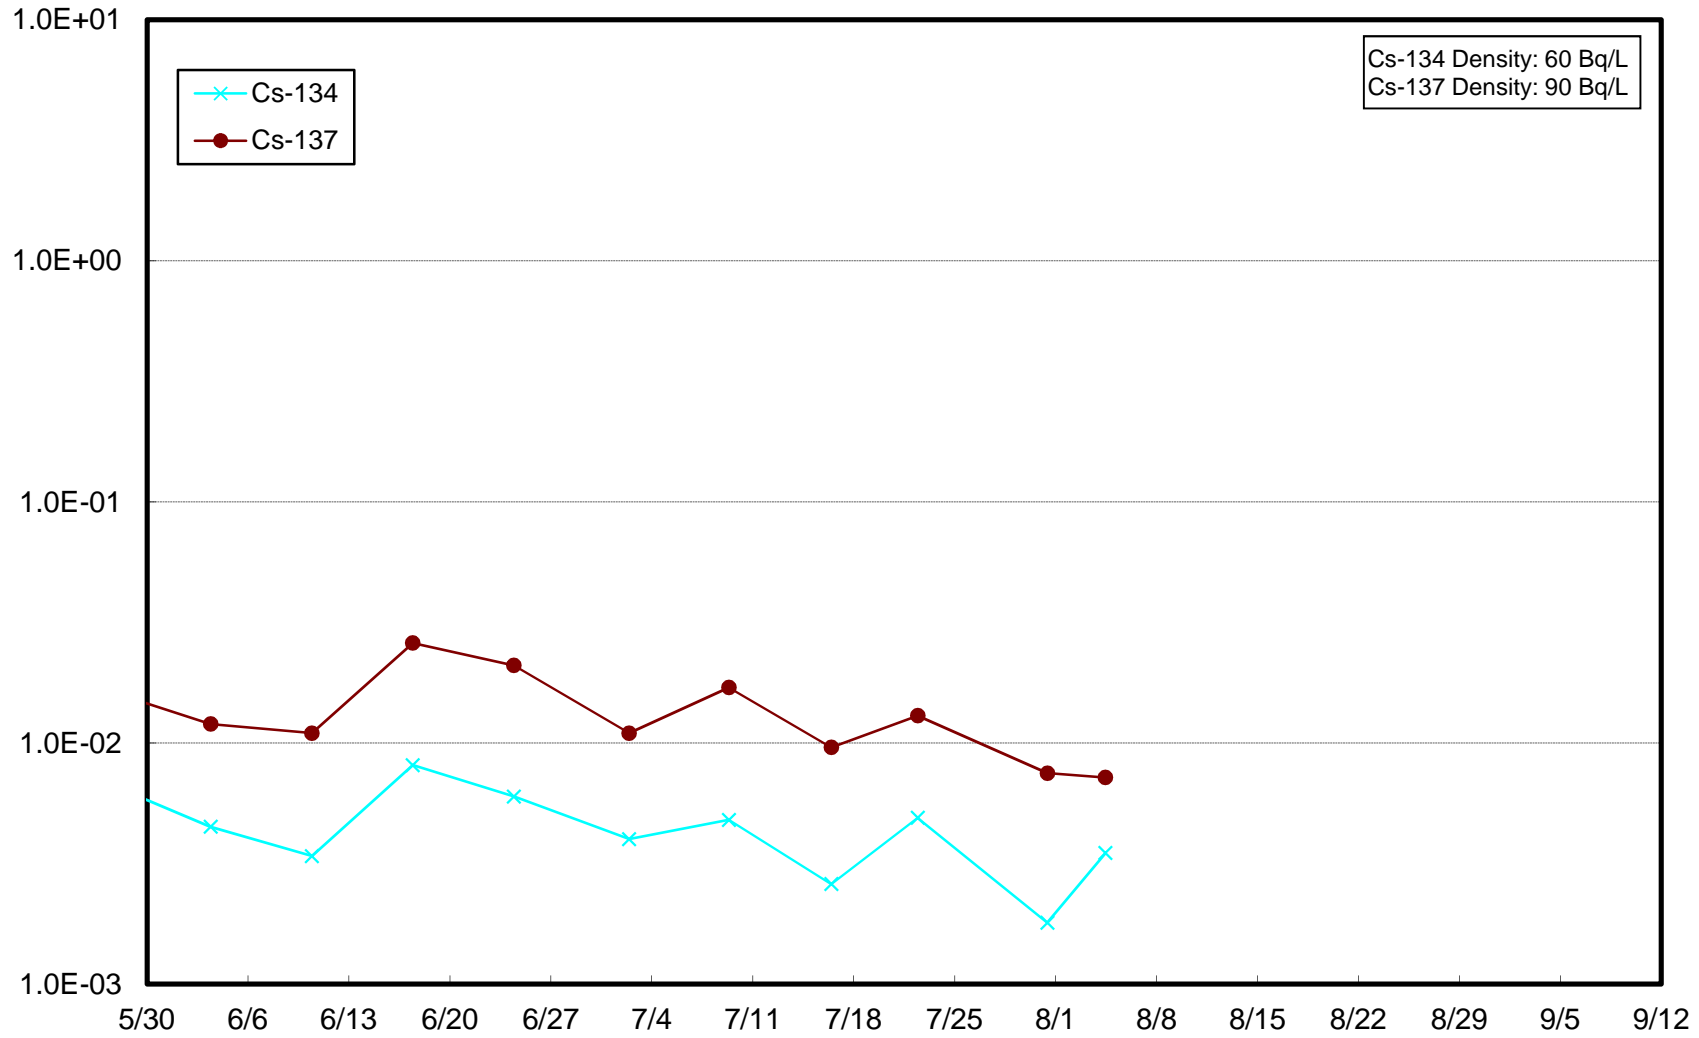


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer (Bq/L)

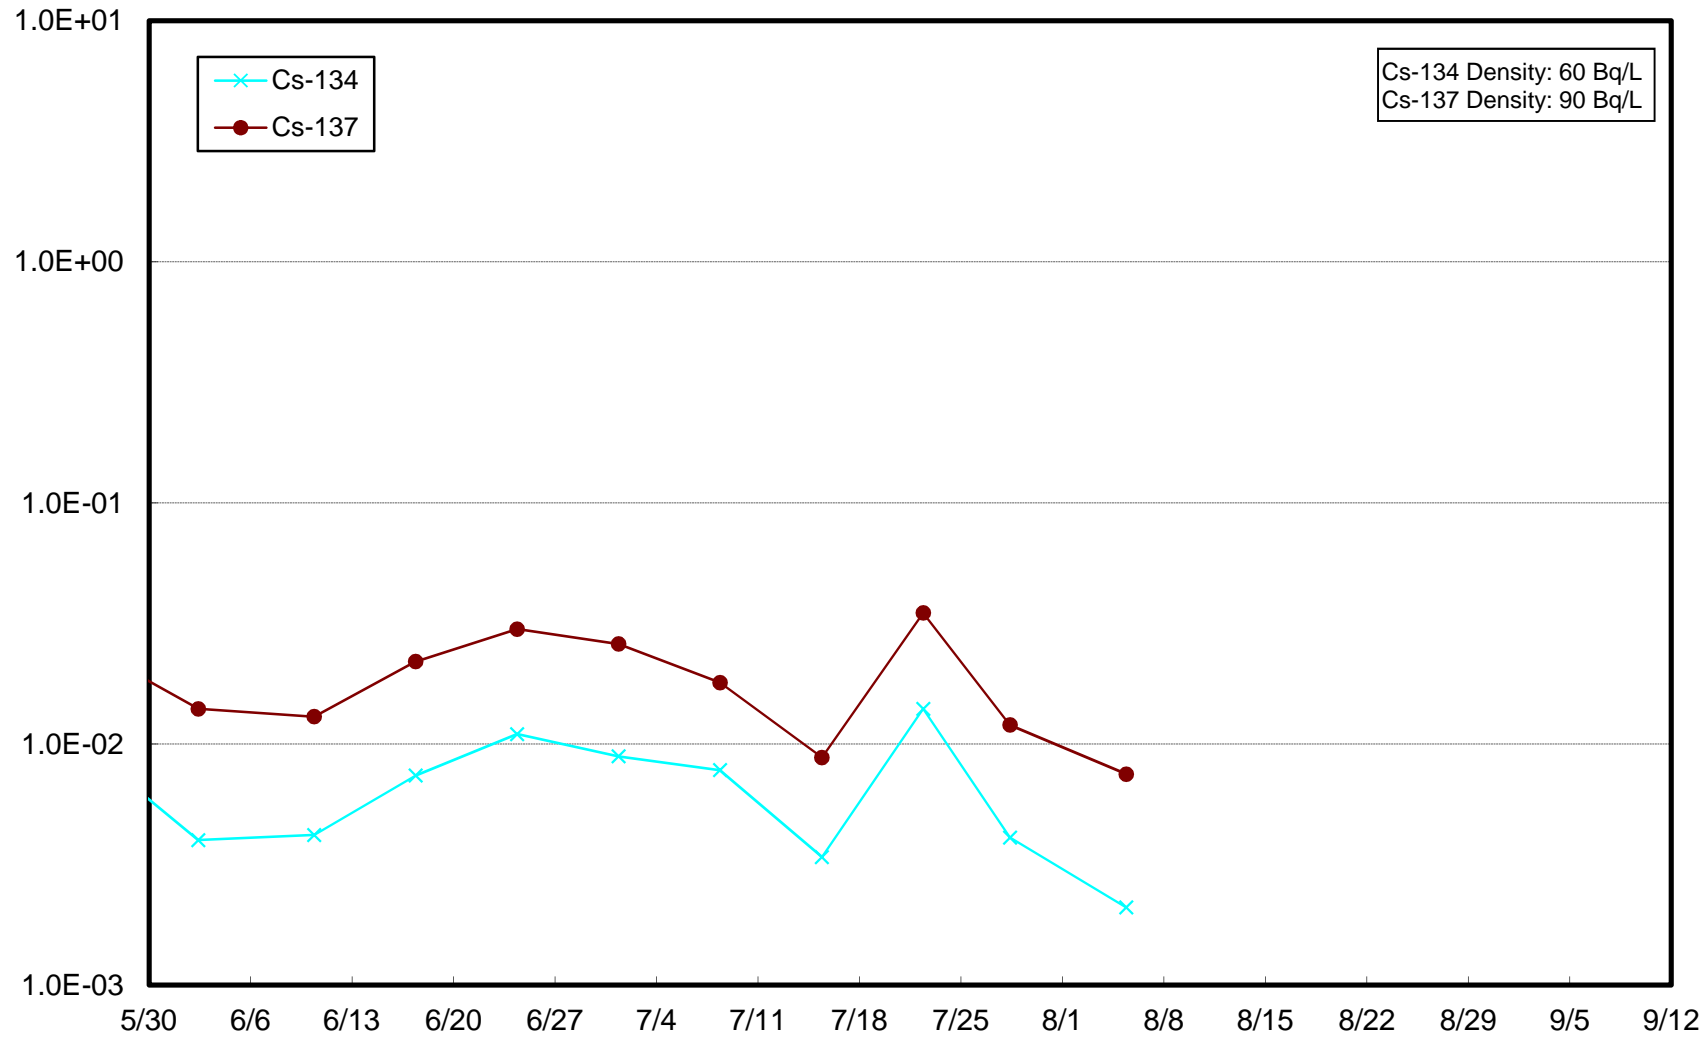


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Lower Layer (Bq/L)

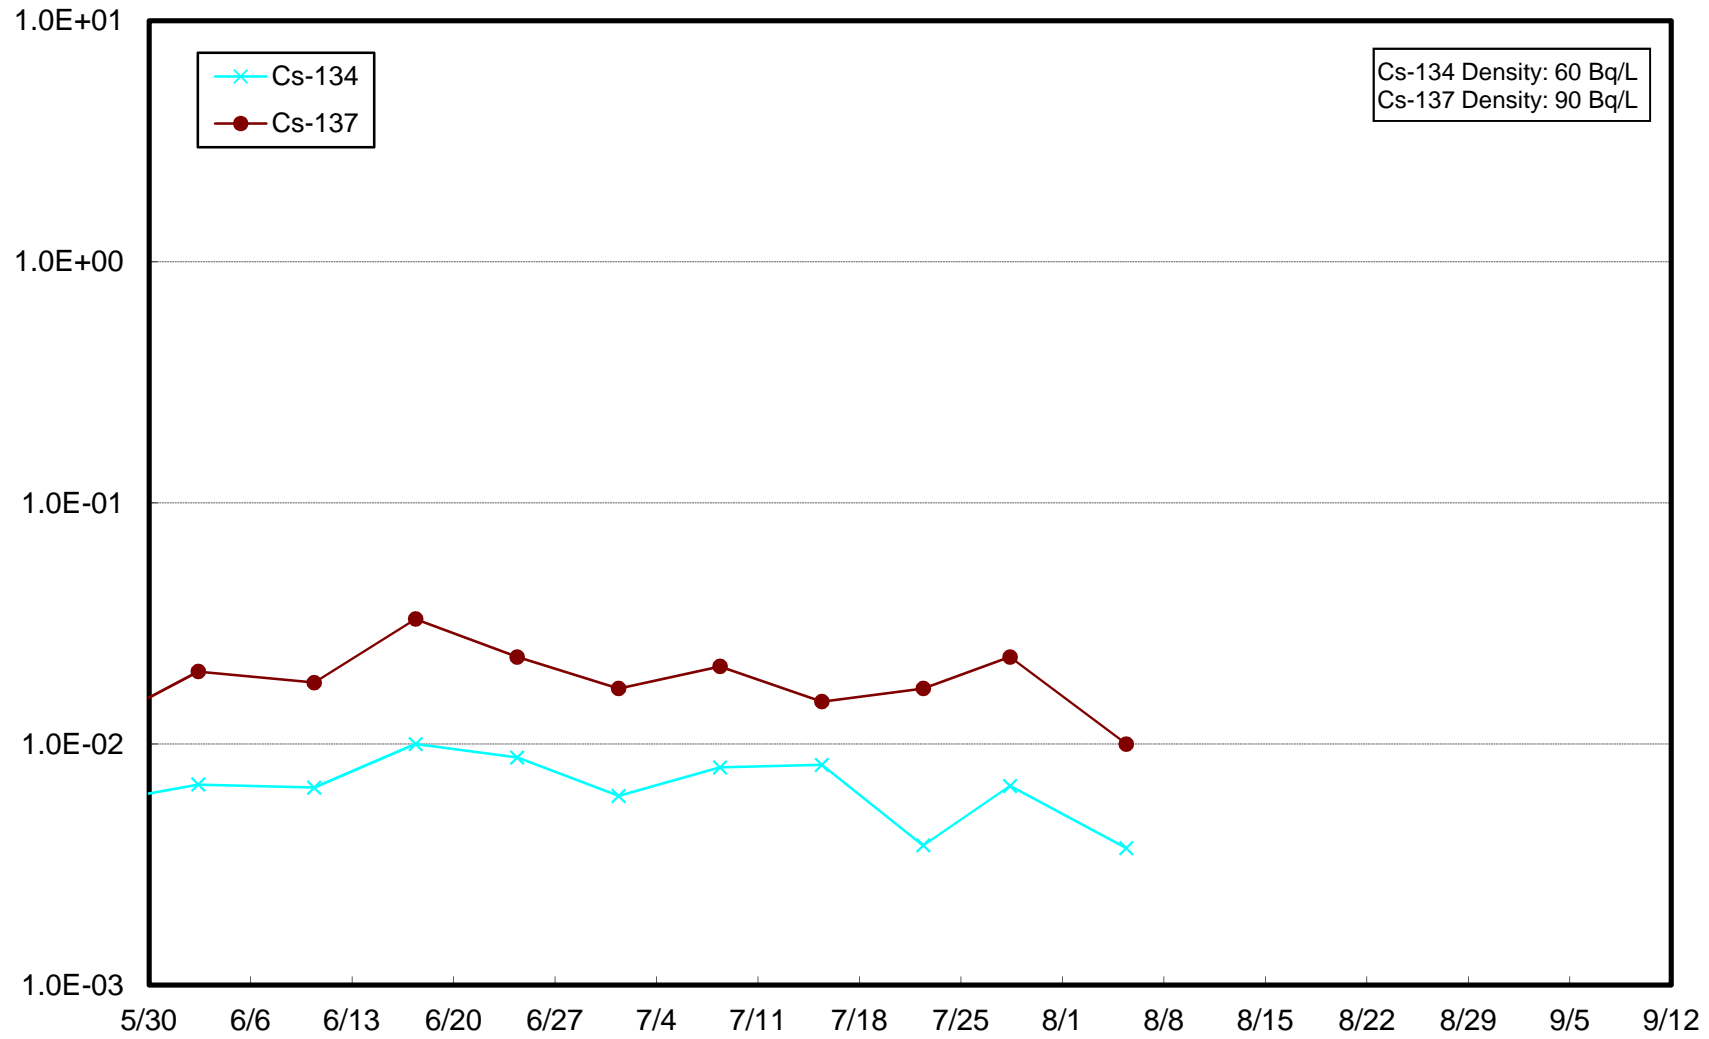


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Upper Layer (Bq/L)

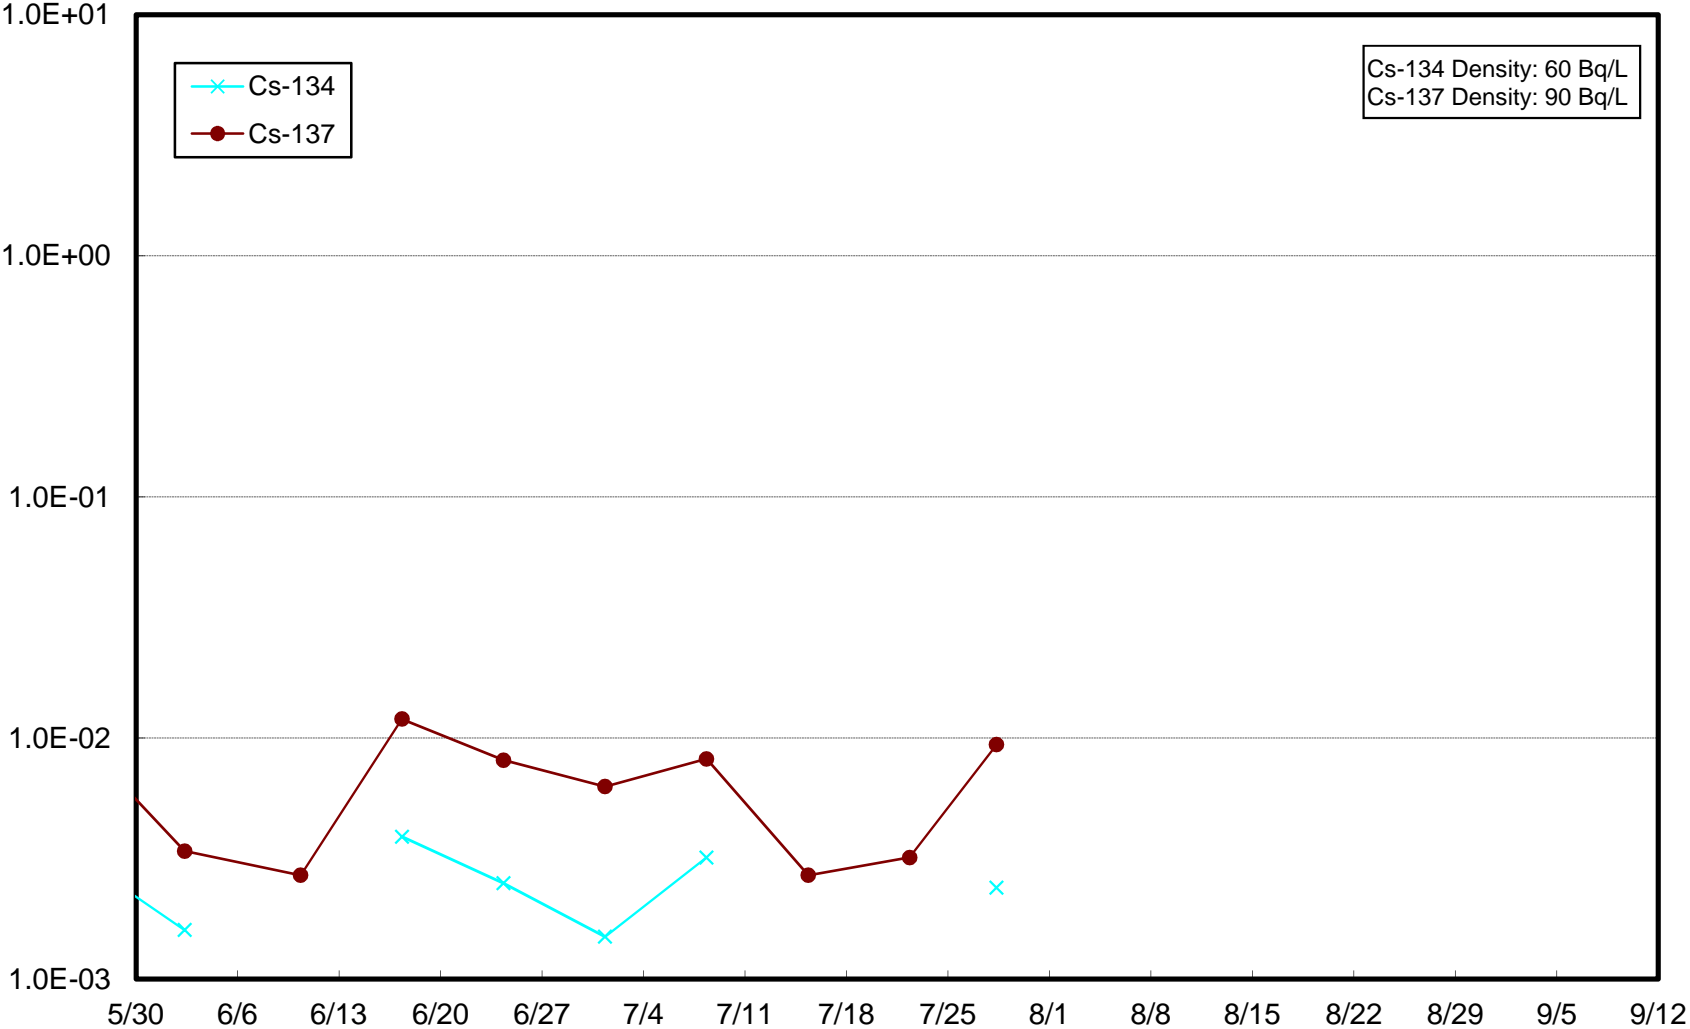


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Lower Layer (Bq/L)

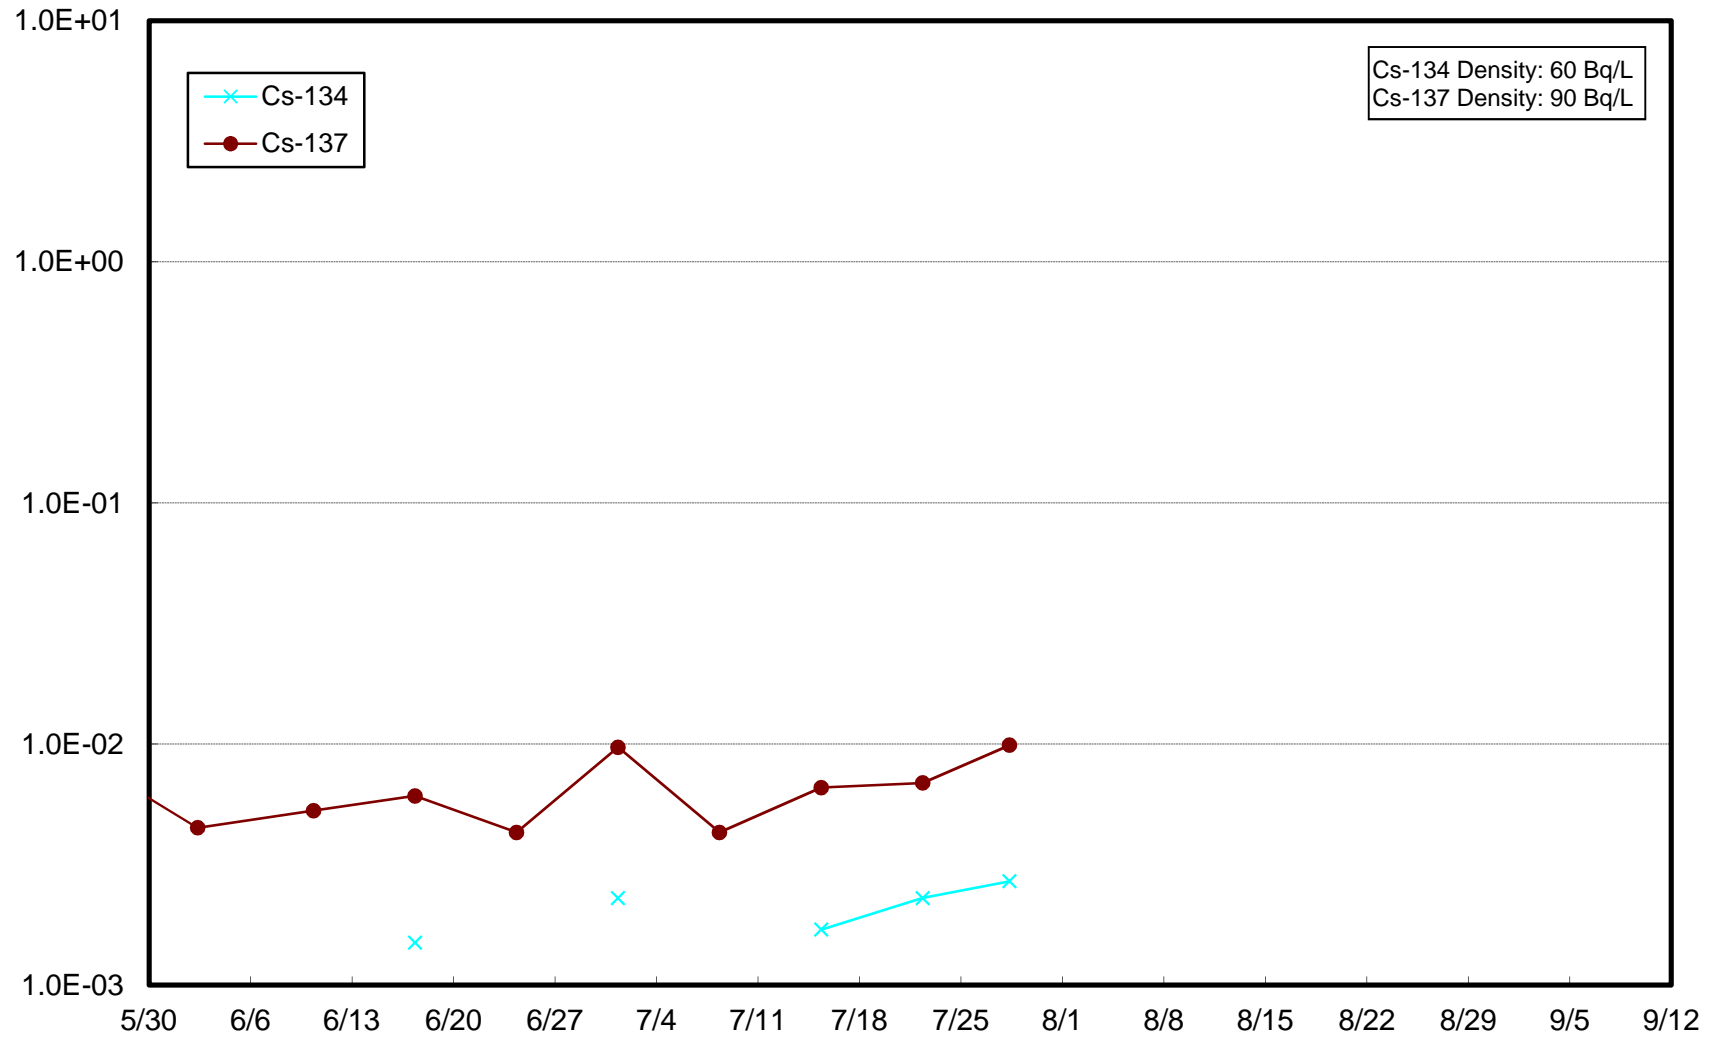


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Upper Layer (Bq/L)

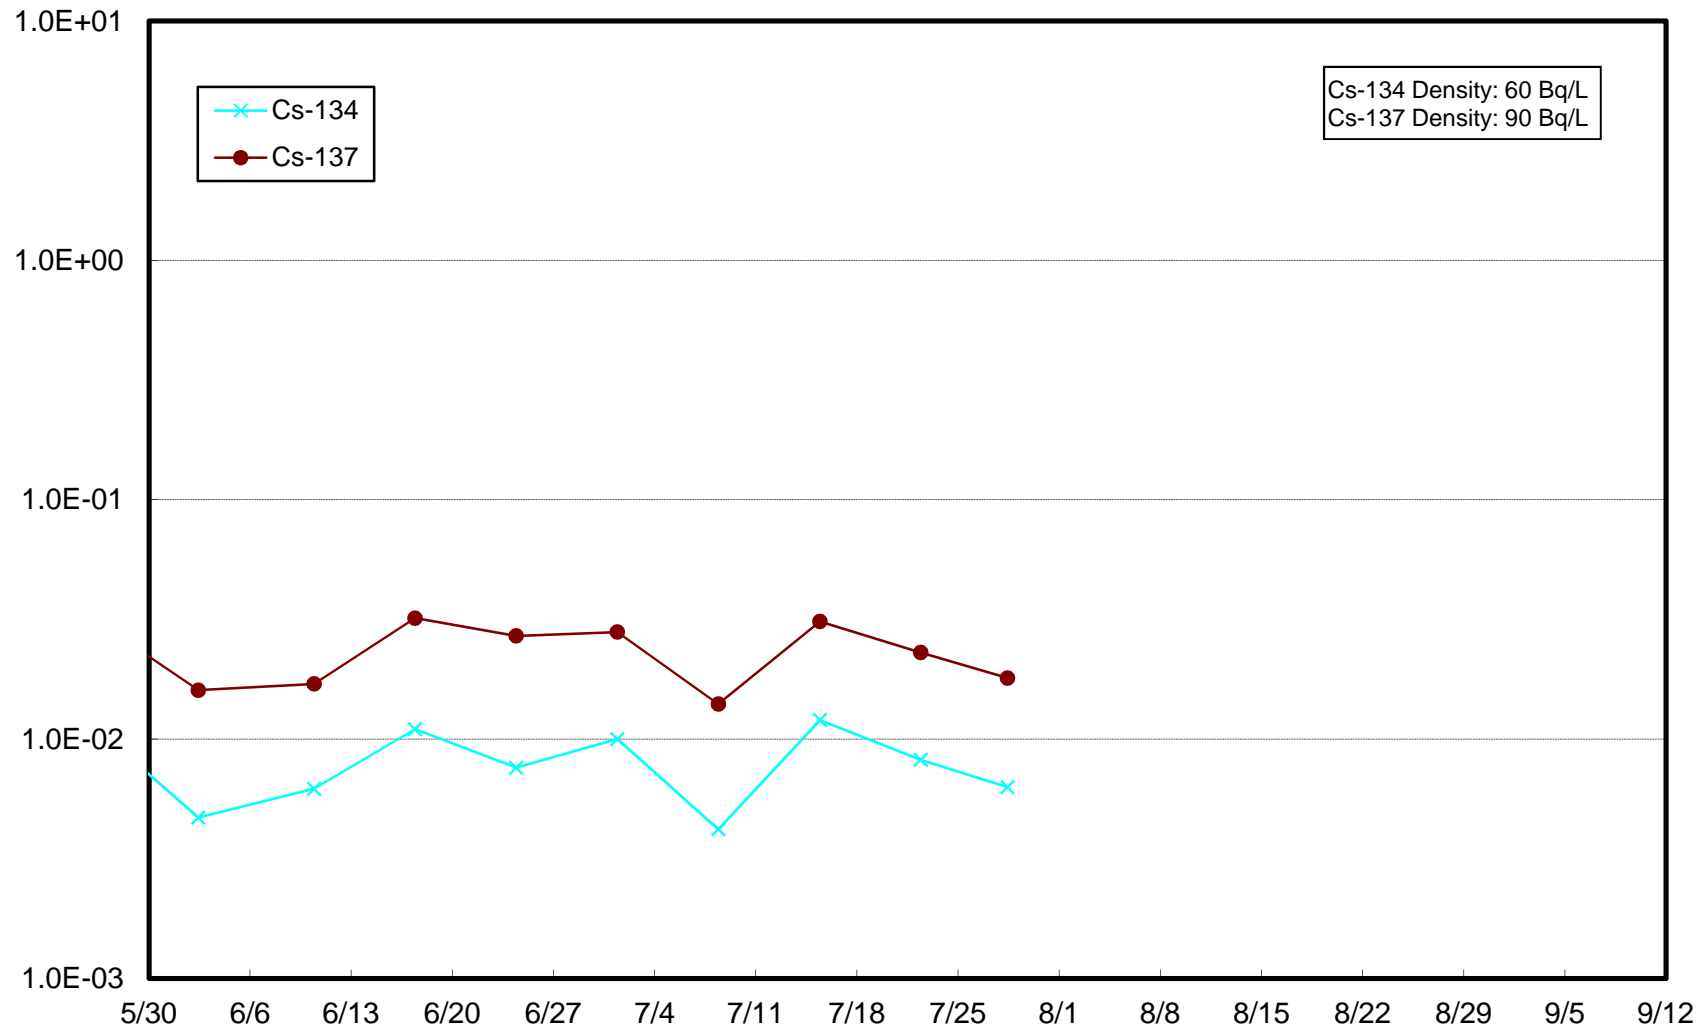


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Upper Layer (Bq/L)

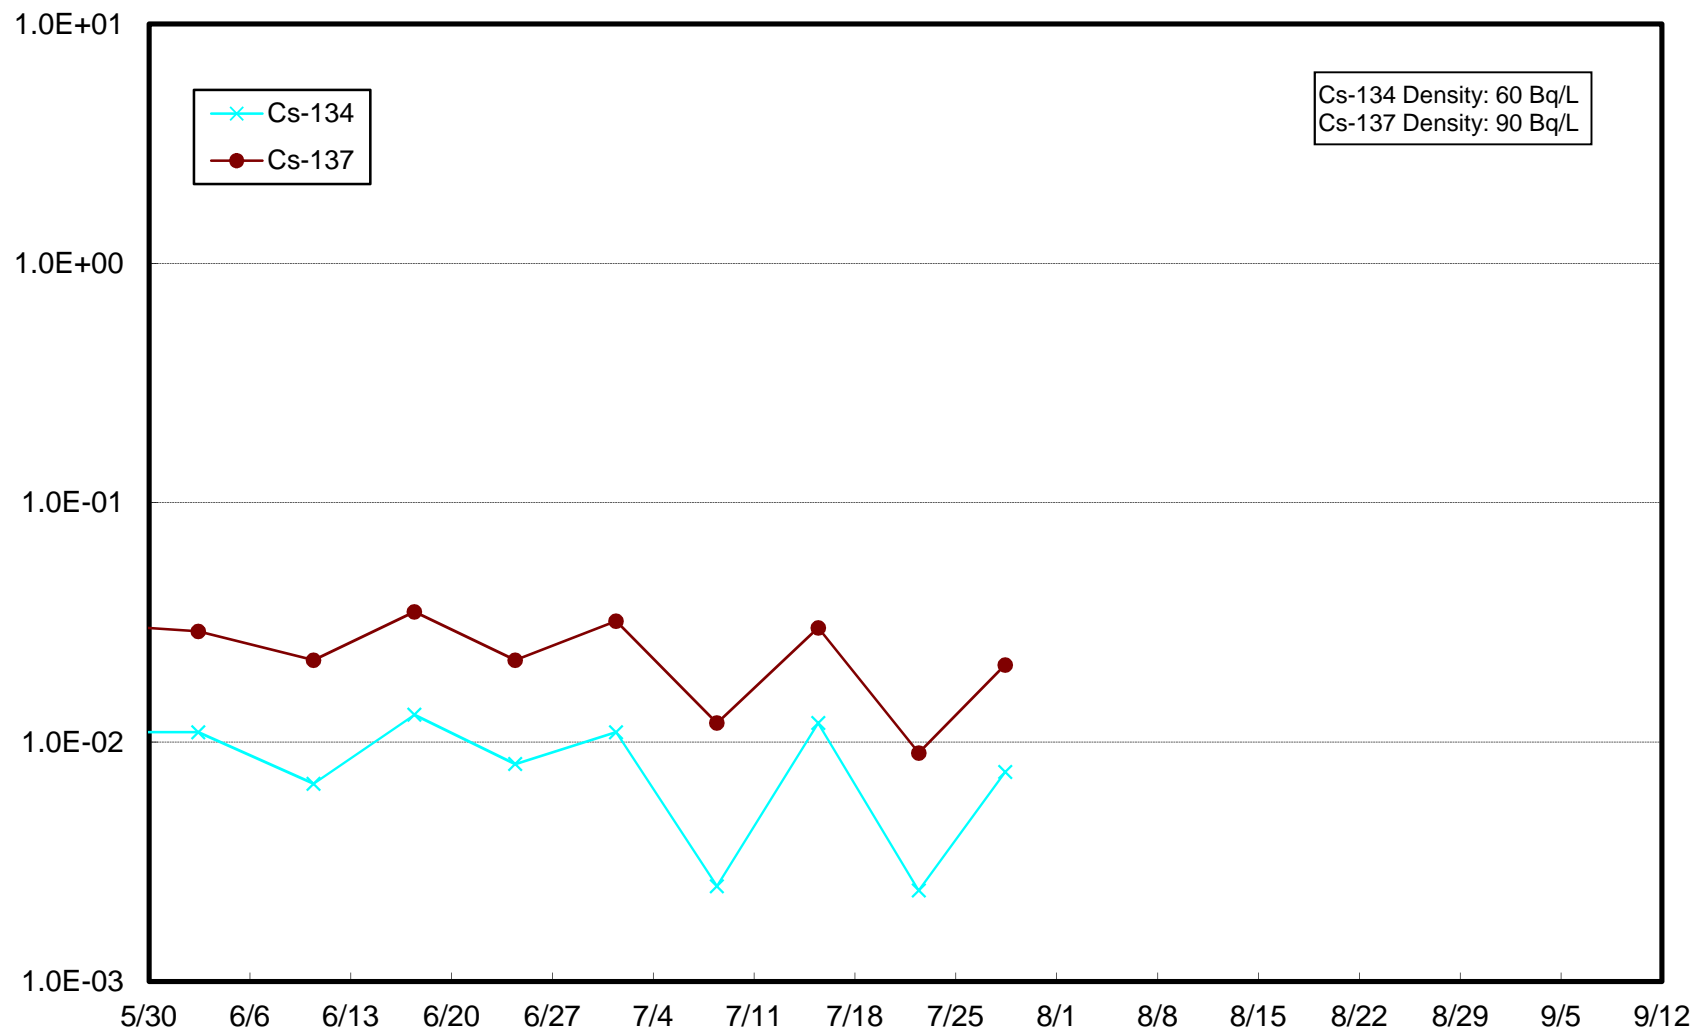


Radioactivity Density of the Seawater at 3km Offshore of North of Iwaki City(T-12) Upper Layer (Bq/L)

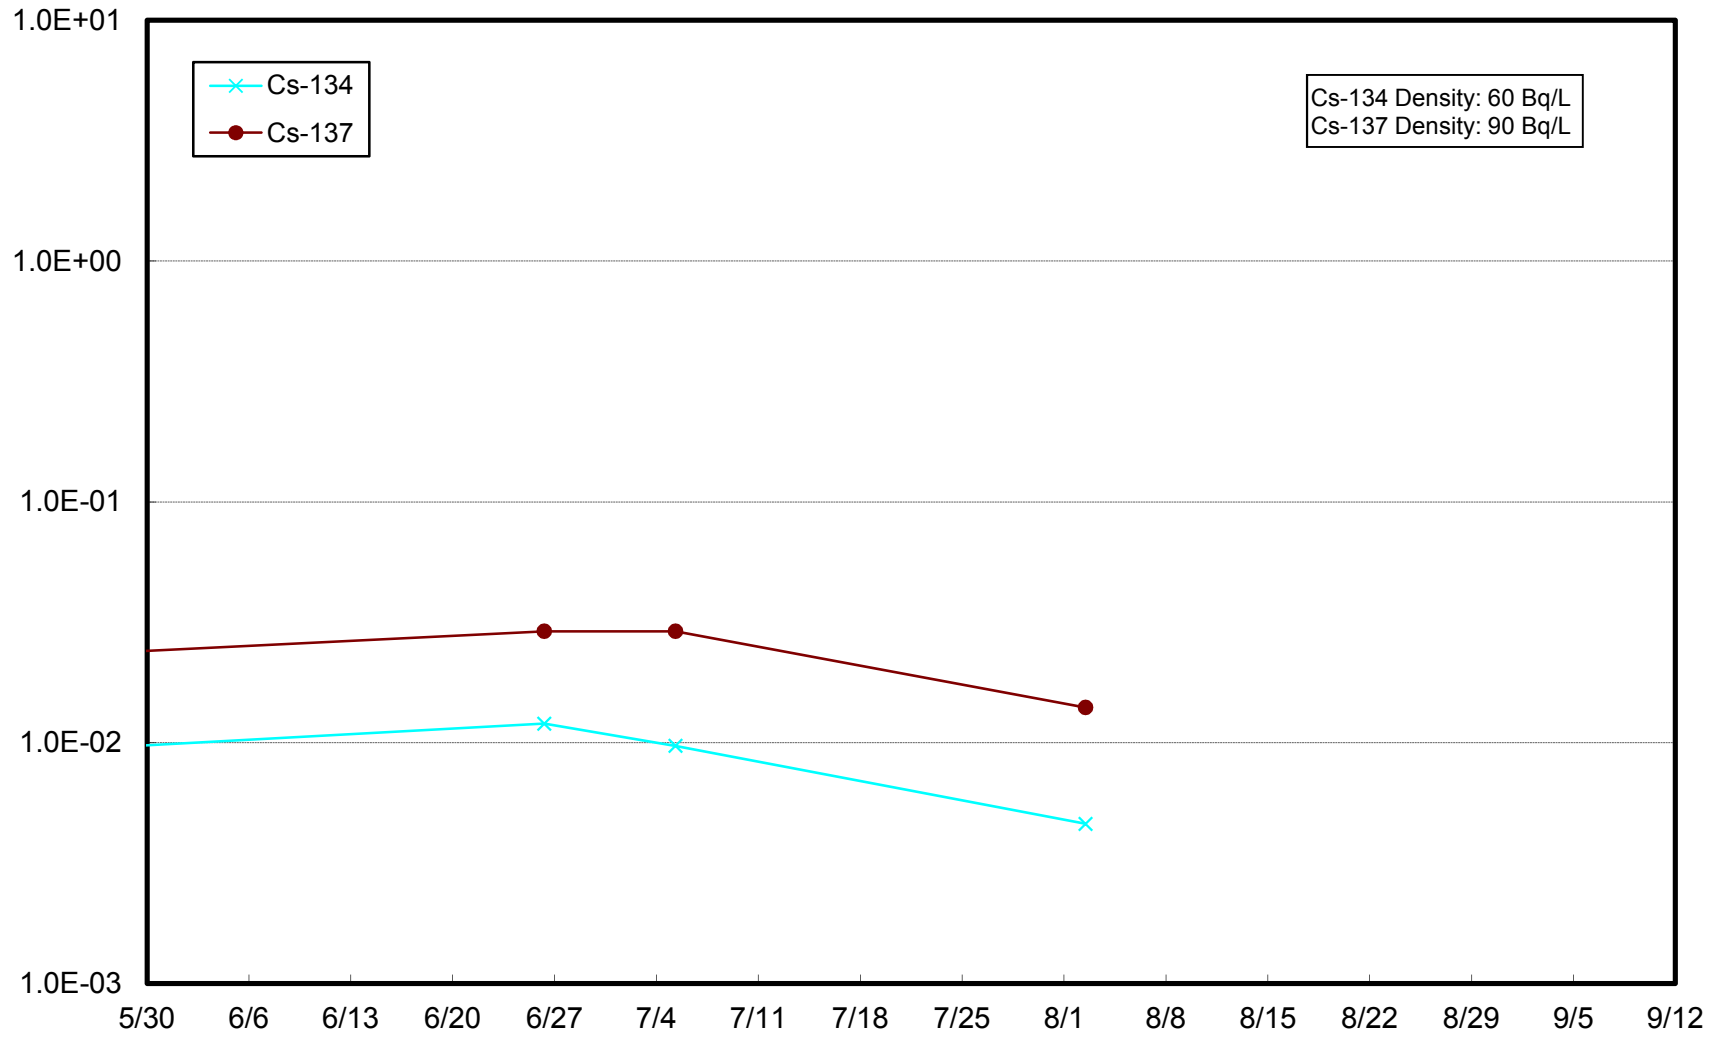


Radioactivity Density of the Seawater at 3km Offshore of North of Iwaki City(T-12) Lower Layer (Bq/L)

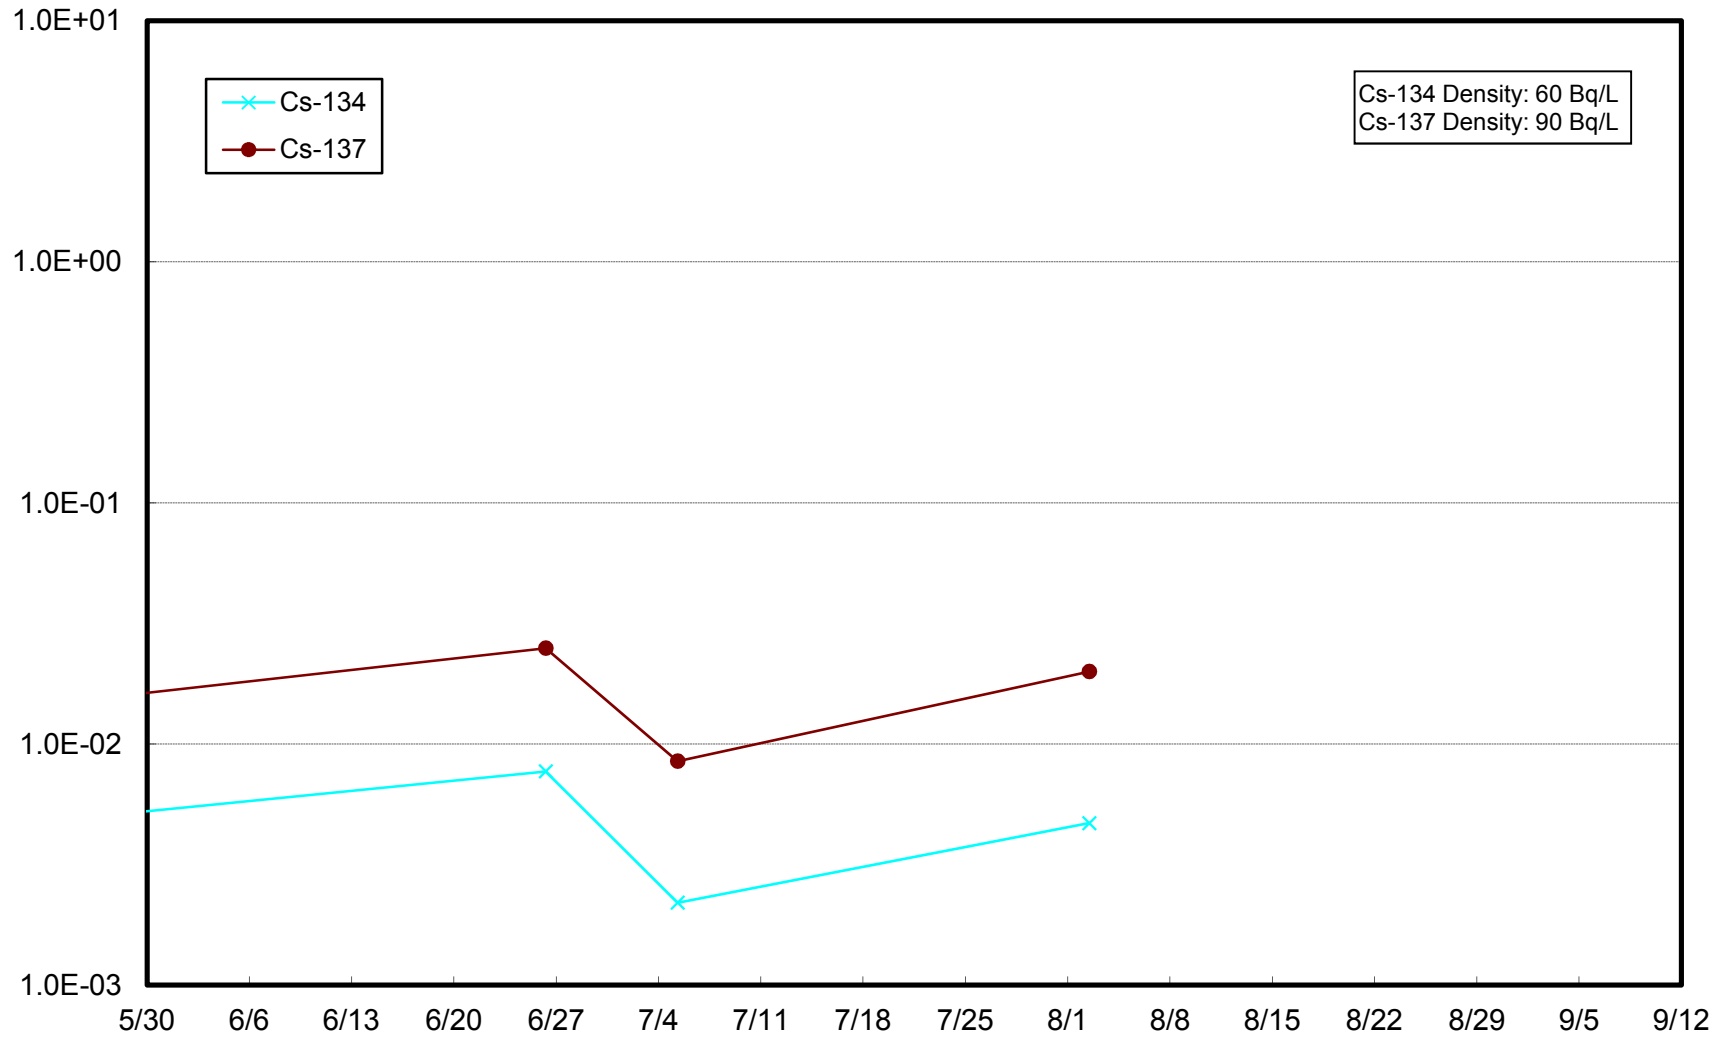


Radioactivity Density of the Seawater at 1km Offshore of Natsui River (T-17-1) Upper Layer (Bq/L)

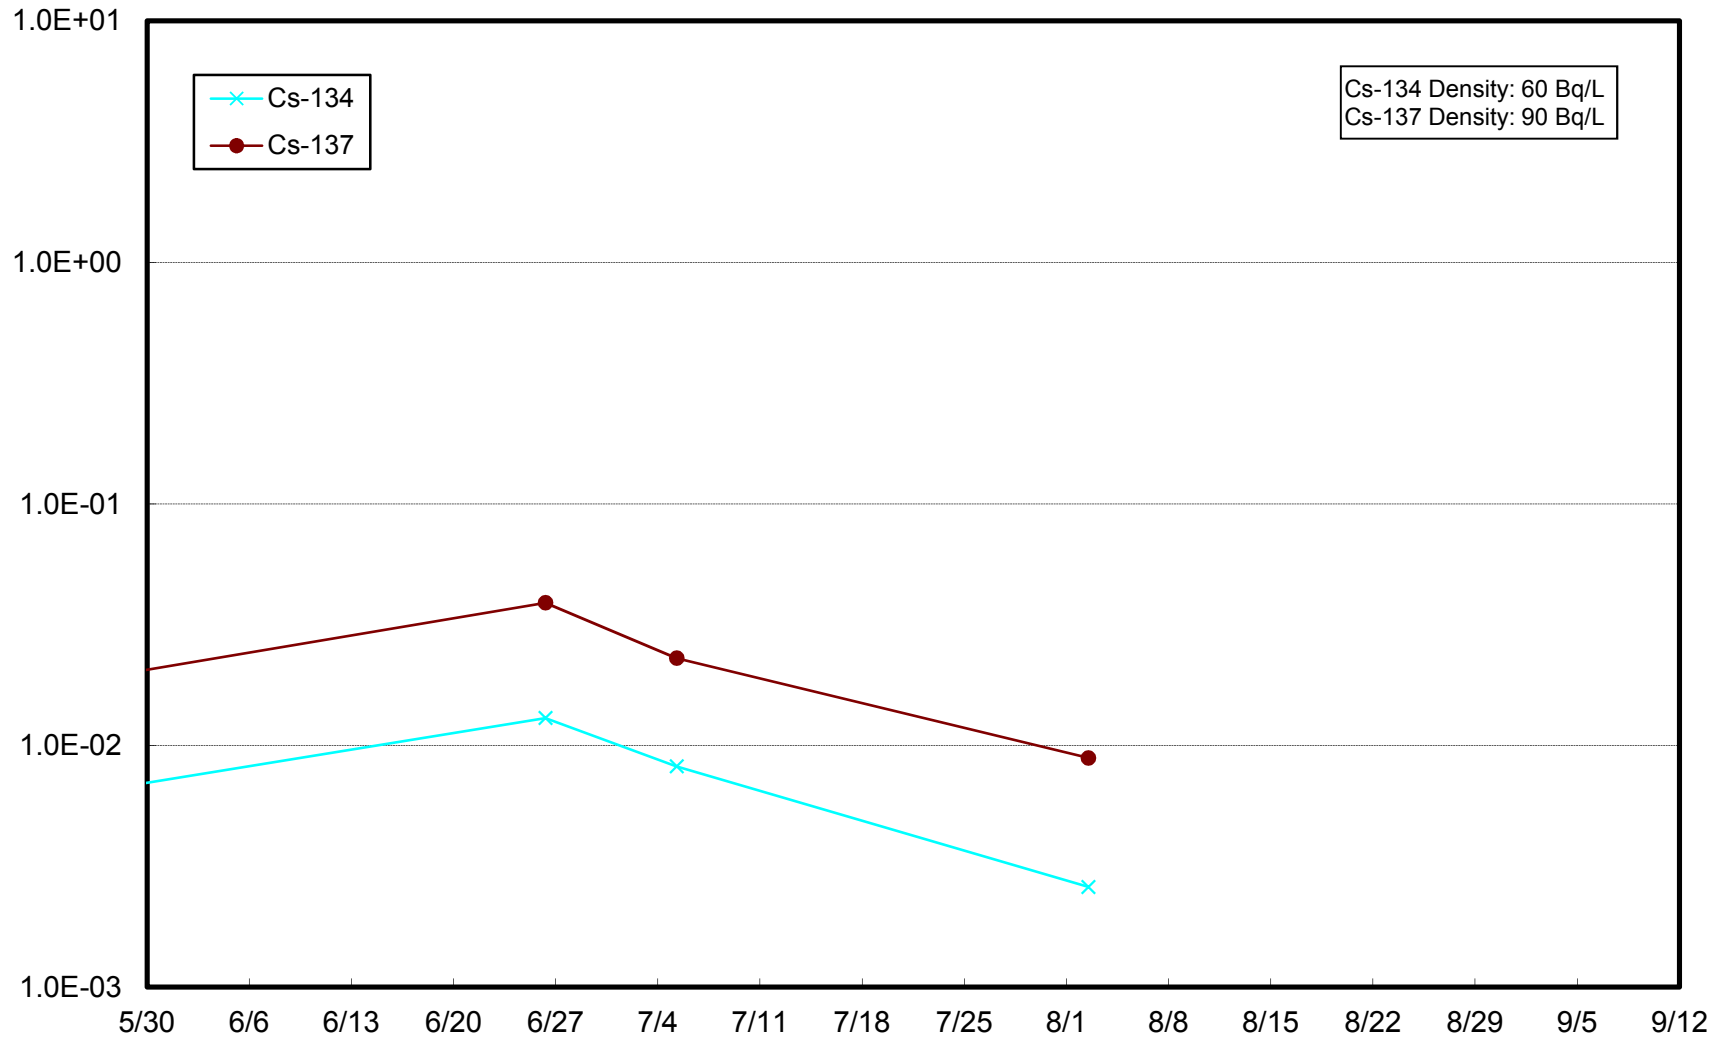


Radioactivity Density of the Seawater at 1km Offshore of Natsui River (T-17-1) Lower Layer (Bq/L)

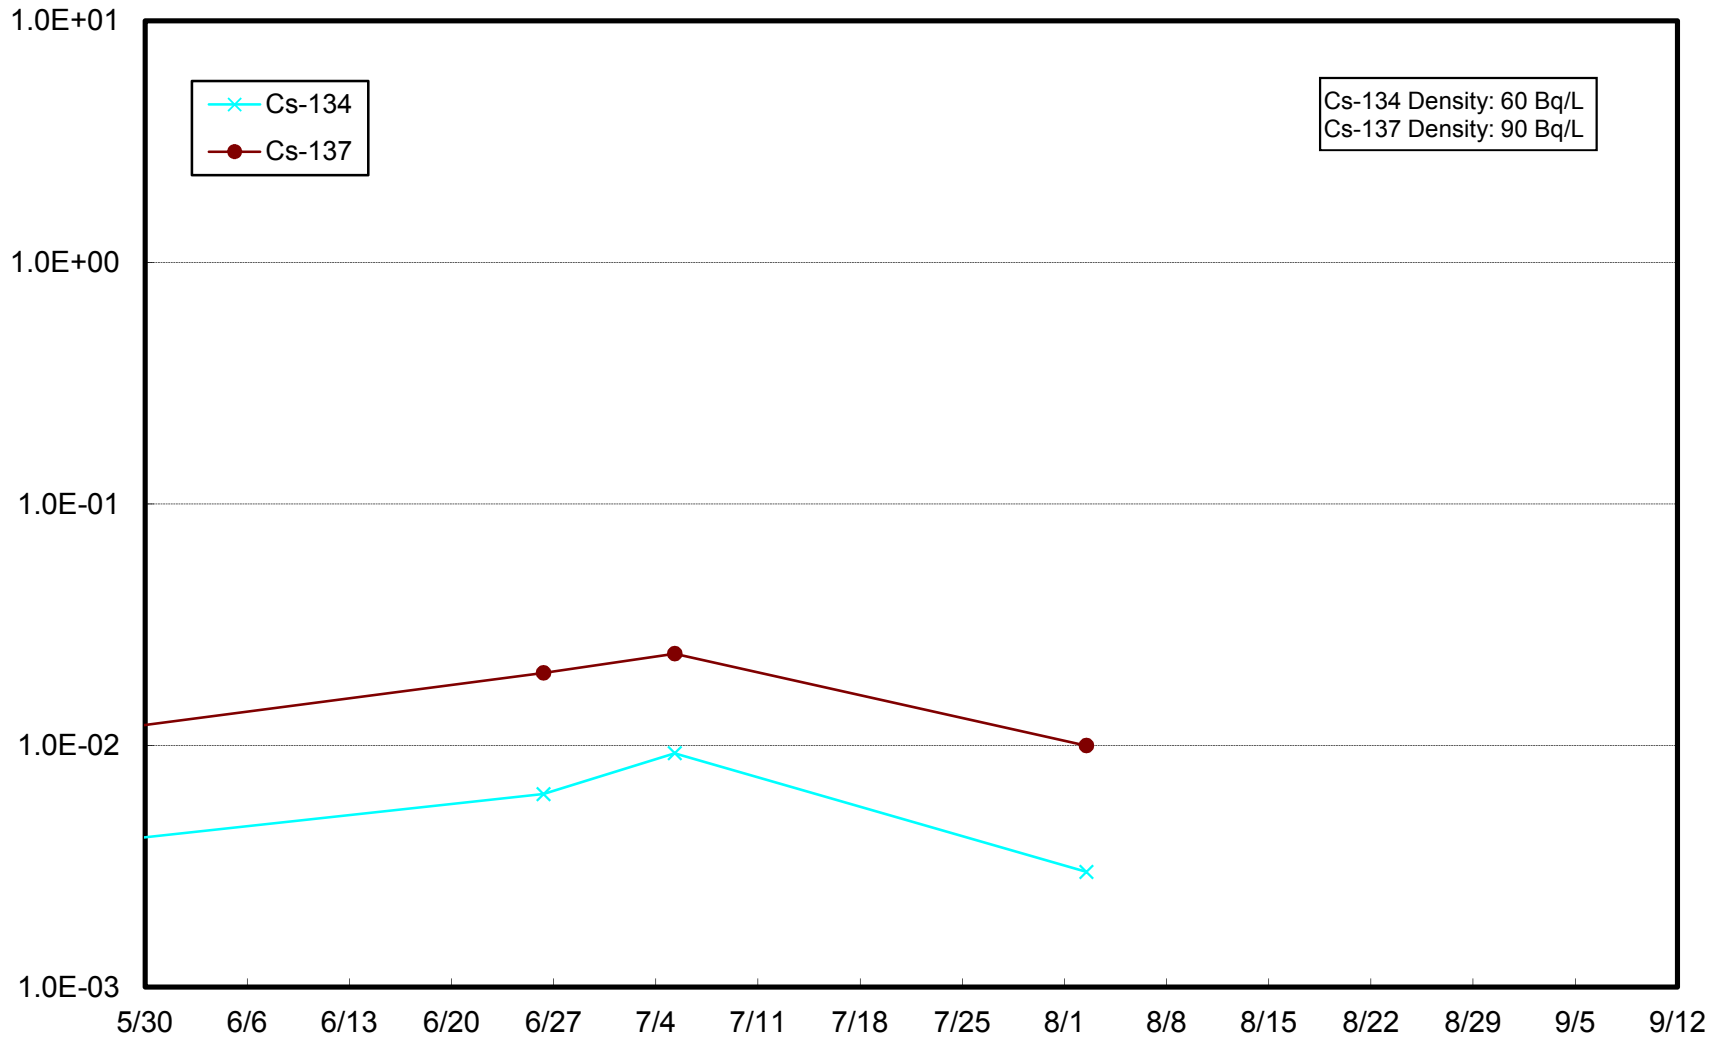


Radioactivity Density of the Seawater at 3km Offshore of Toyoma (T-20) Upper Layer (Bq/L)

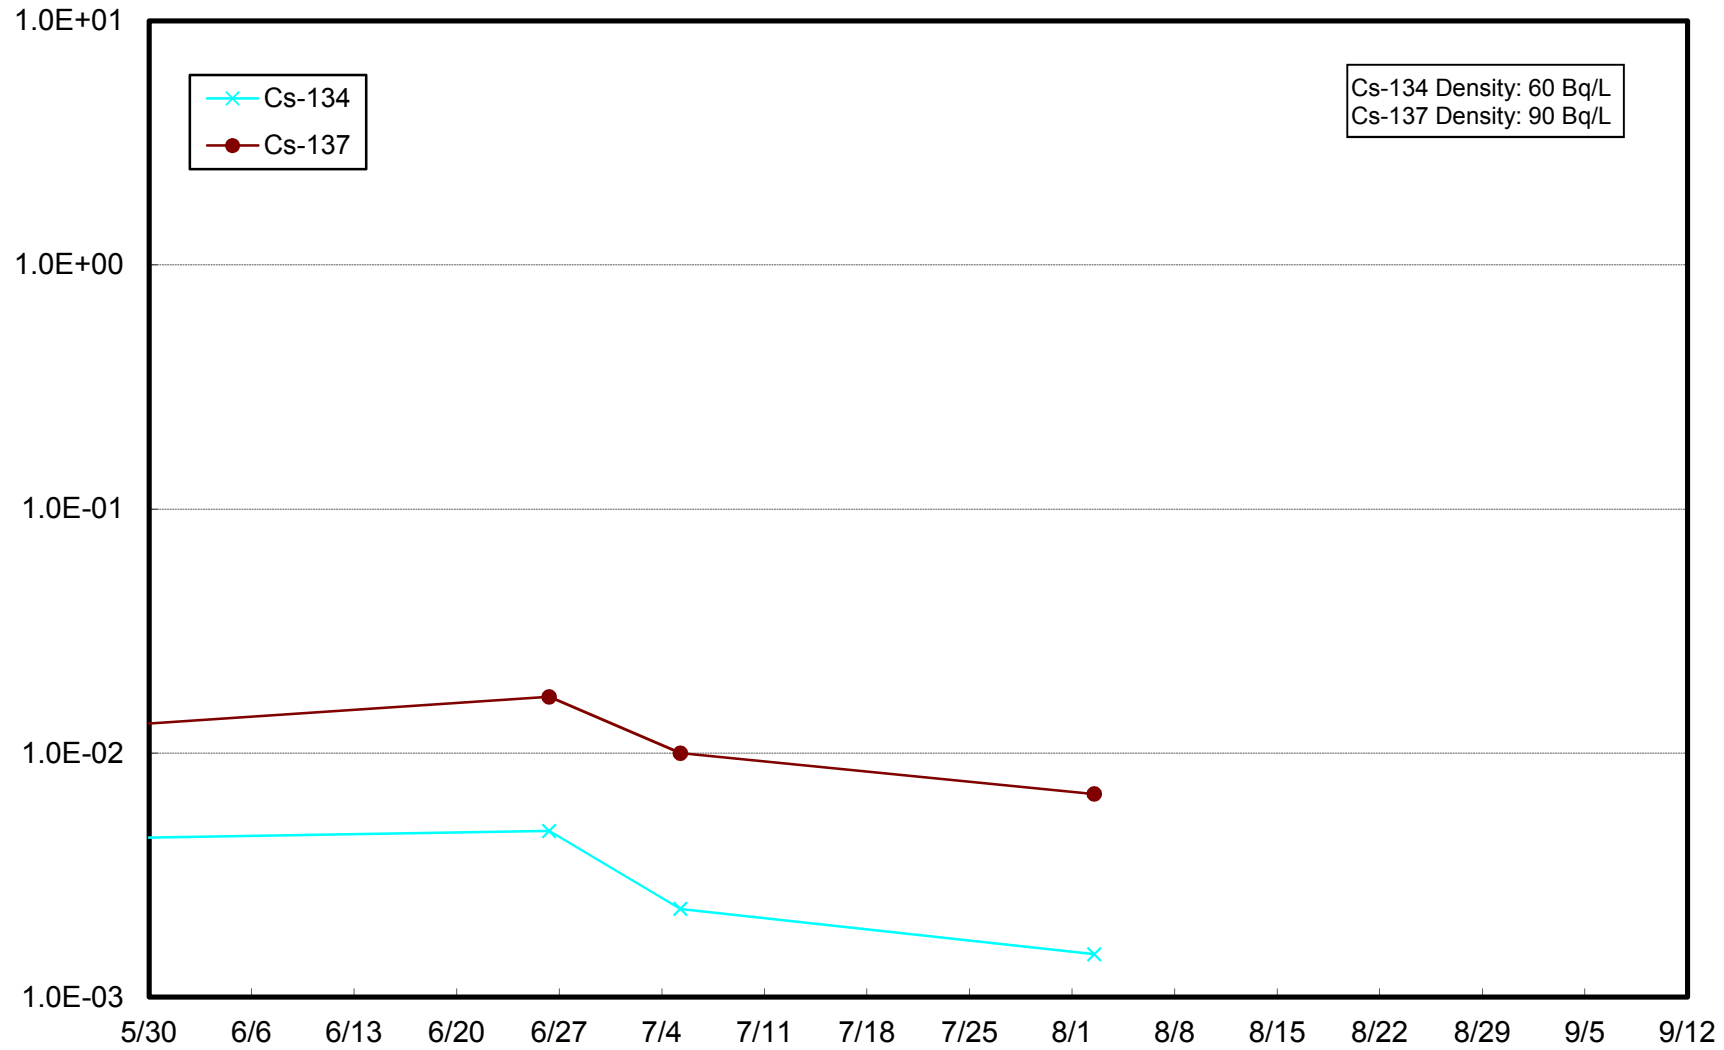


Radioactivity Density of the Seawater at 3km Offshore of Toyoma (T-20) Upper Layer (Bq/L)

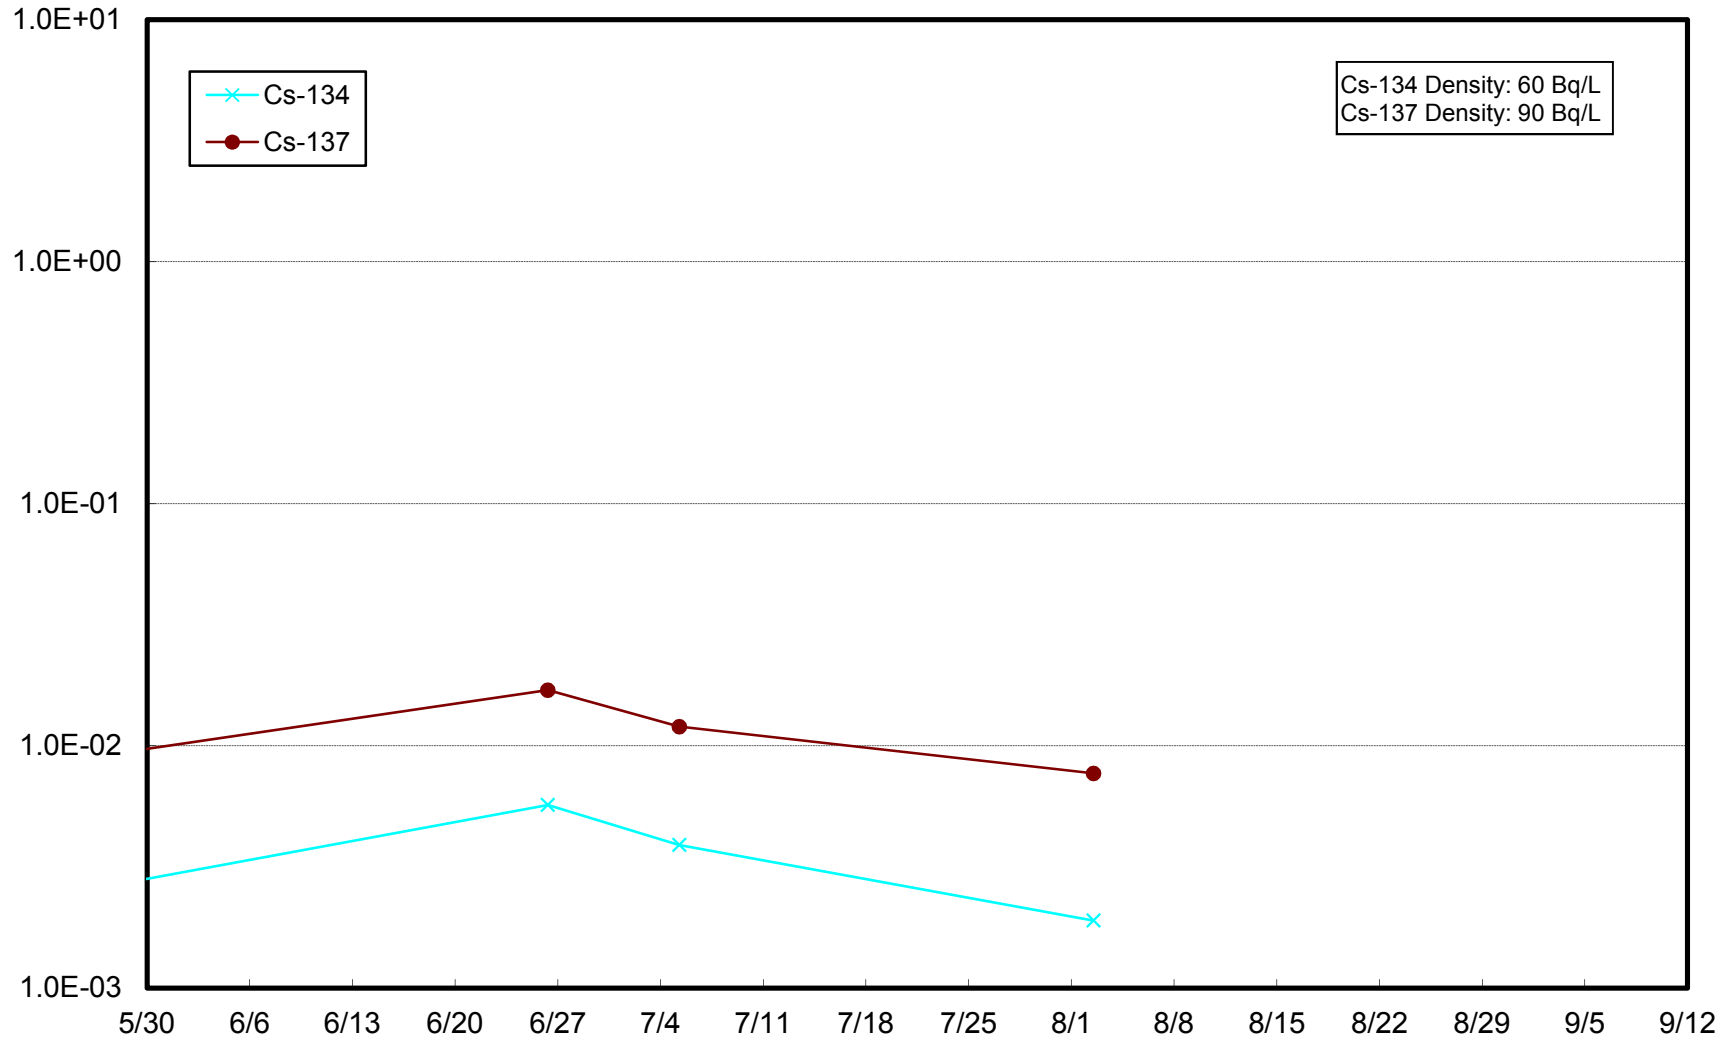


Radioactivity Density of the Seawater at 1km Offshore of Nida River (T-13-1) Upper Layer (Bq/L)

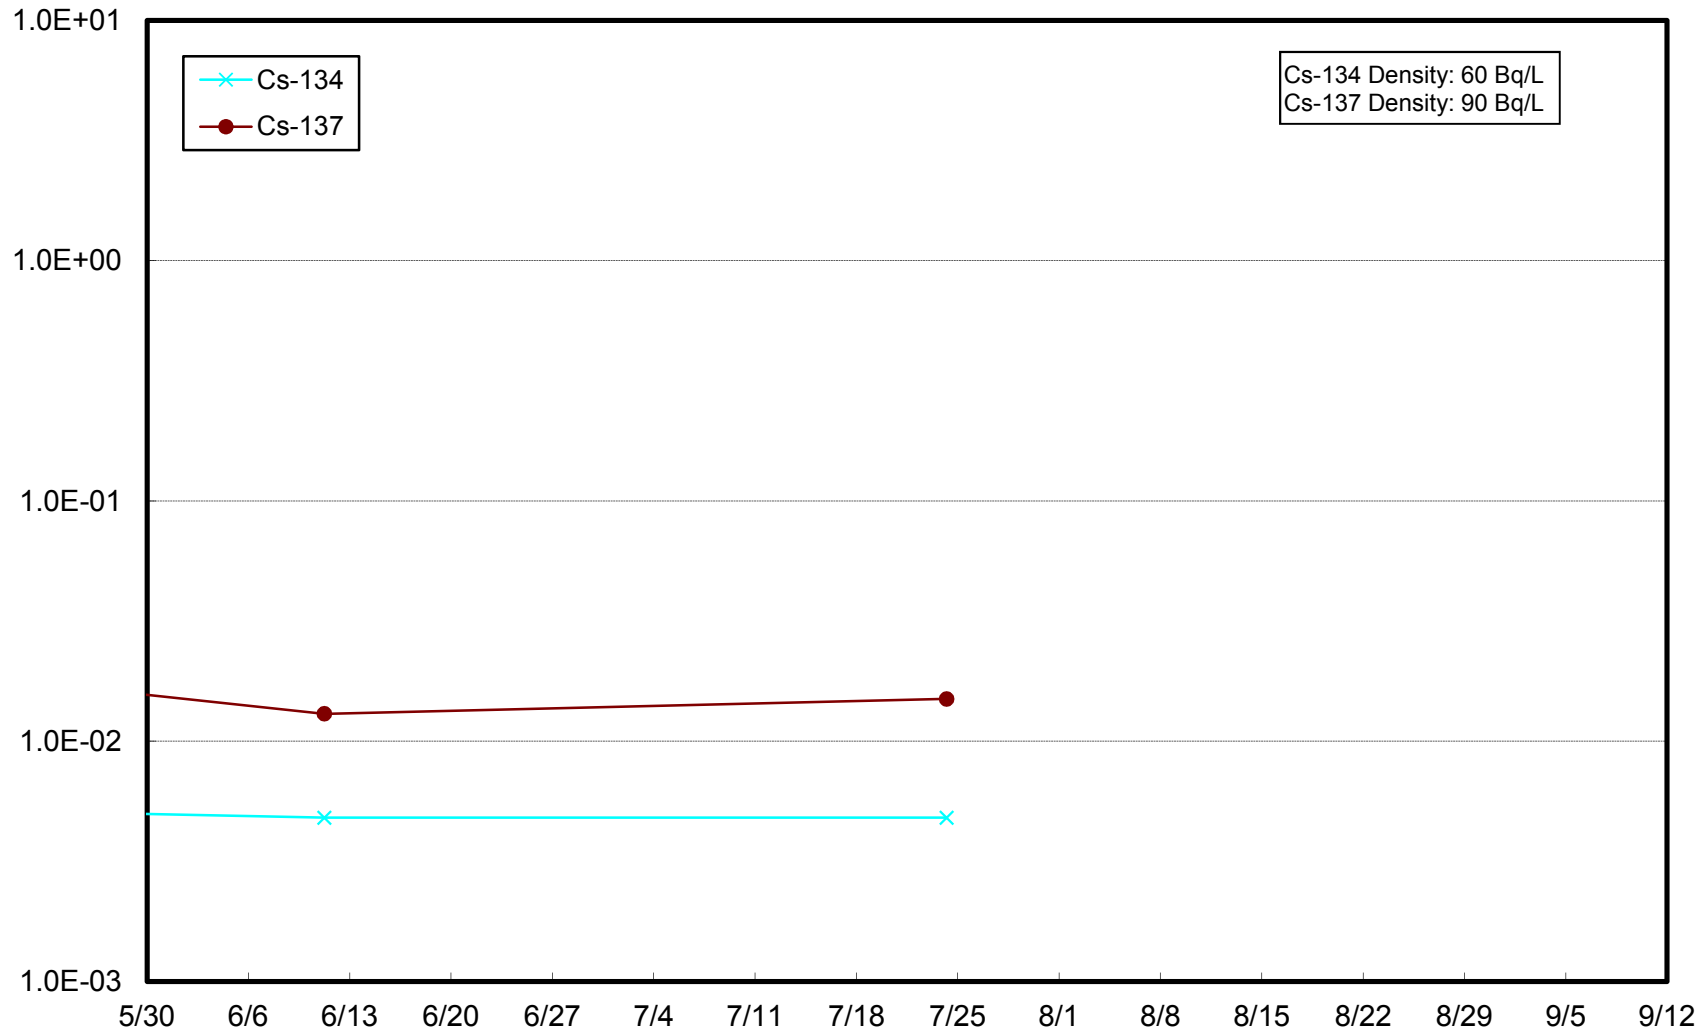


Radioactivity Density of the Seawater at 1km Offshore of Nida River (T-13-1) Lower Layer (Bq/L)

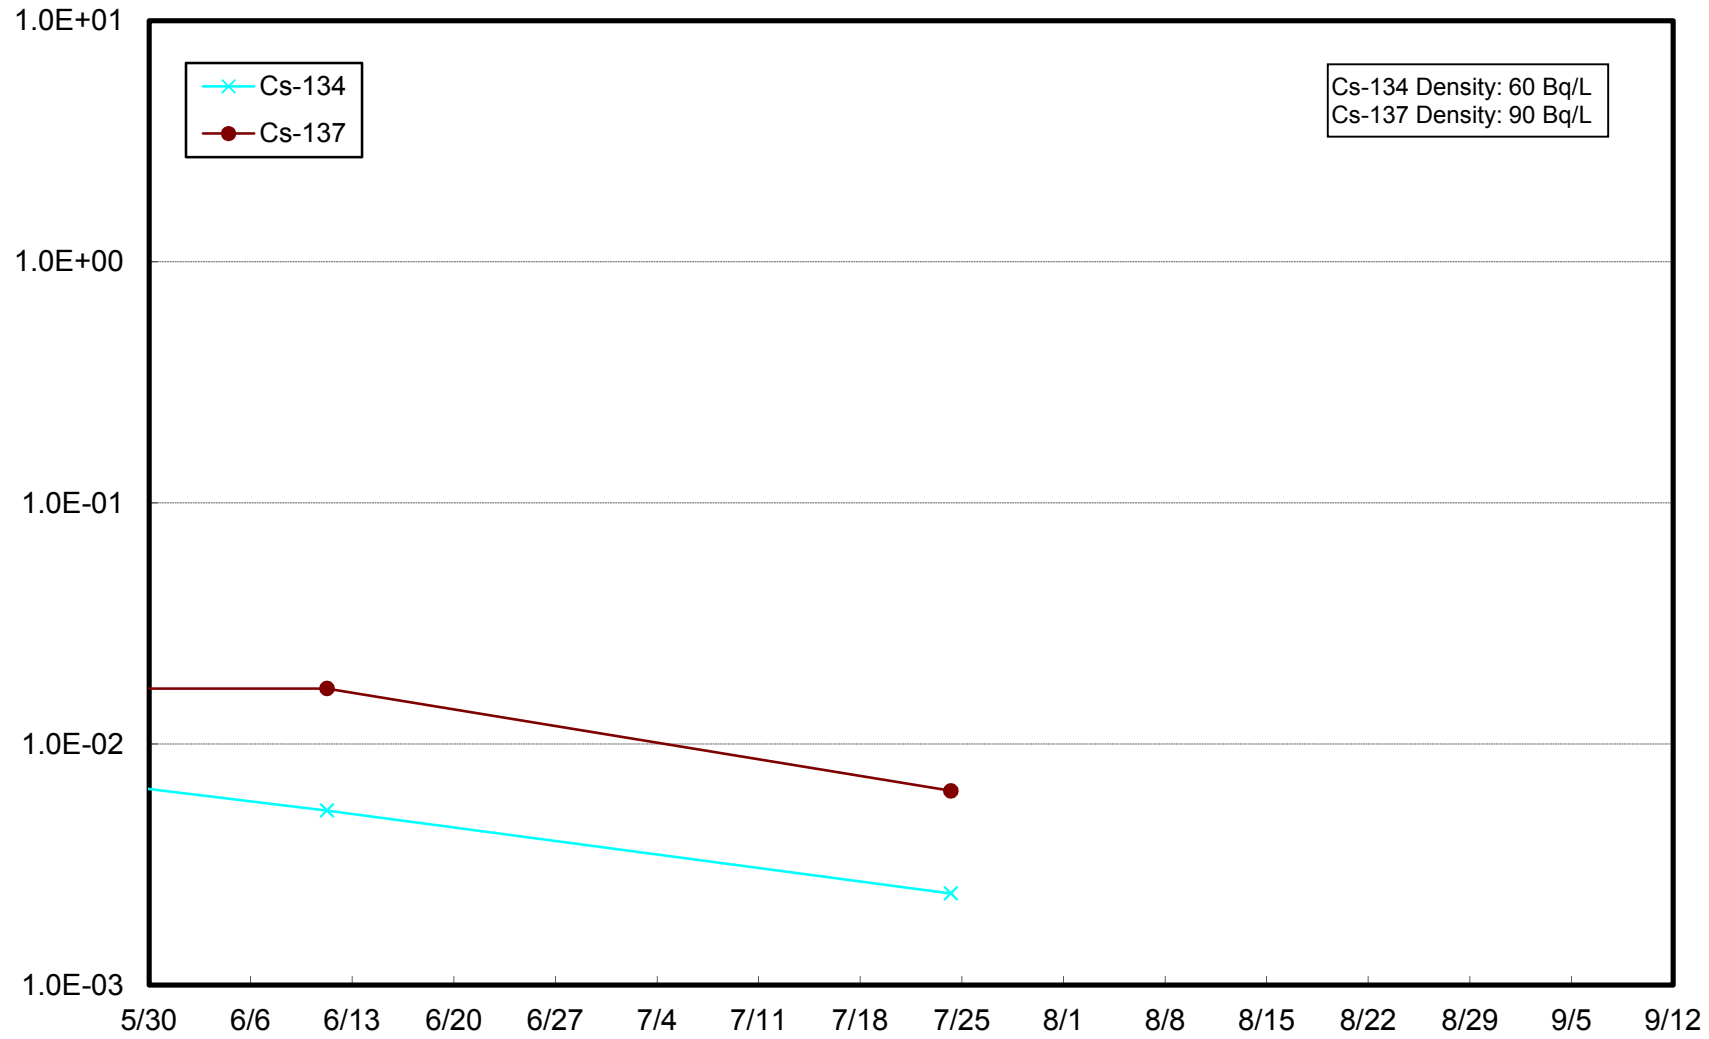


Radioactivity Density of the Seawater at 3km Offshore of Soma (T-22) Upper Layer (Bq/L)

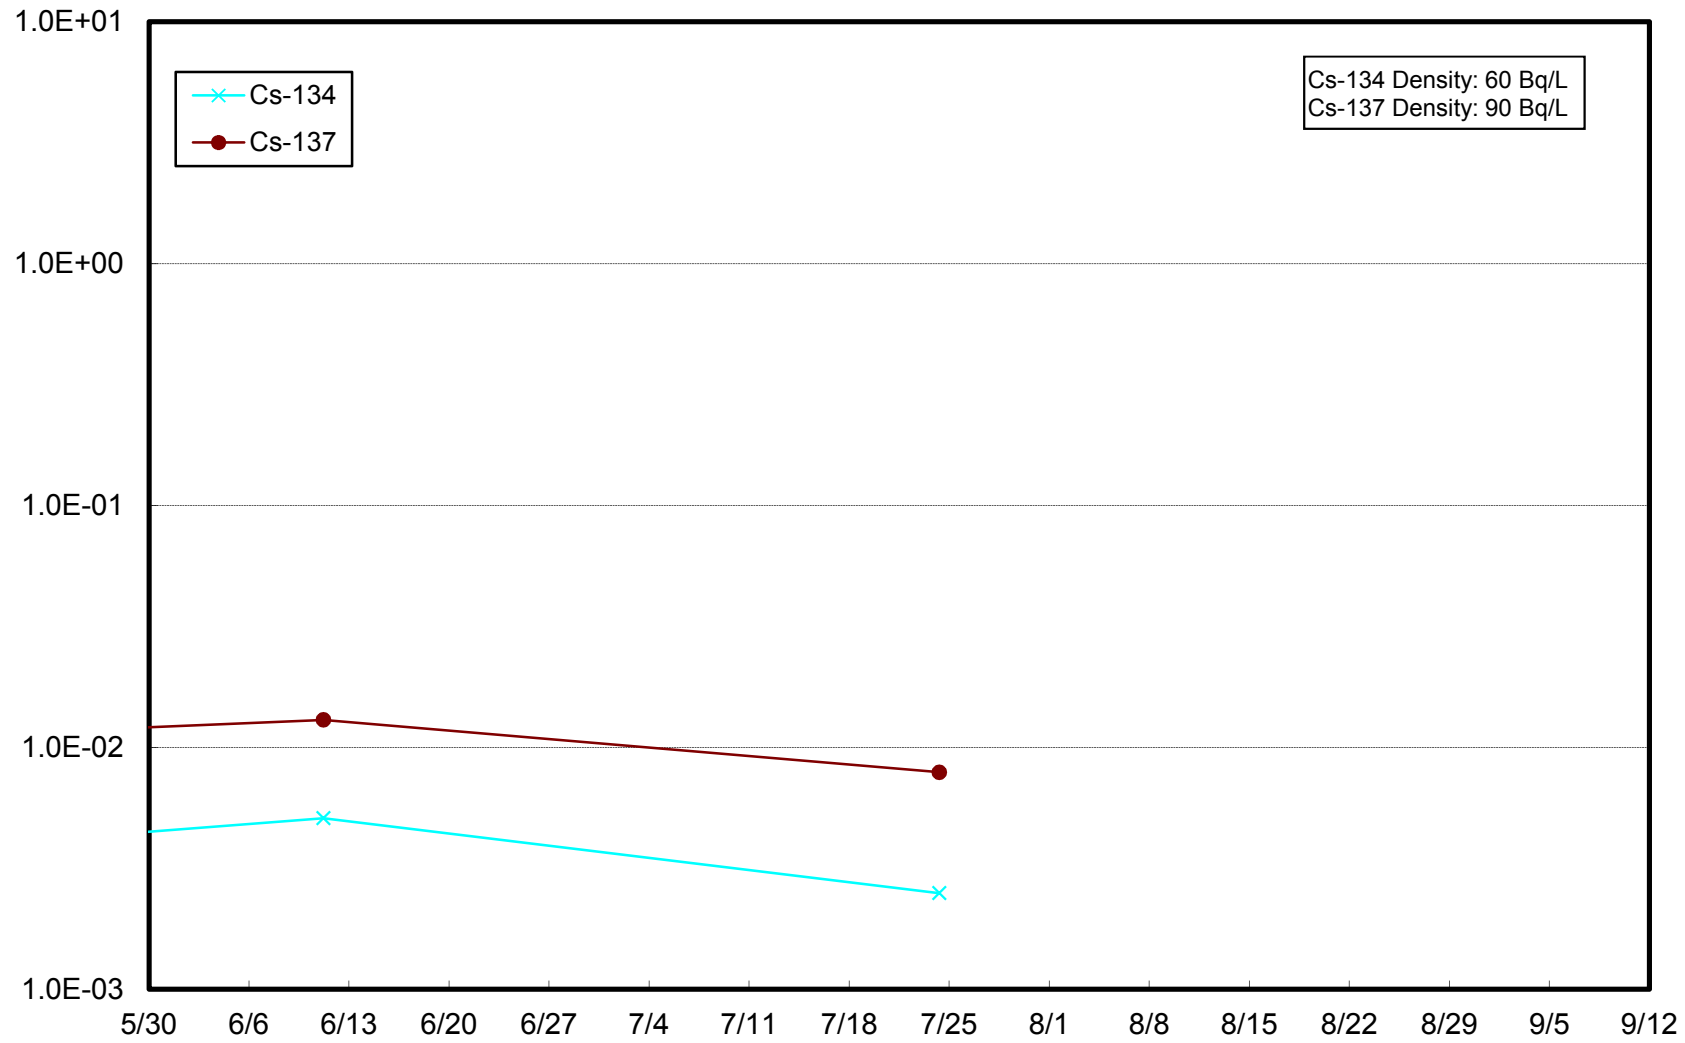


Radioactivity Density of the Seawater at 3km Offshore of Soma (T-22) Lower Layer (Bq/L)

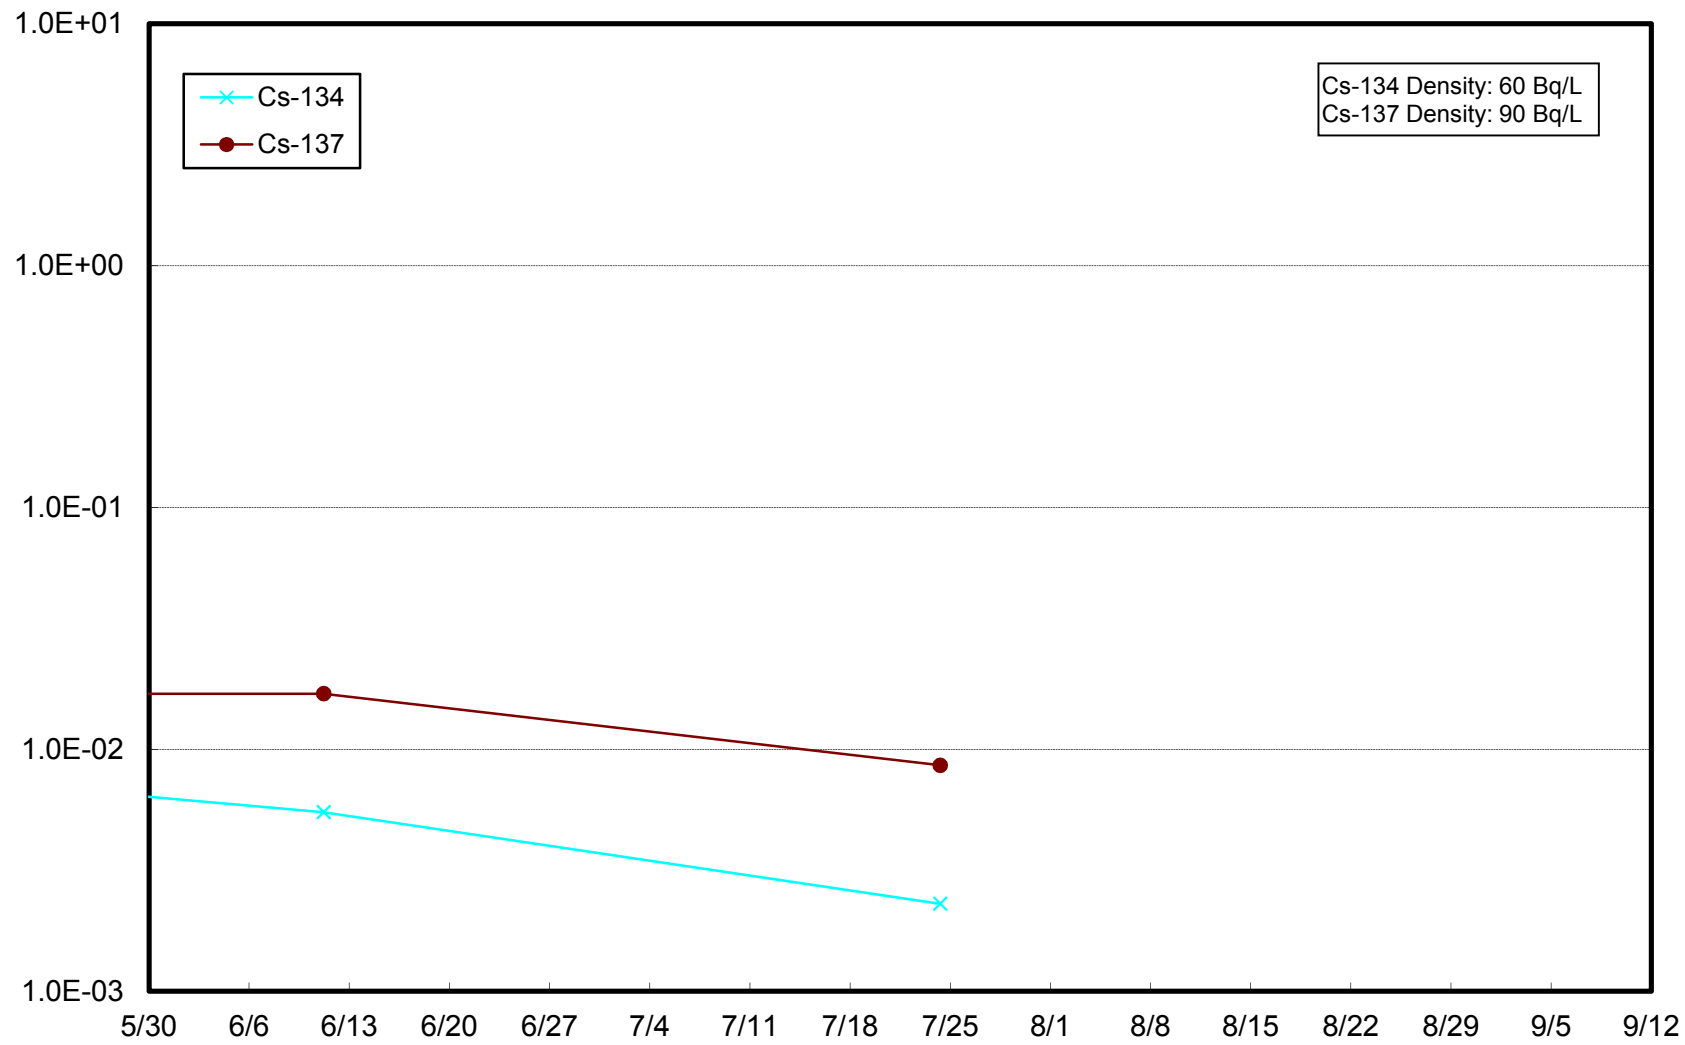


Radioactivity Density of the Seawater at 5km Offshore of Kashima (T-MA) Upper Layer (Bq/L)

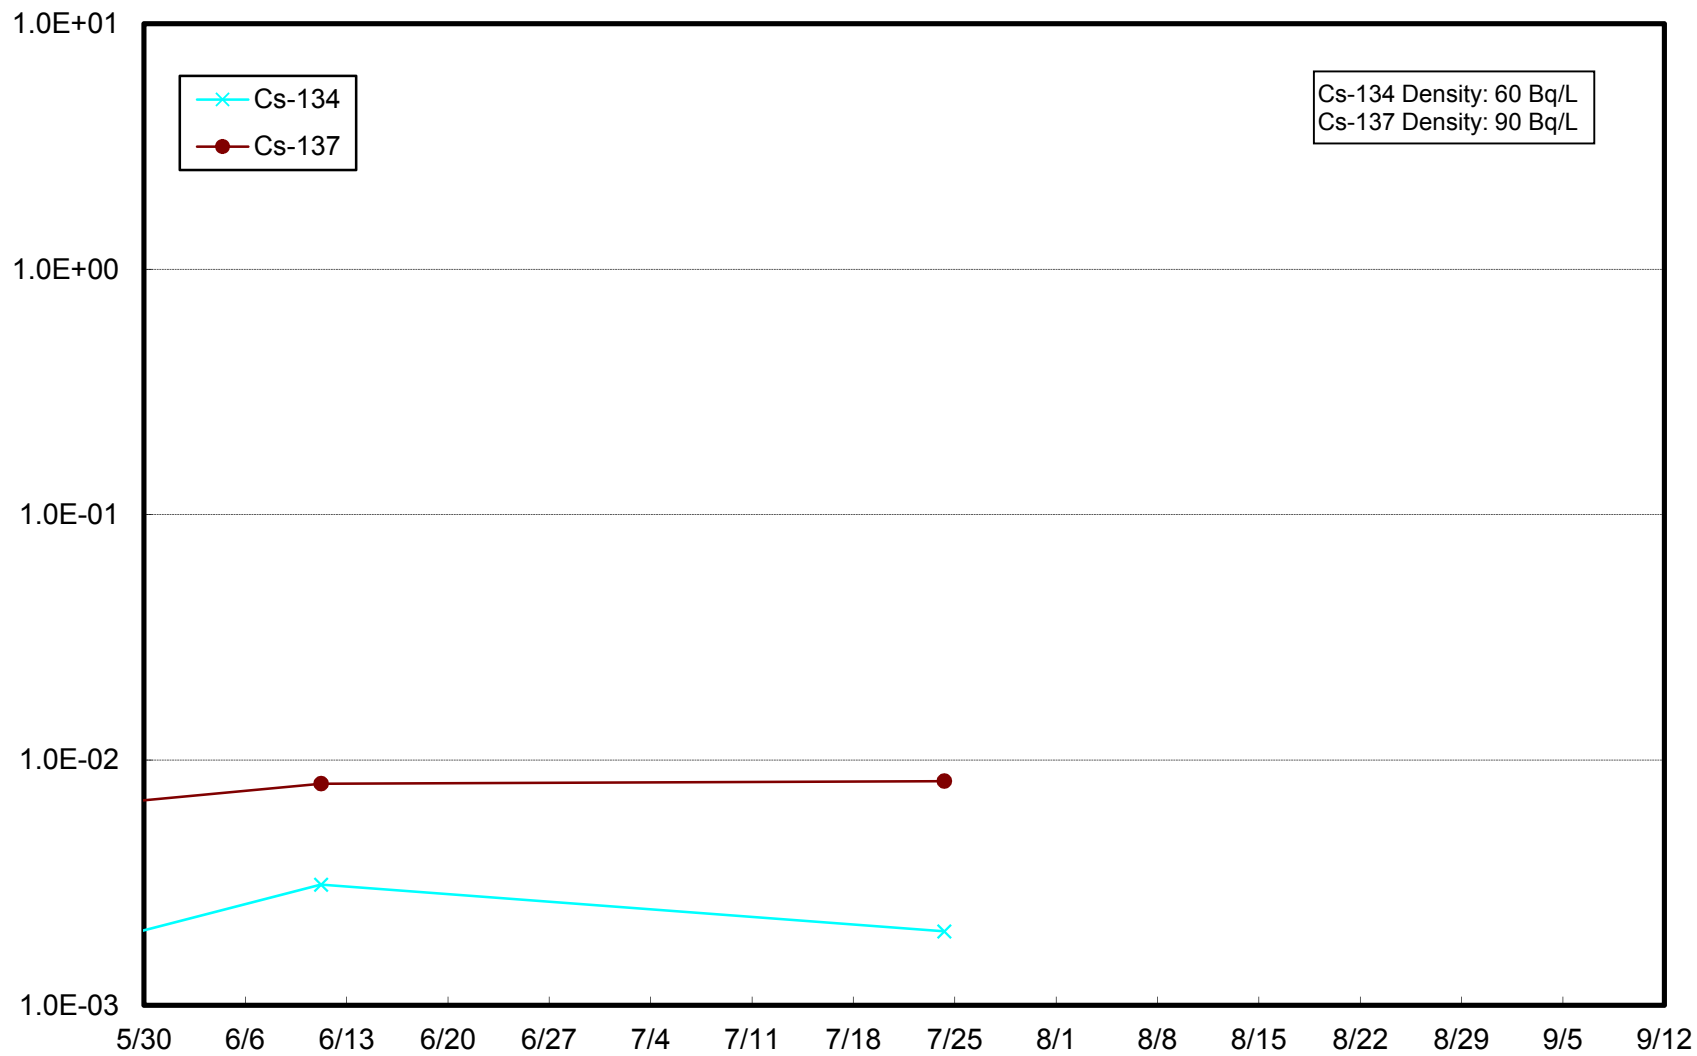


Radioactivity Density of the Seawater at 5km Offshore of Kashima (T-MA) Lower Layer (Bq/L)

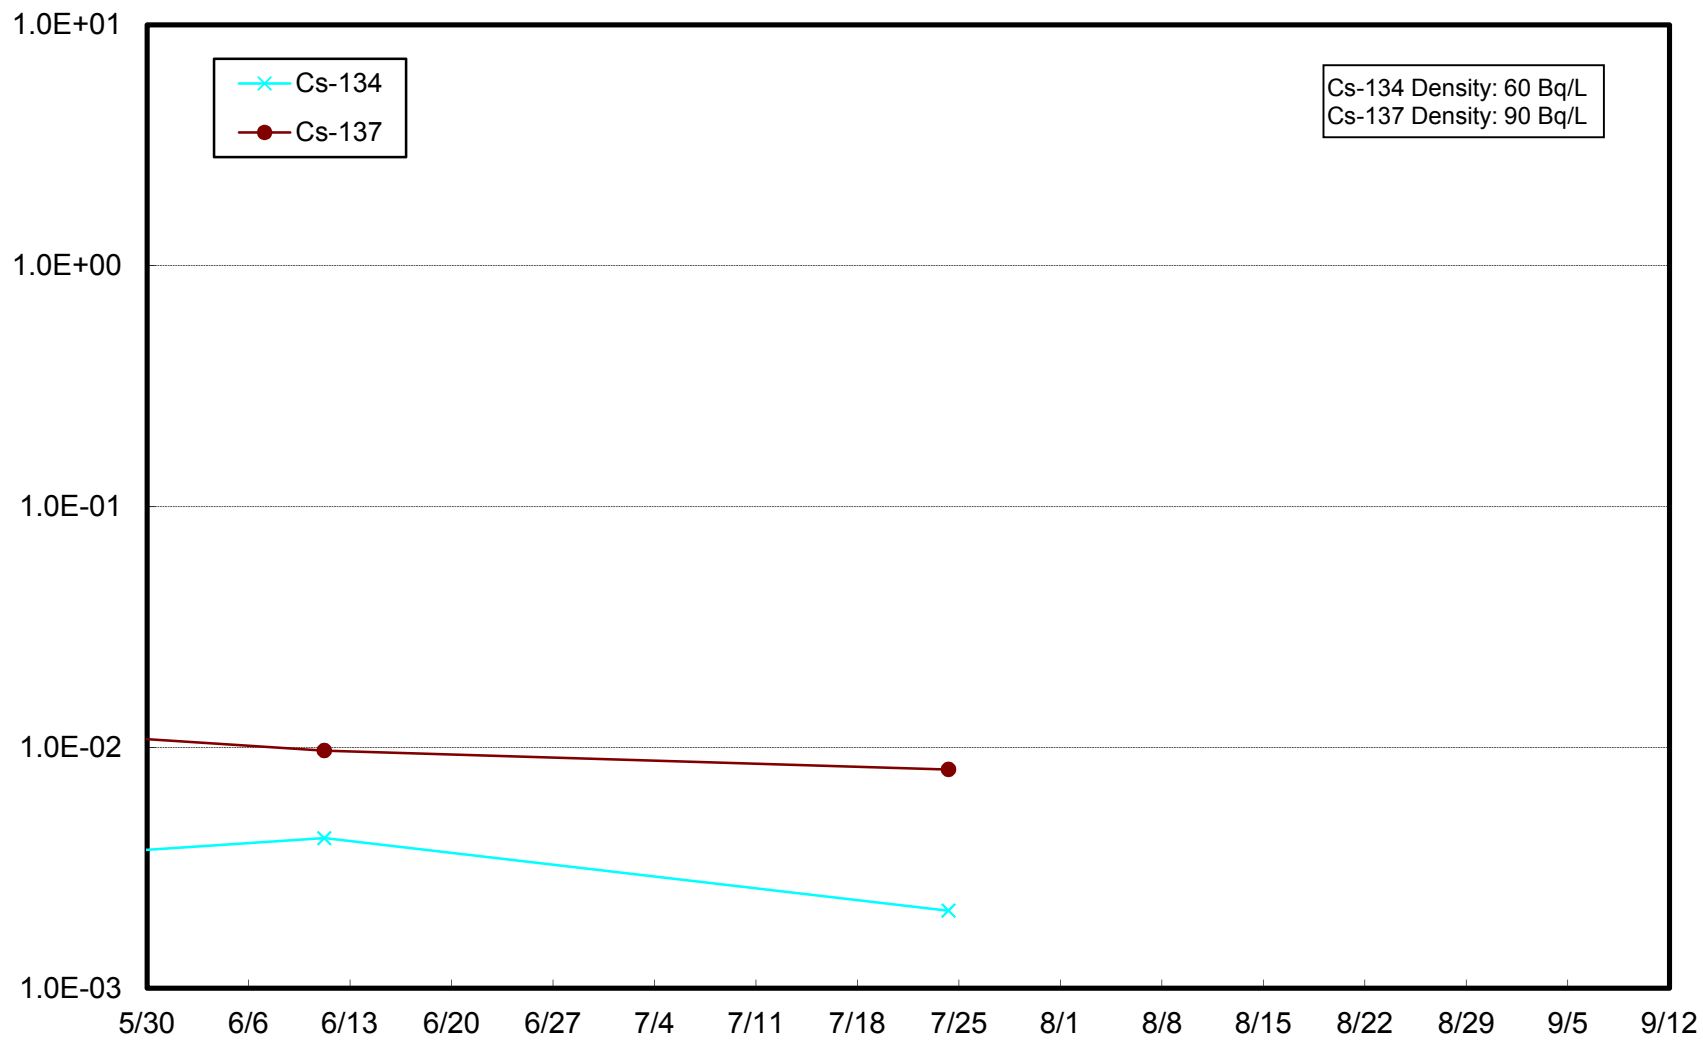


Radioactivity Density of the Seawater Around 1km Offshore of Ota River (T-S1) Upper Layer (Bq/L)

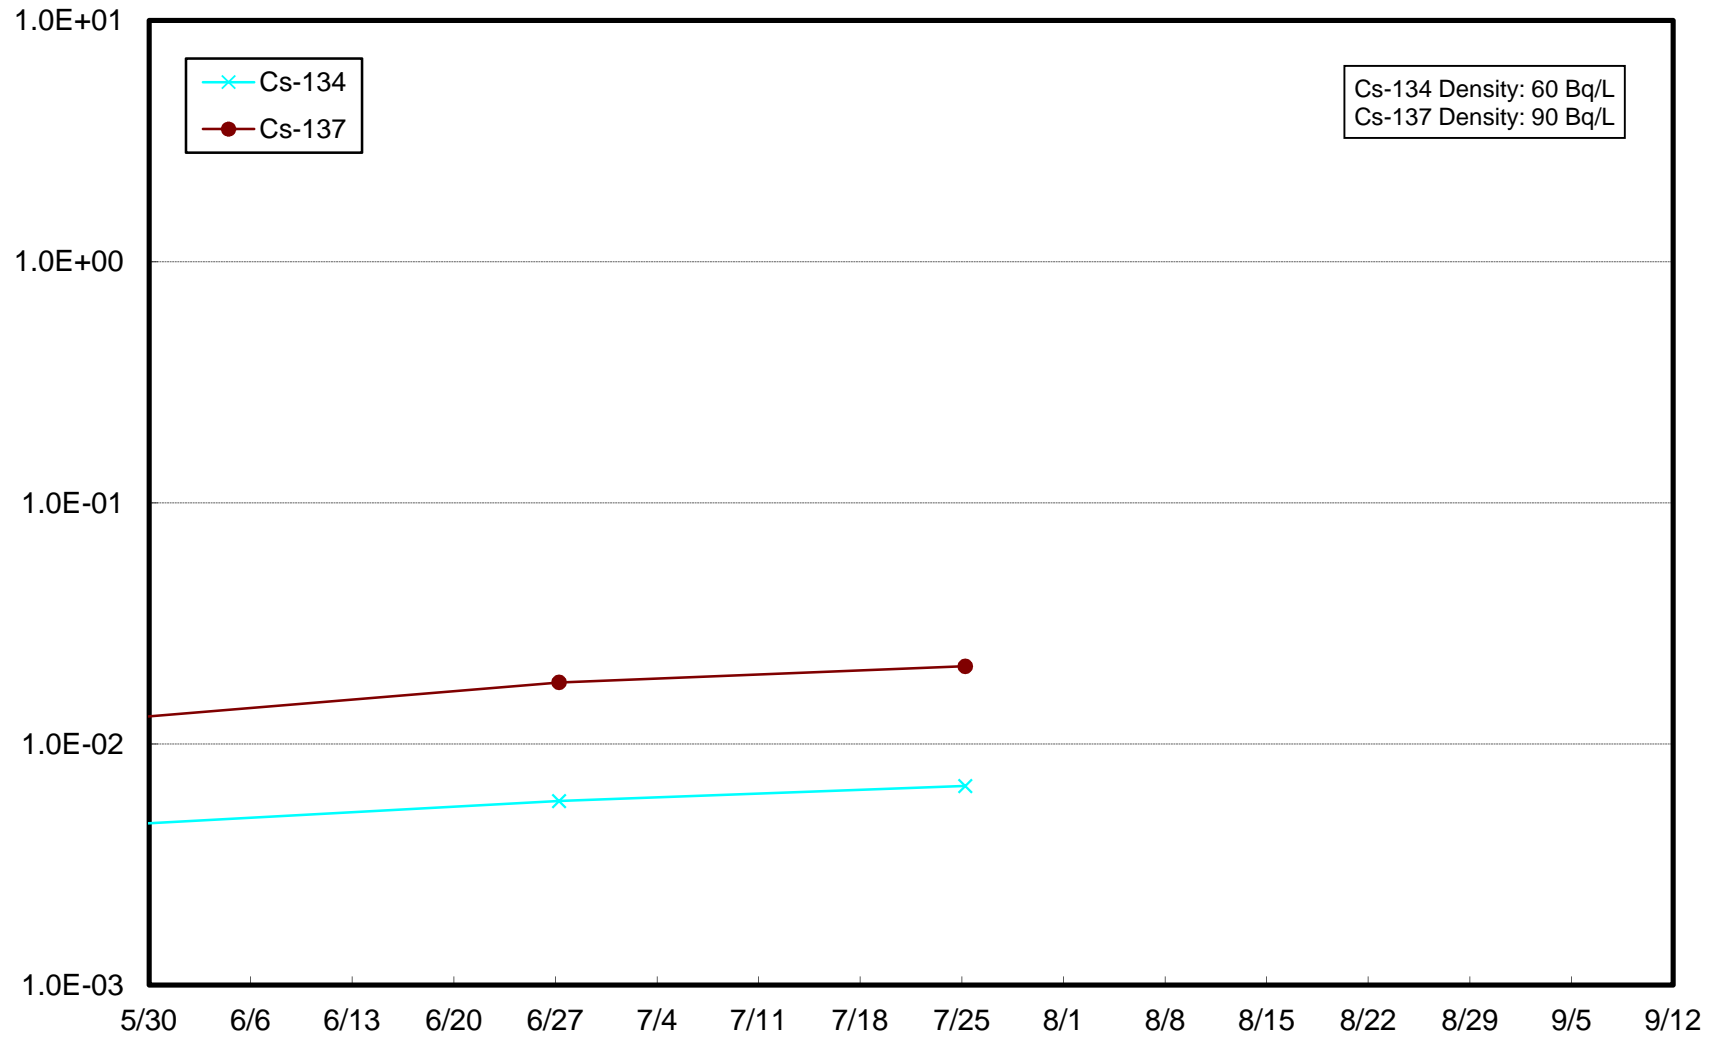


Radioactivity Density of the Seawater Around 1km Offshore of Ota River (T-S1) Lower Layer (Bq/L)

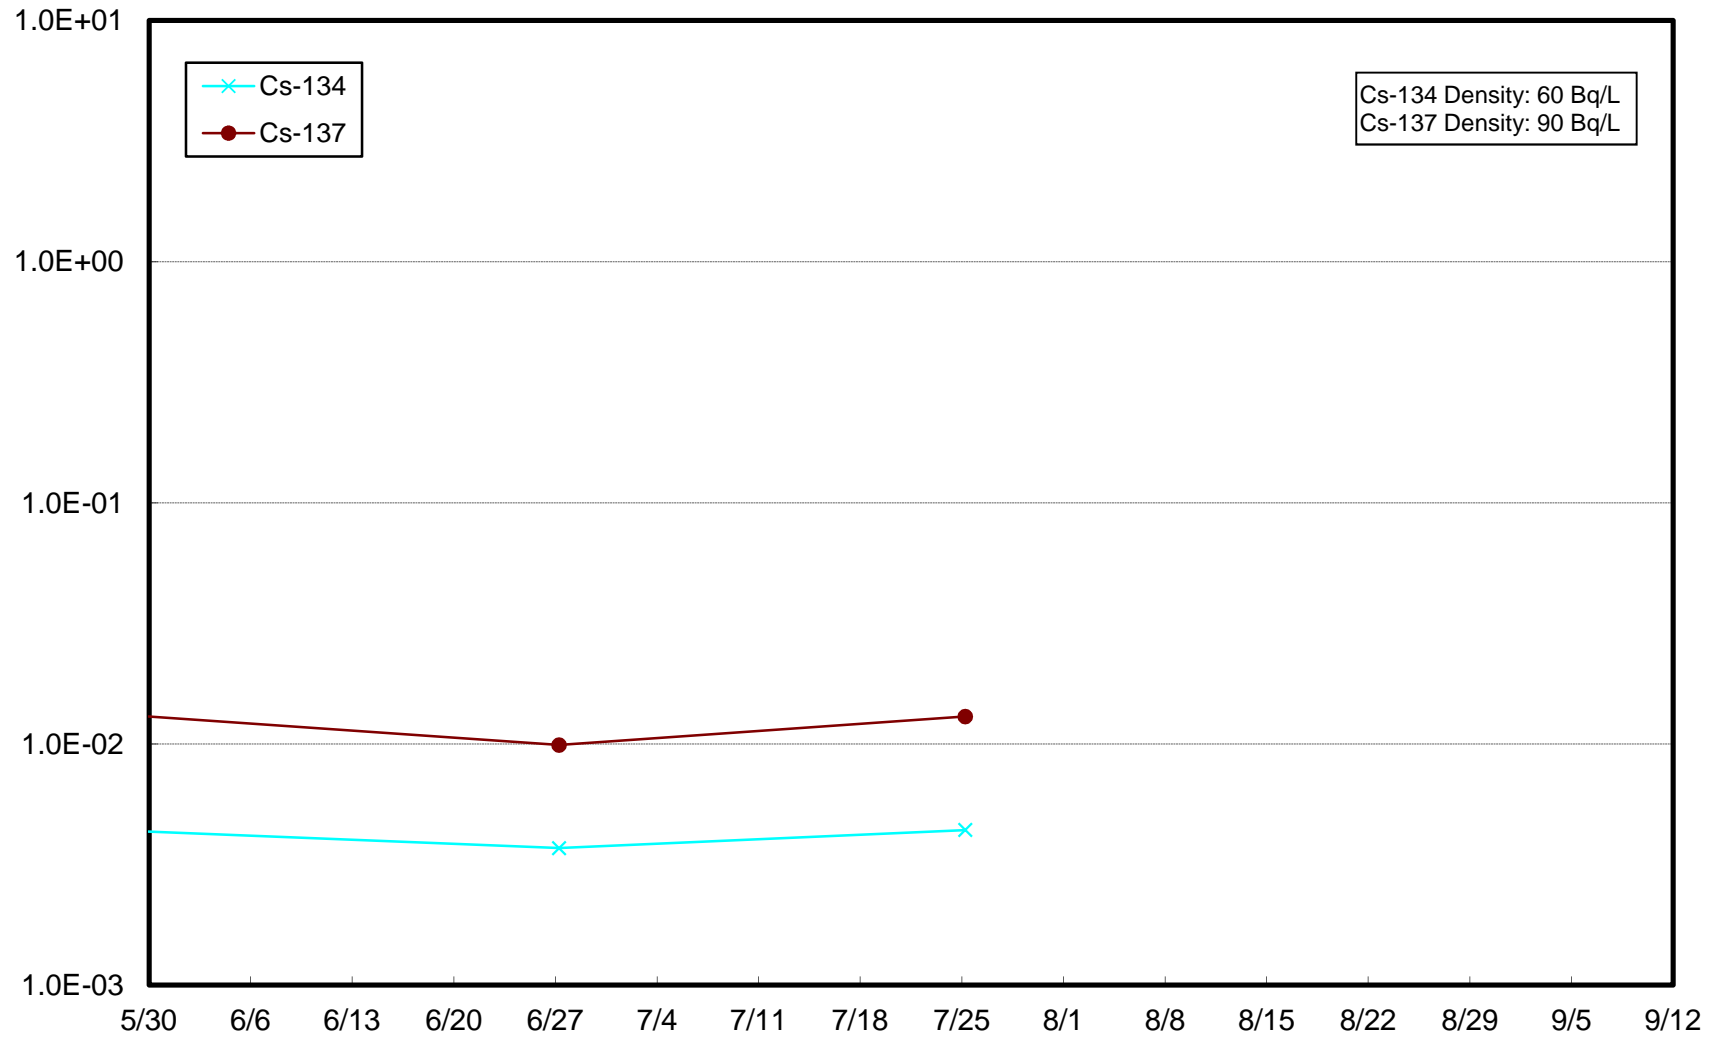


Radioactivity Density of the Seawater Around 3km Offshore of Odaka Ward (T-S2) Upper Layer (Bq/L)

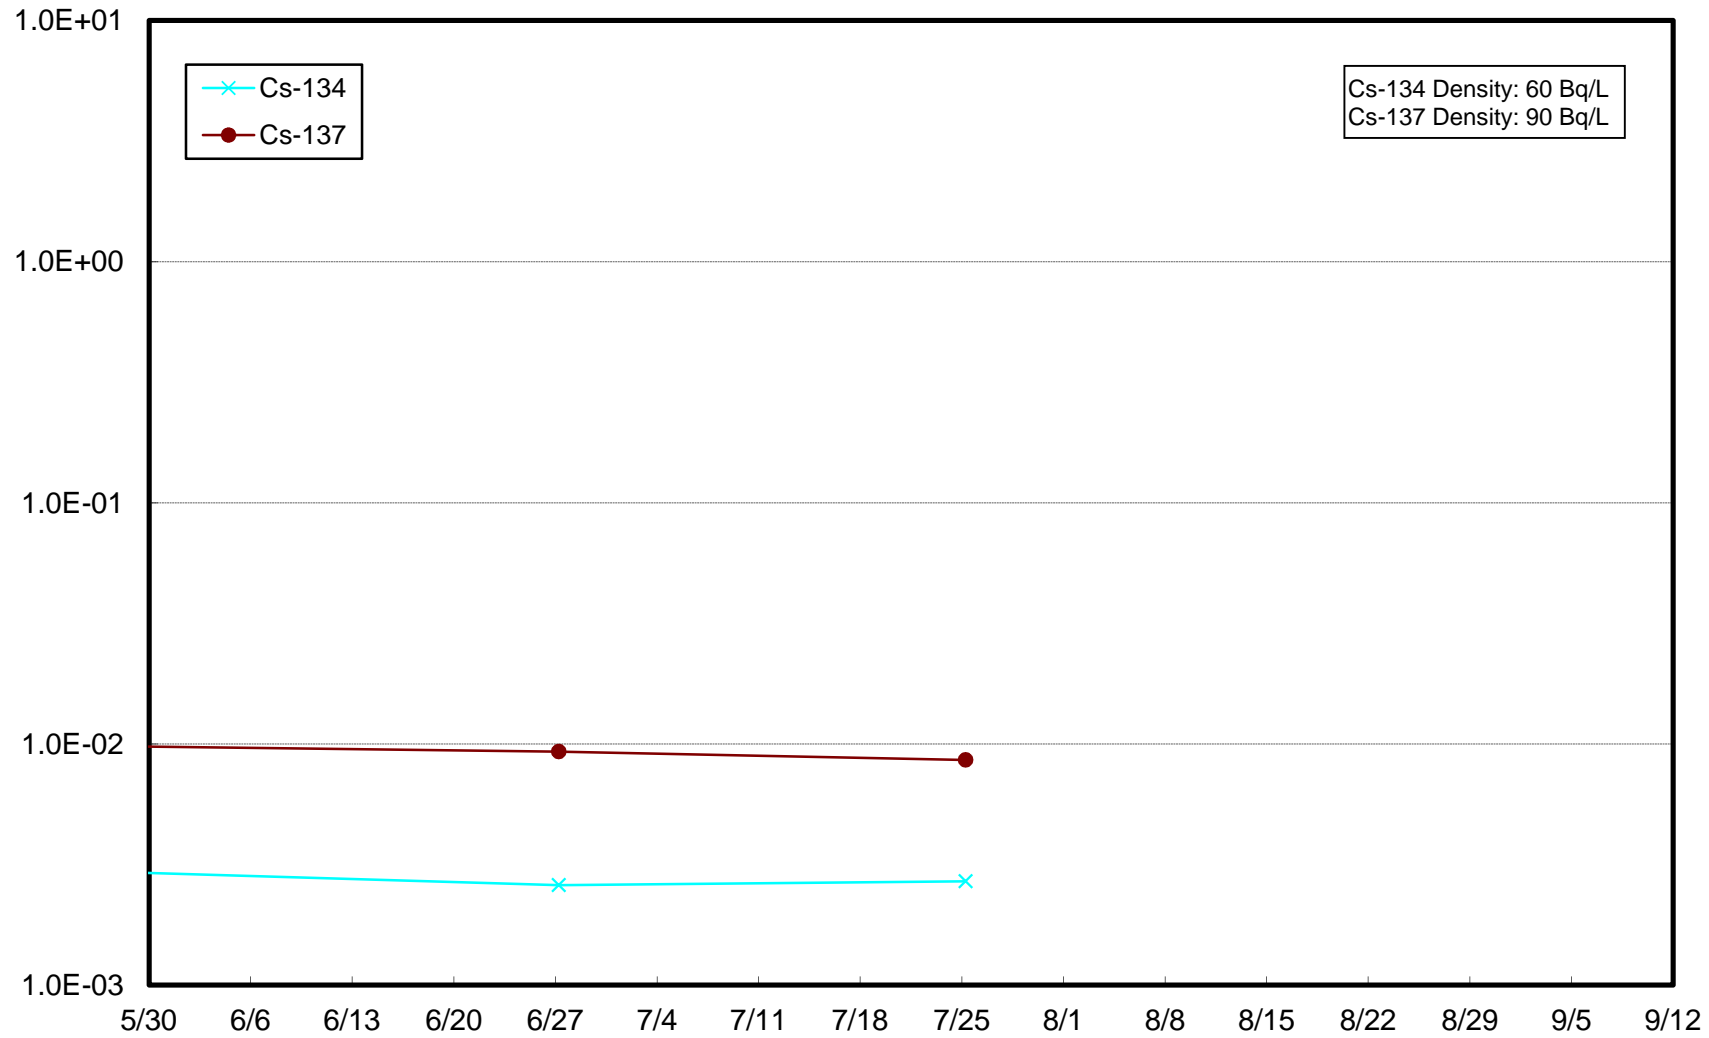


Radioactivity Density of the Seawater Around 3km Offshore of Odaka Ward (T-S2) Lower Layer (Bq/L)

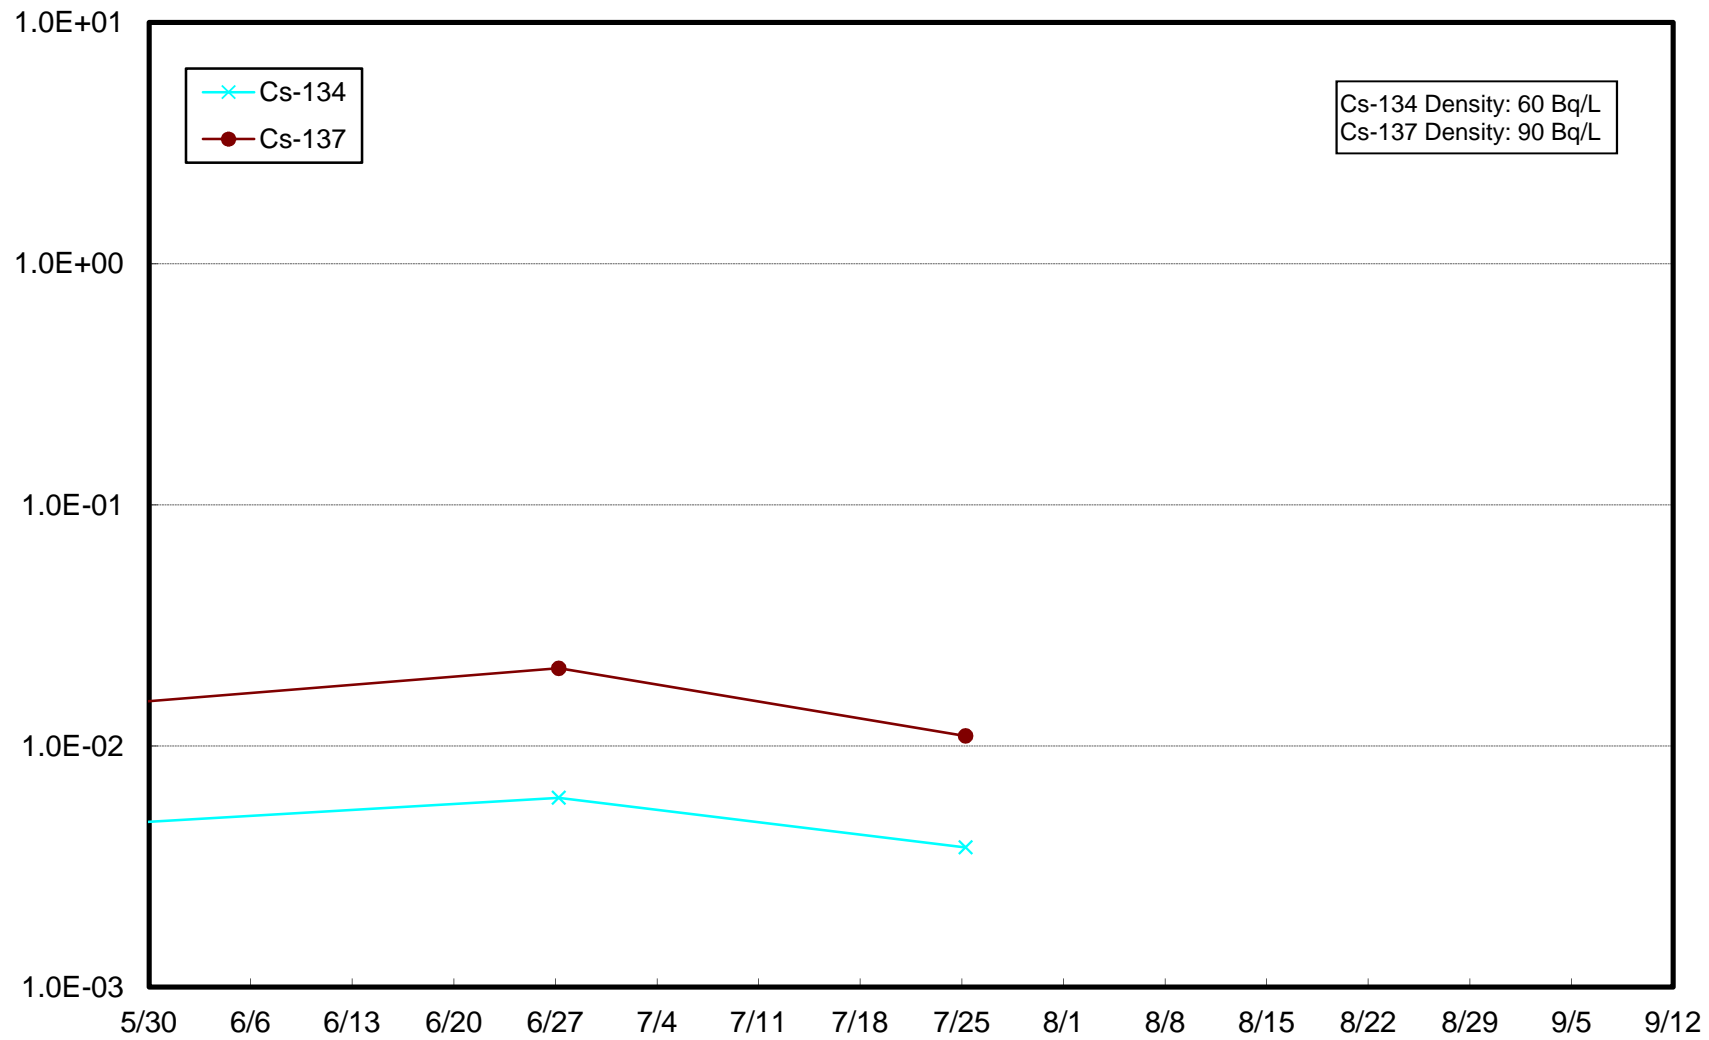


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Upper Layer (Bq/L)

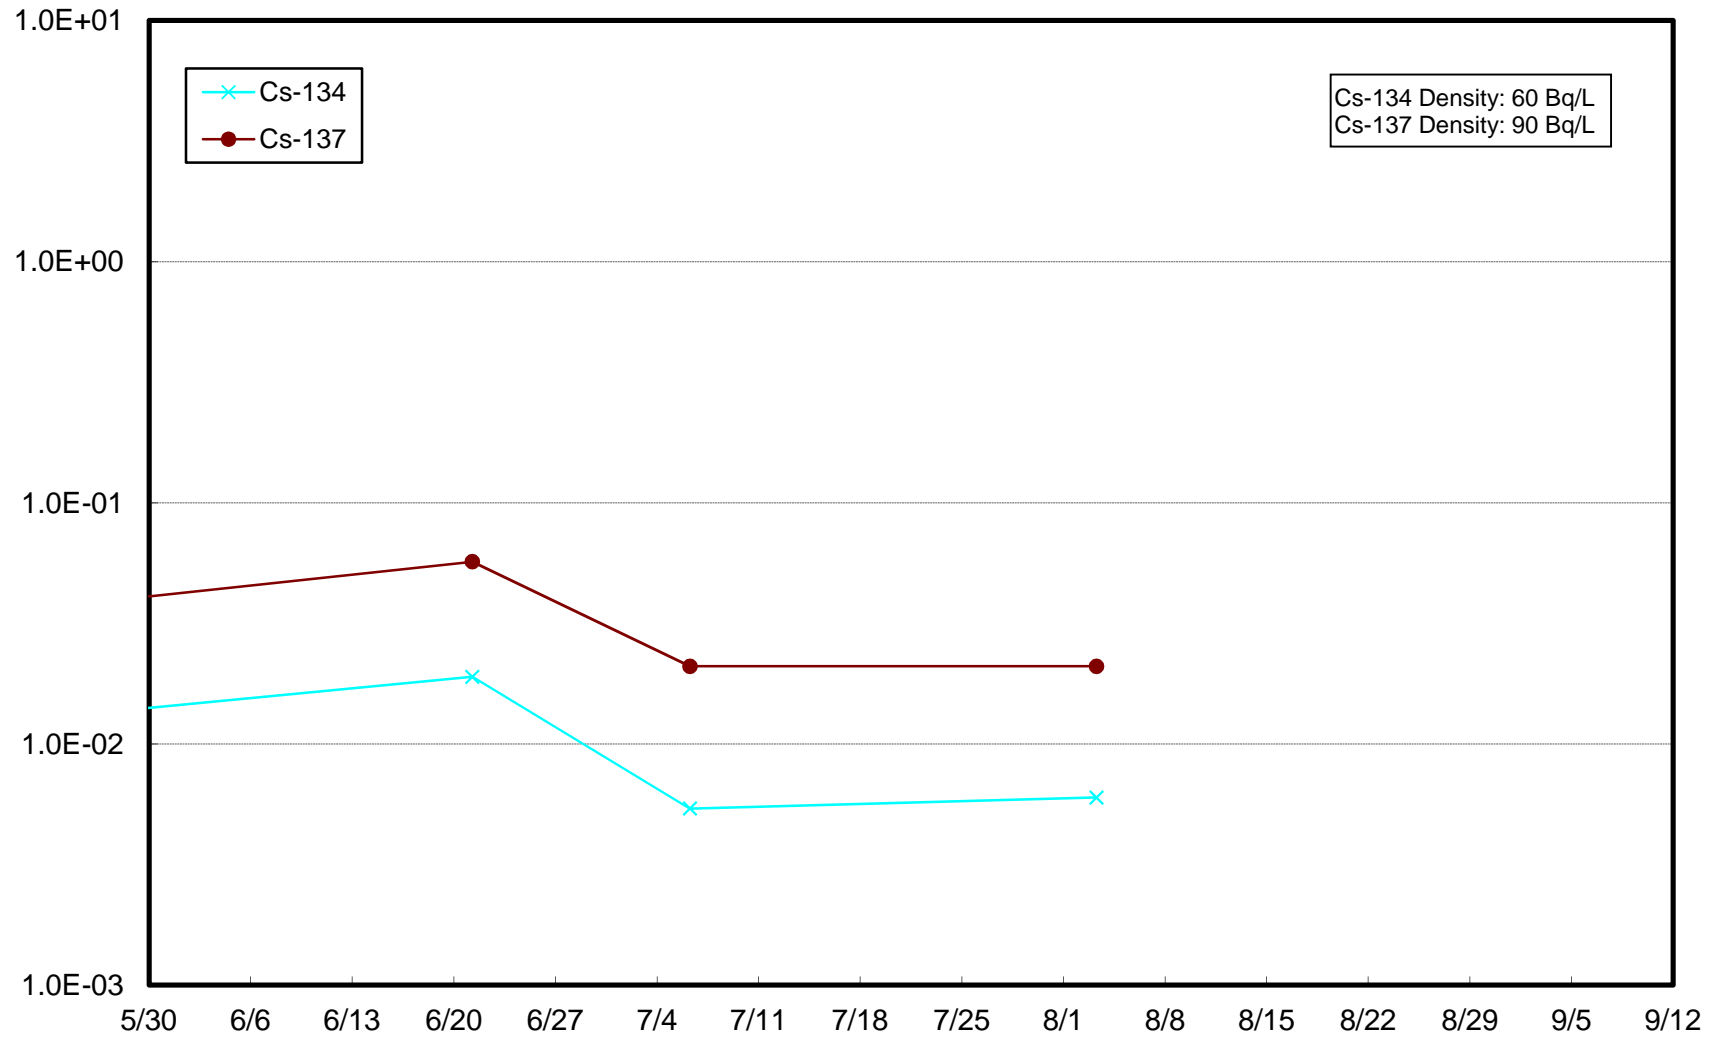


Radioactivity Density of the Seawater at 2km Offshore of Kido River (T-S5) Lower Layer (Bq/L)

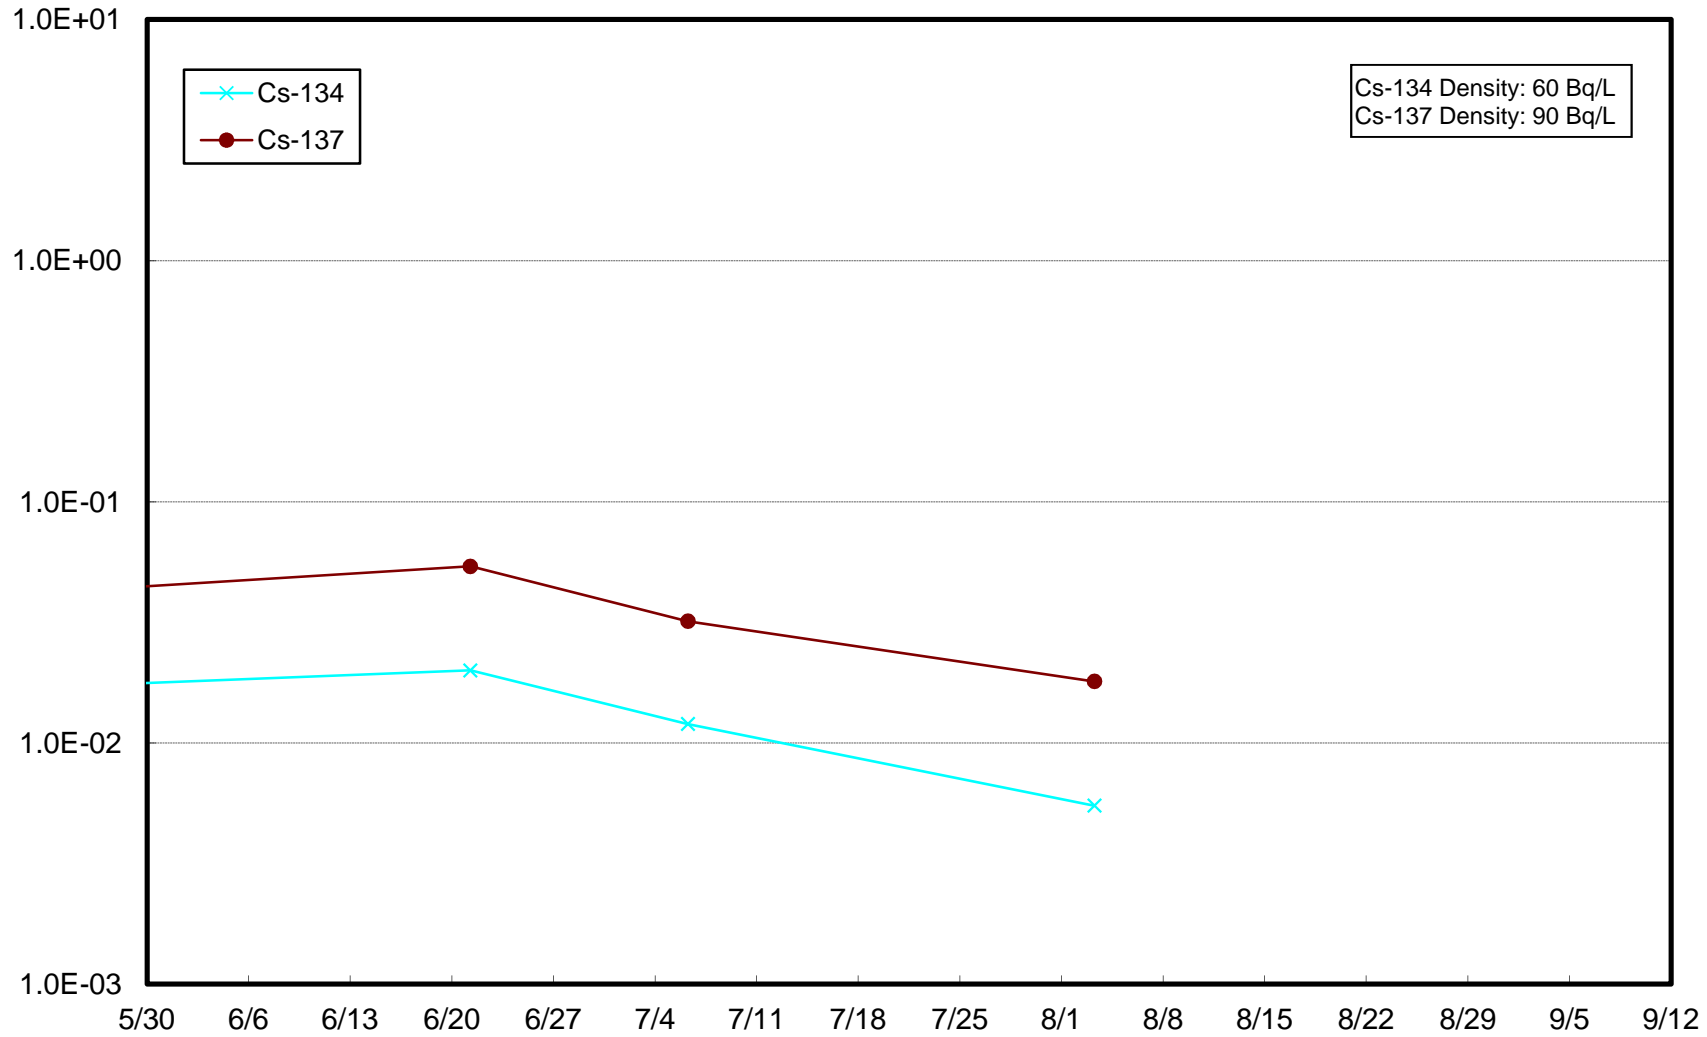


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Upper Layer (Bq/L)

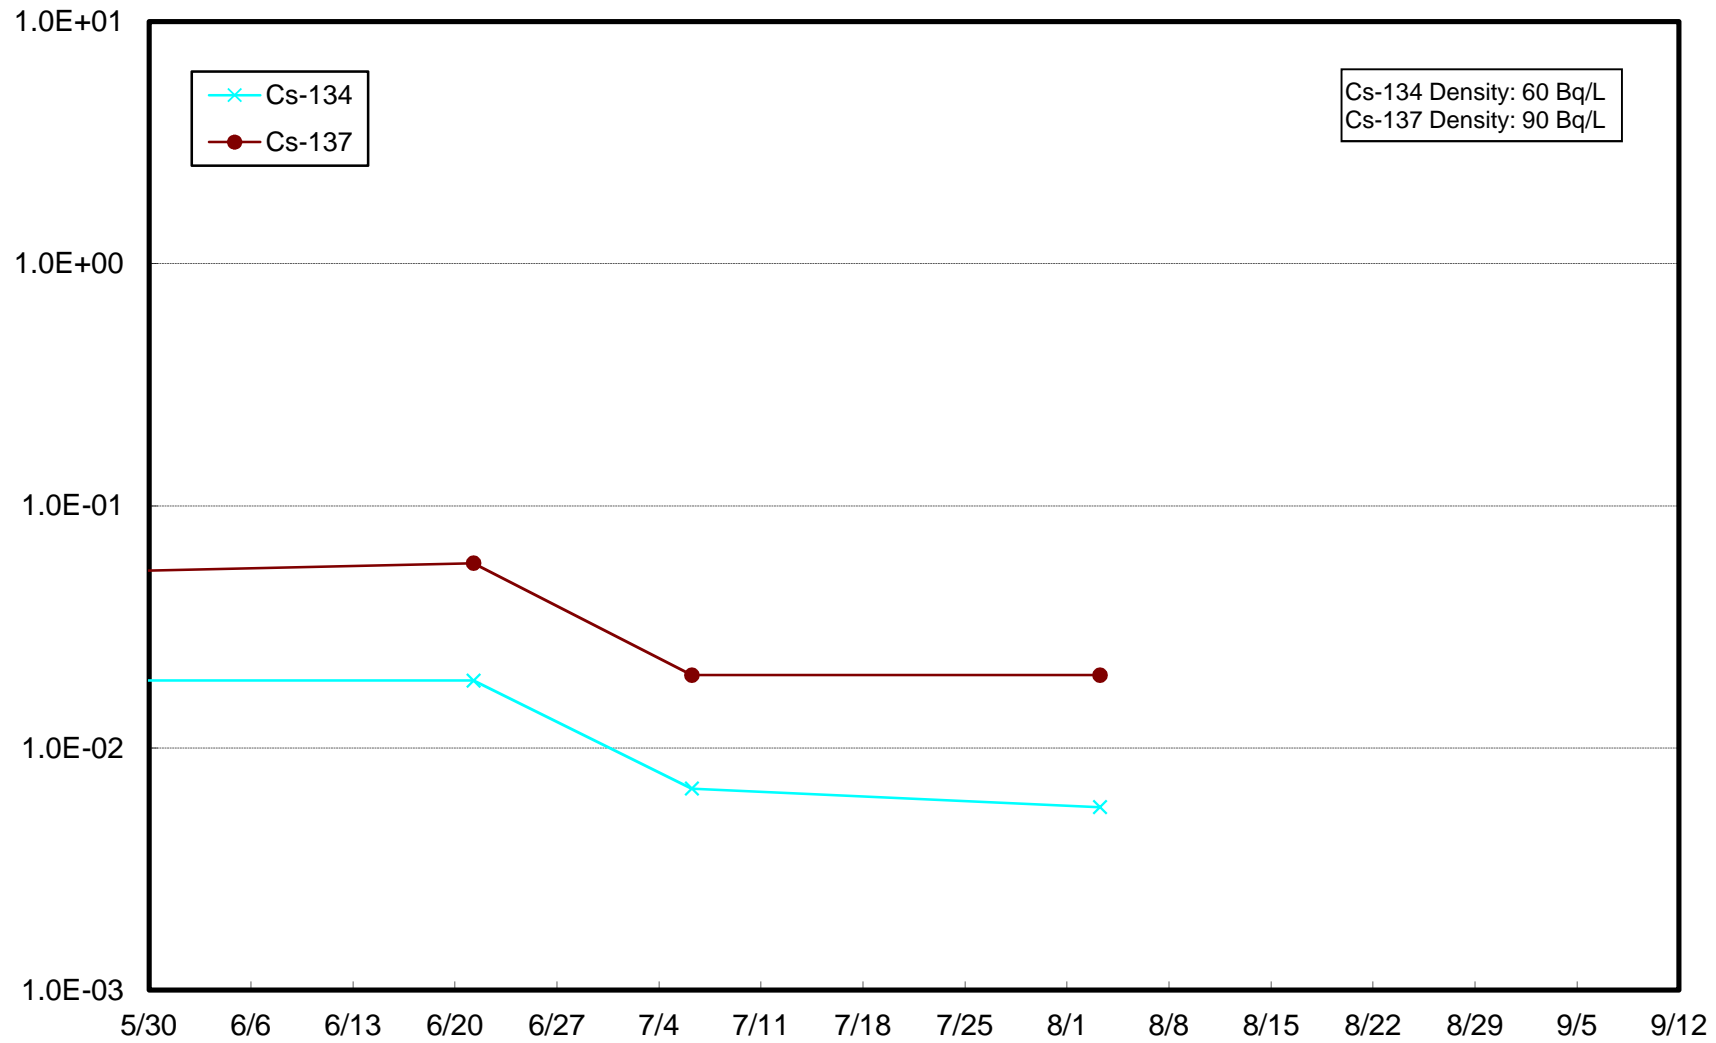


Radioactivity Density of the Seawater at 2km Offshore of Fukushima Daini NPS (T-S7) Lower Layer (Bq/L)

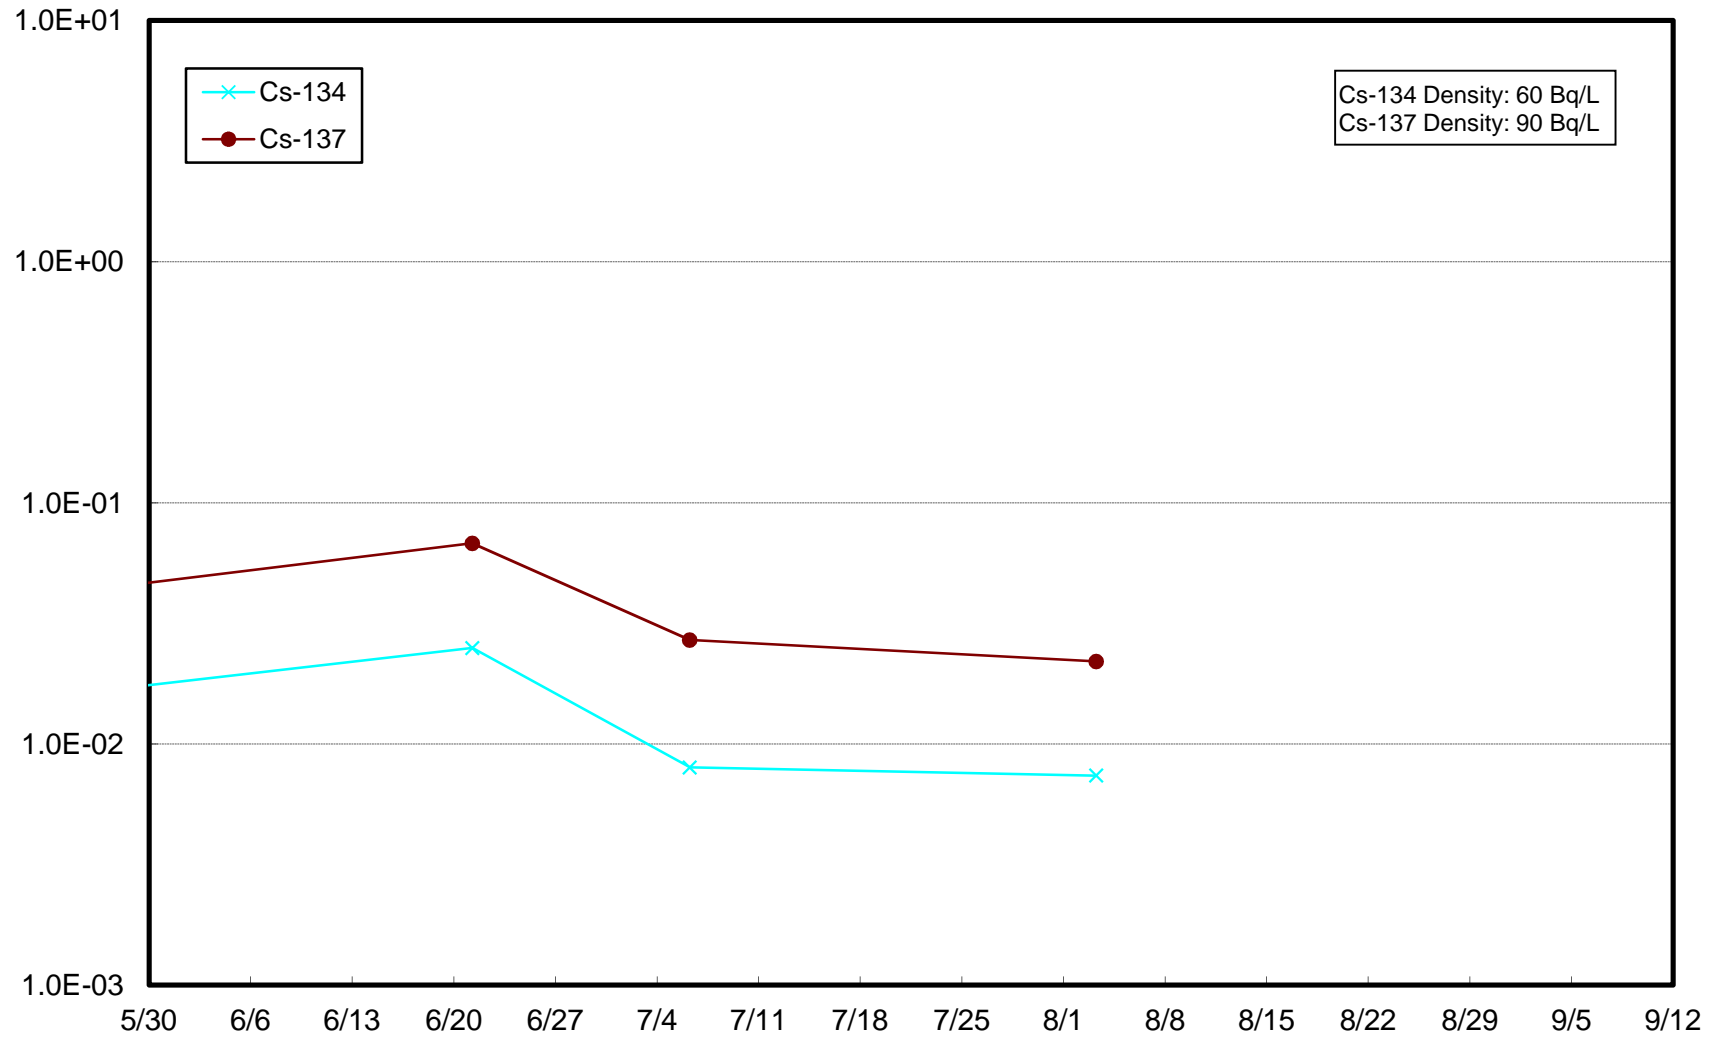


Radioactivity Density of the Seawater Around 4km Offshore of Kumagawa (T-S8) Upper Layer (Bq/L)

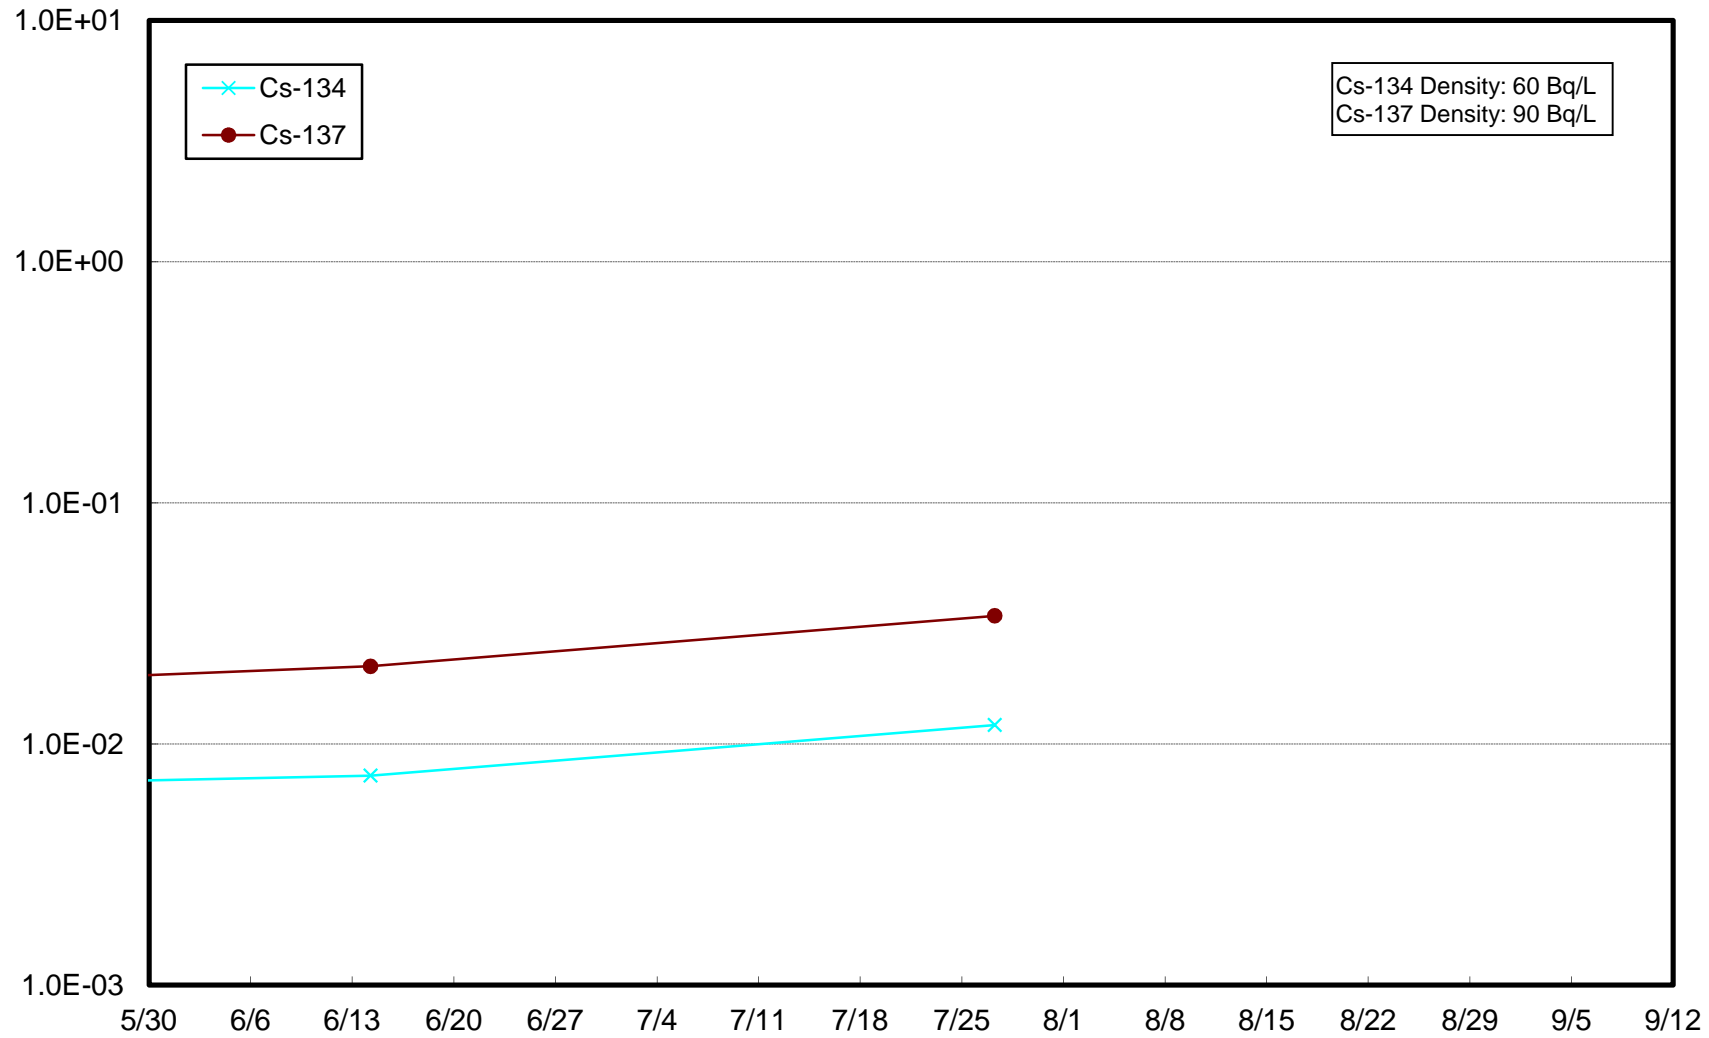


Radioactivity Density of the Seawater Around 4km Offshore of Kumagawa (T-S8) Lower Layer (Bq/L)

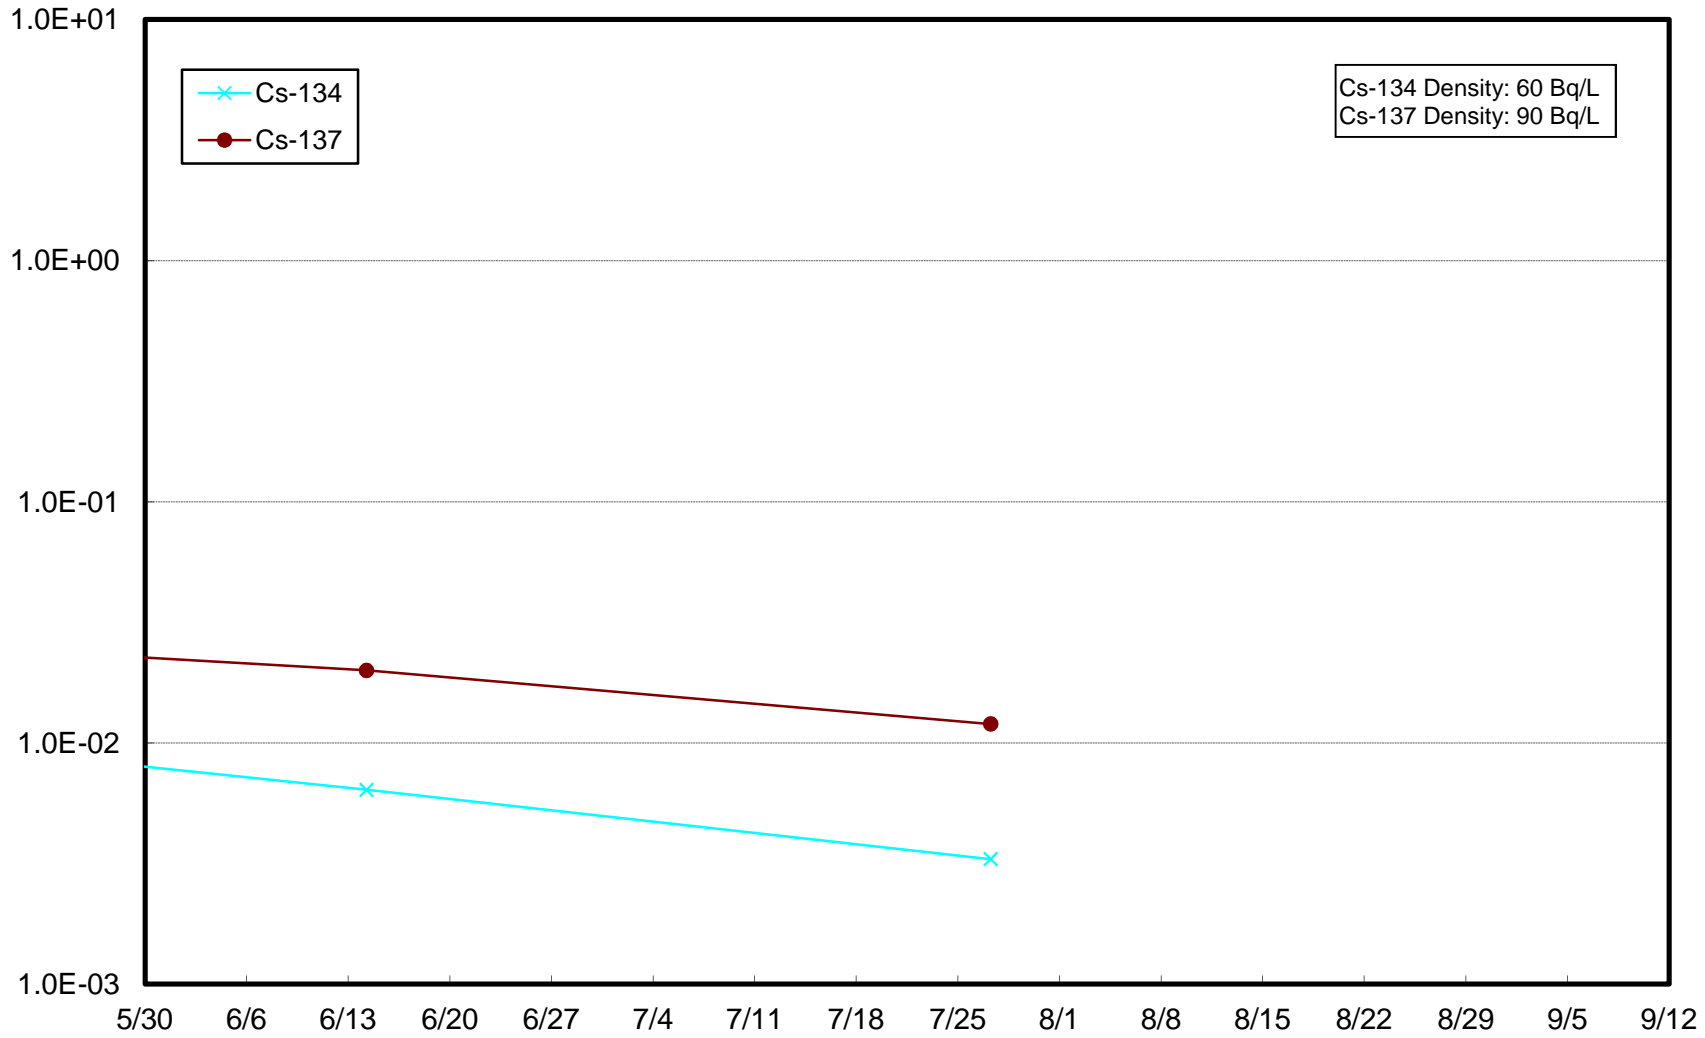


Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Upper Layer (Bq/L)

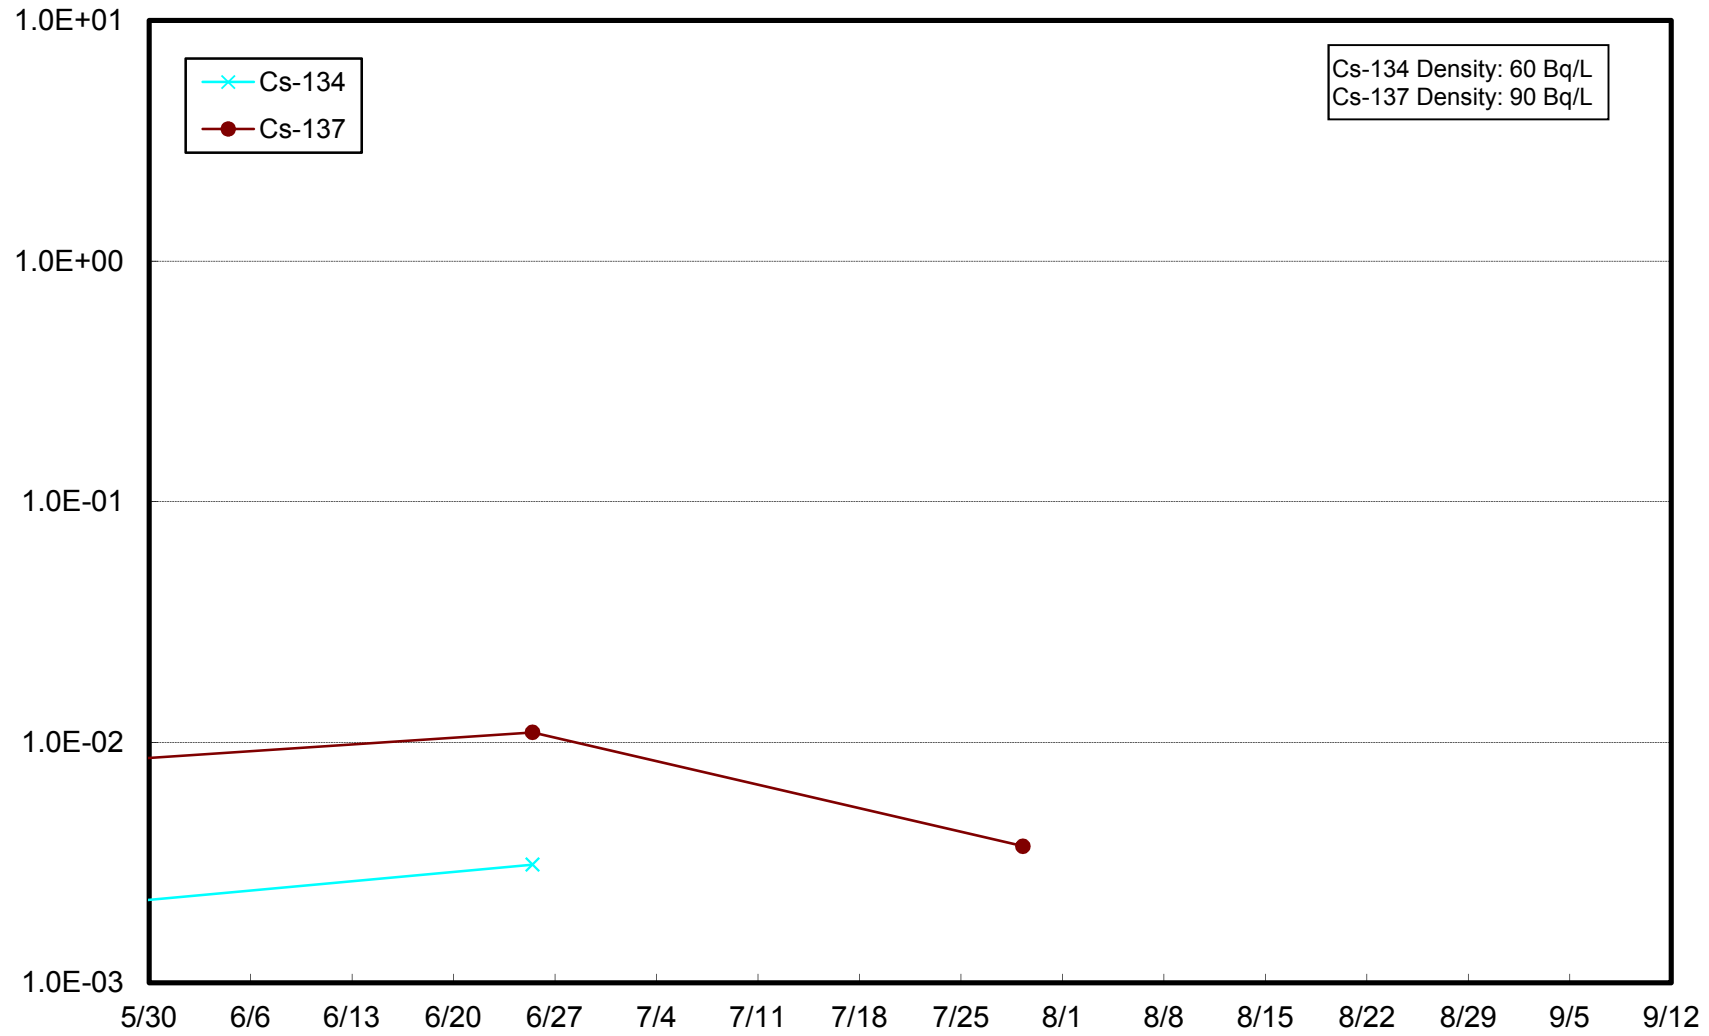

Radioactivity Density of the Seawater at 15km Offshore of Odaka Ward (T-B1) Lower Layer (Bq/L)

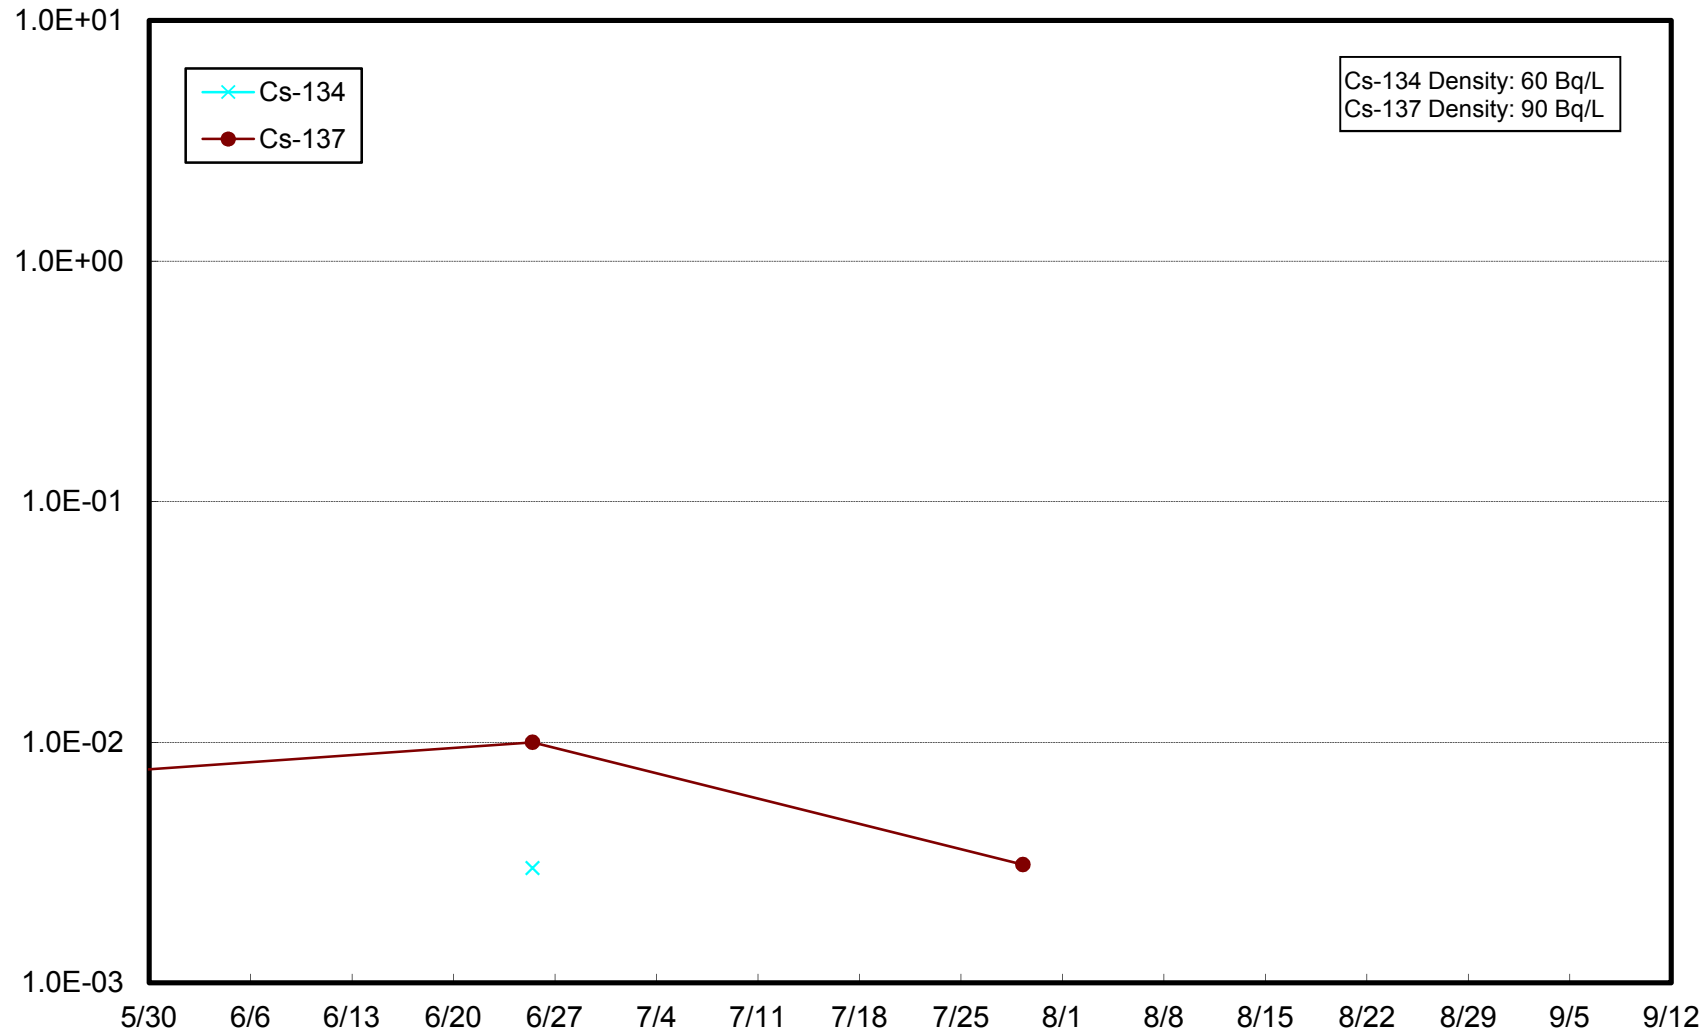

Radioactivity Density of the Seawater at 18km Offshore of Ukedo River (T-B2) Upper Layer (Bq/L)

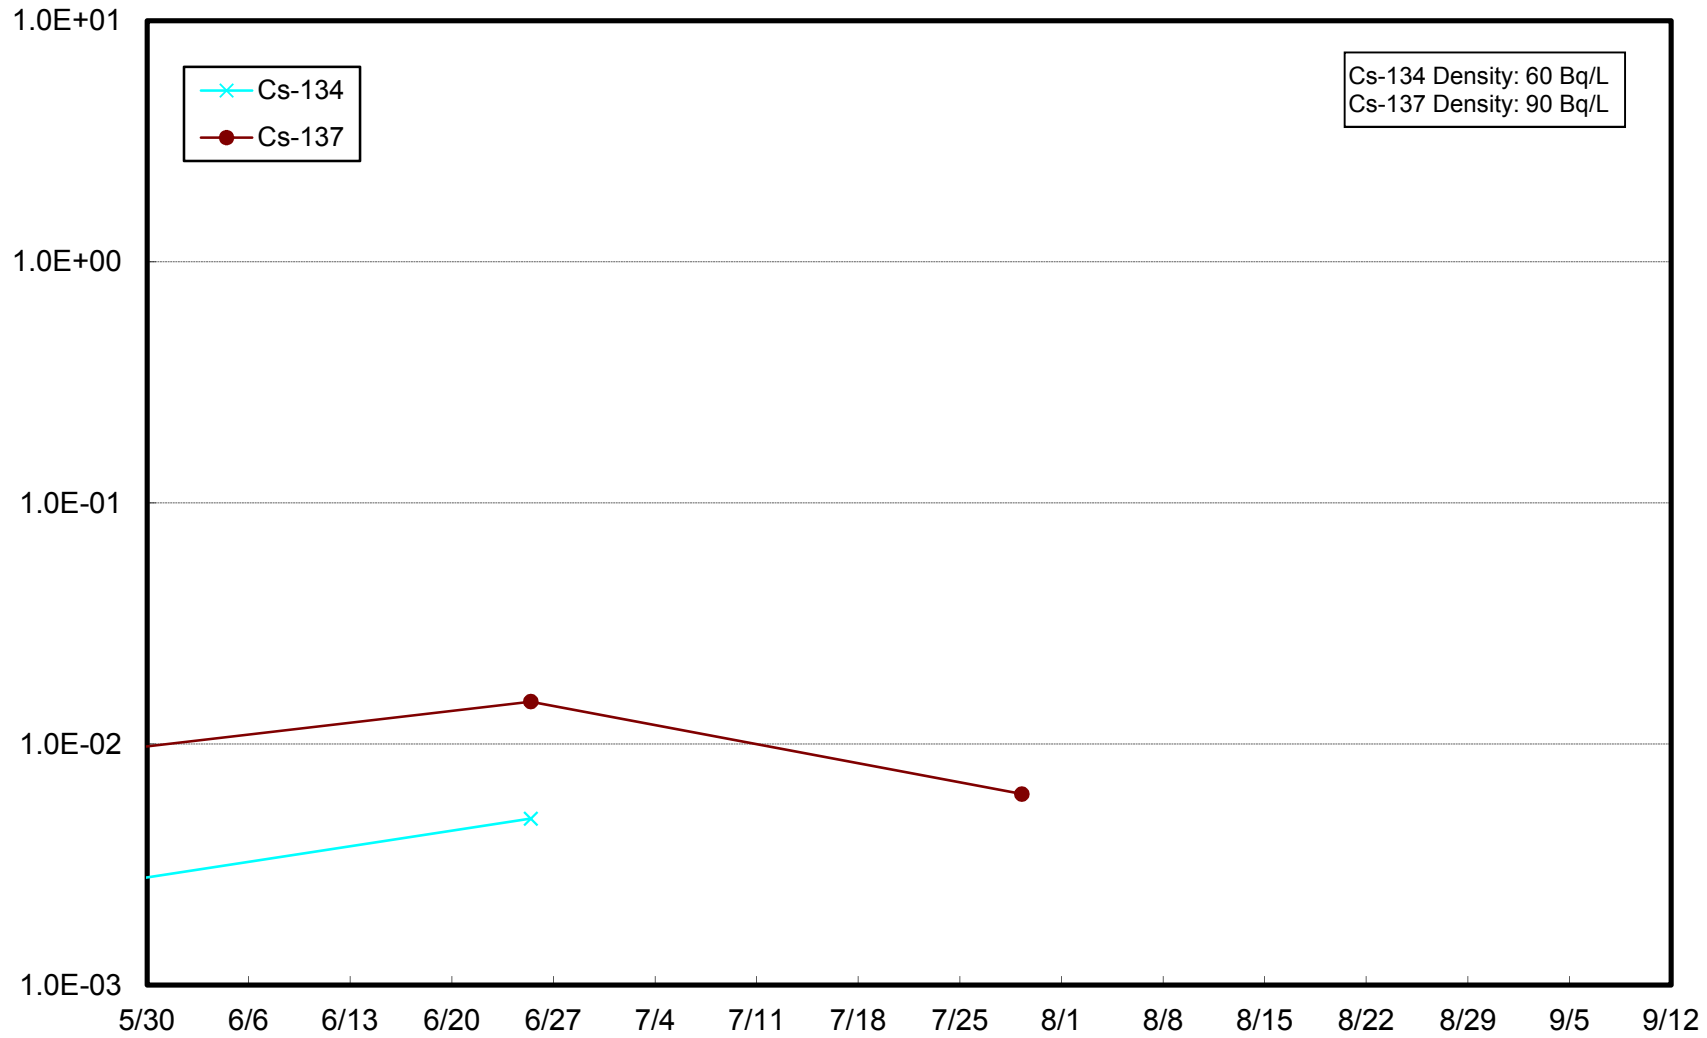

Radioactivity Density of the Seawater at 18km Offshore of Ukedo River (T-B2) Lower Layer (Bq/L)

