

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on November 26, 2014)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling Nov 25, 2014 7:06 AM		Time of Sampling Nov 25, 2014 5:50 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	0.79	-	0.66	-	40
Cs-134 (Approx. 2 years)	ND(0.73)	-	0.67	-	60
Cs-137 (Approx. 30 years)	ND	0.01	0.70	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit, which is provided in parentheses.

**Nuclides Analysis Result of the Radioactive Materials in the Seawater
< Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >**

(Data summarized on November 26)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)						Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel)						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Oct 20, 2014 5:30 AM		Oct 27, 2014 6:20 AM		Nov 3, 2014 6:45 AM		Oct 20, 2014 4:35 AM		Oct 27, 2014 5:40 AM		Nov 13, 2014 5:45 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	ND(0.39)	-	ND(0.42)	-	ND(0.57)	-	ND(0.23)	-	ND(0.53)	-	ND(1.3)	-	60
Cs-137 (Approx. 30 years)	ND	-	ND	-	ND	-	ND	-	ND	-	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by: Tokyo Power Tecnology Ltd.

Nuclides Analysis Result of the Radioactive Materials in the Seawater
< Coast, Fukushima Daini Nuclear Power Station >

Reference

(Data summarized on November 26)

Place of Sampling	2F Around the North Discharge Channel (Around Unit 3-4 Discharge Channel) (Approx. 10km from 1F)						2F Around Iwasawa Shore (Approx. 7km South of Unit 1 & 2 Discharge Channel) (Approx. 16km from 1F)						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Oct 21, 2014 10:10 AM		Oct 28, 2014 10:00 AM		Nov 4, 2014 10:20 AM		Oct 21, 2014 4:20 PM		Oct 28, 2014 4:05 PM		Nov 4, 2014 4:20 PM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.027	0.00	0.031	0.00	0.025	0.00	0.019	0.00	0.026	0.00	0.014	0.00	60
Cs-137 (Approx. 30 years)	0.081	0.00	0.10	0.00	0.073	0.00	0.065	0.00	0.082	0.00	0.048	0.00	90

- * The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.
- * In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.
- * Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.
- * Analyzed by : Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Coast Fukushima Daiichi NPS Within 20km Range>

Reference

(Data summarized on November 26)

Place of Sampling	South side of Ukedo Port (At 5.5km off shore of Unit 5 and Unit 6 north side)						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Time of Sampling	Oct 21,2014 7:00 AM		Oct 28,2014 9:05 AM		Nov 4,2014 8:30 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.037	0.00	0.020	0.00	0.021	0.00	60
Cs-137 (Approx. 30 years)	0.11	0.00	0.054	0.00	0.071	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted. * Analyzed by : Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 1/4 >

(Data summarized on November 26)

Place of Sampling (Place No.)	*1 3km Offshore of Odaka Ward (T-14)				*2 3km Offshore of Ukedo river (T-D1)				*2 3km Offshore of Ukedo River (T-D1)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 17, 2014 9:27 AM		Oct 17, 2014 9:27 AM		Oct 24, 2014 9:46 AM		Oct 24, 2014 9:46 AM		Oct 30, 2014 8:48 AM		Oct 30, 2014 8:48 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0036	0.00	0.0093	0.00	0.0026	0.00	0.0044	0.00	0.0035	0.00	0.0022	0.00	60
Cs-137 (Approx. 30 years)	0.011	0.00	0.029	0.00	0.011	0.00	0.016	0.00	0.013	0.00	0.011	0.00	90

Place of Sampling (Place No.)	*2 3km Offshore of Fukushima Daiichi NPS (T-D5)				*2 3km Offshore of Fukushima Daiichi NPS (T-D5)				*2 3km Offshore of Fukushima Daini NPS (T-D9)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 24, 2014 8:36 AM		Oct 24, 2014 8:36 AM		Oct 28, 2014 8:52 AM		Oct 28, 2014 8:52 AM		Oct 25, 2014 7:50 AM		Oct 25, 2014 7:50 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0045	0.00	0.0050	0.00	0.0062	0.00	0.010	0.00	0.0066	0.00	0.0099	0.00	60
Cs-137 (Approx. 30 years)	0.010	0.00	0.018	0.00	0.018	0.00	0.028	0.00	0.020	0.00	0.034	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : *1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD., *2 Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 2/4 >

(Data summarized on November 26)

Place of Sampling (Place No.)	*2 15km Offshore of Fukushima Daiichi NPS (T-5)				*1 3km Offshore of Iwasawa Shore (T-11)				*1 3km Offshore of Iwasawa Shore (T-11)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 28, 2014 7:50 AM		Oct 28, 2014 7:50 AM		Oct 18, 2014 8:33 AM		Oct 18, 2014 8:33 AM		Oct 18, 2014 10:27 AM		Oct 18, 2014 10:27 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0087	0.00	0.0049	0.00	ND	-	ND	-	0.0084	0.00	0.0085	0.00	60
Cs-137 (Approx. 30 years)	0.026	0.00	0.021	0.00	0.0026	0.00	0.0046	0.00	0.028	0.00	0.027	0.00	90

Place of Sampling (Place No.)	*1 3km Offshore of Iwasawa Shore (T-11)				*1 3km Offshore of Konahama Shore (T-18)				*1 5km Offshore of Numanouchi (T-M10)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 8, 2014 7:33 AM		Oct 8, 2014 7:33 AM		Oct 4, 2014 6:14 AM		Oct 4, 2014 6:14 AM		Oct 4, 2014 6:44 AM		Oct 4, 2014 6:44 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0045	0.00	ND	-	0.0056	0.00	0.0021	0.00	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	0.017	0.00	0.0028	0.00	0.019	0.00	0.0093	0.00	0.0018	0.00	0.0023	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

Cs-134: Approx.0.0017Bq/L As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : *1 THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD., *2 Tokyo Power Technology Ltd.

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 3/4 >

(Data summarized on November 26)

Place of Sampling (Place No.)	1km Offshore of Niida river (T-13-1)				3km Offshore of Souma (T-22)				5km Offshore of Kashima (T-MA)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 10, 2014 6:20 AM		Oct 10, 2014 6:20 AM		Oct 10, 2014 5:10 AM		Oct 10, 2014 5:10 AM		Oct 10, 2014 5:39 AM		Oct 10, 2014 5:39 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0044	0.00	0.0050	0.00	0.0051	0.00	0.0035	0.00	0.0025	0.00	0.0013	0.00	60
Cs-137 (Approx. 30 years)	0.016	0.00	0.016	0.00	0.017	0.00	0.015	0.00	0.0093	0.00	0.0067	0.00	90

Place of Sampling (Place No.)	1km Offshore of Ota river (T-S1)				3km Offshore of Odaka ward (T-S2)				3km Offshore of Ukedo river (T-S3)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 24, 2014 5:57 AM		Oct 24, 2014 5:57 AM		Oct 24, 2014 6:24 AM		Oct 24, 2014 6:24 AM		Oct 9, 2014 5:49 AM		Oct 9, 2014 5:49 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0042	0.00	0.013	0.00	0.0017	0.00	0.0033	0.00	0.0091	0.00	0.0024	0.00	60
Cs-137 (Approx. 30 years)	0.014	0.00	0.043	0.00	0.0082	0.00	0.0096	0.00	0.030	0.00	0.0092	0.00	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD..

Nuclides Analysis Result of Radioactive Materials in the Seawater <Offshore 4/4 >

(Data summarized on November 26)

Place of Sampling (Place No.)	3km Offshore of Fukushima daiichi (T-S4)				Around 12km Offshore of Kidogawa River (T-S5)				Around 2km Offshore of Fukushima daini (T-S7)				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 9, 2014 6:12 AM		Oct 9, 2014 6:12 AM		Oct 19, 2014 9:18 AM		Oct 19, 2014 9:18 AM		Oct 19, 2014 9:00 AM		Oct 19, 2014 9:00 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0091	0.00	0.0024	0.00	0.011	0.00	0.0099	0.00	0.013	0.00	0.015	0.00	60
Cs-137 (Approx. 30 years)	0.029	0.00	0.0082	0.00	0.034	0.00	0.033	0.00	0.040	0.00	0.051	0.00	90

Place of Sampling (Place No.)	Around 4km Offshore of Kumagawa River (T-S8)				/				/				② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Upper Layer		Lower Layer		Upper Layer		Lower Layer		Upper Layer		Lower Layer		
Time of Sampling	Oct 19, 2014 6:29 AM		Oct 19, 2014 6:29 AM		/		/		/		/		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0048	0.00	0.0020	0.00	/	/	/	/	/	/	/	/	60
Cs-137 (Approx. 30 years)	0.016	0.00	0.0092	0.00	/	/	/	/	/	/	/	/	90


* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of 2 nuclides or more, the sum of scaling factors to density limits is compared to 1.


* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by : THE GENERAL ENVIRONMENTAL TECHNOS Co., LTD.


Radioactivity Density of the Seawater at 1F Units 5-6 North Discharge Channel (Bq/L)

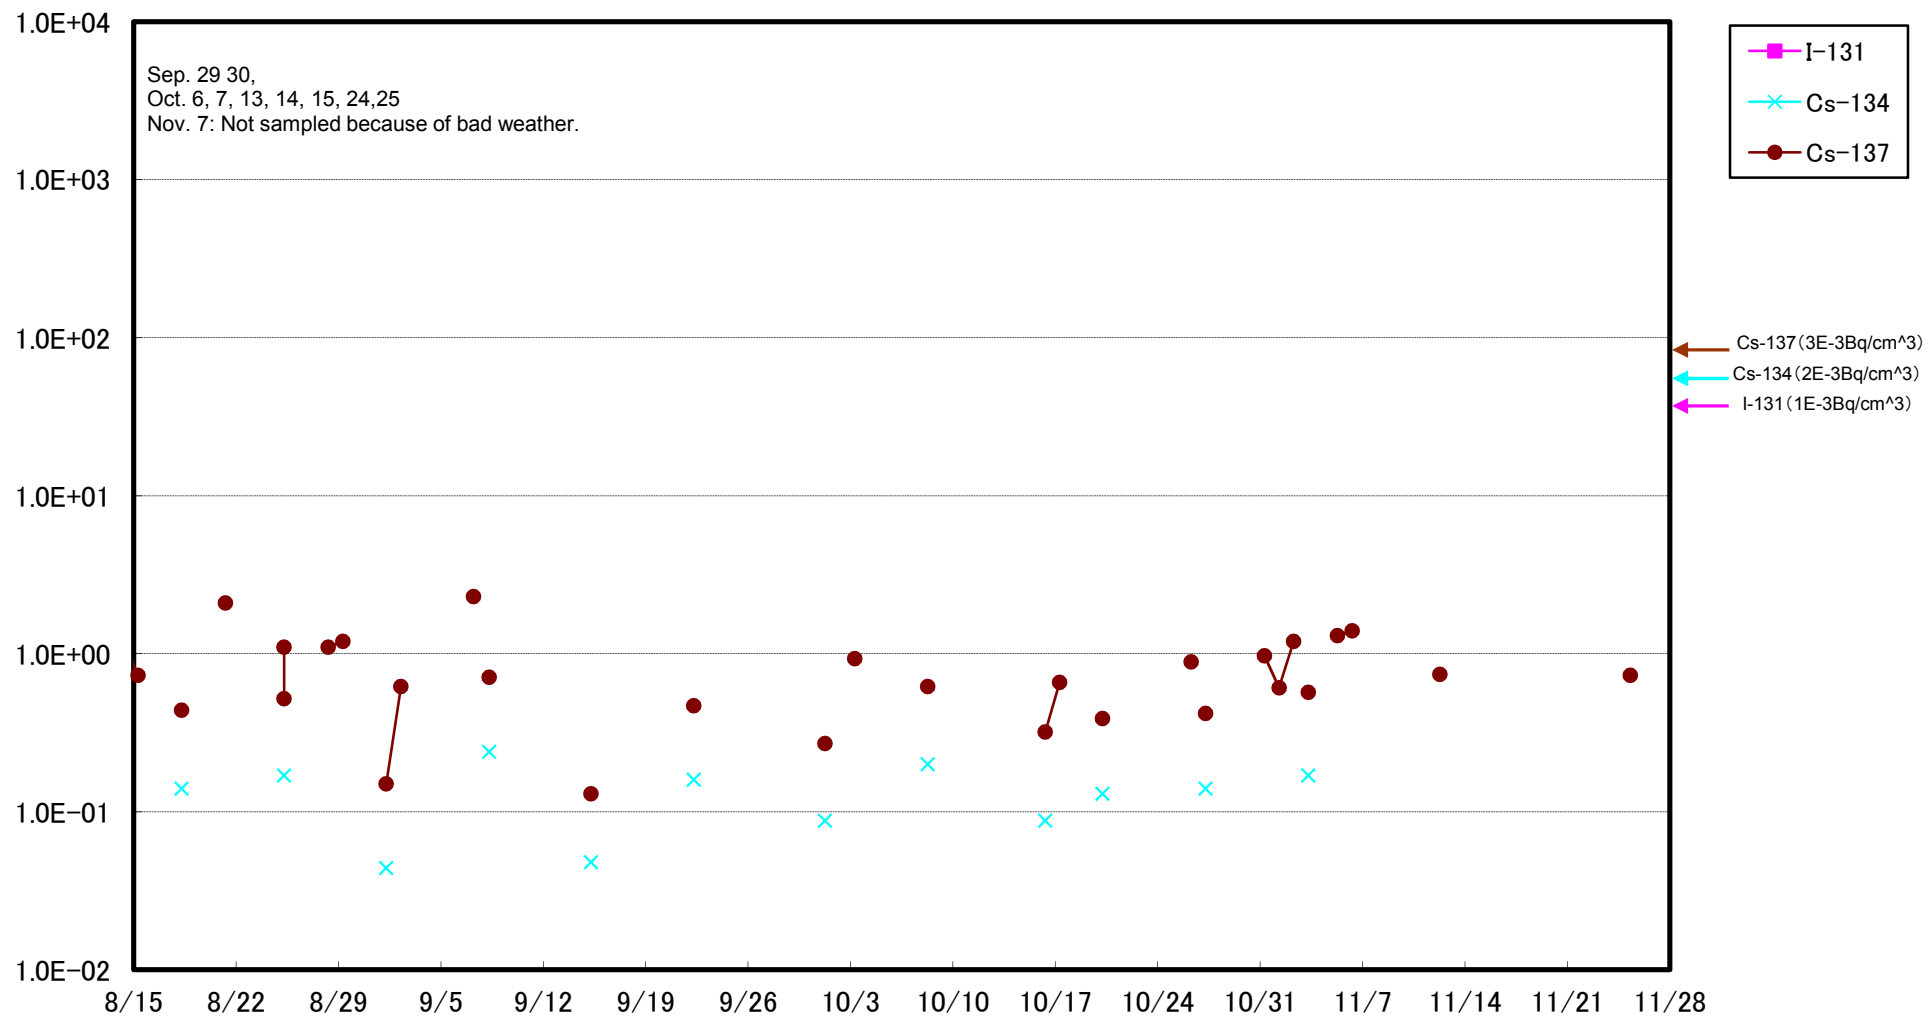


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

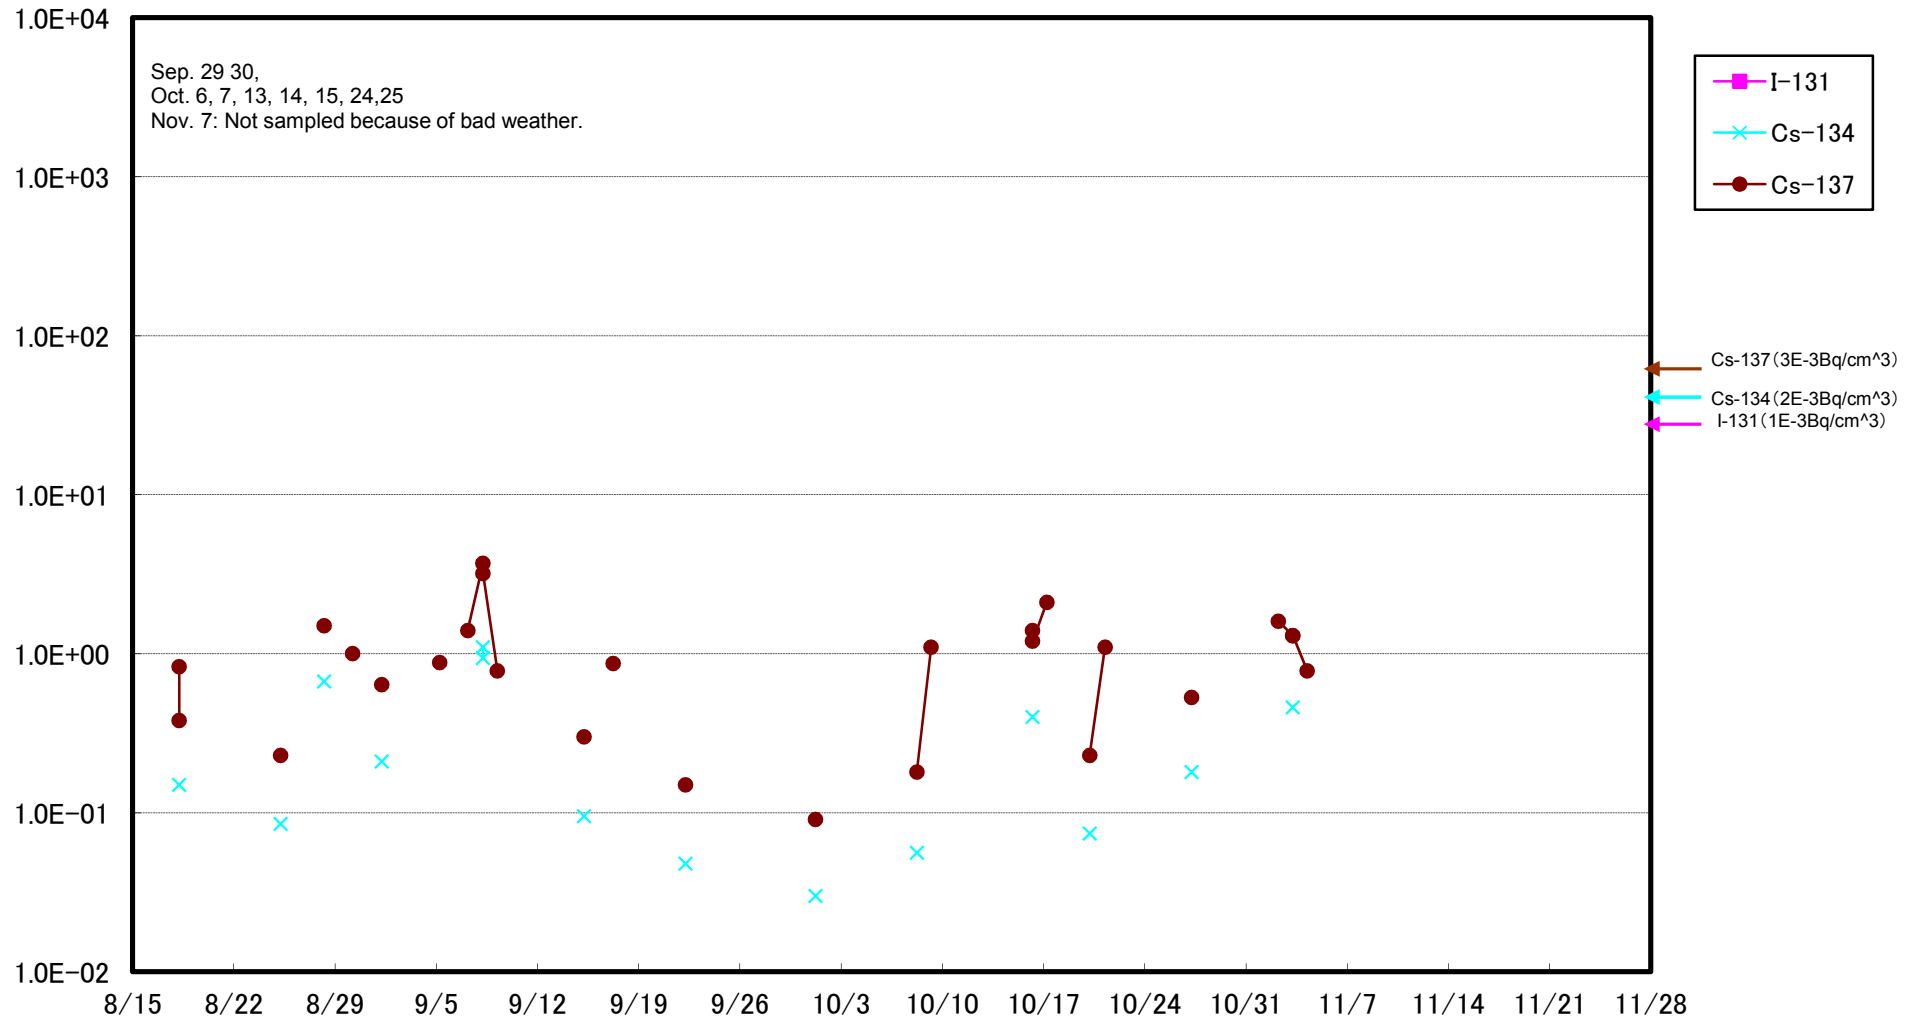


Radioactivity Density of the Seawater at 2F North Discharge Channel (Bq/L)

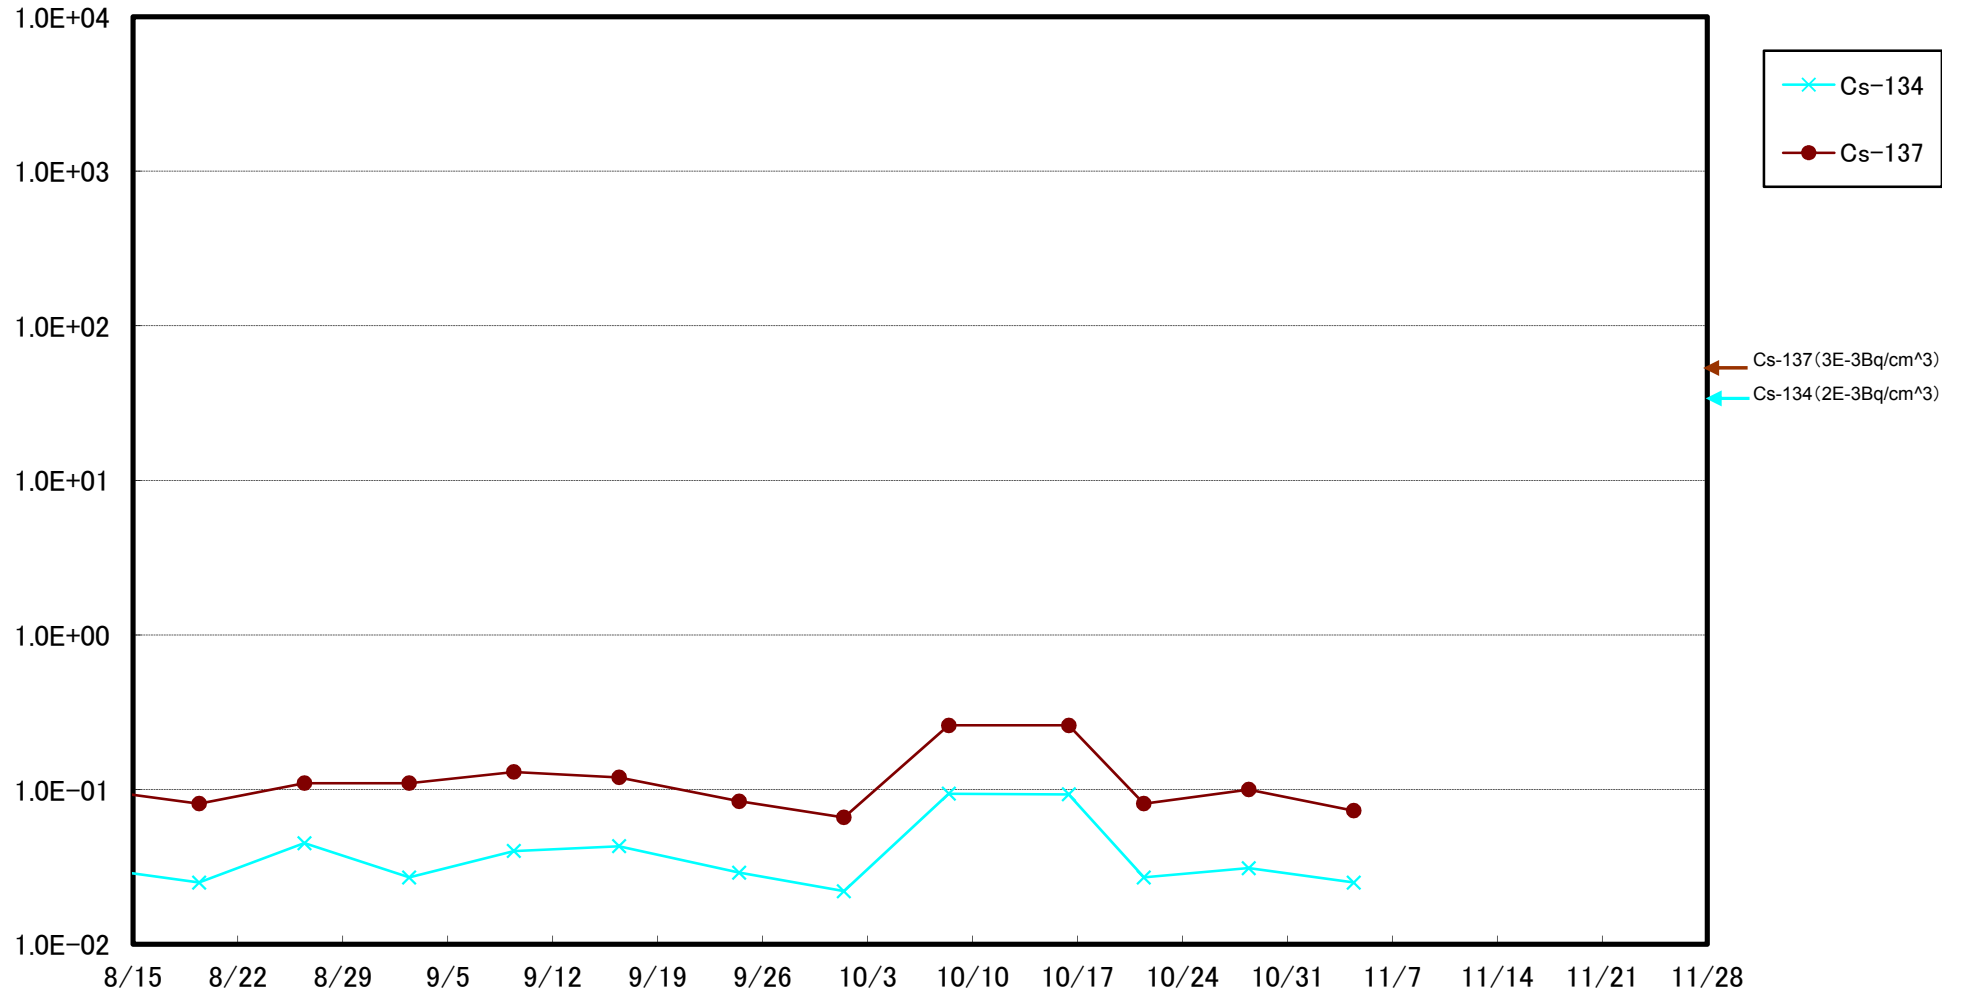


Radioactivity Density around Iwasawa shore at 2F North Discharge Channel (Bq/L)

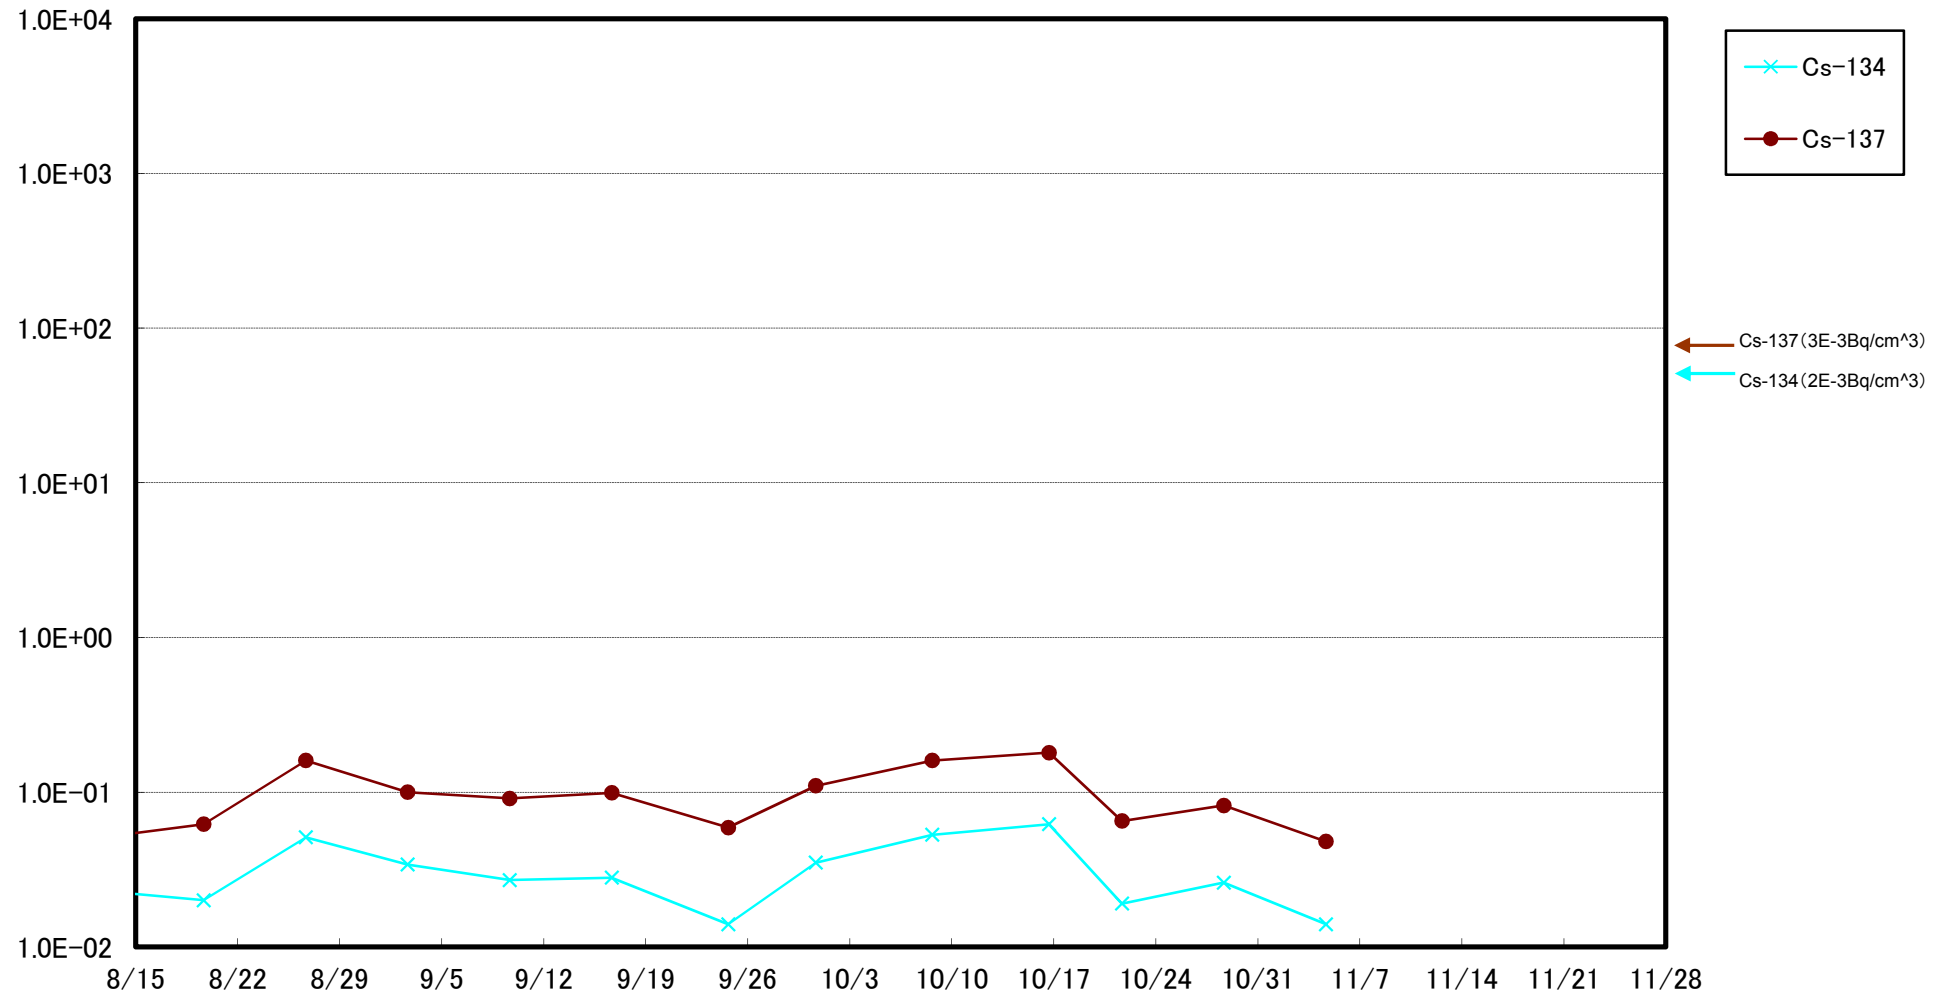


Radioactivity Density of the Seawater at South saide of Ukedo Port (Bq/L)

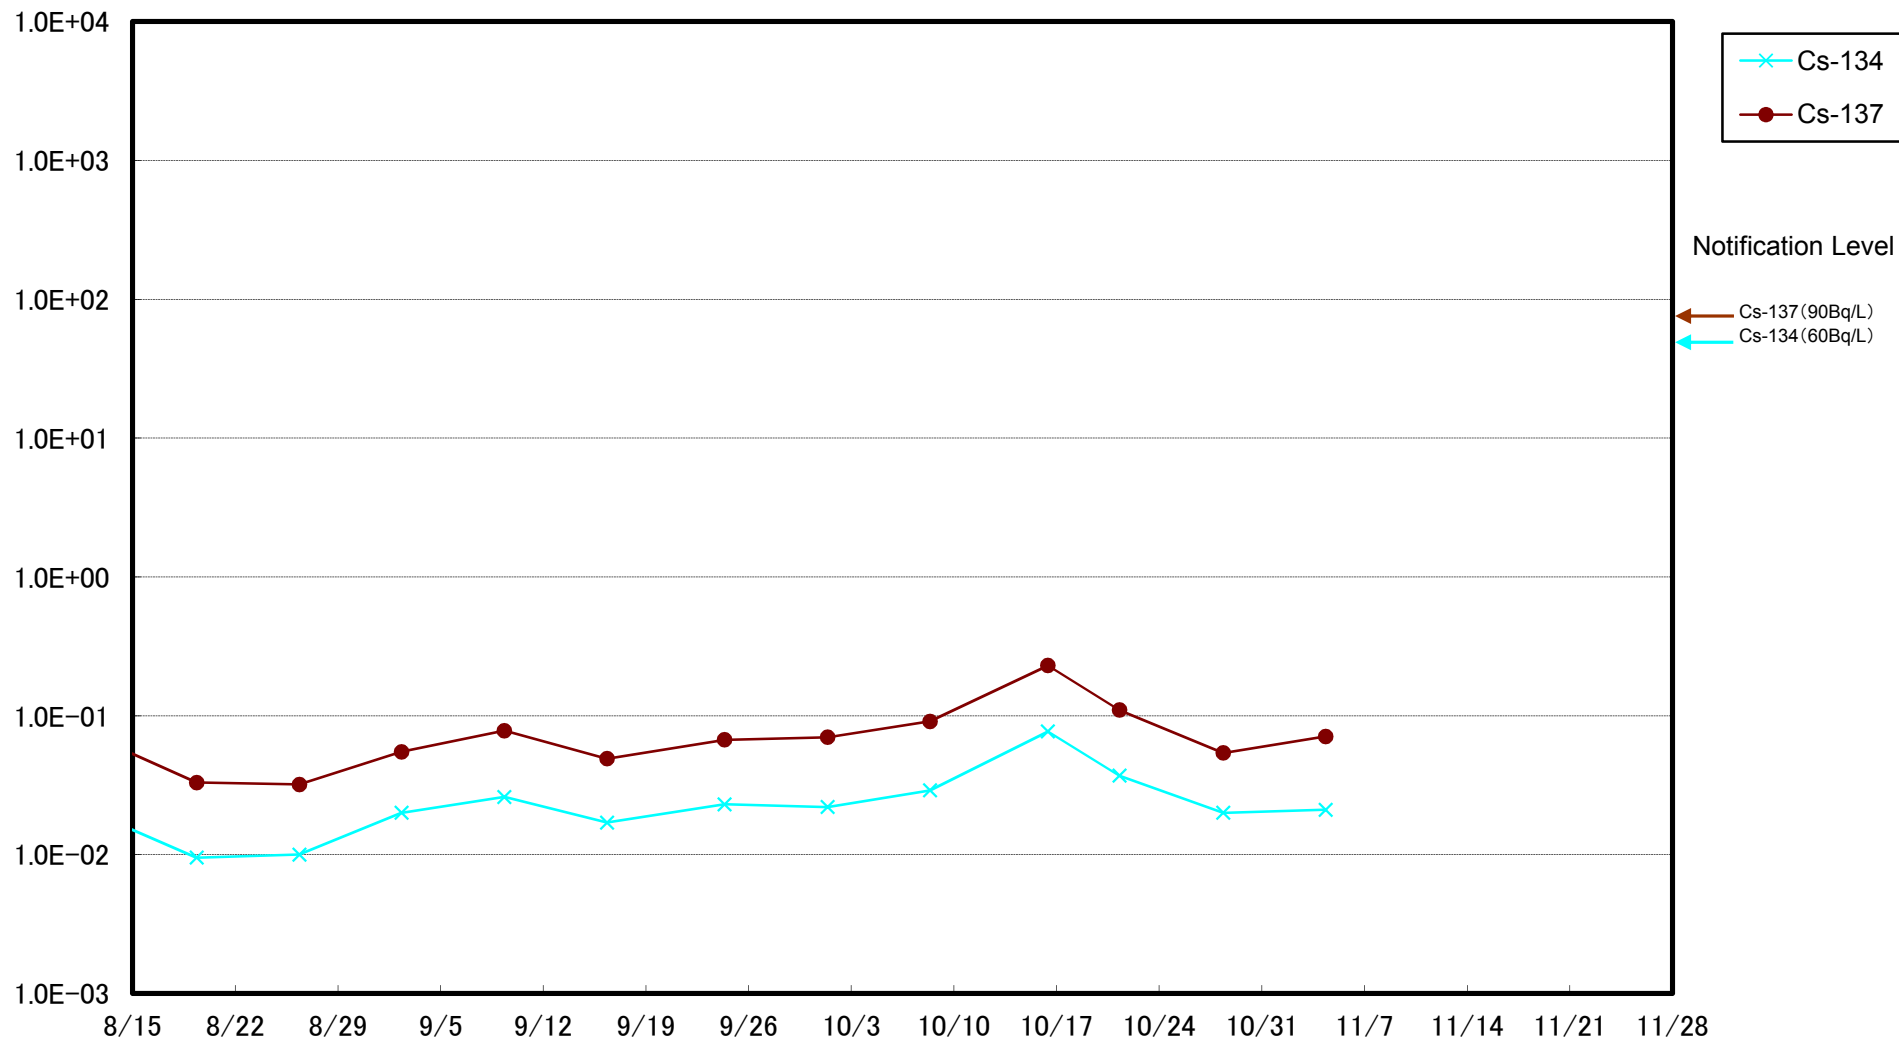


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Upper Layer (Bq/L)

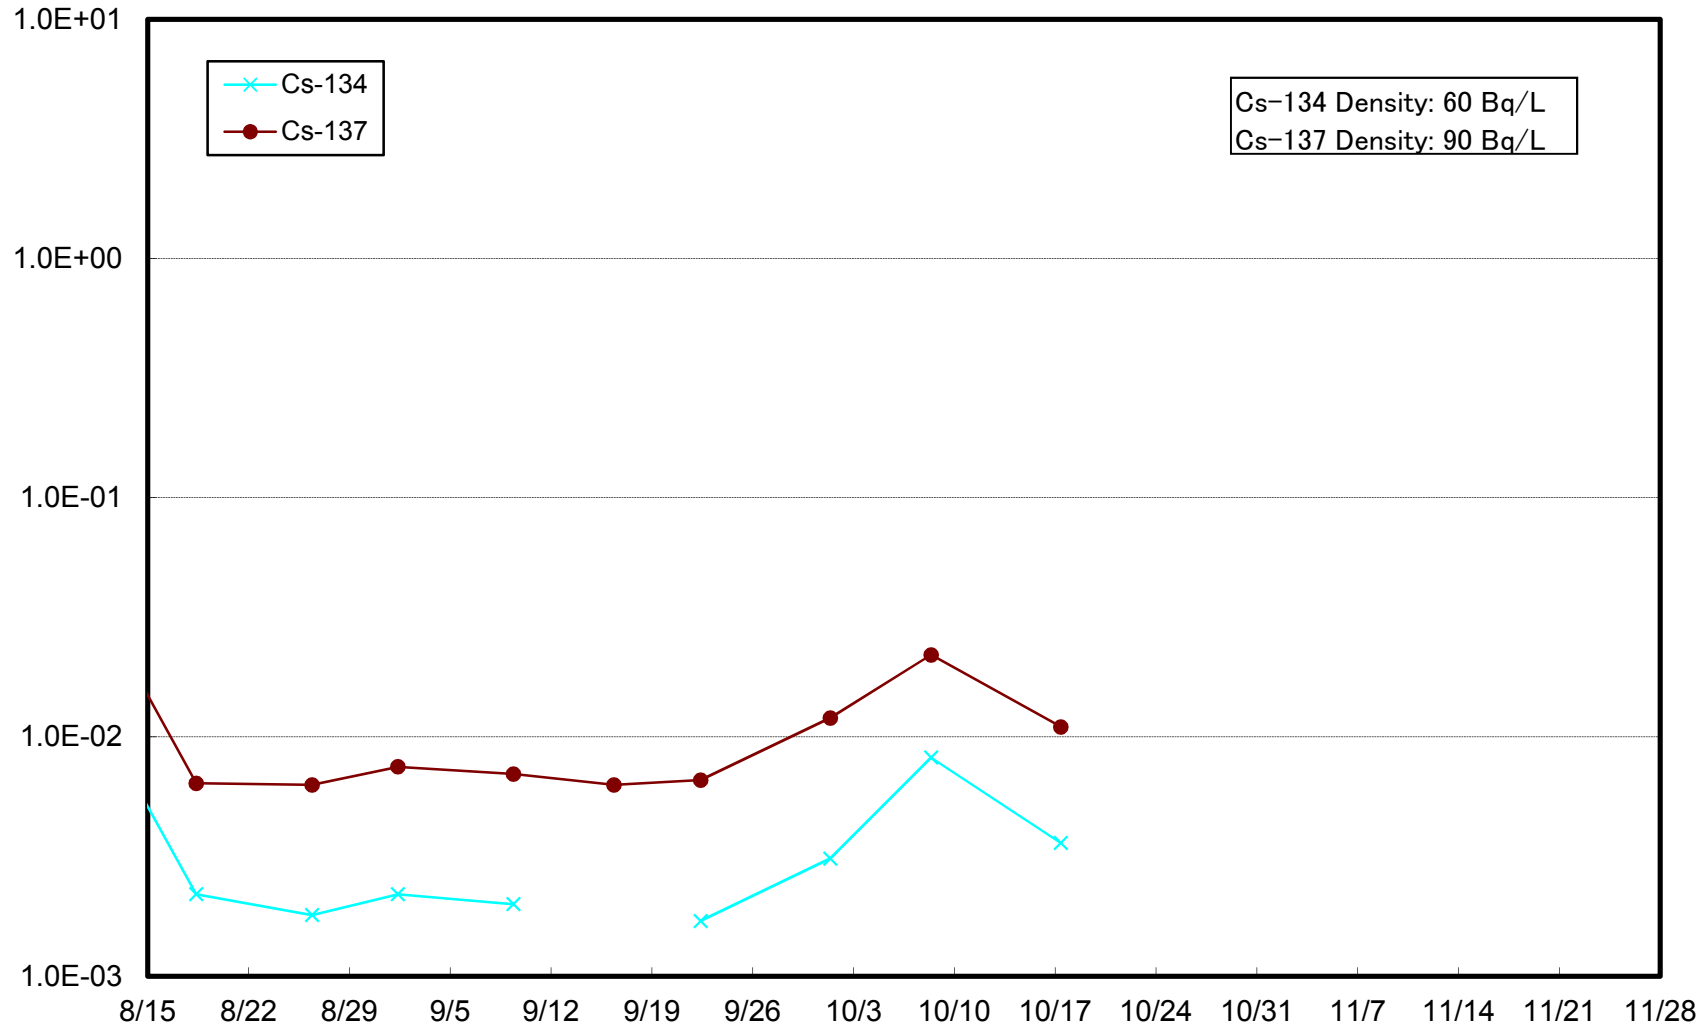


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Lower Layer (Bq/L)

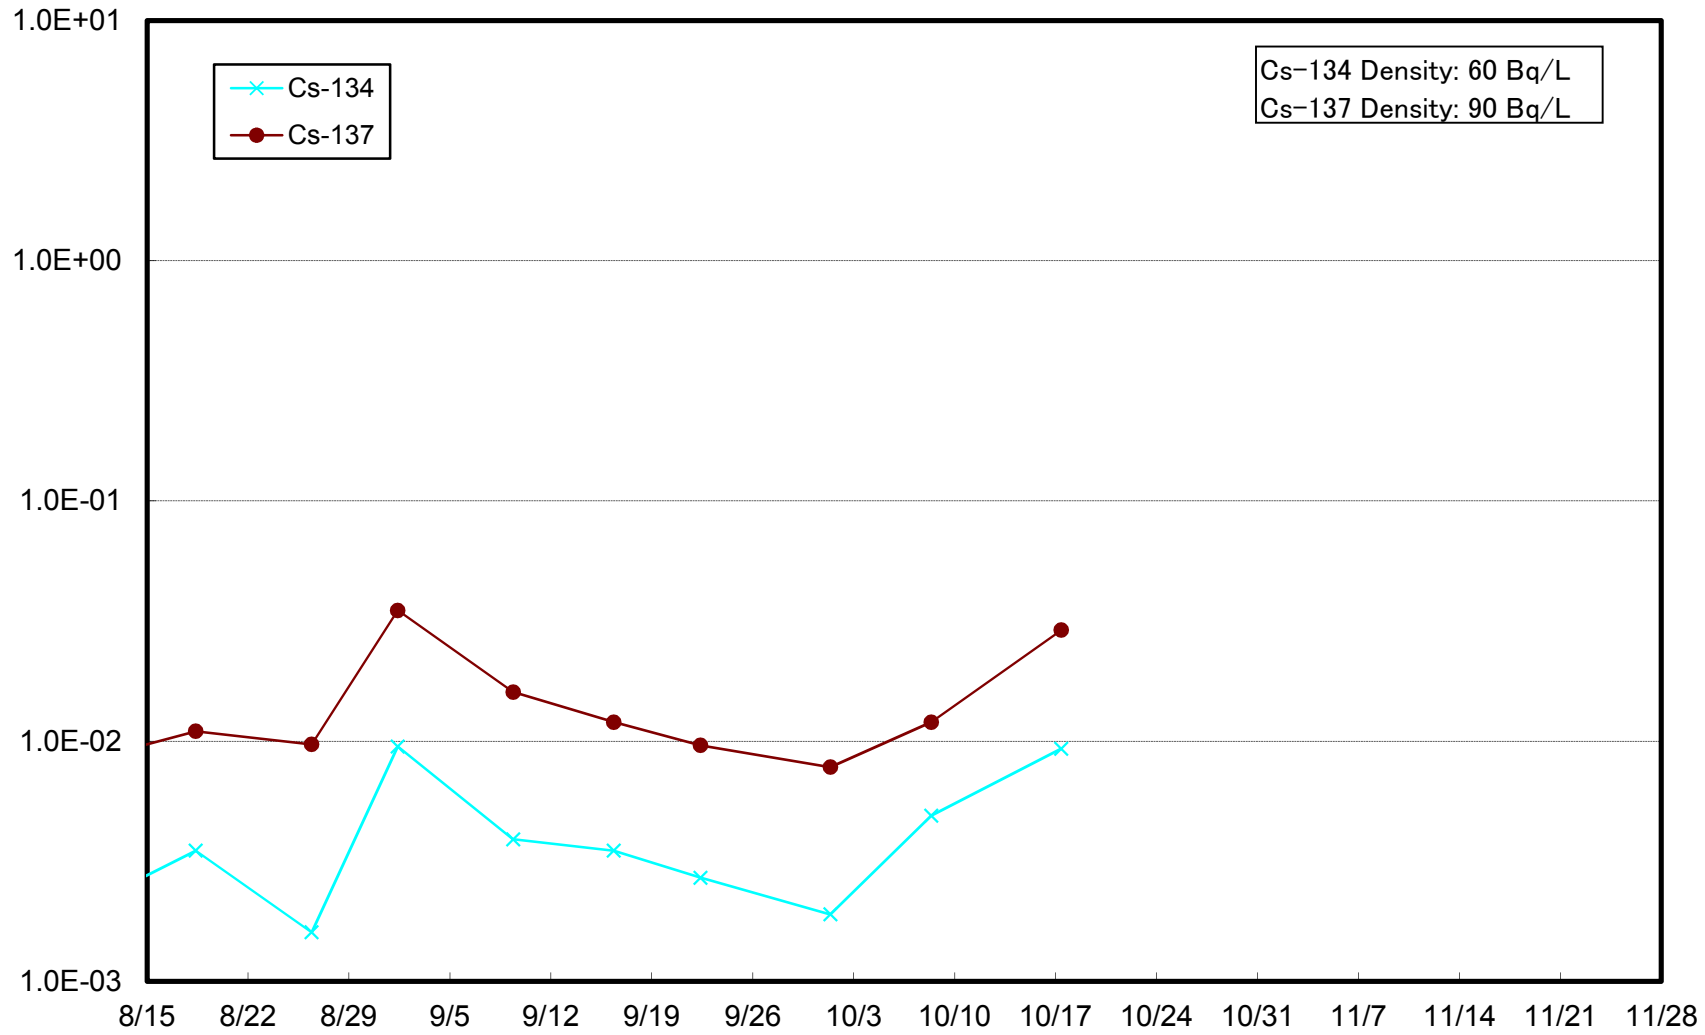


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Upper Layer (Bq/L)

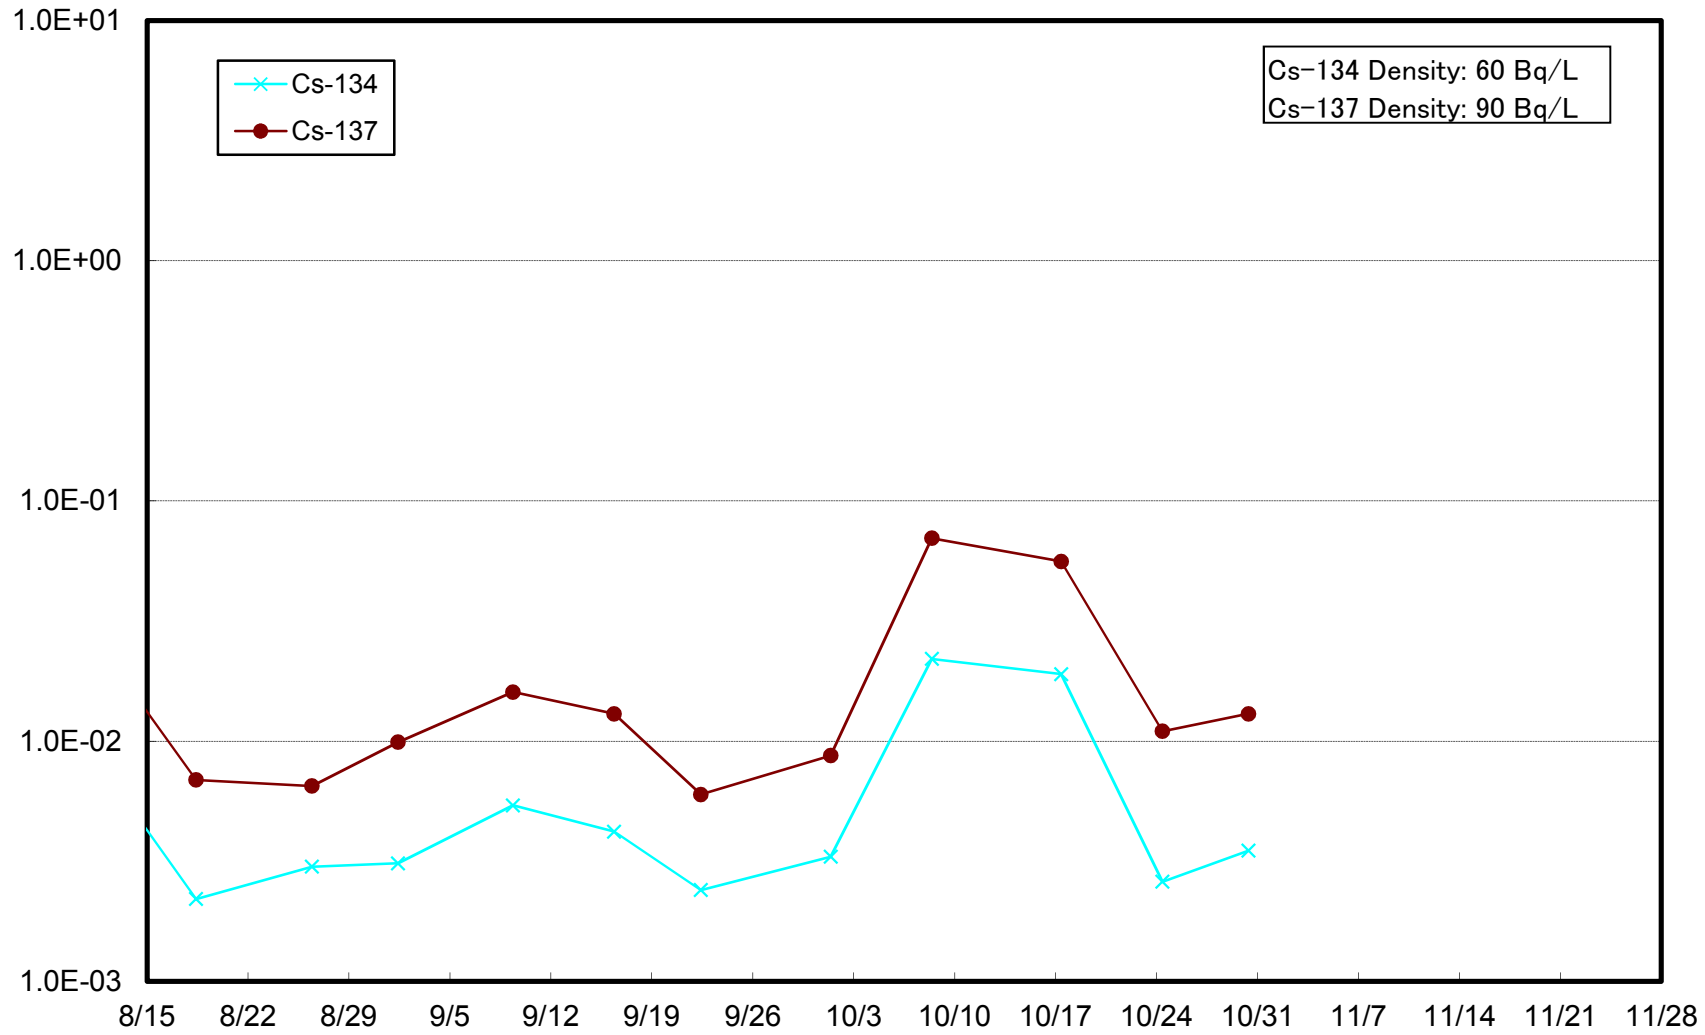


Radioactivity Density of the Seawater at 3km Offshore of Ukedo River (T-D1) Lower Layer (Bq/L)

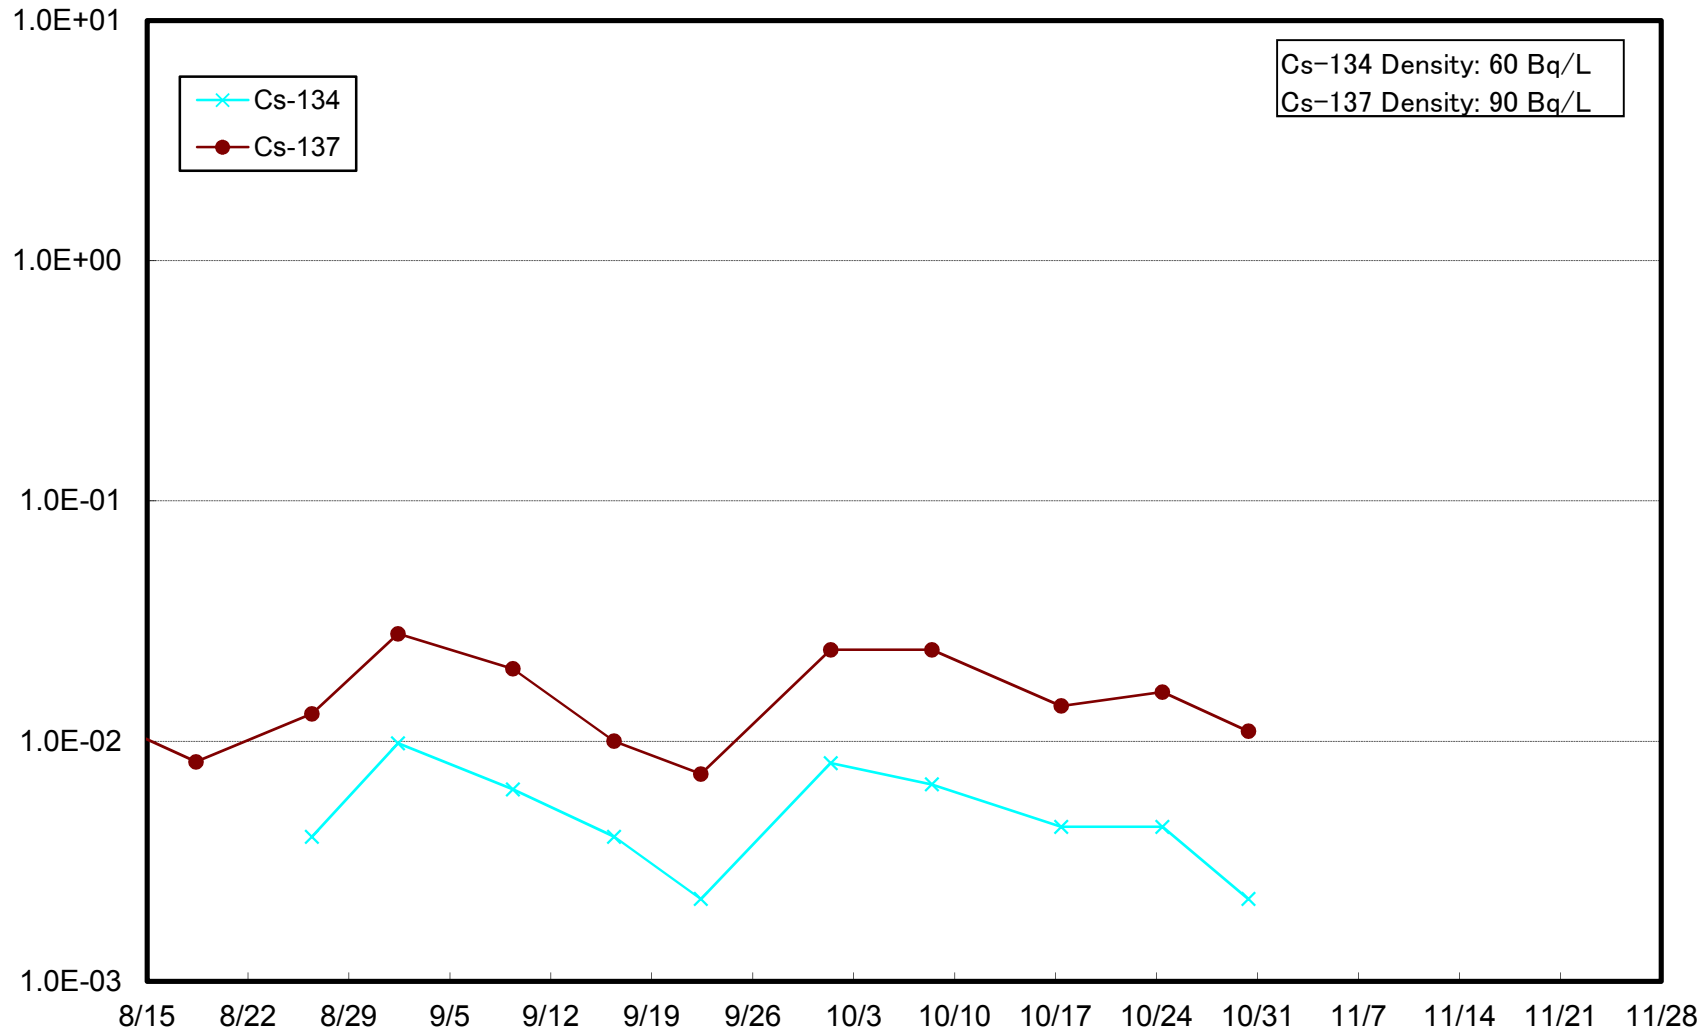


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Upper Layer (Bq/L)

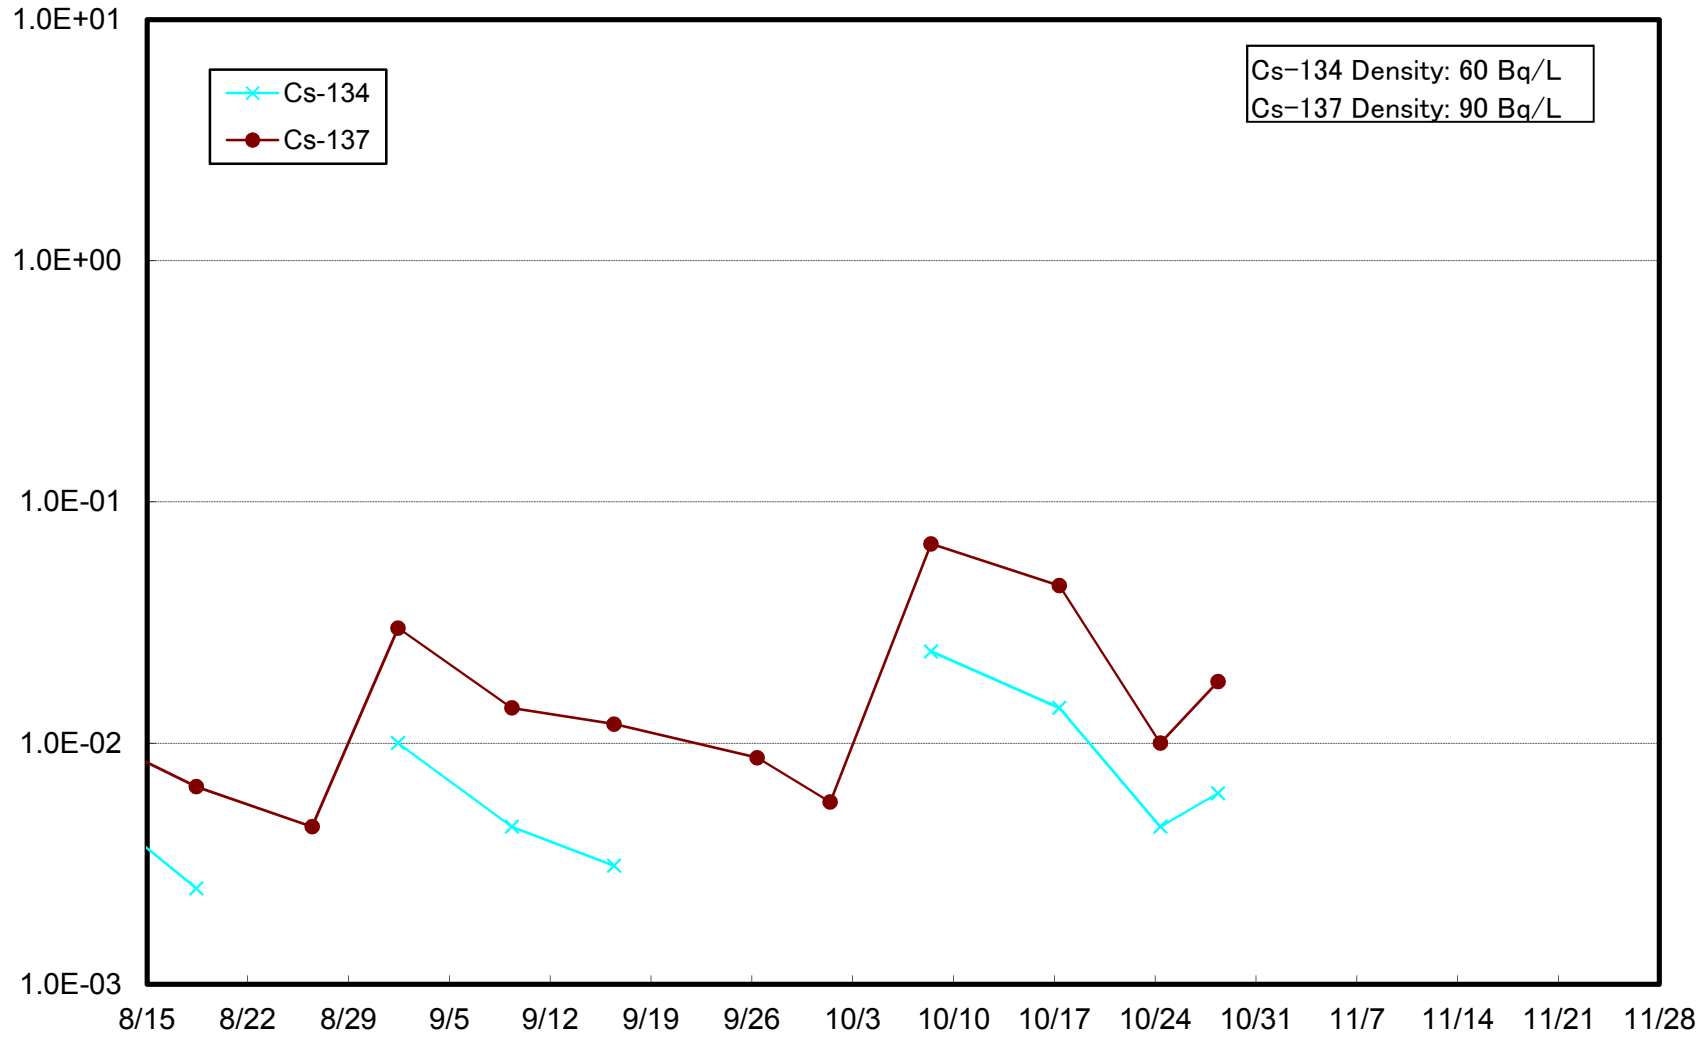


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daiichi NPS (T-D5) Lower Layer (Bq/L)

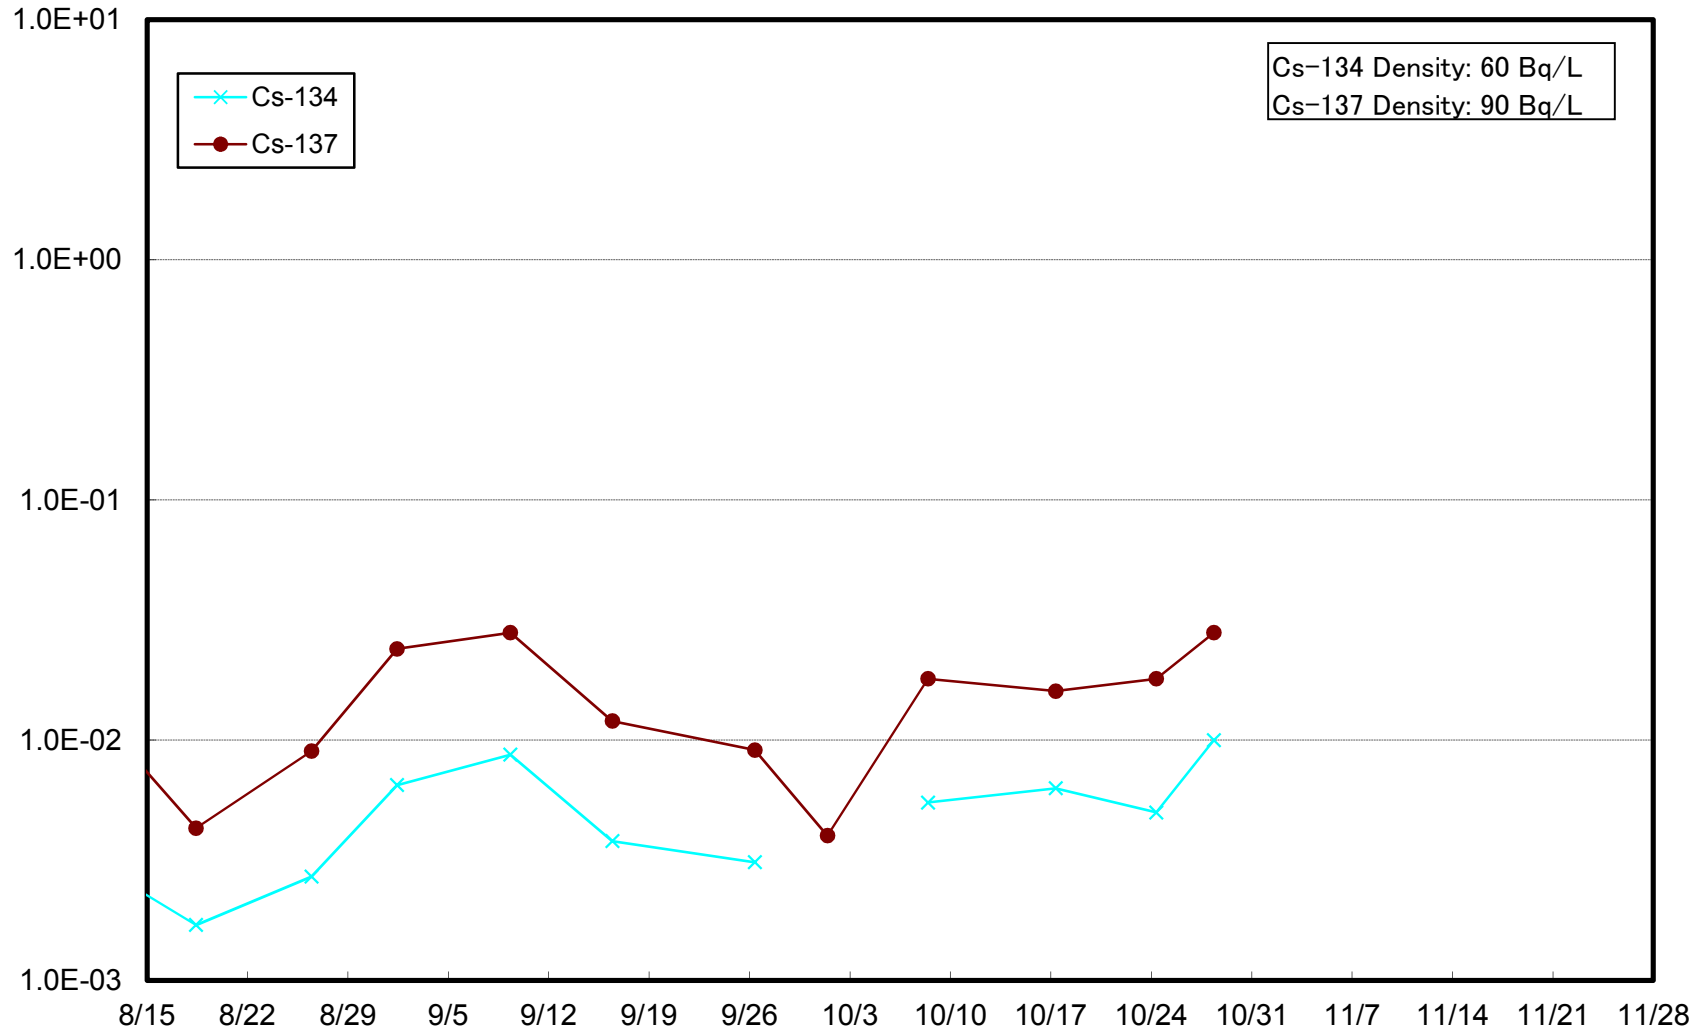


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Upper Layer (Bq/L)

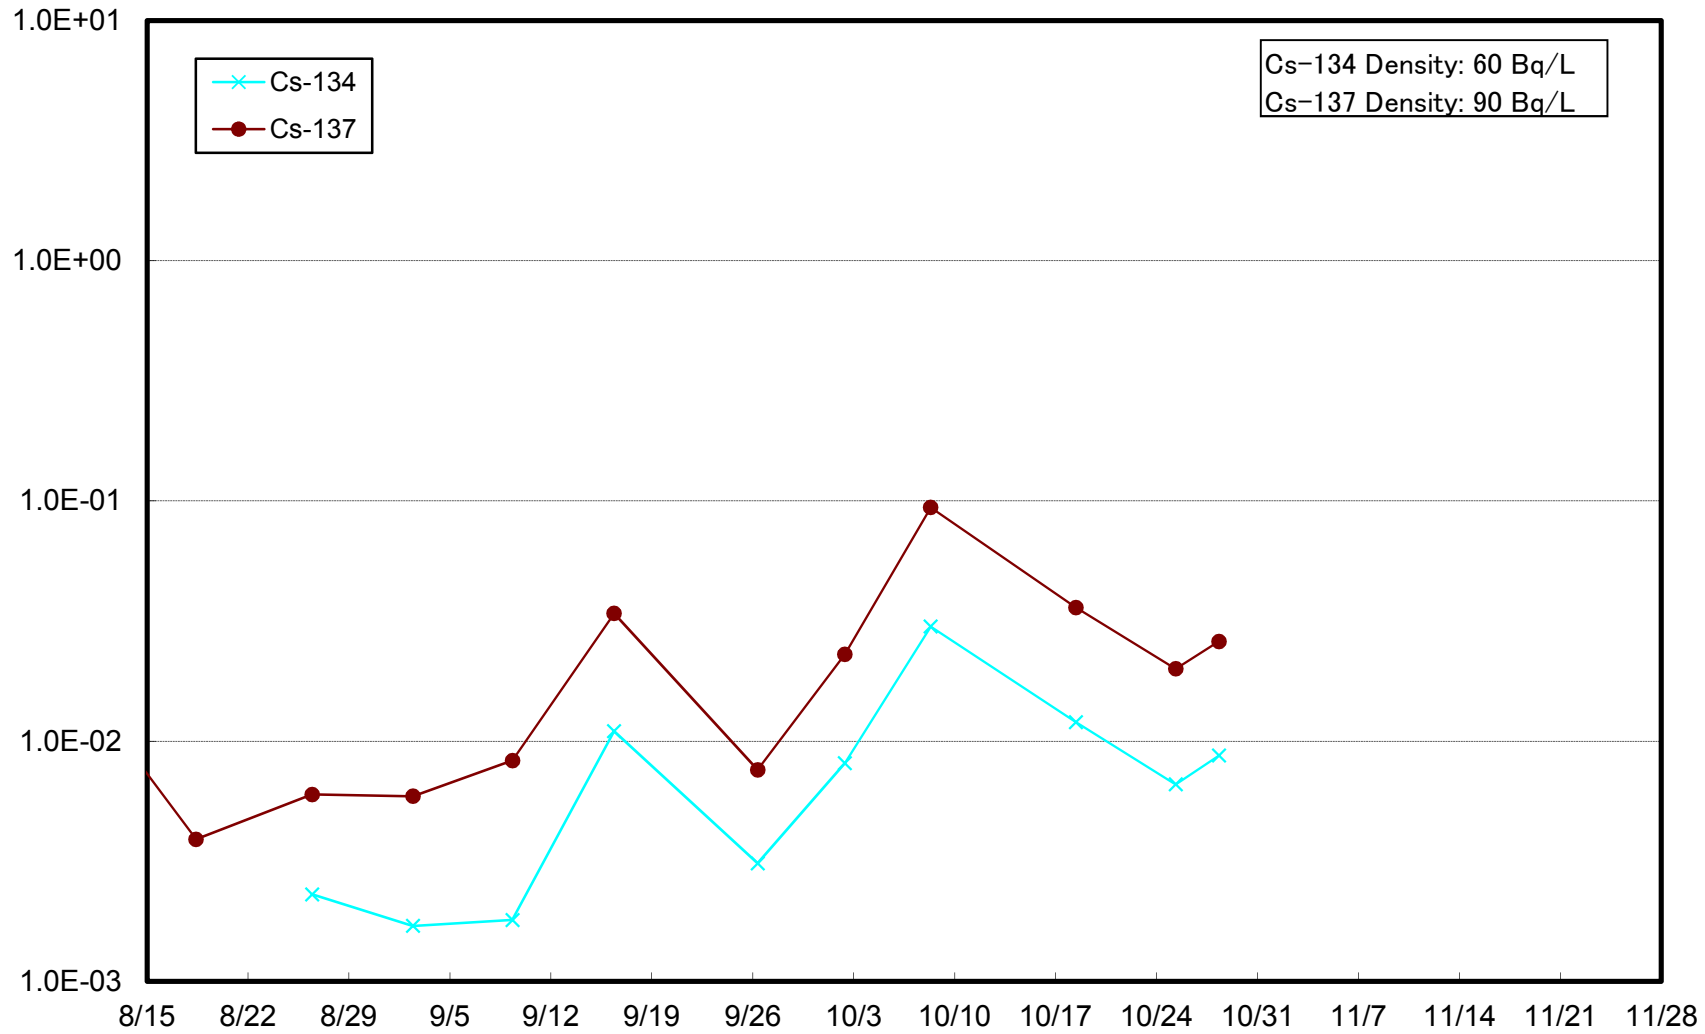


Radioactivity Density of the Seawater at 3km Offshore of Fukushima Daini NPS (T-D9) Lower Layer (Bq/L)

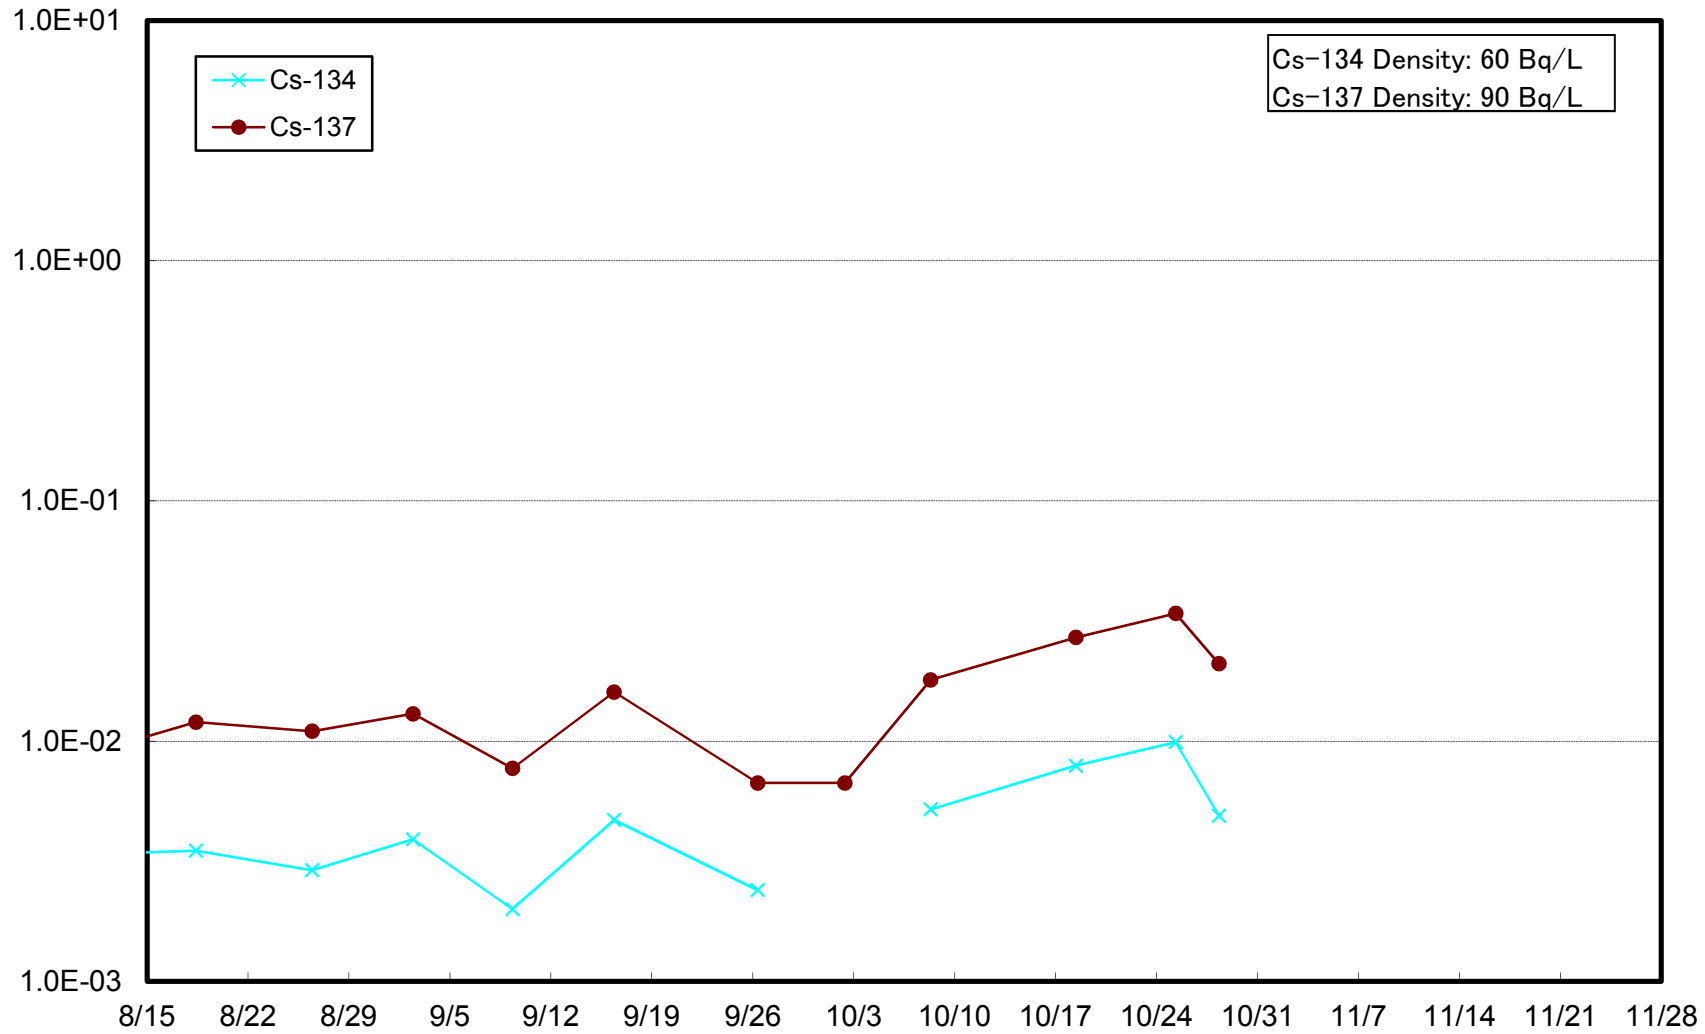


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Upper Layer (Bq/L)

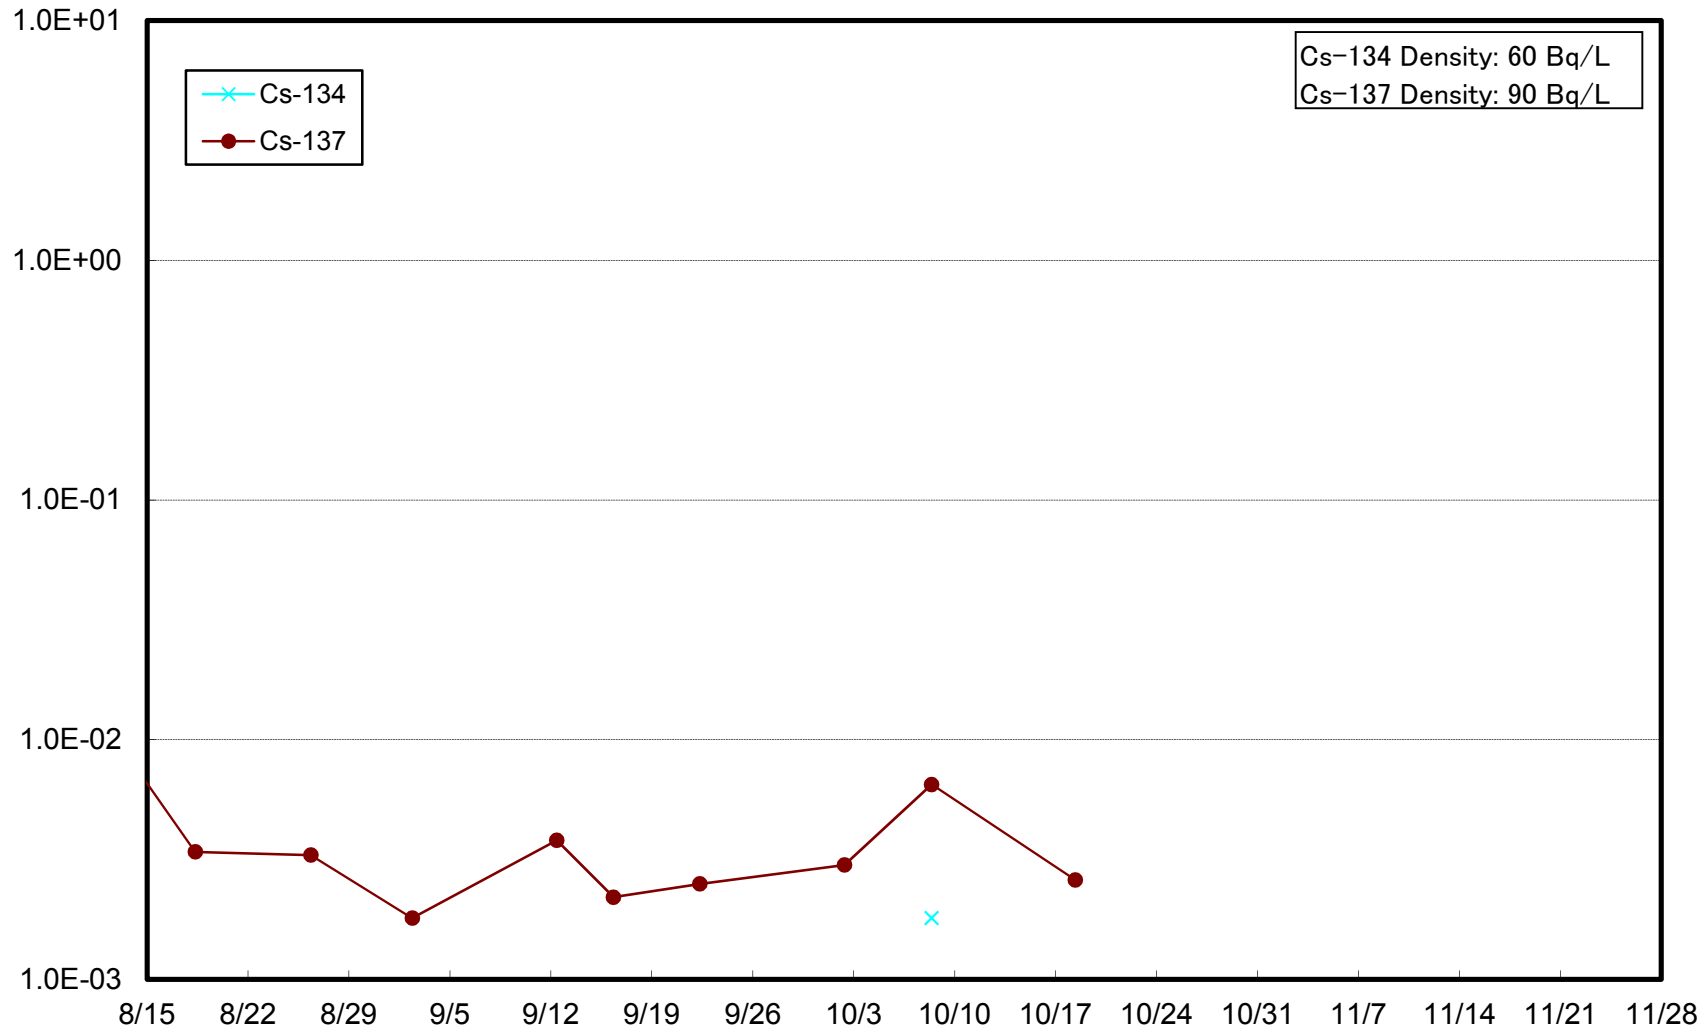


Radioactivity Density of the Seawater at 15km Offshore of Fukushima Daiichi NPS (T-5) Lower Layer (Bq/L)

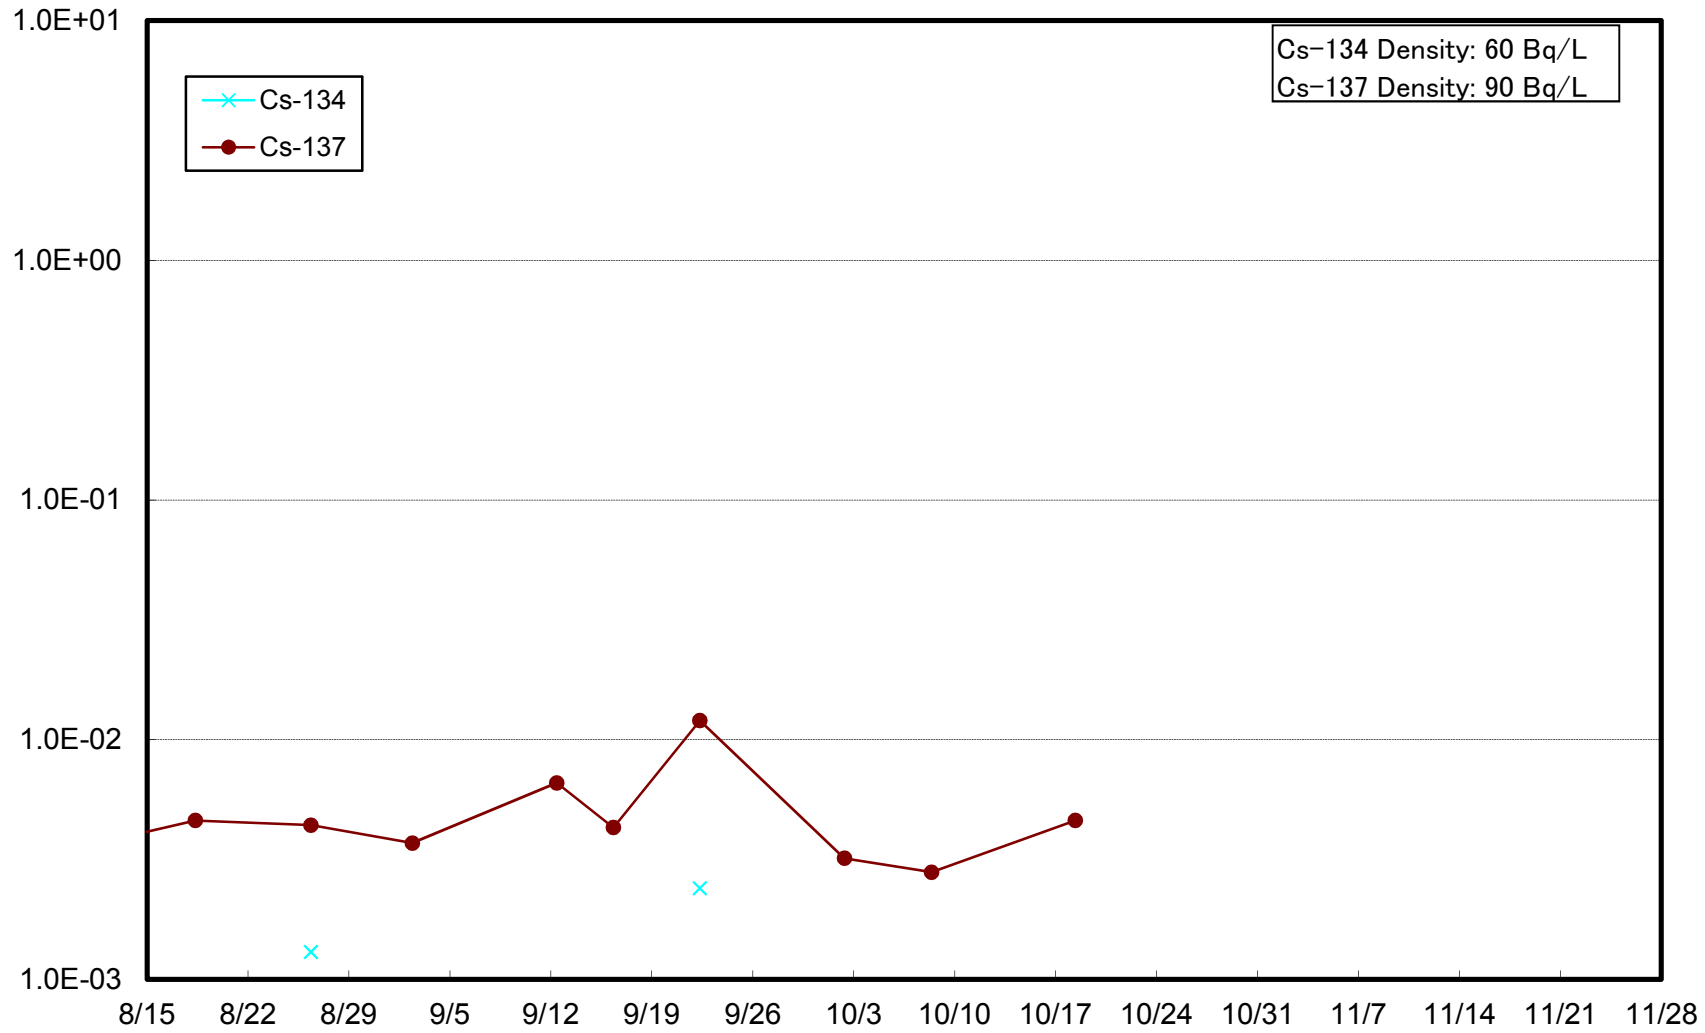


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Upper Layer (Bq/L)

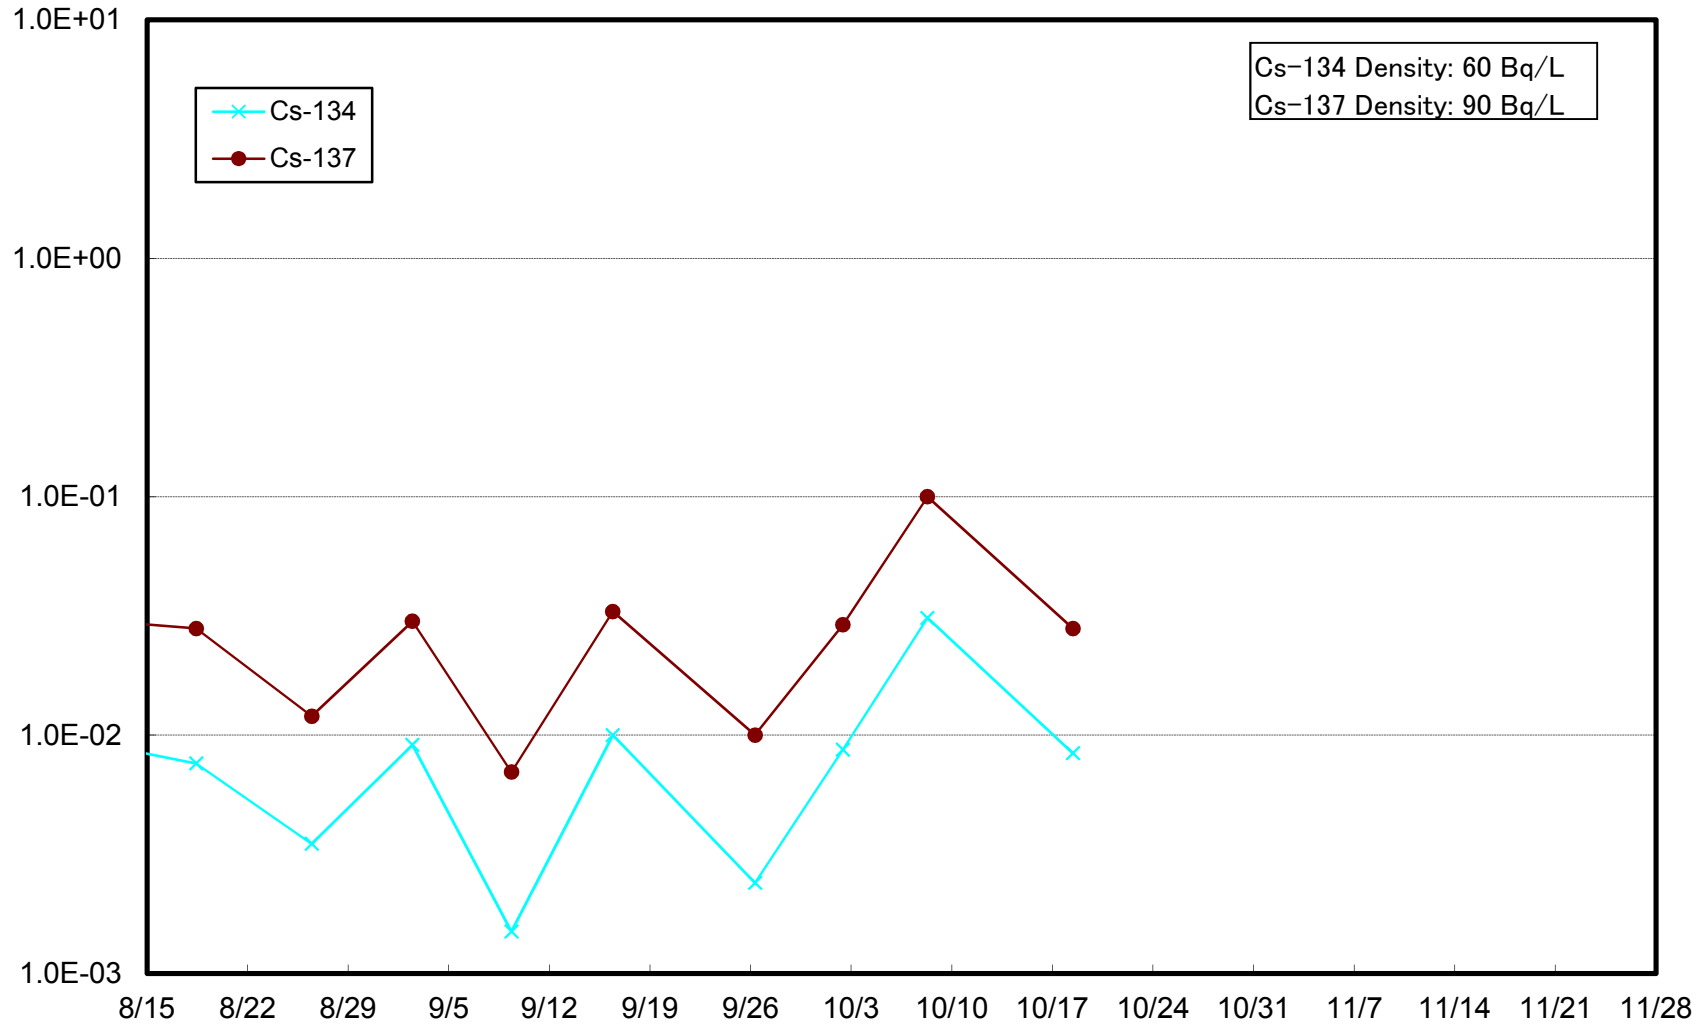


Radioactivity Density of the Seawater at 3km Offshore of Iwasawa Shore (T-11) Lower Layer (Bq/L)

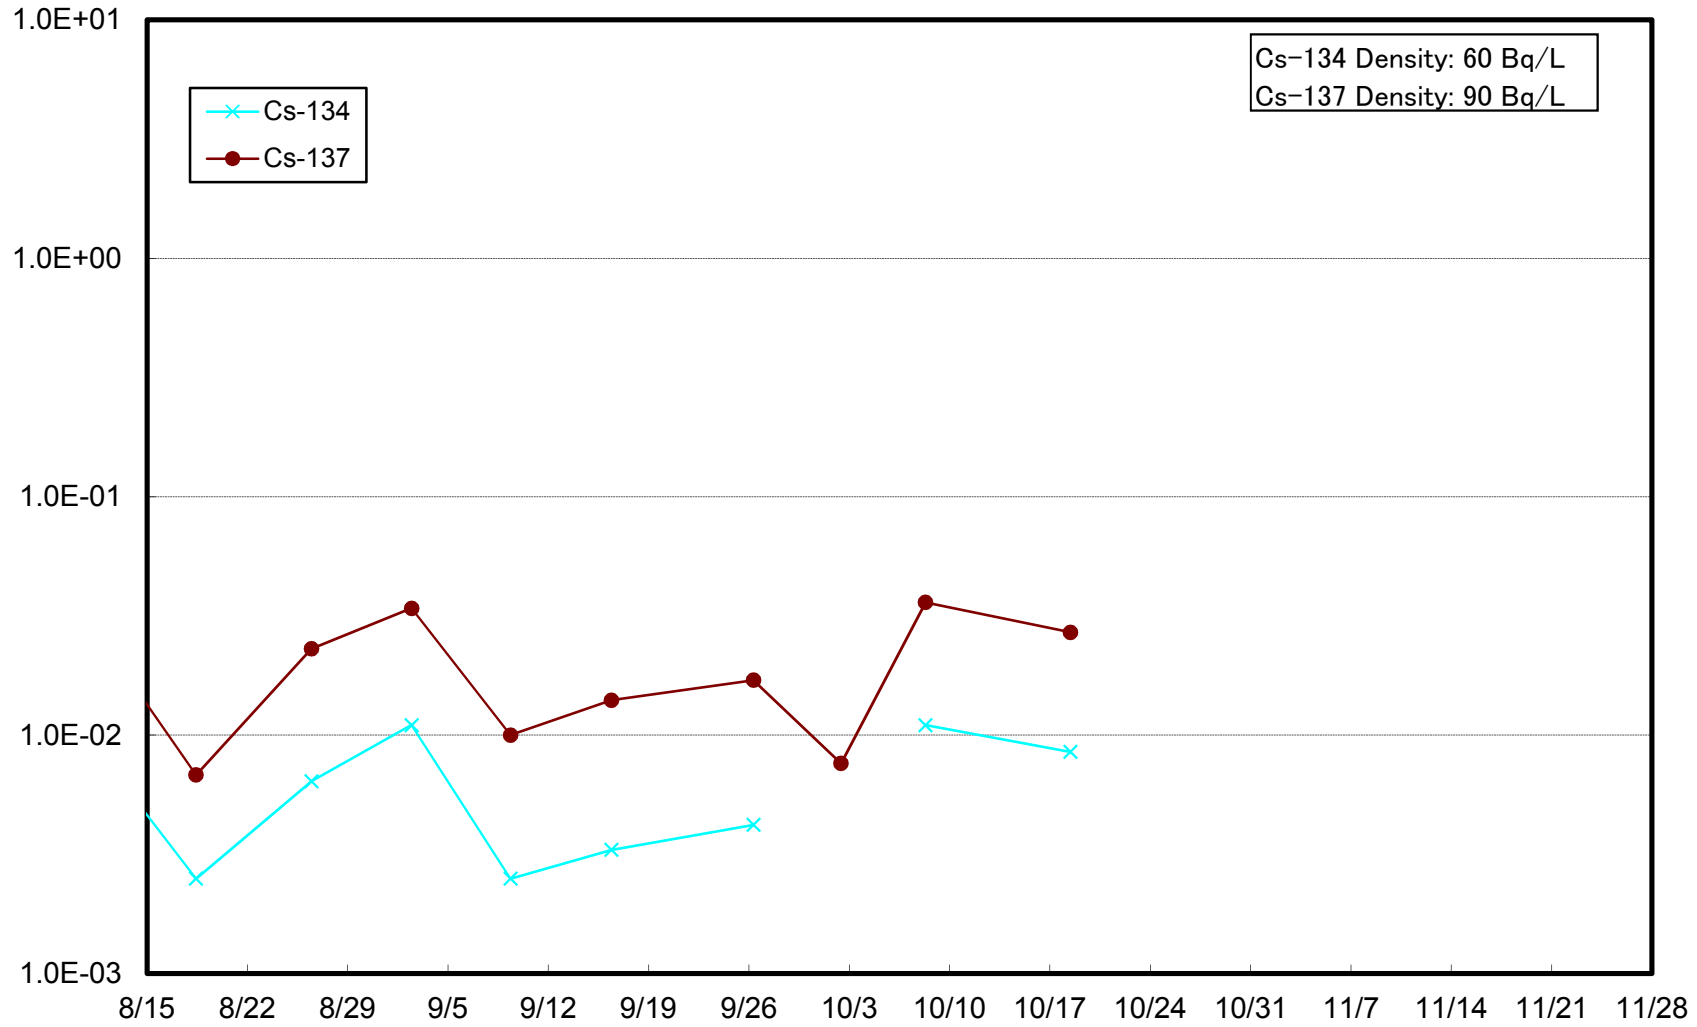


Radioactivity Density of the Seawater at 15km Offshore of Iwasawa Shore (T-7) Upper Layer (Bq/L)

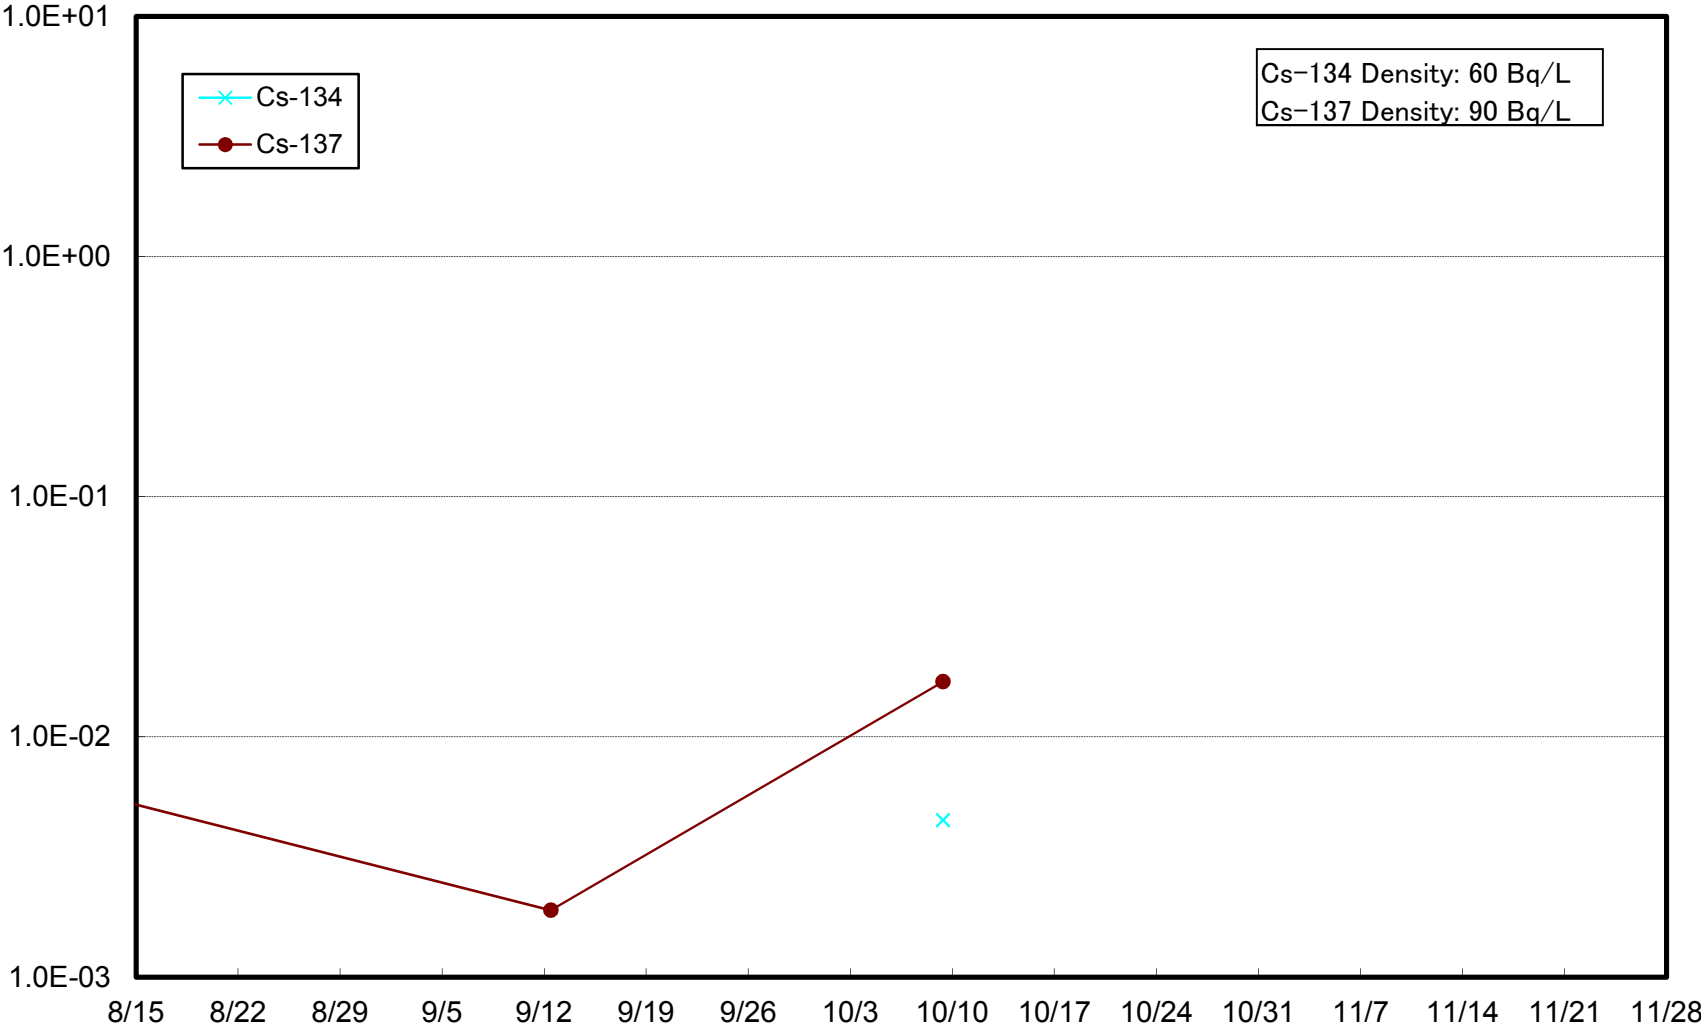


Radioactivity Density of the Seawater at 15km Offshore of Iwasawa Shore (T-7) Lower Layer (Bq/L)

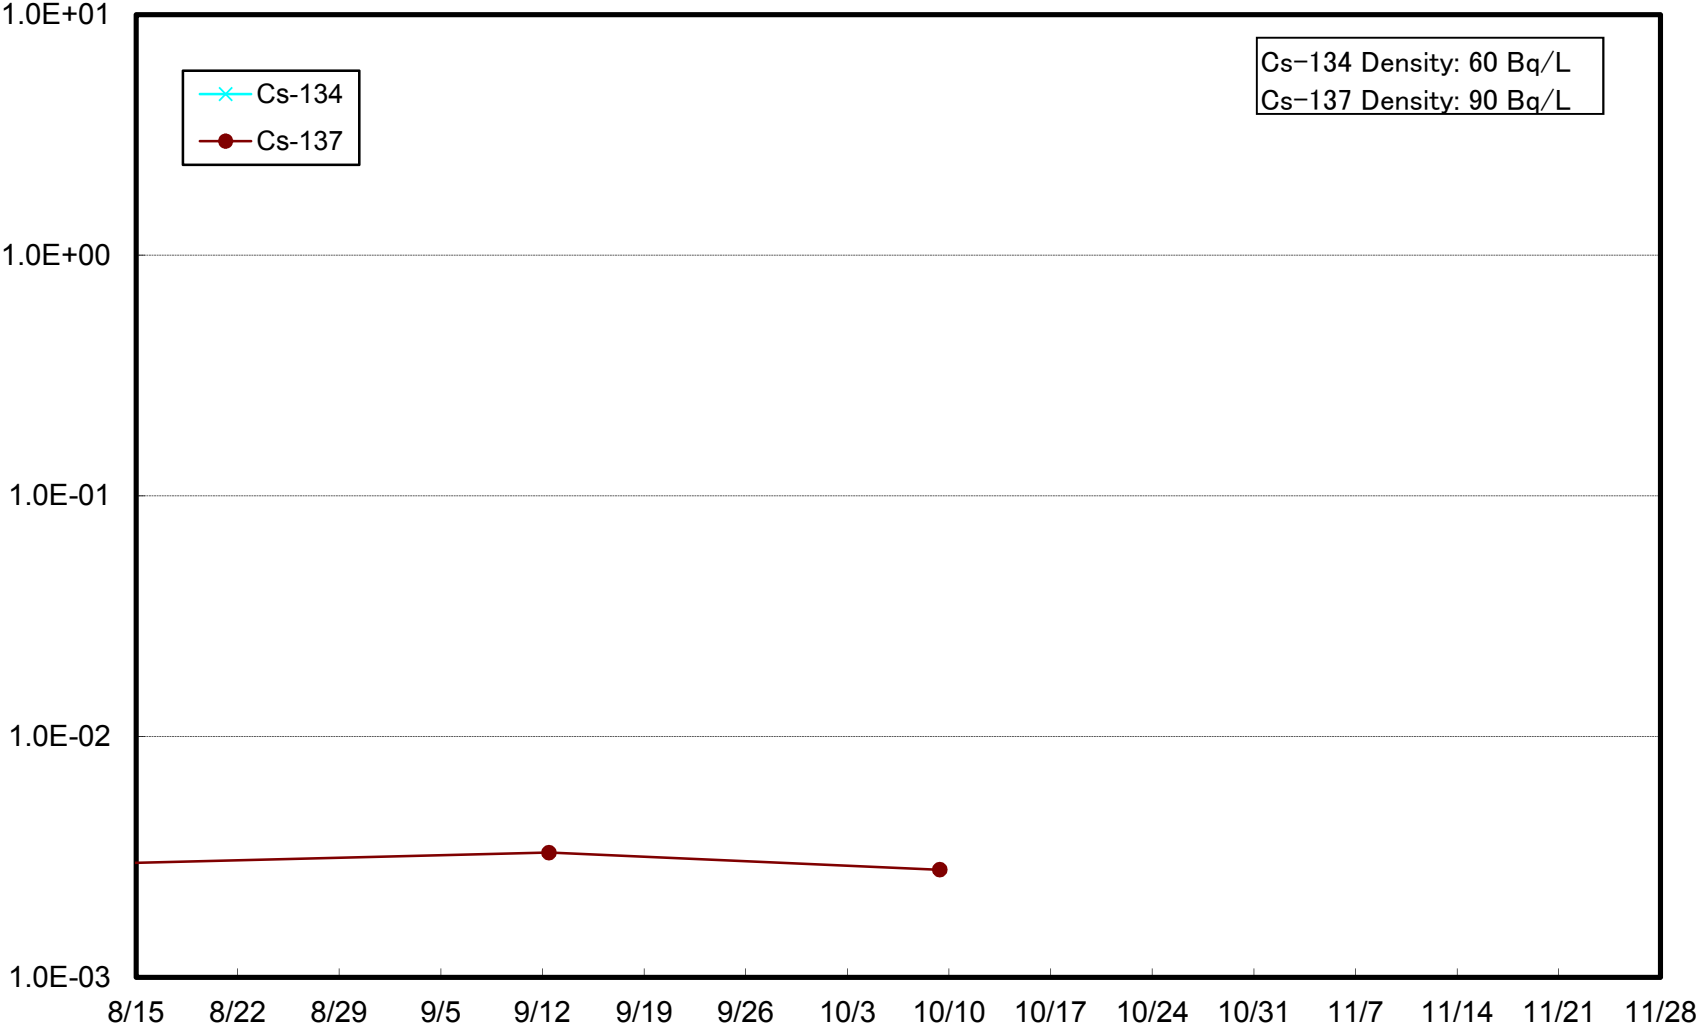


Radioactivity Density of the Seawater at 3km Offshore of Onahama Port (T-18) Upper Layer (Bq/L)

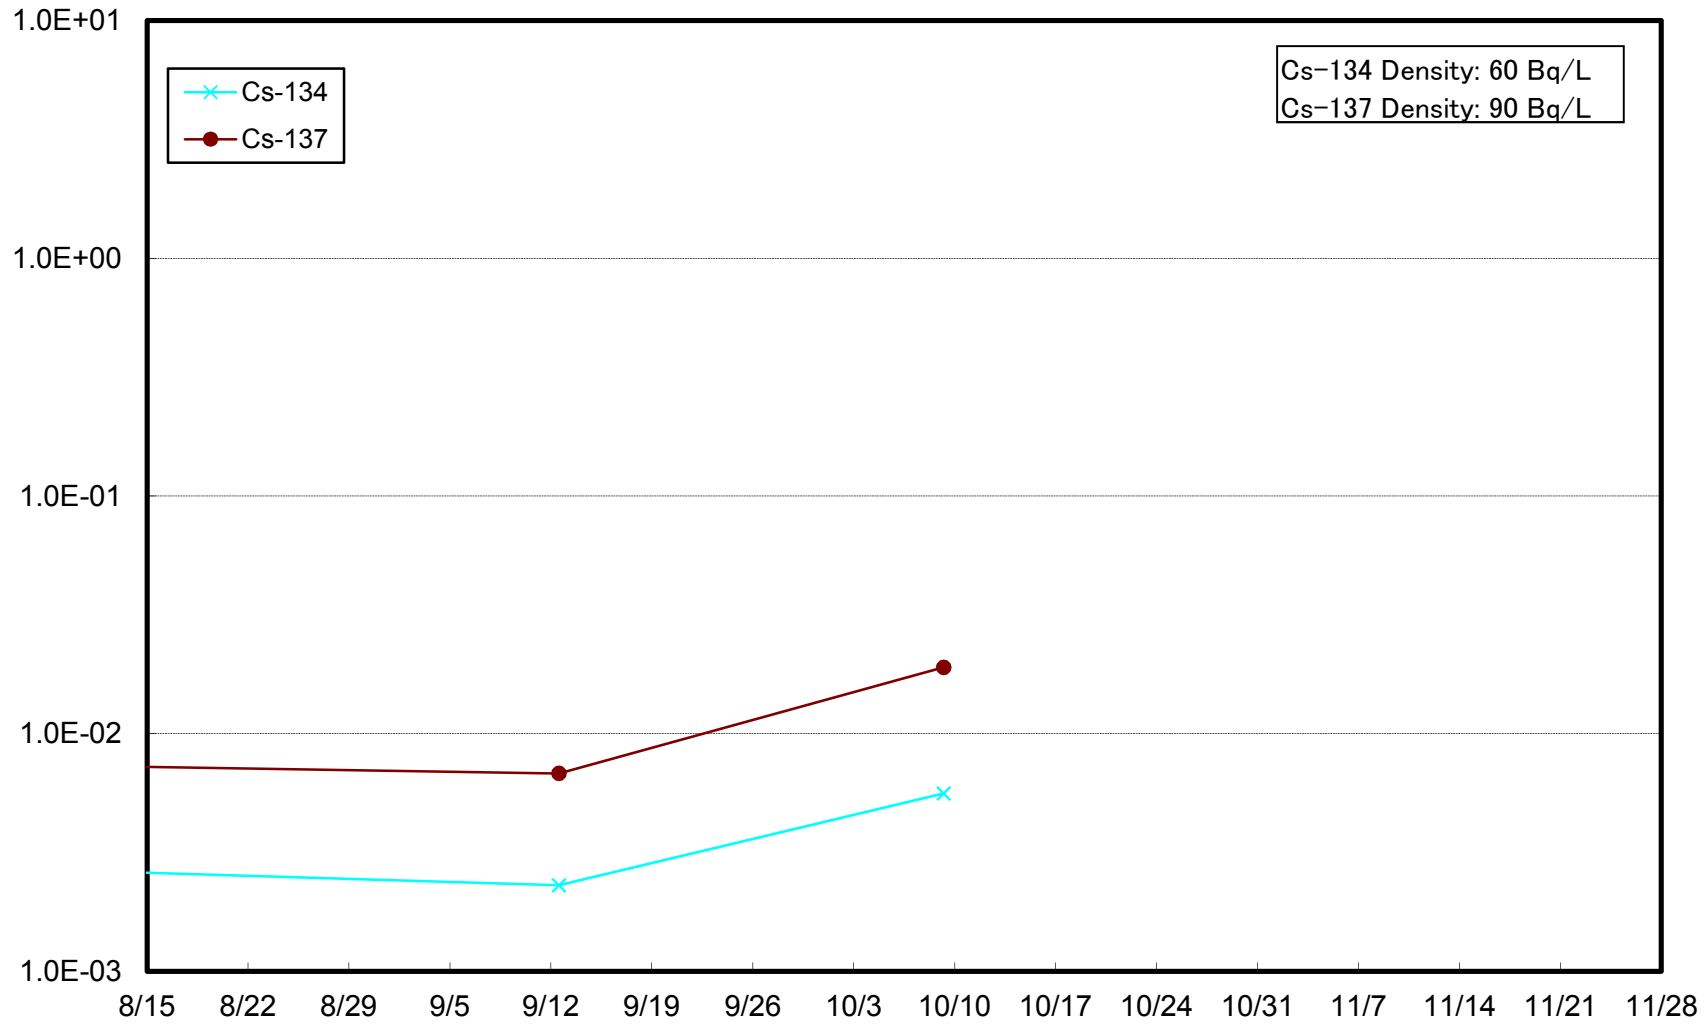


Radioactivity Density of the Seawater at 3km Offshore of Onahama Port (T-18) Lower Layer (Bq/L)

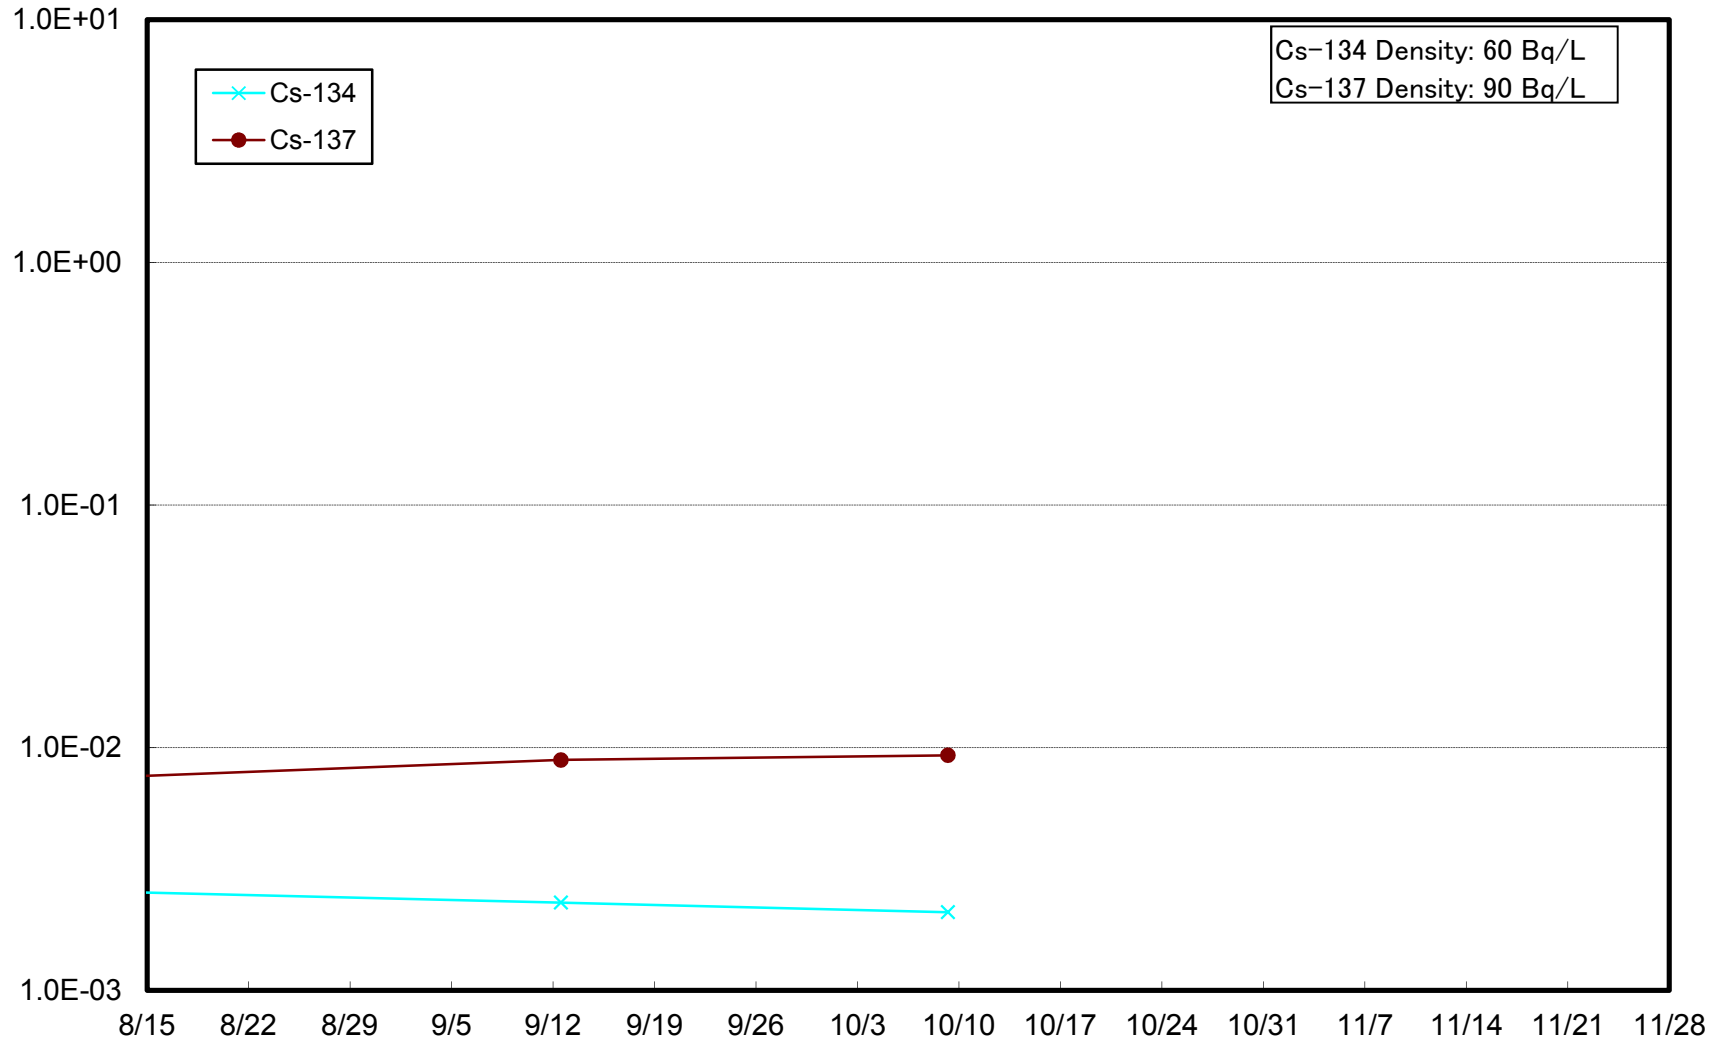


Radioactivity Density of the Seawater at 5km Offshore of Numanouchi (T-M10) Upper Layer (Bq/L)

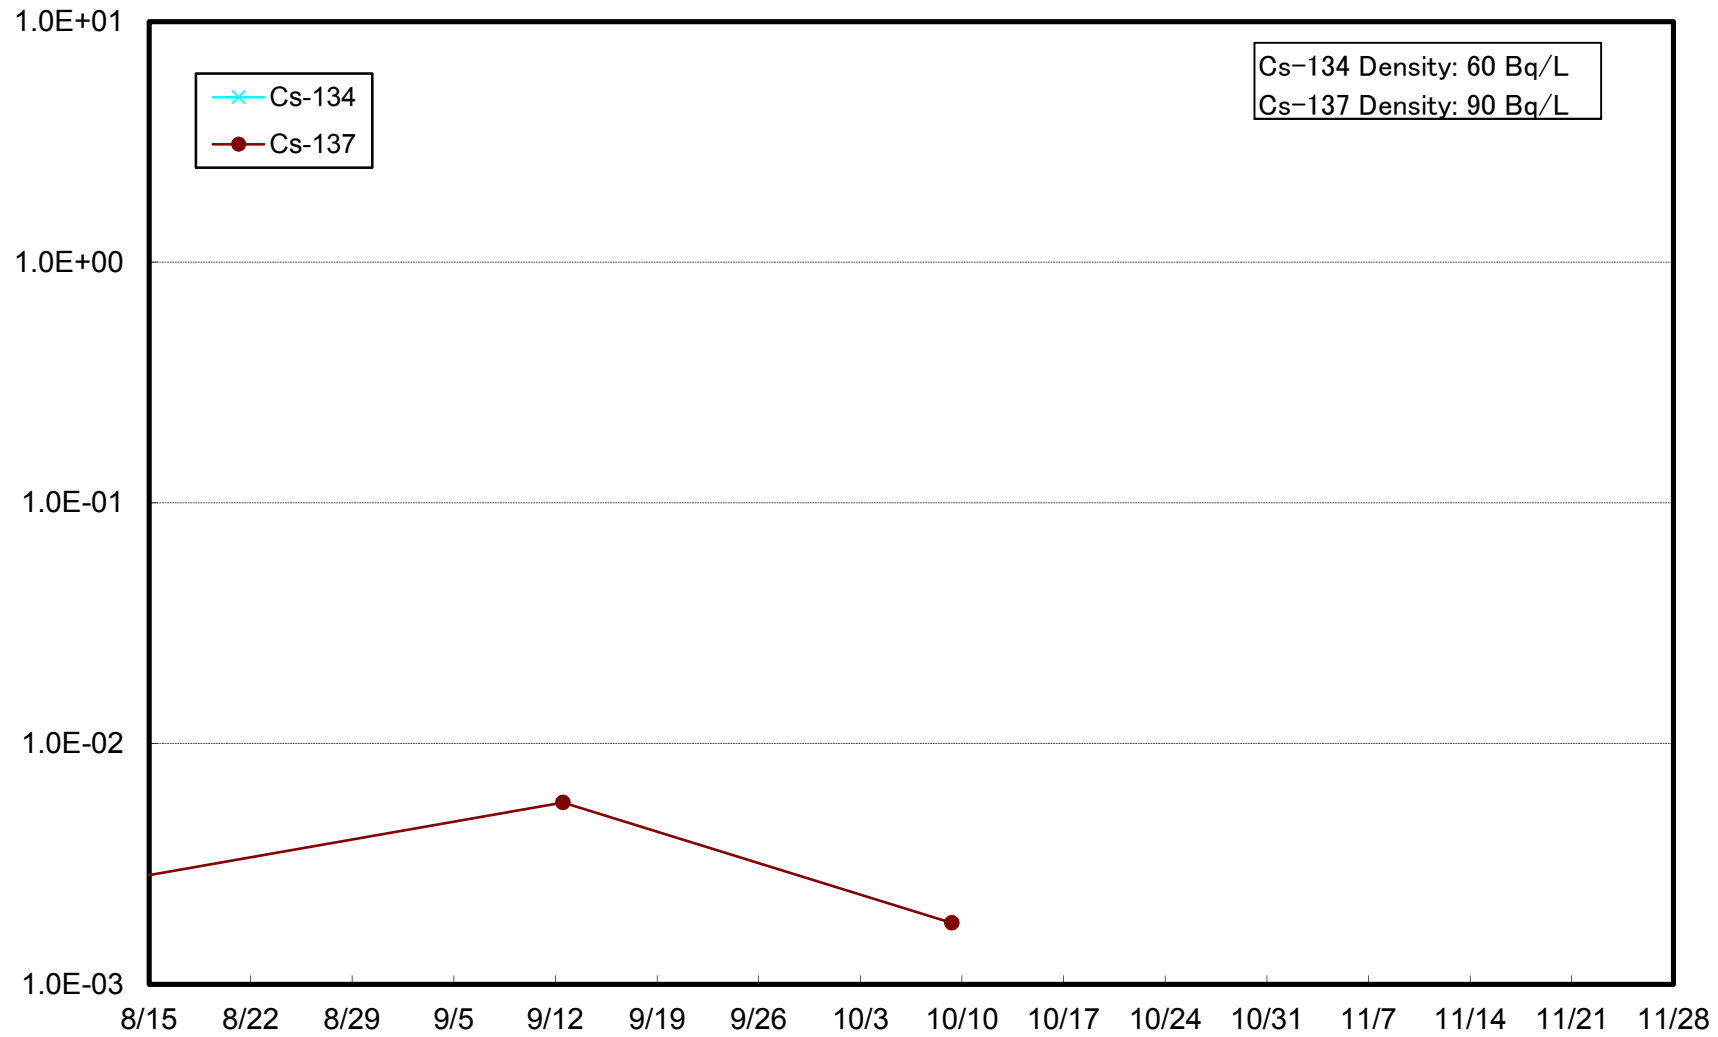


Radioactivity Density of the Seawater at 5km Offshore of Numanouchi (T-M10) Lower Layer (Bq/L)

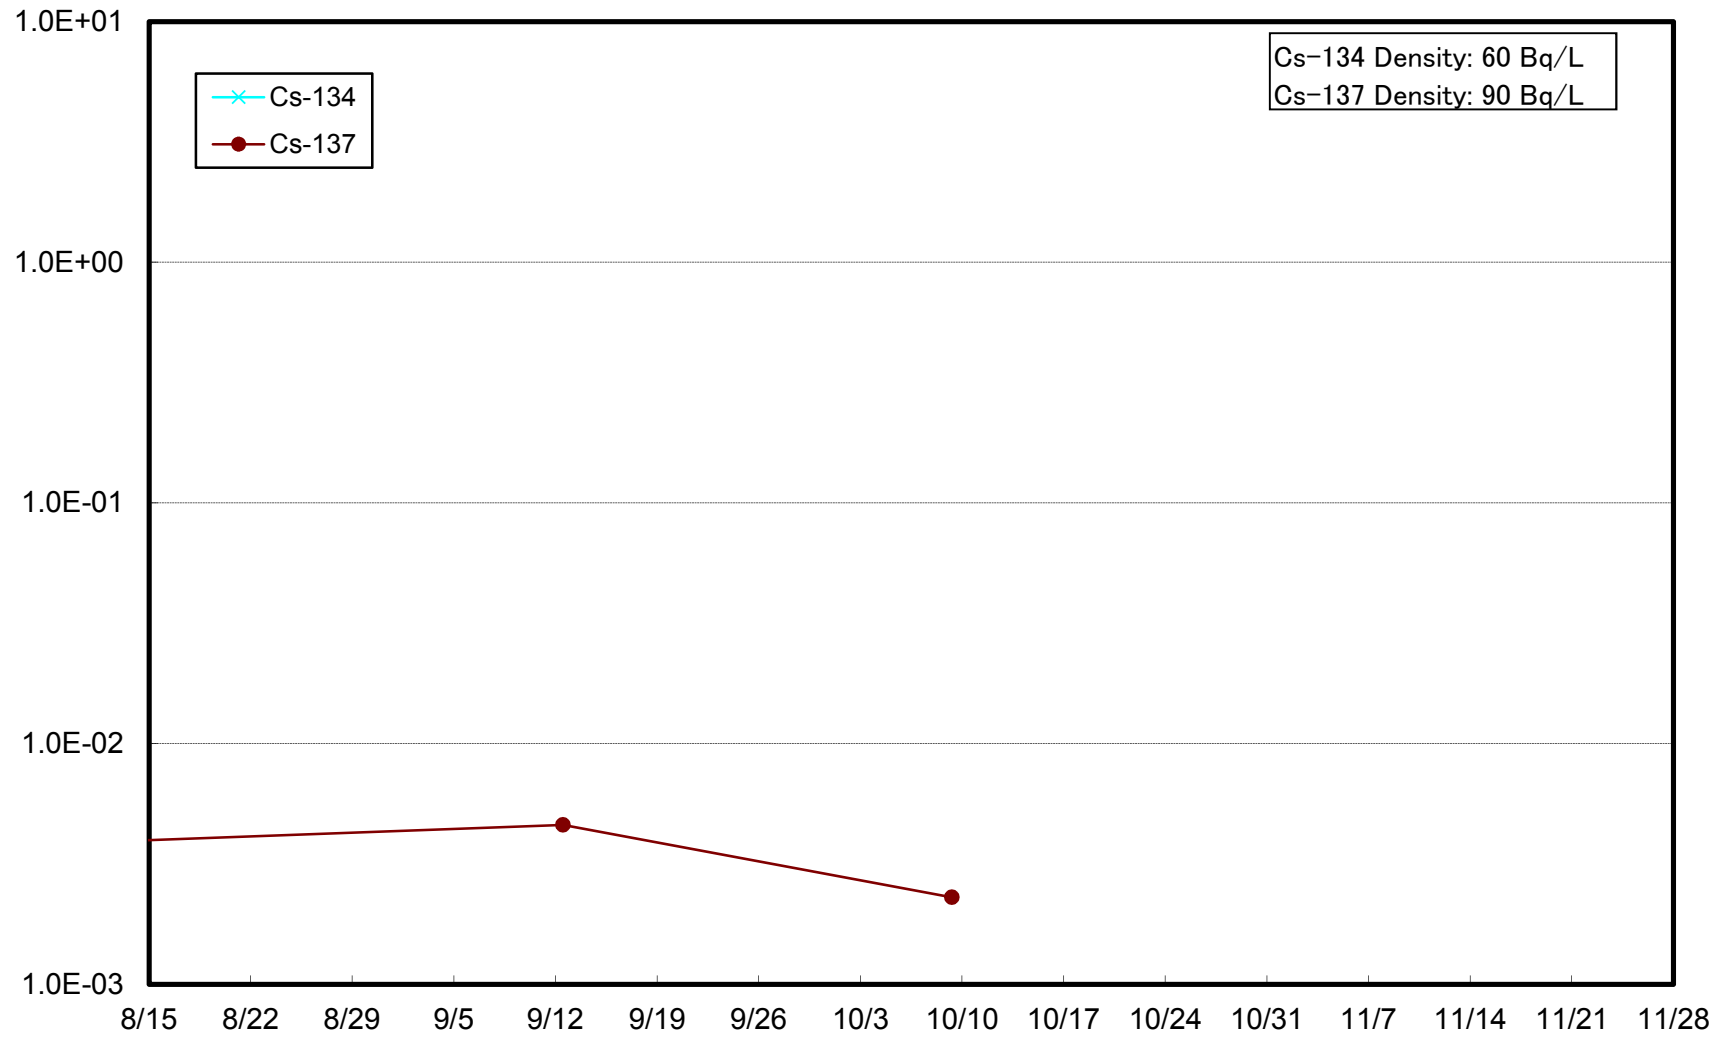


Radioactivity Density of the Seawater at 1km Offshore of Niidagawa river(T-13-1) Upper Layer (Bq/L)

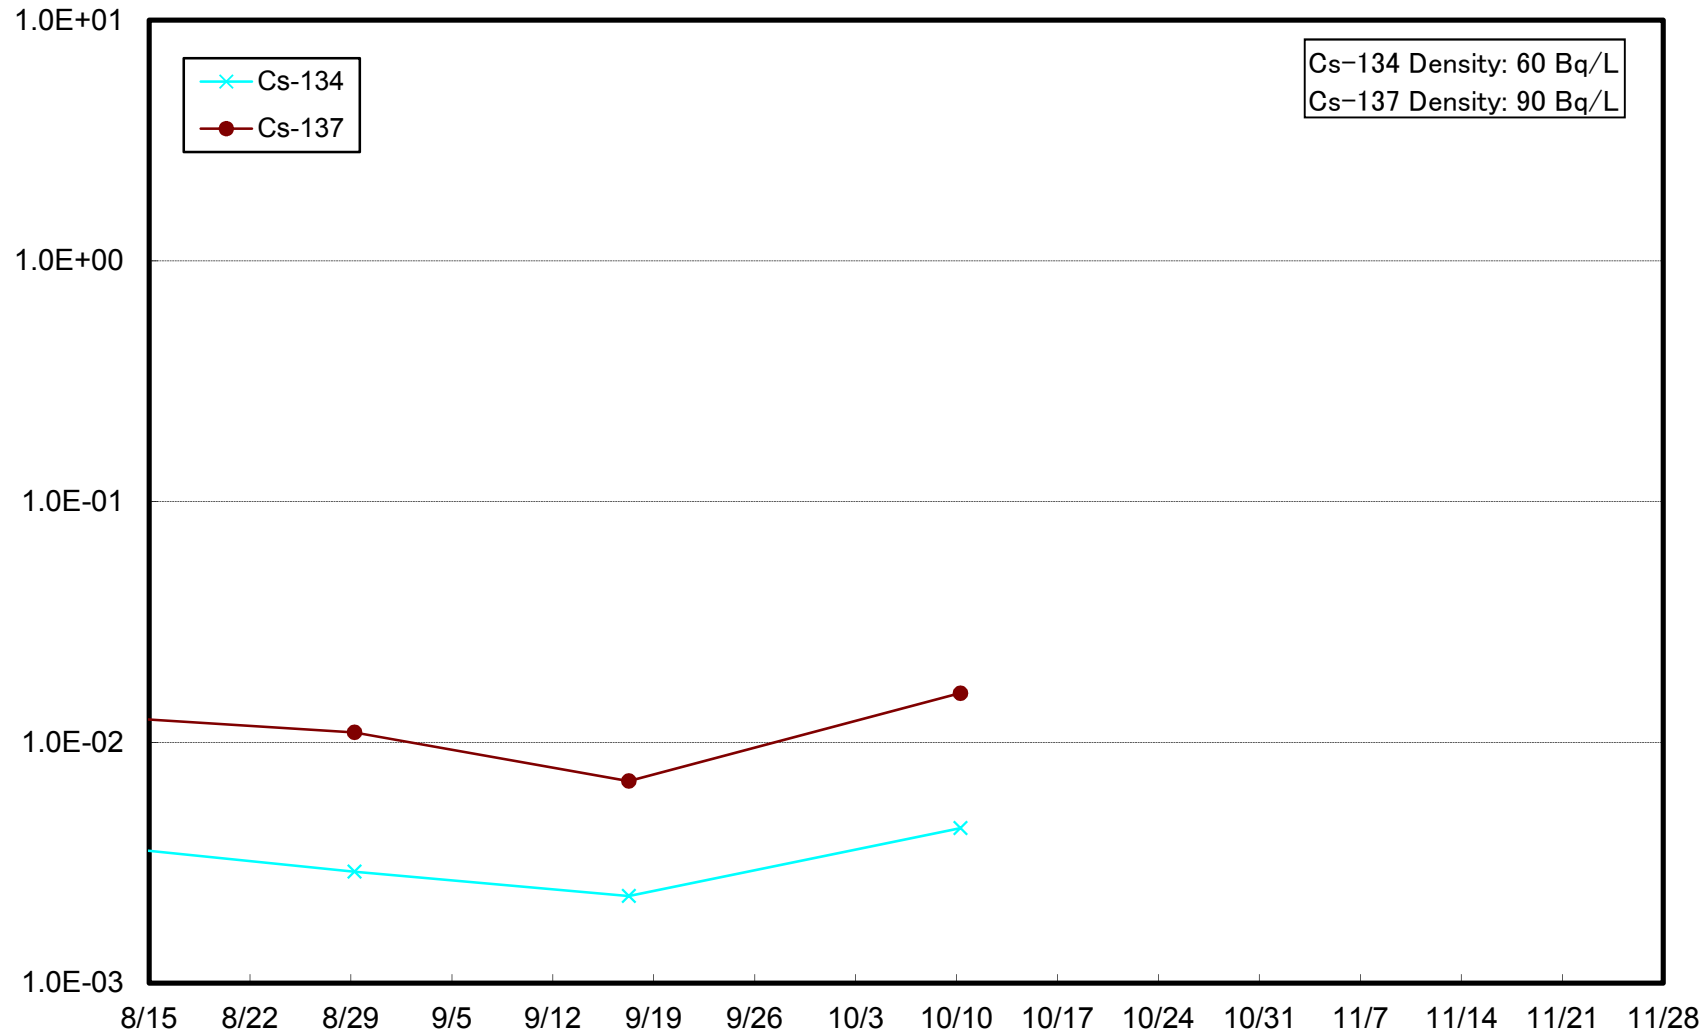


Radioactivity Density of the Seawater at 1km Offshore of Niidagawa river(T-13-1) Lower Layer (Bq/L)

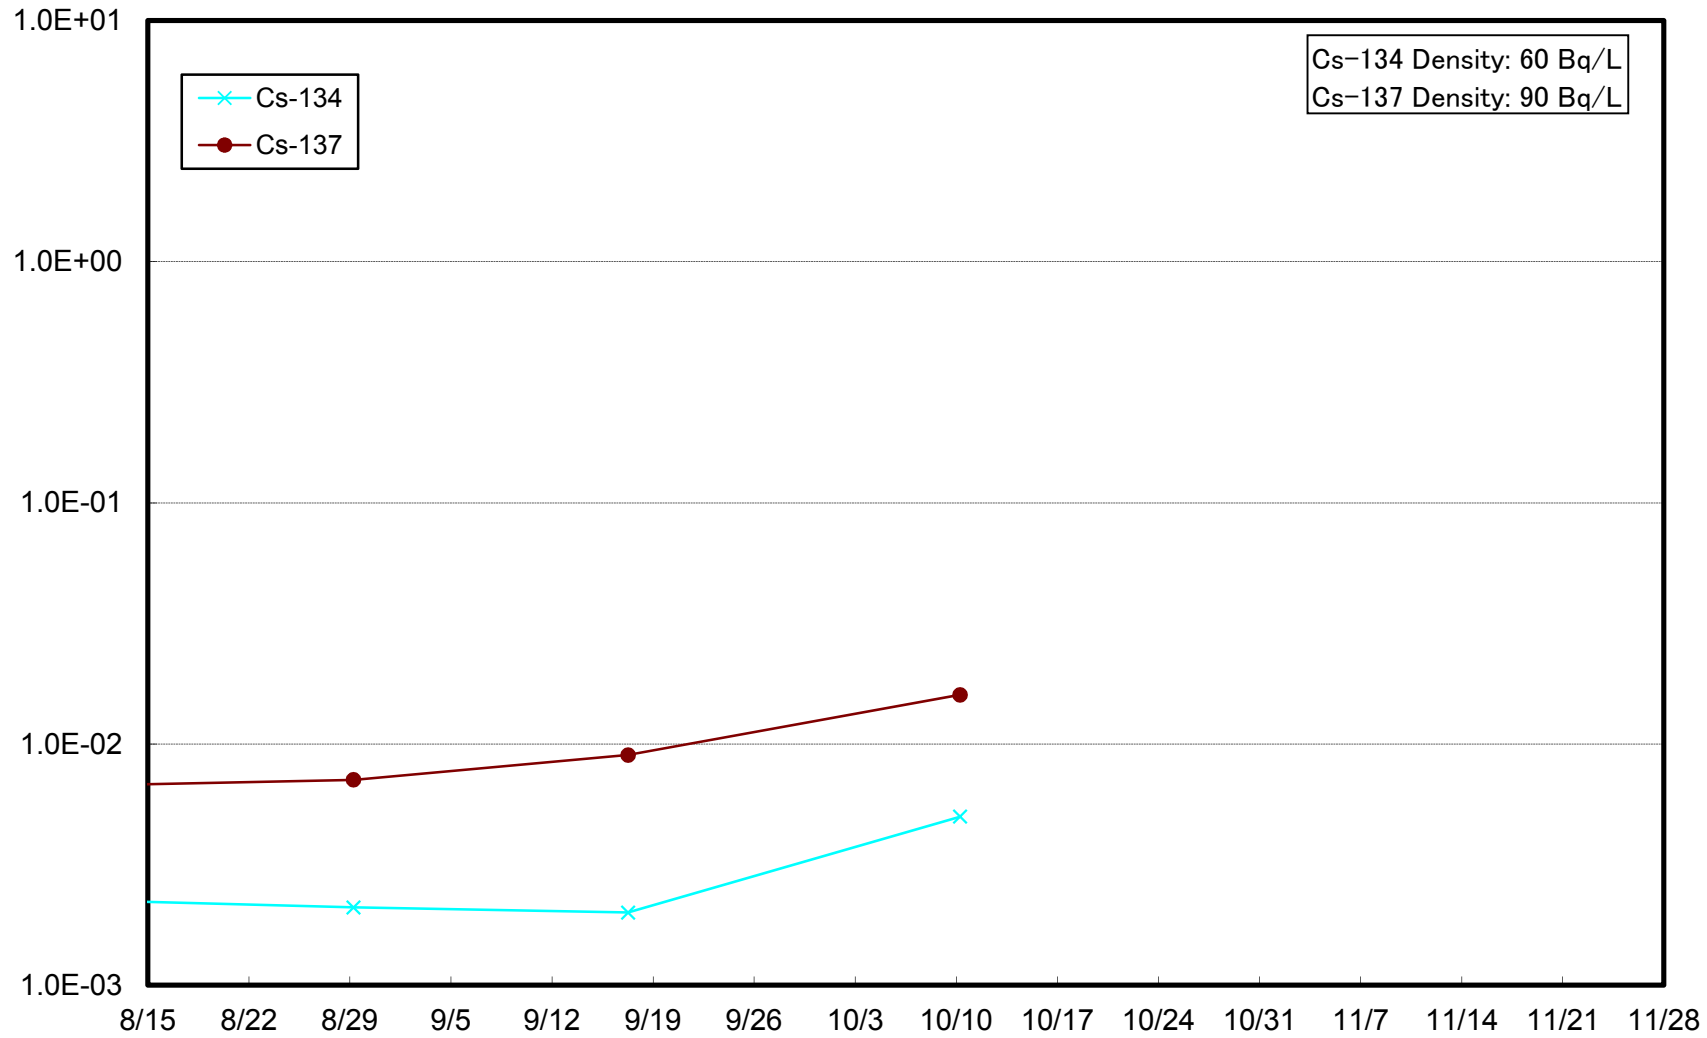


Radioactivity Density of the Seawater at 3km Offshore of Souma(T-22) Upper Layer (Bq/L)

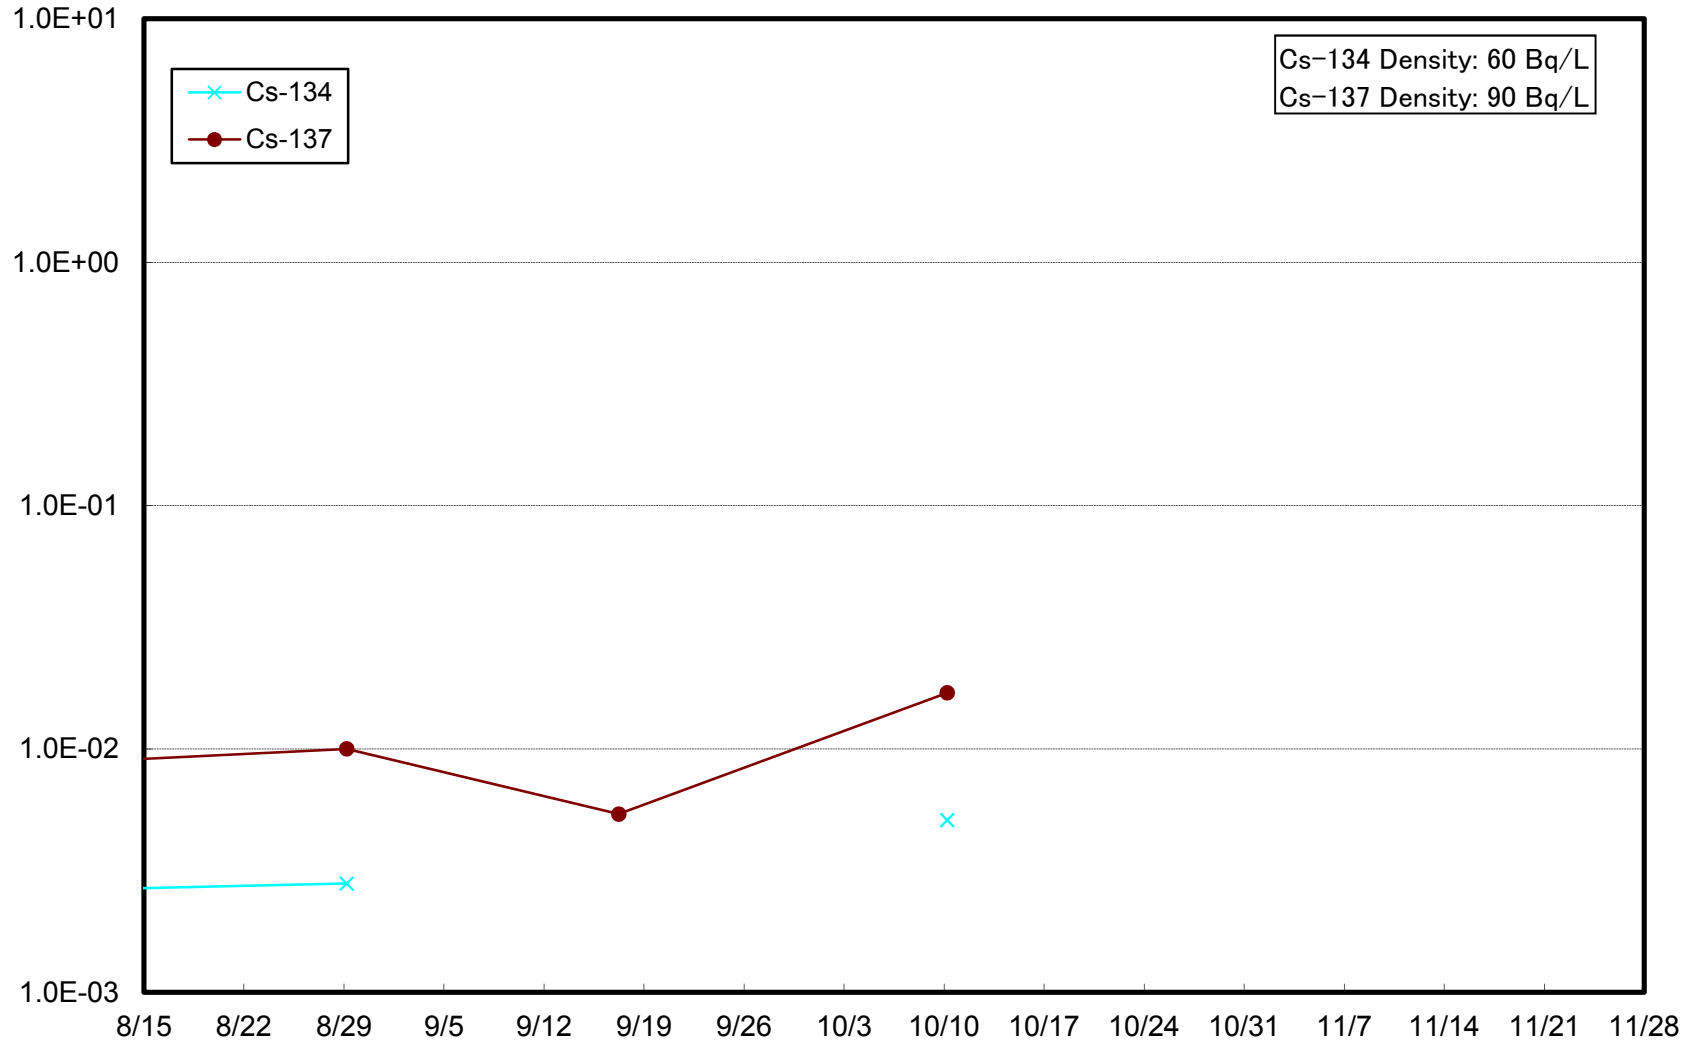


Radioactivity Density of the Seawater at 3km Offshore of Souma(T-22) Lower Layer (Bq/L)

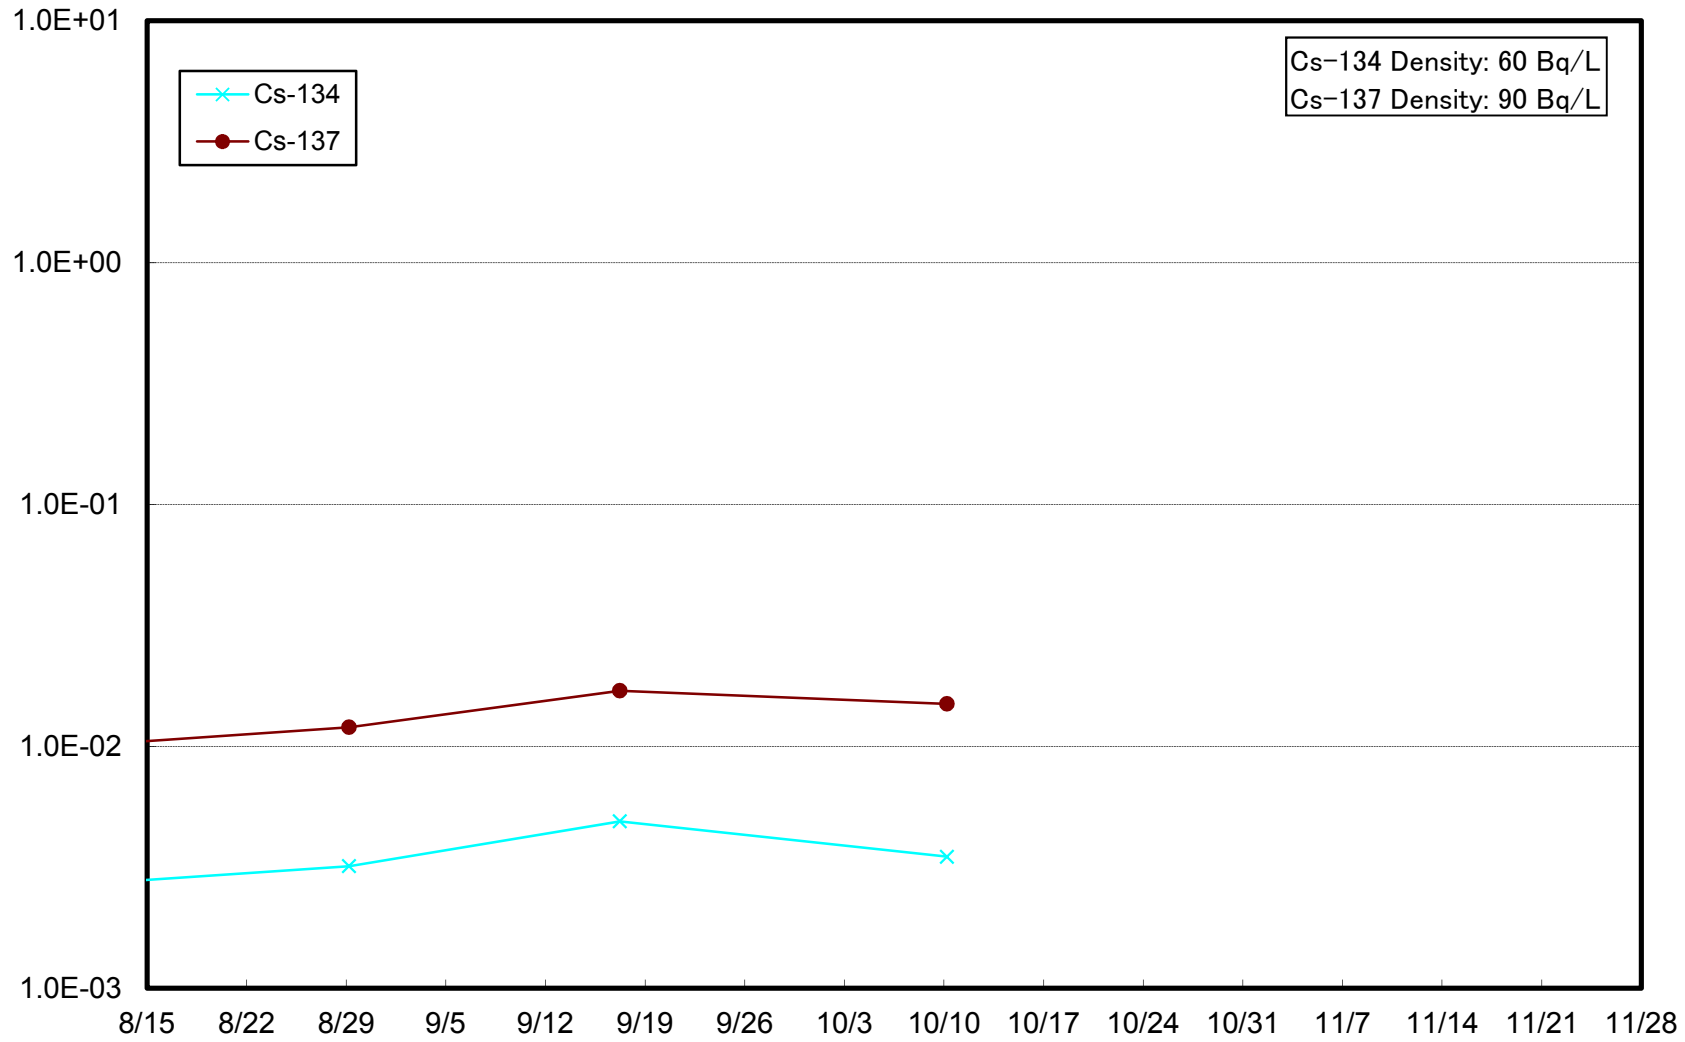


Radioactivity Density of the Seawater at 5km Offshore of Kashima(T-MA) Upper Layer (Bq/L)

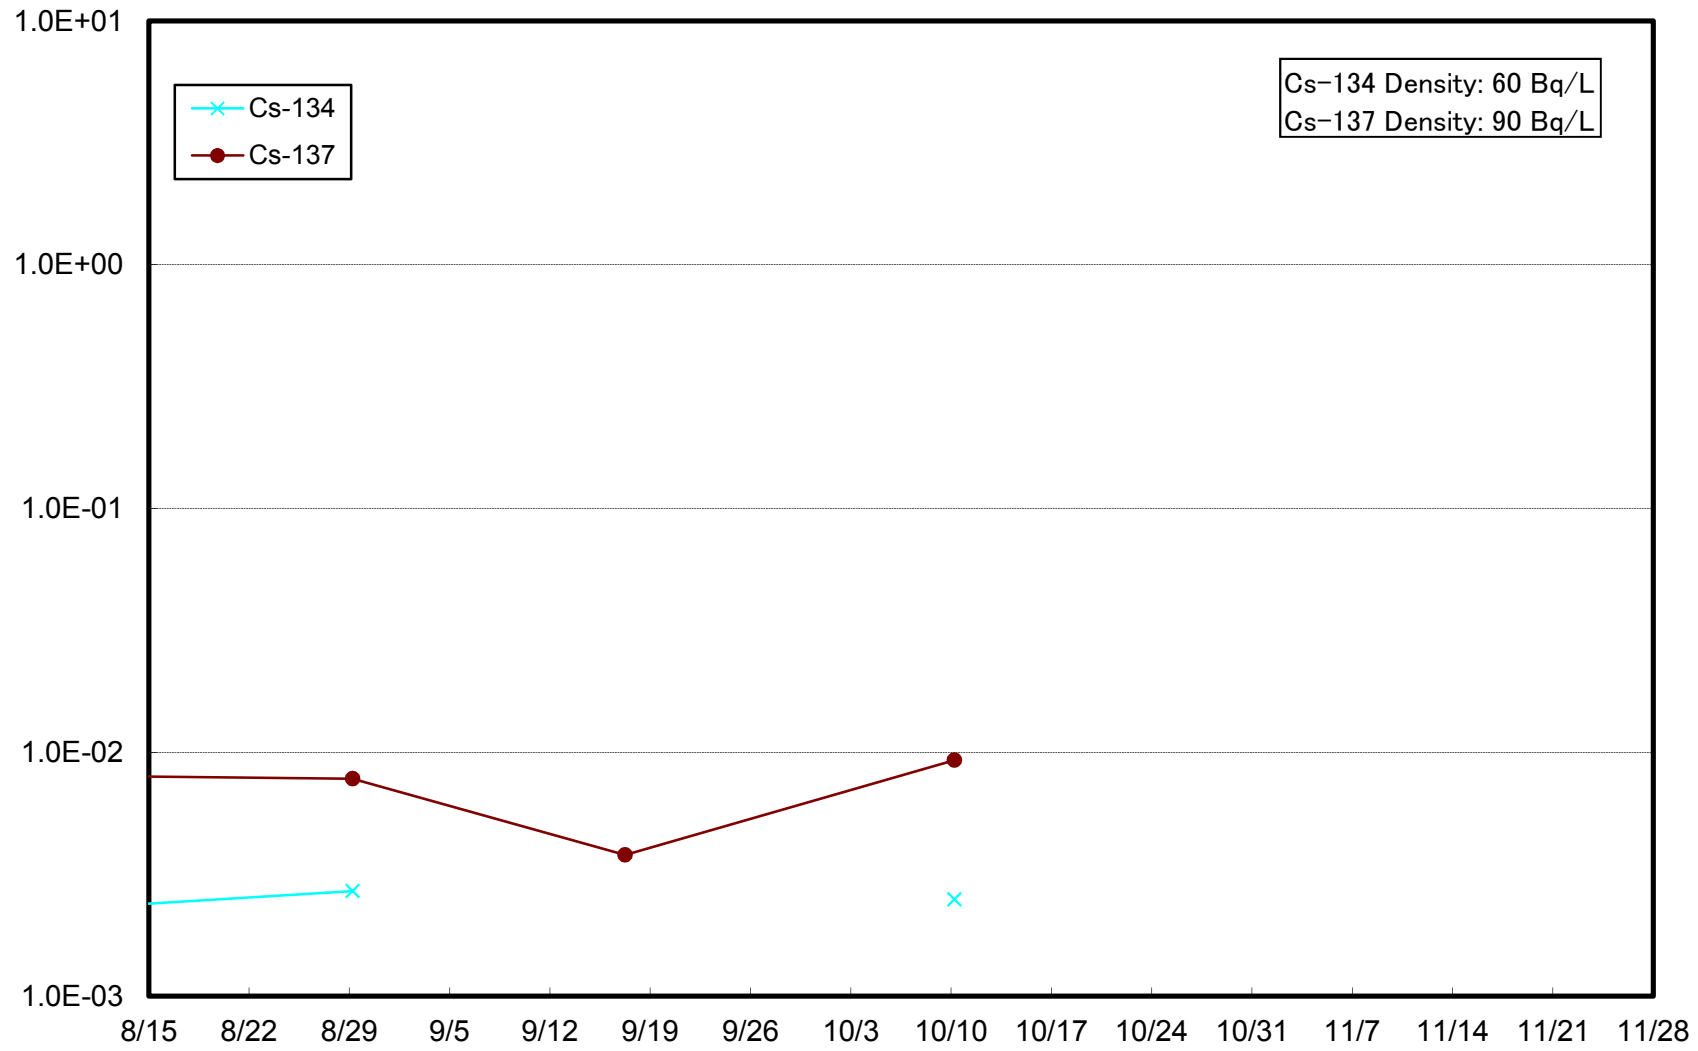


Radioactivity Density of the Seawater at 5km Offshore of Kashima(T-MA) Lower Layer (Bq/L)

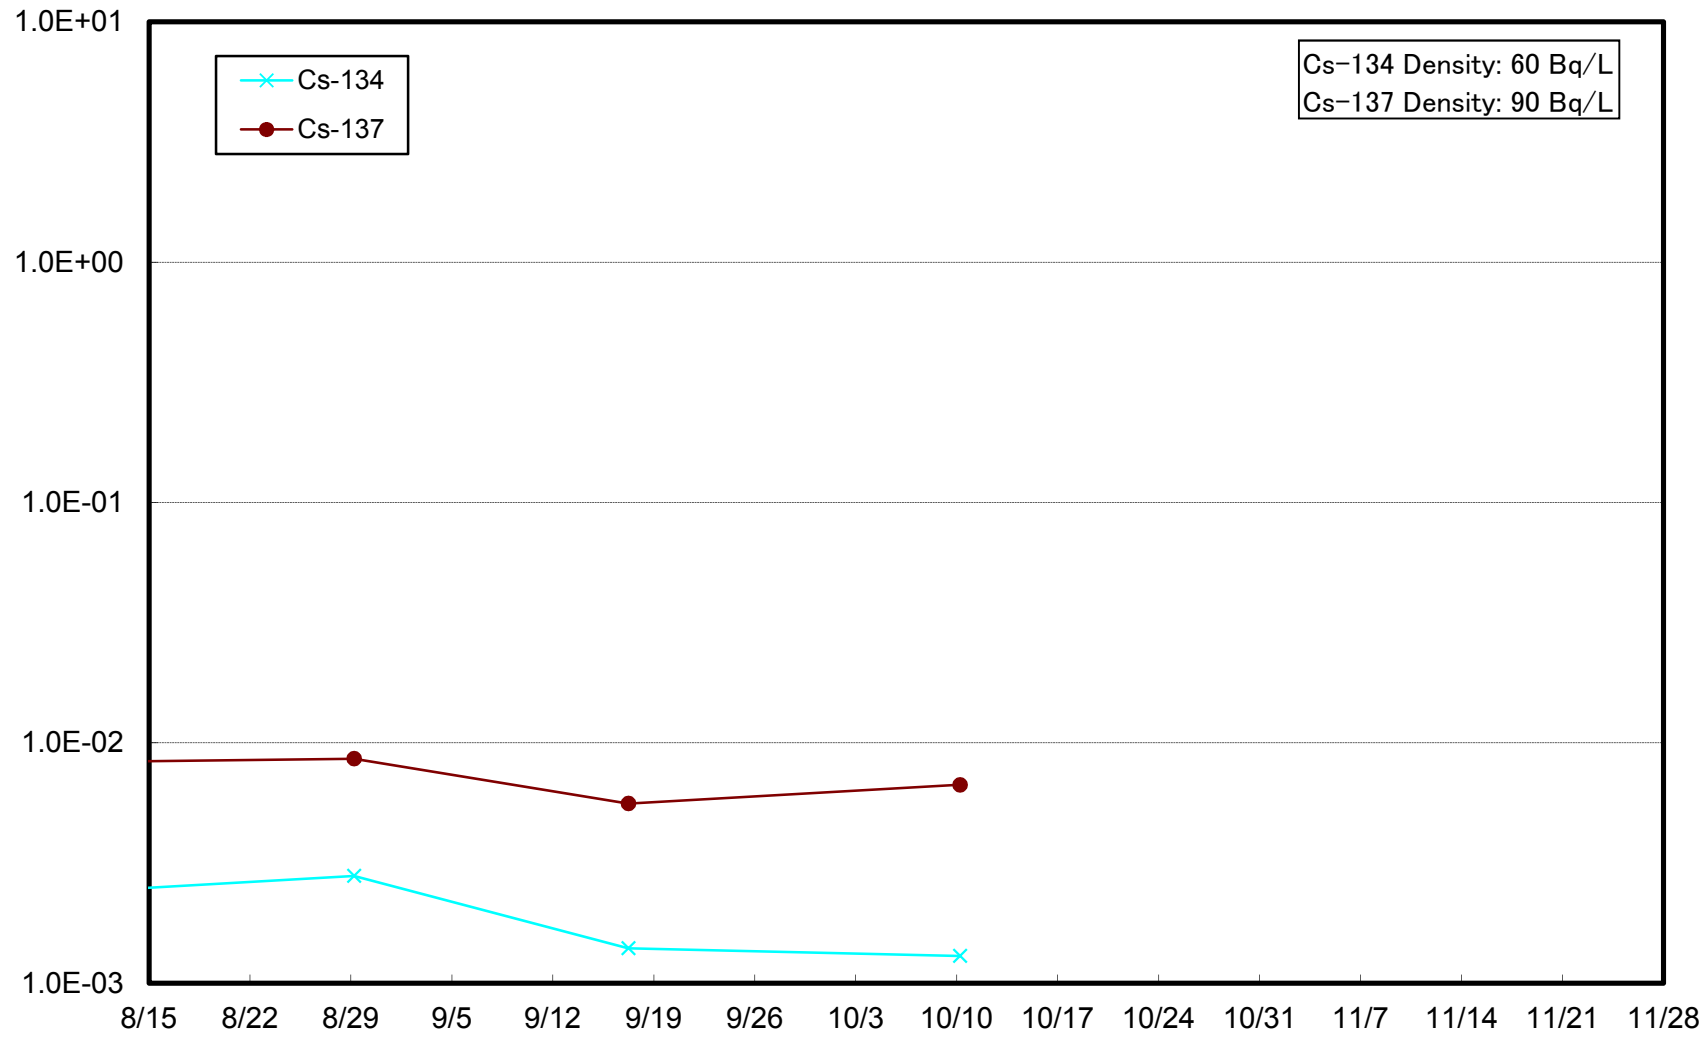


Radioactivity Density of the Seawater at 1km Offshore of Ota river (T-S1) Upper Layer (Bq/L)

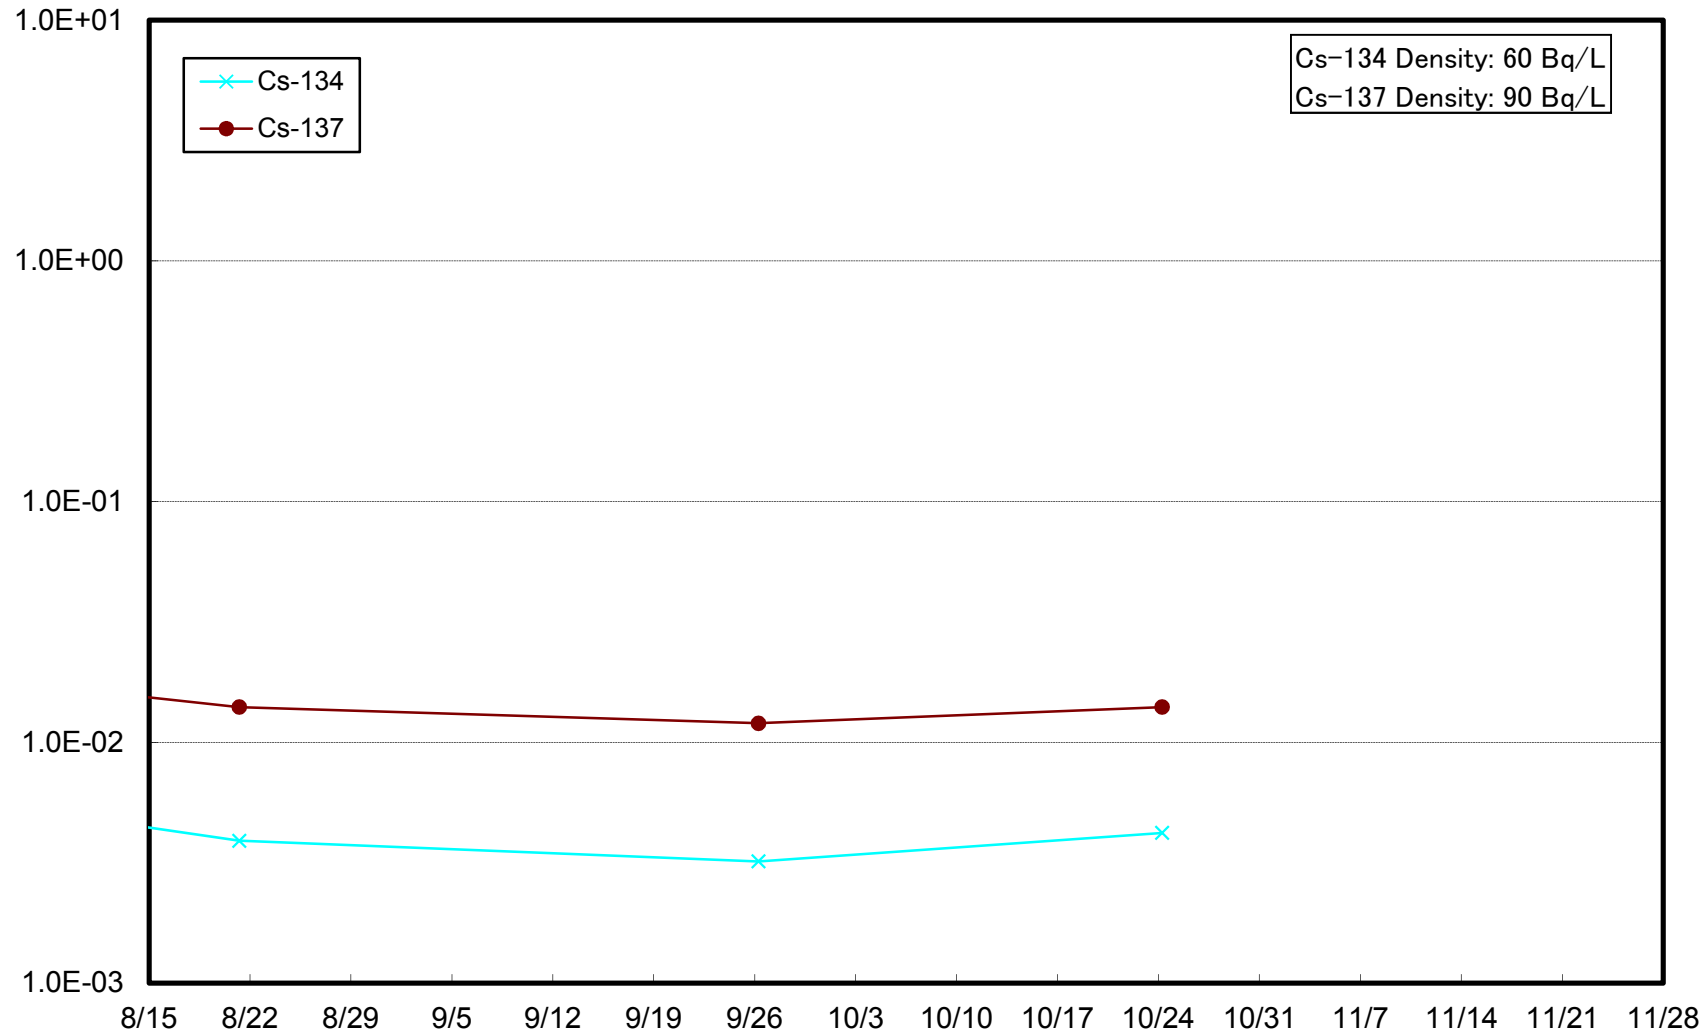


Radioactivity Density of the Seawater at 1km Offshore of Ota river (T-S1) Lower Layer (Bq/L)

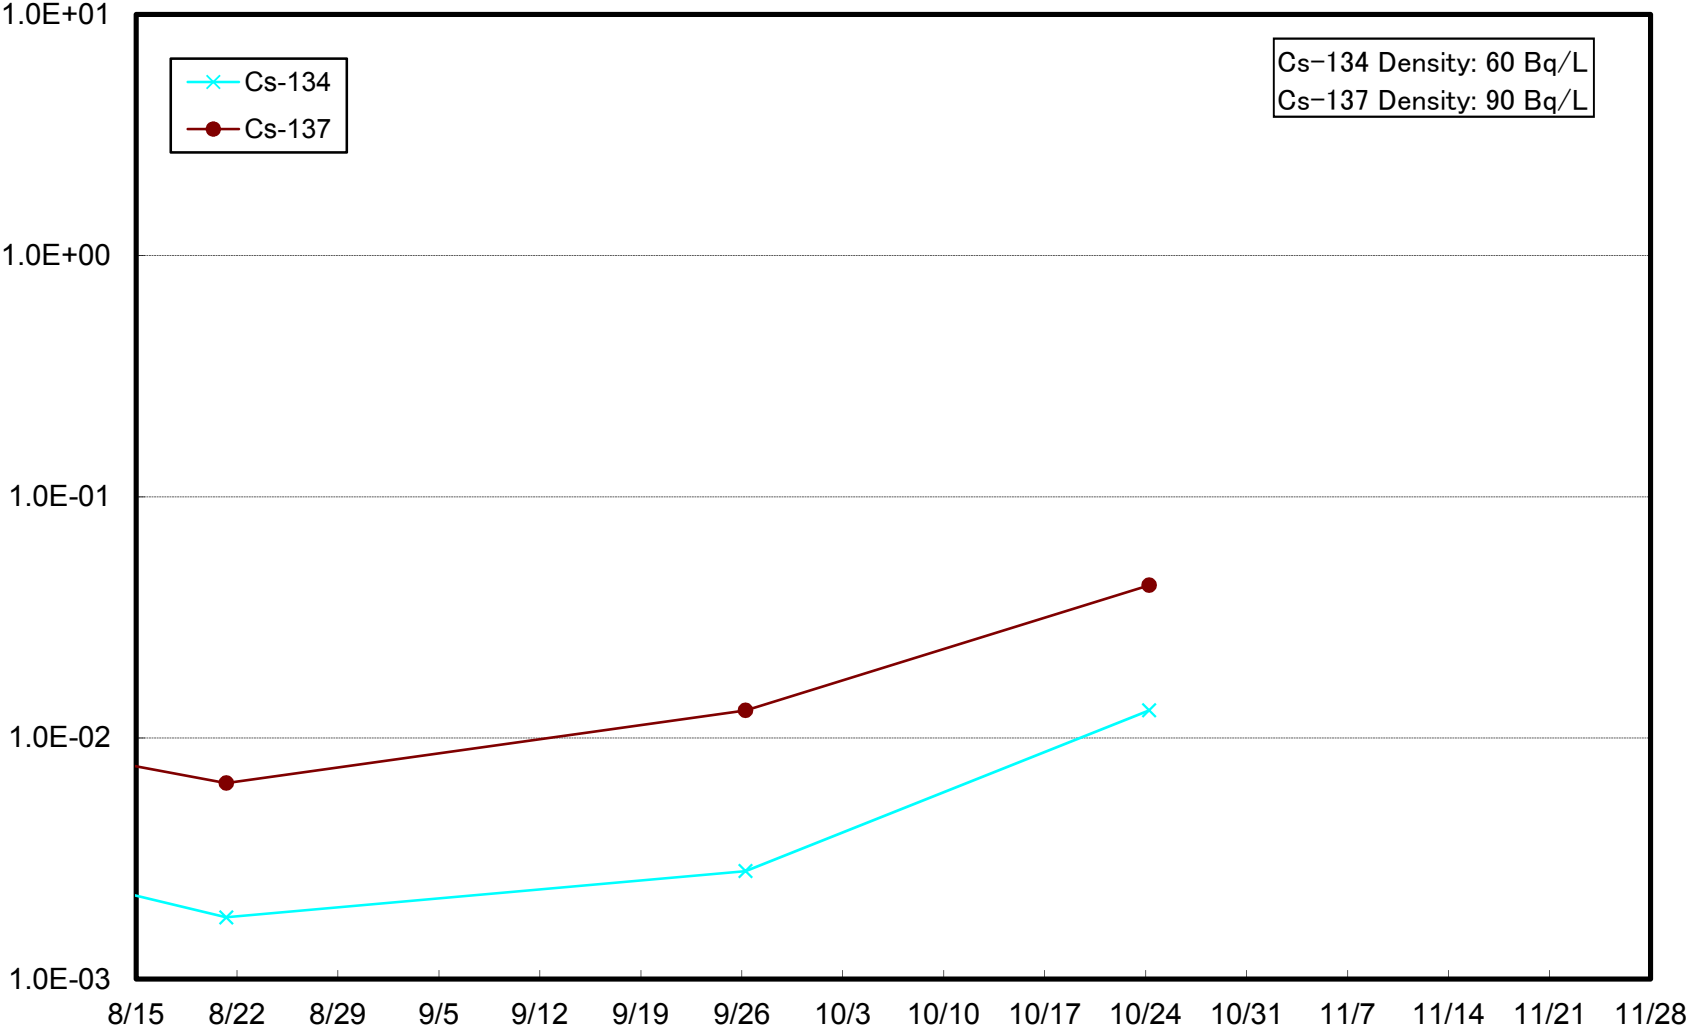


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Upper Layer (Bq/L)

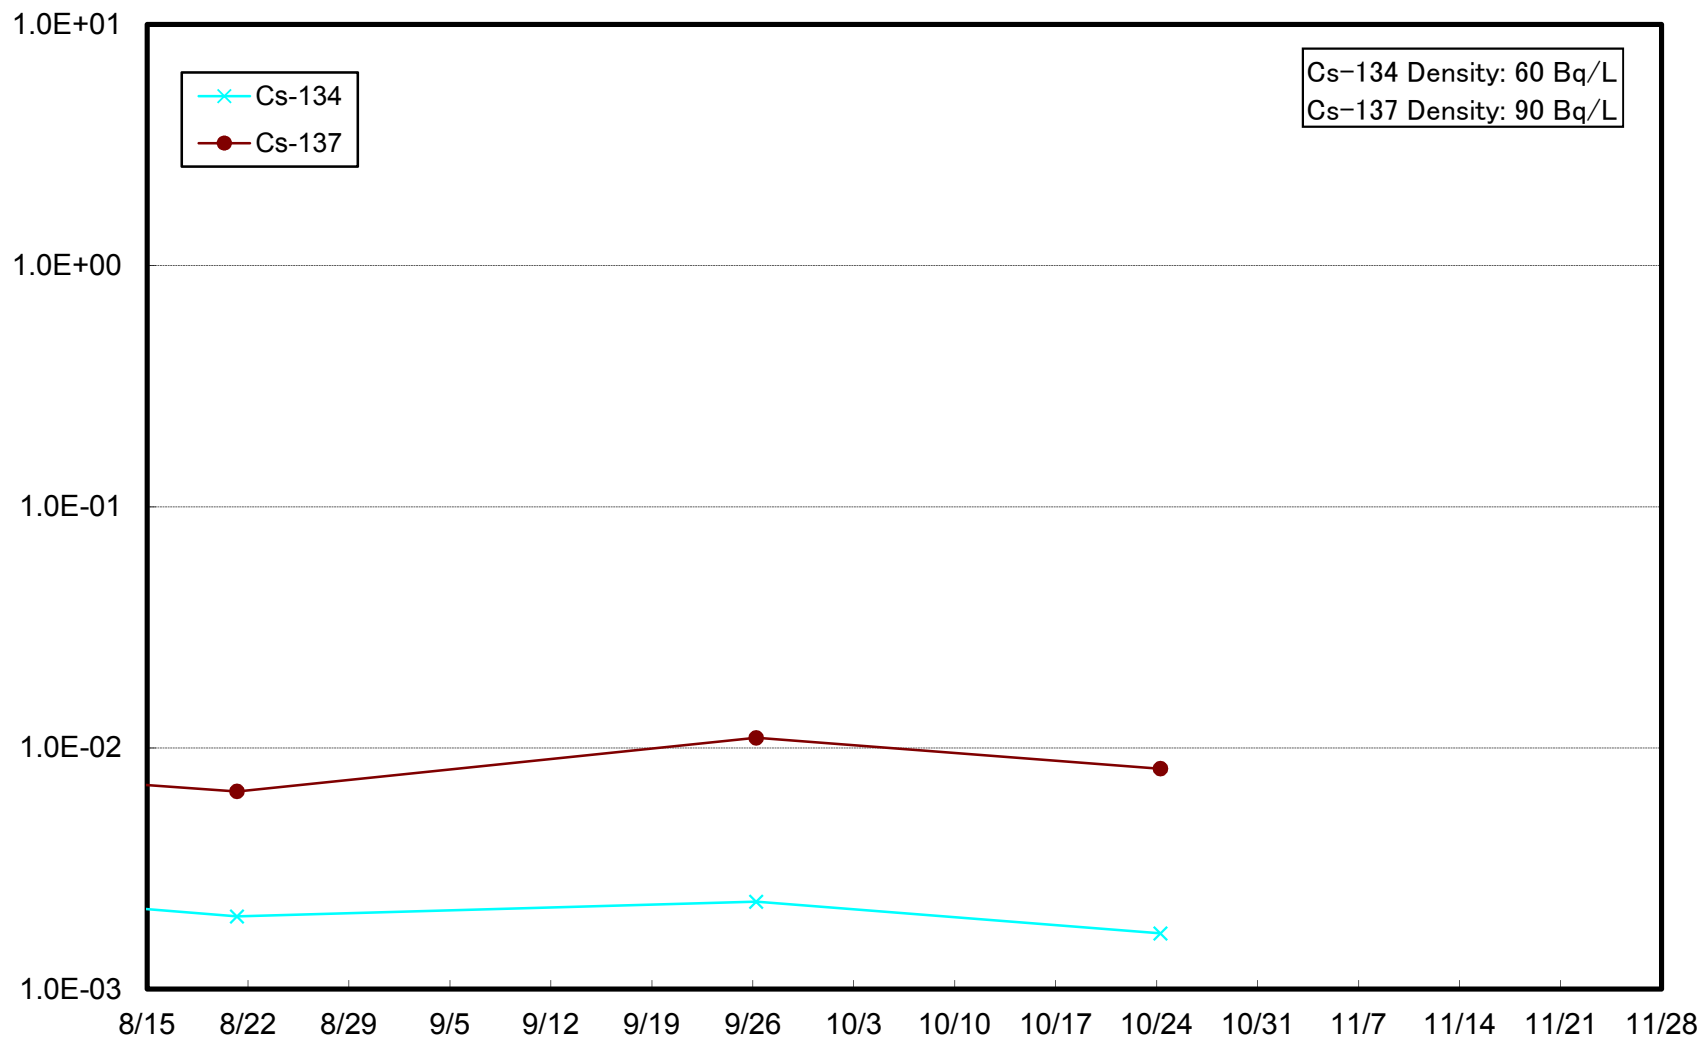


Radioactivity Density of the Seawater at 3km Offshore of Odaka Ward (T-14) Lower Layer (Bq/L)

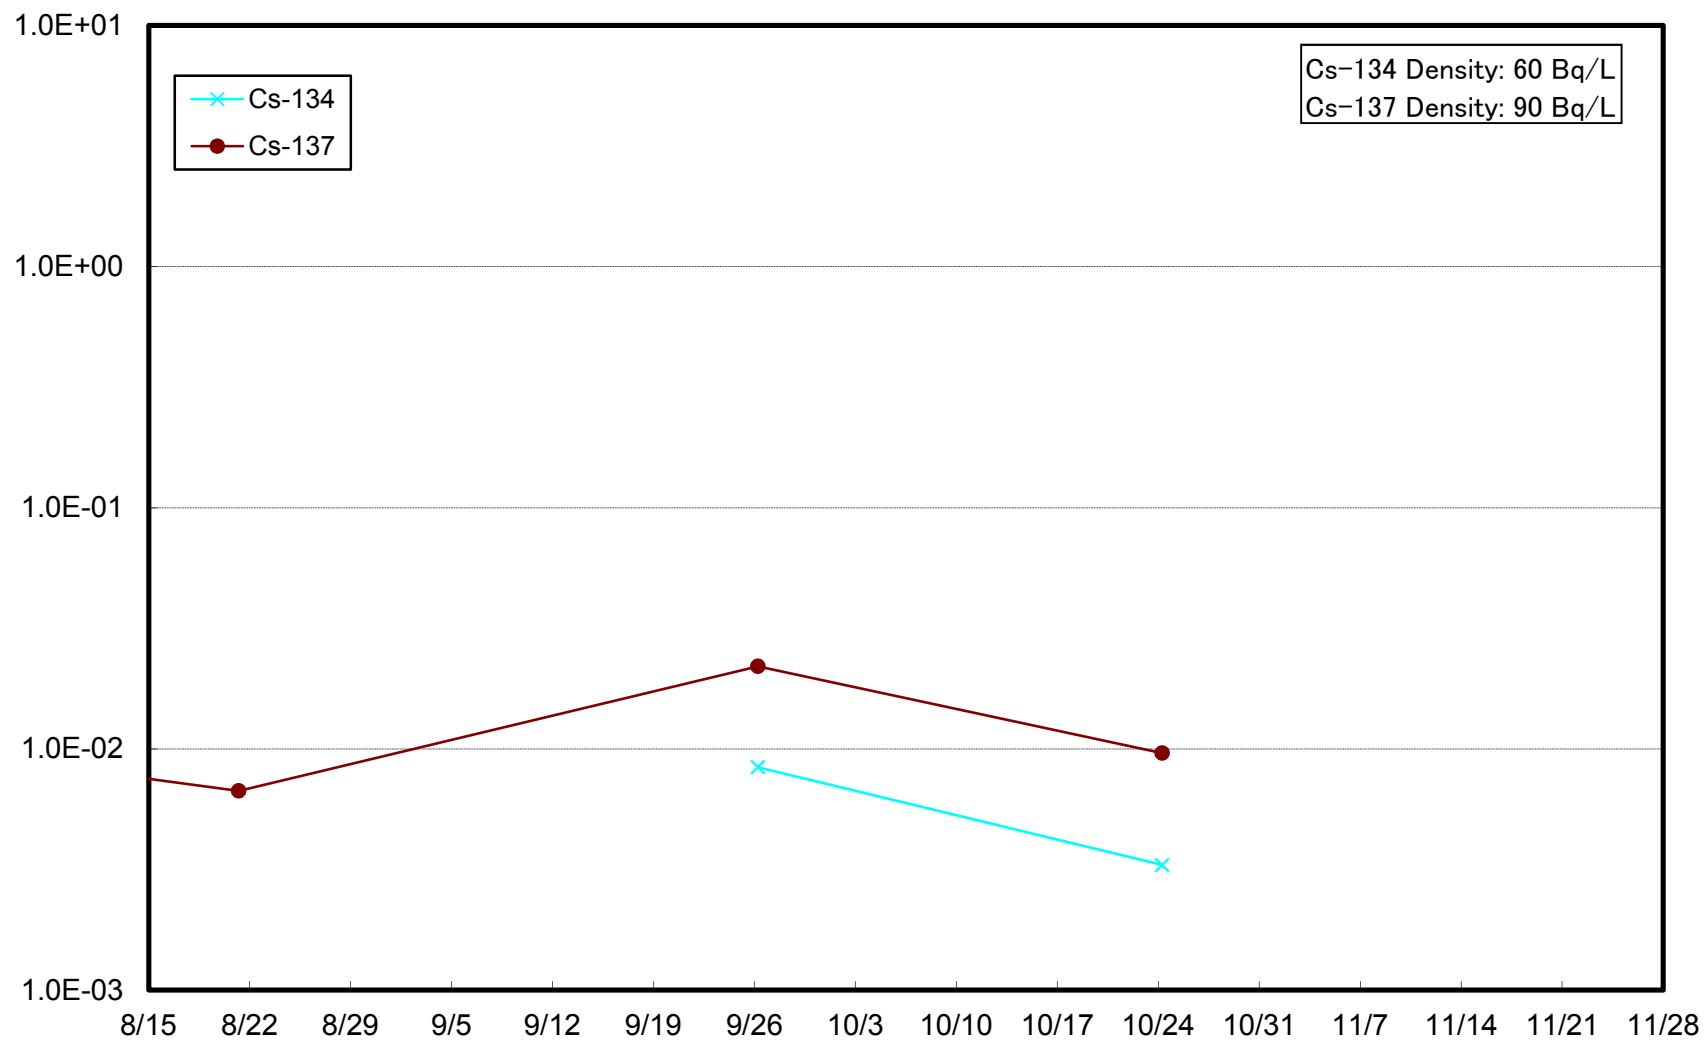


Radioactivity Density of the Seawater at 3km Offshore of Ukedo river (T-14) Upper Layer (Bq/L)

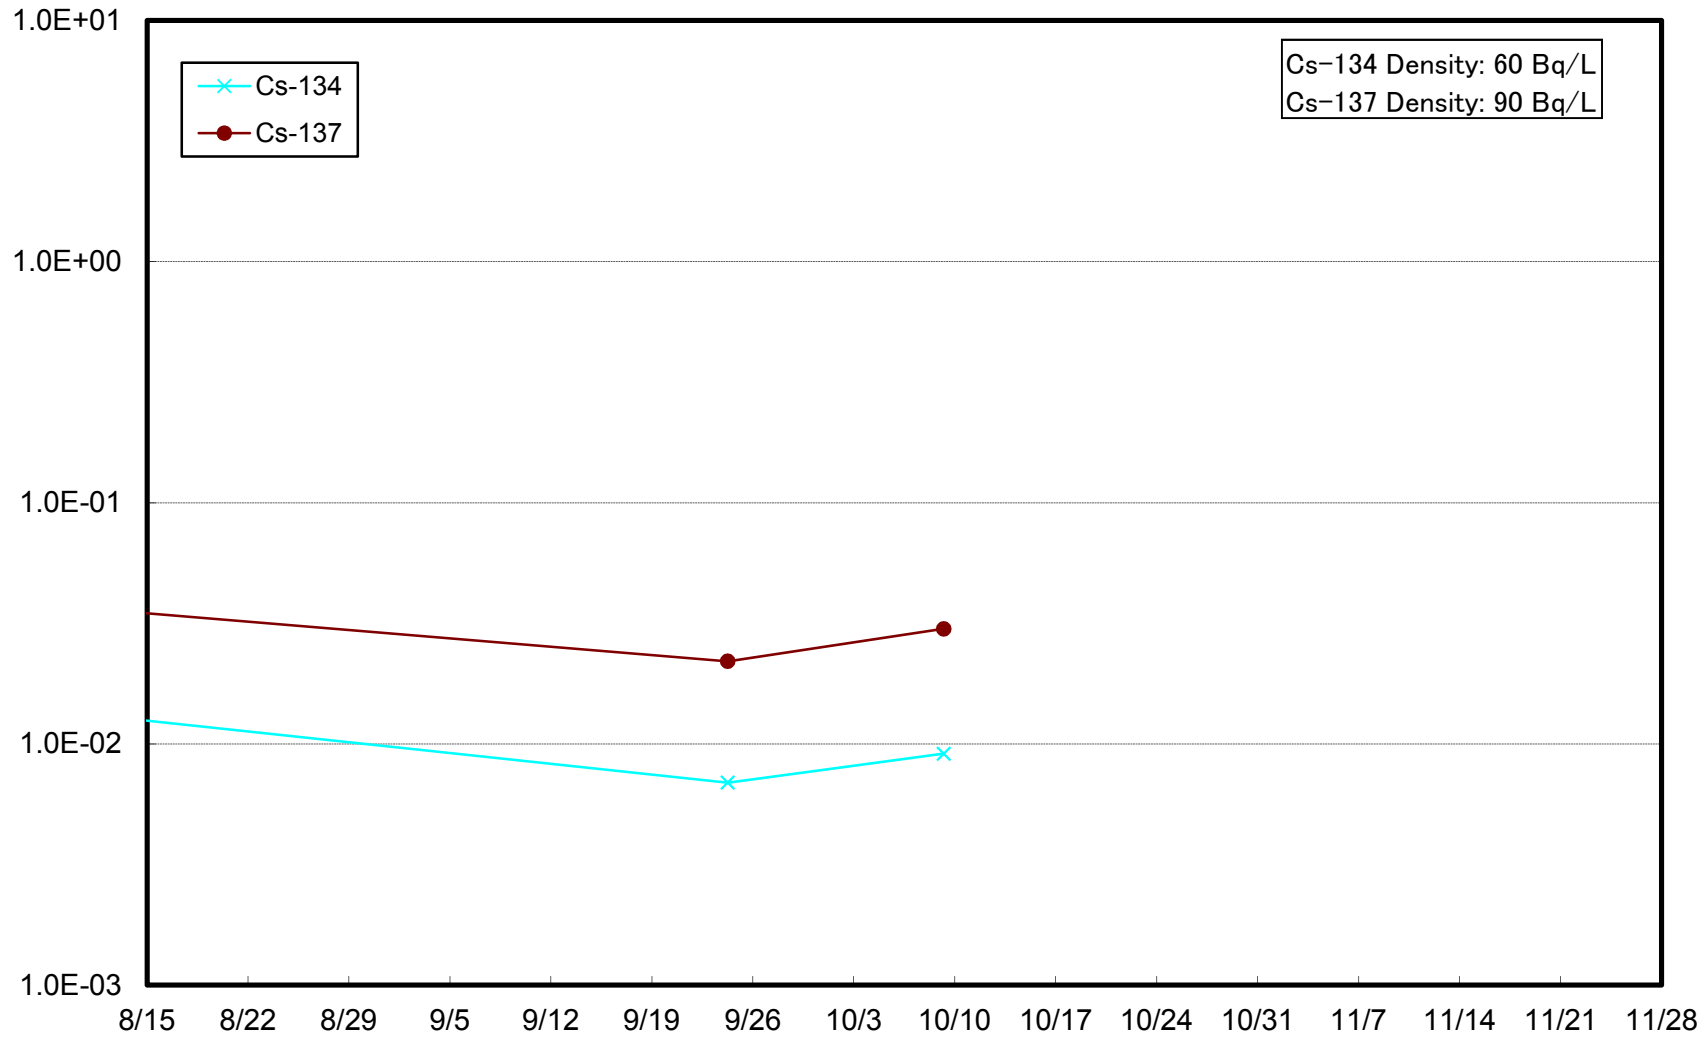


Radioactivity Density of the Seawater at 3km Offshore of Ukedo river (T-S3) Lower Layer (Bq/L)

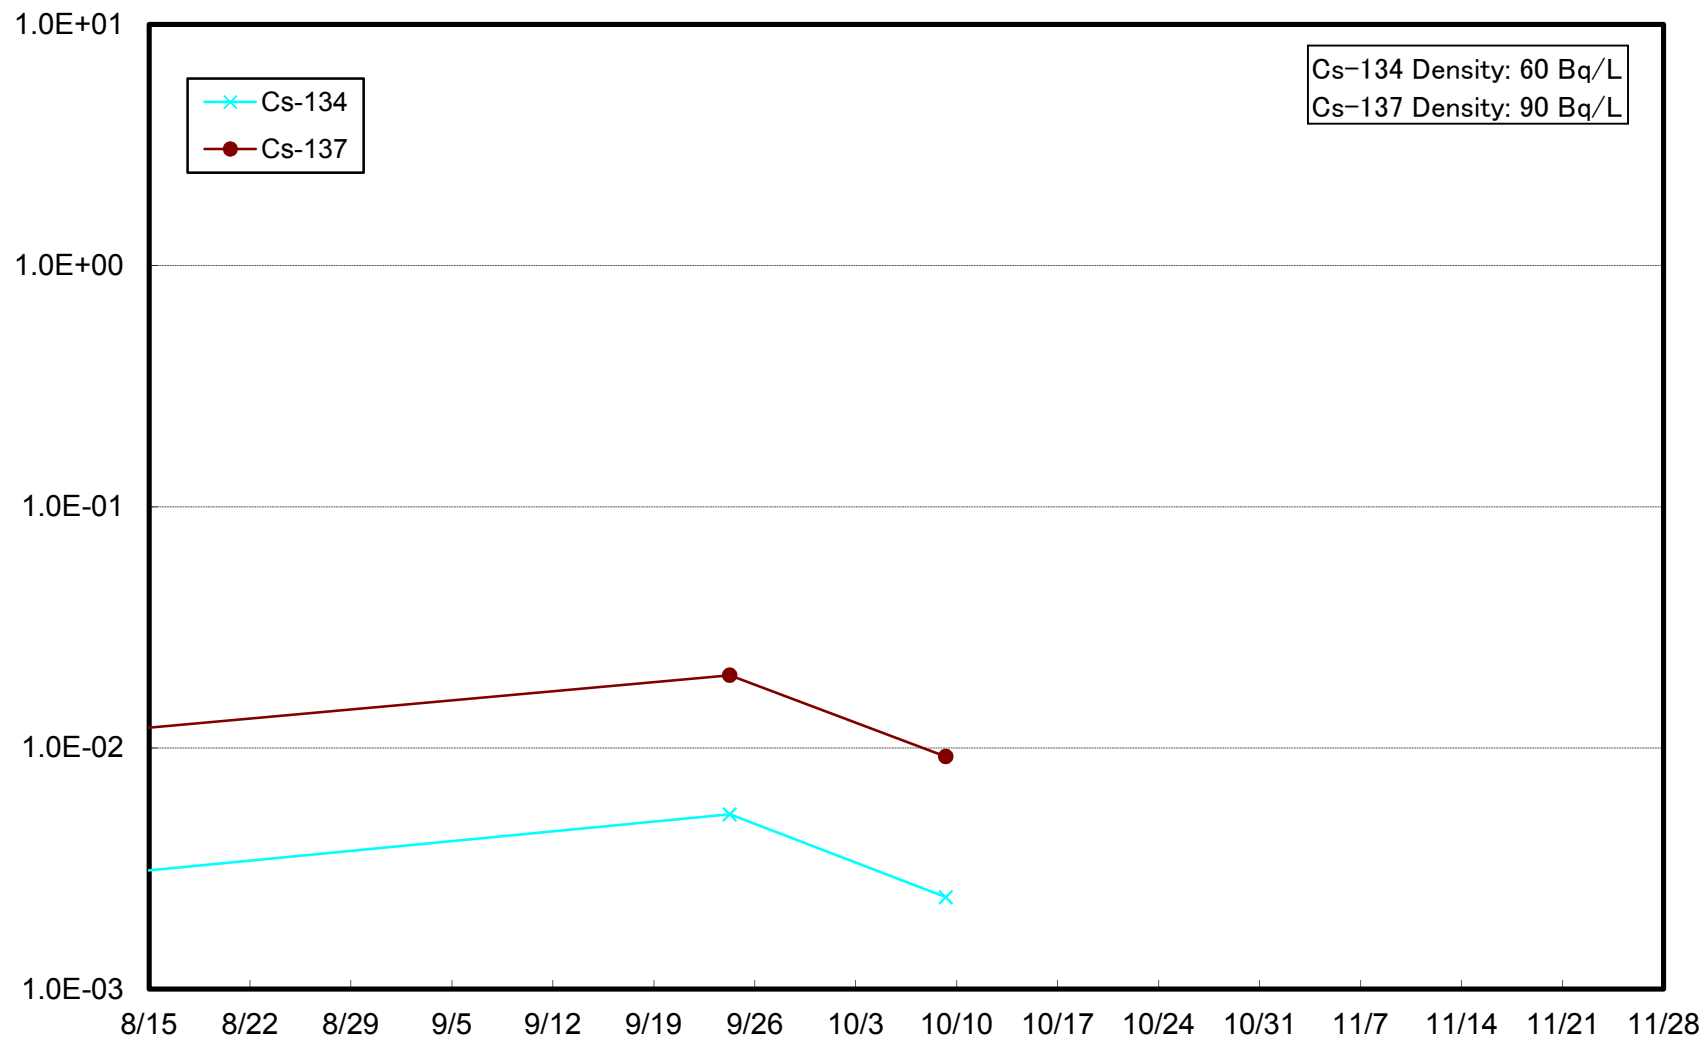


Radioactivity Density of the Seawater at 3km Offshore around Fukushima Daiichi NPS (T-S4) Upper Layer (Bq/L)

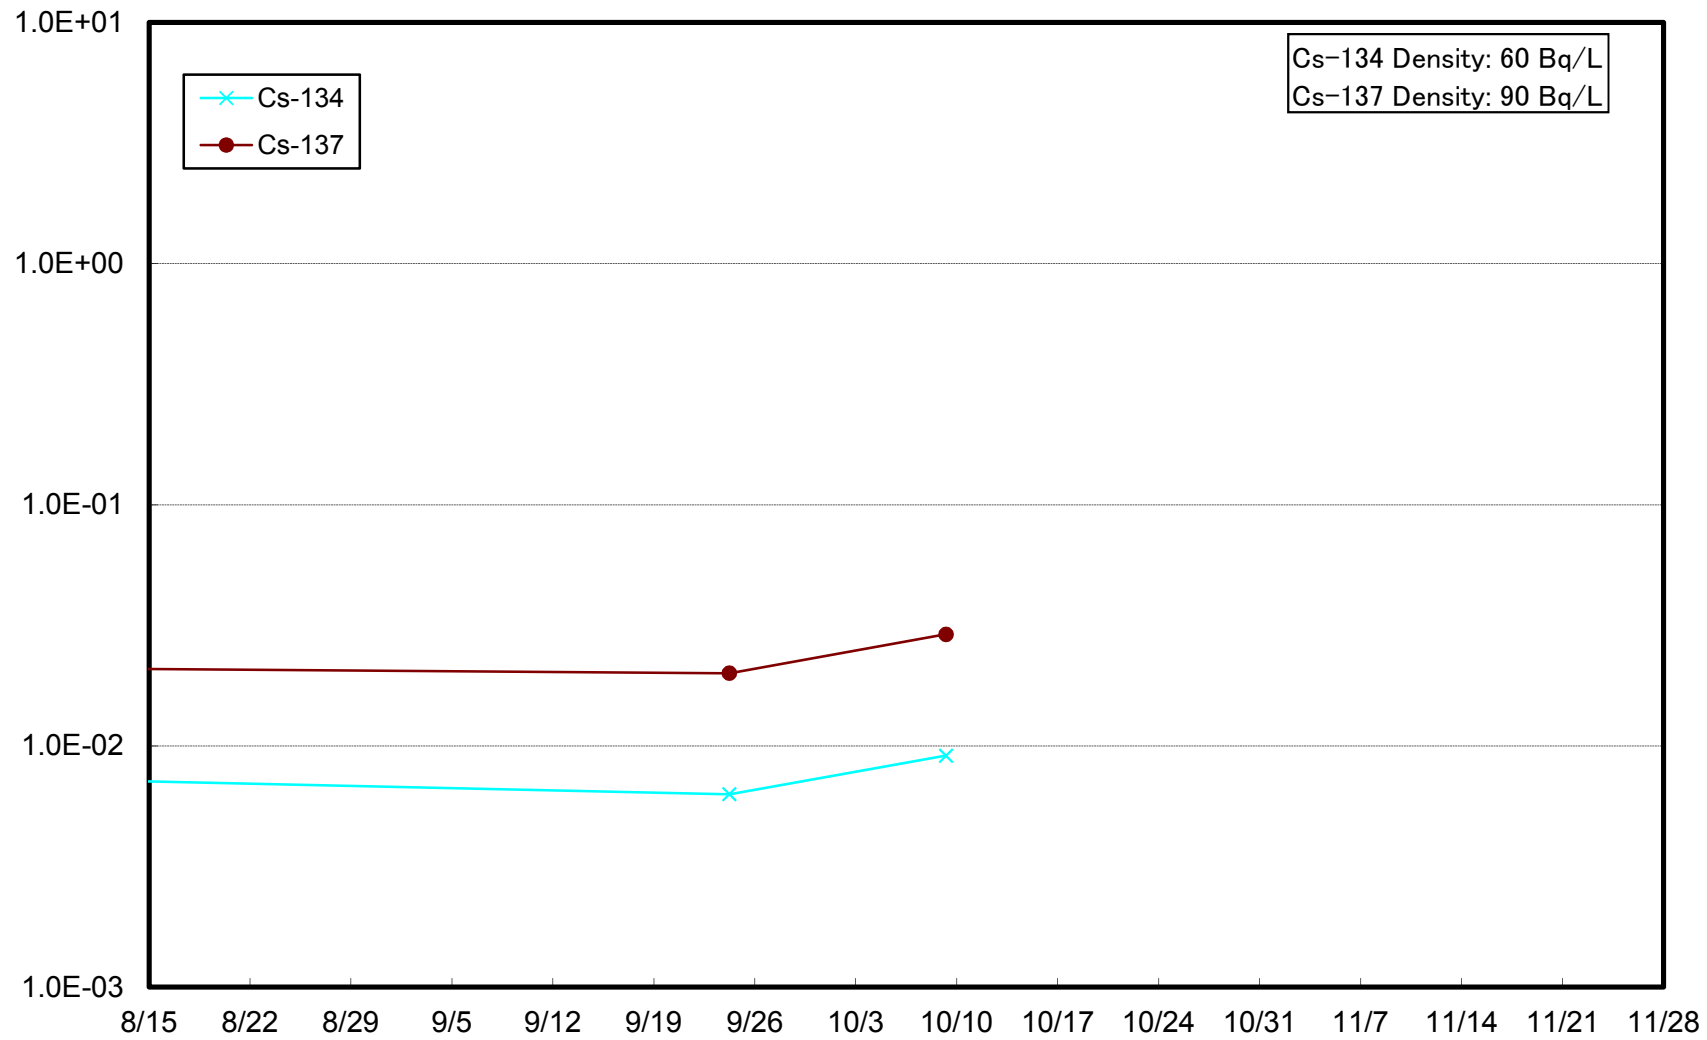


Radioactivity Density of the Seawater at 3km Offshore around Fukushima Daiichi NPS (T-S4) Lower Layer (Bq/L)

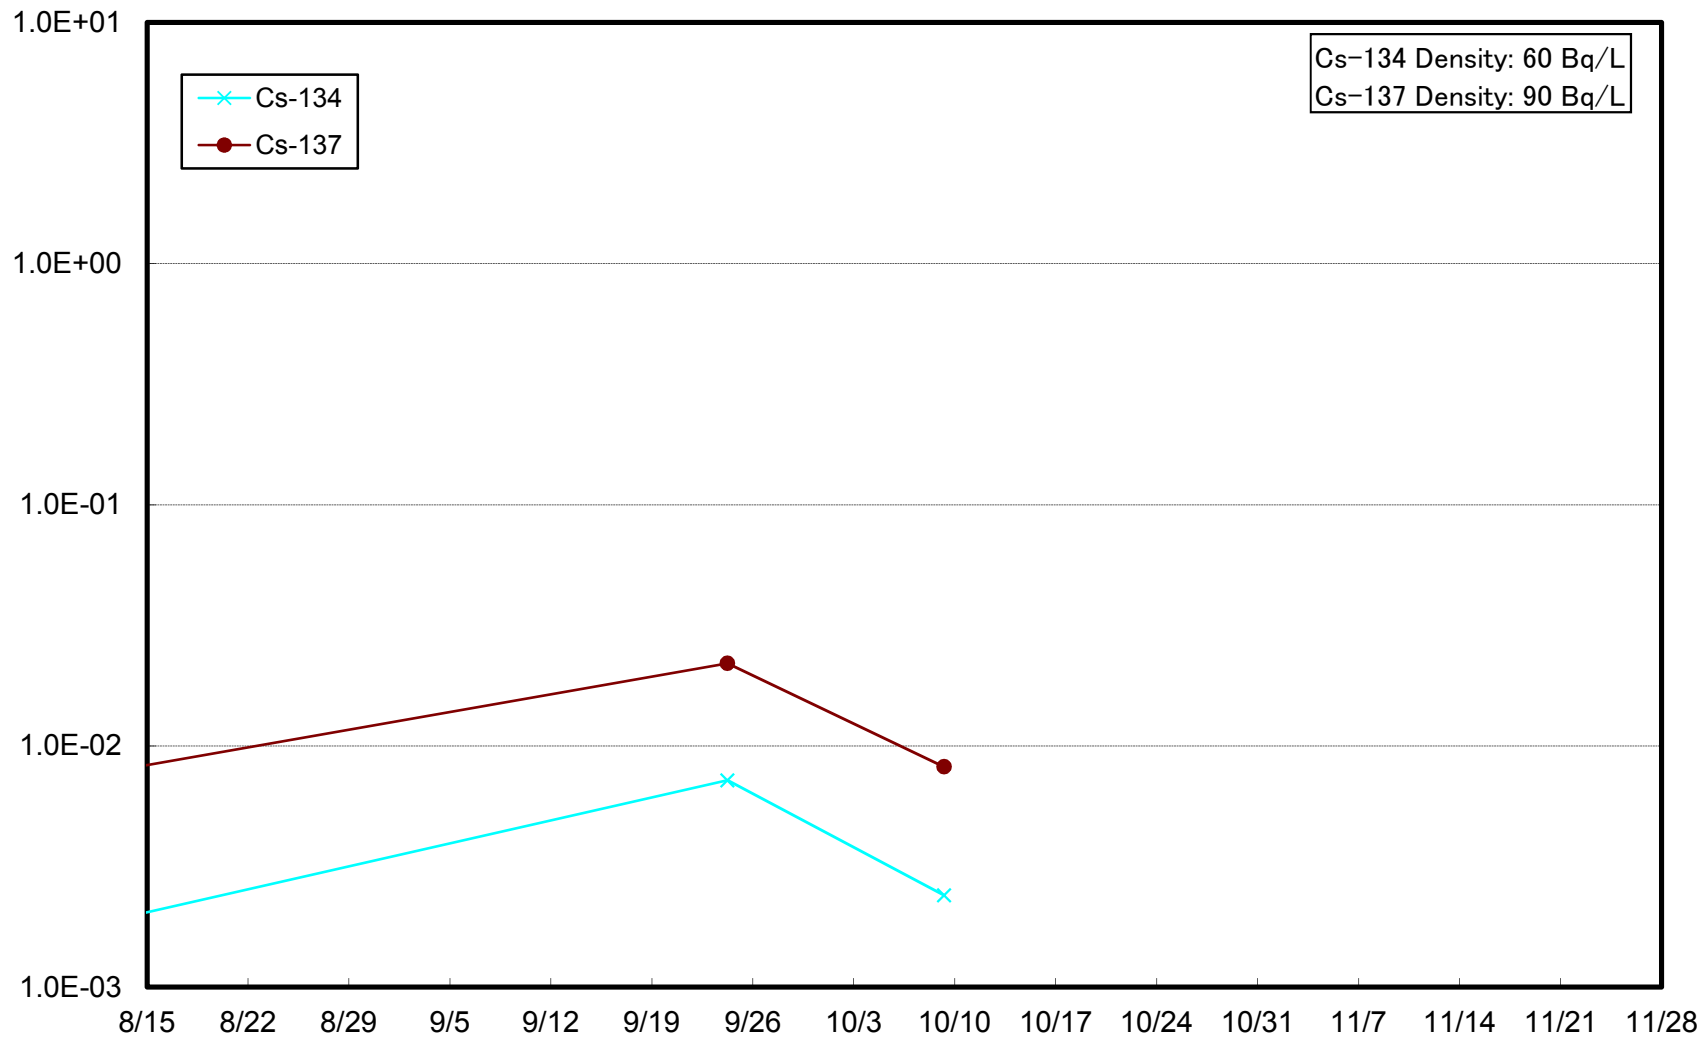


Radioactivity Density of the Seawater at 2km Offshore of kido river (T-S5) Upper Layer (Bq/L)

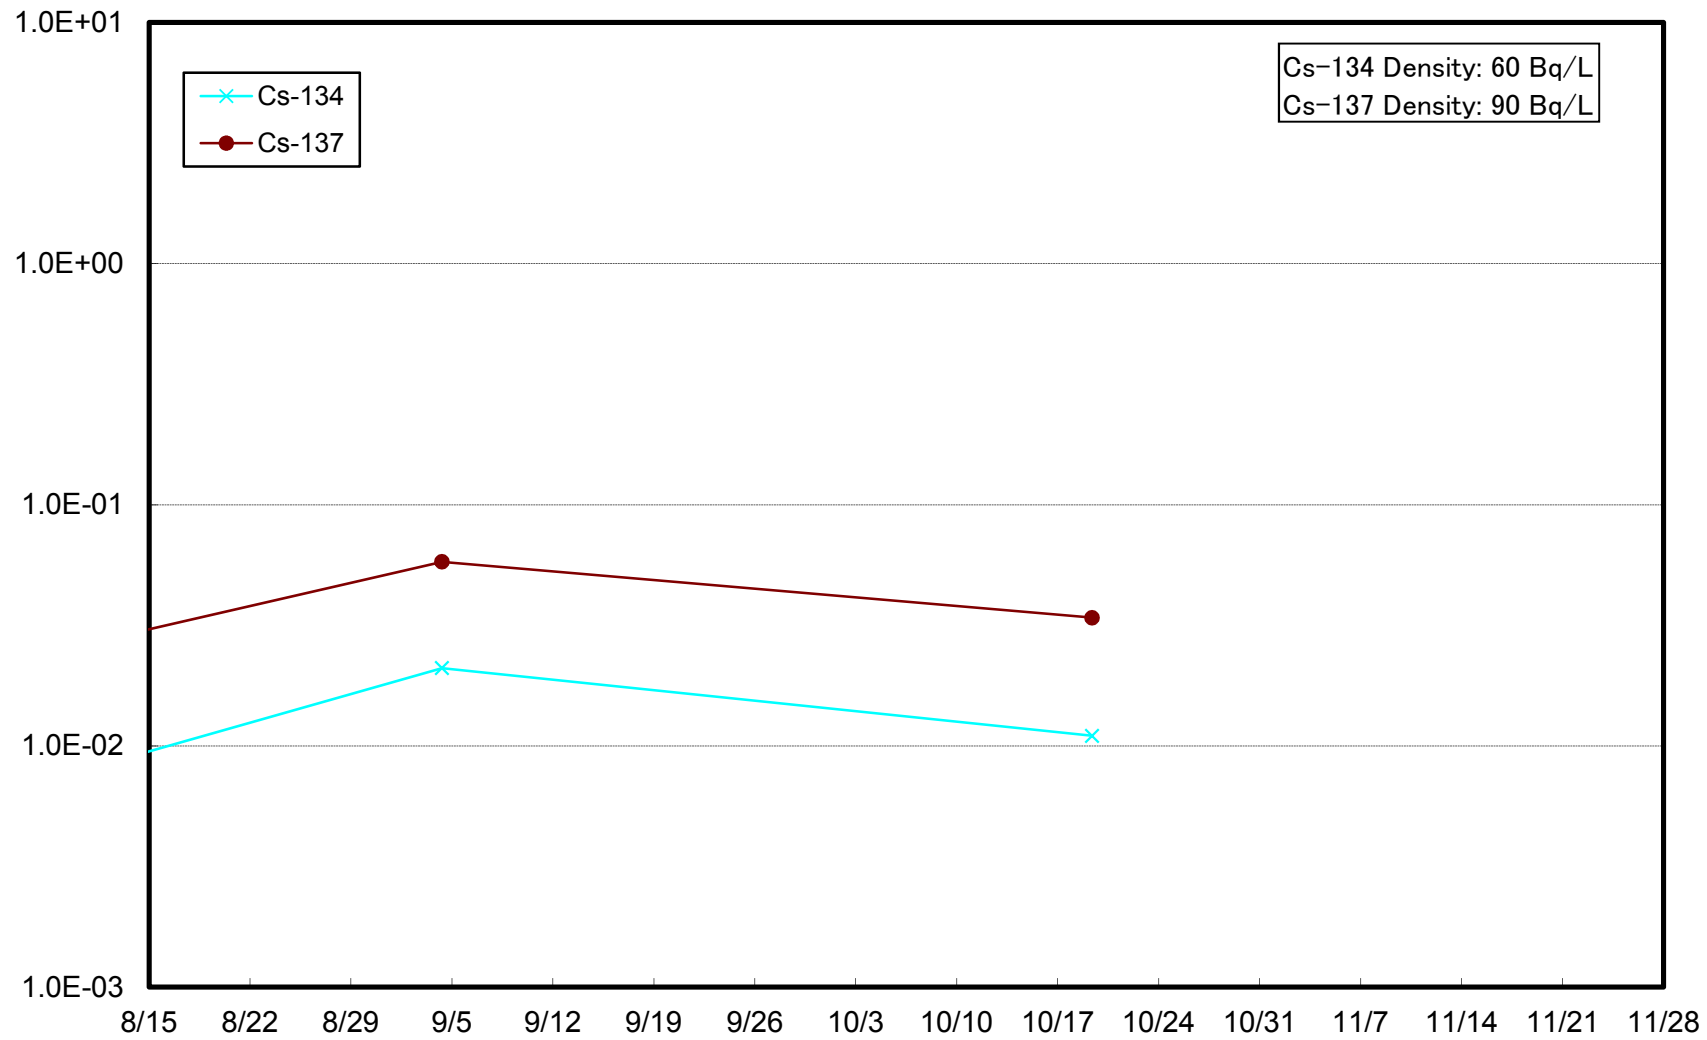


Radioactivity Density of the Seawater at 2km Offshore of kido river (T-S5) Lower Layer (Bq/L)

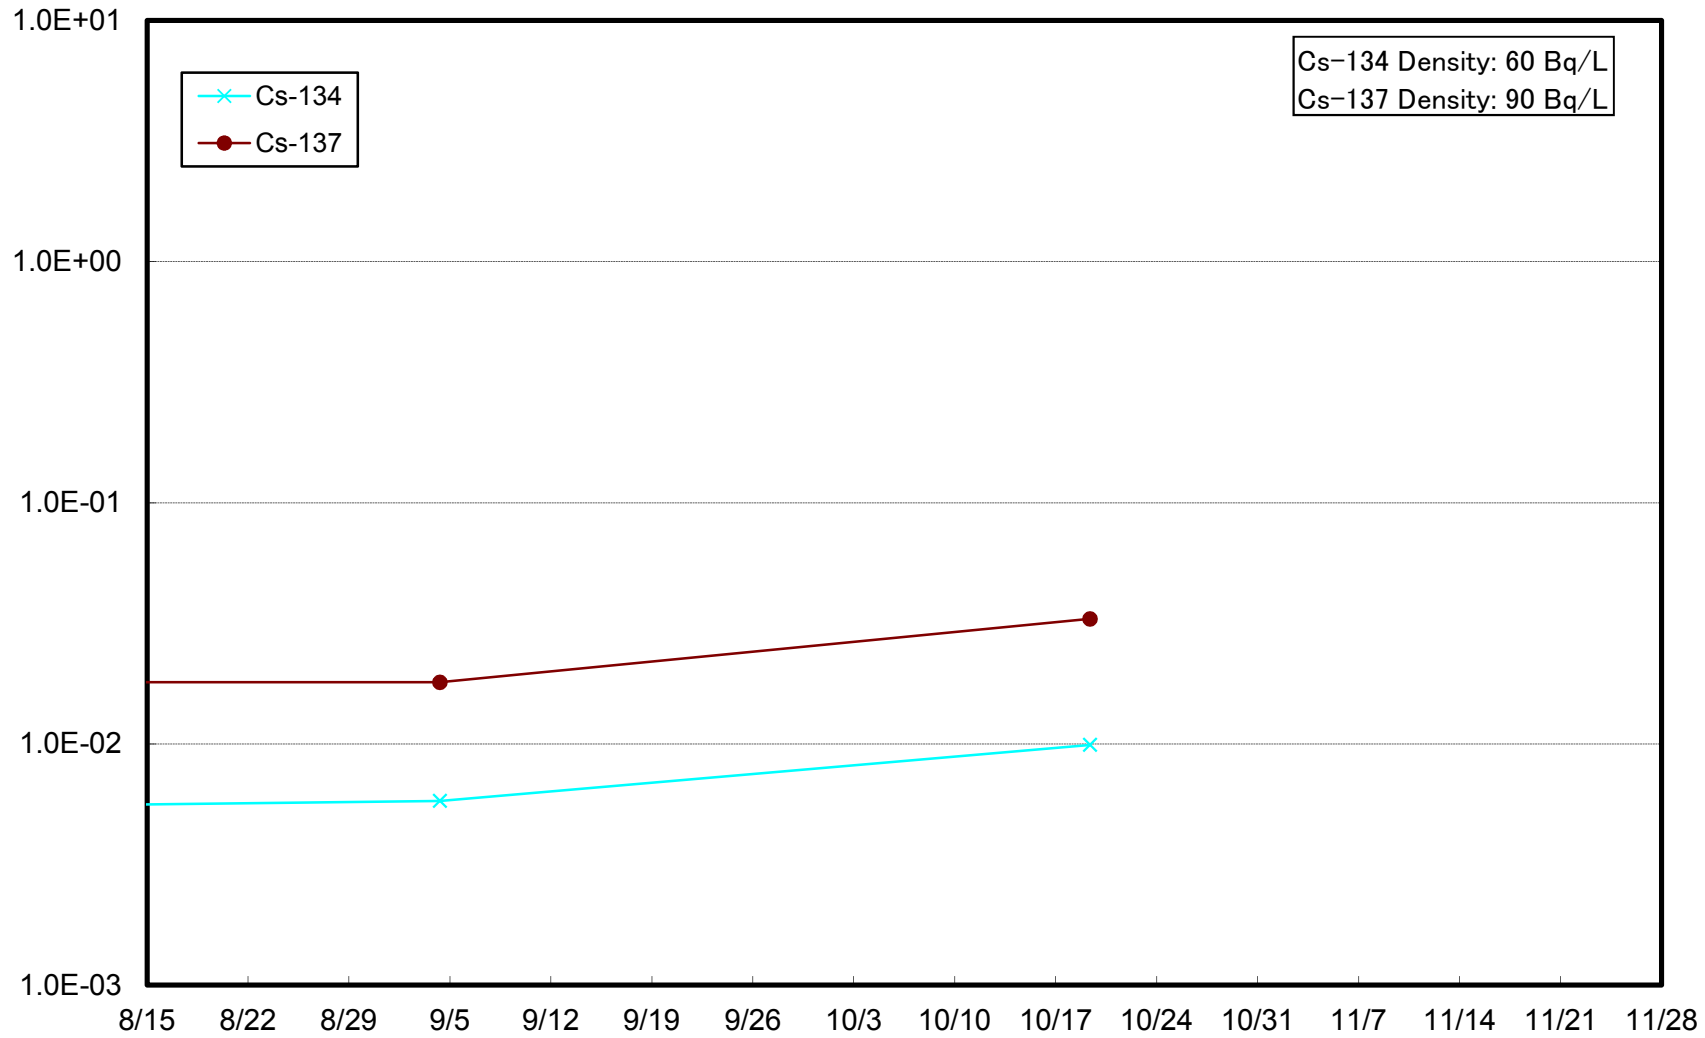


Radioactivity Density of the Seawater at 2km Offshore around Fukushima Daiini NPS (T-S7) Upper Layer (Bq/L)

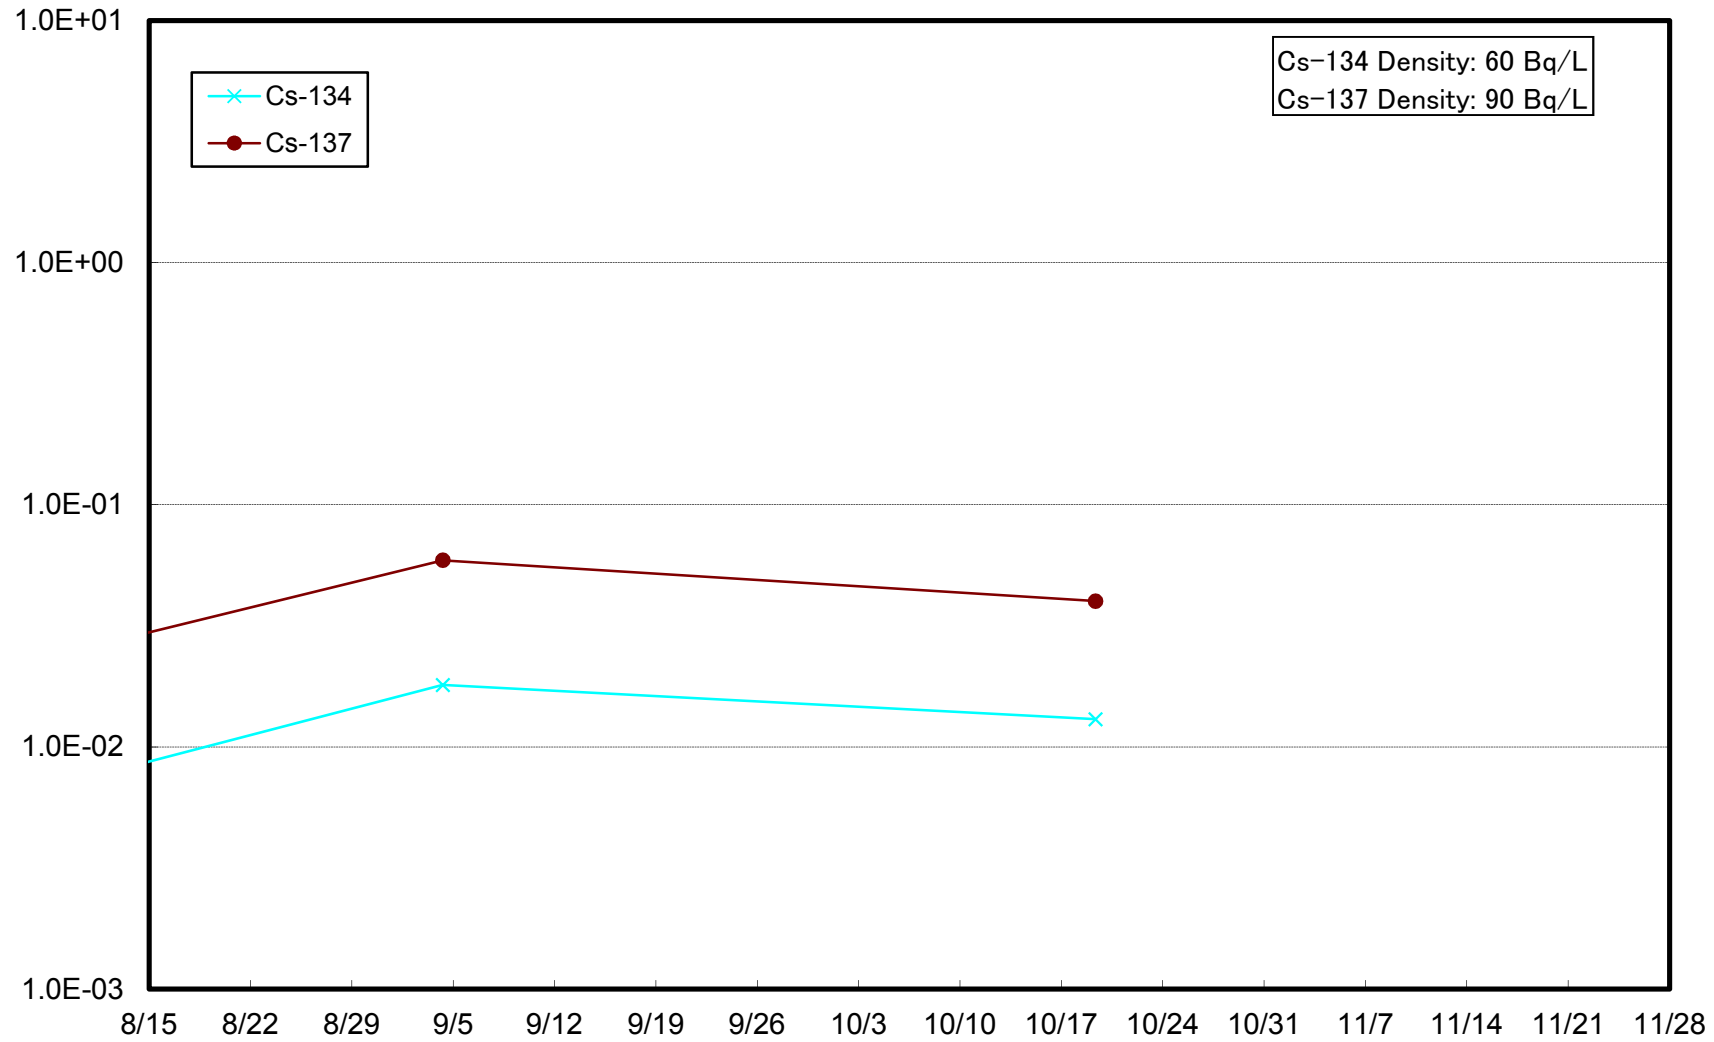

Radioactivity Density of the Seawater at 2km Offshore around Fukushima Daiini NPS (T-S7) Lower Layer (Bq/L)

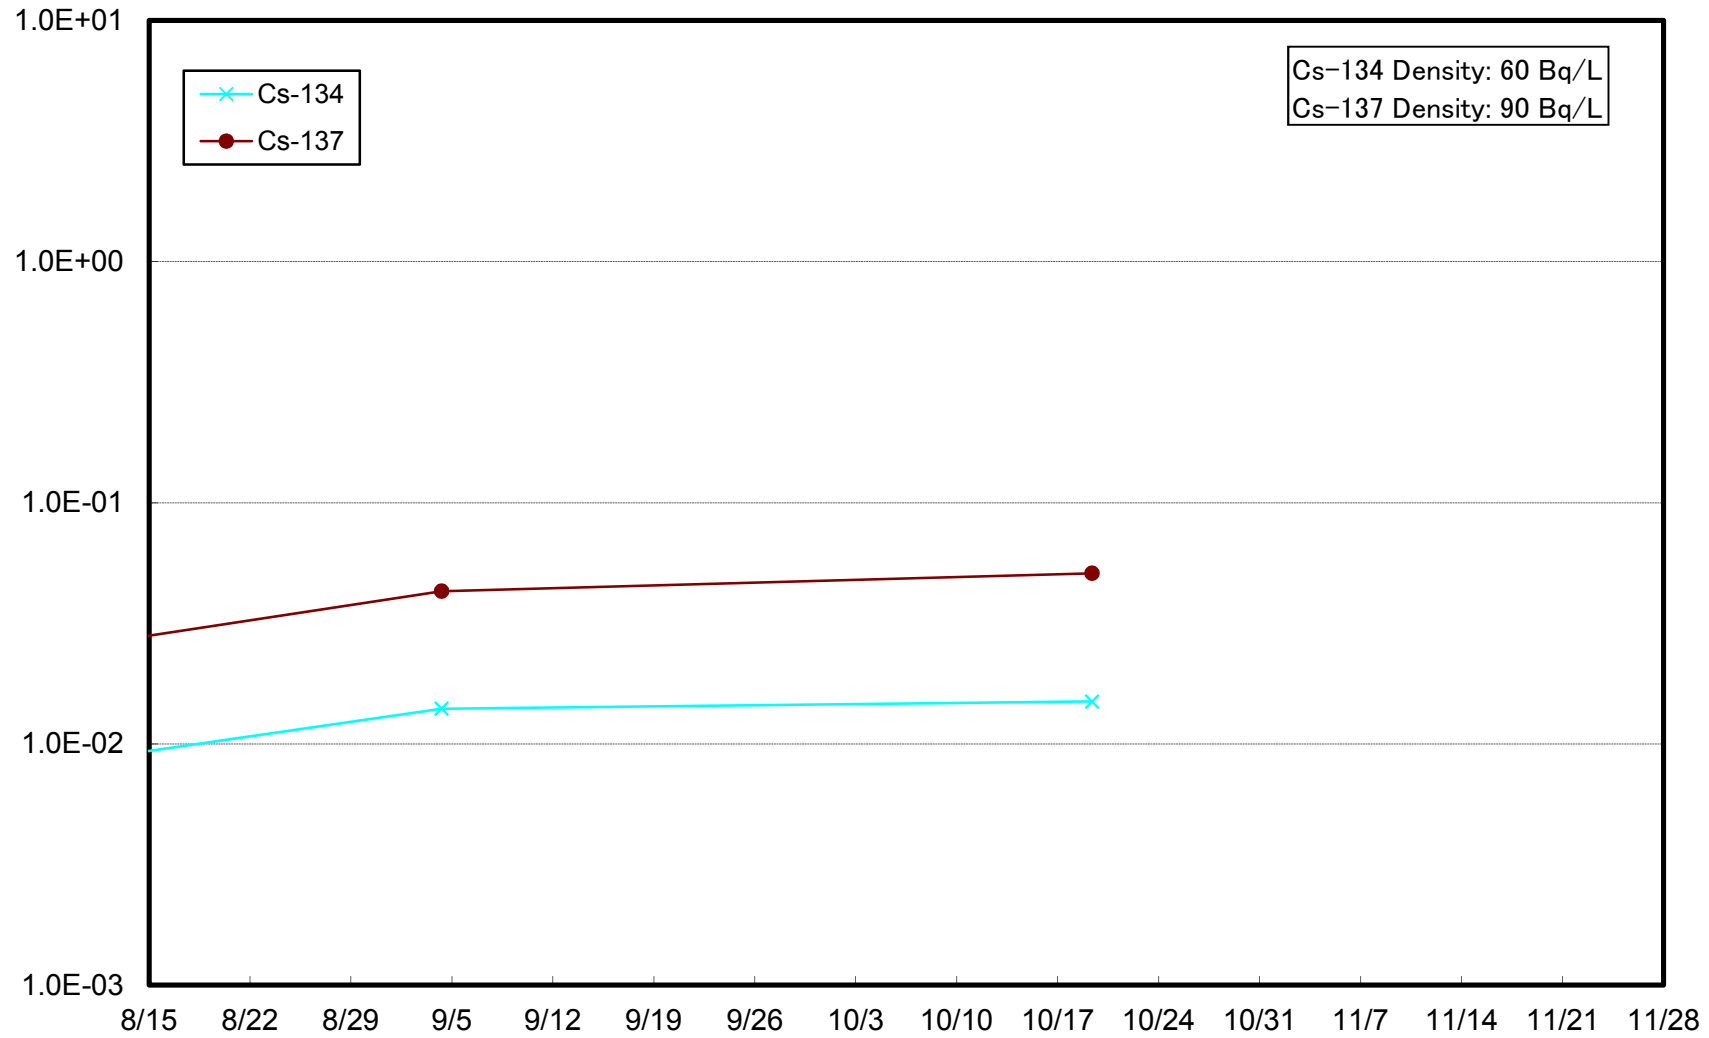

Radioactivity Density of the Seawater at 4km Offshore around Kumagawa river (T-S8) Upper Layer (Bq/L)

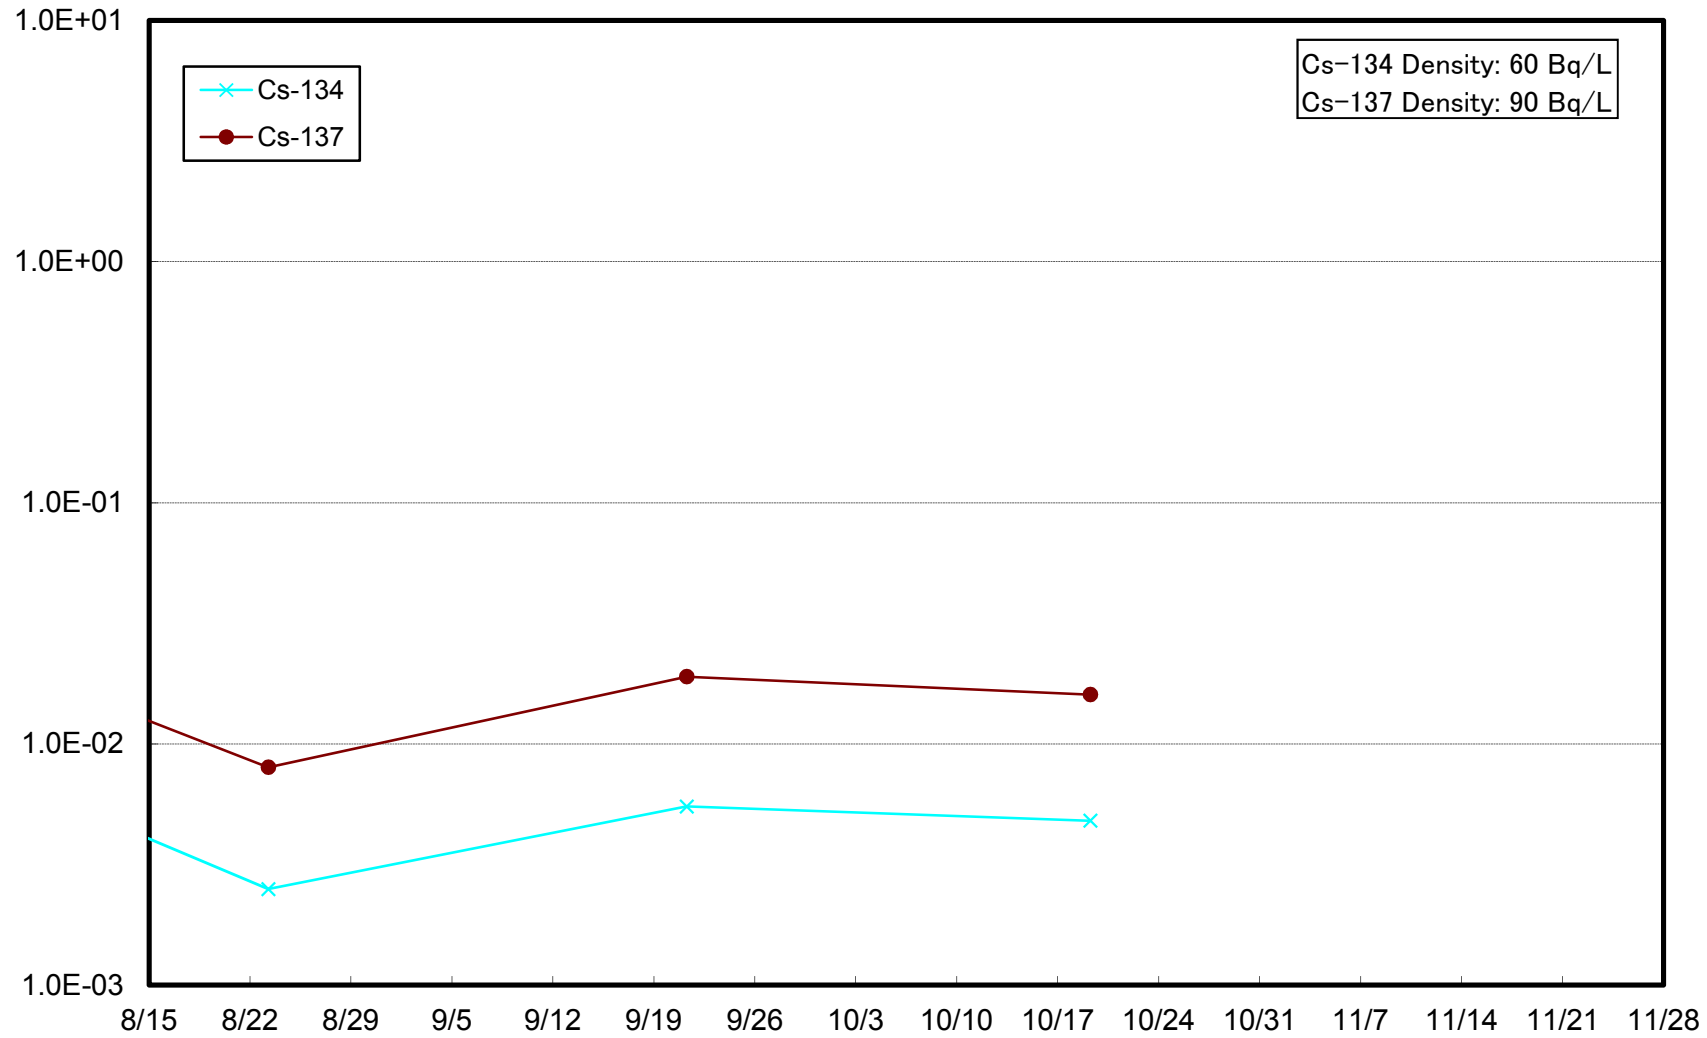

Radioactivity Density of the Seawater at 4km Offshore around Kumagawa river (T-S8) Lower Layer (Bq/L)

