


# Sampling Results of Drainage Water at Fukushima Daiichi Nuclear Power Station

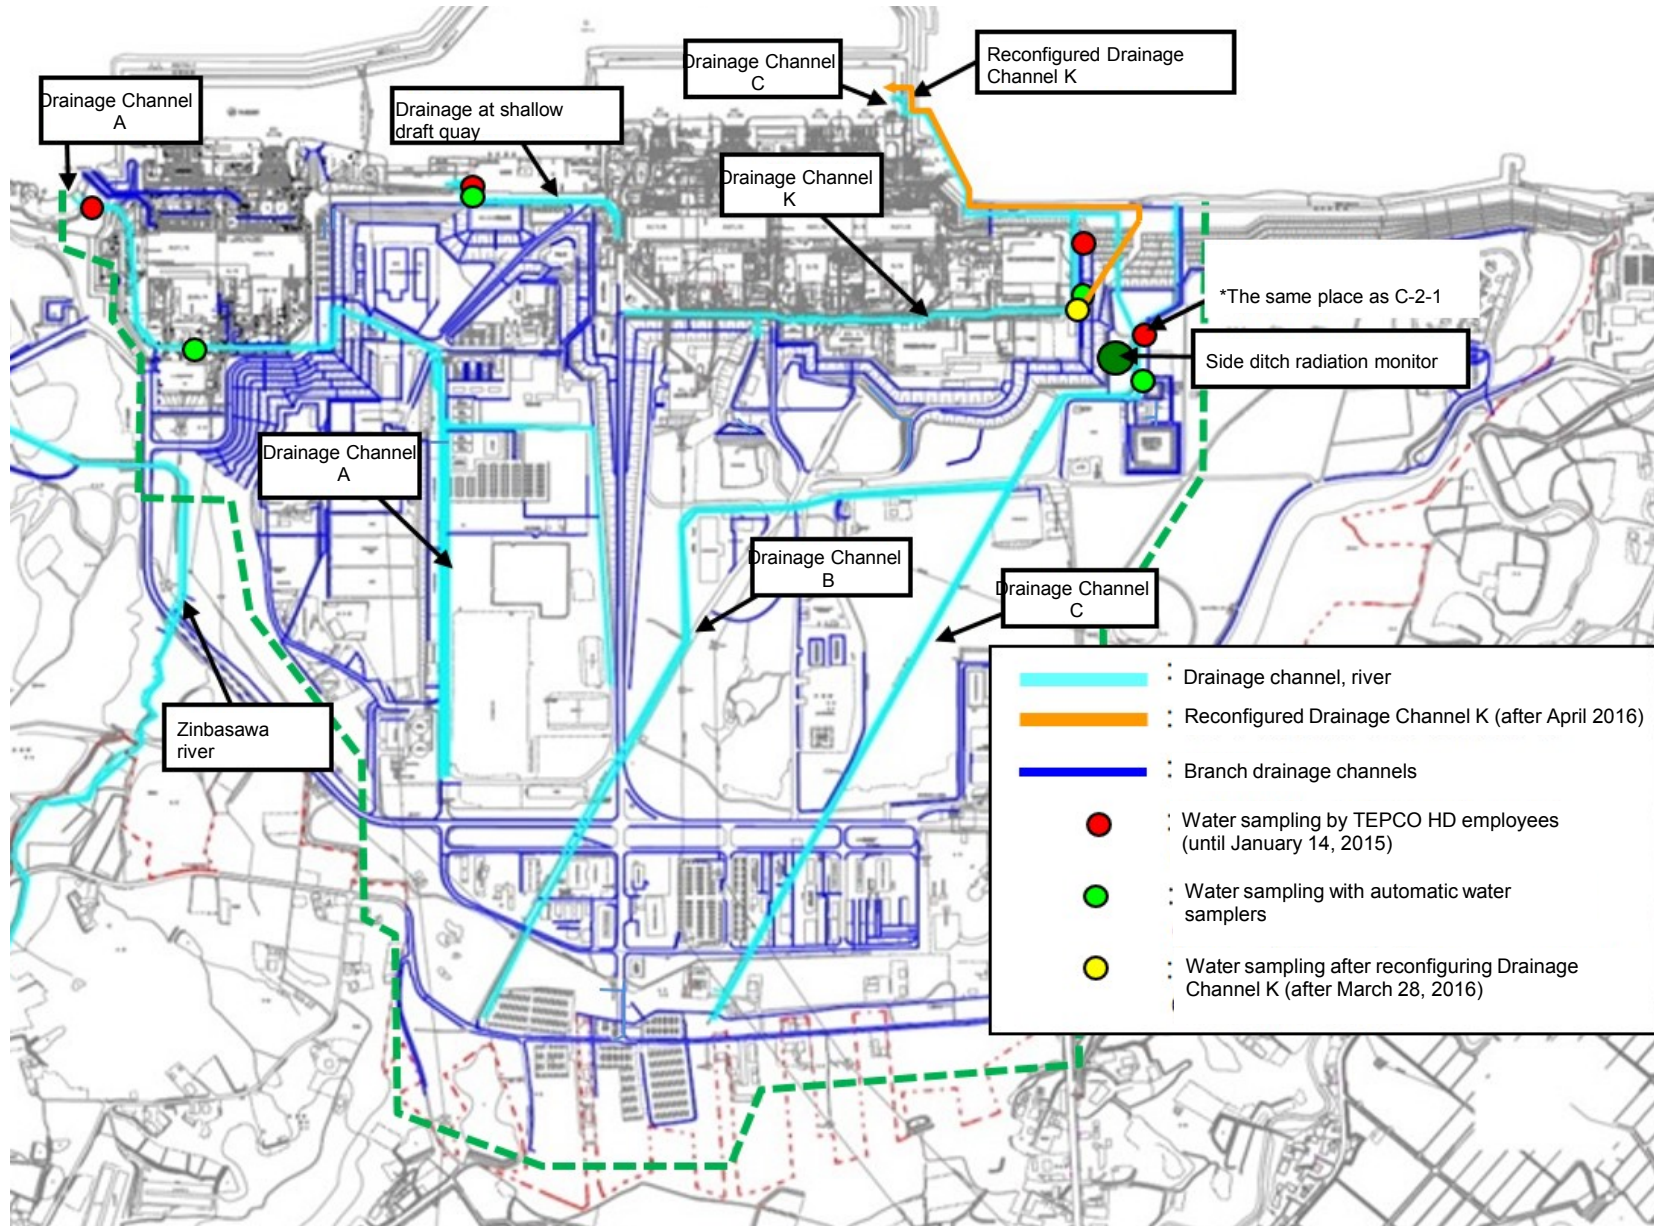

## Analysis results of drainage water at Fukushima Daiichi Nuclear Power Station

Unit: Bq/L

	Drainage Channel A outlet						Drainage outlet at shallow draft quay							
Sampling date	MM/DD	MM/DD	MM/DD	MM/DD	MM/DD			MM/DD	MM/DD	MM/DD	MM/DD	MM/DD		
Sampling time	hh:mm	hh:mm	hh:mm	hh:mm	hh:mm			hh:mm	hh:mm	hh:mm	hh:mm	hh:mm		
Rainfall (mm/day)														
Flow rate (m <sup>3</sup> /minute)														
Cs-134 (Approx. 2 years)														
Cs-137 (Approx. 30 years)														
Gross β														
H-3 (Approx. 12 years)														

Unit: Bq/L

	Drainage Channel K outlet						Drainage Channel C at 35m above the sea level							
Sampling date	MM/DD	MM/DD	MM/DD	MM/DD	MM/DD			MM/DD	MM/DD	MM/DD	MM/DD	MM/DD		
Sampling time	hh:mm	hh:mm	hh:mm	hh:mm	hh:mm			hh:mm	hh:mm	hh:mm	hh:mm	hh:mm		
Rainfall (mm/day)														
Flow rate (m <sup>3</sup> /minute)														
Cs-134 (Approx. 2 years)														
Cs-137 (Approx. 30 years)														
Gross β														
H-3 (Approx. 12 years)														

• The latest figures are in the cells surrounded by thick lines.

• "-" indicates non-sampling target.

• "ND (not detected)" indicates that the measurement results are below the detection limits, and the detection limit of each radioactive material is provided in parentheses.

\*The increase in values is presumed to have occurred because rainwater washed away surface soil, thereby carrying radioactive materials down to the drainage channel.

# Analysis results of drainage water at Fukushima Daiichi Nuclear Power Station

<Highest values up until the previous measurement>

Unit: Bq/L

	Drainage Channel A outlet	Drainage outlet at shallow draft quay	Drainage Channel K outlet	Drainage Channel C at 35m above the sea level
Cs-134 (Approx. 2 years)				
Cs-137 (Approx. 30 years)				
Gross-β				
H-3 (Approx. 12 years)				

Note: The numbers in square brackets indicate the sampling dates when the highest values were measured.