


Removal of the Guide Pipe (Used for PCV Inside Investigation) from Unit 2 PCV at Fukushima Daiichi Nuclear Power Station

< Reference >


April 26, 2013

Tokyo Electric Power Company


From April 24 to 26, 2013, the removal of the guide pipe (used for the inside investigation of the PCV) from Unit 2 PCV was performed. The guide pipe has been successfully removed. The investigation equipment will be improved while preparing for reinvestigation.

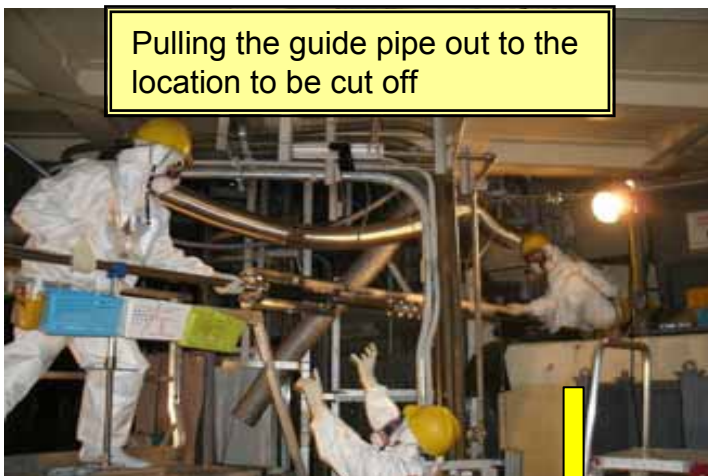

Pulling the guide pipe out to the location to be cut off

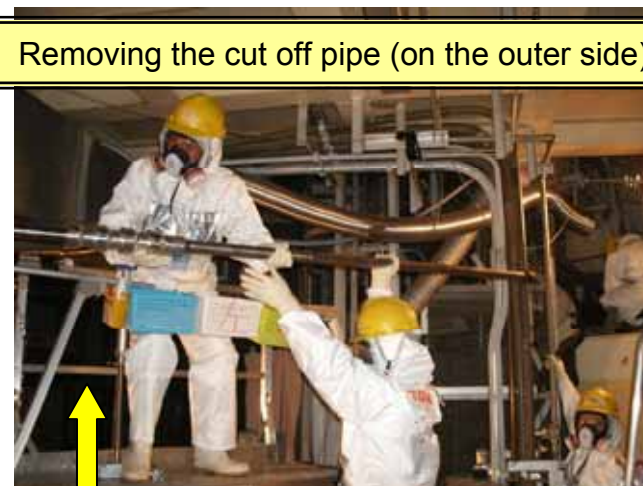

Removing the cut off pipe (on the outer side)

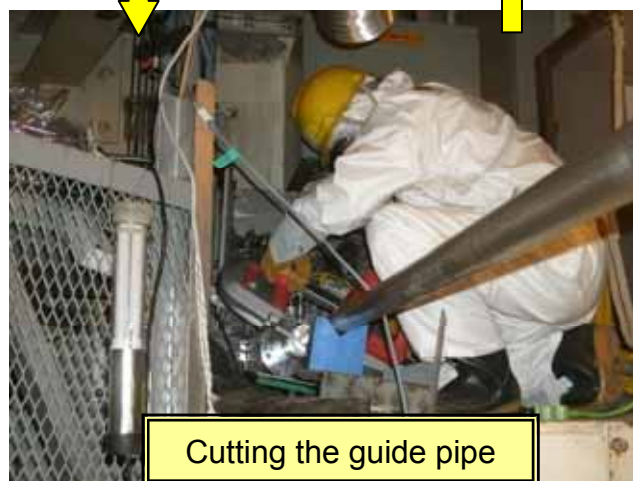

Cutting the guide pipe