


# Ambient Dose Measurement Around the Shield Plug on the Fifth Floor of Unit 3 at Fukushima Daiichi Nuclear Power Station

<Reference>  
July 24, 2013

Tokyo Electric Power Company

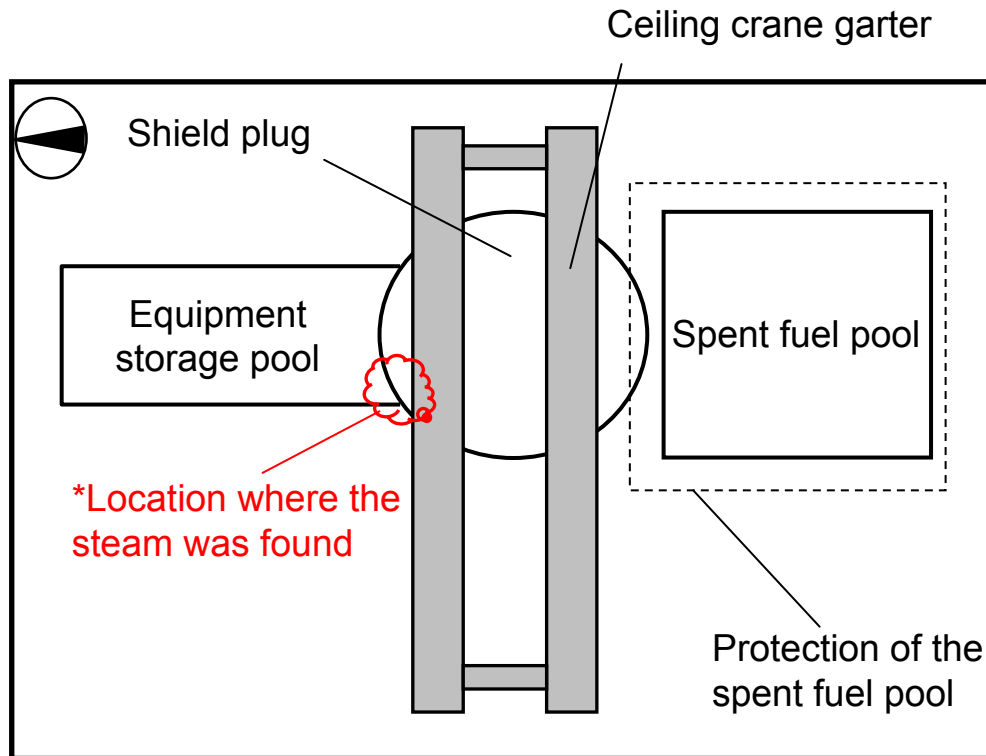


View of the fifth floor of the Reactor Building from above




Condition around the shield plug  
(Photo taken by TEPCO on July 23, 2013)

- Measurement point: Approx. 1m from the floor surface on the fifth floor
- Measurement time per 1 point: Approx. 30 seconds
- Measurement method:  
Transfer a dosimeter to the measurement point using a remote control large crane.  
The dosimeter will be collected after the ambient dose measurement, and data will be checked.

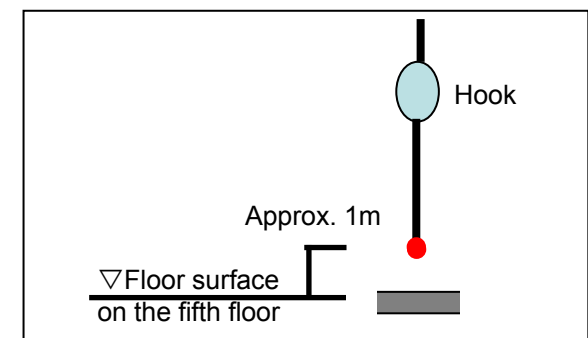

# <Reference> Measurement Results of Ambient Dose Around the Shield Plug

## ◆ Measurement position of ambient dose around the shield plug

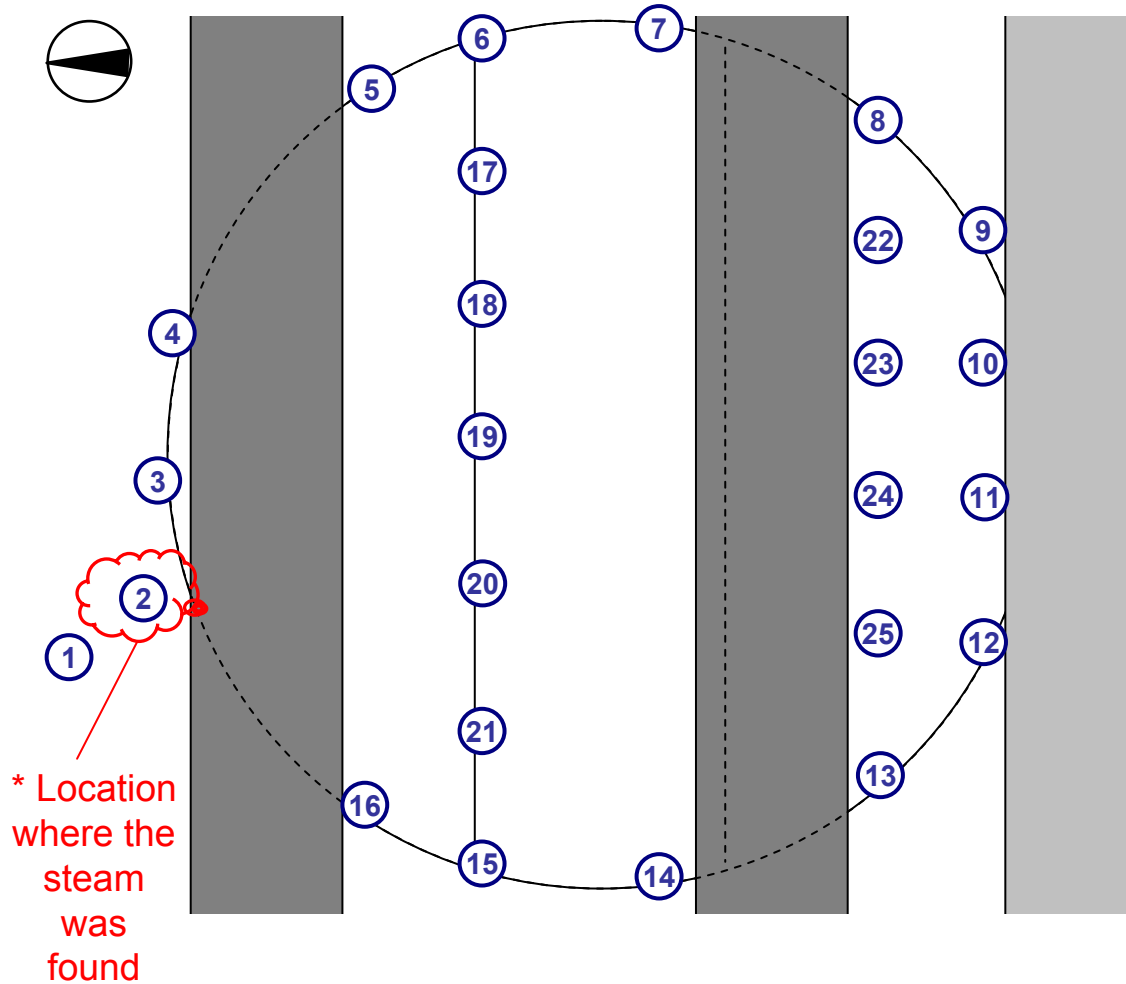

## ◆ Measurement results of ambient dose

Ambient dose (mSv/h)					
1	398	11	1040	21	1100
2	562	12	1090	22	534
3	413	13	382	23	287
4	679	14	731	24	925
5	685	15	301	25	774
6	528	16	657		
7	445	17	824		
8	137	18	1590		
9	352	19	2170		
10	522	20	1330		