

<Reference>

Condition of Radioactive Density of the Groundwater and the Seawater at the East Side of Turbine Buildings


September 6, 2013

Tokyo Electric Power Company




東京電力

Transition of the Groundwater Level (August 5 - September 5)

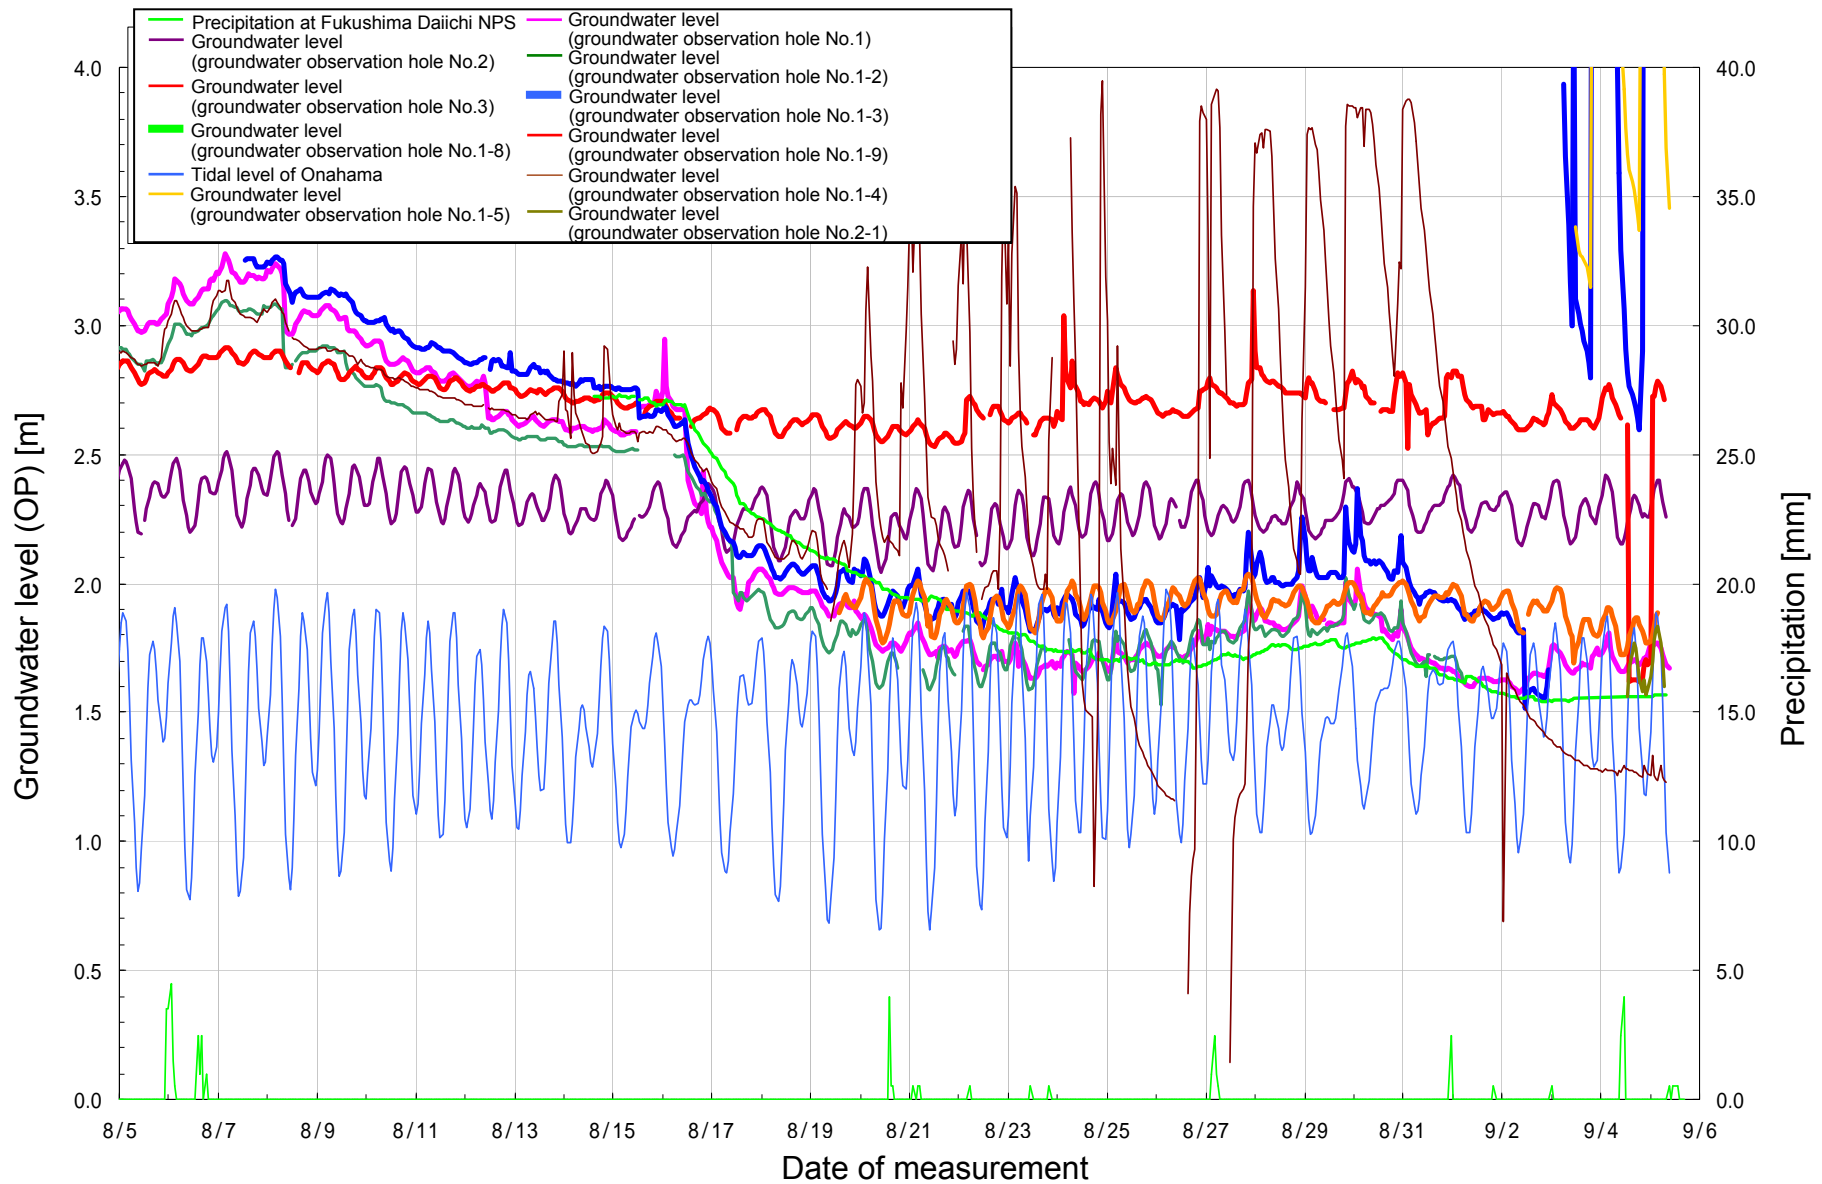


* Automatic measurement data measured by water gauge

Progress Status of Ground Improvement Construction between Unit 1 and 2 (As of the Morning on September 6)

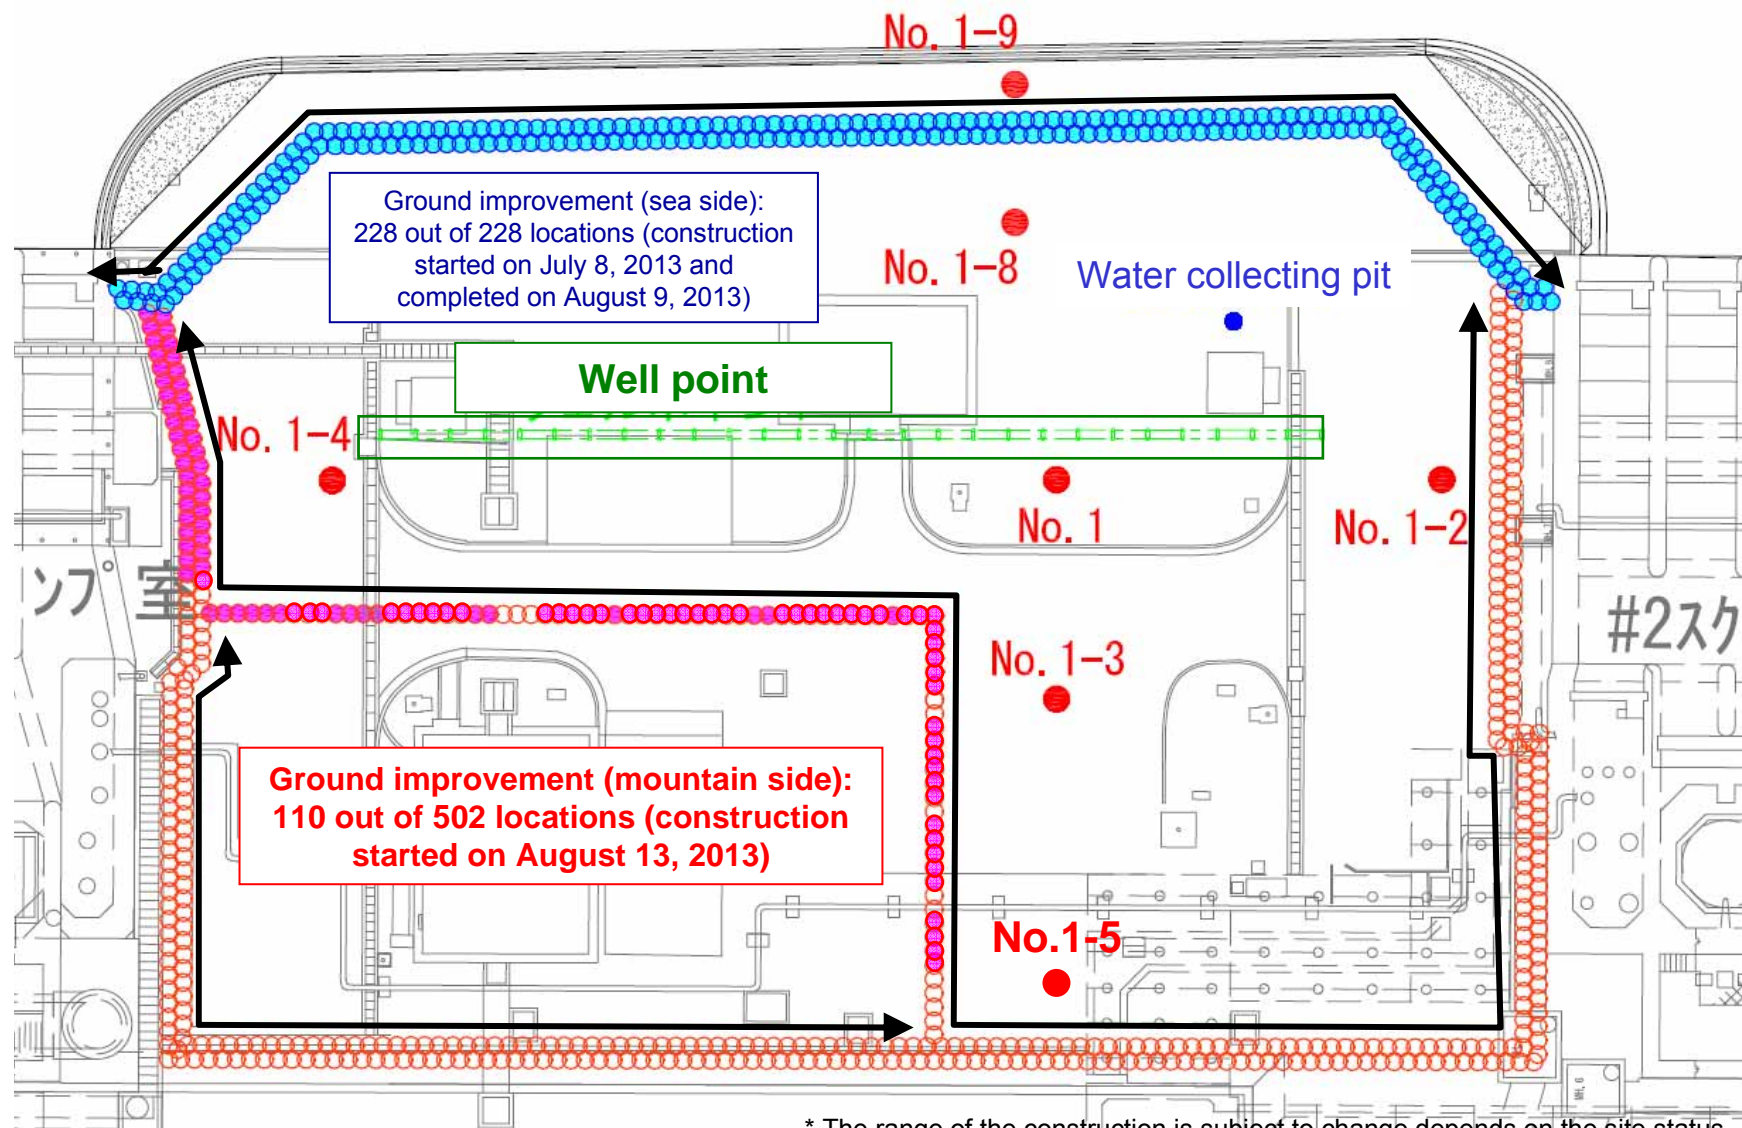

* The range of the construction is subject to change depends on the site status.


Progress Status of Ground Improvement Construction between Unit 2 and 3 (As of the Morning on September 6)

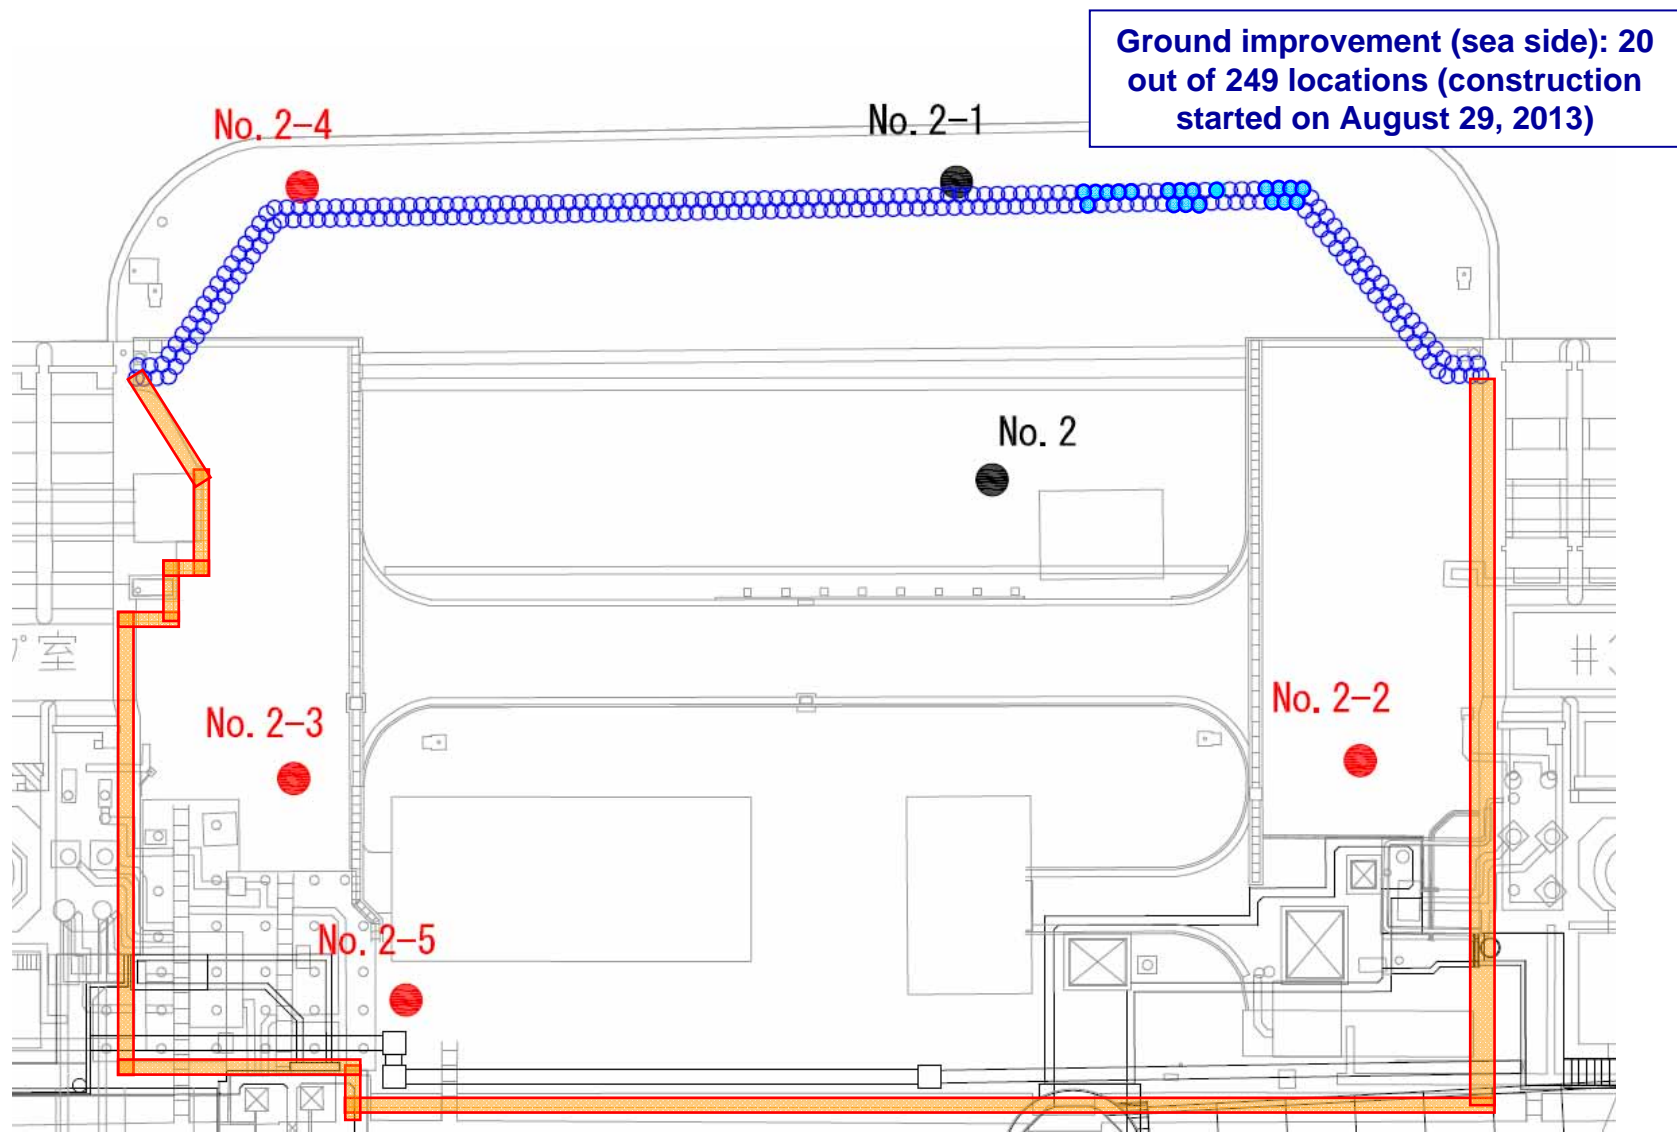

* The range of the construction is subject to change depends on the site status.

Progress Status of Ground Improvement Construction between Unit 3 and 4 (As of the Morning on September 6)

Ground improvement (sea side): 25
out of 132 locations (construction
started on August 23, 2013)

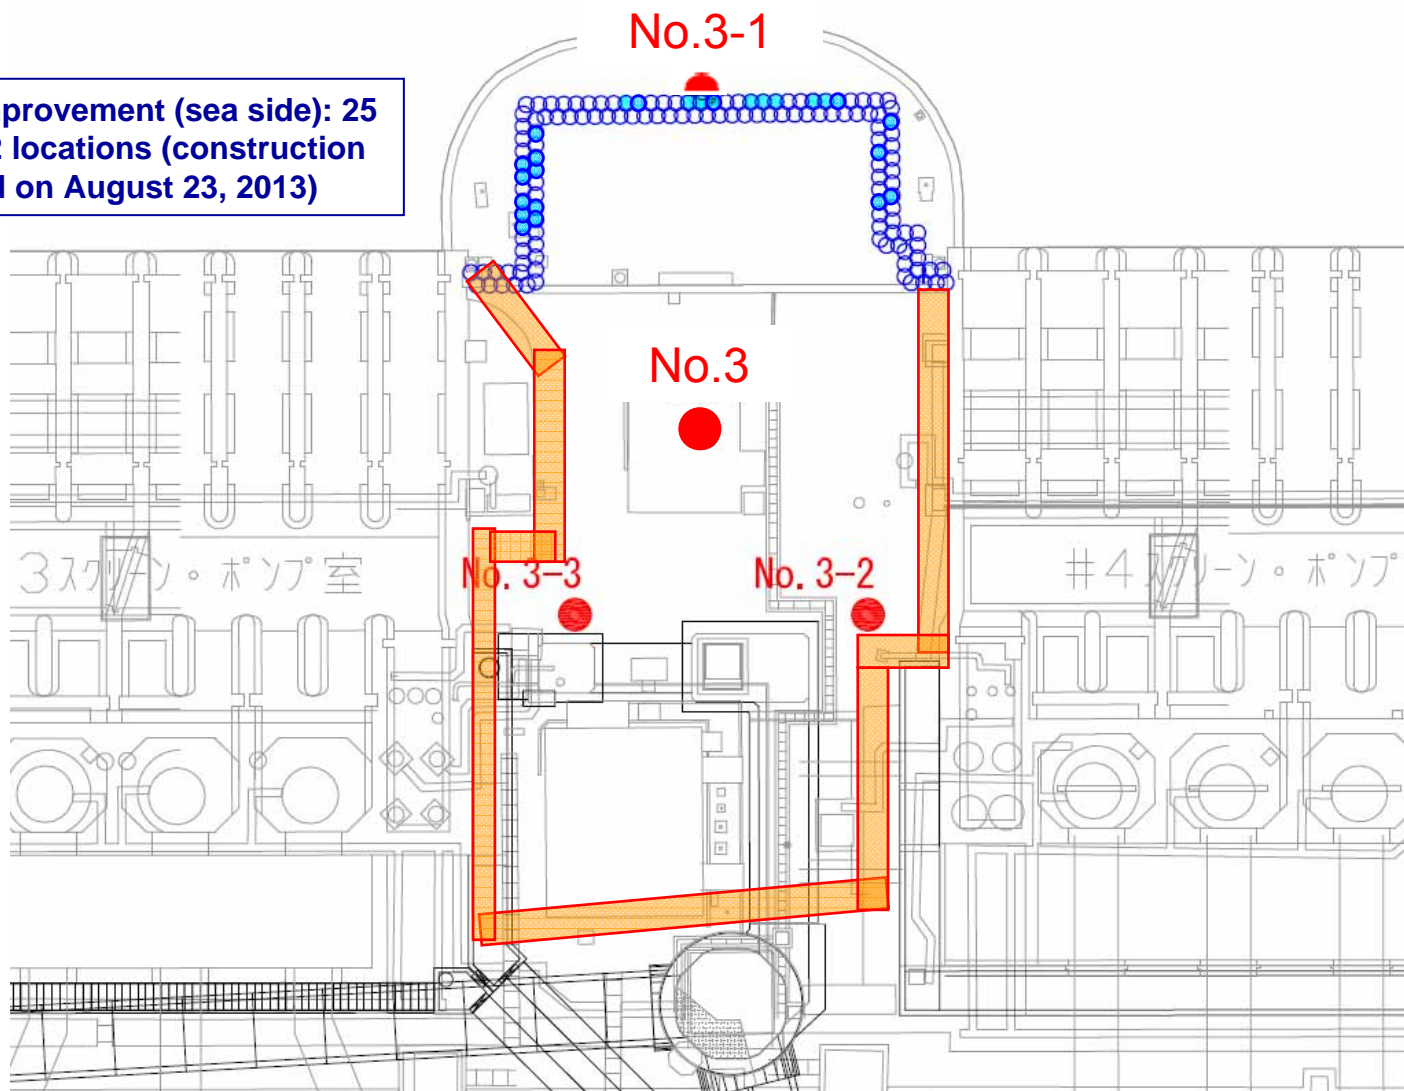

*1 The range of the construction is subject to change depends on the site status.

*2 Groundwater observation hole No.3-1 will be not in use due to the ground improvement construction.

Monitoring Plan (Sampling Locations)


- □ Monitoring of influence in the port
- △ □ Monitoring of groundwater density
- Monitoring of sub-drain (groundwater)

- □ Monitoring of influence on the sea
- □ Monitoring of distribution of radioactive density in the port

Item and frequency of measurement

ray	All	H-3	Sr-90
1/week	1/week	1/week	1/month

* Frequency of the measurement is subject to change as needed.

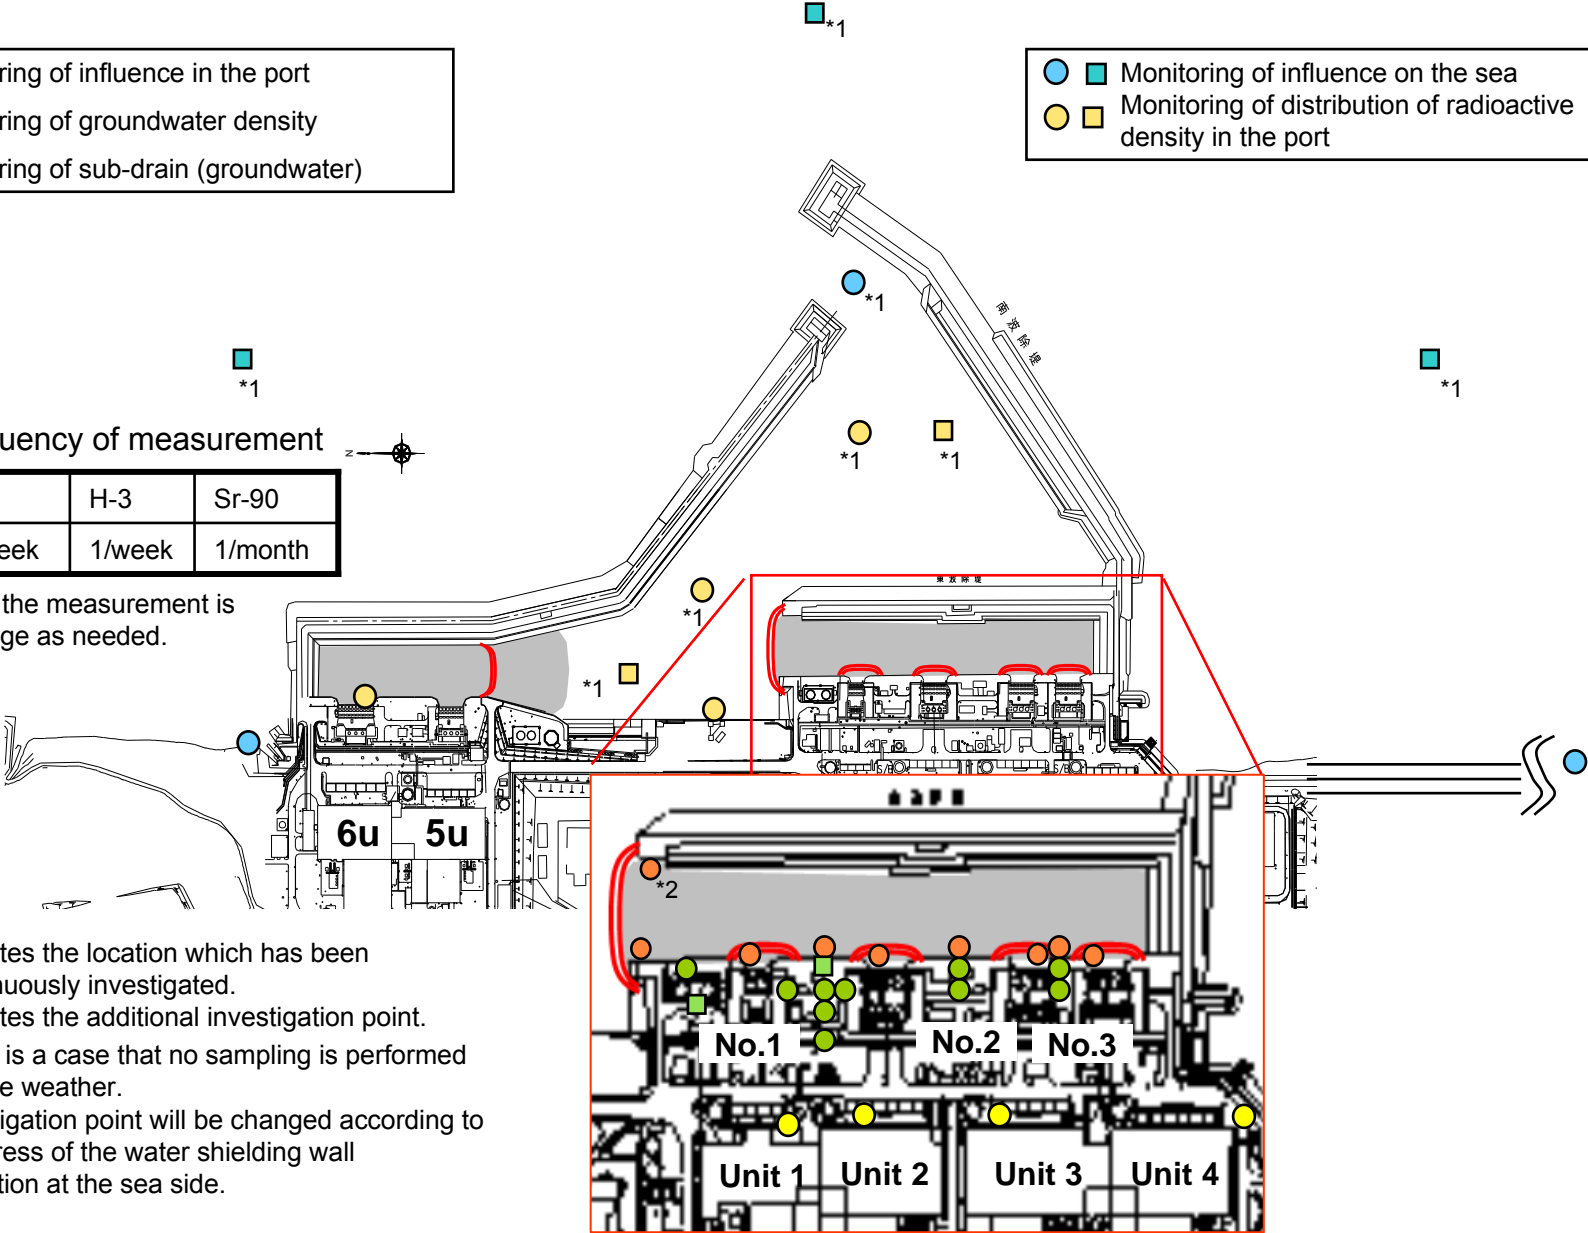


indicates the location which has been continuously investigated.
indicates the additional investigation point.

- *1 There is a case that no sampling is performed due to the weather.
- *2 Investigation point will be changed according to the progress of the water shielding wall construction at the sea side.


Density Transition of Tritium in the Groundwater

As of September 5, 2013

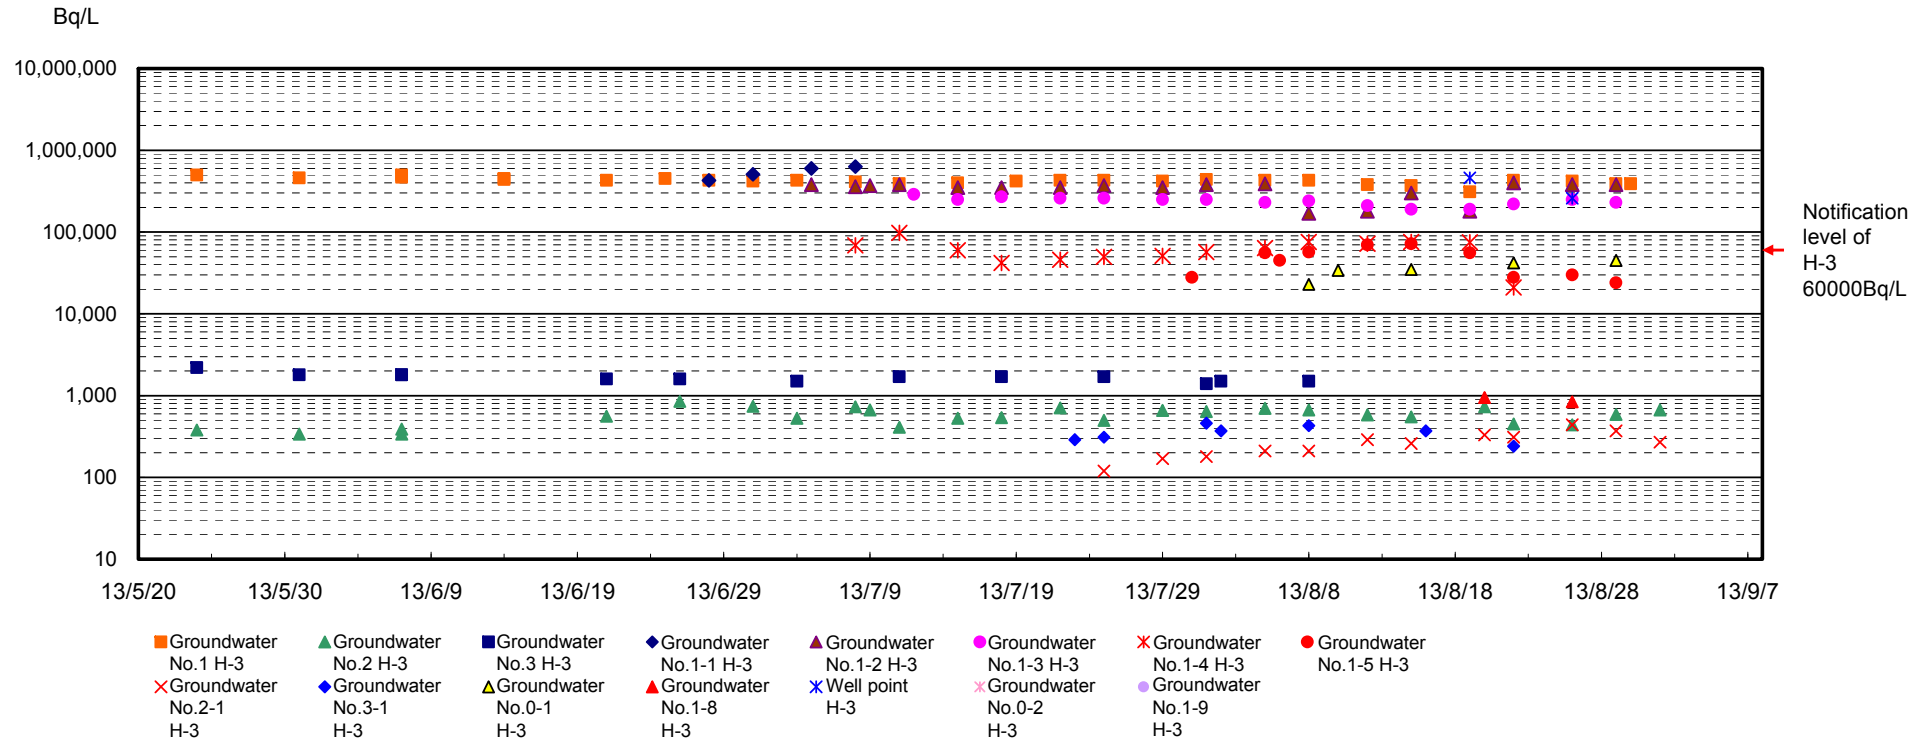


Density Transition of All and Strontium in the Groundwater

As of September 5, 2013

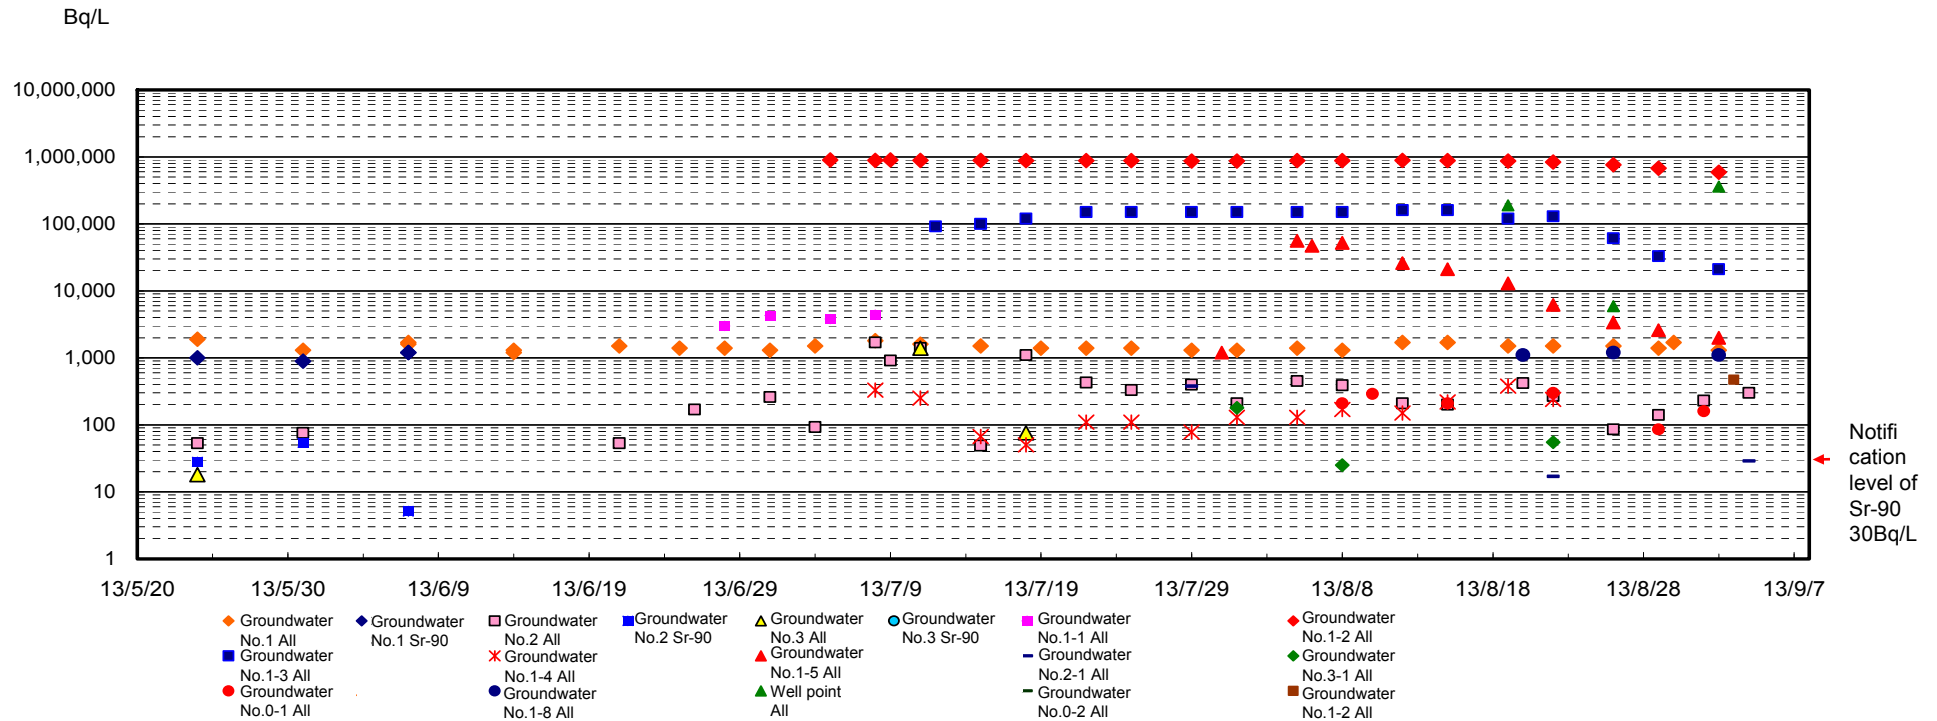


Density Transition in the Seawater Obtained at Water Intake Channel between Unit 1 and Unit 2

As of September 5, 2013

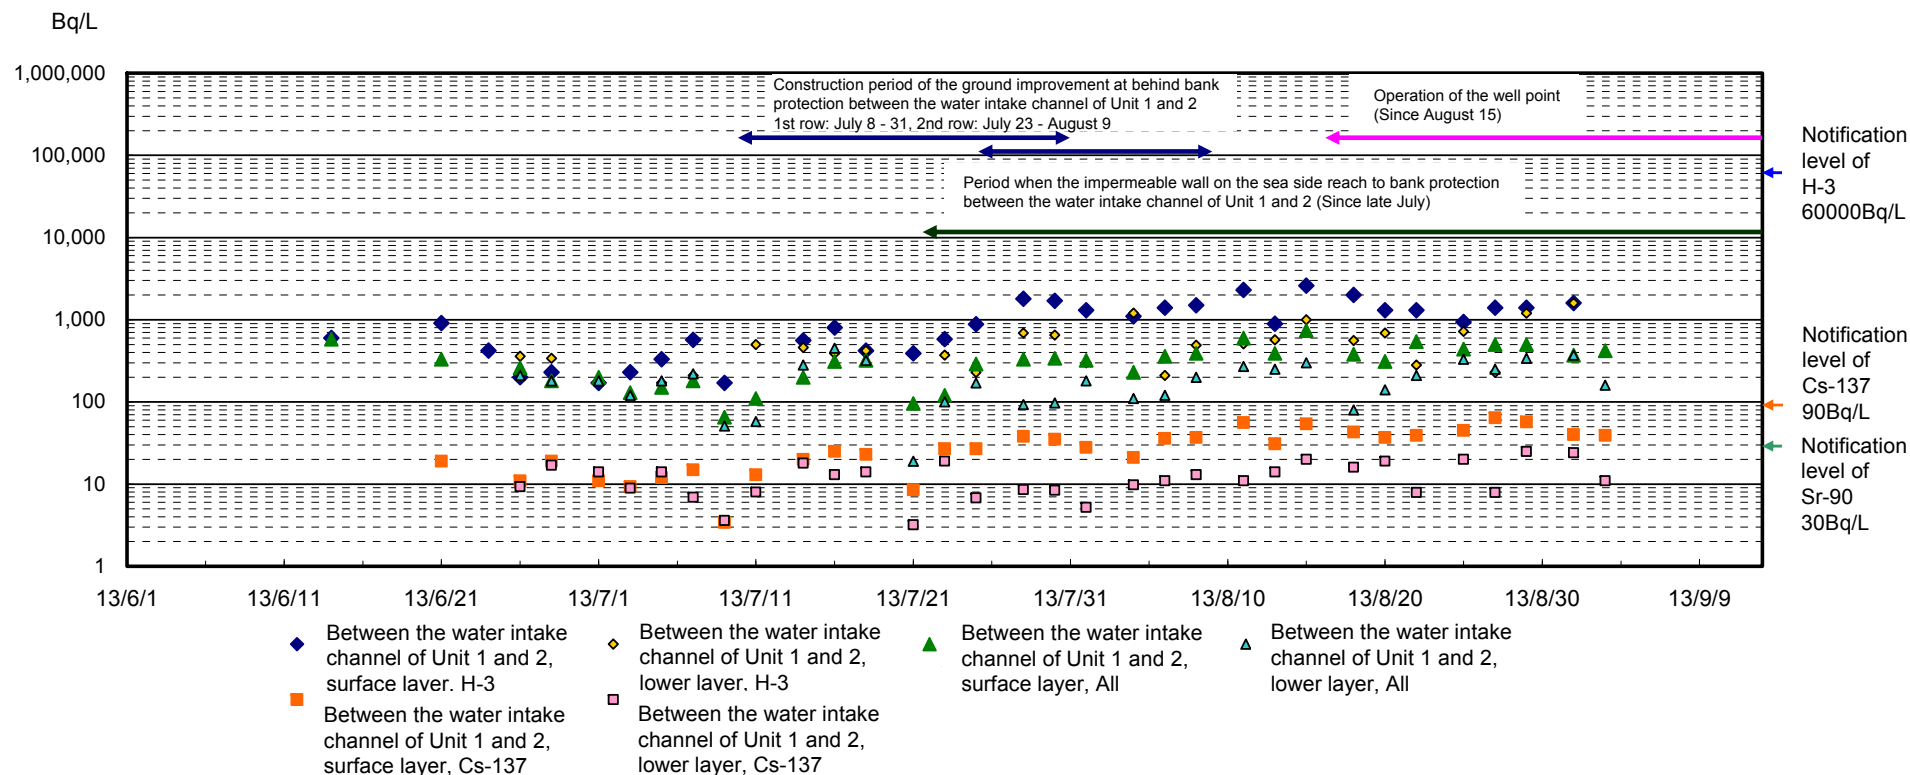

Density Transition in the Seawater Obtained at Unit 1-4 Water Intake Channel and the North Side of the East Seawall Break

As of September 5, 2013

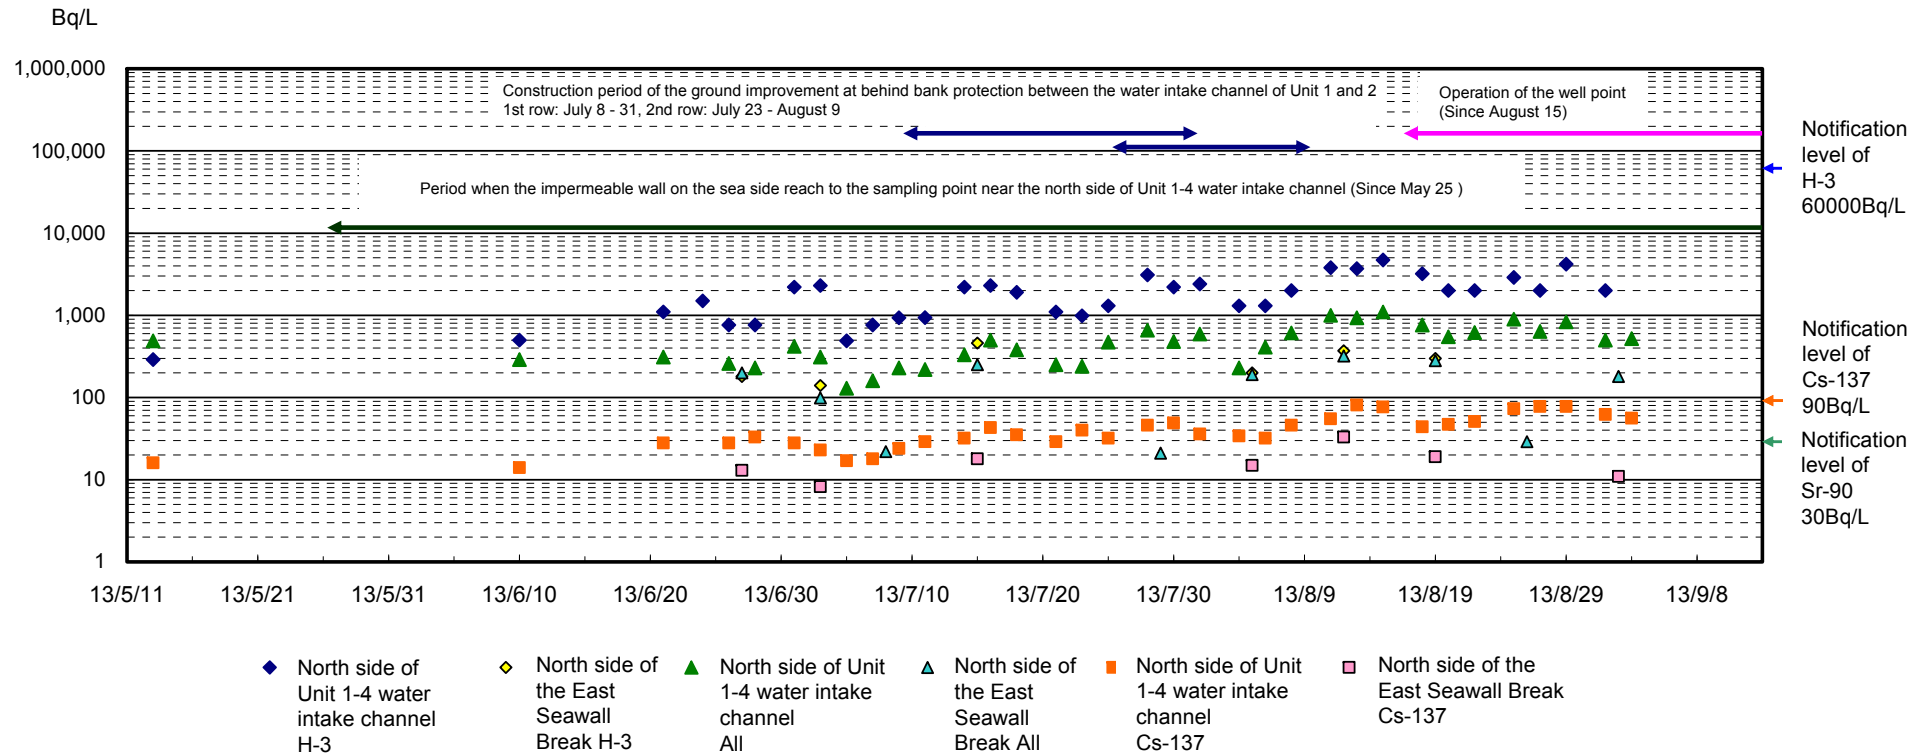

Groundwater observation hole No.0-1 (Bq/L)

Sampling date	2013/8/8	2013/8/8 (Remeasurement)	2013/8/10	2013/8/15	2013/8/22	2013/8/29	2013/9/1
Sampling time	2:15 PM	2:15 PM	9:35 AM	10:52 AM	9:41 AM	9:50 AM	11:03 AM
Cs-134	0.61		0.66	0.39	ND (0.42)	1.4	0.80
Cs-137	1.6		1.2	1.1	0.64	3.0	2.1
Ru-106	ND		ND	ND	ND	ND	ND
Mn-54	ND		ND	ND	ND	ND	ND
Co-60	ND		ND	ND	ND	ND	ND
Sb-125	ND		ND	ND	ND	ND	ND
All β	210		290	210	300	86	160
H-3	23,000	23,000	34,000	35,000	42,000	45,000	Under measurement
Sr-90	Under measurement		-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.0-2 (Bq/L)

Sampling date	2013/9/2
Sampling time	9:51 AM
Cs-134	ND (0.47)
Cs-137	0.75
Ru-106	ND
Mn-54	ND
Co-60	ND
Sb-125	ND
All β	ND (24)
H-3	ND (120)
Sr-90	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1 (Bq/L)

Sampling date	2012/12/8 ²	2013/5/24	2013/5/31	2013/6/7 (1)	2013/6/7 (2)	2013/6/14 (1)	2013/6/14 (2)	2013/6/21	2013/6/25	2013/6/28	2013/7/1
Sampling time	11:00 AM	4:19 PM	3:01 PM	3:45 PM	3:45 PM	2:29 PM	2:29 PM	9:01 AM	1:39 PM	5:50 PM	3:05 PM
Cs-134	ND (0.59)	ND (0.45)	0.53	ND (0.42)	ND (0.40)	ND (0.37)	ND (0.37)	ND (0.36)	ND (0.39)	ND (0.40)	1.1
Cs-137	ND (0.72)	ND (0.45)	0.57	ND (0.53)	0.49	ND (0.43)	0.51	0.53	ND (0.49)	ND (0.43)	1.5
Ru-106	ND	26	19	19	21	18	19	16	20	16	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	150	1,900	1,300	1,700	1,600	1,200	1,300	1,500	1,400	1,400	1,300
H-3	29,000	500,000	460,000	500,000	470,000	450,000	440,000	430,000	450,000	430,000	420,000
Sr-90	8.6	1,000	890	1,200	1,200	Under measurement	Under measurement	Under measurement	-	-	-

*1 "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

*2 As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Sampling date	2013/7/4	2013/7/8	2013/7/11	2013/7/15	2013/7/19	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8
Sampling time	11:50 AM	1:30 PM	12:51 PM	1:00 PM	8:02 AM	1:21 PM	1:15 PM	11:50 AM	11:55 AM	12:23 PM	11:29 AM
Cs-134	ND (0.64)	ND (0.50)	ND (0.61)	ND (0.43)	ND (0.48)	ND (0.42)	ND (0.42)	ND (0.46)	ND (0.44)	ND (0.52)	0.52
Cs-137	ND (0.47)	ND (0.47)	1.0	ND (0.49)	0.73	ND (0.45)	ND (0.55)	ND (0.51)	0.55	0.62	1.1
Ru-106	24	16	15	18	17	ND	12	17	14	17	15
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	0.50	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	1.7	ND	ND	ND	ND	ND	ND	ND	ND
All β	1,500	1,800	1,600	1,500	1,400	1,400	1,400	1,300	1,300	1,400	1,300
H-3	430,000	410,000	390,000	400,000	420,000	430,000	430,000	420,000	440,000	430,000	430,000
Sr-90	-	-	-	-	-	-	Under measurement	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/8/30	2013/9/2
Sampling time	10:46 AM	12:01 PM	10:21 AM	10:58 AM	10:36 AM	10:15 AM	11:25 AM	10:07 AM
Cs-134	ND (0.42)	ND (0.54)	3.2	ND (0.57)	ND (0.47)	13	0.98	1.5
Cs-137	0.50	ND (0.49)	4.3	0.66	0.84	31	2.1	3.5
Ru-106	12	11	14	7.9	14	17	17	11
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND
All β	1,700	1,700	1,500	1,500	1,500	1,400	1,700	1,300
H-3	380,000	370,000	310,000	430,000	420,000	390,000	390,000	Under measurement
Sr-90	-	-	-	Under measurement	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-1 (Bq/L)

Sampling date	2013/6/28	2013/7/1	2013/7/5	2013/7/8
Sampling time	4:40 PM	4:05 PM	11:00 AM	2:35 PM
Cs-134	ND (0.41)	ND (0.44)	ND (0.42)	1.9
Cs-137	ND (0.51)	0.98	0.55	3.6
Ru-106	-	7.8	7.7	7.9
Mn-54	0.52	0.92	1.0	0.78
Co-60	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND
All β	3,000	4,300	3,800	4,400
H-3	430,000	510,000	600,000	630,000
Sr-90	Under measurement	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-2 (Bq/L)

Sampling date	2013/7/5	2013/7/8	2013/7/8 (Filtration)	2013/7/9	2013/7/9 (Filtration)	2013/7/9 (Residue)	2013/7/11	2013/7/11 (Filtration)	2013/7/15	2013/7/15 (Filtration)
Sampling time	12:10 PM	2:00 PM	2:00 PM	1:00 PM	1:00 PM	1:00 PM	1:25 PM	1:25 PM	1:23 PM	1:23 PM
Cs-134	99	9,000	94	11,000	130	10,000	8,200	98	5,900	ND (21)
Cs-137	210	18,000	190	22,000	270	20,000	17,000	150	12,000	ND (21)
Ru-106	95	ND	/	ND	/	/	ND	/	ND	/
Mn-54	62	25	/	ND	/	/	ND	/	ND	/
Co-60	1.2	3.1	/	ND	/	/	ND	/	ND	/
Sb-125	35	ND	/	ND	/	/	ND	/	250	/
All β	900,000	890,000	920,000	900,000	890,000	/	890,000	/	890,000	/
H-3	380,000	360,000	/	370,000	/	/	380,000	/	350,000	/
Sr-90	Under measurement	-	/	-	/	/	-	/	-	/

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/18	2013/7/18 (Filtration)	2013/7/22	2013/7/22 (Filtration)	2013/7/25	2013/7/25 (Filtration)	2013/7/29	2013/7/29 (Filtration)	2013/8/1	2013/8/1 (Filtration)
Sampling time	1:23 PM	1:23 PM	1:47 PM	1:47 PM	2:00 PM	2:00 PM	12:10 PM	12:10 PM	12:25 PM	12:25 PM
Cs-134	5,400	ND (25)	3,500	50	2,600	ND (22)	1,300	ND (18)	760	ND (26)
Cs-137	11,000	ND (25)	7,300	71	5,400	25	2,700	ND (21)	1,600	45
Ru-106	ND	/	ND	/	ND	/	ND	/	ND	/
Mn-54	ND	/	ND	/	ND	/	ND	/	ND	/
Co-60	ND	/	ND	/	ND	/	ND	/	ND	/
Sb-125	ND	/	ND	/	ND	/	180	/	110	/
All β	880,000	/	880,000	/	880,000	/	870,000	/	870,000	/
H-3	350,000	/	350,000	/	370,000	/	350,000	/	380,000	/
Sr-90	-	/	-	/	-	/	-	/	-	/

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/5	2013/8/5 (Filtration)	2013/8/8	2013/8/8 (Filtration)	2013/8/12	2013/8/12 (Filtration)	2013/8/15	2013/8/15 (Filtration)	2013/8/19	2013/8/19 (Filtration)
Sampling time	12:46 PM	12:46 PM	1:38 PM	1:38 PM	12:27 PM	12:27 PM	1:35 PM	1:35 PM	12:06 PM	12:06 PM
Cs-134	350	ND (18)	200	19	180	ND (20)	150	ND (18)	880	53
Cs-137	750	ND (22)	400	29	400	ND (23)	360	38	1,900	97
Ru-106	ND	/	ND	/	ND	/	160	/	ND	/
Mn-54	ND	/	ND	/	ND	/	ND	/	ND	/
Co-60	ND	/	ND	/	ND	/	ND	/	ND	/
Sb-125	110	/	170	/	130	/	95	/	200	/
All β	880,000	/	880,000	/	890,000	/	880,000	/	870,000	/
H-3	390,000	/	170,000	/	180,000	/	300,000	/	180,000	/
Sr-90	-	/	Under measurement	/	-	/	-	/	-	/

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/22	2013/8/22 (Filtration)	2013/8/26	2013/8/26 (Filtration)	2013/8/29	2013/8/29 (Filtration)	2013/9/2	2013/9/2 (Filtration)
Sampling time	12:33 PM	12:33 PM	12:35 PM	12:35 PM	11:42 AM	11:42 AM	11:56 AM	11:56 AM
Cs-134	150	110	110	80	120	75	140	66
Cs-137	360	230	270	170	260	160	300	150
Ru-106	ND	/	ND	/	ND	/	ND	/
Mn-54	ND	/	ND	/	ND	/	ND	/
Co-60	ND	/	ND	/	ND	/	ND	/
Sb-125	ND	/	ND	/	ND	/	ND	/
All β	840,000	/	760,000	/	680,000	/	590,000	/
H-3	400,000	/	380,000	/	380,000	/	Under measurement	/
Sr-90	-	/	-	/	-	/	-	/

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-3 (Bq/L)

Sampling date	2013/7/12	2013/7/15	2013/7/18	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15
Sampling time	12:20 PM	1:20 PM	12:36 PM	12:33 PM	12:45 PM	11:26 AM	11:20 AM	11:18 AM	12:18 PM	11:20 AM	12:26 PM
Cs-134	ND (0.66)	ND (0.46)	ND (0.39)	ND (0.46)	ND (0.44)	ND (0.44)	ND (0.50)	ND (0.61)	ND (0.55)	ND (0.55)	ND (0.64)
Cs-137	1.4	ND (0.54)	0.53	ND (0.58)	ND (0.62)	ND (0.47)	0.75	ND (0.60)	1.0	ND (0.67)	ND (0.76)
Ru-106	16	14	15	17	11	16	15	11	17	12	11
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	1.4	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	92,000	100,000	120,000	150,000	150,000	150,000	150,000	150,000	150,000	160,000	160,000
H-3	290,000	250,000	270,000	260,000	260,000	250,000	250,000	230,000	240,000	210,000	190,000
Sr-90	Under measurement	-	-	-	-	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/9/2
Sampling time	10:54 AM	11:25 AM	11:18 AM	10:38 AM	10:37 AM
Cs-134	ND (0.56)	1.0	1.1	1.3	10
Cs-137	ND (0.65)	2.3	2.1	3.3	24
Ru-106	14	12	5.1	4.6	ND
Mn-54	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND
Sb-125	ND	ND	1.4	ND	ND
All β	120,000	130,000	61,000	33,000	21,000
H-3	190,000	220,000	250,000	230,000	Under measurement
Sr-90	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-4 (Bq/L)

Sampling date	2013/7/8	2013/7/11	2013/7/15	2013/7/18	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12
Sampling time	3:30 PM	12:25 PM	11:55 AM	12:03 PM	12:18 PM	12:00 PM	10:51 AM	10:43 AM	10:40 AM	11:00 AM	10:21 AM
Cs-134	1.5	0.91	ND (0.41)	0.67	ND (0.43)	0.49	0.48	0.50	ND (0.46)	0.55	ND (0.41)
Cs-137	3.6	2.0	0.67	1.0	1.1	0.88	1.1	1.4	0.65	1.2	1.3
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	3.1	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	330	250	67	50	110	110	78	130	130	170	150
H-3	69,000	98,000	60,000	42,000	46,000	50,000	51,000	57,000	64,000	76,000	72,000
Sr-90	Under measurement	-	-	-	-	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/15	2013/8/19	2013/8/22
Sampling time	11:30 AM	9:50 AM	10:20 AM
Cs-134	ND (0.47)	1.1	1.0
Cs-137	1.2	2.1	1.8
Ru-106	ND	ND	ND
Mn-54	ND	ND	ND
Co-60	ND	ND	ND
Sb-125	ND	ND	ND
All β	220	380	240
H-3	76,000	75,000	21,000
Sr-90	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-5 (Bq/L)

Sampling date	2013/7/31	2013/8/5	2013/8/6	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/9/2
Sampling time	1:05 PM	11:55 AM	10:38 AM	1:05 PM	12:00 PM	1:02 PM	11:40 AM	12:00 PM	12:00 PM	11:13 AM	11:16 AM
Cs-134	21	310	260	250	190	150	130	91	53	62	40
Cs-137	44	650	540	520	390	320	260	190	110	130	85
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	6.7	12	8.9	9.3	ND	ND	ND	ND	ND
All β	1,200	56,000	47,000	52,000	26,000	21,000	13,000	6,200	3,400	2,600	2,000
H-3	28,000	56,000	45,000	57,000	70,000	72,000	56,000	28,000	30,000	24,000	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	Under measurement	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-8 (Bq/L)

Sampling date	2013/8/20	2013/8/26	2013/9/2
Sampling time	9:40 AM	9:36 AM	9:37 AM
Cs-134	21	26	30
Cs-137	45	58	63
Ru-106	ND	ND	ND
Mn-54	ND	0.52	ND
Co-60	ND	ND	ND
Sb-125	ND	ND	ND
All β	1,100	1,200	1,100
H-3	950	840	Under measurement
Sr-90	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater pumped up from the well point (Bq/L)

Sampling date	2013/8/19	2013/8/26	2013/9/2
Sampling time	11:20 AM	10:30 AM	9:35 AM
Cs-134	1.5	1.0	ND (1.6)
Cs-137	3.4	2.1	ND (1.6)
Ru-106	17	9.7	25
Mn-54	ND	ND	ND
Co-60	ND	ND	ND
Sb-125	ND	ND	ND
All β	190,000	5,900	360,000
H-3	460,000	260,000	Under measurement
Sr-90	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-9 (Bq/L)

Sampling date	2013/9/3	2013/9/3 (Filtration)
Sampling time	10:20 AM	10:20 AM
Cs-134	170	66
Cs-137	380	120
Ru-106	ND	/
Mn-54	ND	/
Co-60	ND	/
Sb-125	ND	/
All β	470	/
H-3	Under measurement	/
Sr-90	Under measurement	/

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.2 (Bq/L)

Sampling date	2012/12/8 ²	2013/5/24	2013/5/31	2013/6/7 (1)	2013/6/7 (2)	2013/6/21	2013/6/26	2013/7/1	2013/7/4	2013/7/8	2013/7/9
Sampling time	11:00 AM	4:12 PM	3:16 PM	4:05 PM	4:05 PM	5:44 PM	2:30 PM	4:55 PM	1:05 PM	1:00 PM	12:25 PM
Cs-134	ND (0.61)	ND (0.37)	ND (0.41)	0.47	ND (0.37)	ND (0.32)	ND (0.40)	0.48	ND (0.39)	ND (0.49)	0.50
Cs-137	ND (0.81)	ND (0.41)	0.95	0.73	ND (0.48)	ND (0.37)	ND (0.48)	0.66	ND (0.46)	0.74	0.74
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	55	53	76	ND (18)	ND (18)	53	170	260	93	1,700	910
H-3	410	380	340	390	340	560	850	740	530	730	670
Sr-90	8.2	28	54	5.2	5.1	Under measurement	-	-	-	-	-

*1 "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

*2 As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Sampling date	2013/7/11	2013/7/15	2013/7/18	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15
Sampling time	11:30 AM	10:50 AM	11:22 AM	11:37 AM	11:04 AM	11:30 AM	12:05 PM	11:18 AM	11:36 AM	11:10 AM	11:32 AM
Cs-134	ND (0.47)	ND (0.37)	ND (0.36)	ND (0.44)	ND (0.39)	ND (0.40)	ND (0.35)	ND (0.42)	ND (0.39)	ND (0.38)	ND (0.46)
Cs-137	1.2	ND (0.44)	0.50	ND (0.53)	0.46	ND (0.47)	1.2	ND (0.53)	ND (0.49)	ND (0.48)	ND (0.53)
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	1,400	49	1,100	430	330	400	210	450	390	210	200
H-3	410	530	540	710	500	660	640	700	670	580	550
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/9/1	2013/9/4
Sampling time	9:57 AM	9:25 AM	10:15 AM	10:10 AM	10:00 AM	10:10 AM
Cs-134	ND (0.42)	ND (0.41)	ND (0.43)	ND (0.43)	ND (0.41)	ND (0.44)
Cs-137	0.68	0.74	0.66	ND (0.54)	ND (0.55)	0.53
Ru-106	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND
All β	420	270	86	140	230	300
H-3	730	450	440	590	670	Under measurement
Sr-90	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.2-1 (Bq/L)

Sampling date	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29
Sampling time	11:28 AM	10:53 AM	11:19 AM	10:40 AM	11:05 AM	10:34 AM	10:56 AM	9:18 AM	9:57 AM	9:45 AM	9:36 AM
Cs-134	ND (0.42)	ND (0.43)	0.44	ND (0.44)	ND (0.40)	ND (0.43)	ND (0.37)	ND (0.45)	ND (0.43)	ND (0.43)	ND (0.43)
Cs-137	0.69	1.0	0.95	0.55	0.69	0.48	ND (0.52)	ND (0.61)	ND (0.56)	ND (0.54)	1.1
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	ND (17)	380	ND (17)	ND (22)	ND (18)	ND (19)	ND (18)	ND (18)	17	ND (18)	ND (20)
H-3	120	170	180	210	210	290	260	330	310	440	370
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/1	2013/9/4
Sampling time	9:30 AM	9:40 AM
Cs-134	0.66	ND (0.40)
Cs-137	1	0.82
Ru-106	ND	ND
Mn-54	ND	ND
Co-60	ND	ND
Sb-125	ND	ND
All β	ND (19)	29
H-3	270	Under measurement
Sr-90	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.3 (Bq/L)

Sampling date	2012/12/12 ²	2013/5/24	2013/5/31	2013/6/7 (1)	2013/6/7 (2)	2013/6/21	2013/6/26	2013/7/4	2013/7/11	2013/7/18	2013/7/25
Sampling time	11:00 AM	4:52 PM	3:32 PM	3:58 PM	3:58 PM	5:01 PM	3:50 PM	2:00 PM	10:55 AM	10:45 AM	1:30 PM
Cs-134	ND (0.60)	0.87	1.6	0.9	0.5	1.7	0.96	1.5	1.9	1.2	3.5
Cs-137	ND (0.79)	1.4	2.7	2.0	1.6	2.9	2.9	2.8	4.8	3.1	3.9
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	41	18	ND (17)	ND (18)	ND (18)	ND (17)	ND (21)	ND (18)	1,400	76	ND (17)
H-3	3,200	2,200	1,800	1,800	1,800	1,600	1,600	1,500	1,700	1,700	1,700
Sr-90	8.3	ND (1.0)	0.25	ND (0.24)	ND (0.27)	Under measurement	-	-	-	-	-

*1 "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

*2 As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Sampling date	2013/8/1	2013/8/2	2013/8/8
Sampling time	12:59 PM	2:25 PM	2:19 PM
Cs-134	1.8	2.4	2.2
Cs-137	4.2	4.0	5.9
Ru-106	ND	ND	ND
Mn-54	ND	ND	ND
Co-60	ND	ND	ND
Sb-125	ND	ND	ND
All β	ND (17)	ND (18)	ND (18)
H-3	1,400	1,500	1,500
Sr-90	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.3-1 (Bq/L)

Sampling date	2013/7/23	2013/7/25	2013/8/1	2013/8/2	2013/8/8	2013/8/16	2013/8/22
Sampling time	11:10 AM	3:15 PM	1:38 PM	3:45 PM	3:04 PM	12:21 PM	11:55 AM
Cs-134	1.1	1.2	1.1	1.0	1.2	0.67	0.68
Cs-137	2.2	2.2	2.6	2.3	2.0	1.8	1.2
Ru-106	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND
All β	ND (19)	ND (18)	180	ND (18)	25	ND (20)	55
H-3	290	310	460	370	430	370	240
Sr-90	Under measurement	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of Unit 5,6 discharge channel (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26
Sampling time	7:25 AM	11:25 AM	6:55 AM	6:15 AM	6:05 AM	5:50 AM	5:55 AM	6:55 AM	6:30 AM	6:10 AM	6:00 AM
Cs-134	1.8	ND (1.9)	ND (1.2)	1.4	ND (1.2)	ND (1.3)	ND (0.92)	ND (1.4)	ND (0.93)	ND (1.4)	ND (1.2)
Cs-137	2.1	3.3	1.2	2.5	1.5	2.5	ND (1.4)	ND (1.5)	1.4	ND (1.5)	ND (1.7)
All β	-	ND (22)	ND (17)	ND (19)	ND (22)	ND (23)	ND (19)	ND (22)	ND (19)	ND (18)	ND (19)
H-3	-	8.6	4.9	3.7	5.5	ND (3.2)	ND (2.9)	3.7	4.7	5.4	8.3
Sr-90	-	5.8	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/2
Sampling time	6:00 AM
Cs-134	ND (1.1)
Cs-137	ND (1.4)
All β	ND (16)
H-3	Under measurement
Sr-90	-

※ NDの場合、括弧内は検出限界値を示す。

In front of Unit 6 water intake channel, seawater (Bq/L)

Sampling date	2013/6/25	2013/7/2	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2
Sampling time	7:15 AM	6:25 AM	6:30 AM	6:15 AM	5:50 AM	6:15 AM	6:10 AM	6:20 AM	6:30 AM	5:50 AM	5:50 AM
Cs-134	ND (3.3)	ND (1.7)	ND (2.2)	ND (1.6)	ND (1.4)	ND (2.4)	ND (2.0)	ND (2.4)	2.4	ND (2.0)	ND (3.2)
Cs-137	ND (2.1)	2.6	ND (1.9)	3.1	ND (1.3)	ND (2.3)	ND (2.7)	ND (2.5)	4.7	ND (2.5)	2.4
All β	ND (18)	20	ND (17)	ND (22)	ND (21)	ND (19)	ND (22)	ND (19)	46	ND (21)	ND (19)
H-3	6.0	8.2	ND (3.1)	11	ND (3.2)	ND (2.9)	4.1	8.8	24	5.9	Under measurement
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

In front of shallow draft quay, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2
Sampling time	6:06 AM	6:03 AM	5:31 AM	5:30 AM	5:25 AM	5:34 AM	6:00 AM	6:10 AM	5:53 AM	5:48 AM	5:49 AM
Cs-134	ND (1.8)	1.9	ND (1.8)	ND (2.3)	ND (1.9)	ND (1.7)	5.3	3.5	3.3	ND (2.0)	ND (1.9)
Cs-137	2.3	5.6	5.1	5.7	ND (2.2)	2.2	8.6	7.9	7.4	ND (2.2)	ND (2.5)
All β	ND (18)	40	19	35	ND (21)	ND (19)	31	25	28	28	ND (19)
H-3	340	ND (120)	ND (120)	ND (120)	ND (120)	ND (120)	ND (130)	ND (120)	ND (120)	ND (120)	Under measurement
Sr-90	7.4	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of Unit 1-4 water intake channel, seawater (Bq/L)

Sampling date	2013/1/14	2013/2/11	2013.3.11	2013/4/15	2013/5/13	2013/6/10	2013/6/21	2013/6/24	2013/6/26	2013/6/28	2013/7/1
Sampling time	7:00 AM	6:32 AM	6:27 AM	6:12 AM	5:59 AM	6:01 AM	6:18 AM	5:50 PM	6:13 AM	6:27 AM	6:26 AM
Cs-134	3.5	3.7	31	ND (2.5)	9.2	7.3	12	-	18	15	13
Cs-137	5.7	10	56	6.0	16	14	28	-	28	33	28
All β	170	260	230	140	490	290	310	-	260	230	420
H-3	110	170	120	110	290	500	1,100	1,500	760	760	2,200
Sr-90	-	-	-	-	-	-	Under measurement	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/3	2013/7/5	2013/7/7	2013/7/9	2013/7/11	2013/7/14	2013/7/16	2013/7/18	2013/7/21	2013/7/23	2013/7/25
Sampling time	6:08 AM	6:17 AM	6:11 AM	6:09 AM	6:46 AM	6:11 AM	6:08 AM	6:06 AM	5:51 AM	6:23 AM	6:11 AM
Cs-134	13	6.3	8.0	11	12	14	19	14	16	18	18
Cs-137	23	17	18	24	29	32	43	35	29	40	32
All β	310	130	160	230	220	330	500	380	250	240	470
H-3	2,300	490	760	930	940	2,200	2,300	1,900	1,100	990	1,300
Sr-90	-	-	-	-	-	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/28	2013/7/30	2013/8/1	2013/8/4	2013/8/6	2013/8/8	2013/8/11	2013/8/13	2013/8/15	2013/8/18	2013/8/20
Sampling time	6:13 AM	6:04 AM	6:23 AM	6:13 AM	6:05 AM	6:02 AM	6:04 AM	6:11 AM	6:15 AM	6:05 AM	6:33 AM
Cs-134	24	21	19	14	13	17	27	34	32	18	22
Cs-137	46	49	36	34	32	46	55	81	77	44	47
All β	660	480	590	230	410	610	1,000	930	1,100	760	550
H-3	3,100	2,200	2,400	1,300	1,300	2,000	3,800	3,700	4,700	3,200	2,000
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/22	2013/8/25	2013/8/27	2013/8/29	2013/9/1	2013/9/3
Sampling time	6:09 AM	5:58 AM	6:07 AM	6:13 AM	6:05 AM	6:03 AM
Cs-134	24	33	33	35	28	28
Cs-137	51	73	78	78	62	56
All β	620	900	640	830	500	520
H-3	2,000	2,900	2,000	4,200	2,000	Under measurement
Sr-90	Under measurement	-	-	-	-	-

※ NDの場合、括弧内は検出限界値を示す。

North side of Unit 1-4 water intake channel (north side of the east seawall break), seawater (Bq/L)

Sampling date	2013/6/27	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2
Sampling time	9:50 AM	6:50 AM	6:17 AM	6:12 AM	6:14 AM	6:15 AM	6:42 AM	6:58 AM	6:43 AM	6:28 AM	6:17 AM
Cs-134	6.1	3.3	ND (1.4)	7.7	ND (1.8)	ND (2.5)	7.9	16	8.0	ND (2.1)	4.8
Cs-137	13	8.2	ND (1.7)	18	ND (1.8)	ND (1.9)	15	33	19	ND (2.2)	11
All β	200	99	22	250	21	190	320	280	280	29	180
H-3	180	140	ND (120)	460	ND (120)	ND (120)	200	370	300	ND (120)	Under measurement
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 1 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26
Sampling time	6:23 AM	6:18 AM	6:13 AM	5:45 AM	5:43 AM	5:38 AM	5:44 AM	6:10 AM	6:20 AM	6:09 AM	5:58 AM
Cs-134	6.9	8.9	5.4	3.4	17	4.8	16	12	24	24	23
Cs-137	15	20	13	12	37	8.4	34	28	51	41	50
All β	160	170	140	89	320	79	330	260	700	540	530
H-3	480	530	420	180	1,300	320	1,500	1,200	2,500	1,800	1400
Sr-90	Under measurement	-	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/2
Sampling time	5:57 AM
Cs-134	24
Cs-137	50
All β	540
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 1 and Unit 2, seawater (Surface layer) (Bq/L)

Sampling date	2013/6/14	2013/6/21	2013/6/24	2013/6/26 Surface layer	2013/6/28 Surface layer	2013/7/1 Surface layer	2013/7/3 Surface layer	2013/7/5 Surface layer	2013/7/7 Surface layer	2013/7/9 Surface layer	2013/7/11 Surface layer
Sampling time	1:20 PM	11:00 AM	6:00 PM	4:55 PM	11:34 AM	6:04 AM	6:15 AM	6:25 AM	6:22 AM	6:18 AM	6:58 AM
Cs-134	-	9.4	-	6.2	8.5	4.9	5.3	5.6	6.8	ND (2.1)	5.6
Cs-137	-	19	-	11	19	11	9.3	12	15	3.4	13
All β	-	330	-	260	180	200	130	150	180	65	110
H-3	600	910	420	200	230	170	230	330	570	170	ND (120)
Sr-90	-	Under measurement	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/14 Surface layer	2013/7/16 Surface layer	2013/7/18 Surface layer	2013/7/21 Surface layer	2013/7/23 Surface layer	2013/7/25 Surface layer	2013/7/28 Surface layer	2013/7/30 Surface layer	2013/8/1 Surface layer	2013/8/4 Surface layer	2013/8/6 Surface layer
Sampling time	6:20 AM	6:16 AM	6:14 AM	5:59 AM	6:33 AM	6:26 AM	6:22 AM	6:13 AM	6:34 AM	6:25 AM	6:13 AM
Cs-134	7.9	11	9.5	3.3	15	14	15	17	13	11	19
Cs-137	20	25	23	8.5	27	27	38	35	28	21	36
All β	200	310	320	96	120	290	330	340	320	230	360
H-3	560	800	420	390	580	880	1,800	1,700	1,300	1,100	1,400
Sr-90	-	-	-	-	Under measurement	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/8 Surface layer	2013/8/11 Surface layer	2013/8/13 Surface layer	2013/8/15 Surface layer	2013/8/18 Surface layer	2013/8/20 Surface layer	2013/8/22 Surface layer	2013/8/25 Surface layer	2013/8/27 Surface layer	2013/8/29 Surface layer	2013/9/1 Surface layer
Sampling time	6:08 AM	6:15 AM	6:19 AM	6:27 AM	6:13 AM	6:41 AM	6:31 AM	6:12 AM	6:15 AM	6:25 AM	6:12 AM
Cs-134	18	27	15	25	21	16	20	17	26	26	23
Cs-137	37	56	31	54	43	37	39	45	64	57	40
All β	390	600	390	740	380	310	540	440	500	500	370
H-3	1,500	2,300	890	2,600	2,000	1,300	1,300	940	1400	1400	1600
Sr-90	-	-	-	-	-	-	Under measurement	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/3
Sampling time	6:11 AM
Cs-134	16
Cs-137	39
All β	420
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 1 and Unit 2, seawater (Lower layer) (Bq/L)

Sampling date	2013/6/26 Lower layer	2013/6/28 Lower layer	2013/7/1 Lower layer	2013/7/3 Lower layer	2013/7/5 Lower layer	2013/7/7 Lower layer	2013/7/9 Lower layer	2013/7/11 Lower layer	2013/7/14 Lower layer	2013/7/16 Lower layer	2013/7/18 Lower layer
Sampling time	4:55 PM	11:36 AM	6:04 AM	6:15 AM	6:25 AM	6:22 AM	6:18 AM	6:58 AM	6:20 AM	6:16 AM	6:14 AM
Cs-134	6.2	7.5	5.7	3.0	6.8	4.9	2.0	2.6	9.6	7.5	7.0
Cs-137	9.3	17	14	8.9	14	6.9	3.6	8.0	18	13	14
All β	210	180	180	120	180	220	51	58	180	450	320
H-3	360	340	ND (120)	ND (120)	170	210	ND (120)	500	460	390	420
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/21 Lower layer	2013/7/23 Lower layer	2013/7/25 Lower layer	2013/7/28 Lower layer	2013/7/30 Lower layer	2013/7/31 Lower layer	2013/8/4 Lower layer	2013/8/6 Lower layer	2013/8/8 Lower layer	2013/8/11 Lower layer	2013/8/13 Lower layer
Sampling time	5:59 AM	6:33 AM	6:26 AM	6:22 AM	6:13 AM	6:34 AM	6:25 AM	6:13 AM	6:08 AM	6:15 AM	6:19 AM
Cs-134	ND (1.6)	9.9	4.3	2.3	2.5	4.0	5.8	4.2	6.0	5.7	6.1
Cs-137	3.2	19	6.8	8.6	8.4	5.2	9.8	11	13	11	14
All β	19	100	170	93	97	180	110	120	200	270	250
H-3	ND (120)	370	230	690	650	300	1,200	210	490	510	570
Sr-90	-	Under measurement	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/15 Lower layer	2013/8/18 Lower layer	2013/8/20 Lower layer	2013/8/22 Lower layer	2013/8/25 Lower layer	2013/8/27 Lower layer	2013/8/29 Lower layer	2013/9/1 Lower layer	2013/9/3 Lower layer
Sampling time	6:27 AM	6:13 AM	6:41 AM	6:31 AM	6:12 AM	6:15 AM	6:25 AM	6:12 AM	6:11 AM
Cs-134	8.9	5.1	8.3	5.2	9.4	3.4	13	11	3.4
Cs-137	20	16	19	7.9	20	7.9	25	24	11
All β	300	80	140	210	330	250	340	370	160
H-3	1,000	560	690	280	720	230	1,200	1,600	Under measurement
Sr-90	-	-	-	Under measurement	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 2 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26
Sampling time	6:29 AM	6:24 AM	6:27 AM	5:51 AM	5:48 AM	5:45 AM	5:50 AM	6:15 AM	6:31 AM	6:17 AM	6:04 AM
Cs-134	7.1	11	16	ND (1.8)	14	ND (1.9)	6.8	11	20	26	12
Cs-137	14	23	34	5.1	27	ND (1.9)	18	24	42	52	35
All β	230	260	220	26	250	ND (21)	140	240	370	490	280
H-3	290	320	250	ND (120)	440	ND (120)	370	500	570	820	380
Sr-90	Under measurement	-	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/2
Sampling time	6:01 AM
Cs-134	15
Cs-137	36
All β	300
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 2 and Unit 3, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/20 Surface layer	2013/8/20 Lower layer
Sampling time	6:51 AM	6:30 AM	5:56 AM	5:53 AM	5:49 AM	5:54 AM	6:19 AM	6:37 AM	6:21 AM	10:55 AM	11:10 AM
Cs-134	8.8	6.0	4.6	9.3	ND (1.7)	8.4	15	21	12	5.2	3.5
Cs-137	18	14	15	18	ND (1.8)	23	34	37	30	14	9.8
All β	220	140	40	250	ND (21)	160	210	410	310	230	85
H-3	350	ND (120)	ND (120)	460	ND (120)	660	320	720	240	-	-
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/26	2013/9/2
Sampling time	6:08 AM	6:03 AM
Cs-134	8.2	10
Cs-137	24	24
All β	280	300
H-3	350	Under measurement
Sr-90	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 3 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/16	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19
Sampling time	6:33 AM	6:30 AM	6:36 AM	6:01 AM	5:59 AM	6:32 AM	11:13 AM	5:57 AM	6:25 AM	6:41 AM	6:28 AM
Cs-134	64	59	32	8.3	350	190	31	7.6	69	39	68
Cs-137	110	120	68	16	770	380	63	19	140	82	140
All β	270	310	230	72	1,000	610	120	96	290	340	270
H-3	220	190	ND (120)	ND (120)	ND (120)	-	ND (120)	200	240	380	160
Sr-90	Under measurement	-	-	-	-	-	Under measurement	-	-	-	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/26	2013/9/2
Sampling time	6:14 AM	6:06 AM
Cs-134	14	17
Cs-137	43	32
All β	300	220
H-3	260	Under measurement
Sr-90	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 3 and Unit 4, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/20 Surface layer	2013/8/20 Lower layer
Sampling time	6:47 AM	6:38 AM	6:06 AM	6:00 AM	6:02 AM	6:02 AM	6:29 AM	6:48 AM	6:32 AM	11:16 AM	11:25 AM
Cs-134	9.9	7.3	2.6	12	ND (2.0)	11	12	22	20	14	4.8
Cs-137	23	16	7.0	26	ND (2.0)	22	28	45	43	30	7.7
All β	230	130	18	260	ND (21)	120	210	390	160	180	57
H-3	250	ND (120)	ND (120)	430	ND (120)	280	280	650	270	-	-
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/26	2013/9/2
Sampling time	6:20 AM	6:08 AM
Cs-134	12	9.8
Cs-137	26	22
All β	320	250
H-3	310	Under measurement
Sr-90	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 4 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26
Sampling time	6:37 AM	6:35 AM	6:42 AM	6:04 AM	6:02 AM	11:16 AM	6:00 AM	6:28 AM	6:44 AM	6:37 AM	6:18 AM
Cs-134	31	34	17	46	43	12	30	27	30	20	13
Cs-137	70	65	36	93	89	26	64	58	62	49	34
All β	250	220	160	130	300	49	200	210	310	200	270
H-3	ND (210)	260	ND (120)	ND (120)	180	ND (120)	260	210	400	ND (120)	280
Sr-90	Under measurement	-	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/2
Sampling time	6:12 AM
Cs-134	16
Cs-137	28
All β	230
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Around the south discharge channel (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26
Sampling time	7:15 AM	11:15 AM	5:10 AM	5:15 AM	10:45 AM	5:15 AM	5:15 AM	5:20 AM	5:40 AM	5:20 AM	5:20 AM
Cs-134	ND (1.0)	ND (1.1)	ND (1.2)	ND (0.93)	ND (1.2)	ND (1.2)	ND (1.0)	ND (1.3)	ND (1.2)	ND (1.4)	ND (1.1)
Cs-137	2.0 (1.3)	ND (1.3)	ND (1.2)	ND (1.1)	3.0	ND (1.4)	ND (1.3)	ND (1.6)	ND (1.4)	ND (1.5)	ND (1.0)
All β	ND (19)	ND (22)	ND (18)	ND (18)	ND (21)	ND (20)	ND (21)	ND (18)	ND (19)	ND (18)	ND (19)
H-3	-	ND (2.9)	ND (3.0)	ND (3.1)	ND (2.9)	ND (3.2)	ND (2.9)	ND (3.1)	ND (2.9)	ND (3.0)	ND (1.7)
Sr-90	-	0.36	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/2
Sampling time	5:20 AM
Cs-134	ND (1.4)
Cs-137	ND (1.3)
All β	ND (21)
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Port entrance, seawater (Bq/L)

Sampling date	2013/6/20	2013/6/26	2013/7/4	2013/7/9	2013/7/17	2013/7/22	2013/7/31	2013/8/5	2013/8/12	2013/8/19	2013/8/28
Sampling time	1:18 PM	2:19 PM	3:19 PM	10:29 AM	12:20 PM	11:32 AM	7:38 AM	11:54 AM	9:14 AM	7:22 AM	7:21 AM
Cs-134	ND (1.3)	ND (1.9)	ND (1.7)	ND (2.0)	ND (2.2)	ND (1.9)	ND (2.1)	ND (1.9)	ND (1.4)	1.6	ND (2.0)
Cs-137	ND (1.2)	3.7	ND (2.0)	ND (2.6)	ND (2.0)	ND (2.0)	ND (1.9)	ND (2.4)	ND (1.5)	4.7	ND (1.6)
All β	15	31	ND (22)	ND (19)	ND (20)	ND (18)	ND (20)	ND (20)	ND (21)	69	ND (17)
H-3	5.0	29	ND (3.6)	4.2	4.8	ND (3.0)	ND (3.1)	3.8	ND (2.8)	68	4.0
Sr-90	3.5	-	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/3
Sampling time	7:52 AM
Cs-134	ND (1.2)
Cs-137	ND (1.0)
All β	ND (16)
H-3	Under measurement
Sr-90	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

East side in the port, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/4	2013/7/9	2013/7/17	2013/7/22	2013/7/31	2013/8/5	2013/8/12	2013/8/19	2013/8/28	2013/9/3
Sampling time	2:22 PM	10:32 AM	10:34 AM	2:40 PM	11:41 AM	7:43 AM	11:58 AM	9:20 AM	7:30 AM	7:28 AM	8:00 AM
Cs-134	ND (2.4)	ND (2.3)	ND (2.0)	ND (1.7)	ND (2.3)	ND (1.6)	ND (1.4)	ND (1.8)	2.9	ND (1.1)	ND (1.3)
Cs-137	ND (2.4)	3.3	ND (2.4)	ND (2.5)	ND (2.1)	ND (2.4)	ND (2.0)	ND (1.9)	6.6	1.9	ND (1.0)
All β	33	40	ND (19)	ND (20)	ND (18)	ND (20)	ND (20)	ND (18)	74	ND (17)	ND (16)
H-3	14	44	ND (2.9)	7.0	ND (3.0)	ND (3.1)	ND (3.1)	ND (2.8)	67	6.6	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

West side in the port, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/4	2013/7/9	2013/7/17	2013/7/22	2013/7/31	2013/8/5	2013/8/12	2013/8/19	2013/8/28	2013/9/3
Sampling time	2:25 PM	10:37 AM	10:38 AM	2:47 PM	11:50 AM	7:48 AM	12:02 PM	9:02 AM	7:33 AM	7:38 AM	8:49 AM
Cs-134	ND (2.5)	ND (2.2)	ND (2.0)	ND (2.2)	ND (2.2)	ND (1.5)	ND (1.8)	ND (2.0)	2.6	ND (1.1)	ND (1.3)
Cs-137	3.3	ND (2.6)	ND (1.9)	2.4	ND (2.2)	ND (2.4)	ND (1.9)	ND (2.3)	6.5	1.6	ND (1.2)
All β	43	60	ND (19)	ND (20)	ND (18)	ND (20)	ND (20)	ND (18)	57	ND (17)	ND (16)
H-3	26	37	4.7	20	ND (3.0)	6.3	4.2	4.8	59	5.3	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side in the port, seawater (Bq/L)

Sampling date	2013/8/12	2013/8/19	2013/8/28	2013/9/3
Sampling time	9:31 AM	7:36 AM	7:35 AM	8:53 AM
Cs-134	ND (1.8)	ND (2.0)	ND (2.1)	ND (1.1)
Cs-137	ND (2.1)	4.7	1.8	ND (1.1)
All β	ND (21)	69	ND (17)	ND (16)
H-3	6.5	52	7.3	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

South side in the port, seawater (Bq/L)

Sampling date	2013/8/12	2013/8/19	2013/8/28	2013/9/3
Sampling time	9:24 AM	7:27 AM	7:24 AM	7:57 AM
Cs-134	ND (2.0)	2.1	1.1	ND (1.5)
Cs-137	ND (2.3)	4.6	3.4	ND (1.3)
All β	ND (18)	79	ND (17)	ND (16)
H-3	3.4	60	3.2	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of the north breakwater (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3
Sampling time	8:17 AM	8:09 AM	8:14 AM	8:39 AM
Cs-134	ND (1.5)	ND (1.1)	ND (0.66)	ND (0.88)
Cs-137	ND (1.4)	ND (1.4)	ND (0.49)	ND (0.58)
All β	ND (18)	ND (20)	ND (17)	ND (16)
H-3	4.7	ND (2.9)	ND (2.0)	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

East side of the port entrance (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3
Sampling time	8:21 AM	8:16 AM	8:20 AM	8:39 AM
Cs-134	ND (1.1)	ND (1.0)	ND (0.84)	ND (0.63)
Cs-137	ND (1.1)	ND (1.3)	ND (0.69)	ND (0.69)
All β	ND (18)	ND (20)	ND (17)	ND (16)
H-3	ND (2.9)	ND (2.9)	ND (2.0)	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

South side of the south breakwater (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3
Sampling time	8:09 AM	8:01 AM	8:07 AM	8:31 AM
Cs-134	ND (1.5)	ND (1.0)	ND (0.69)	ND (0.43)
Cs-137	ND (1.1)	ND (1.4)	ND (0.68)	ND (0.66)
All β	ND (18)	ND (20)	ND (17)	ND (16)
H-3	ND (2.9)	ND (2.9)	ND (2.0)	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.