


### Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

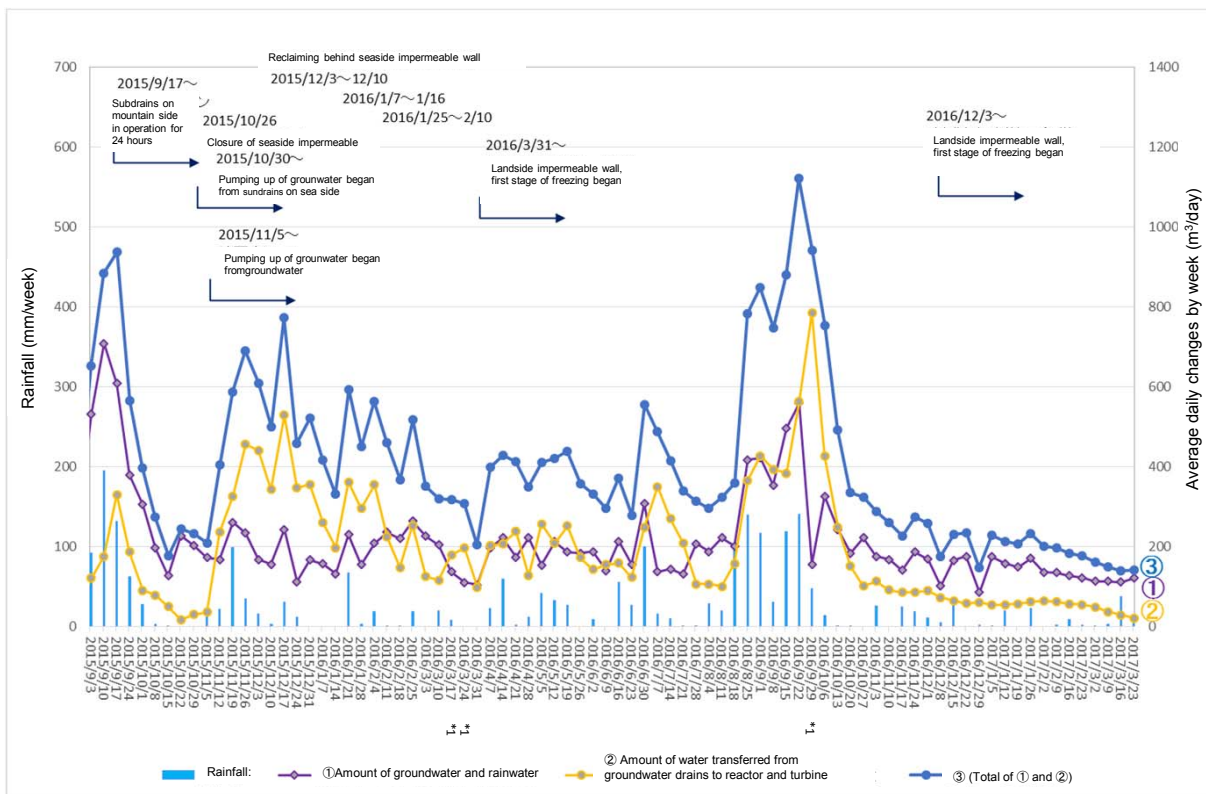

### Amount of water transferred from groundwater drains to reactor and turbine buildings (From March 16, 2017 to March 22, 2017/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
Mar.16	5	0	0	5	13	0	0	13	18
Mar.17	8	0	0	8	17	0	0	17	25
Mar.18	4	0	0	4	18	0	0	18	22
Mar.19	0	0	0	0	19	0	0	19	19
Mar.20	0	0	0	0	20	0	0	20	20
Mar.21	3	0	0	3	18	0	0	18	21
Mar.22	5	0	0	5	19	0	0	19	24

\*①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 121m<sup>3</sup>/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 21m<sup>3</sup>/day, ③(Total of ① and ②): 142m<sup>3</sup>/day, Rainfall: 12.0mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.