


Temperature of Reactor Water and Spent Fuel Pool, Unit 5 Fukushima Daiichi NPS

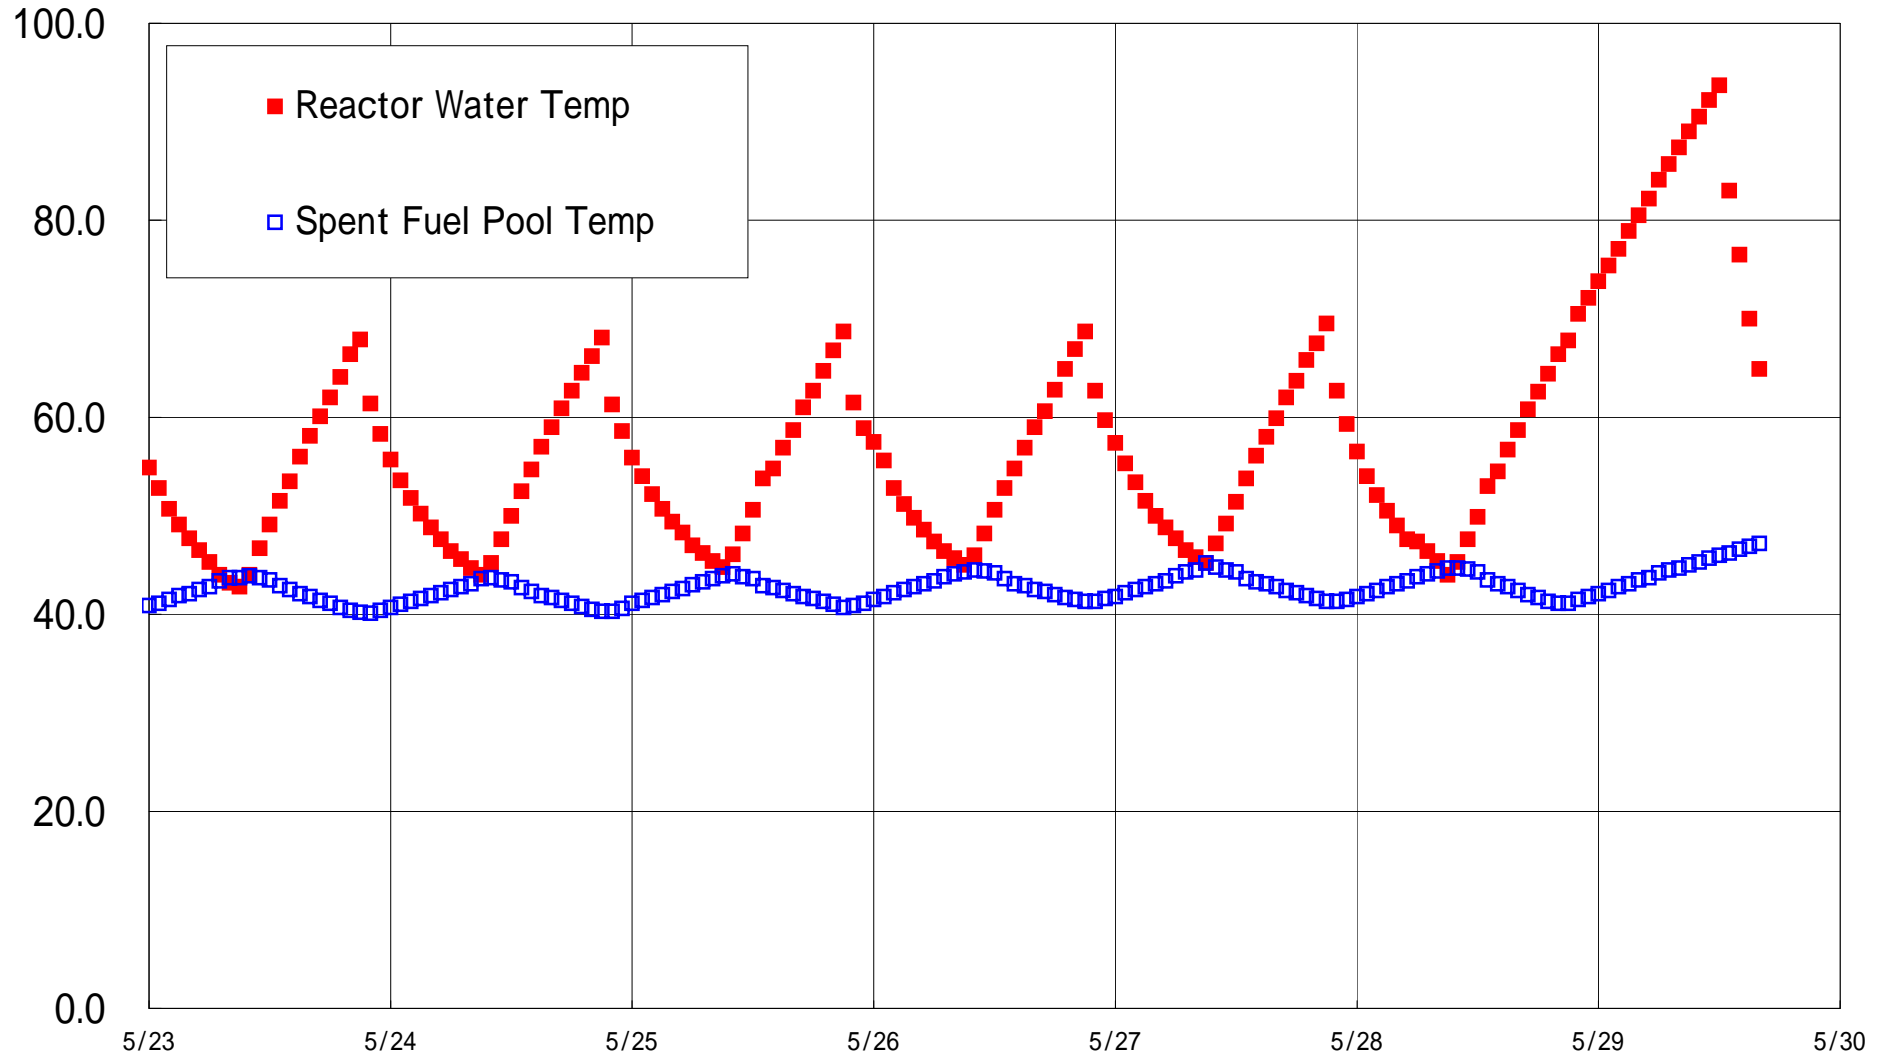


Temperature of Reactor Water and Spent Fuel Pool,
Unit 5 Fukushima Daiichi Nuclear Power Station

| | Reactor Water Temp | Spent Fuel Pool Temp |
|------------|--------------------|----------------------|
| 5/27 0:00 | 57.4 | 41.8 |
| 5/27 1:00 | 55.3 | 42.2 |
| 5/27 2:00 | 53.4 | 42.5 |
| 5/27 3:00 | 51.5 | 42.8 |
| 5/27 4:00 | 50.0 | 43.1 |
| 5/27 5:00 | 48.8 | 43.4 |
| 5/27 6:00 | 47.7 | 43.9 |
| 5/27 7:00 | 46.5 | 44.3 |
| 5/27 8:00 | 45.8 | 44.5 |
| 5/27 9:00 | 45.2 | 45.2 |
| 5/27 10:00 | 47.2 | 44.8 |
| 5/27 11:00 | 49.2 | 44.5 |
| 5/27 12:00 | 51.4 | 44.3 |
| 5/27 13:00 | 53.8 | 43.6 |
| 5/27 14:00 | 56.1 | 43.3 |
| 5/27 15:00 | 58.0 | 43.1 |
| 5/27 16:00 | 59.9 | 42.8 |
| 5/27 17:00 | 62.0 | 42.4 |
| 5/27 18:00 | 63.7 | 42.2 |
| 5/27 19:00 | 65.8 | 41.9 |
| 5/27 20:00 | 67.5 | 41.6 |
| 5/27 21:00 | 69.5 | 41.3 |
| 5/27 22:00 | 62.7 | 41.3 |
| 5/27 23:00 | 59.3 | 41.5 |
| 5/28 0:00 | 56.5 | 41.8 |
| 5/28 1:00 | 54.0 | 42.1 |
| 5/28 2:00 | 52.1 | 42.4 |
| 5/28 3:00 | 50.5 | 42.8 |
| 5/28 4:00 | 49.0 | 43.1 |
| 5/28 5:00 | 47.6 | 43.4 |
| 5/28 6:00 | 47.4 | 43.8 |
| 5/28 7:00 | 46.4 | 44.1 |
| 5/28 8:00 | 45.4 | 44.4 |
| 5/28 9:00 | 44.0 | 44.7 |
| 5/28 10:00 | 45.3 | 44.7 |
| 5/28 11:00 | 47.6 | 44.6 |
| 5/28 12:00 | 49.9 | 44.3 |
| 5/28 13:00 | 53.0 | 43.5 |
| 5/28 14:00 | 54.5 | 43.1 |
| 5/28 15:00 | 56.7 | 42.8 |
| 5/28 16:00 | 58.7 | 42.4 |
| 5/28 17:00 | 60.8 | 42.0 |
| 5/28 18:00 | 62.6 | 41.7 |
| 5/28 19:00 | 64.4 | 41.3 |
| 5/28 20:00 | 66.4 | 41.1 |
| 5/28 21:00 | 67.8 | 41.1 |
| 5/28 22:00 | 70.5 | 41.5 |
| 5/28 23:00 | 72.1 | 41.8 |
| 5/29 0:00 | 73.8 | 42.1 |
| 5/29 1:00 | 75.4 | 42.4 |
| 5/29 2:00 | 77.1 | 42.8 |
| 5/29 3:00 | 78.9 | 43.1 |
| 5/29 4:00 | 80.5 | 43.5 |
| 5/29 5:00 | 82.2 | 43.7 |
| 5/29 6:00 | 84.1 | 44.2 |
| 5/29 7:00 | 85.7 | 44.5 |
| 5/29 8:00 | 87.4 | 44.7 |
| 5/29 9:00 | 89.0 | 45.0 |
| 5/29 10:00 | 90.5 | 45.3 |
| 5/29 11:00 | 92.2 | 45.7 |
| 5/29 12:00 | 93.7 | 46.0 |
| 5/29 13:00 | 83.0 | 46.2 |
| 5/29 14:00 | 76.5 | 46.6 |
| 5/29 15:00 | 70.0 | 46.9 |
| 5/29 16:00 | 64.9 | 47.2 |

Layout, Temporary RHRPumps for Unit 5

May 29, 2011

The Tokyo Electric Power Company

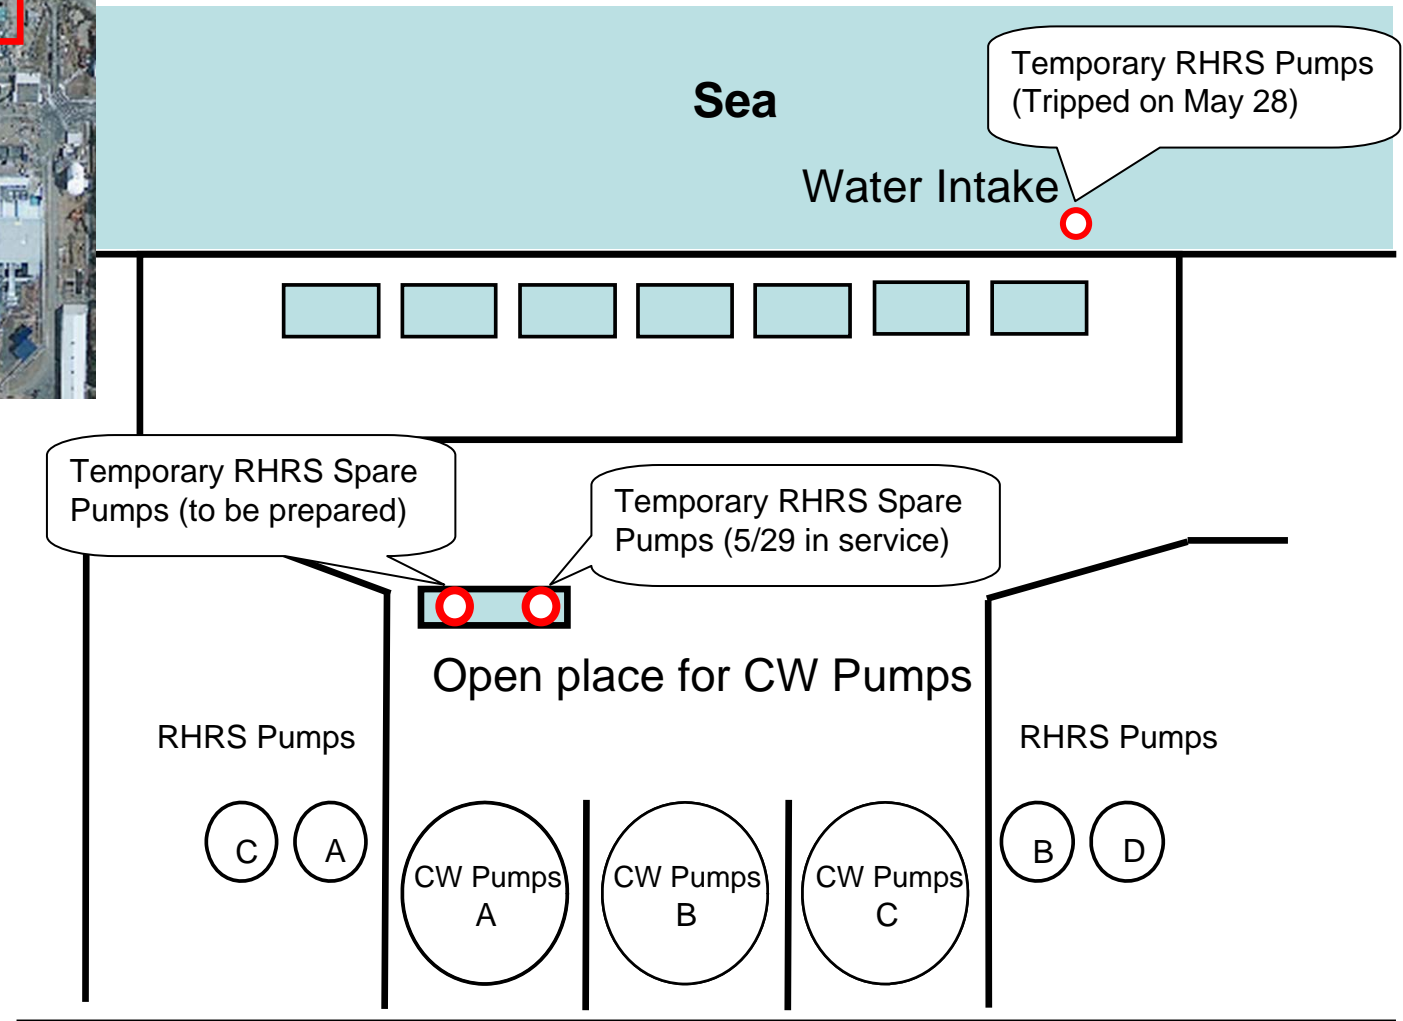

RHRPumps : Residual Heat Removal System Sea Water Pumps
CW Pumps : Circulating Water Pumps