


Installation of the temporary differential pressure gauge at Fukushima Daiichi Nuclear Power Station Unit 2

June 22, 2011
Tokyo Electric Power Company

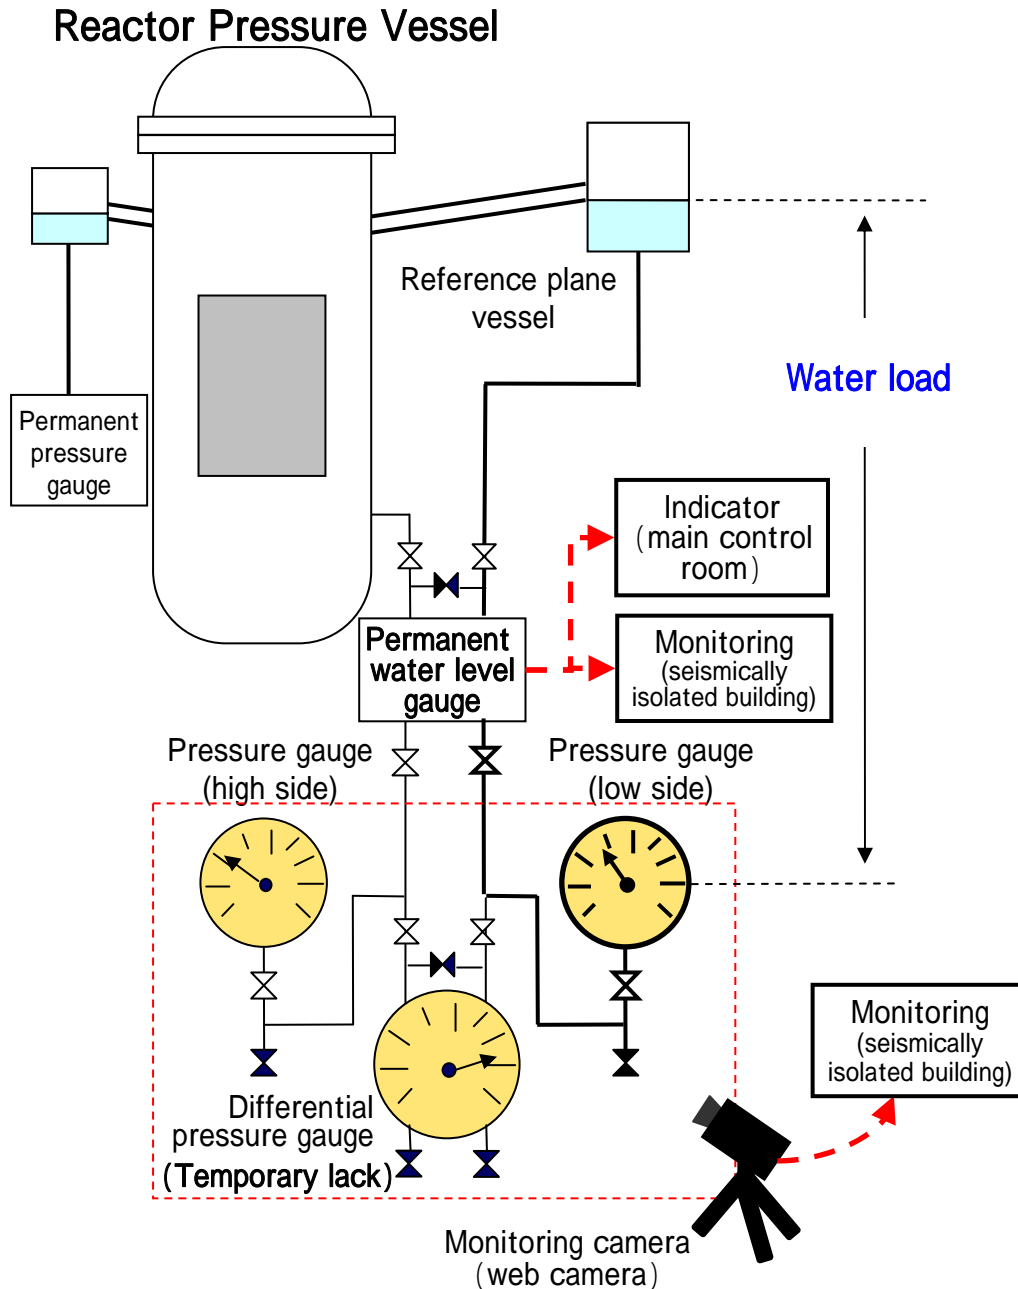

Install a temporary lack (differential pressure gauge and pressure gauge in the dotted line) to the permanent pressure gauge and fill water. Monitoring and confirmation of the indicated value of the differential pressure gauge and the pressure gauge will be implemented afterwards.